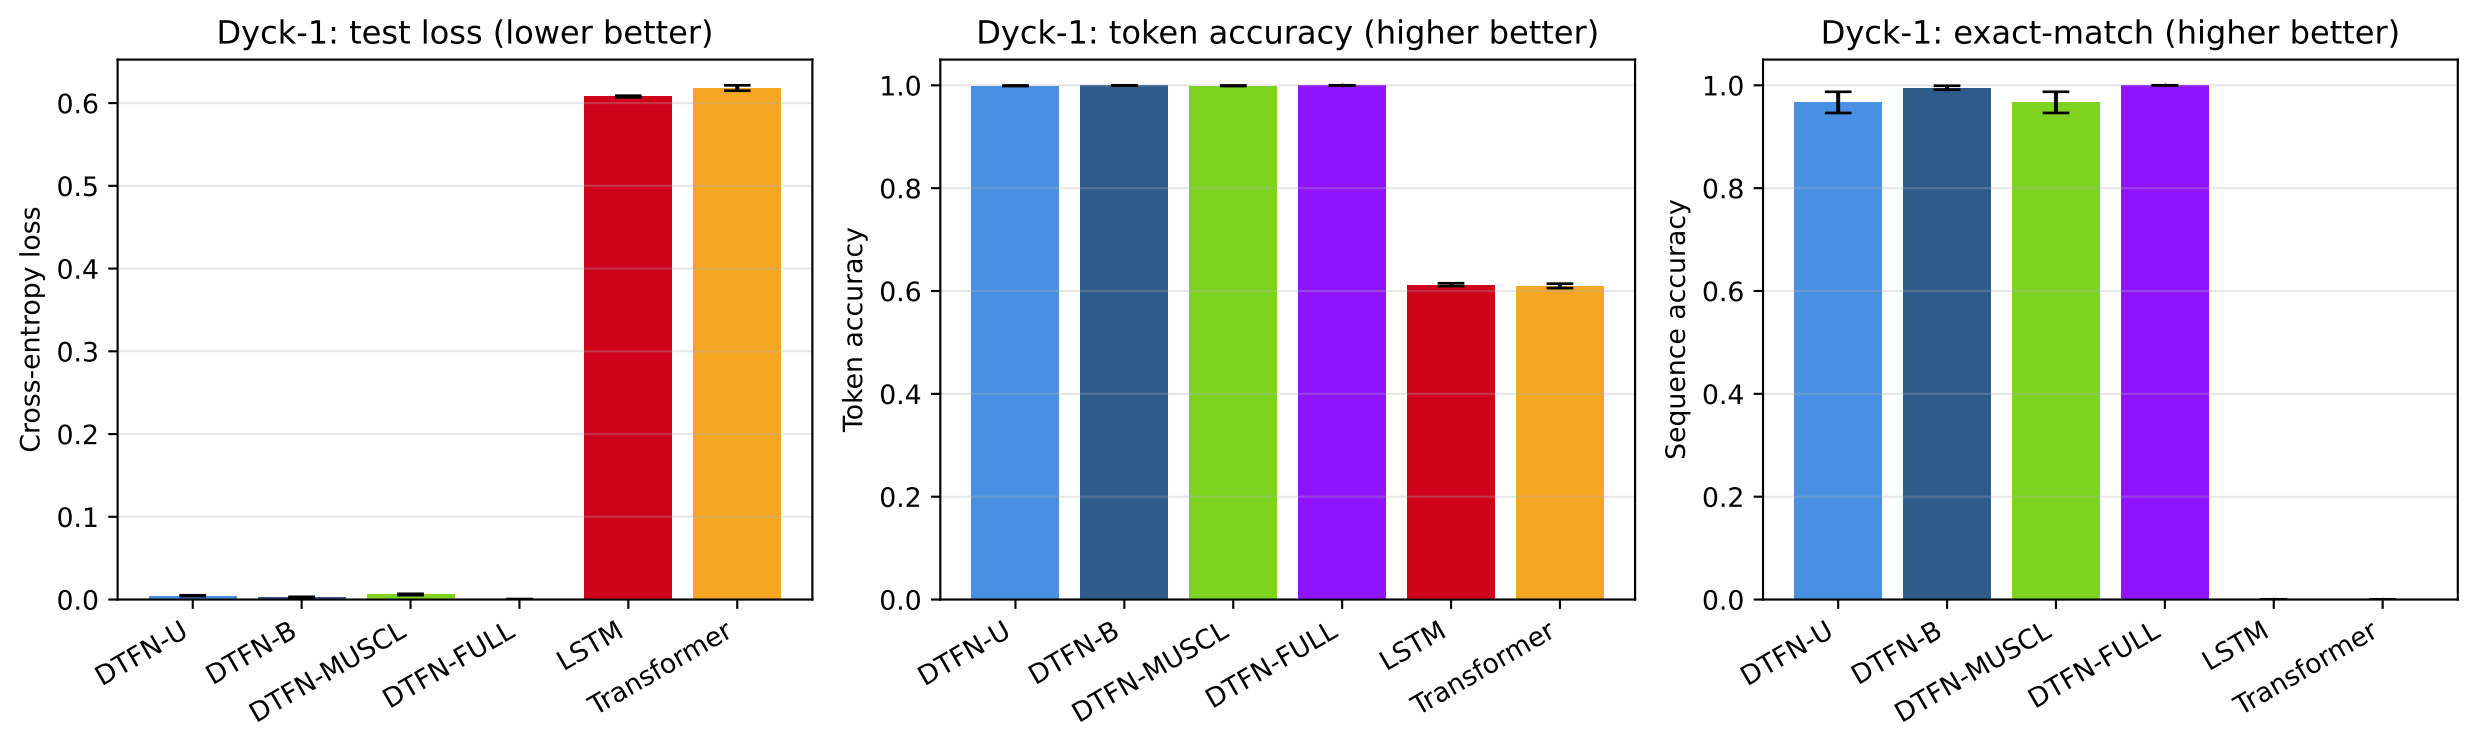
Dyck-1: test loss (lower better)
Cross-entropy loss
0.0
0.1
0.2
0.3
0.4
0.5
0.6
DTFN-U
DTFN-B
DTFN-MUSCL
DTFN-FULL
LSTM
Transformer
Dyck-1: token accuracy (higher better)
Token accuracy
0.0
0.2
0.4
0.6
0.8
1.0
DTFN-U
DTFN-B
DTFN-MUSCL
DTFN-FULL
LSTM
Transformer
Dyck-1: exact-match (higher better)
Sequence accuracy
0.0
0.2
0.4
0.6
0.8
1.0
DTFN-U
DTFN-B
DTFN-MUSCL
DTFN-FULL
LSTM
Transformer