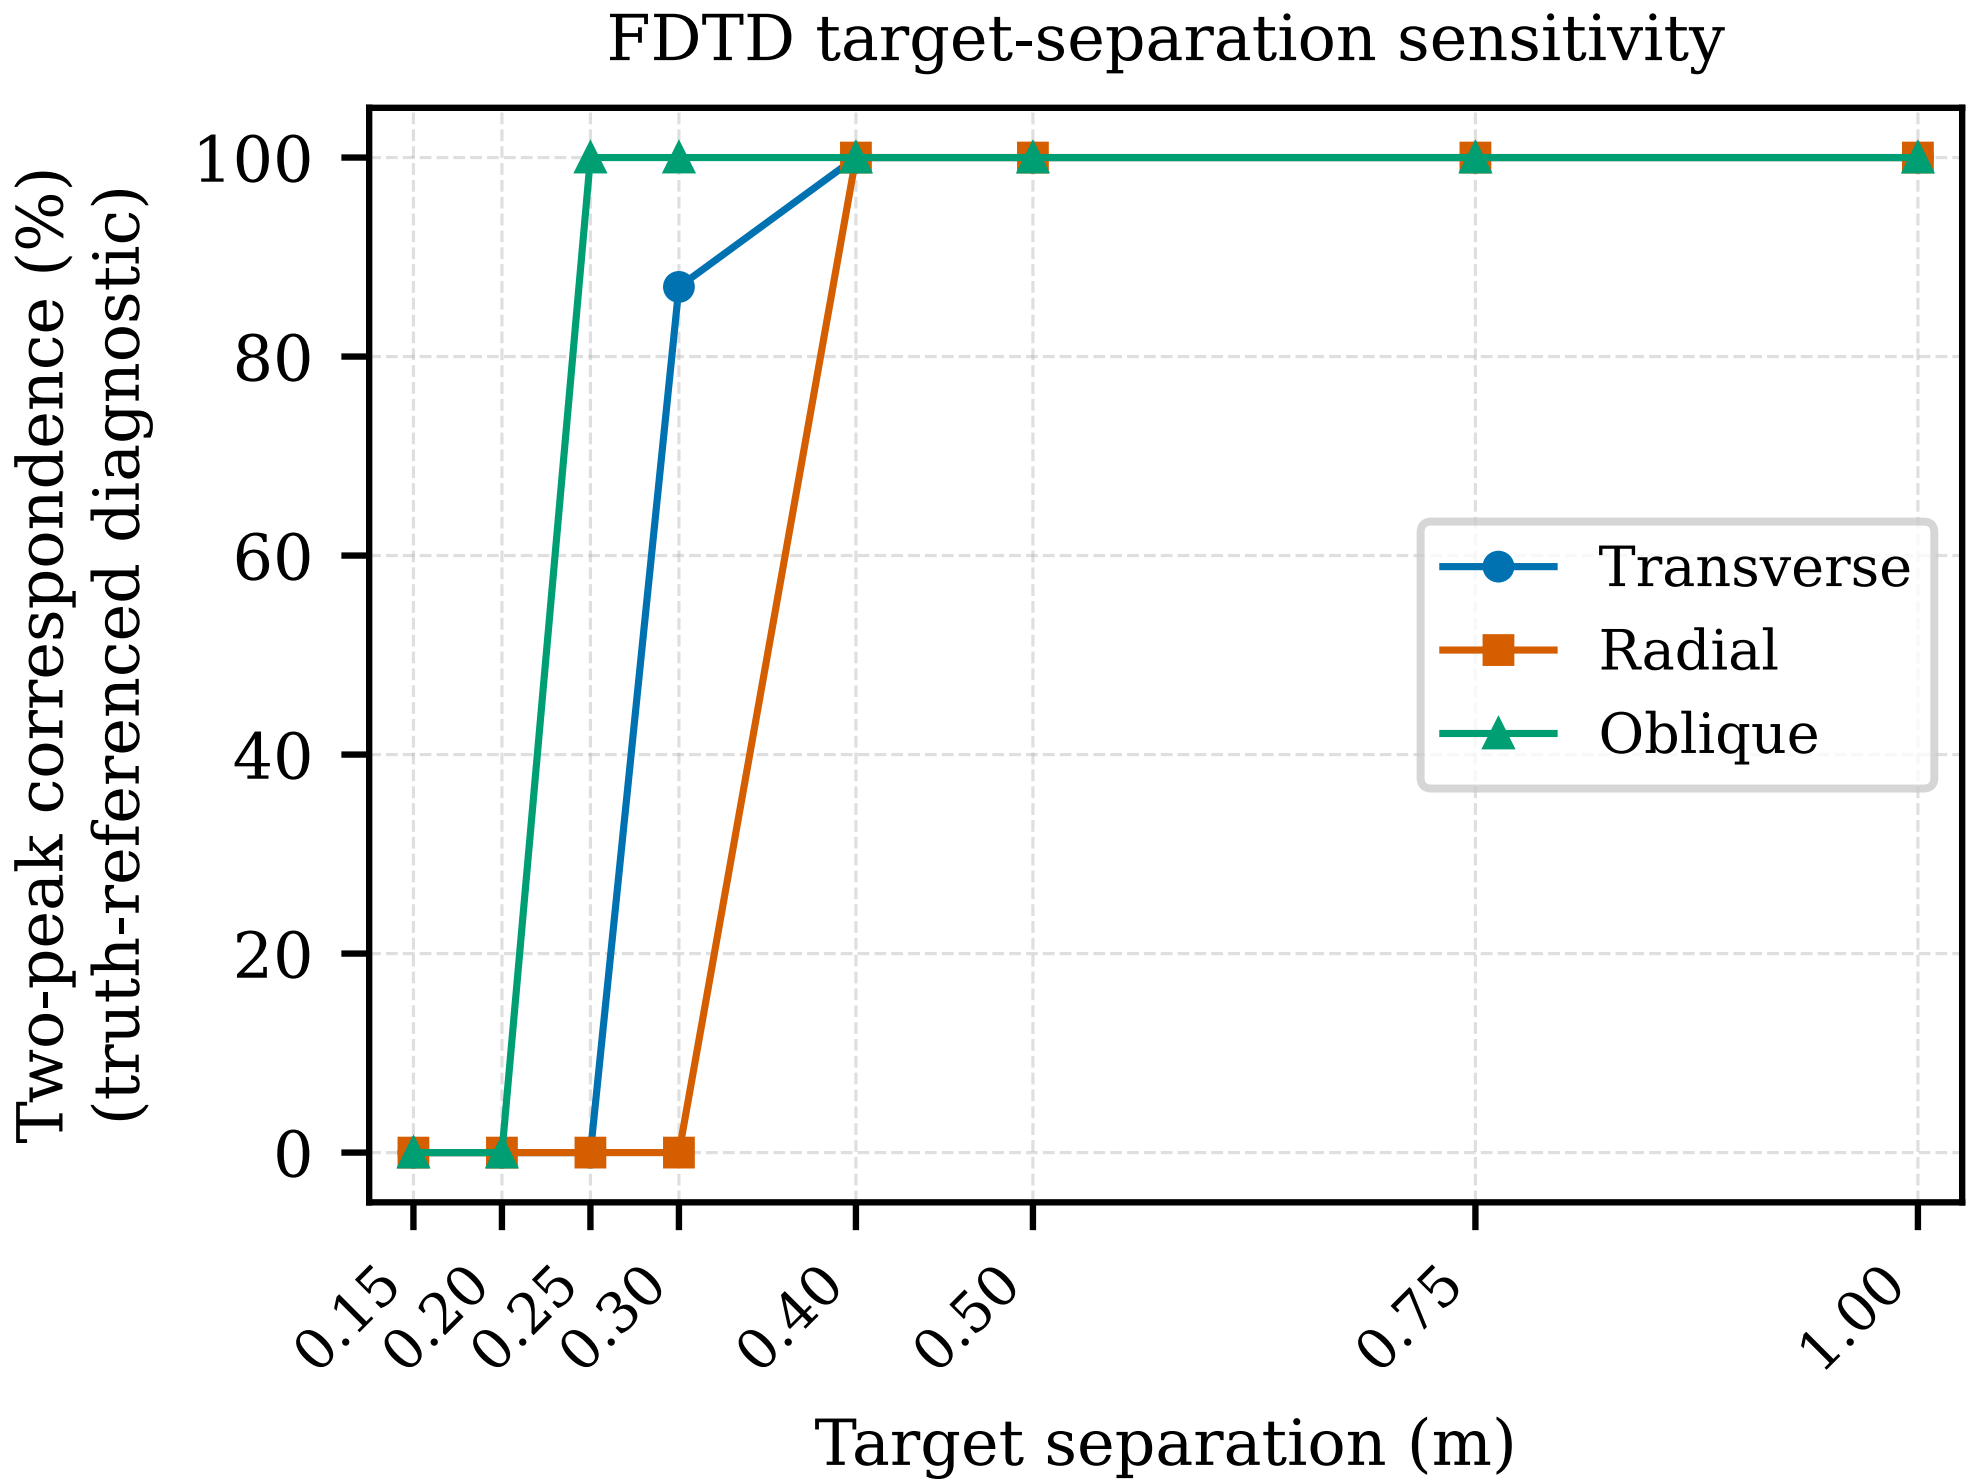
FDTD target-separation sensitivity
Two-peak correspondence (%)
(truth-referenced diagnostic)
100
80
60
40
20
0
0.15
0.20
0.25
0.30
0.40
0.50
0.75
1.00
Target separation (m)
Transverse
Radial
Oblique