WASHINGTON COUNTY OREGON

ADA Curb Ramp New Construction Inspection Form (Perpendicular)

North-South Road Name | Project No. | Sheet No. | Intersection No. | East-West Road Name

{ŜŜ ƘǗǗǇǰăʏĸĸǿǿǿɸƻǋŜƎƻɏɸƎƻǾĸƻŘƻǘĸ9ɏƎʎɏŜŜǋʎɏƎĸ5ƻŎǆʏ̛Ŝɏǘă
ψwƻl·Řǿl·ȅ9ɏƎĸ!5!ψ9ȄƘʎōʎǘ!ɸǇŘŦ ŦƻǋʏƻǋŜ Ŏƻǋɏ Ŝǋ ăǘȅƒŜăɸ
¦ăŜ ² l·ăƘʎɏƎǘƻɏ /ƻǆɏǘȅ Ŏƻǋɏ Ŝǋ ɏǆʏōŜǋʎɏƎ ăȅăǘŜʏɸ

Calibration Date (mm/dd/yy)

Ramp Style: PR

* The passing value for Gutter Flow Slope (GFS) depends on the Intersection Control Type. At a Midblock (MB), GFS must be ≤ Slope of the Road, at Signalized or Uncontrolled (SU), GFS must be ≤ 5.0%, and at Stop or Yield (SY), GFS must be ≤ 2.0%.

* 1 If Back of Ramp Obstruction is Yes, turn space length Y must be minimum 5.0 ft.

* 2 Clear Space area is the width of Ramp Run 1 and extends 4.0 ft into the roadway.

See also Standard Drawings to assess provisions not shown: (inlets, alignment, etc.)

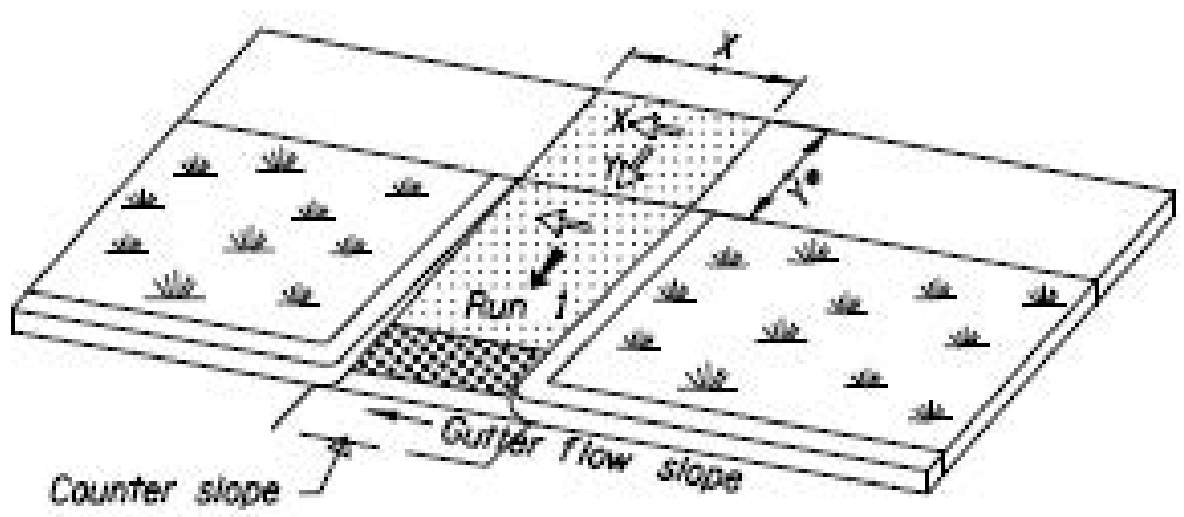

PERPENDICULAR RAMP (PR)

- Pedestrian Access Route (to measure Clear Width)
- Detectable Warning Surface
- Cross Slope (2.0% max.)
- Running Slope (8.3% max.)
- Counter Slope (5.0% max.)
- Turning Space (X & Y) (2.0% max. / 4' x 4' min.)*
  * If constrained at back of walk, min. Y length is 5'.
- Gutter Flow Slope (as directed)

RAMP RUN 1			Pass		Fail
Running Slope 1		≤ 8.3%	■	>8.3%	☐
Length 1					
Cross Slope 1		≤ 2.0%	■	>2.0%	☐
Detectable Warning (Y,N)		Y	■	N	☐
Lip Height		1/4"	☐	>1/4"	☐
Gutter Flow Slope		≤ *	☐	>*	☐
Curb Running Slope (avg)	N/A ☐	≤ 8.3%	☐	>8.3%	☐
Counter Slope (+/-) *2		≤|5.0%|	☐	>|5.0%|	☐
Longest distance from corner to back of curb (see dwg on BT form)		< 5.0'	■	≥ 5.0'	☐
Detectable warning extends full width of ramp throat opening		Y	■	N	☐

TURN SPACE ☐ LANDING ☐ NONE ☐			Pass		Fail
Width X		≥ 4.0'	■	< 4.0'	☐
Length Y		≥ 4.0'*1	■	< 4.0'*1	☐
Back of Ramp Obstruction (Y/N)		≥ 5.0'*1	☐	< 5.0'*1	☐
Slope X		≤2.0%	☐	>2.0%	☐
Slope Y		≤2.0%	☐	>2.0%	■

MISCELLANEOUS	Traversable		Pass		Fail
Flare Slope 1	■	≤ 10%	■	< 10%	☐
Flare Slope 2	■	≤ 10%	■	<10%	☐
Clear Width (feet)		≥ 4.0'	☐	< 4.0'	☐
Intersection Control Type		Slope of Road			
Horizontal Gaps		≤1/2"	☐	> 1/2"	☐

Corner Position

Ramp Position

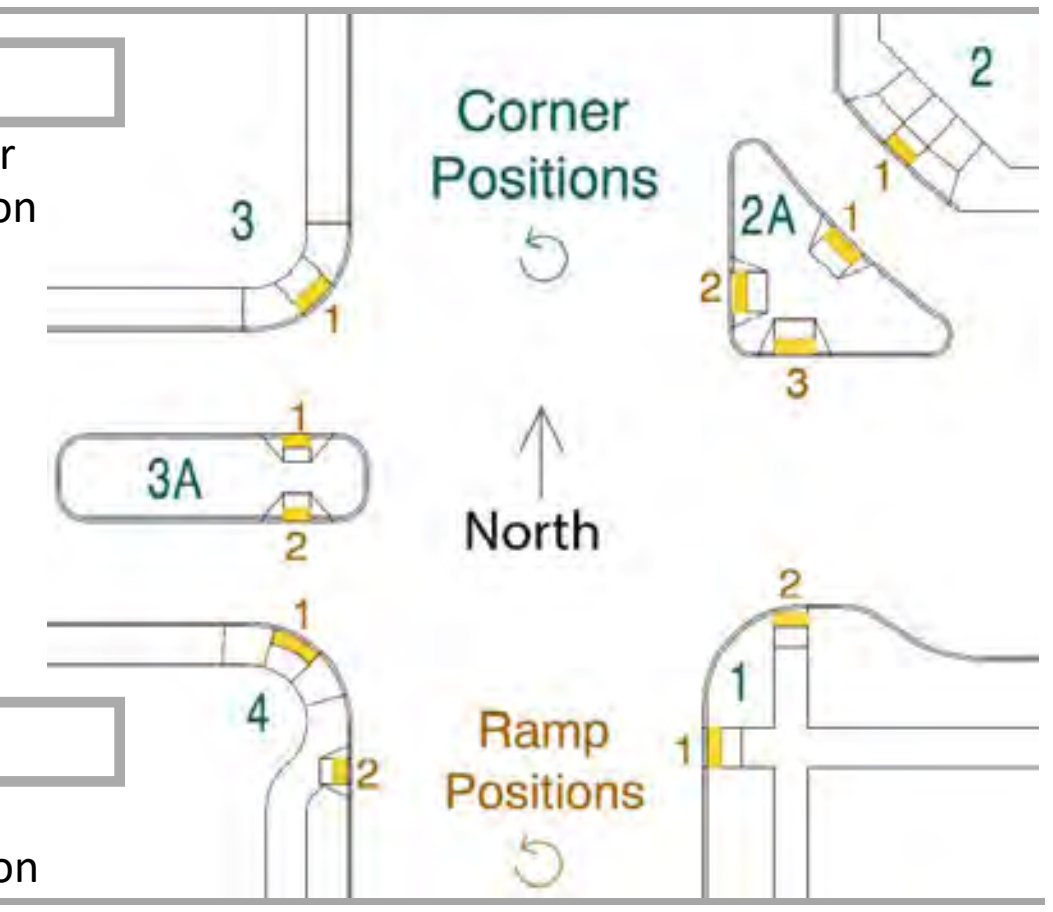

PE Stamp (required for private development)

Comments:

Inspector's Signature | Date (mm/dd/yy)

Print name clearly | Certification No.

Company/Agency

Reset Entire Form | Keep Intersection, Reset Fields

WASHINGTON COUNTY
OREGON

ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed