
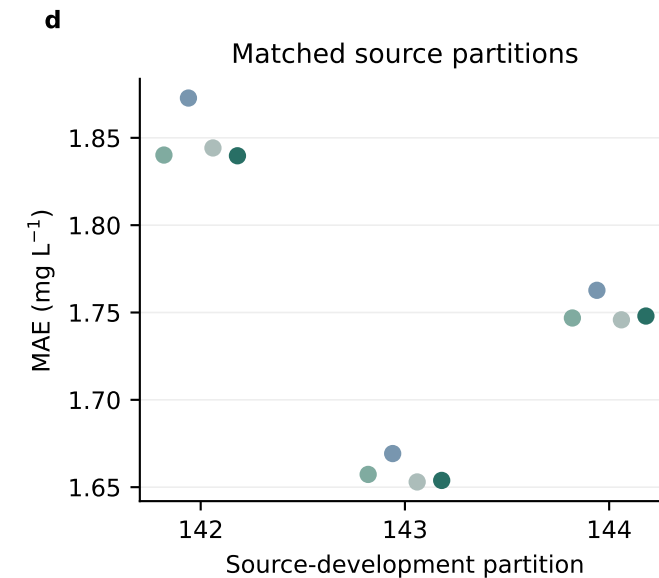
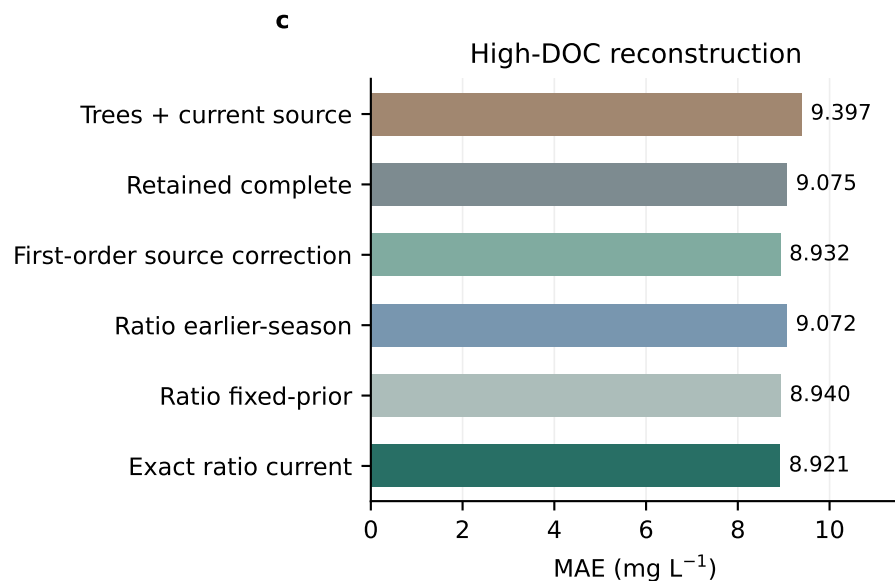
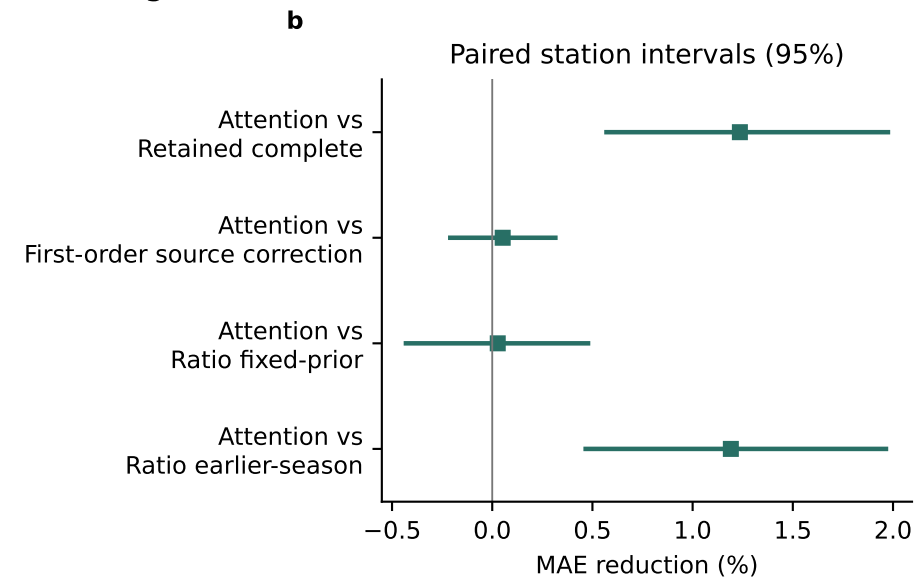


Exact concentration-ratio transfer in the existing DOC model

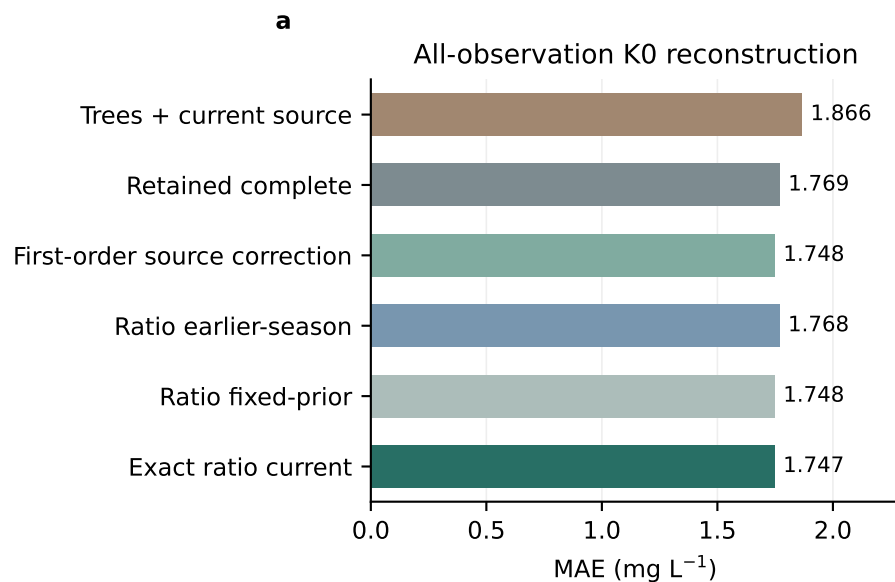

● First-order source correction
 ● Ratio earlier-season
 ● Ratio fixed-prior
 ● Exact ratio current

3 source partitions × 3 seeds · Same reference/backbone · Two matched donor-selection controls
 Receiving water quality absent · 5,000 station draws · Geographical and external products unchanged