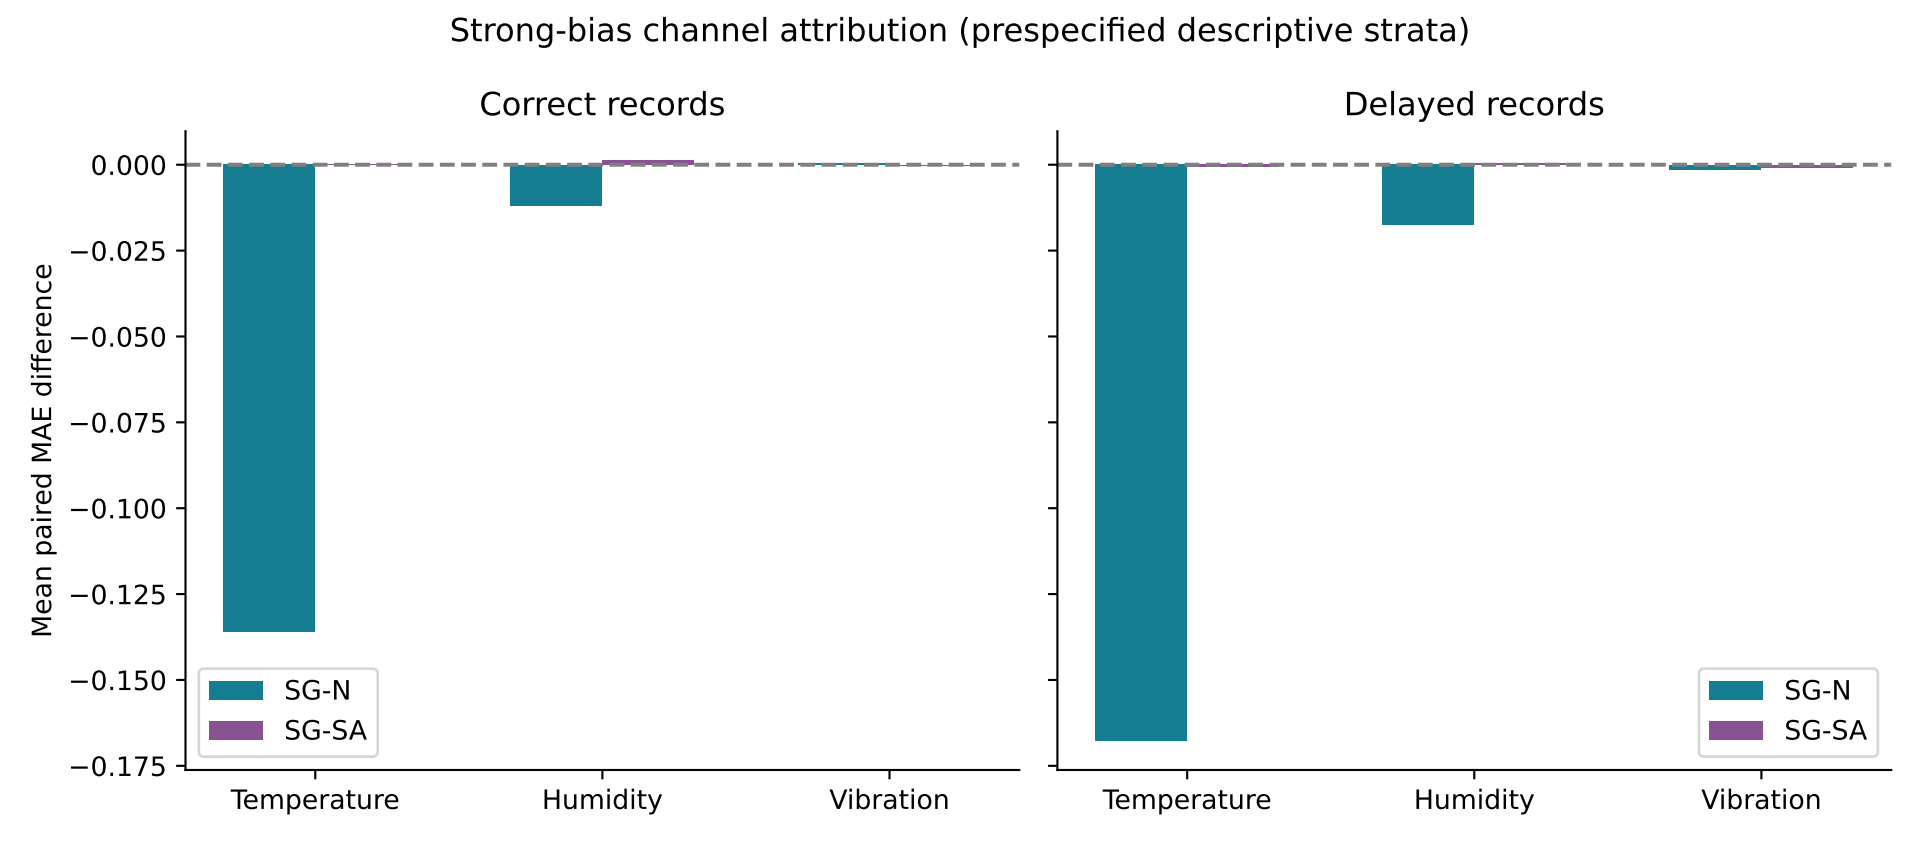
Strong-bias channel attribution (prespecified descriptive strata)
Correct records
Delayed records
Mean paired MAE difference
0.000
−0.025
−0.050
−0.075
−0.100
−0.125
−0.150
−0.175
SG-N
SG-SA
Temperature
Humidity
Vibration