




GABINETE PLC - DROP 5 (EX DROP 1)

VISTA FRONTAL PLETINA

ESC.: 1:7.5

TUBO FLUORESCENTE 18W
MONTADO CONTRA EL TECHO
DEL TABLERO

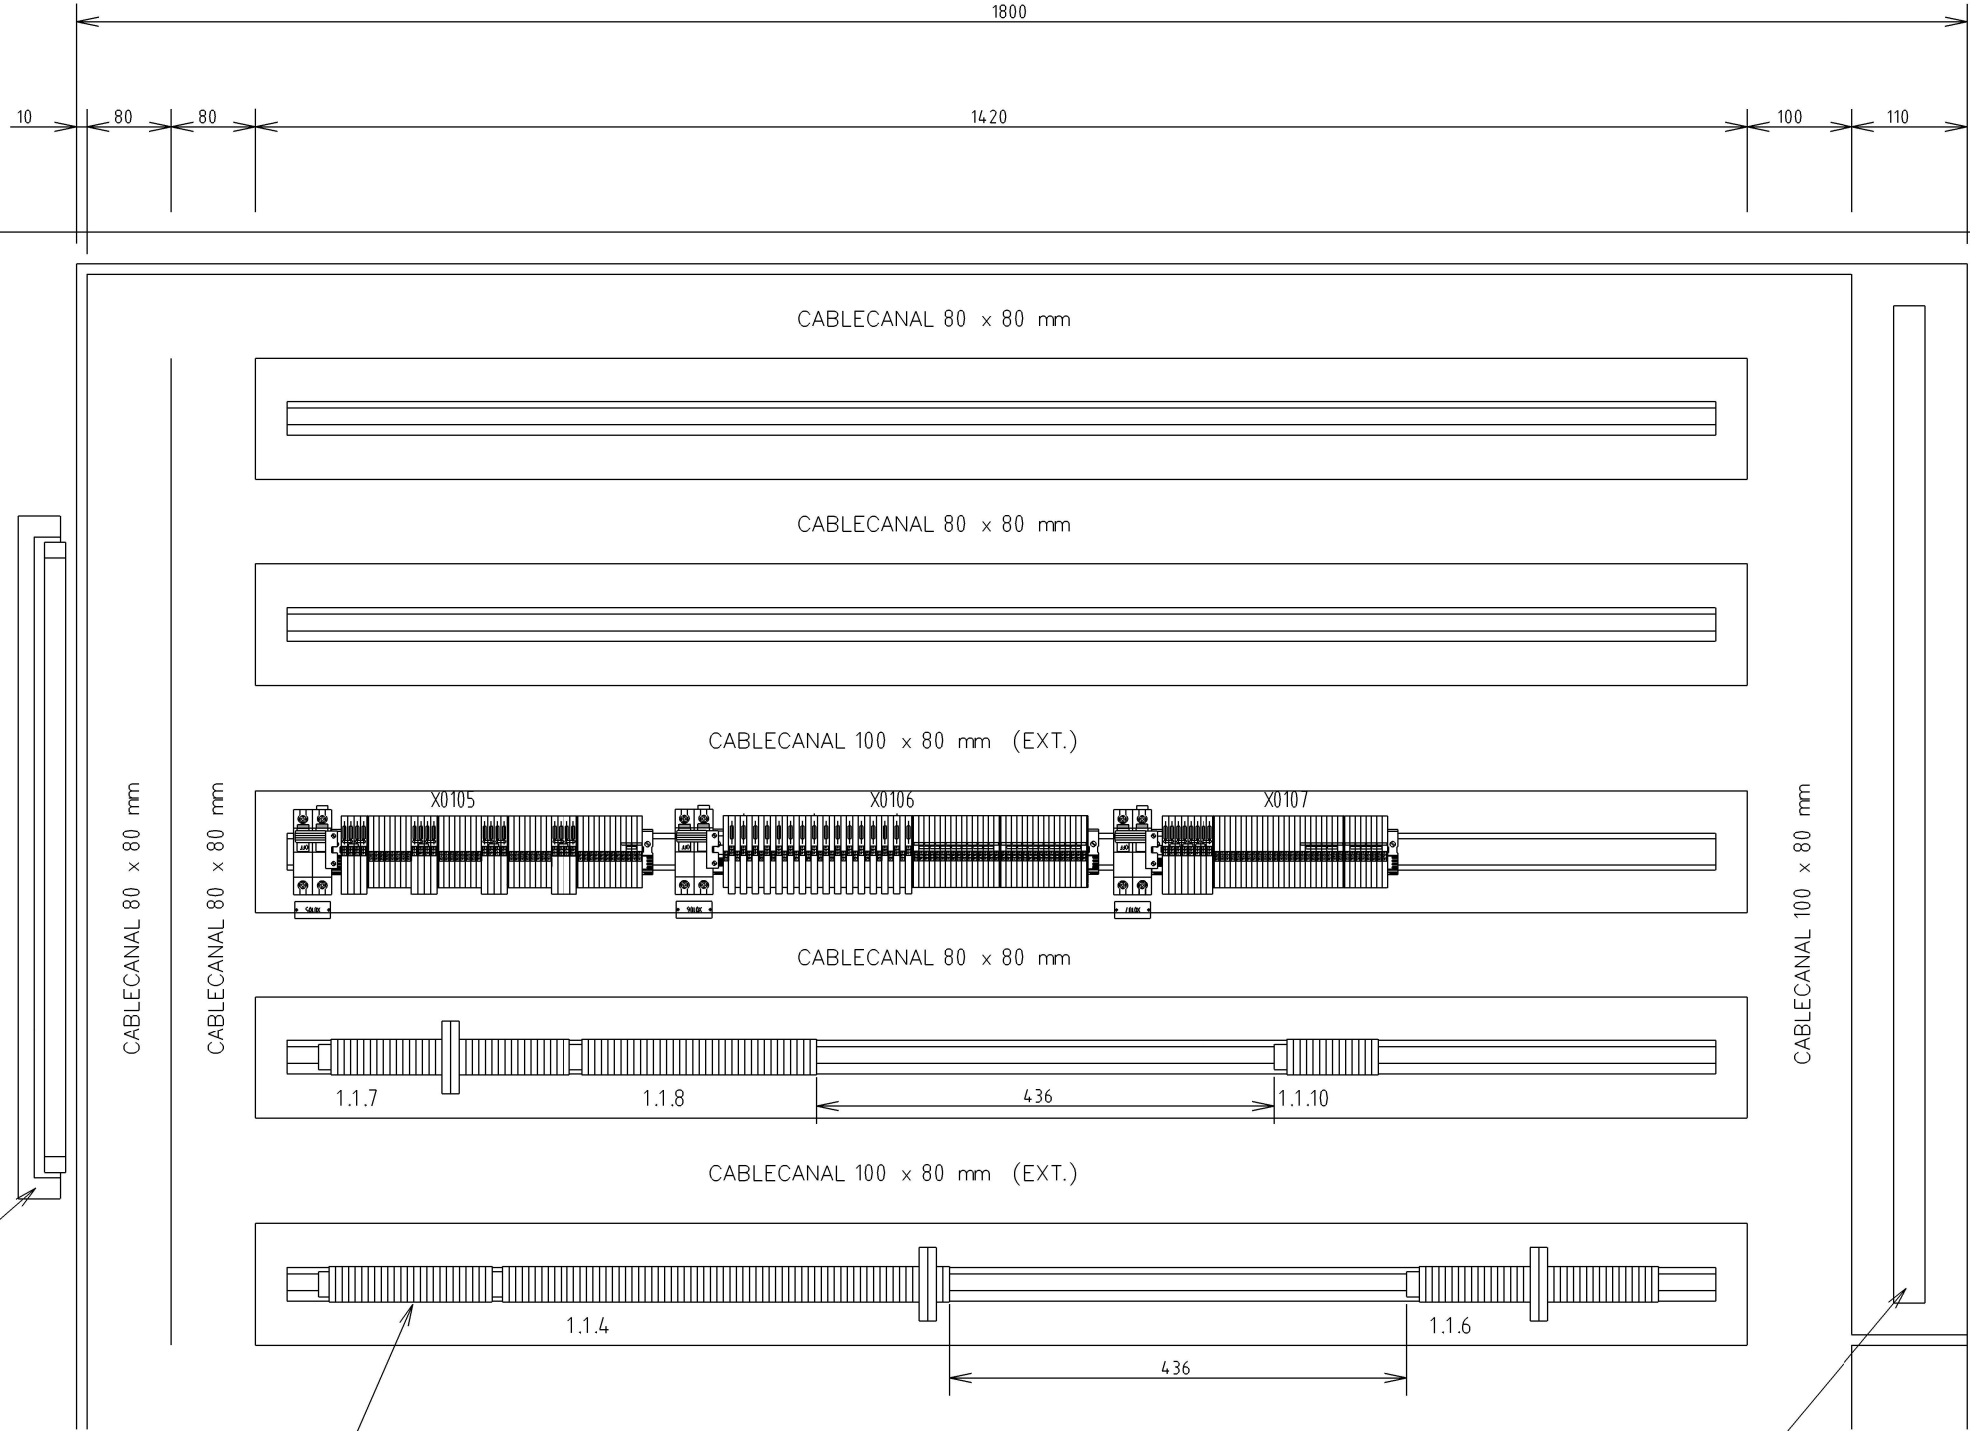

BORNERA GENERAL
40 BORNES ZOLODA
KM4 - LB1

(para conformacion de
borneras ver pag.09
y esquema de bornes
PL2244-E-DE-550002

CHAPA PARA
SUJECION DE CABLES