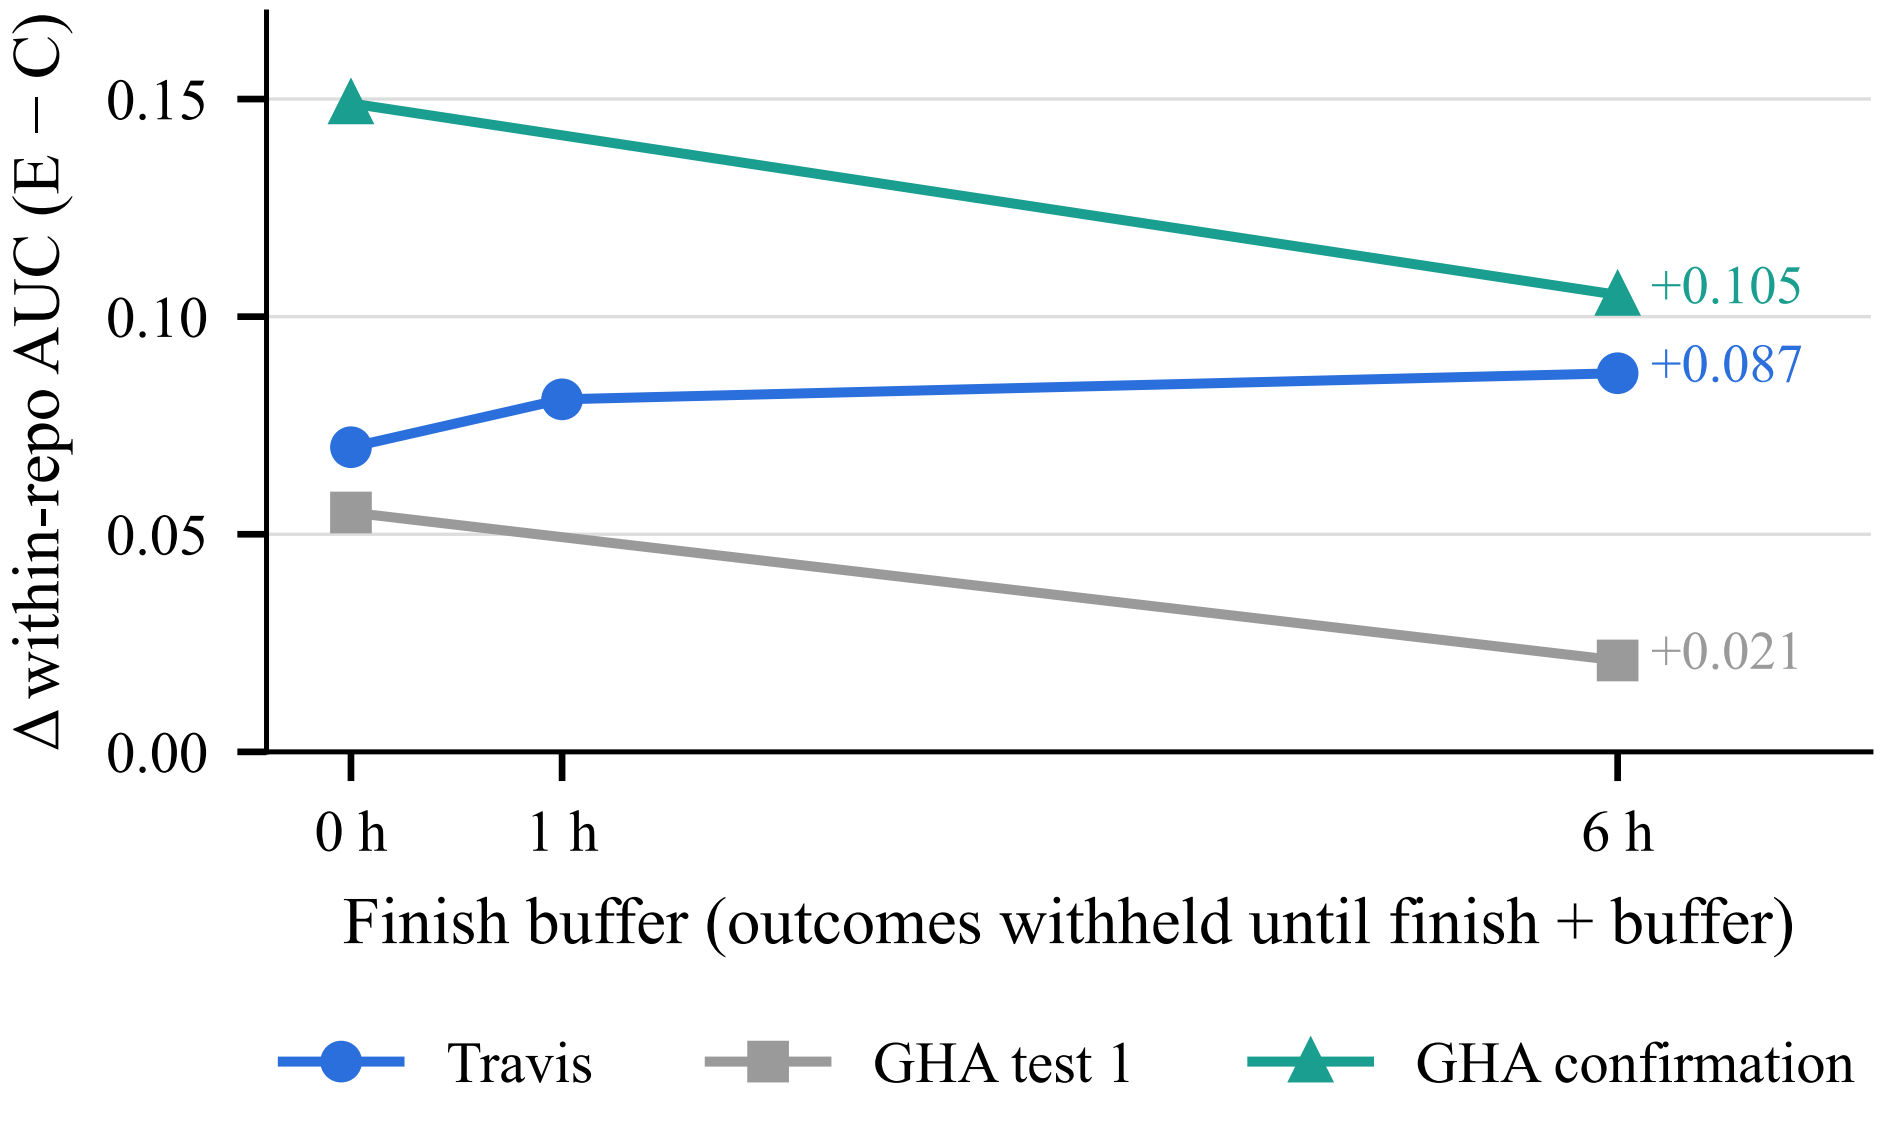
Δ within-repo AUC (E − C)
0.15
0.10
0.05
0.00
+0.105
+0.087
+0.021
0 h
1 h
6 h
Finish buffer (outcomes withheld until finish + buffer)
Travis
GHA test 1
GHA confirmation