SHEAR WALL SCHEDULE

MARK LEVEL		SW1	SW2	SW3	SW4	SW5	SW6	SW7	SW8	SW9	SW10	SW11	SW12	SW13
ABOVE TO TERRACE LVL.	S.W.SIZE (TIES GROUP)					R1 230X1700 (G3) A = 8-16ϕ B = 8-16ϕ C = 8-12ϕ					230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C =32-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE					M-35					M-35	M-35	M-35	M-35
	REFER SECTION					5B					10B	11C	12	13A
TERRACE LVL. TO 14TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C =28-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C =32-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8D	9	10B	11C	12	13A
14TH FL00R LVL. TO 13TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C =28-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C =32-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8D	9	10B	11C	12	13A
13TH FL00R LVL. TO 12TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C =28-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C =32-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8D	9	10B	11C	12	13A
12TH FL00R LVL. TO 11TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C =28-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C =32-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8D	9	10B	11C	12	13A
11TH FL00R LVL. TO 10TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C =28-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C =32-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8D	9	10B	11C	12	13A
10TH FL00R LVL. TO 9TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C =28-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C =32-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8D	9	10B	11C	12	13A
9TH FL00R LVL. TO 8TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C = 4-12ϕ D =26-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C = 4-12ϕ D =30-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8C	9	10B	11B	12	13A
8TH FL00R LVL. TO 7TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D =26-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C = 4-12ϕ D =30-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8B	9	10B	11B	12	13A
7TH FL00R LVL. TO 6TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =22-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C = 4-12ϕ D =30-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8B	9	10B	11B	12	13A
6TH FL00R LVL. TO 5TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =22-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =26-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35	M-35
	REFER SECTION	1	2	3	4	5B	6	7B	8B	9	10B	11A	12	13A
5TH FL00R LVL. TO 4TH FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =22-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C = 4-12ϕ D =24-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =26-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40
	REFER SECTION	1	2	3	4	5B	6	7B	8B	9	10A	11A	12	13A
4TH FL00R LVL. TO 3RD FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-10ϕ F = 4-10ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =22-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C = 4-12ϕ D =24-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =26-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40
	REFER SECTION	1	2	3	4	5B	6	7B	8B	9	10A	11A	12	13A
3RD FL00R LVL. TO 2ND FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-10ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 4-12ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C =10-10ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 8-12ϕ E = 8-12ϕ F =16-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C = 4-12ϕ D =24-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =26-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C =26-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40
	REFER SECTION	1	2	3	4	5B	6	7B	8A	9	10A	11A	12	13A
2ND FL00R LVL. TO 1ST FL00R LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ	230X1185 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 4-12ϕ	230X1855 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 6-12ϕ	230X3600 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 8-12ϕ E = 8-12ϕ F =16-12ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =20-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-16ϕ C = 8-12ϕ D = 8-12ϕ E = 8-12ϕ F =20-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D =22-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40
	REFER SECTION	1	2	3	4	5A	6	7A	8A	9	10	11	12	13
1ST FL00R LVL. TO GROUND FLOOR LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-16ϕ D = 4-12ϕ	230X1185 (G3) A = 4-16ϕ B = 4-16ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 4-12ϕ	230X1855 (G3) A = 4-16ϕ B = 4-16ϕ C = 4-16ϕ D = 4-16ϕ E = 4-16ϕ F = 4-16ϕ H = 6-12ϕ	230X3600 (G3) A = 8-16ϕ B = 8-16ϕ C = 8-16ϕ D = 8-16ϕ E = 8-16ϕ F = 8-12ϕ G =12-12ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D = 4-12ϕ E =20-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-16ϕ C = 8-12ϕ D = 8-12ϕ E = 8-12ϕ F =20-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D =22-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40
	REFER SECTION	1	2	3	4	5A	6	7A	8	9	10	11	12	13
GROUND FLOOR LVL. TO FOUNDATION LVL.	S.W.SIZE (TIES GROUP)	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 8-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X1000 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ	230X1150 (G3) A = 4-16ϕ B = 4-12ϕ C = 4-12ϕ D = 4-12ϕ E = 4-12ϕ F = 2-12ϕ	230X1700 (G3) A = 4-20ϕ B = 4-20ϕ C = 4-20ϕ D = 4-16ϕ E = 4-16ϕ F = 8-16ϕ G = 6-16ϕ	230X1185 (G3) A = 4-16ϕ B = 4-16ϕ C = 4-16ϕ D = 4-12ϕ F = 4-12ϕ	230X1855 (G3) A = 4-16ϕ B = 4-16ϕ C = 4-16ϕ D = 4-16ϕ E = 4-16ϕ F = 4-16ϕ G = 4-16ϕ H = 8-16ϕ	230X3600 (G3) A = 8-16ϕ B = 8-16ϕ C = 8-16ϕ D = 8-16ϕ E = 8-16ϕ F = 8-12ϕ G =12-12ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C =10-10ϕ	230X3445 (G3) A = 8-16ϕ B = 8-16ϕ C = 8-12ϕ D = 4-12ϕ E =20-10ϕ	230X4065 (G3) A = 8-16ϕ B = 8-16ϕ C = 8-12ϕ D = 8-12ϕ E = 8-12ϕ F =20-10ϕ	AS/SECTION (G3) A = 8-16ϕ B =16-12ϕ C = 6-10ϕ	200X3445 (G3) A = 8-16ϕ B = 8-12ϕ C = 8-12ϕ D =22-10ϕ
	VERTICAL REINF.													
	CONCRETE GRADE	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40	M-40
	REFER SECTION	1	2	3	4	5	6	7	8	9	10	11	12	13
REMARK	DESCRIPTION													

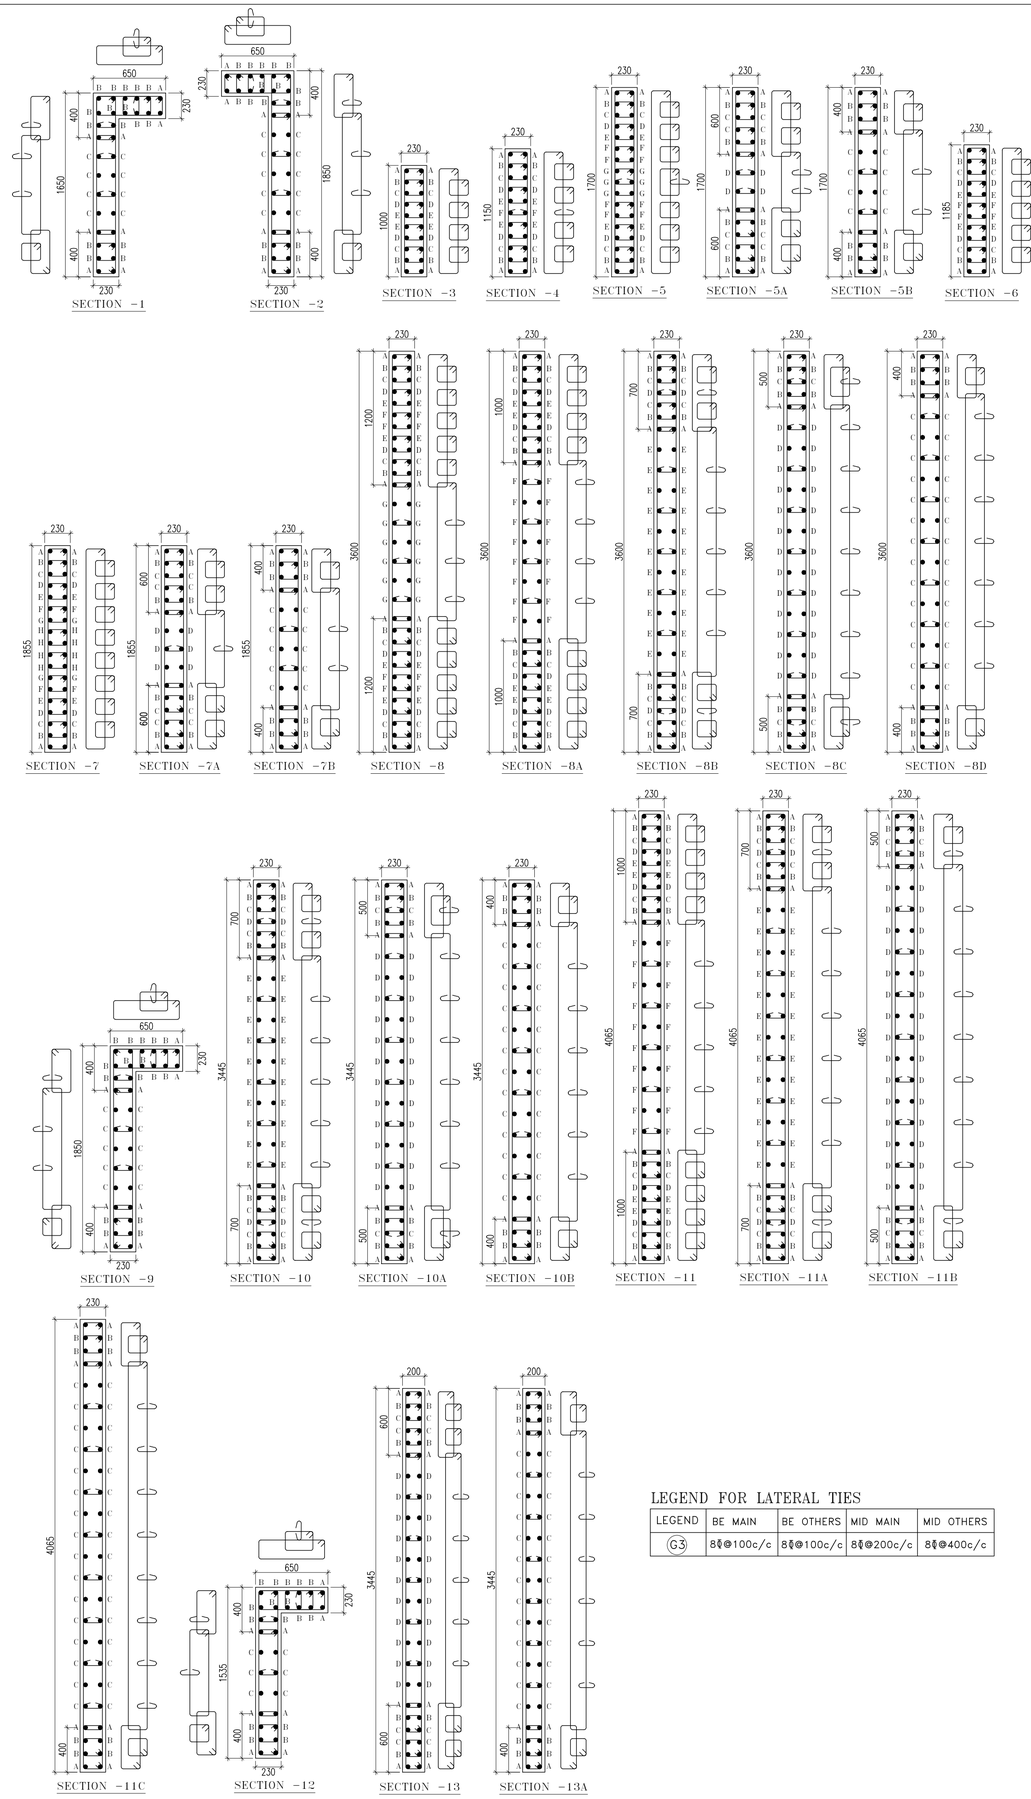

LEGEND FOR LATERAL TIES

LEGEND	BE MAIN	BE OTHERS	MID MAIN	MID OTHERS
G3	8ϕ@100c/c	8ϕ@100c/c	8ϕ@200c/c	8ϕ@400c/c

THIS DRAWING IS THE COPYRIGHT OF THE CONSULTANTS AND MAY BE USED OR REPRODUCED ONLY WITH HIS PRIOR PERMISSION.

NOTES:

1. READ THIS DRAWING IN CONJUNCTION WITH RELEVANT ARCHITECTURAL DRAWINGS. ANY DISCREPANCY IF FOUND SHALL BE BROUGHT TO THE NOTICE OF CONSULTANT.
2. ALL DIMENSIONS & LEVELS ARE IN MILIMETERS.
3. DO NOT SCALE ANY DIMENSION.
4. CONFIRM LOCATION OF WALLS WITH RELEVANT ARCH. DRGS.
5. GRADE OF CONCRETE
   RAFT : M-25 COLUMNS/SHEAR WALLS : AS/SCHDULE.
6. HYSD REINFORCEMENT BARS CONFIRM TO IS:1786:2008 FE 550D.
7. THE CLEAR COVER TO THE REINFORCEMENT SHALL BE AS FOLLOWS:-
   (a) RAFT TOP & SIDE: 50 MM
   RAFT BOTTOM : 75 MM
   (b) COLUMNS : 40 MM
   (c) BEAMS SIMPLE/CONTINUOUS : 40/30 MM
   (d) SLABS SIMPLE/CONTINUOUS : 25/25 MM
   (e) CHAJJAS/CONOPY : 20 MM
   (f) R.C.C. WALL FOR >230 : 40 MM
   (g) R.C.C. WALL FOR <=230 : 25 MM
   NOMINAL COVER IS THE DEPTH OF CONCRETE COVER TO ALL STEEL REINFORCEMENT INCLUDING LINKS/ TIES/ STIRRUPS.
8. NOT MORE THAN 50% OF THE BARS SHALL BE LAPPED AT ANY SECTION. LAPS CLOSE TO THE MID SPAN IN BOTTOM BARS & CLOSE TO SUPPORTS IN TOP BARS SHALL BE AVOIDED.
9. ALL R.C.C. TO BE MACHINE MIXED, VIBRATED AND CURED THOROUGHLY AS PER I.S 456-LATEST.
10. ALL FOOTING ARE CENTRALLY PLACED WITH RESPECTED TO THE CENTER LINE OF COLUMN.
11. REINFORCEMENT SHALL BE PROVIDED IN TWO LAYERS WHEREVER FOUND NECESSARY WITH SPACER BAR TO BE PROVIDED BETWEEN TWO LAYERS OF REINFORCEMENTS AS PER IS:456. SPACER BARS
12. ALL DIMENSIONS MUST BE CHECKED WITH ARCHITECT'S DRGS. & IN CASE OF ANY DISCREPANCY ARCHITECTS DRGS. SHALL PREVAIL.
13. ALL CONSTRUCTION JOINTS SHALL BE APROVED BY CONSULTANT ON THE BASIS OF SCHEME PREPARED BY CONTRACTOR.
14. TOP AND BOTTOM EX