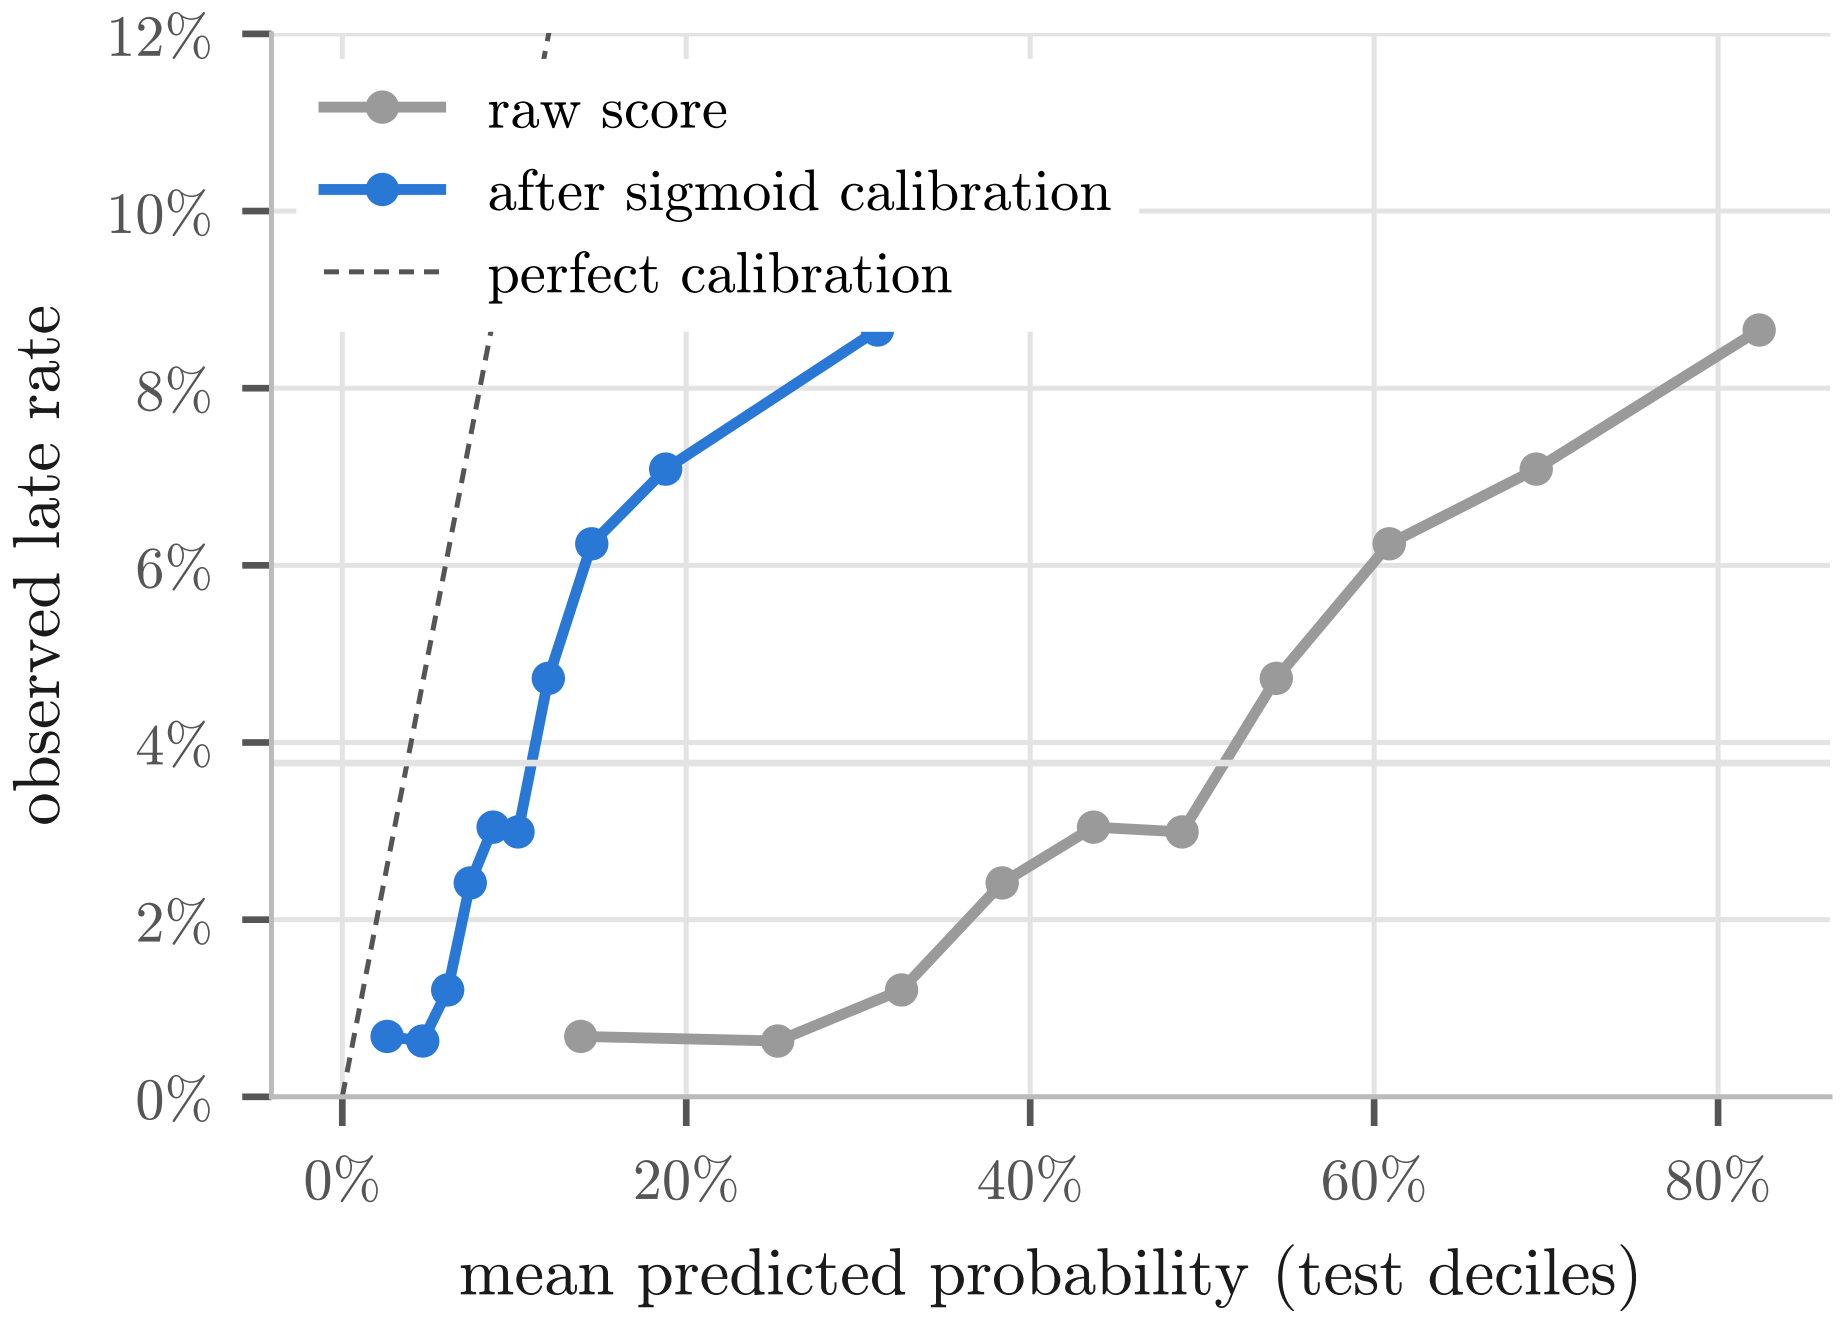
raw score
after sigmoid calibration
perfect calibration
observed late rate
mean predicted probability (test deciles)
0%
2%
4%
6%
8%
10%
12%
0%
20%
40%
60%
80%