
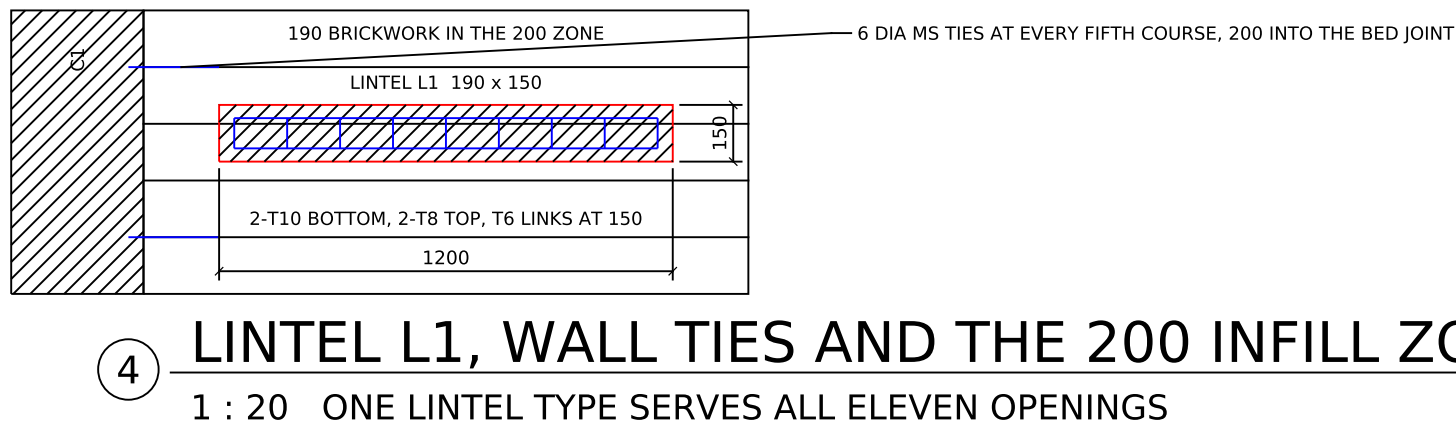
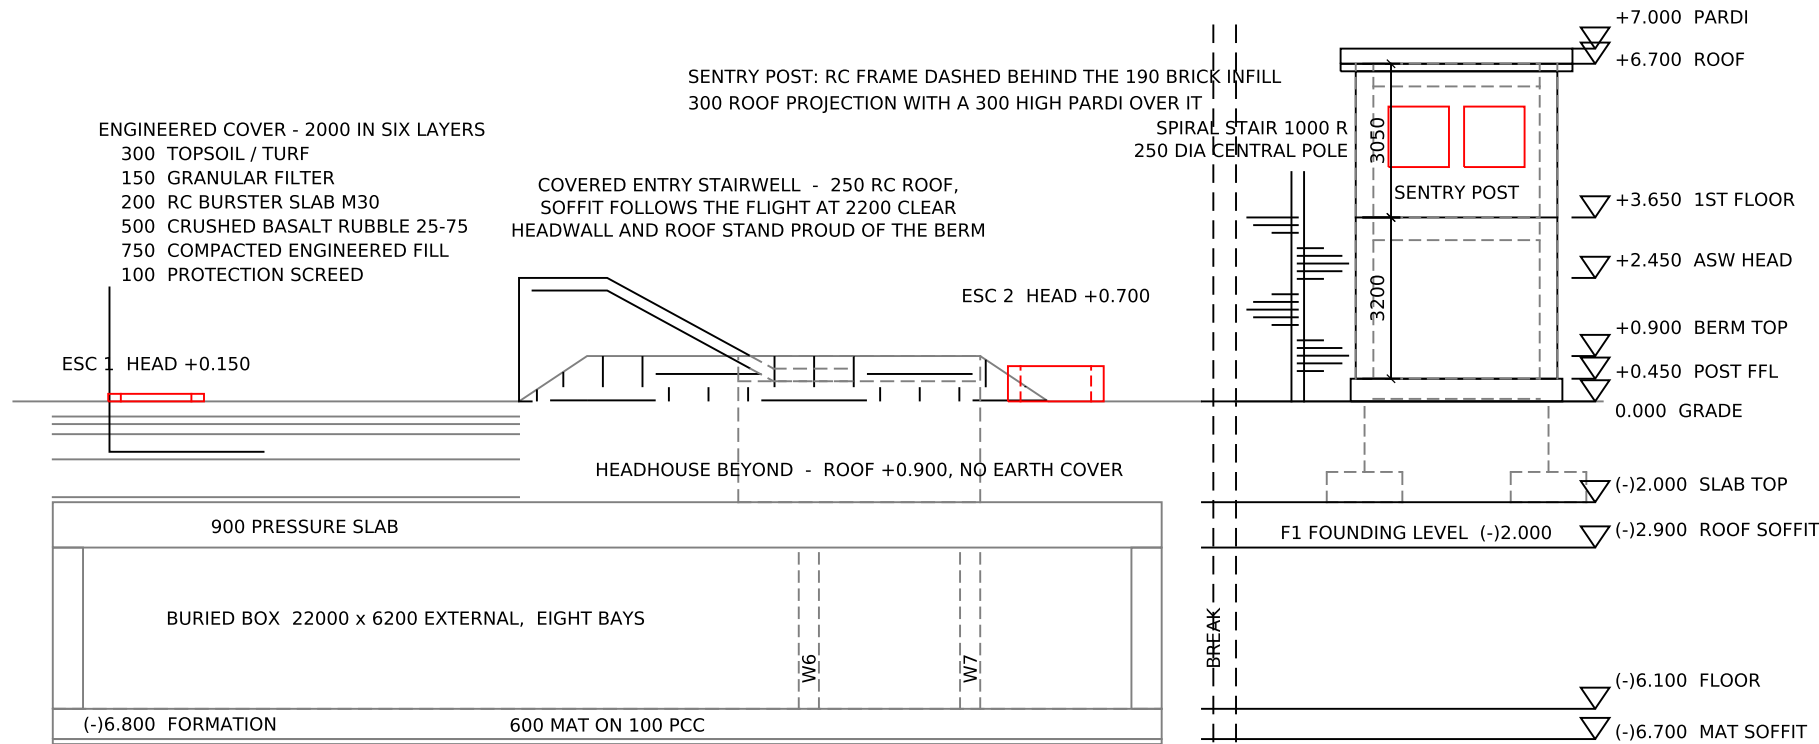


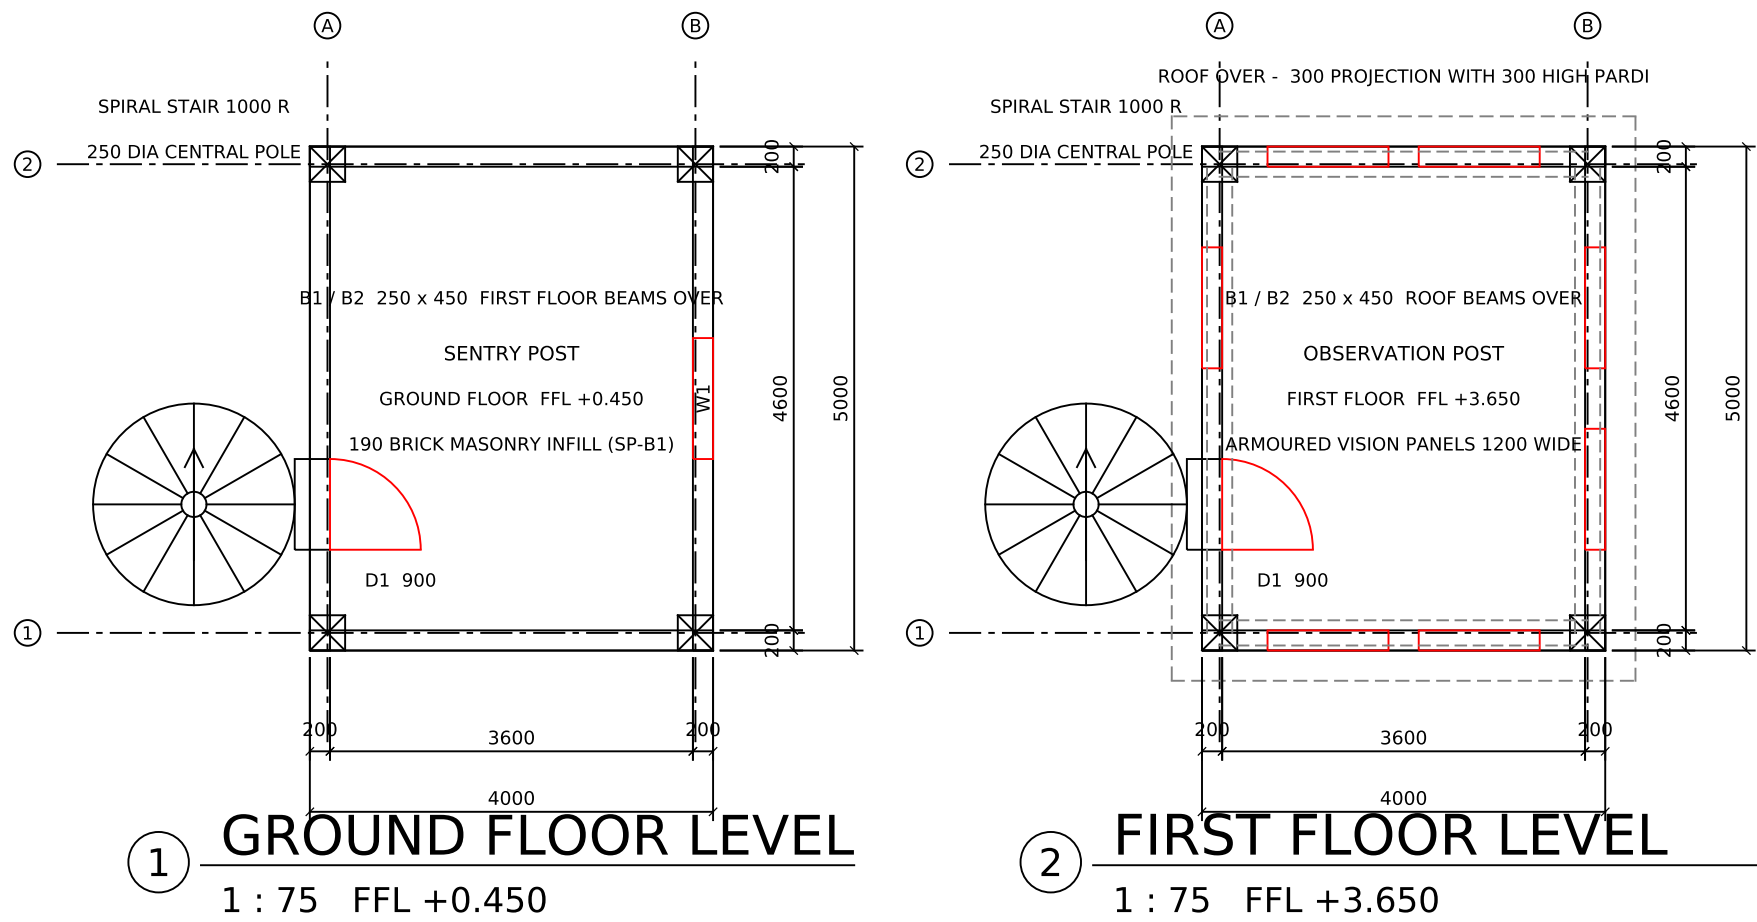

SENTRY POST ELEMENT SCHEDULE				
ELEMENT	SIZE	EXTENT	COVER	NOTES
C1 COLUMN	350 x 350	4 No., BOTH STOREYS	40	AT THE FOUR CORNERS, OUTER FACES FLUSH
B1 BEAM	250 x 450	SPANS A-B, 3650 c/c	30	ON GRIDS 1 AND 2
B2 BEAM	250 x 450	SPANS 1-2, 4650 c/c	30	ON GRIDS A AND B
S1 SLAB	150 THK	3650 x 4650 c/c, TWO-WAY	30	BOTH FLOORS
PB PLINTH BEAM	250 x 400	AT +0.450	30	TOP = GROUND FFL
F1 ISOLATED FOOTING	1500 x 1500 x 600	4 No.	50	ON IN-SITU BASALT AT (-)2.000
GROUND INFILL	200 ZONE	190 BRICKWORK IS 1077, CM 1:6	-	10 TAKEN UP IN THE INTERNAL PLASTER
FIRST STOREY INFILL	200 ZONE	ARMOURED VISION PANELS 1200 WIDE	-	ALL FOUR FACES
ROOF PROJECTION	300 WIDE	ALL ROUND, AT ROOF LEVEL	-	300 HIGH PARDI (PARAPET) 300 x 150 OVER IT
SPIRAL STAIR	1000 R	EXTERNAL, WEST OF THE POST	-	250 DIA CENTRAL POLE, 12 TREADS, LANDING AT D1
L1 LINTEL	190 x 150	OVER EVERY OPENING	30	2-T10 BTM, 2-T8 TOP, T6 LINKS AT 150, BEARING 200

COLUMN GRID SCHEDULE			
GRID	AXIS	COORDINATE	SPACING
A	X	175	3650 c/c TO GRID B
B	X	3825	-
1	Y	175	4650 c/c TO GRID 2
2	Y	4825	-

SENTRY POST LEVEL SCHEDULE		
LEVEL	VALUE	NOTES
PARAPET TOP	+7.000	-
ROOF SLAB	+6.700	FIRST STOREY HEIGHT 3050
FIRST FLOOR	+3.650	GROUND STOREY HEIGHT 3200
GROUND FLOOR FFL	+0.450	= TOP OF PLINTH BEAM PB
PLINTH BEAM SOFFIT	+0.050	PB 250 x 400
FINISHED SITE GRADE	0.000	-
FOUNDING LEVEL	(-)2.000	F1 ON IN-SITU BASALT

DOOR AND OPENING SCHEDULE				
MARK	TYPE	SIZE	POSITION	No.
D1	DOOR	900 x 2100	WEST WALL, Y 1000-1900, BOTH STOREYS	OPENS EAST
W1	ARMOURED VISION PANEL	1200 WIDE	EAST WALL, Y 1900-3100, GROUND STOREY	1 No.
W1	ARMOURED VISION PANEL	1200 WIDE	FIRST STOREY, ALL FOUR FACES	TWO PER FACE
EVERY OPENING HAS A LINTEL L1 190 x 150 OVER IT, BEARING 200 EACH END				

UNDERGROUND CBRN-HARDENED
BLAST-RESISTANT PROTECTIVE
STRUCTURE + SENTRY POST
PUNE, MAHARASHTRA

NOTES

- ALL DIMENSIONS ARE IN MM. ALL LEVELS ARE IN METRES RELATIVE TO FINISHED SITE GRADE 0.000, NEGATIVE DOWNWARDS.
- WRITTEN DIM TO BE FOLLOWED ONLY. DRG NOT TO BE SCALED.
- THIS DRG IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCH, STR AND SERVICES DRGS.
- THE SENTRY POST IS AN ABOVE-GROUND FRAMED STRUCTURE WITH BRICK INFILL. IT IS NOT BLAST RATED AND IT IS NOT PART OF THE PROTECTIVE BOUNDARY.
- WALL POSITIONS ARE IDENTICAL ON BOTH FLOORS. DOOR D1 IS IN THE WEST WALL AT Y 1000 - 1900 ON BOTH STOREYS, HINGED ON THE SOUTH JAMB AND OPENING EAST INTO THE ROOM, OFF THE EXTERNAL SPIRAL STAIR LANDING.
- THE ROOF PROJECTS 300 ALL ROUND WITH A 300 HIGH PARDI OVER IT. THE FIRST FLOOR DOES NOT PROJECT; THE FIRST-FLOOR PLAN SHOWS THE ROOF PROJECTION HIDDEN, AS THE THING OVERHEAD.
- GROUND-STOREY INFILL IS 190 ONE-BRICK MODULAR BRICKWORK TO IS 1077 IN CM 1:6, BUILT INSIDE THE UNCHANGED 200 STRUCTURAL ZONE BETWEEN THE COLUMN FACES, THE RESIDUAL 10 TAKEN UP AT THE INTERNAL FACE IN THE PLASTER.
- THE TOP COURSE IS BUILT TIGHT TO THE BEAM SOFFIT AND THE LAST JOINT PACKED. THE INFILL IS NOT SEPARATED FROM THE FRAME.
- WALL TIES 6 DIA MS AT EVERY FIFTH COURSE, APPROXIMATELY 450, UP BOTH COLUMN FACES, PROJECTING 200 INTO THE BED JOINT AND ANCHORED BY A CAST-IN OR DRILLED-AND-GROUTED 10 DOWEL.
- LINTEL L1, ONE TYPE OVER EVERY OPENING: 190 WIDE x 150 DEEP, M30 / Fe500, COVER 30, BEARING 200 EACH END.
- THE SENTRY POST STANDS CLEAR OF THE SHELTER EXCAVATION. ITS SITE POSITION IS X 32000 - 36000, Y 600 - 5600.
- THIS DRG HAS BEEN PREPARED IN ACCORDANCE WITH EXISTING CODES, NBC OF INDIA 2016, SOA 2009 AND SEISMIC LOADS.
- CONTRACTOR TO CHECK AND VERIFY THE DRG BEFORE EXECUTION.

SENTRY POST -
GROUND FLOOR
LEVEL, FIRST
FLOOR LEVEL PLAN,
SOUTH ELEVATION

CBRN HARDENED
UG OPS ROOM

SHEET 02

Project number 01
Date 18 SEP 2026
Drawn by SYN 01
Checked by DR IR CHAUDHARI

ARCH002

Scale As indicated