


# MH/HH/PED Naming FRC Coding

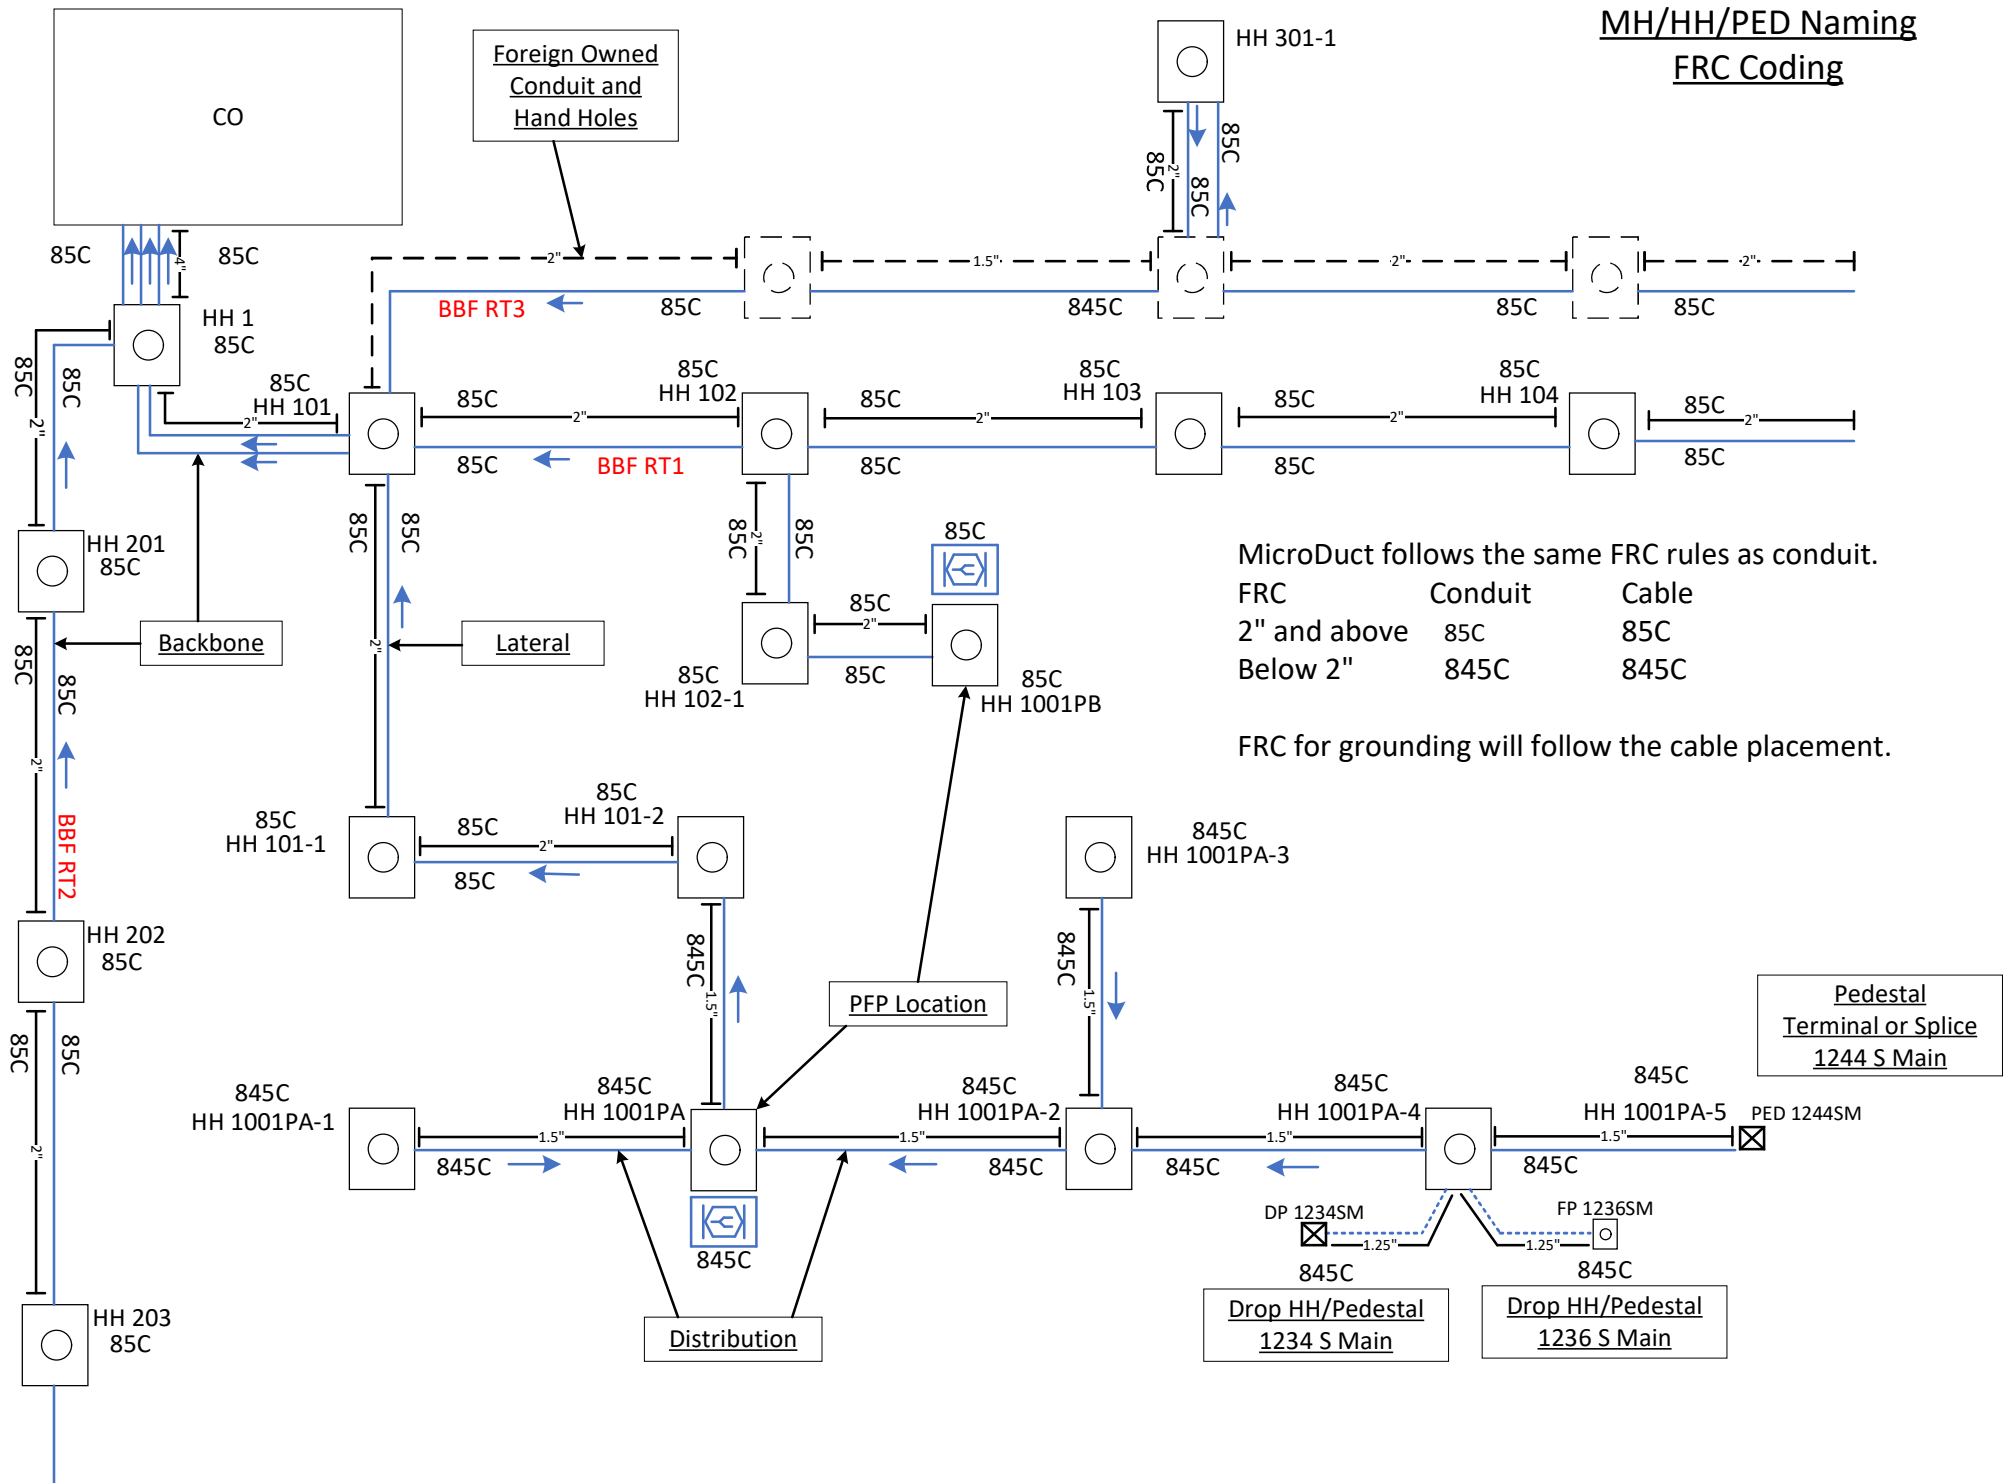

MicroDuct follows the same FRC rules as conduit.

FRC	Conduit	Cable
2" and above	85C	85C
Below 2"	845C	845C

FRC for grounding will follow the cable placement.

Pedestal  
Terminal or Splice  
1244 S Main

Drop HH/Pedestal  
1234 S Main

Drop HH/Pedestal  
1236 S Main