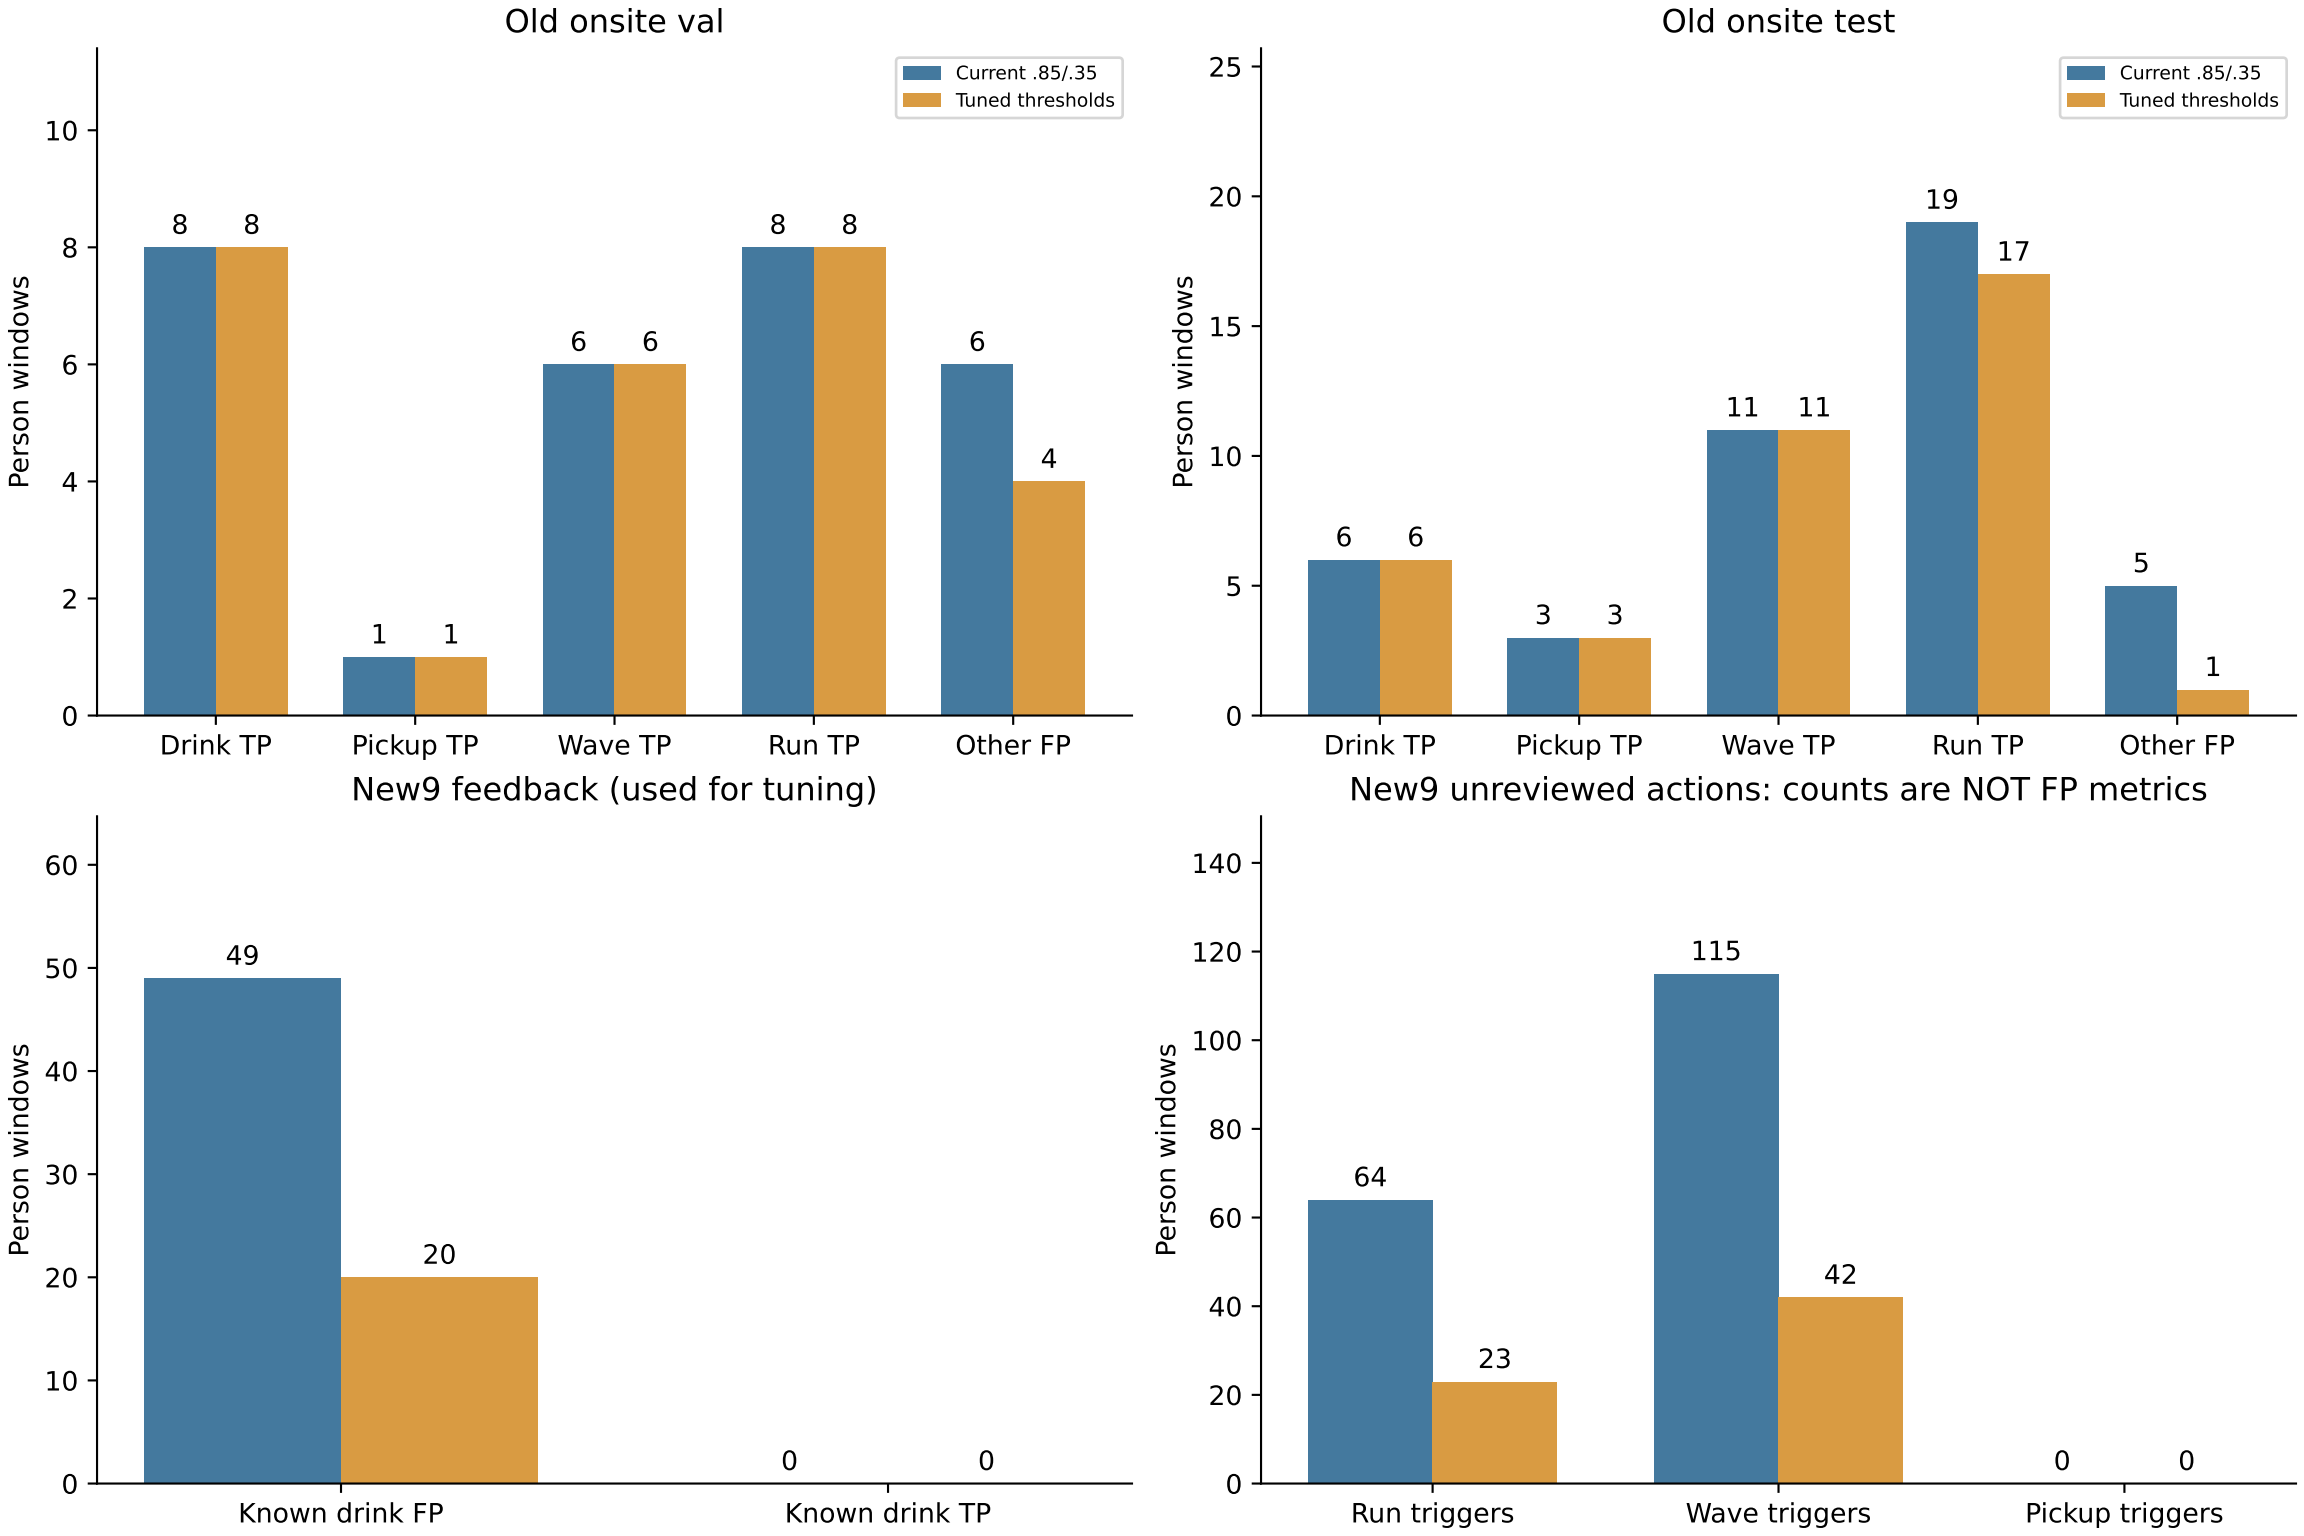
Old onsite val
Current .85/.35
Tuned thresholds
Person windows
Drink TP
Pickup TP
Wave TP
Run TP
Other FP
8 8
1 1
6 6
8 8
6 4
Old onsite test
6 6
3 3
11 11
19 17
5 1
New9 feedback (used for tuning)
49 20
0 0
Known drink FP
Known drink TP
New9 unreviewed actions: counts are NOT FP metrics
64 23
115 42
0 0
Run triggers
Wave triggers
Pickup triggers