



Network Tariff Report 2005

1st March 2005

TABLE OF CONTENTS

1	INTRODUCTION	1
2	OVERVIEW OF NETWORK TARIFF COMPONENTS	1
2.1	DISTRIBUTION USE OF SYSTEM CHARGES (DUoS)	1
2.1.1	<i>The Price Control</i>	2
2.1.2	<i>Re-balancing Constraints</i>	2
2.2	FIXED CHARGE TARIFFS	2
2.2.1	<i>Abolition of distribution standing charges for large customers</i>	3
2.2.2	<i>Amendments to standing charges for smaller customers</i>	3
2.3	INTER DISTRIBUTION SYSTEM CHARGES	3
2.4	TRANSMISSION CHARGES	3
2.4.1	<i>Land Tax</i>	4
2.5	INTERVAL METER TARIFFS	4
2.6	INTERVAL METER TARIFF REASSIGNMENT	ERROR! BOOKMARK NOT DEFINED.
2.7	CURRENT DISTRIBUTION TARIFFS ARE EFFICIENT	4
3	PRICING METHODOLOGY FOR TRANSMISSION CHARGES	6
3.1	TRANSMISSION CHARGES	6
4	NETWORK TARIFFS	7
4.1	LIST OF APPROVED NETWORK TARIFFS	7
4.1.1	<i>Residential Single Rate Tariffs</i>	7
4.1.2	<i>Residential Two Rate Tariffs</i>	8
4.1.3	<i>Residential interval</i>	9
4.1.4	<i>Dedicated Supplies (Storage Water & Space Heating)</i>	10
4.1.5	<i>General Purpose Single Rate .</i>	11
4.1.6	<i>General Purpose Two Rate (5 day peak)</i>	12
4.1.7	<i>General Purpose Interval</i>	13
4.1.8	<i>General Purpose Two Rate (7 day peak)</i>	14
4.1.9	<i>Large Two Rate (7 day peak)</i>	15
4.1.10	<i>Large LV Demand Metered</i>	15
4.1.11	<i>HV Demand Metered</i>	16
4.1.12	<i>HV Demand Metered (D1)</i>	16
4.1.13	<i>Subtransmission</i>	16
4.1.14	<i>Unmetered Supplies</i>	16

LIST OF FIGURES

FIGURE 1: RESIDENTIAL SINGLE RATE – AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	8
FIGURE 2: RESIDENTIAL SINGLE RATE BULK – AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	8
FIGURE 3: RESIDENTIAL TWO RATE – AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	9
FIGURE 4: RESIDENTIAL TWO RATE BULK– AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	9
FIGURE 5: DEDICATED SUPPLIES– AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	10
FIGURE 6: DEDICATED SUPPLIES BULK– AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	11
FIGURE 7: GENERAL PURPOSE SINGLE RATE – AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	11
FIGURE 8: GENERAL PURPOSE SINGLE RATE BULK – AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	12
FIGURE 9: GENERAL PURPOSE TWO RATE (5 DAY PEAK) – AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	13
FIGURE 10: GENERAL PURPOSE TWO RATE (5 DAY PEAK) BULK – AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	13
FIGURE 11: GENERAL PURPOSE TWO RATE (7 DAY PEAK) – AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	14
FIGURE 12: GENERAL PURPOSE TWO RATE (7 DAY PEAK) BULK – AVERAGE ANNUAL BILL BY CUSTOMER SEGMENT	14
FIGURE 13: LARGE TWO RATE (7 DAY PEAK) – AVERAGE ANNUAL BILL (THOUSANDS OF DOLLARS) BY CUSTOMER SEGMENT	15
FIGURE 14: LARGE LV DEMAND METERED (BULK) – AVERAGE ANNUAL BILL (THOUSANDS OF DOLLARS) BY CUSTOMER SEGMENT	15
FIGURE 15: HV DEMAND METERED – AVERAGE ANNUAL BILL (THOUSANDS OF DOLLARS) BY CUSTOMER SEGMENT	16

1 INTRODUCTION

As part of its *Electricity Distribution Price Determination*, the Office of the Regulator General (the Office), now known as the Essential Services Commission (the Commission) required the Distributors prepare an annual report on their network tariffs. This requirement is detailed in clause 2.3.13 of *Electricity Distribution Price Determination - Volume II*.

2 OVERVIEW OF NETWORK TARIFF COMPONENTS

Network tariffs consist of two components:

- Distribution related charges (DUoS) to recover the regulated revenues for the distribution business; and
- Transmission related charges (TUoS) to recover the costs of transmission use of system services provided by Victorian Energy Networks Corporation (VENCorp), transmission connection services provided by SPI PowerNet, equalisation payments prescribed by regulation and inter distribution system charges.

These various components are described in detail in Sections 2.1 to 2.6 below.

2.1 *Distribution Use of System Charges (DUoS)*

Leading up to each five year regulatory period the Commission determines the revenue requirement for each distribution business over the next regulatory period. The Office has utilised a building block methodology to determine the amount of required revenue for the purposes of the previous price review. Recovery of the aggregate distribution revenue requirement determined by the Commission is achieved through the application of DUoS tariffs. In terms of distribution prices from 2001 to 2005, the final outcome of the Distribution Price Review for CitiPower was a real reduction in average distribution prices of 11.2% in 2001 and 1% in subsequent years. This 1% reduction is reflected in the approved 2005 tariffs.¹

The application of distribution tariffs is governed by the price controls established by the Office, and contained in the *Electricity Distribution Price Determination 2001-2005 – Volume II*. The key provisions of this document define:

- The price control mechanisms applied to determine whether proposed prices are compliant; and
- The constraints on adjusting existing tariffs, called re-balancing constraints.

¹ CitiPower's network tariff schedules are contained in Appendix 1 of this document.

2.1.1 The Price Control

The Office has introduced a tariff based approach to regulate Distribution prices which is essentially a CPI-X price control based on tariff components weighted by their respective component quantities. The price regulation mechanism is based entirely on actual sales and does not rely on forecasts.²

- The maximum $(1+CPI_t)*(1-X_t)*(1+St)$ ratio allowed for 2005 is 1.0165 based on:-
- All Groups Index, Weighted Average of Eight Capital Cities, September quarter 2004 of 145.4
- All Groups Index, Weighted Average of Eight Capital Cities, September quarter 2003 of 142.1
- X_t for 2005 of .01
- St for 2005 of .003474

2.1.2 Re-balancing Constraints

The average price of a network tariff is limited by the re-balancing constraint. This control effectively limits the rate of increase of individual network tariffs. The re-balancing constraint for 2005 for both transmission and distribution tariffs is CPI plus 2%.

Due to large price increases from Vencorp, the re-balancing control on transmission tariffs has been increased to CPI plus 20% for 2005. Despite this increase the constraint prevented CitiPower from pricing transmission charges to fully recover expected transmission costs. Any under collection will be added to the 2006 tariffs through the correction factor.

2.2 Fixed charge tariffs

A large proportion of a distribution business' costs are fixed. A consequence of a predominantly fixed cost business is that a customer's consumption pattern will only impact on costs when the distribution assets servicing that customer fall due for renewal.

Levying a customer a variable charge where costs are fixed will result in large energy users subsidising small energy users. Hence where suitable metering is available CitiPower has sought to closely align the recovery of fixed costs through fixed charges ie. through minimum demand charges. At present the minimum demand thresholds are 10,000 kW, 1,000 kW and 120 kW.

For domestic and small customers a standing charge is applied as a proxy for the recovery of fixed costs. In the interests of not disadvantaging small customers, CitiPower has placed

² For a comprehensive description of the price controls see Office's "Electricity Distribution Price Determination 2001-2005, Volume II – Price Controls"

a relatively low reliance on standing charges. After analysis of the current application of standing charges, CitiPower has made the following amendments effective 1 January 2005:

2.2.1 Abolition of distribution standing charges for large customers

This applies to all large low voltage, high voltage and subtransmission distribution tariffs. Standing charges for these customers were largely insignificant; comprising less than 3 per cent of the average customer bill. CitiPower has withdrawn standing charges for these distribution tariffs. These customers continue to make a contribution to the fixed costs of the network through demand charges.

2.2.2 Amendments to standing charges for smaller customers

This applies to all residential, dedicated supplies and general purpose distribution tariffs. Standing charges were levied on the distribution but not transmission tariffs for small customers. Given the fixed nature of part of the transmission costs incurred by CitiPower, it is appropriate for part of the transmission costs to be recouped by way of a standing charge. This will align small customers with large customers, where transmission costs are recouped partly by way of a fixed (i.e. demand) charge.

However, small customers are very sensitive to increases in standing charges, especially those for whom standing charges make up a large proportion of their electricity bill. CitiPower is aware of this and has offset the new transmission standing charges by reducing the distribution standing charges so that, at a network tariff level, 2005 standing charges are equal to their 2004 levels. From a distribution perspective, this has the added benefit of providing a stronger demand management signal to customers, as the inverse block structure is now of increased importance.

2.3 *Inter Distribution System Charges*

The CitiPower distribution network is interconnected with the neighbouring distribution businesses of AGL and United Energy. These interconnected DBs buy and sell distribution capacity across their distribution boundaries. This practice is efficient and avoids the unnecessary duplication of assets.

CitiPower is a net purchaser of inter-DB capacity and under the existing pricing regulations these net costs are recovered through the Network Tariffs.

2.4 *Transmission Charges*

Costs associated with the use of and the connection to the Transmission system are incurred by CitiPower and incorporated into the transmission component of CitiPower's Network Tariffs to be passed through to distribution customers.

The elements of TUoS are: Prescribed Connection Charges, Excluded Transmission Services, Transmission Use of System charges, Equalisation and Inter Distribution System

Charges. For a more detailed description of each of these elements please refer to CitiPower's Distribution Price Review Submission of December 1999.

2.4.1 Land Tax

The Victorian Government on 1 July 2004 abolished the smelter levy charged on retailers under the National Electricity Code and replaced it with a land tax on transmission easements resulting in a marked increase in TUoS charges levied by SPI Powernet and VENCORP to the distribution businesses. The impact of the land tax on transmission easements on the distributor's TUoS charges commenced from 1 July 2004. However, the price controls only provide for adjustment to tariffs on an annual basis. Therefore, the land tax recovery in 2005 will be for the period 1 July 2004 to 31 December 2004 of \$5.1M and 1 January 2005 to 31 December 2005 of \$10.5M. As a result, customers TUoS energy component of their network bill will increase in 2005 in proportion to the original smelter levy.

2.5 Interval meter tariffs

The Commission is amending the Electricity Customer Metering Code to require distributors to complete an accelerated roll out of interval meters to off peak customers by 2012. All new and replacement meters will also be required to be interval meters and some new CitiPower customers will receive an interval meter in 2005.

Given this, CitiPower has introduced new interval meter tariffs from 1 January 2005. CitiPower now offers four interval meter tariffs, residential interval (C3R), residential interval bulk (C3RB), general purpose interval (C3G) and general purpose interval bulk (C3GB). The purpose of the tariffs is two-fold:

- To support the gathering of information from CitiPower's meter data management system to better understand the consumption patterns of customers that have interval meters installed; and
- To allow for distribution tariffs for interval metered customers to be amended over time to gradually create more efficient price signals for customers.

Initially the charges and structures for these interval meter tariffs will be equivalent to their two rate equivalents i.e. C3R = C2R, C3RB = C2RB etc. As a consequence of these changes, for 2005 only C1R, C1RB, C3R, C3RB, C1G, C1GB, C3G and C3GB are intended to remain available to new residential and small business customers.

2.6 Current distribution tariffs are efficient

Under clause 2.3.12 of the *Electricity Distribution Price Determination 2001-2005 - Volume II Price Controls* of September 2000 distributors are required to have regard to the "efficient window" in the setting of distribution tariffs. The "efficient window" is defined as follows:

- the lower bound - each distribution tariff should be above the marginal cost of serving the customers assigned to that tariff; and

- the upper bound - each distribution tariff should be below the stand-alone cost of serving the customers assigned to that tariff.

CitiPower's distribution tariffs are within the efficient cost window according to the Commission's criteria." CitiPower will continue to monitor its existing tariffs and all proposed new tariffs to ensure they remain efficient.

3 PRICING METHODOLOGY FOR TRANSMISSION CHARGES

The transmission charges which CitiPower pays to VENCORP and SPI PowerNet consist of components that can be separated into demand based and energy based components. These components are then recovered on the basis of “user pays”, to the extent allowed by the binding re-balancing constraint discussed in section 2.1, to derive the TUoS price components of the Network Tariffs.

The following elements of the Transmission Charges were assigned to the Demand component:

- Connection charges;
- Maximum Demand Charges;
- Energy Charges;

The remaining elements listed below were allocated to the Energy Component:

- VENCORP Common Service Charge (\$/MW on all energy transmitted); and
- Equalisation Adjustment (a tax which should be recovered in a manner that gives rise to the least possible distortion of economic signals).

From these components a demand and energy price were calculated.

With reference to experience in the Network Planning group and from the End Use Measurement Survey, it was possible to arrive at a series of load factors and peak contribution factors which were used to allocate transmission costs to the tariff groups in proportion to the demand presented at the time of CitiPower’s system peak and the total energy consumed on the basis of the demand and energy prices derived above.³

3.1 *Transmission Charges*

The transmission charges are then established to collect the required revenue on the basis of available metering data. For example, the price for single rate customers is derived by subtracting the standing charge revenue from the total revenue required then dividing the result by the forecast energy.

For residential customers it can be assumed that there is a reasonable correlation between energy usage and contribution to the local and system network maximum demand. Network tariffs for larger customers contain a demand related component which in part reflects the cost of transmission system usage.

Energy components of transmission charges such as the Common Service Charge and the Equalisation payment have been allocated to energy components of the transmission tariffs including the off-peak components.

³ The End Use Measurement Study commenced in 1994 as a Victorian Distribution Industry load monitoring study. Smart meters compile load data on a sample of residential, commercial and industrial customers.

4 NETWORK TARIFFS

As required by the Office's Final Determination, CitiPower has produced a schedule of network, distribution and transmission tariffs. The network tariffs are a simple addition of the distribution and transmission components. These tariff schedules are available in Table 1, Table 2 and Table 3. These tariffs recover the distribution revenue requirement (as set out in the Office's Price Determination) plus the assumed transmission and inter distribution business charges.

CitiPower recognises that tariff design ultimately requires compromises to be reached in relation to a range of conflicting objectives such as:

- economic efficiency;
- energy efficiency;
- pricing stability;
- commercial imperatives; and
- customer equity.

CitiPower has considered, and will continue to consider, in an even-handed way, the trade-offs between these objectives, in formulating new tariffs or modifications to existing ones. These objectives are embodied in CitiPower's network charges, discussed in section 5 below.

4.1 List of approved Network Tariffs

Each of CitiPower's network tariffs are examined in the sections below. All prices and annual bill calculations exclude GST.

4.1.1 Residential Single Rate Tariffs

The Residential Single Rate and Residential Single Rate - Bulk tariffs were originally based on retail Maximum Uniform Tariffs (MUTs) for residential customers. The price for the first 340 kWh per month is slightly lower than for the balance.

This inverse block structure has been introduced to the residential network tariff to maintain a positive rudimentary demand management signal to larger than average consumers. The average consumption of CitiPower single rate residential customers is approximately 4300 kWh per annum which is close to the 340 kWh per month (4080 kWh per annum) used in the MUTs GD and GR. For simplicity the same 340 kWh per month transition point has been retained.

On the basis that residential customers, in aggregate, present a different demand profile to commercial and industrial customers these tariffs are restricted to residential customers. Figures 1 and 2 below illustrate diagrammatically the impact the significant reductions have

had in delivering price reductions to small residential customers, and the block structure in providing a price incentive to large residential customers.

Figure 1: Residential Single Rate – Average Annual Bill by Customer Segment


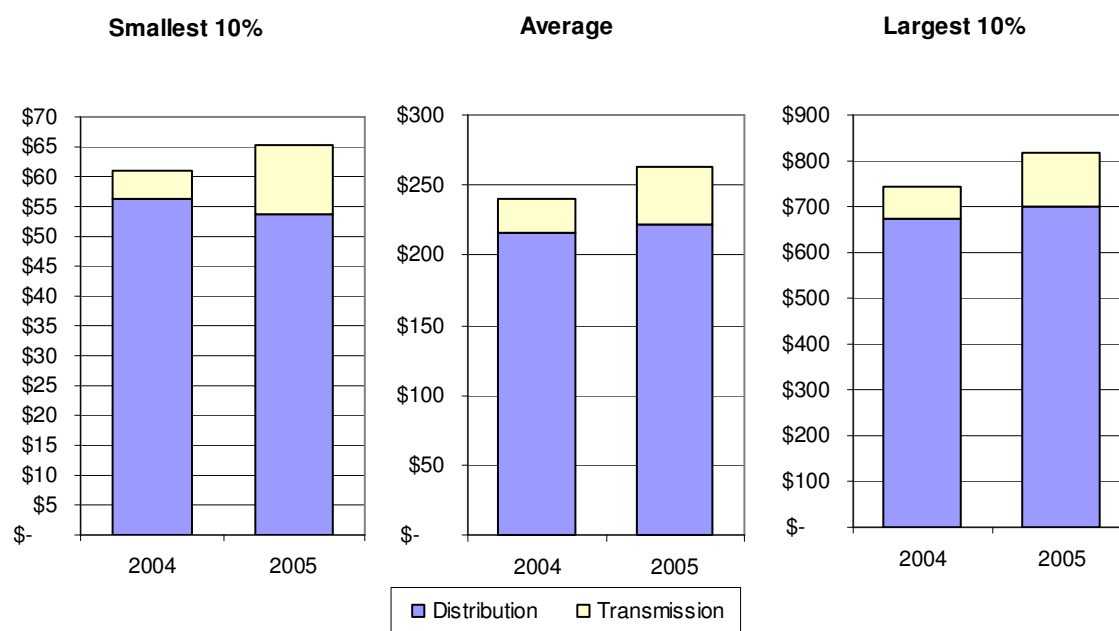


Figure 2: Residential Single Rate Bulk – Average Annual Bill by Customer Segment

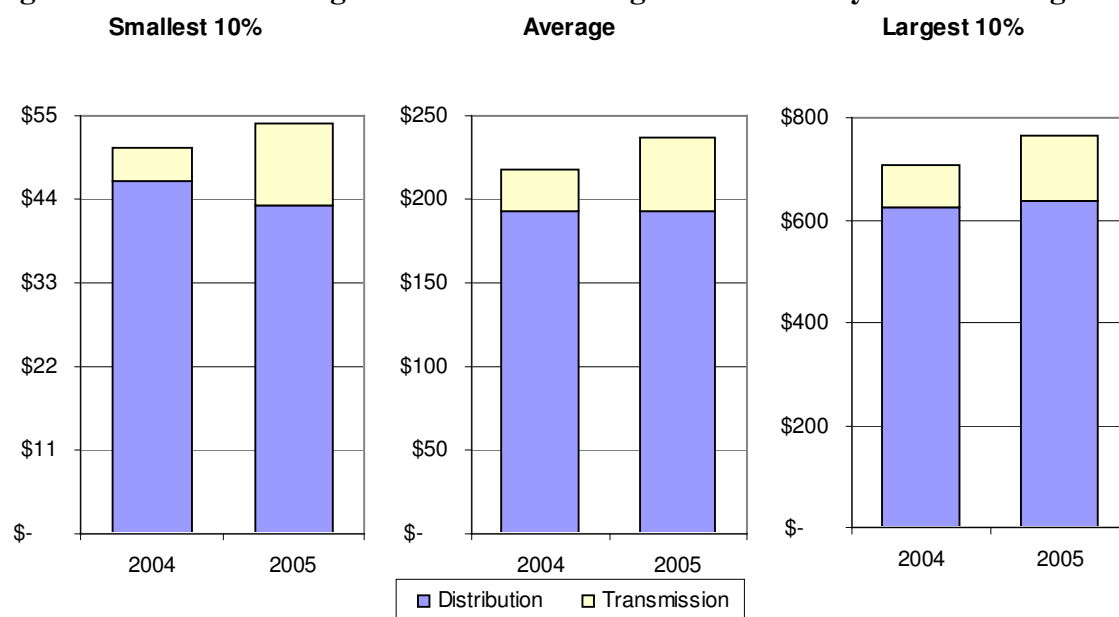

4.1.2 Residential Two Rate Tariffs

The Residential Two Rate and Residential Two Rate - Bulk tariffs were originally also based on retail Maximum Uniform Tariffs (MUTs) for residential customers and include a rudimentary demand signal through the differential pricing for time of use. On the basis that residential customers, in aggregate, present a different demand profile to commercial and industrial customers these tariffs are restricted to residential customers.

The impact of these tariffs is shown diagrammatically in Figures 3 and 4 below.

From 1 January 2005, C2R and C2RB are only available to customers who have an existing C2R or C2RB configuration. Customers who would previously have been connected to these tariffs will be connected to CitiPower's C3R residential interval and C3RB residential interval bulk network tariffs. If suitable interval metering is not available (as will be the case with multi phase customers initially) new customers will continue to be connected to CitiPower's C2R residential two rate or the C2RB residential two rate bulk tariffs.

Figure 3: Residential Two Rate – Average Annual Bill by Customer Segment


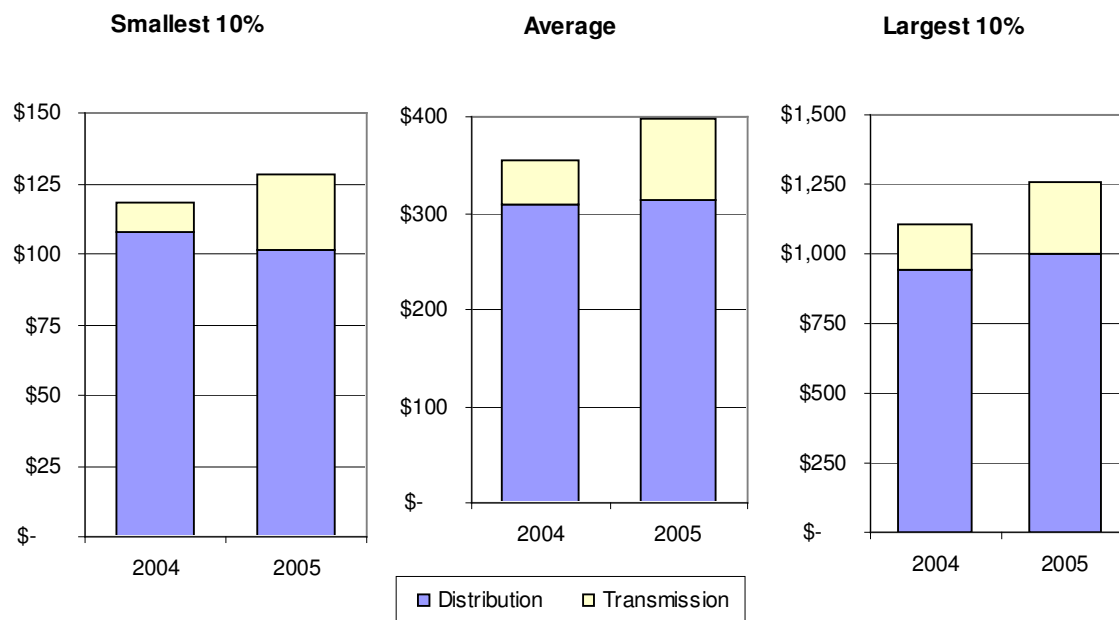


Figure 4: Residential Two Rate Bulk– Average Annual Bill by Customer Segment

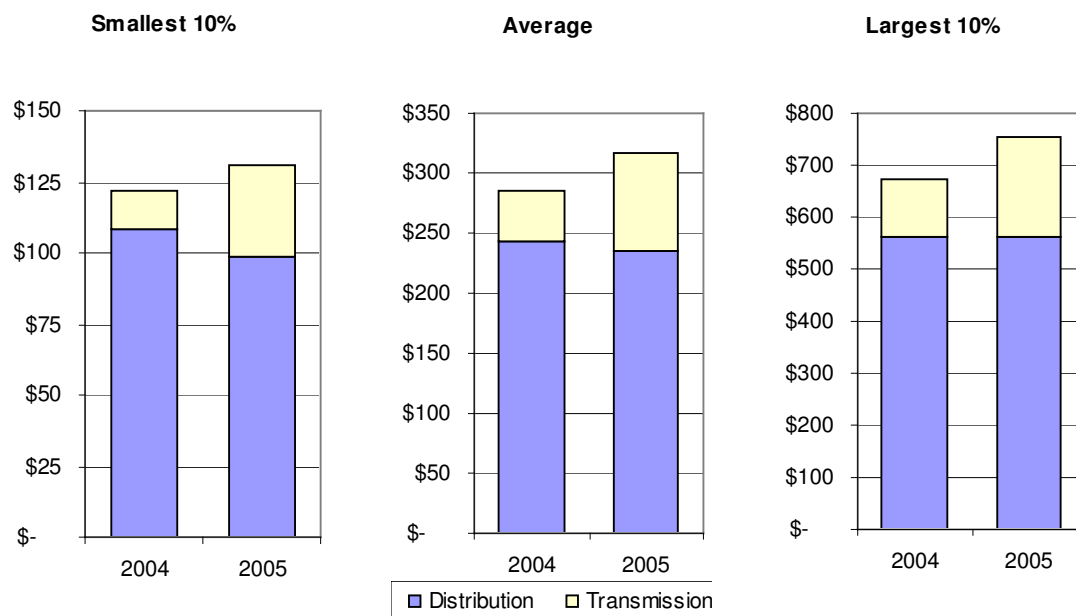

4.1.3 Residential interval

The Residential Interval and Residential Interval-Bulk tariffs apply to residential interval meter customers. This network tariff is for general domestic usage such as lights and power.

The tariff includes a fixed standing charge, peak and off-peak energy charge. The peak charge applies between 7am and 11pm, Monday to Friday. Off-peak periods, such as the weekend and overnight, have a very low rate relative to the peak charge.

4.1.4 Dedicated Supplies (Storage Water & Space Heating)

The Dedicated Supplies and the Dedicated Supplies-Bulk tariffs are available for controlled loads such as storage water heating and space heating for residential purposes only. Being controlled loads, they make no contribution to peak demands on either the transmission or distribution system.

These tariffs currently make a substantial contribution to the total revenue without driving capacity increase while at the same time facing intense competition from alternative fuel sources such as natural gas. Therefore the large reductions in the 2001 rates to make these tariffs more affordable have been maintained. This should help discourage these sales being unnecessarily eroded to the detriment of system utilisation and therefore overall economic efficiency of the distribution network.

From 1 January 2005, CDS and CDSB are only available to customers who have an existing CDS or CDSB configuration.

Customers who would previously have been connected to these tariffs will be connected to CitiPower's C3R residential interval and C3RB residential interval bulk network tariffs. If suitable interval metering is not available (as will be the case with multi phase customers initially) new customers will be connected to CitiPower's C2R residential two rate or the C2RB residential two rate bulk tariffs.

Figure 5: Dedicated Supplies– Average Annual Bill by Customer Segment


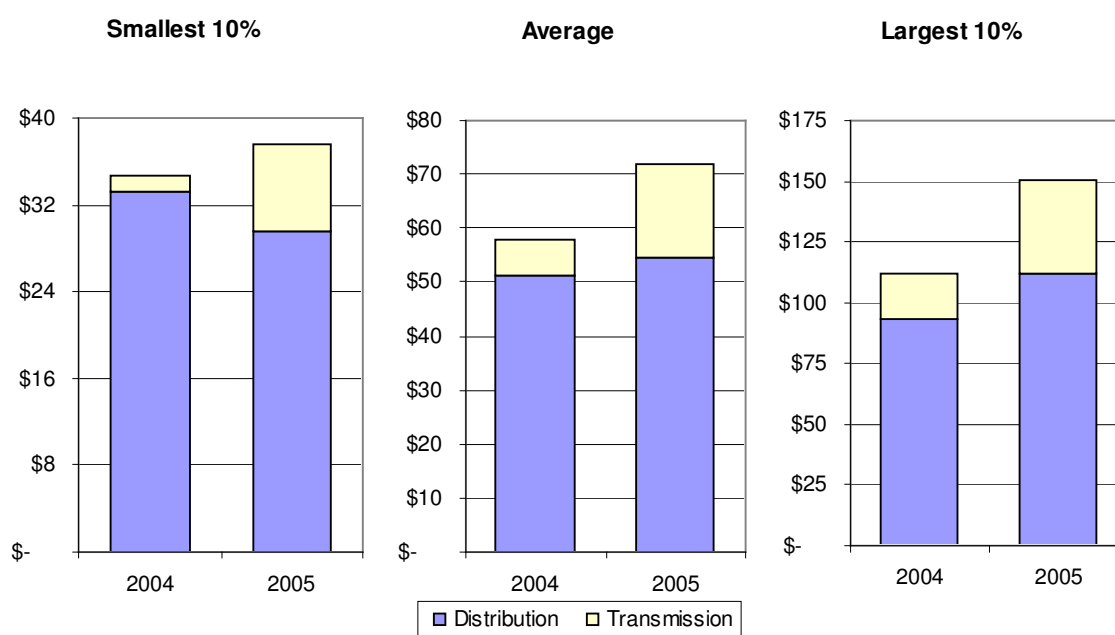


Figure 6: Dedicated Supplies Bulk– Average Annual Bill by Customer Segment

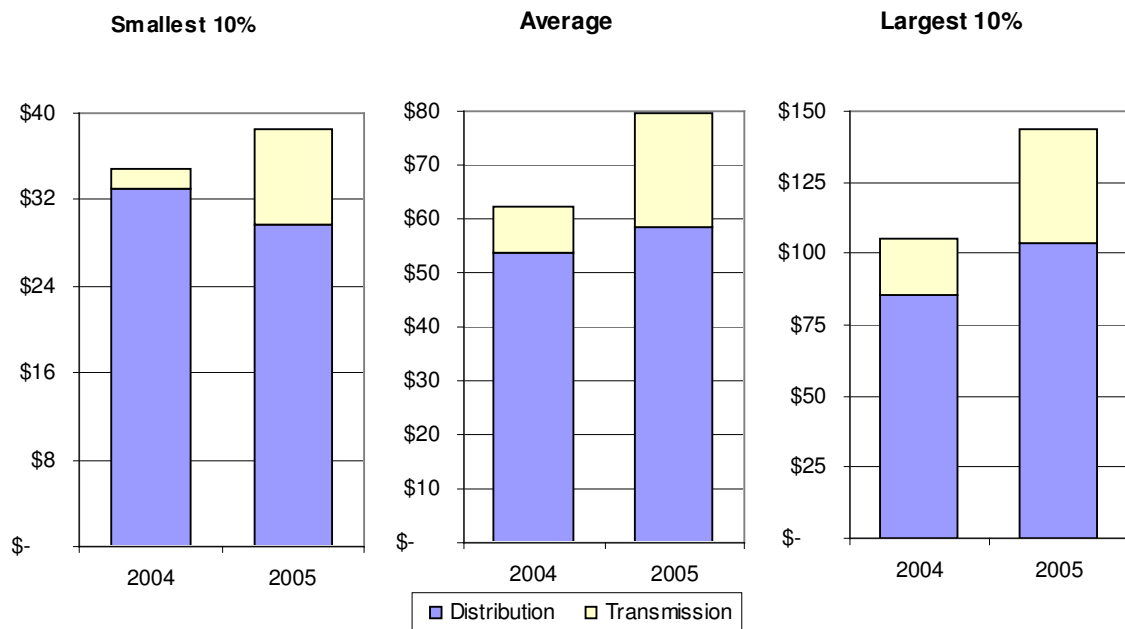

4.1.5 General Purpose Single Rate .

The General Purpose Single Rate and the General Purpose Single Rate-Bulk tariffs are available to small and medium business and industrial customers.

No major changes have been made to the structure of these tariffs and new customers are encouraged to consider the interval or maximum demand tariffs as an alternative, as they promote more efficient utilisation of the network by providing a time of use signal.

Figure 7: General Purpose Single Rate – Average Annual Bill by Customer Segment


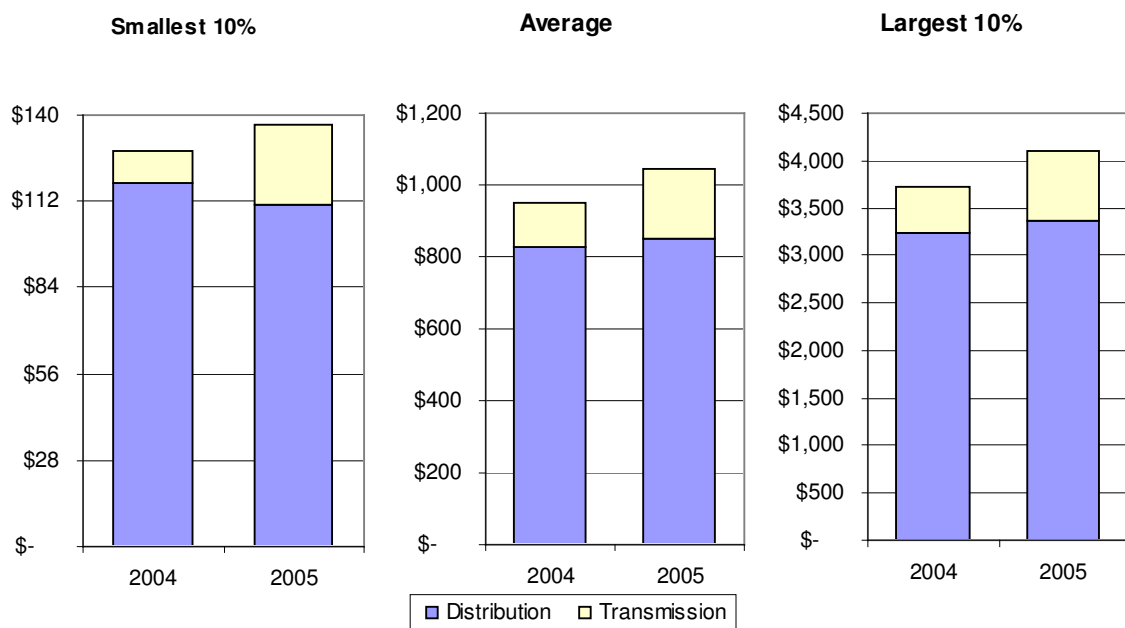


Figure 8: General Purpose Single Rate Bulk – Average Annual Bill by Customer Segment

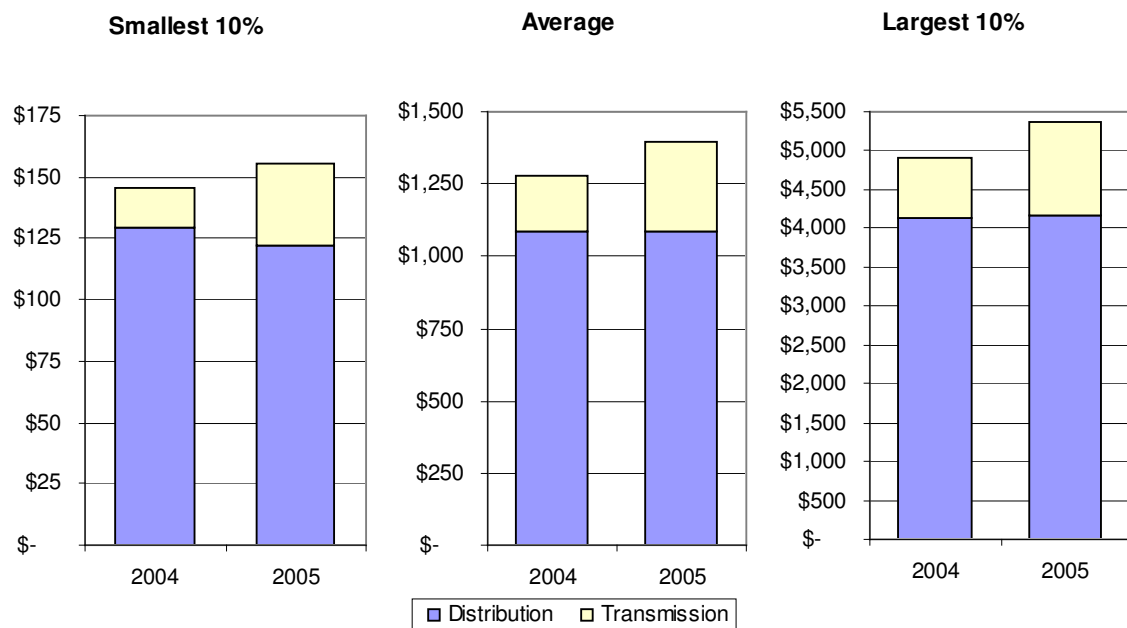

4.1.6 General Purpose Two Rate (5 day peak)

The General Purpose Two Rate (5 day peak) and the General Purpose Two Rate (5 day peak)-Bulk tariffs were based on the two rate General Purpose MUT used by small and medium business and industrial customers and include a rudimentary demand signal through the differential pricing for time of use.

The impact of these tariffs is shown diagrammatically in Figures 3 and 4 below.

From 1 January 2005, C2G5 and C2G5B are only available to customers who have an existing C2G5 or C2G5B configuration. Customers who would previously have been connected to these tariffs will be connected to CitiPower's C3G General Purpose Interval and C3GB General Purpose Interval bulk network tariffs. If suitable interval metering is not available (as will be the case with multi phase customers initially) new customers will continue to be connected to CitiPower's C2G5 General Purpose two rate (5 day peak) or the C2G5B General Purpose (5 day peak) bulk tariffs.

Figure 9: General Purpose Two Rate (5 day peak) – Average Annual Bill by Customer Segment


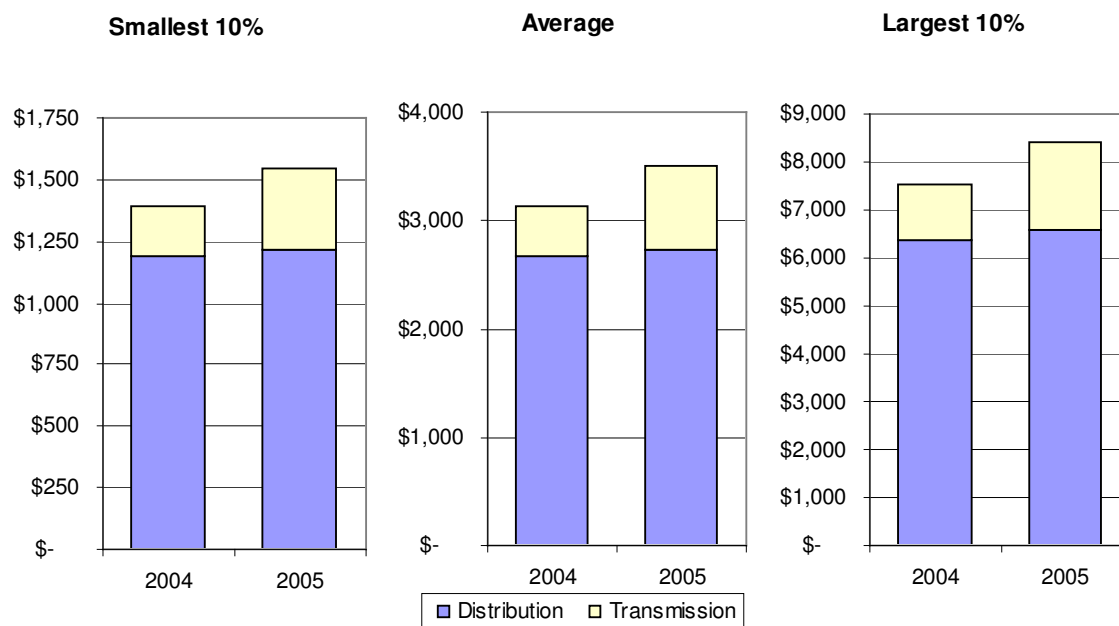


Figure 10: General Purpose Two Rate (5 day peak) Bulk – Average Annual Bill by Customer Segment

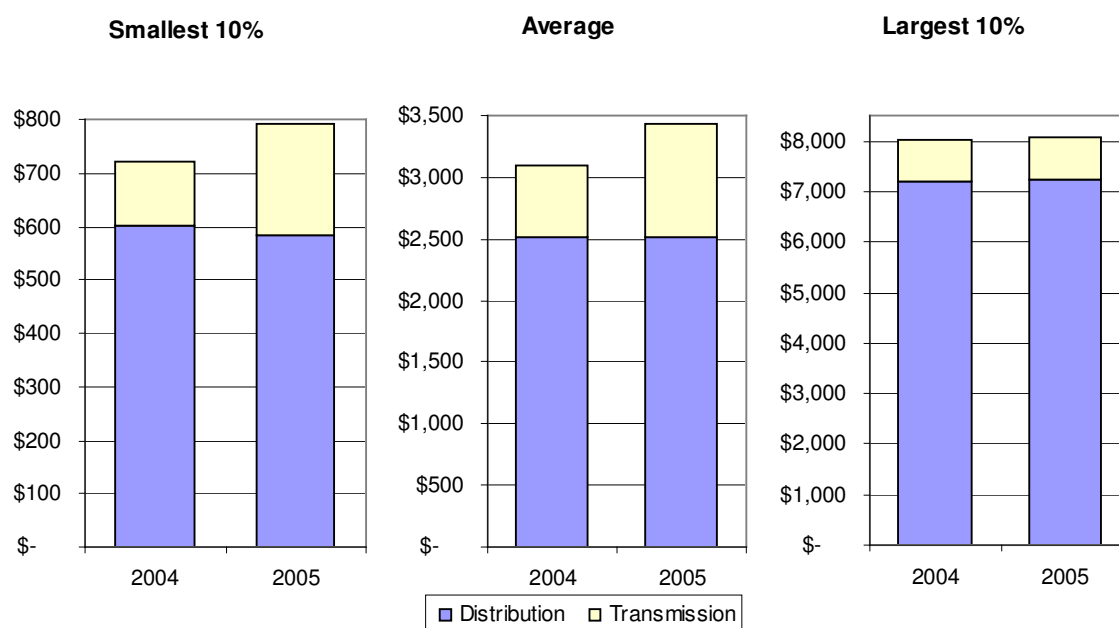

4.1.7 General Purpose Interval

The General Purpose Interval and General Purpose Interval-Bulk tariffs apply to small business interval meter customers. The tariff includes a fixed standing charge, peak and off-peak energy charge. The peak charge applies between 7am and 11pm, Monday to Friday. Off-peak periods, such as the weekend and overnight, have a very low rate relative to the peak charge.

4.1.8 General Purpose Two Rate (7 day peak)

These tariffs were based on the obsolete MUT E1, and are available only to existing installations supplied under this tariff. Existing customers are encouraged to consider the interval or maximum demand tariffs as an alternative because they promote more efficient utilisation of the network by providing an appropriate time of use signal.

Figure 11: General Purpose Two Rate (7 day peak) – Average Annual Bill by Customer Segment


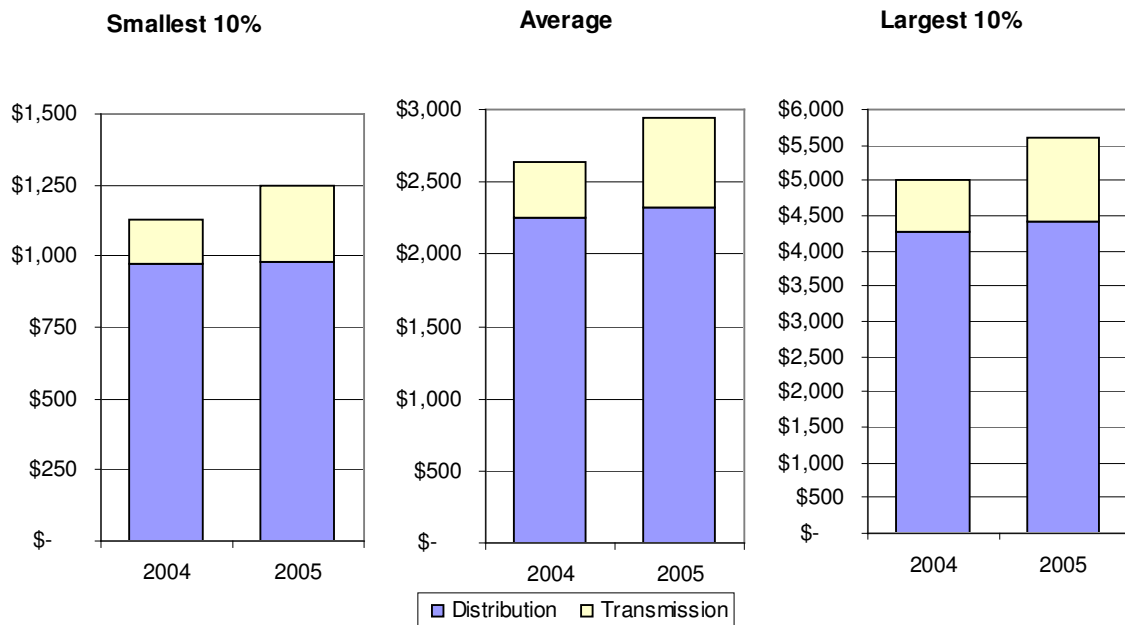


Figure 12: General Purpose Two Rate (7 day peak) Bulk – Average Annual Bill by Customer Segment

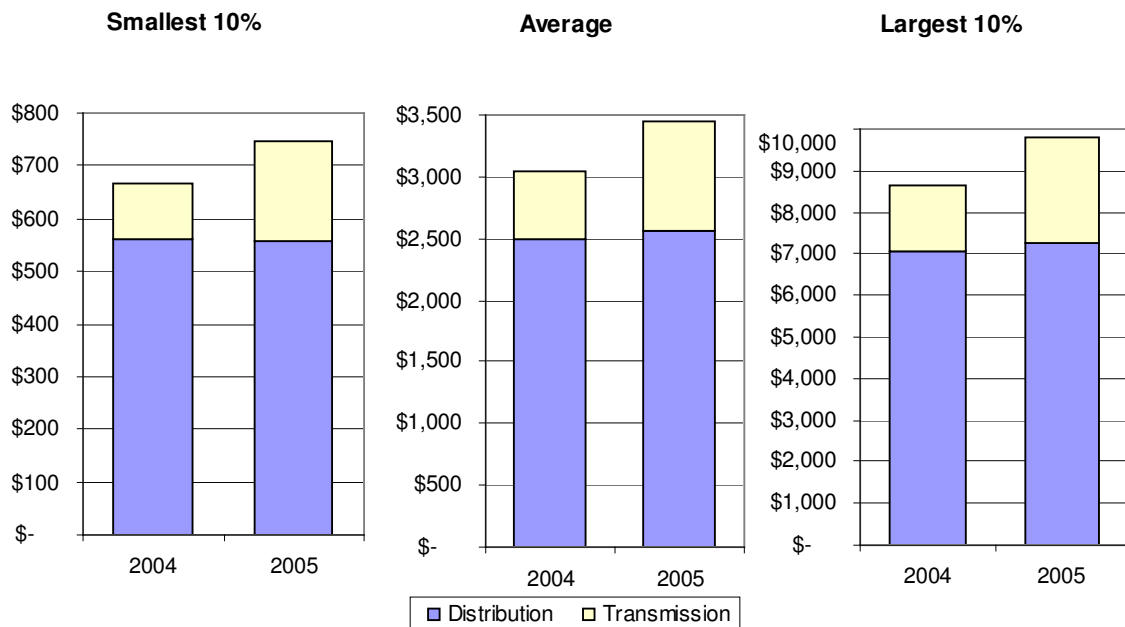


4.1.9 Large Two Rate (7 day peak) Bulk

This tariff is based on the obsolete MUT E1 and is available only to existing installations supplied under this tariff. There are relatively few customers supplied under this tariff and they are encouraged to consider the Large LV Demand metered tariff as an alternative

because it promotes more efficient utilisation of the network by providing an appropriate time of use signal.

Figure 13: Large Two Rate (7 day peak) Bulk – Average Annual Bill (thousands of dollars) by Customer Segment

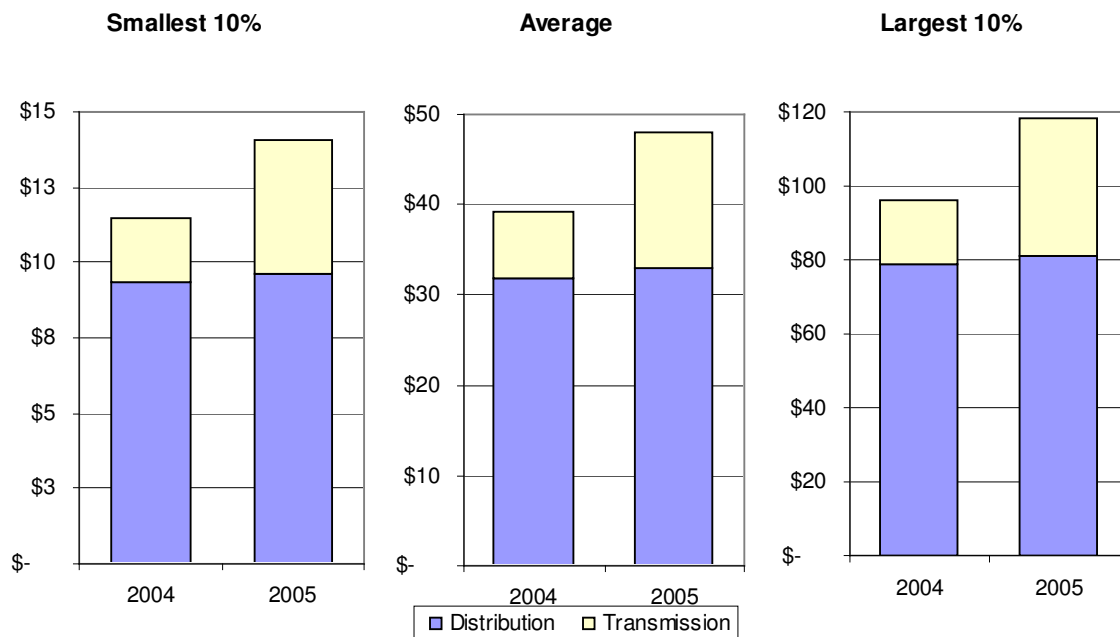


4.1.10 Large LV Demand Metered

The Large LV Demand Metered and Large LV Demand Metered Bulk tariffs are designed for larger commercial and industrial customers and provide both a demand signal and a time of use signal to promote efficient network use.

The calculation of the demand component is based on a “contract demand” which sets minimum billed demand for at least one billing year.


Figure 14: Large LV Demand Metered (Bulk) – Average Annual Bill (thousands of dollars) by Customer Segment

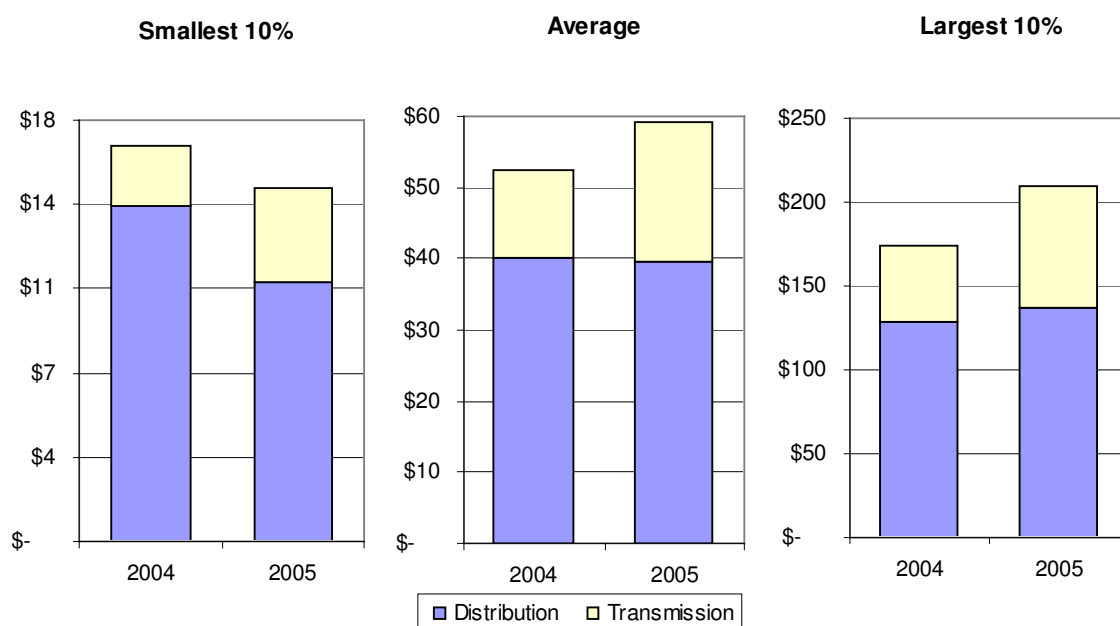

4.1.11 HV Demand Metered

This tariff is designed for larger commercial and industrial customers who require high voltage supply. It provides both a demand signal and a time of use signal to promote efficient network use. As with the Large LV Demand Metered Tariff, the calculation of the demand component is based on a “contract demand”.

Figure 15: HV Demand Metered – Average Annual Bill (thousands of dollars) by Customer Segment

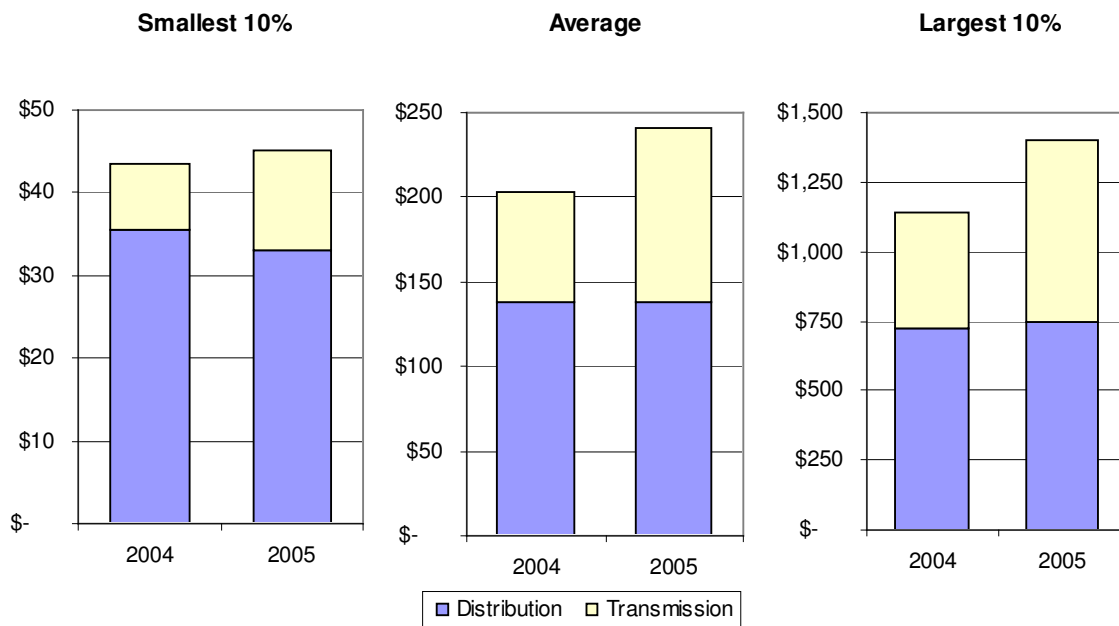

4.1.12 HV Demand Metered (D1)

This tariff is designed for larger commercial and industrial customers who require high voltage supply (with a total maximum demand greater than 40,000kW) who are connected at 11/6.6kV via 2 or more dedicated closed ring underground feeders without directional powerflow control and without auto/transfer capability. It provides both a demand signal and a time of use signal to promote efficient network use.

4.1.13 Subtransmission

This tariff applies only to a very limited number of large connections operating at 22,000 volts. It is heavily dominated by the transmission component.

4.1.14 Unmetered Supplies

This tariff applies only to those situations where it is not economic to install a meter such as public lighting, telephone cabinets etc.



APPENDIX 1 : DISTRIBUTION TARIFF SCHEDULE

(GST EXCLUSIVE)

1 JANUARY 2005 – 31 DECEMBER 2005

Table 1 – Distribution tariffs effective 1 January 2005

DUoS Tariff	Code	Standing charges \$/cust/pa	Demand charges \$/kW/pa	Minimum Demand kW	Peak charges (c/kWh)		Off peak charges c/kWh
					First 340 kWh/month	Balance	
Residential single rate	C1R	17.432			4.352	5.711	
Residential single rate - Bulk	C1RB	15.032			3.517	4.468	
Residential two rate	C2R	38.920			6.367	6.367	0.937
Residential two rate - Bulk	C2RB	38.368			5.016	5.016	0.803
Residential interval	C3R	38.920			6.367	6.367	0.937
Residential interval - Bulk	C3RB	38.368			5.016	5.016	0.803
Dedicated supplies	CDS	22.480					1.064
Dedicated supplies - Bulk	CDSB	22.208					0.924
General Purpose single rate	C1G	39.264			5.280	5.280	
General Purpose single rate - Bulk	C1GB	33.488			4.217	4.217	
General Purpose two rate (5 day peak)	C2G5	93.248			6.191	6.191	1.427
General Purpose two rate (5 day peak) - Bulk	C2G5B	86.936			4.684	4.684	1.064
General Purpose interval	C3G	93.248			6.191	6.191	1.427
General Purpose interval - Bulk	C3GB	86.936			4.684	4.684	1.064
General Purpose two rate (7 day peak)	C2G7	84.520			5.208	5.208	1.422
General Purpose two rate (7 day peak) - Bulk	C2G7B	77.816			4.044	4.044	1.085
Unmetered supplies	C2U				6.116	6.116	1.495
Large two rate (7 day peak)	C2L7	81.792			4.451	4.451	1.321
Large LV Demand Metered	C2DL		64.310	120	1.106	1.106	1.131
Large LV Demand Metered - Bulk	C2DLB		58.835	120	0.642	0.642	1.038
HV Demand Metered	C2DH		43.670	1,000	0.328	0.328	0.493
HV Demand Metered (D1)	C2DHD1		25.509	40,000	0.075	0.075	0.069
Subtransmission	C2DT		9.660	10,000	0.097	0.097	0.147

Issued by Manager Network Pricing – 1 January 2005.



APPENDIX 1 : TRANSMISSION TARIFF SCHEDULE

(GST EXCLUSIVE)

1 JANUARY 2005 – 31 DECEMBER 2005

Table 2 – Transmission tariffs effective 1 January 2005

TUoS Tariff	Code	Standing charges \$/cust/pa	Demand charges \$/kW/pa	Minimum Demand kW	Peak charges c/kWh		Peak charges c/kWh	Off peak charges c/kWh
					First 1020kWh/qtr	Balance		
Residential Single Rate	C1R				0.554	0.554		
Residential Single Rate - Bulk	C1RB				0.554	0.554		
Residential Two Rate	C2R						0.972	0.222
Residential Two Rate - Bulk	C2RB						0.972	0.222
Dedicated Supplies	CDS							0.221
Dedicated Supplies - Bulk	CDSB							0.222
General Purpose Single Rate	C1G						0.773	
General Purpose Single Rate - Bulk	C1GB						0.773	
General Purpose Two Rate (5 day peak)	C2G5						1.138	0.222
General Purpose Two Rate (5 day peak) - Bulk	C2G5B						1.139	0.221
General Purpose Two Rate (7 day peak)	C2G7						0.908	0.222
General Purpose Two Rate (7 day peak) - Bulk	C2G7B						0.908	0.222
Unmetered Supplies	C2U						0.224	0.221
Large Two Rate (7 day peak) - Bulk	C2L7						0.998	0.214
Large LV Demand Metered	C2DL		5.960	120 kW			0.934	0.214
Large LV Demand Metered - Bulk	C2DL-B		5.860	120 kW			0.919	0.210
HV Demand Metered	C2DH		4.970	1,000 kW			1.015	0.207
HV Demand Metered (D1)	C2DHD1		6.920	40,000 kW			0.973	0.316
Subtransmission	C2DT		2.000	10,000 kW			1.133	0.192

Issued by Manager Network Pricing – 1 January 2005.



APPENDIX 1 : NETWORK TARIFF SCHEDULE

(GST EXCLUSIVE)

1 JANUARY 2005 – 31 DECEMBER 2005

Table 3 – Network tariffs effective 1 January 2005

NUoS Tariff	Code	Standing charges \$/cust/pa	Demand charges \$/kW/pa	Minimum Demand kW	Peak charges c/kWh		Peak charges c/kWh	Off peak charges c/kWh
					First 1020kWh/qtr	Balance		
Residential Single Rate	C1R	21.790			4.690	5.981		
Residential Single Rate - Bulk	C1RB	18.790			3.986	4.913		
Residential Two Rate	C2R	48.650					6.410	1.469
Residential Two Rate - Bulk	C2RB	47.960					5.463	1.249
Dedicated Supplies	CDS	28.100						0.994
Dedicated Supplies - Bulk	CDSB	27.760						0.876
General Purpose Single Rate	C1G	49.080					5.846	
General Purpose Single Rate - Bulk	C1GB	41.860					4.959	
General Purpose Two Rate (5 day peak)	C2G5	116.560					7.103	1.597
General Purpose Two Rate (5 day peak) - Bulk	C2G5B	108.670					5.793	1.278
General Purpose Two Rate (7 day peak)	C2G7	105.650					5.918	1.590
General Purpose Two Rate (7 day peak) - Bulk	C2G7B	97.270					4.811	1.269
Unmetered Supplies	C2U						6.064	1.649
Large Two Rate (7 day peak) - Bulk	C2L7	102.240					5.323	1.498
Large LV Demand Metered	C2DL	3,847.640	68.810	120 kW			1.736	1.034
Large LV Demand Metered - Bulk	C2DL-B	3,847.640	63.360	120 kW			1.417	1.016
HV Demand Metered	C2DH	2,510.060	48.640	1,000 kW			1.315	0.657
HV Demand Metered (D1)	C2DHD1	2,462.160	31.850	40,000 kW			1.042	0.380
Subtransmission	C2DT	2,530.060	11.660	10,000 kW			1.219	0.322

Issued by Manager Network Pricing – 1 January 2005.

The following terms apply:

- (a) C2R, C2RB, C2G5, C2G5B, C2G7, C2G7B and C2L7 are only available to existing customers who have these configurations.
- (b) C3R residential interval meter tariff is available to small interval meter customers.
- (c) C3RB residential interval meter bulk tariff is available to small interval meter bulk customers.
- (d) C3G general purpose interval meter tariff is available to general purpose interval meter customers.
- (e) C3GB general purpose interval meter bulk tariff is available to general purpose interval meter bulk customers.
- (f) C2U is restricted to supply points with a demand less than 500 Watts.
- (g) Tariff HV Demand Metered (D1) applies to sites with a maximum demand greater than 40,000kW who are connected at 11/6.6kV via 2 or more dedicated closed ring underground feeders without directional powerflow control and without auto/transfer capability.
- (h) Tariffs designated "Bulk" apply to customers supplied directly from on site substation terminals where there are no Citipower low voltage distribution assets beyond the substation.