



# Annual network prices report

1 July 2010 – 30 June 2011

**countryenergy**

## TABLE OF CONTENTS

|       |                                                                           |    |
|-------|---------------------------------------------------------------------------|----|
| 1     | BACKGROUND .....                                                          | 4  |
| 1.1   | Background .....                                                          | 4  |
| 1.2   | Our Proposal.....                                                         | 4  |
| 1.3   | Our Business.....                                                         | 4  |
| 1.4   | Network Investment and Challenges .....                                   | 5  |
| 2     | PRICES FOR NETWORK DISTRIBUTION SERVICES.....                             | 6  |
| 3     | FORTHCOMING CHANGES IN NETWORK TARIFFS .....                              | 7  |
| 4     | REGULATORY COMPLIANCE .....                                               | 7  |
| 4.1   | Overview .....                                                            | 7  |
| 4.2   | Weighted average price cap .....                                          | 7  |
| 4.3   | Transmission-related cost recovery arrangements.....                      | 8  |
| 4.4   | Consumer price index.....                                                 | 8  |
| 4.5   | Climate change levy .....                                                 | 8  |
| 4.6   | Limits on network price movements.....                                    | 9  |
| 5     | IMPACT OF FORTHCOMING CHANGES TO NETWORK TARIFFS .....                    | 9  |
| 5.1   | Expected network price increases 2010/11 to 2013/14.....                  | 10 |
| 6     | PRICING PRINCIPLES AND COST ALLOCATION.....                               | 11 |
| 6.1   | Network prices based on incremental and stand-alone cost principles ..... | 11 |
| 6.2   | Network prices based on fully distributed cost principles.....            | 12 |
| 6.3   | Network customer classes.....                                             | 12 |
| 6.3.1 | Standard customer classes .....                                           | 12 |
| 6.3.2 | Locational specific customer class .....                                  | 13 |
| 6.4   | Overview of network pricing methodology .....                             | 13 |
| 6.5   | Calculation of annual revenue requirements .....                          | 13 |
| 6.6   | Network cost drivers .....                                                | 14 |
| 6.6.1 | Customer related cost driver .....                                        | 14 |
| 6.6.2 | Demand-related cost driver .....                                          | 14 |
| 6.6.3 | Energy related cost driver .....                                          | 15 |
| 6.6.4 | Common service costs .....                                                | 15 |
| 6.7   | Network price components.....                                             | 15 |
| 6.7.1 | Demand charges .....                                                      | 15 |
| 6.7.2 | Energy charges (network usage charges).....                               | 16 |

|                                                                                             |           |
|---------------------------------------------------------------------------------------------|-----------|
| 6.7.3 Network access charges (fixed charges) .....                                          | 16        |
| <b>6.8 Fully distributed cost of supply modelling .....</b>                                 | <b>16</b> |
| 6.8.1 Allocation of network costs to asset cost pools .....                                 | 17        |
| 6.8.2 Network asset categories (cost pools) .....                                           | 17        |
| <b>6.9 Cost allocation to asset categories .....</b>                                        | <b>18</b> |
| 6.9.1 Asset related costs .....                                                             | 19        |
| 6.9.2 Conversion of cost pools to usage-based network prices .....                          | 19        |
| 6.9.3 CRNP customer class .....                                                             | 19        |
| 6.9.4 Standard customer classes .....                                                       | 20        |
| 6.9.5 Controlled load customer class .....                                                  | 21        |
| <b>6.10 Allocation of transmission network costs .....</b>                                  | <b>21</b> |
| <b>6.11 Incremental and stand alone cost allocation process .....</b>                       | <b>22</b> |
| <b>6.12 Setting of price structures and levels .....</b>                                    | <b>24</b> |
| 6.12.1 Factors considered .....                                                             | 24        |
| 6.12.2 Network tariff classes .....                                                         | 24        |
| 6.12.3 Cost reflective network prices and cross subsidies .....                             | 25        |
| <b>7 EXPECTED LEVELS OF SERVICE AND PROJECTED CAPITAL EXPENDITURE PROJECTS .....</b>        | <b>25</b> |
| <b>7.1 Capital expenditure projects .....</b>                                               | <b>25</b> |
| 7.1.1 Growth in demand and system augmentation .....                                        | 26        |
| 7.1.2 Asset renewal and replacement .....                                                   | 27        |
| 7.1.3 Non-system requirements .....                                                         | 27        |
| <b>7.2 Expected levels of service for the coming year .....</b>                             | <b>28</b> |
| <br>Attachment 1 – Network Price List 2010-11 .....                                         | <br>29    |
| <br>Attachment 2 - Fully Distributed – Standalone Comparison .....                          | <br>30    |
| <br>Attachment 3 - Price Schedule for Miscellaneous, monopoly and emergency work fees ..... | <br>35    |
| <br>Attachment 4 – Country Energy Streetlighting price list .....                           | <br>49    |

## **1 BACKGROUND**

### **1.1 Background**

The Australian Energy Regulator (AER) has economic regulation over distribution network service providers in New South Wales and requires Country Energy to publish an Annual Network Prices Report. This report establishes a process of price notification and review by AER for annual price changes.

The Annual Network Prices Report complies with the requirements of the NSW distribution determination 2009-10 to 2013-14 (the determination), the Electricity DNSP's annual information reporting requirements, section 6.18 of the transitional National Electricity Rules (the Rules) and specifically addresses the following:

- ✓ Prices for network distribution services
- ✓ Forthcoming changes in network prices
- ✓ Compliance with the regulatory arrangements relating to limits on price and revenue movements
- ✓ Impacts of the proposed changes on customers
- ✓ Pricing principles and the allocation of costs
- ✓ Expected levels of service and projected capital expenditure
- ✓ Expected consumption for major customer classes and maximum demand for the coming year.

Enquiries regarding this document should be directed to:

Network Pricing  
PO Box 718  
Queanbeyan NSW 2620  
Email: [networkpricing@countryenergy.com.au](mailto:networkpricing@countryenergy.com.au)  
Fax: (02) 6589 8483

### **1.2 Our Proposal**

Country Energy is proposing an overall increase in average prices for network distribution services from 1 July 2010 of 19.3 per cent nominal. This increase consists of distribution services, CPI, transmission charges and climate change levy and each component is discussed in this report.

Country Energy is not proposing any changes to existing price structures, application of these price structures or associated criteria. The number of prices applicable to new connections, and the number of prices classed as obsolete and not available to new connections will not change. However a transitional demand tariff has been introduced for certain customers who consume more than 160MWh and are therefore required to move from a standard time of use tariff to a demand based tariff. Application of this tariff will be limited and only available for a maximum period of 12 months.

### **1.3 Our Business**

Country Energy operates Australia's largest electricity network spanning 95 per cent of New South Wales, with over 200,000 kilometres of powerlines and 1.4 million power poles spanning diverse terrain and climatic conditions from subtropics to alps and plains.

Country Energy is a leading Australian energy business owned by the NSW Government, with around 4,500 employees serving almost 800,000 customers. Country Energy has a decentralised regional structure operating in 146 customer and field service centres and eight regional offices, assuring we are responsive to

local priorities and achieve consistently strong customer satisfaction levels. We are a leader in safety, with the lowest Lost Time Injury Frequency Rate (LTIFR) of any New South Wales electricity distributor.

The figure below illustrates our distribution area, which covers approximately 95 per cent of New South Wales.



Figure 1 Country Energy's distribution area

## 1.4 Network Investment and Challenges

The AER has approved Country Energy's \$3.8 billion (\$3,840 million) five year network investment program and \$2.1 billion (\$2,052 million) over five years to operate and maintain Country Energy's electricity network and services.

The network investment program builds on the \$2.1 billion already invested in essential infrastructure over the preceding five years. These programs ensure Country Energy can continue to deliver reliable, efficient and safe power to our growing customer base.

This investment recognises Country Energy needs to make further significant network investments to meet growth demands and safety requirements, renew ageing assets, deliver better reliability in the future and manage input cost increases such as fuel, skilled labour, materials and environmental standards which are increasing the overall costs of network projects and investments. It also addresses the challenges of:

- Much of Country Energy's 200,000 kilometre power network is across a vast and unique operating environment which has been in service for decades - to continue to deliver safe, reliable power we need to replace and upgrade key network equipment
- Many country and coastal centres are experiencing high population growth - the network is moving from high demand in winter to even higher demand in summer, predominantly driven by air conditioning
- Planning for Country Energy's Intelligent Network (IN) project is well advanced and trials and development of smart metering continues in New South Wales. Smart metering will improve network efficiency, and help customers manage their energy costs and carbon emissions via real-time updates on energy consumption and support for the growth of renewables like solar power. The Ministerial Council on Energy (MCE) has endorsed a distributor led rollout of smart metering where a jurisdictional implementation date has been set and where the benefits outweigh the costs.

## **2 PRICES FOR NETWORK DISTRIBUTION SERVICES**

Country Energy provides network distribution services to all electricity customers connected within our distribution area. Customers may choose any retailer.

Network distribution services are those services performed by Country Energy to provide access to our power supply network. Those services are principally the ownership, planning, design, construction, operation and maintenance of the electricity distribution network - consisting of equipment such as poles, wires and substations - to supply a safe and reliable power supply.

The conditions under which these network services are provided are contained in Country Energy's Standard Form Customer Connection Contract. A copy of this agreement is available at [www.countryenergy.com.au](http://www.countryenergy.com.au) or on request by phoning 13 23 56.

Network prices are a use of system charge for the use of Country Energy's electricity distribution network and also include a charge for the use of the transmission system.

Network prices are subject to annual review in accordance with pricing determinations by the AER. The Network Price List is available on Country Energy's website [www.countryenergy.com.au](http://www.countryenergy.com.au) or on request. The network price list contains network prices effective from 1 July 2010 There is an additional price list for monopoly fees and miscellaneous charges effective from 1 July 2009.

Network access is under the terms and conditions contained within our Standard Form Customer Connection Contract. A negotiated network connection agreement is also available where specific contractual conditions are required.

Network distribution services supplied by Country Energy and covered by this Network Prices Report include:

- Distribution use of system services
- Private powerline inspections and customer installation inspections
- Miscellaneous services
- Monopoly services associated with contestable works
- Emergency recoverable works

### **3 FORTHCOMING CHANGES IN NETWORK TARIFFS**

Country Energy is proposing an average increase in prices for network distribution services of 19.3 per cent. We believe our proposal will assist in establishing a financially sustainable level of network revenue that will ensure Country Energy has sufficient resources to meet its obligations, maintain its significant asset investment and to continue to efficiently deliver network distribution services to meet increasing customer expectations.

Country Energy is not proposing any changes to:

- application of price structures
- associated criteria
- the number of prices applicable to new connections
- the number of prices classed as obsolete and not available to new connections

A transitional demand tariff has been introduced for certain customers who consume more than 160MWh and are therefore required to move from a standard time of use tariff to a demand based tariff. Application of this tariff will be limited and only available for a maximum period of 12 months.

Country Energy has prepared this proposal in accordance with the determination and the Rules. All changes proposed are within the limits on price movements set out in the determination and are discussed further throughout this document.

### **4 REGULATORY COMPLIANCE**

#### **4.1 Overview**

The AER has determined the regulatory arrangements that apply to network distribution services over the regulatory period and how it will regulate charges for network distribution services and other fees that electricity distributors are entitled to charge over the regulatory period. This annual network prices report explains how Country Energy's prices meet the regulatory arrangements, including limits on network price movements, weighted average price cap control formula and provide for the recovery of transmission related payments. Further detail on each of these items is contained below.

#### **4.2 Weighted average price cap**

Charges for network distribution services (distribution use of system (DUOS) prices, miscellaneous charges, monopoly fees and charges for recoverable works for emergency services) are regulated in accordance with a weighted average price cap (WAPC) formula which includes a CPI-X factor. The WAPC operates by restricting the (weighted) average change in Country Energy's prices to a limit (the 'X-factor') determined by the AER. The CPI-X factor is used to achieve a price path that ensures revenue raised reflects underlying costs.

The average allowable increase in distribution prices (or X-factor) for 2010-11 has been limited by the AER to 17.9 per cent (real \$2009-10). The x-factor is contained in the formula for the WAPC and determines how prices for network distribution services can change in real terms over the regulatory period.

In setting prices for the upcoming year, Country Energy must ensure that the average price change relative to the prices it is charging satisfies the constraint. Country Energy has applied the weighted average price control formula set out in clause 4.5 of the determination to each of the DUOS prices, miscellaneous service charges and monopoly service charges for 2010-11.

As part of the annual price setting process, the AER was provided with all supporting calculations and information including audited quantities necessary to demonstrate compliance with all of the requirements of clause 4.6 and appendix J of the determination. The application of the weighted average price cap formula

results in an average price increase of 20.05 per cent for network distribution services in accordance with the determination, and the AER has verified compliance with the determination.

### 4.3 Transmission-related cost recovery arrangements

The AER allows Country Energy to recover transmission-related costs by setting transmission cost recovery (TUOS) prices to recover:

- Transmission charges paid to transmission network service providers
- Avoided TUOS payments to embedded generators calculated in accordance with the Rules
- Inter-distributor transfer payments to other network distribution businesses

Clause 4.7 (referring to clause 6.12.1 of the transitional chapter 6 rules) and appendix I of the determination requires Country Energy to demonstrate to the AER compliance with transmission cost recovery requirements. As part of the 2010-11 price approval process, the AER has been provided with the expected cost of transmission related payments. In accordance with appendix I of the determination, Country Energy develops transmission cost recovery prices, using the methodology outlined in section 6 of this report, to recover the expected cost of transmission-related payments.

Country Energy will also be recovering avoided TuOS payments to generators who have advised they will be supplying energy into our Network. As this effectively represents less transmission from Transgrid's network Country Energy are required to pay avoided TuOS to the generators under section 5.5 of the Rules.

The total transmission revenue Country Energy requires in 2010-11 has increased by 17.4 per cent from the forecast amount for 2009-10. Expected transmission revenue and expense for 2010-11 is summarised in the unders and overs account table below.

**Figure 2 Transmission use of system unders and overs account (\$'000)**

| Year ending                                                            | Forecast<br>2010  |
|------------------------------------------------------------------------|-------------------|
| Revenue from Transmission Cost Recovery tariffs                        | 244,711           |
| Transmission charges to be paid to TNSP's                              | 230,287           |
| Avoided TUOS payments                                                  | 928               |
| Inter-distributor payments                                             | 19,108            |
| <b>Total transmission related payments (net of settlement residue)</b> | <b>\$ 250,323</b> |
| Interest rate applicable to balance                                    | 10.02%            |
| Opening balance                                                        | 5,377             |
| Interest on opening balance (365 days)                                 | 539               |
| forecast over / (under) recovery for financial year                    | (5,612)           |
| Interest charged on over/under recovery for financial year             | (274)             |
| <b>Closing balance of transmission overs/ (unders) account</b>         | <b>\$ 29</b>      |

### 4.4 Consumer price index

The CPI used in setting prices for 2010-11 is 1.82 per cent, the December four quarter all major cities CPI as published by the Australian Bureau of Statistics.

### 4.5 Climate change levy

The minister for department of Climate Change has legislated that Country Energy contribute \$35 million to the climate change levy in 2010-11. Country Energy is permitted to collect this contribution from its customers through network prices.

#### 4.6 Limits on network price movements

In 2010-11 a side constraint of CPI-X + 2 percent applies to DUOS for each tariff class. The average increase in DUOS charges for each tariff class is less than this constraint.

### 5 IMPACT OF FORTHCOMING CHANGES TO NETWORK TARIFFS

This section demonstrates the impact of the forthcoming changes in Network Tariffs on typical customers' bills, including disclosing forecast average prices (based on typical account categories).

The following table demonstrates the average impact of the proposed prices to the residential and business customer classes. Displayed below are the average increases expected for each of the consumption types for residential and business network prices. These include standard supply, time of use, controlled load, and demand network prices for business customers.

**Figure 3 Average increases for domestic and business customers**

|                 |                   | Average annual MWh | Average annual current account | Average annual proposed account | Average increase per customer | Average increase (%) | Average current c/kWh | Average proposed c/kWh |
|-----------------|-------------------|--------------------|--------------------------------|---------------------------------|-------------------------------|----------------------|-----------------------|------------------------|
| Residential     | Continuous        | 5.35               | \$709.46                       | \$853.33                        | \$143.87                      | 20.3%                | 13.27                 | 15.96                  |
|                 | Time of Use       | 15.95              | \$1,331.81                     | \$1,625.08                      | \$293.27                      | 22.0%                | 8.35                  | 10.19                  |
|                 | Controlled Load 1 | 2.80               | \$69.05                        | \$80.88                         | \$11.83                       | 17.1%                | 2.47                  | 2.89                   |
|                 | <b>Total</b>      | <b>24.1</b>        | <b>\$2,110.32</b>              | <b>\$2,559.29</b>               | <b>\$448.97</b>               | <b>21.3%</b>         | <b>8.76</b>           | <b>10.62</b>           |
| Non Residential | Continuous        | 14.41              | \$2,150.47                     | \$2,551.94                      | \$401.48                      | 18.7%                | 14.93                 | 17.71                  |
|                 | Time of Use       | 69.52              | \$5,460.52                     | \$6,516.90                      | \$1,056.38                    | 19.3%                | 7.85                  | 9.37                   |
|                 | Controlled Load 2 | 2.71               | \$136.04                       | \$161.65                        | \$25.61                       | 18.8%                | 5.02                  | 5.96                   |
|                 | Demand            | 674.23             | \$61,366.06                    | \$72,782.29                     | \$11,416.23                   | 18.6%                | 9.10                  | 10.79                  |
|                 | <b>Total</b>      | <b>760.87</b>      | <b>\$69,113.08</b>             | <b>\$82,012.78</b>              | <b>\$12,899.70</b>            | <b>18.7%</b>         | <b>9.08</b>           | <b>10.78</b>           |

The average domestic customer, without controlled load, in Country Energy's distribution area will see an increase of approximately \$143.87 or 20.3 per cent for the 2010-11 year based on an annual consumption of 5.35 MWh.

The average small business customer in Country Energy's distribution area will see an increase of approximately \$401.84 or 18.7 per cent for the 2010-11 year based on an annual consumption of 14.41 MWh.

A typical residential customer living in Country Energy's distribution area would generally be connected to the following network prices:

- BLNN2AU: Residential non-TOU
- BLNC1AU: Residential controlled load 1

Provided below is an analysis of the impacts of price increases for a low usage customer and a typical usage customer.

**Figure 4 Impact of price increases for typical residential customers of Country Energy**

| Customer type             | % controlled load | 2009-10 Quarterly network bill | 2010-11 Quarterly network bill | Increase in quarterly network bill |
|---------------------------|-------------------|--------------------------------|--------------------------------|------------------------------------|
| Low usage (3,5000 kWh)    | 40%               | \$106.15                       | \$127.57                       | \$21.51                            |
| Typical usage (6,000 kWh) | 40%               | \$148.53                       | \$178.29                       | \$29.77                            |

A typical small business customer operating in Country Energy's distribution area would generally be connected to the following network price:

- BLNN1AU: Urban business non-TOU

Provided below is an analysis of the impacts of price increases for a customer that consumes 20 MWh per annum and a customer that consumes 40 MWh per annum.

**Figure 5 Impact of price increases for typical business customers of Country Energy**

| Customer type | 2009-10 Monthly network bill | 2010-11 Monthly network bill | Increase in Monthly network bill |
|---------------|------------------------------|------------------------------|----------------------------------|
| 20 MWh        | \$242.51                     | \$288.72                     | \$46.21                          |
| 40 MWh        | \$468.94                     | \$560.75                     | \$91.81                          |

The table below shows the expected increase in the average rate for each of the tariff classes that Country Energy have for network charges. The examples provided above for typical residential and small business customers all fall within the Low voltage –Energy tariff class.

**Figure 6 Impact of price increases for each tariff class (c/kWh)**

| Tariff class          | 2009-10                 |                         | 2010-11                 |                         |
|-----------------------|-------------------------|-------------------------|-------------------------|-------------------------|
|                       | Forecast Revenue \$'000 | Forecast avg rate c/kWh | Forecast Revenue \$'000 | Forecast avg rate c/kWh |
| Low voltage - Energy  | 478,160                 | 11.02                   | 580,838                 | 13.23                   |
| Low voltage - Demand  | 144,463                 | 9.14                    | 173,712                 | 10.87                   |
| High voltage - Demand | 31,586                  | 6.51                    | 37,747                  | 7.65                    |
| Subtransmission       | 13,972                  | 2.13                    | 11,423                  | 2.39                    |
| Unmetered             | 3,045                   | 7.53                    | 3,654                   | 8.93                    |
| <b>Total average</b>  |                         | <b>9.03</b>             |                         | <b>10.79</b>            |

Attachment 1 provides a full price list by tariff class for 2010-11 network charges.

## **5.1 Expected network price increases 2010/11 to 2013/14**

For the remainder of the regulatory period Country Energy's price changes will be subject to the distribution X factors shown below in Figure 7. These X factors form part of the Australian Energy Regulator's 2009 Revenue Determination for NSW DNSPs, and drive annual escalations under the weighted average price cap. Price changes will also be subject to increases in transmission charges and recovery for CPI is also allowed under the weighted average price cap formula. Included in Country Energy's network revenue is an allowance for recovery of transmission related costs and the NSW Government's Climate Change Fund.

**Figure 7 Transmission and distribution X factors for Country Energy**

| <b>X – factors</b> | <b>2010-11</b> | <b>2011-12</b> | <b>2012-13</b> | <b>2013-14</b> |
|--------------------|----------------|----------------|----------------|----------------|
| Distribution       | -17.90%        | -17.90%        | -14.75%        | 3.99%          |
| Transmission       | -17.54%        | -5.61%         | -5.61%         | -5.61%         |

As part of complying with Clause 6.18.9(3) of the Rules, Country Energy has evaluated price trends for the regulatory control period. The results of this evaluation are provided in our Statement of Expected Price Trends 2010-11 to 2013-14 which is also available on our website. The forecasts of CPI, the Climate Change Fund and recoveries of transmission related costs are likely to change over the regulatory control period and cannot be determined with certainty. Distribution X – factors may also change if there is a pass through event.

## **6 PRICING PRINCIPLES AND COST ALLOCATION**

Costs of the shared distribution network are characterised by economies of scale leading to large and lumpy investments, which occur at irregular intervals and generally have long lives. From a purely economic efficiency perspective, prices should reflect the marginal cost of providing customers with access to the electricity network. The long run marginal cost (LRMC) approach to pricing achieves economic efficiency by signalling the future cost of the next increment of network asset investment. Network prices would in this case send an economic signal to customers of the costs of the next increment of load and provide locational signals for future investment.

Country Energy strives to send customers accurate network price signals, which reflect the marginal costs of supply. However, the LRMC approach to pricing is difficult to implement. Also, network pricing based on economically efficient marginal costs do not recover the long run average costs, except where there is network congestion. This creates a significant tension between economically efficient prices and prices necessary for the commercial sustainability of the distributor.

A practical approach to minimising distortions is to recover the gap between marginal and average costs in a manner which does not vary between locations, contains a fixed component - and to the extent that a variable component is necessary - includes both energy and demand components. Electricity prices for the great majority of customers are averaged in a conventional distributed cost of supply model as detailed below. Large individual customers and standard customer classes receive average network prices consisting of combinations of energy and demand price structures.

Country Energy has developed a cost of supply allocation and tariff structure model ('CoS Model') that is used to allocate the appropriate network costs that are to be recovered from network customers through network use of system charges. The CoS Model has been designed to provide a transparent and defensible allocation of network costs based on pricing principles and the methodology and pricing strategies described in this document.

### **6.1 Network prices based on incremental and stand-alone cost principles**

There are two principles that can be used to test for cross subsidisation in monopoly services.

- **Stand-alone costs**  
Cross subsidisation exists when customers pay more for a service than the costs another firm would incur if it served those customers on a stand-alone basis.
- **Incremental costs**  
Cross subsidies do not exist when the revenues received for a service is less than the stand-alone cost, or are greater than the incremental or marginal cost of providing the service. The incremental cost test is appropriate when the goal is to show that prices for services are not 'unfair'.

The range of prices that lies between incremental cost and stand-alone cost is known as the subsidy-free pricing zone. Cross subsidisation occurs when prices lie outside this zone. Country Energy has developed a marginal cost and standalone CoS model for this purpose. This document provides details of the methodology used, incremental cost and standalone cost of supplying network distribution services to customers connected to Country Energy's network.

## **6.2 Network prices based on fully distributed cost principles**

Network costs are largely fixed and sunk, and due to the meshed nature of electricity distribution networks, pricing must involve a substantial degree of averaging.

For these reasons, Country Energy's approach to allocating costs to customers is primarily founded on equity considerations, where there is some degree of averaging present in the calculation of standard network prices for the majority of customers belonging to general customer classes.

Country Energy has adopted the average or fully distributed cost approach for the allocation of the revenue requirement. Network revenue as a cost is allocated to standard customer classes based on the use of network assets, with prices averaged by customer class. This pricing policy is driven mainly by equity considerations. It is applied to individual prices for large customers and standard published network prices.

We believe this average allocation approach best reflects the manner in which costs are incurred by customer classes and provides equitable and reasonably efficient outcomes.

## **6.3 Network customer classes**

Distribution services are provided to a range of tariff or customer classes. Segregation of customers by class is commonly carried out to assess their relative impact on network costs.

### **6.3.1 Standard customer classes**

All but the largest Country Energy customers have network prices that are average for their customer class. Different customer classes have different consumption profiles and therefore impact differently on network costs.

Customer classes have been established taking into consideration historical pricing structures, existing metering and the cost effectiveness of metering options and connected voltage level.

Historically, customer classes have been grouped according to end use such as domestic, business, commercial, or industrial purposes. However, network costs are not necessarily driven by the end use of electricity but rather by the voltage of supply, the capacity being held in readiness for demand and the time of day that this demand occurs.

The assets required to provide network distribution services to each customer class is a major cost driver. Customer segmentation is carried out in different ways, largely dependent upon the availability of detailed cost information. It has been possible, to some degree, to segregate network costs by voltage level. Therefore, Country Energy's customer classes vary in accordance with the voltage level at which electricity is taken from the network.

Country Energy also offers controlled load services.

The definitions of network customer classes are detailed in section 6.12.2 below and can also be found in Country Energy's Network Price List upon approval by the AER. This list is updated each year or as required in consultation with AER.

### **6.3.2 Locational specific customer class**

For large customers, Country Energy may provide an individual price which is a cost reflective network pricing (CRNP) applicable to the location of the customer's supply point.

The CRNP process is a cost allocation mechanism based on the structure of the present network using a fully distributed cost of supply analysis and is a reasonable assessment of long run incremental pricing for the individual assets through which energy is transported to the individual customer. The CRNP approach fulfils the requirements for an equitable sharing of past and future costs. This price comprises an allocation of the costs associated with only those assets used by the customer. The calculation of CRNP charges involves analysis of the network to which the customer is connected to determine the allocation of asset-related revenue recovery in proportion to the peak utilisation of the relevant assets. CRNP is assessed annually to allow the application of new prices by 1 July each year.

## **6.4 Overview of network pricing methodology**

Country Energy has separated each network price into a DUOS price for providing distribution use of system services to distribution customers and a separate transmission cost recovery (TUOS) price. The methodology adopted by Country Energy for setting network prices is summarised as follows:

1. Project total network revenue requirements (total network cost) for the upcoming year taking into account distribution revenue derived from the WAPC form of regulation, the cost of transmission related payments, transmission under and over recovery balance, climate change levy and the forecast growth in the network.
2. Model fully distributed costs.
3. Model the long run marginal and stand-alone cost of supply to each customer class to establish the 'subsidy free zone'. The long run marginal cost of supply to customer classes is based on the usage of the network and other network services and the impact on future capital expenditure made by each customer class. The stand-alone cost of supply is based on establishing an alternative source of supply to the customer class.
4. Assess the existing network prices to establish whether they fall between the marginal and stand-alone cost of supply.
5. Establish medium term price paths to move existing network prices steadily toward the subsidy free zone, whilst complying with the economic regulatory arrangements of the Determination and Country Energy's medium term network pricing strategy to progressively equalise prices across the network.

## **6.5 Calculation of annual revenue requirements**

The first stage in the process involves calculating Country Energy's total revenue requirements based on the cost of providing network distribution services.

The form of economic regulation affects the annual revenue that Country Energy is able to receive for the provision of network services and the setting of prices. DUOS prices, miscellaneous charges, monopoly fees and charges for recoverable works for emergency services are regulated by the AER under a WAPC. The WAPC operates by restricting the weighted average change in Country Energy's prices to a limit - the 'X-factor' - determined by the AER.

To set the X-factor values for the WAPC - that is the amount by which average distribution prices can change in each year of the regulatory period - the AER undertook a cost building block analysis to determine the notional revenue requirement for each year of the regulatory period for Country Energy. The building block approach sets the base revenue and has been assessed on the basis of a wide range of factors including network

operations, asset valuation, commercial risks, appropriate costs of capital, relative levels of efficiency, and reliability and quality of supply.

Then, taking into account Country Energy's growth forecast, the AER converted the notional revenue requirements to calculate the amount by which current average prices would need to rise or fall in each year of the regulatory period to generate the required revenue.

The Determination allows Country Energy to increase average distribution prices by CPI +17.9 per cent for 2010-11.

## **6.6 Network cost drivers**

The costs drivers of owning and operating Country Energy's electricity distribution network are diverse and are driven by customer related, demand related and energy related cost drivers and common service costs.

It is appropriate to allocate and recover costs, to some degree, from customer classes in accordance with these cost drivers as discussed below.

### **6.6.1 Customer related cost driver**

These costs relate to the individual customer and as such the number of customers drives total costs. The individual cost can vary with the size of the customer but not necessarily in proportion to energy or demand requirements. Customer related costs cover the maintenance of service connection equipment (such as metering, load control receivers and service lines) and the 'administrative' costs arising from the connection of a customer to the network such as meter reading, billing, collection, price setting and network-related customer account management. For standard customer classes these costs are averaged across all customers and are generally reflected in the Network Access Charge of the standard network prices.

### **6.6.2 Demand-related cost driver**

The capacity of a distribution or transmission network is developed to serve the demand for electricity that customers impose upon it. The available capacity of the network is driven by the diversified demand-related usage of the low voltage system (not including service mains), distribution substations and of the higher voltage distribution and sub-transmission networks. Customer loads have an incremental effect on the overall and local diversified load pattern.

The demand served by the network is the most important driver of costs in the provision of network services containing the bulk of the direct asset-related costs. They are often referred to as maximum demand-related costs. It consists of the costs of financing and constructing the provision and maintenance of plant and equipment necessary to supply the cumulative demand of customers. These costs are principally fixed, proportional to the size of the peak demand supplied.

Network augmentation to increase capacity takes place at different levels throughout the network - subtransmission, high voltage, low voltage mains and substations. The need to augment the network arises when the power flow exceeds the capacity available in that part of the network.

At higher level voltages, augmentation of the network is necessary from time to time, to maintain adequate supply capacity and to maintain quality and reliability standards. Investment in the capacity of the network is achieved by a series of discrete, incremental augmentations and extensions. However, augmentation usually involves the provision of lumpy expensive network assets that have long lives. The cost of providing a given overall network capacity is made up of the sum of many of these augmentations in separate parts of the network.

Where demand is measured these costs can be directly applied, but for installations with energy only metering, it is common to regard energy consumption as a surrogate for demand, particularly for those standard customer classes with a predictable and relatively limited range of load profiles.

Demand related costs are distributed between all those customers who utilise the network so that each is allocated an equitable share according to their contribution to the total demand-related costs. Country Energy uses a mathematical process called the “Method of Intercepts” to allocate demand-related costs according to the relative contribution per customer class to the network maximum demand.

### **6.6.3 Energy related cost driver**

These costs tend to be less influenced by a customer’s capacity requirements. They include costs which are related to the utilisation of the network and include the costs of general operation and maintenance of the shared network and referred costs such as transmission charges and demand management payments. These costs are most equitably allocated according to the amount of energy used by the customer (kilowatt hours consumed).

### **6.6.4 Common service costs**

These costs relate to the provision of corporate services which are provided internally in support of network distribution services and other business units and cannot be reliably allocated by any one of the above three cost drivers. In order to carry out a fully distributed cost analysis, these costs are distributed according to one or a combination of the above drivers.

## **6.7 Network price components**

Country Energy’s network prices contain the following price components, also referred to as charging parameters.

### **6.7.1 Demand charges**

The demand imposed by larger customers has a more direct and significant impact on future network costs than smaller customers. The diversity of demand is more significant for smaller customers. It is therefore appropriate that larger customers should have pricing based on measured demand or supply capacity where the costs recovered through the demand charge represent those that could be directly impacted by the customer’s demand on the network.

Demand based prices provide the customer with a clear signal relating to the benefits of load management to improve their average load and avoid short duration load peaks. Customer load factors can vary considerably from mining customers, with load factors in the range of 0.7-0.8, to irrigation loads with annual load factors less than 0.3. The load factor is a measure of how “peaky” a load is and therefore the nature of the demand placed on the network. A load factor of 1 indicates a constant flat load, which therefore uses the network in a consistent fashion regardless of the time of day or season. The \$/kWh or per unit network charge for a customer with a low load factor would be significantly greater than for high load factor customers. Poor load factor customers on a demand price would, as a consequence, need to alter their usage patterns, if feasible, to minimise costs. Customers with typical load factors will generally find the standard demand time of use price results in a much lower average network charge.

Customers’ loads consume both real and reactive power and as such the maximum demand is metered in kVA to reflect the customer’s power factor. Customers on a demand based price can achieve significant savings by improving their power factor to as close to unity as possible to minimise the kVA demand. For smaller customers the cost of reactive compensation is less economic, and signalling of kW demand would be appropriate. For smaller customers, the time of use energy acts as a reasonable surrogate for the demand.

The factor, which drives augmentation, is the coincident demand at different levels of the network. However, there are issues arising from attempting to pass on a coincident demand-related price signal, such as:

- The coincident demand is dependent upon the actions of a group of customers rather than the actions of an individual
- A coincident demand charge can only be calculated after the event, when all customer contributions are known
- The coincident demand at different levels in the network each will have a different impact upon future costs
- The coincident demand carries with it a significant degree of complexity in terms of incorporation into the network billing system.

For these reasons, it is more appropriate for the customer's recorded non-coincident demand to be used to determine the demand charge.

### **6.7.2 Energy charges (network usage charges)**

Where a customer does not have a meter capable of recording demand, the metered energy consumption, either in the form of a single anytime energy rate or as a time of use energy rate, provides the only means of signalling future augmentation costs to the customer.

Energy based charges are most commonly on an anytime basis with a single rate as most domestic and small business meters presently only record consumption in this form.

The peak and shoulder components of the time of use price provide a reasonable surrogate for the signalling of the costs of demand during those time periods that drive investment in the network.

### **6.7.3 Network access charges (fixed charges)**

Most network prices have a fixed Network Access Charge, which is independent of the demand and energy supplied. Fixed charges are non-discretionary in nature and represent the means of cost recovery for those costs which are fixed and reflect the costs that vary due to customer numbers. They are unrelated to actual consumption.

The Network Access Charge is associated with the provision of the following network services, which are fixed in terms of costs:

- Maintenance of assets dedicated to the customer's supply such as connection and metering assets, low voltage assets and for larger customers, the substation circuit breaker and instrument transformers used for metering
- Customer related operation and maintenance costs such as the 24 hour/7 day control centre, emergency and technical response crews
- Meter reading, billing and account processing
- The distribution substation and high voltage power.

The Network Access Charge does not fully recover the fixed costs of some customer classes.

## **6.8 Fully distributed cost of supply modelling**

Once the total annual revenue requirement (total network cost) is determined, then it must be apportioned to customers connected to the network.

Due to the meshed nature of the electricity distribution networks and largely fixed and sunken nature of costs, pricing must involve a substantial degree of cost averaging. Country Energy has adopted the fully distributed cost approach to allocate all network costs to each network customer class and large network customers based on the assets required to serve the customers and their usage of network distribution services. This approach is largely based on current costs, with new capital investment rolled into the regulatory asset base. We believe this general principle best reflects the manner in which costs are incurred by general customer classes and provides equitable and reasonably efficient outcomes.

Fully distributed cost of supply modelling involves three fundamental steps:

1. The determination of the total network revenue requirements/costs for the networks business to provide the desired standard of network distribution service
2. The allocation of network costs to separate asset categories (cost pools) within classes of network distribution services
3. Conversion of cost pools to usage-based network prices for different individual customers and classes of customers, based on factors such as voltage level and their use of the distribution system (load shape) to determine cost reflective prices. The structure of these prices varies for customer classes as outlined in the previous section.

#### **6.8.1 Allocation of network costs to asset cost pools**

Electricity may be supplied directly to a single large customer or indirectly to a homogeneous class of customers such as low voltage customers. There is dedicated connection equipment associated with each customer and to varying degrees each customer makes use of the shared distribution network assets. If the assets are for the sole use of one customer, then the cost allocation process is straightforward as all costs are totally attributable to that customer. However, when assets are shared, such as the shared distribution network, then the task is more difficult in allocating costs in an equitable and consistent manner between customers.

The cost components of a customer using the distribution system relate to those portions of the network, and as such asset groups, which are being used. The model allocates the network cost components into separate cost pools, which have varying cost drivers or inputs. The cost pools generally reflect the different voltage levels of the network.

The model takes as inputs the following quantities:

- The total distribution network cost and transmission related payments
- Optimised network asset values for each asset class and each individual subtransmission element
- Operating and maintenance costs for each asset class and each individual subtransmission network element
- Depreciation allowances and the effective return on capital for each asset class and each individual subtransmission network element
- Connectivity of subtransmission elements
- Forecast customer numbers, energy consumption and demand
- Load profile characteristics for individual customers and major customer classes.

An intermediate stage in the cost allocation process to the derivation of desired network prices is the separation of the network into several asset categories.

#### **6.8.2 Network asset categories (cost pools)**

In order to apportion the total revenue required to network elements, network assets are first subdivided into several asset categories. The cost of supply model apportions the allowable network revenue as a cost into “cost pools” for these various major asset classes of the network.

Network assets are segregated into several asset categories based on voltage level:

▪ **Distribution network assets**

Distribution network assets are all the assets between the transmission point of connection and the distribution connection assets supplying a customer or group of customers. All the customers connected to the distribution network share these assets to a greater or lesser extent. The following voltage based asset categories, and as such cost pools, are used:

- Sub-transmission network mains – overhead and underground mains
- Zone substations
- High voltage distribution network mains – overhead and underground distribution
- Distribution substations
- Low voltage network mains - overhead and underground.

The cost of these asset categories comprises operation and maintenance, depreciation and a return on the capital employed.

▪ **Connection assets**

Customers are connected at all voltages within Country Energy’s network, either directly to substations or embedded within the network. Connection assets (also referred to as exit assets) are those fully dedicated to a customer, or group of customers, at their point of connection to the network where power exits the network. Examples of these include service lines, metering and where applicable instrument transformers, load control or circuit breakers in a zone substation supplying a single large customer. The costs associated with these assets form the basis for the Network Access Charge.

▪ **Common service assets**

Common service assets are those that benefit all customers and which cannot be reasonably allocated on an individual network asset basis. Common service assets are subdivided into the following asset categories:

- Network common service assets include system control and communication systems, voltage regulators and reactive plant providing voltage support, spare parts, land and buildings not associated with lines or substations. Network common service includes network management and support costs
- Controlled load common service assets include off-peak load management equipment such as load control signal generators and injection plant
- Corporate common service assets include an allocation to the networks business of those assets and costs associated with the management and administration of the total business.

A customer connected to the high voltage network would be allocated a share of the costs from the transmission, sub-transmission mains, zone substations, high voltage distribution mains, and connection assets cost pools and those common service assets, which provide high voltage support. It is for this reason that prices vary with connected voltage level. The average network price that a typical customer may experience will increase with connections at lower voltages. A typical customer connected at high voltage will generally have an average price which is lower than a typical low voltage customer.

## **6.9 Cost allocation to asset categories**

In a fully distributed cost model, the annual revenue requirement is determined for each of the above asset categories (cost pools) using similar principles to that applied by the AER in the Determination. That is, each

network “cost pool” is assigned an asset-related cost (asset depreciation and a return on the assets employed) and efficient operating costs as follows:

Allocation to cost pool = operating costs + return of capital + return on capital + cost of tax.

Where information is available, the direct costs of an asset category or individual element are directly attributed to that asset cost pool. Amounts related to allocated ‘indirect’ costs as well as the returns required on the optimised values of assets are calculated and stored for each asset category or element.

In some cases, average unit operating cost (particularly maintenance cost per kilometre for network mains and maintenance cost per asset value for sub-transmission substations) is used to determine the elemental costs.

If the above process is carried out for each of the asset categories listed above, then the sum of the annual revenue requirements for all of the asset categories, plus the allocation of shared corporate common services, would equal Country Energy’s regulated distribution revenue requirements for that year, not including pass-through costs such as transmission related costs.

The relative proportions of operating costs and asset returns vary with each asset class due to the differences in asset values, depreciated life and operating expenditure requirements.

### **6.9.1 Asset related costs**

Prior to calculating any asset-related returns, the value of assets financed by capital contributions is deducted from the total value of each asset category. Assets financed by capital contributions are not subject to a rate of return or depreciation charge, and only efficient maintenance and operation costs are recovered for these assets through network charges.

To arrive at an asset-related return for a particular asset category, the ODRC (excluding contributed assets) is multiplied by Country Energy’s effective regulated rate of return to arrive at the return on assets for that asset category. To this is added the depreciation charge, based on the ODRC valuation and effective asset lives, to arrive at the total asset-related return for that asset category.

### **6.9.2 Conversion of cost pools to usage-based network prices**

Once the costs have been determined for each of the shared asset categories, the next step is to apportion them to individual major customers and standard customer classes.

In this case the utilisation of these assets for the individual large customer or customer class is matched with the costs assigned to those assets. A technique called the “Method of Intercepts” is fundamental to shared network cost allocation process and is used to determine the contribution or impact of each on the demand that must be met by the network. This process utilises load profiles derived from estimates or samples.

The following steps provide an overview of the process that is used by Country Energy to apportion the annual revenue requirement for shared network assets to nodes in the network.

### **6.9.3 CRNP customer class**

For those customers eligible for CRNP pricing the following cost allocation process is used:

- The assets providing supply to the large individual customer are itemised and costs assigned (efficient operating costs, depreciation and return on asset) as a portion of the pool costs for the shared asset classes using the process described above. This enables the annual revenue requirement for each individual asset to be determined. Allocation is based on the optimised asset valuation of each asset

category. Network common service costs are included in the allocation process as a component of the annual revenue requirement for each asset. All exit nodes from the sub-transmission network are identified as part of this process

- An annual load profile dissected into hourly demand periods is obtained for each node on the sub-transmission network. By summing the load profiles of customers downstream from each node either from estimates or samples, the load profile of that network node can be derived. Financial responsibilities for upstream assets can then be allocated in proportion to demands at each network node. In this way all of the operating costs, depreciation and return on assets for the sub-transmission network can be related to individual customers and/or customer classes. Hourly metered load data for each day of the previous year is used. This data is summarised to produce an average daily load curve for the node. The load curve is converted to a load duration curve by the software for the allocation process. The load profile of each large CRNP customer is overlaid onto the load profile for the node. This identifies which customer contributes most to the peak periods and therefore drives the need for greater system capacity
- Costs are allocated using the “Method of Intercepts” process, which apportions the required revenue at shared nodes so that each customer bears an equitable portion of the input cost at that node. The method of intercepts may be thought of as producing a “flow rate” of annual revenue costs per hour per megawatt (\$/hour/MW). This approach places an increasing value on the use of the network during periods of high demand. A load that has a high peak utilisation will receive a proportionally higher sharing of costs. This method is based on the fact that a customer not only has a maximum demand at a certain moment of time, but also a varying demand at other times, and that this varying demand, however small, is also making use of Country Energy’s supply facilities. That is equal proportions of network costs are assigned to equal increments of load. The resulting cost allocation takes into account the proportion of use. Thus the sharing of annual revenue requirement is based not just on a proportion of the maximum demand but rather on an integrated function of both demand and duration
- The outcome is an annual demand-related cost at each node on the sub-transmission network that includes an allocated portion of all the upstream network costs, which are recovered in proportion to a customer’s utilisation of the assets
- Customer-related costs are also determined for the dedicated connection assets. Customer dedicated assets are identified and costs, associated with these assets, are applied to the individual customer including operating and maintenance costs and a capital return. These costs are normally applied as a fixed charge. Dedicated assets paid for by customers do not attract a capital return
- Corporate common service costs are allocated to customers based on an average rate per kWh. A simple approach to cost sharing based on energy consumption is used for these cost components, as this quantity is easily measured or can be estimated for all customers supplied by the network
- For customers satisfying the criteria for individual customer pricing, the total cost at the customer’s exit node is then calculated including transmission use of system, distribution network use of system (as per the method of intercepts allocation), common service and connection service components. This annual revenue requirement at the exit nodes for CRNP customers is translated into price levels and structure.

#### **6.9.4 Standard customer classes**

For standard class customers the following process is used:

- Annual revenue requirements are allocated to asset cost pools in accordance with the process set out above. From these the costs assigned to CRNP customers are deducted. Usage-based network prices are then derived for each of the asset cost pools, from the allocated costs and the energy consumption for each customer class. The forecast energy projections for each class are derived from readings of metering equipment for the previous year
- The cumulative usage-based prices (shared distribution use of system) for each standard customer class is derived by adding together the usage price for each asset category utilised down to the point of exit from the network for that particular class. That is, each customer class is allocated a usage based

revenue requirement in accordance with the assets (sub-transmission, high voltage, distribution substation and low voltage) utilised

- Added to this shared distribution use of system charge is the transmission use of system, and the customer-related costs such as common service and connection service components which includes metering, service lines and load control receivers. A portion of these costs is recovered through the Network Access Charge
- Connection service costs are allocated on an average rate per kWh approach using standard charges for different customer classes. Where the connection assets have been provided by customers or are the subject of a capital contribution, the costs are adjusted accordingly.

The cumulative usage based prices generated for each customer class in this manner is reflective of the asset-related costs and operating costs which would be attributed to the customer loads connected at each voltage level.

### **6.9.5 Controlled load customer class**

Due to the ability to control a customer's load to avoid system peaks, the allocation of network service charges to controlled load network prices does not include any demand component. However, the principal residential and business network price includes a demand cost allocation. The controlled load network price includes the cost of a customer's load control equipment and an allocation for the load control signal injection equipment.

### **6.10 Allocation of transmission network costs**

Country Energy's total revenue requirement incorporates transmission related payments. Transmission charges are a significant cost component for Country Energy and are recovered as part of the total network charges levied on our customers.

Transmission related payments include:

- The cost of transmission related costs for use of transmission networks owned by TransGrid, EnergyAustralia and Powerlink
- Avoided TUOS payments to embedded generators calculated in accordance with the Rules
- Payments for network services to other distributors for inter-distributor transfers.

Transmission charges are not in a form that readily translates into network price structures. Country Energy translates historical energy and kilowatt demand charges from transmission authorities into equivalent peak, shoulder and off-peak energy rates in order to allocate those charges to the network use of system tariffs.

Country Energy allocates transmission charges to network prices using the following principles:

- The total TUOS allocated to network prices aligns with total expected transmission related payments to be made by Country Energy
- Transmission charges are allocated to network prices in a way that reflects the cost drivers present in transmission
- The pass through of transmission charges and the structure of network prices have been aligned wherever possible by Country Energy
- CRNP customers have transmission charges allocated in a way that preserves the location and time signals of transmission pricing as per chapter 6 of the Rules
- Network prices for standard customer classes have transmission charges allocated on an average basis due to the difficulties associated with equitably allocating the general and common service fixed

charge as a fixed network access charge, and passing through location price signals which cannot be preserved when the end price is applied to many customers within the network.

For larger customers connected in close electrical proximity to transmission connection points, transmission charges constitute the majority of the network price. It is therefore important that TUOS price is cost reflective and that the structure is mapped, as directly as possible, into network prices. For large customers with individual prices, the individual cost of transmission is directly assigned to the customer. The balance is allocated to standard customer classes.

Direct mapping to network prices for standard customer classes has not been possible due to the large fixed transmission charges that cannot be directly included in network price structures for these customers, which typically have a small fixed charge. More importantly, the customer's metering generally does not readily permit it. Due to these limitations, it is therefore not possible to pass the same transmission cost drivers through to all customers in the same format as they are provided to Country Energy.

While the allocation of the large fixed charge component is reasonably discretionary, it has been apportioned between customer classes on the basis of their consumption. Allocation to customers in this way is a balance between equity and efficiency. Only the peak and shoulder energy component can be readily passed on to customers through distribution prices.

The transmission charges are allocated on their non time of use energy, peak and shoulder energy consumption, and/or demand and are added to the distribution network costs for each customer class. The intention of this mapping methodology is to preserve within the customer's price, to the extent possible, the cost drivers inherent in the transmission charge.

- Non-TOU price – the total transmission charge allocation for the class is divided by the total class consumption and added to the energy rate for the price. Average transmission charges would apply to smaller customers.
- TOU price – the transmission allocation relating to the transmission demand and energy components is divided by the peak, shoulder and off peak consumption and added to the peak, shoulder and off peak energy rates. The transmission allocation relating to the fixed transmission component is added to the TOU energy rates.
- Demand TOU price – the transmission allocation relating to the transmission demand and energy components is divided by the peak, shoulder and off peak consumption and added to the peak, shoulder and off peak energy rates. The transmission allocation relating to the fixed transmission component is added to the TOU energy rates.

The fixed component of the transmission charge was originally largely determined from an 'anytime' energy allocation of costs. This component is apportioned between individual customers and customer classes on the basis of their anytime energy consumption. Allocation to customers in this way is a balance between equity and efficiency. The allocation of the transmission demand charge using peak and shoulder energy is justified on the basis that in the long run, the augmentation of the transmission network - and hence future costs - is related to peak and shoulder utilisation of the network.

### **6.11 Incremental and stand alone cost allocation process**

Country Energy's cost of supply model assesses cost allocations to customer classes both on a LRMC and stand-alone basis. It is inappropriate for network distribution service charges to be below the incremental cost (LRMC) of supply as it results in inefficient pricing signals. It is also inappropriate for charges to exceed that which the customer could pay for an alternative equivalent service, the stand-alone cost.

The stand-alone cost of supply is based on establishing an alternative source of supply to the customer class. Stand-alone costs are assessed by calculating the costs of various alternative supplies to our distribution

network such as the construction of an alternative grid or the use of a community or individual generator. The lowest of the various stand-alone costs is chosen for the comparison.

Marginal costs are established by assessing the marginal component of the cost pools and allocating these costs to customer classes. This process takes into account the usage of the distribution network and other distribution network services and the impact on future capital expenditure made by each customer class. The LRMC of the distribution network is determined by separately identifying capacity related expenditure and averaging this over a forecast change in output (the Average Incremental Cost Approach).

The below steps are followed in the determination of Country Energy's marginal costs:

1. Marginal cost components are allocated to the following cost pools:
  - Customer** – marginal costs reflect the costs that vary due to additional customer numbers, i.e. building and maintaining the low voltage network, customer inquiries, and emergency response and outage restoration
  - Demand** – marginal costs accrue due to the customer's peak loading that contributes to network capacity requirements and augmentation
  - Energy** – marginal costs accrue due primarily to the structure of transmission charges.
2. Growth related capital expenditure is allocated to the customer and demand cost pools based on forward estimates of average annual growth related network augmentation required over the next ten years
3. Asset renewal expenditure is based on forward estimates of average annual capital expenditure on asset refurbishment or replacement required to meet load growth. These assets would otherwise be unsatisfactory to supply existing loads
4. Capital expenditure for reliability and quality enhancement, and environmental, safety and statutory obligations are allocated to the customer and demand cost pools
5. Operation and maintenance marginal costs excluding administration and overheads are allocated to the customer and demand cost pools according to the relevant activity
6. Marginal transmission costs including both TransGrid and Powerlink demand and energy charges are allocated to the relevant cost pools. The transmission fixed charges are not allocated as marginal costs
7. The allocation of the demand cost pool to customer classes is based on the asset utilisation by each class of customer
8. The allocation of the energy pool is based on energy consumption for each customer class
9. The customer cost pool is allocated according to a weighted customer value representing relevant customer servicing costs.

The network price for each customer class is then compared with the stand-alone costs and LRMC to determine if any cross-subsidisation exists.

Attachment 2 demonstrates the relationship between current network prices and LRMC and stand-alone costs over a range of consumptions in each price class. The table and graphs show that network prices lie above the long run marginal cost of supply and below the lowest cost stand-alone alternative throughout the range of consumption.

## **6.12 Setting of price structures and levels**

### **6.12.1 Factors considered**

Final network prices and structures for standard network customer classes are established taking into consideration the following factors:

- Previous price structures and limits on price movements
- Nature and extent of their usage
- Nature of their connection to the network
- Cost effectiveness of metering requirements
- Demand management
- Simplicity

### **6.12.2 Network tariff classes**

Country Energy's network prices may be separated into six broad categories that address the price setting principles listed above.

- **Low voltage - energy**

This tariff class relates to customers with a low voltage connection to the network and are billed on usage. It includes the customer classes of:

- Residential continuous
- Residential time of use
- Controlled load 1
- Controlled load 2
- Business continuous
- Business time of use < 100 MWh
- Low voltage time of use > 100 MWh

- **Low voltage - demand**

This tariff class relates to customers with a low voltage connection to the network and are billed on usage and demand. It includes the customer classes of:

- Low voltage - average daily demand
- Low voltage - one rate demand
- Low voltage - three rate demand

- **High voltage - demand**

This tariff class relates to customers with a high voltage connection to the network and are billed on usage and demand. It includes the customer classes of:

- High voltage - average daily demand
- High voltage - one rate demand
- High voltage - three rate demand

- **Subtransmission**

This tariff class relates to customers with a subtransmission connection to the network and are billed on usage and demand. It includes the customer classes of:

- Subtransmission - three rate demand
- Cost reflective network customers

- **Inter distributor transfer**

- This tariff class relates to specific connection points between distributors
- **Unmetered**  
This tariff class relates to customers that do not have a meter and includes:
  - Streetlighting usage charges
  - Any other unmetered supply

Further information on Country Energy's network price structures for standard customer classes can be obtained from the Network Price List. The Network Price List is available on Country Energy's website at [www.countryenergy.com.au](http://www.countryenergy.com.au) or on request.

### **6.12.3 Cost reflective network prices and cross subsidies**

Some network prices do not reflect the fully allocated cost of providing the service. Country Energy's fully distributed cost of supply model indicates that some prices are not cost-reflective.

The term 'cross-subsidy' is frequently used when discussing the level of cost reflectivity in prices. However, a large proportion of a network operator's costs are fixed, and allocation of fixed costs to various customer classes is an arbitrary process. Caution must therefore be taken when interpreting discussions of cross-subsidies in network pricing which have been determined by this allocation of fixed costs to various customer classes.

It is important to understand the various interpretations of what constitutes a cross subsidy.

The generally accepted view is that cross-subsidies do not exist if the cost of providing a service exceeds its incremental cost.

Despite this very valid proposition, there are two significant issues for setting network prices that need to be taken into account:

- First, there is subjectivity in the definition of marginal costs for distribution network services. In the short run, marginal costs are negligible as energy losses are traded in the market. In the longer term, incremental costs would trend to average costs as per a fully distributed cost of supply of an optimised network.
- Second, network distribution assets are long lived and their cost recovery needs to be considered over an extended timeframe.

## **7 EXPECTED LEVELS OF SERVICE AND PROJECTED CAPITAL EXPENDITURE PROJECTS**

Country Energy's capital investment program over the five years from 2009-10 to 2013-14 totals \$3,826 million with \$758 million forecast to be invested during 2010-11 (in real 2008-09 dollars).

### **7.1 Capital expenditure projects**

Capital expenditure is invested efficiently by Country Energy to deliver the greatest benefit to all stakeholders. Our medium-term capital investment program is designed to meet targeted programs and to continue to improve the current levels of service to customers. Specifically the program takes into account the following factors:

- The needs of our customers and all other stakeholders
- Current and projected levels of service standards, including long-term network reliability across the network and the specific targeting of those parts of the network that are delivering the lowest service levels

- Independently assessed forecasts of demand growth
- Condition and age of assets
- Regulatory, environmental and safety compliance requirements
- Non system investment requirements
- Efficient alternatives to capital expenditure including efficient operating and maintenance expenditure, demand management, and new generation.

Country Energy's \$757.5 million capital investment program for 2010-11 includes:

- \$150.6 million to renew or refurbish aging assets
- \$256.9 million to support growth across the network
- \$174.0 million to support improvements in reliability and quality of service to customers
- \$38.4 million to meet environmental, safety and statutory obligations

As part of the electricity distribution determination process, the AER undertook a review of the forecast capital expenditure and engaged engineering consultants to undertake a detailed analysis of capital expenditure requirements. The consultants endorsed the levels of capital expenditure proposed by Country Energy and concluded that the investment program is efficient and justified. The AER has adopted the capital expenditure allowances for Country Energy that align with the recommendations of their consultants.

The following section outlines the major capital expenditure categories and provides a brief description of major capital expenditure projects planned for the 2010-11 financial year necessary to meet:

- Growth in demand and system augmentation requirements to maintain system performance and system security
- Asset replacement and renewal requirements to maintain system performance, safety and integrity of the network and to meet customer requirements for network quality and improve reliability
- Non-system investment requirements to support the operations of the distribution business.

#### **7.1.1 Growth in demand and system augmentation**

Growth-related expenditure relates to investments that are required to ensure that the network has adequate capacity to meet increasing demand.

Country Energy's distribution network is operating at or near its maximum capacity in some areas. The strong growth areas include the major regional centres and the northern and southern coastal strips, the latter areas representing some of the fastest growing areas in the state. This reflects continued residential and commercial development, with expansion forecast to continue into the future. Over the medium term, Country Energy will need to continue to expand and reinforce the network in these areas to meet the high growth in demand. In regions west of the ranges, the general rate of growth in residential development is moderate.

A selection of specific growth-related projects for 2010-11 is outlined below:

**Figure 8 growth-related projects for 2010-11**

| Region          | Project Description                                                  | Cost \$ millions |
|-----------------|----------------------------------------------------------------------|------------------|
| South Eastern   | Cooma to Bega construction of additional 132,000 volt circuit        | 39.1             |
| Far North Coast | Koolkhan to Maclean construction of 66,000 volt line (40 kilometres) | 24.0             |

| Region          | Project Description                                                                                                                                  | Cost \$ millions |
|-----------------|------------------------------------------------------------------------------------------------------------------------------------------------------|------------------|
| Southern        | Finley 132 Substation to Mulwala 132,000/22,000 volt substation - Convert existing 66,000 volt line to 132,000 volt (49km)                           | 17.3             |
| Southern        | Deniliquin to Moama construction of new 66,000 volt line (69km)                                                                                      | 22.6             |
| Mid North Coast | Nabiac Possum Brush Bulk Supply Point establishment of new 132,000/66000/11000 volt substation                                                       | 12.5             |
| Southern        | Mulwala establishment of new 132,000/22,000 volt zone substation                                                                                     | 5.2              |
| Northern        | Tamworth South establishment of zone substation stage 2 and 3                                                                                        | 4.6              |
| Far North Coast | Casino North establishment of 66,000/11,000 volt substation                                                                                          | 3.4              |
| North West      | Narromine 132,000/66,000 volt establishment of new 132,000 volt switching station and 132,000/66,000 volt substation (1 x 132,000/66,000 volt 60MVA) | 6.5              |
| Far West        | Buronga town establishment of new substation                                                                                                         | 2.7              |
| Southern        | Wagga Ashmont rebuild existing 66,000/11,000 volt substation                                                                                         | 2.9              |
| Central West    | Forbes to West Jemalong construction of new subtransmission line (40km)                                                                              | 2.7              |

### 7.1.2 Asset renewal and replacement

A significant component of the overall network-related capital program is the replacement and renewal of aged assets. Network assets have a finite life. Replacement and renewal investment ensures the timely replacement or refurbishment of network assets that have become unserviceable, that frequently fail in service, have significantly deteriorated to an unsafe or risky condition or where the present-value cost of maintaining the asset exceeds the cost of replacement. Asset replacement expenditure increases gradually over time due to the ageing of the network. This trend is already evident and will continue through the new regulatory period. Where the condition of the assets has deteriorated and ongoing maintenance is not effective, system assets must be replaced.

Replacement is also driven by environmental, regulatory and industry safety compliance considerations. General distribution related reliability capital expenditure to maintain existing service levels are also included in this category. More than 40 per cent of Country Energy's network assets are over 40 years old and are rapidly ageing. In the areas of the network west of the ranges, the network assets are generally older and the condition of some assets is increasingly requiring replacement in order to maintain the performance level of the network.

### 7.1.3 Non-system requirements

This category includes capital items that will be required to support the electricity distribution business including:

- Information systems development and computer hardware, software and upgrades, licences, plant and equipment relating to IT assets, and related expenditure required to operate the business. A number of Country Energy's core IT assets have reached the end of their useful business life and

as such expenditure will continue being required throughout the current regulatory period to June 2014

- Motor vehicles and plant
- Communication systems such as trunk mobile radio, faxes, mobile phones
- A number of other miscellaneous expenditures such as general office equipment, furniture and whitegoods, small plant and test equipment, and building and property works

Expenditure related to this category will ensure the continued efficient management and support of the electricity distribution business.

## **7.2 Expected levels of service for the coming year**

Country Energy is proud of the service standards achieved within a difficult and unique operating environment.

During the electricity distribution pricing review, the AER accepted Country Energy's reliability performance objectives for the five-year period commencing July 2009. The feeder category objectives are as mandated in the DWE "Design, Reliability and Performance Licence Conditions - 1st December 2007". The Country Energy wide target is derived from the feeder category targets by proportioning based on customer numbers per category. Country Energy will continue implementing a range of programs to improve the network's reliability to ensure the targets are met. These include increased segmentation of the network by installing a large number of reclosers, increased vegetation management and the development of the intelligent network project.

The SAIDI reliability performance objectives for 2010-11 for different components of the network are tabled below. SAIDI represents the total number of minutes on average that each customer installation connection to the distribution system (or to those components) is without a supply of electricity.

**Figure 9 SAIDI Reliability Performance Objectives for 2010-11**

| <b>Component of distribution system</b> | <b>2010-11 SAIDI objective (minutes)</b> |
|-----------------------------------------|------------------------------------------|
| Whole distribution system               | 319                                      |
| Urban feeders                           | 125                                      |
| Rural short feeders                     | 300                                      |
| Rural long feeders                      | 700                                      |

# Country Energy Network Price List

(Excluding GST)  
Effective 1 July 2010



| Tariff Code                                                 | Obsolete tariffs on same rate                                                   | Description                       | Network Access \$/Day | Energy All c/kWh | Energy Peak c/kWh | Energy Shoulder c/kWh | Energy Off-Peak c/kWh | Demand Charge \$/kVA/M | Peak Demand \$/kVA/M | Shoulder Demand \$/kVA/M | Off-Peak Demand \$/kVA/M | Capacity Charge \$/kVA/M |
|-------------------------------------------------------------|---------------------------------------------------------------------------------|-----------------------------------|-----------------------|------------------|-------------------|-----------------------|-----------------------|------------------------|----------------------|--------------------------|--------------------------|--------------------------|
| <b>Low voltage - Energy</b>                                 |                                                                                 |                                   |                       |                  |                   |                       |                       |                        |                      |                          |                          |                          |
| BLNN2AU                                                     | BLNN2SU, BLNN2SP, BLNN2SR, BLNN2ST, BLNN2SV, BLNN2SW, BLNT3SU, BLNT3AR, BLNT3SR | LV Residential Continuous         | 0.5499                | 12.2373          | -                 | -                     | -                     | -                      | -                    | -                        | -                        | -                        |
| BLNT3AU                                                     | BLNC1AR, BLNC1SR, BLNC1SU, BLNC4AR, BLNC4AU, BLNC4CR, OPR, OP                   | LV Residential TOU                | 0.5476                | -                | 13.8531           | 13.8531               | 4.6479                | -                      | -                    | -                        | -                        | -                        |
| BLNC1AU                                                     | BLNC2SU, BLNC3NU, BLNC5AU, BLNC6NR, BLNC6NU, OP2, OPRE, PH                      | Controlled Load 1                 | 0.0735                | 1.9336           | -                 | -                     | -                     | -                      | -                    | -                        | -                        | -                        |
| BLNC2AU                                                     | BLNN1AR, BLNN4CR, GS, GSI, IS, RUB                                              | Controlled Load 2                 | 0.0784                | 4.9169           | -                 | -                     | -                     | -                      | -                    | -                        | -                        | -                        |
| BLNN1AU                                                     | TBI, TI2W, TLV, W, BLNT2AR                                                      | LV General supply                 | 0.5499                | 16.3525          | -                 | -                     | -                     | -                      | -                    | -                        | -                        | -                        |
| BLNT2AU                                                     | BLNT1SR                                                                         | LV TOU <100MWh                    | 2.6564                | -                | 10.5329           | 10.5329               | 5.4293                | -                      | -                    | -                        | -                        | -                        |
| BLNT1AU                                                     |                                                                                 | LV TOU >100MWh                    | 5.0626                | -                | 14.3769           | 14.3769               | 6.7727                | -                      | -                    | -                        | -                        | -                        |
| <b>Low voltage - Demand</b>                                 |                                                                                 |                                   |                       |                  |                   |                       |                       |                        |                      |                          |                          |                          |
| BLND3AO                                                     |                                                                                 | LV TOU Demand 3 Rate              | 9.6866                | -                | 3.6342            | 3.6342                | 2.1325                | -                      | 10.7536              | 10.7536                  | 3.7513                   | -                        |
| BLND3TO                                                     |                                                                                 | LV TOU Demand Transitional tariff | 7.2649                | -                | 3.4401            | 3.4401                | 2.0840                | -                      | 8.0652               | 8.0652                   | 2.8135                   | -                        |
| BLNS1AO                                                     |                                                                                 | LV TOU avg daily demand           | 10.8696               | -                | 3.9748            | 3.9748                | 1.9724                | -                      | 11.4161              | 11.4161                  | 3.9877                   | -                        |
| <b>High voltage - Demand</b>                                |                                                                                 |                                   |                       |                  |                   |                       |                       |                        |                      |                          |                          |                          |
| BHND3AO                                                     |                                                                                 | HV TOU mthly Demand               | 11.7420               | -                | 2.6543            | 2.6543                | 2.1092                | -                      | 8.4151               | 8.4151                   | 2.3923                   | -                        |
| BHNS1AO                                                     |                                                                                 | HV TOU avg daily demand           | 12.1284               | -                | 2.6723            | 2.6723                | 2.1201                | -                      | 8.6920               | 8.6920                   | 2.4710                   | -                        |
| <b>Subtransmission - Demand</b>                             |                                                                                 |                                   |                       |                  |                   |                       |                       |                        |                      |                          |                          |                          |
| BSSD3AO                                                     |                                                                                 | Sub Trans 3 Rate Demand           | 12.0205               | -                | 3.8797            | 2.2867                | 1.9042                | -                      | 3.5690               | 2.5444                   | 1.0142                   | -                        |
| <b>Unmetered Tariffs</b>                                    |                                                                                 |                                   |                       |                  |                   |                       |                       |                        |                      |                          |                          |                          |
| BLNP1AO                                                     | BLNN3AO                                                                         | LV Public Lighting NUOS           | 0.7494                | 16.2908          | -                 | -                     | -                     | -                      | -                    | -                        | -                        | -                        |
| BLNP3AO                                                     |                                                                                 | LV Public Lighting TOU NUOS       | -                     | -                | 15.7804           | 15.7804               | 6.7183                | -                      | -                    | -                        | -                        | -                        |
| <b>Obsolete Tariffs - Not applicable to new connections</b> |                                                                                 |                                   |                       |                  |                   |                       |                       |                        |                      |                          |                          |                          |
| BLNT1SU                                                     |                                                                                 | LV TOU over 100 MWh/yr Sth        | 2.8541                | -                | 12.4728           | 12.4728               | 5.6819                | -                      | -                    | -                        | -                        | -                        |
| BLNT1SR                                                     |                                                                                 | LV TOU over 100 MWh/yr Sth R      | 5.0626                | -                | 14.3769           | 14.3769               | 6.7727                | -                      | -                    | -                        | -                        | -                        |
| BLND1CO                                                     |                                                                                 | LV TOU Demand 1 Rate              | 14.8174               | -                | 5.6355            | 5.6355                | 2.6008                | 17.1309                | -                    | -                        | -                        | -                        |
| BLND1NO                                                     |                                                                                 | LV 1 Rate Demand Nth              | 14.8174               | -                | 5.6355            | 5.6355                | 2.6008                | 17.1309                | -                    | -                        | -                        | -                        |
| BLND1SR                                                     |                                                                                 | LV 1 Rate Demand Sth              | 1.0022                | -                | 11.4681           | 11.4681               | 4.1599                | 11.6938                | -                    | -                        | -                        | 4.1591                   |
| BLND1SU                                                     |                                                                                 | LV 1 Rate Demand Sth              | 1.0022                | -                | 8.4241            | 8.4241                | 4.1297                | 11.3005                | -                    | -                        | -                        | 4.1421                   |
| TLD                                                         |                                                                                 | Time of Day - LV Demand - FW      | 12.2870               | -                | 12.5196           | 12.5196               | 3.6064                | 19.0559                | -                    | -                        | -                        | -                        |
| BLND4NO                                                     |                                                                                 | LV 3 Rate Demand Option 2 Nth     | 9.9917                | -                | 10.4704           | 10.4704               | 8.2112                | -                      | 7.2057               | 7.2057                   | 2.5028                   | -                        |
| BHND1CO                                                     |                                                                                 | HV 1 Rate Demand Cent U           | 19.5402               | -                | 5.5546            | 5.5546                | 2.6521                | 11.2330                | -                    | -                        | -                        | -                        |
| THD                                                         |                                                                                 | Time of Day - HV Demand - FW      | 87.1764               | -                | 7.2686            | 7.2686                | 4.0599                | 13.6183                | -                    | -                        | -                        | -                        |
| BHND1SO                                                     |                                                                                 | HV 1 Rate Demand Sth U            | 1.0022                | -                | 5.2069            | 5.2069                | 3.8995                | 8.2551                 | -                    | -                        | -                        | 3.1923                   |
| BHND1SU                                                     |                                                                                 | HV 1 Rate Demand Sth U            | 1.0022                | -                | 5.2069            | 5.2069                | 3.8995                | 8.2551                 | -                    | -                        | -                        | 3.1923                   |

\* The rates listed are the rates charged to retailers of electricity for the use of Country Energy's distribution system.

\* These rates are inclusive of charges levied on Country Energy by transmission network service providers and government legislation.

\* Country Energy is required to contribute towards the Climate Change Fund which is used to support energy saving initiatives across New South Wales.

\* Network Charges do not include the cost of energy.



Price list should be read in conjunction with explanatory notes available on Country Energy's website




## Attachment 2: Country Energy's Network Annual Pricing Report 2010-11. Fully Distributed Cost Comparison



In accordance with Chapter 6 Part I of the National Electricity Rules (Transitional) Country Energy is required to submit a pricing proposal each year. This proposal must show the tariff classes to apply for the relevant year and demonstrate the relationship between current network prices and LRM and stand-alone costs over a range of consumptions in each price class. The table and graphs show that network prices lie above the long run marginal cost of supply and below the lowest cost stand-alone alternative throughout the range of consumption, as discussed in section 6 of our annual pricing report.

### 1. Low voltage - energy

Connections to Country Energy's low voltage network and includes the following tariffs.

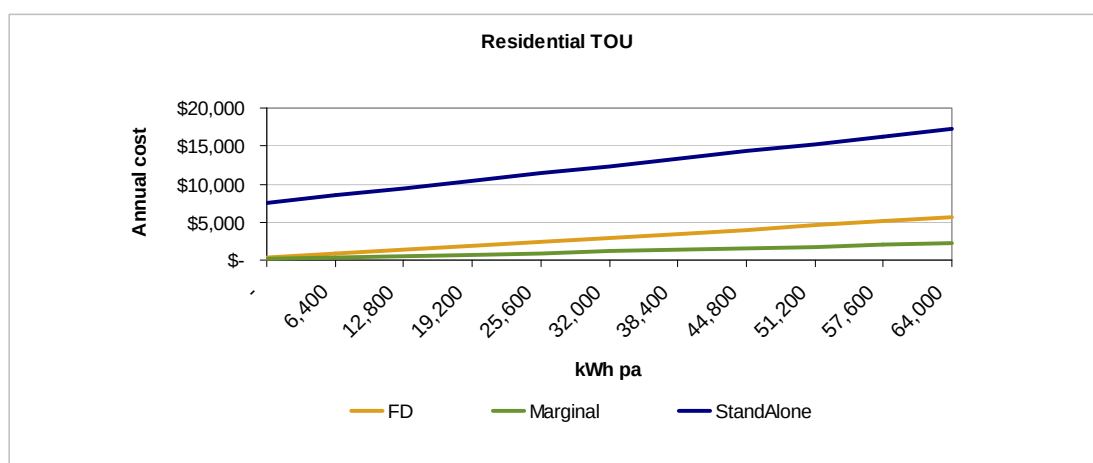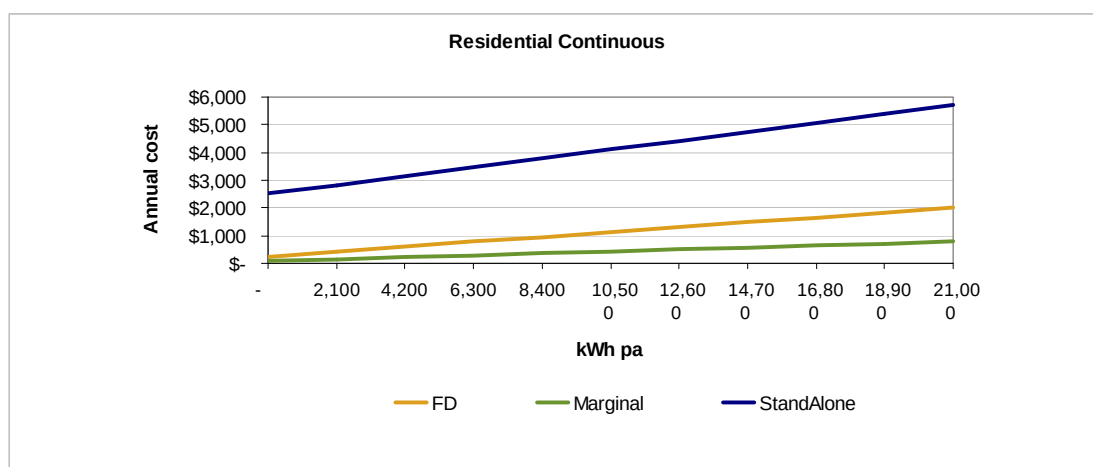


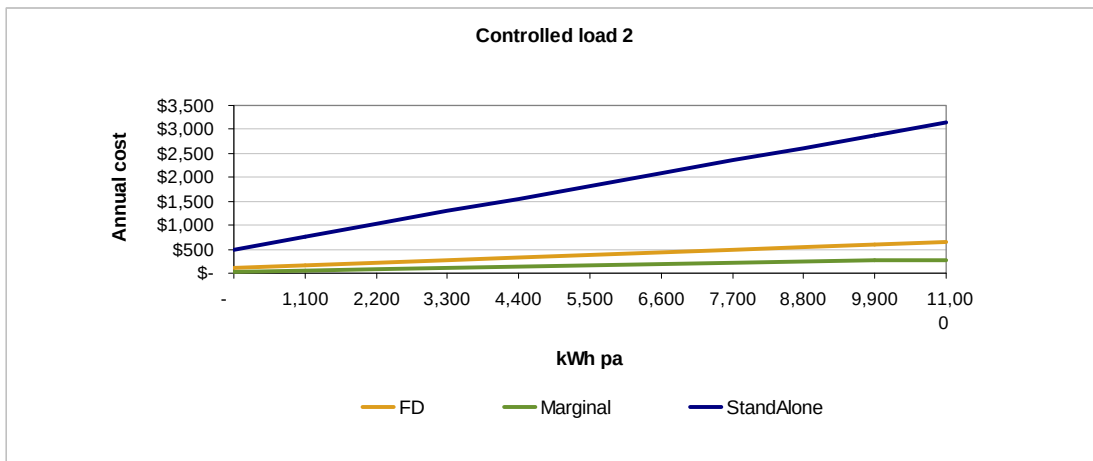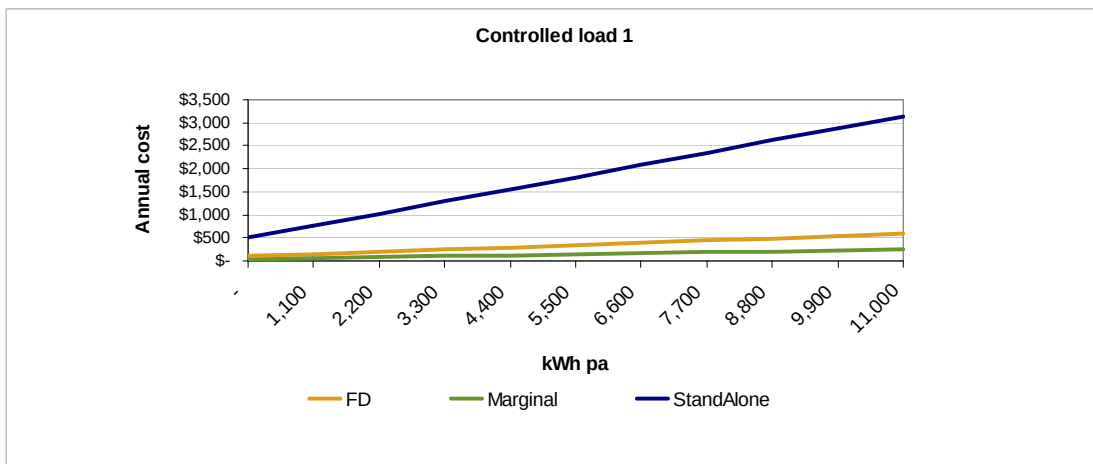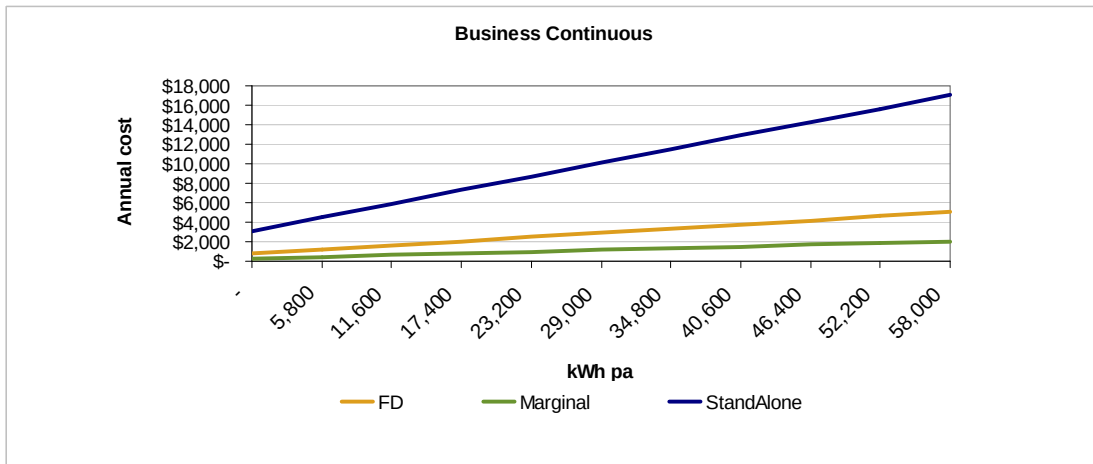


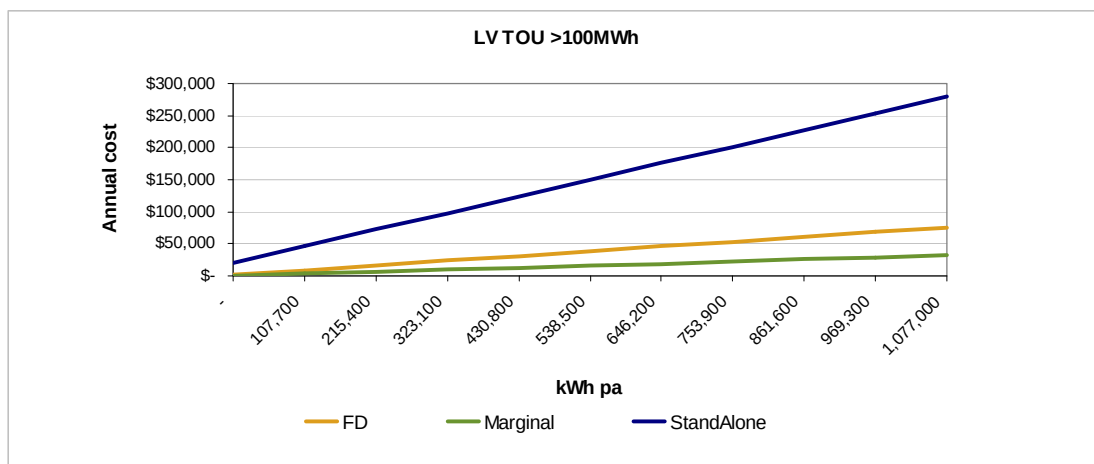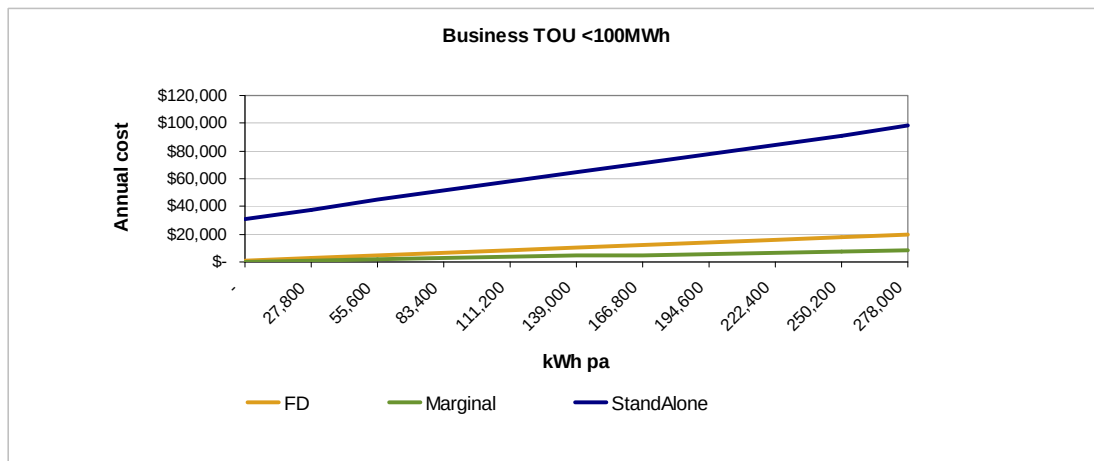

## 2. Low voltage - demand



Connections to Country Energy's low voltage network where the meter is capable of recording peak monthly demand and includes the following tariffs.

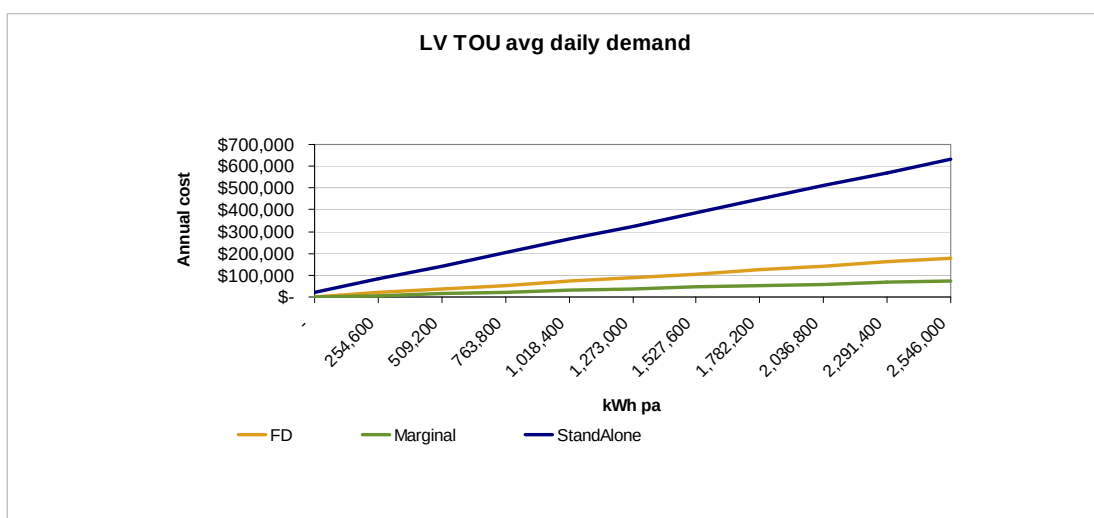

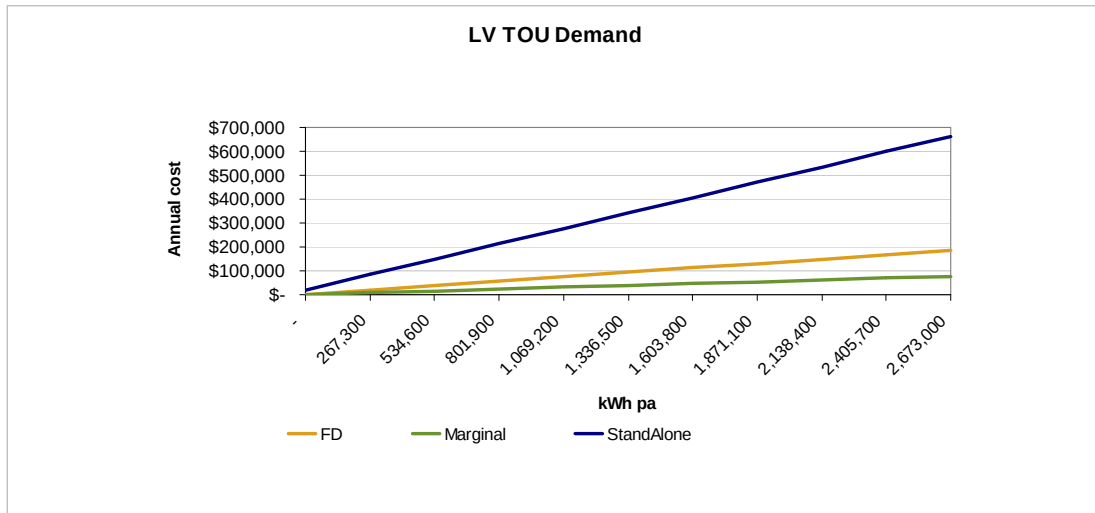


### 3. High voltage - demand

Connections to Country Energy's high voltage network. Generally 11kV or 22kV and includes the following tariffs.

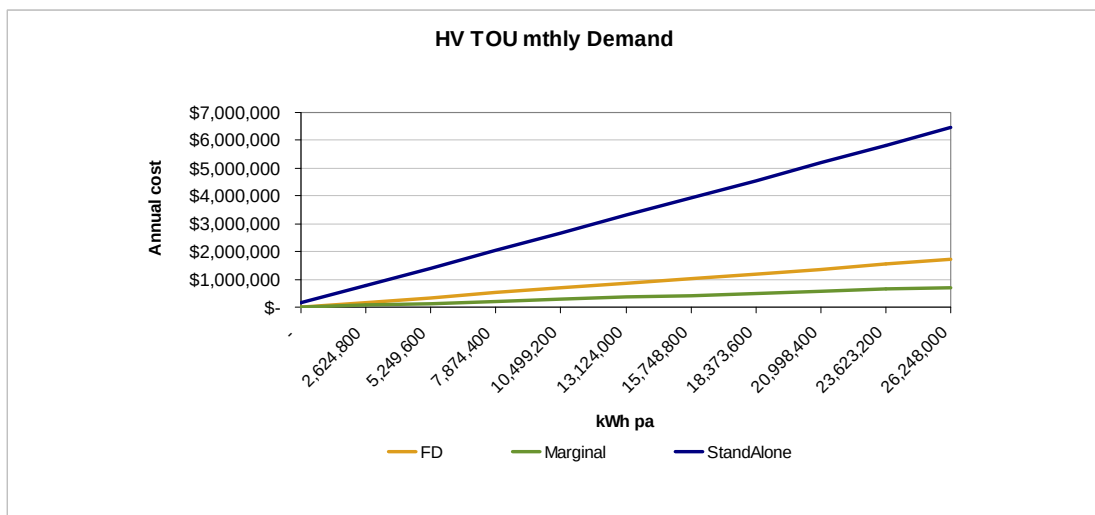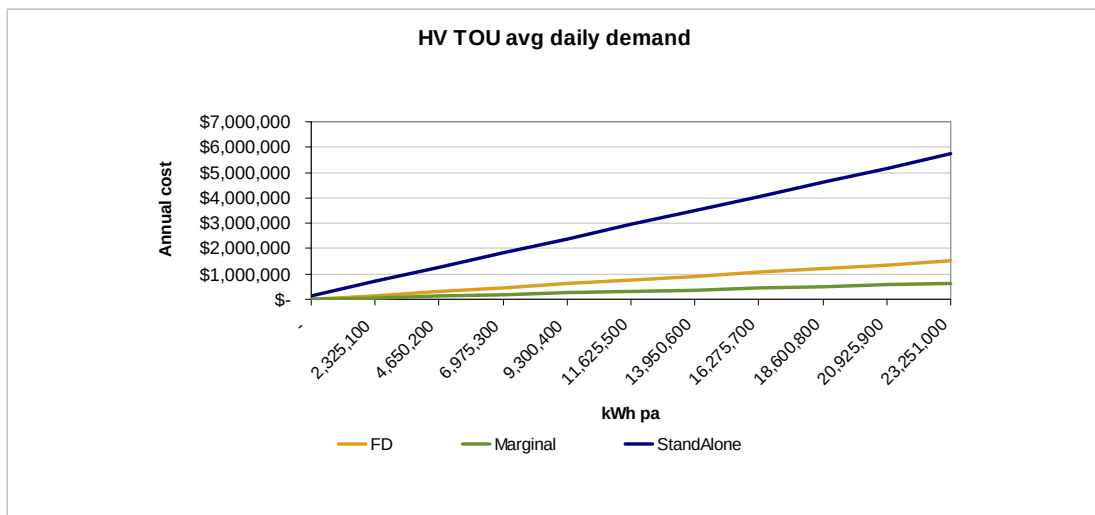

#### 4. Subtransmission

Connections to Country Energy's subtransmission network. Generally 33kV, 66kV, 110 kV or 132kV.

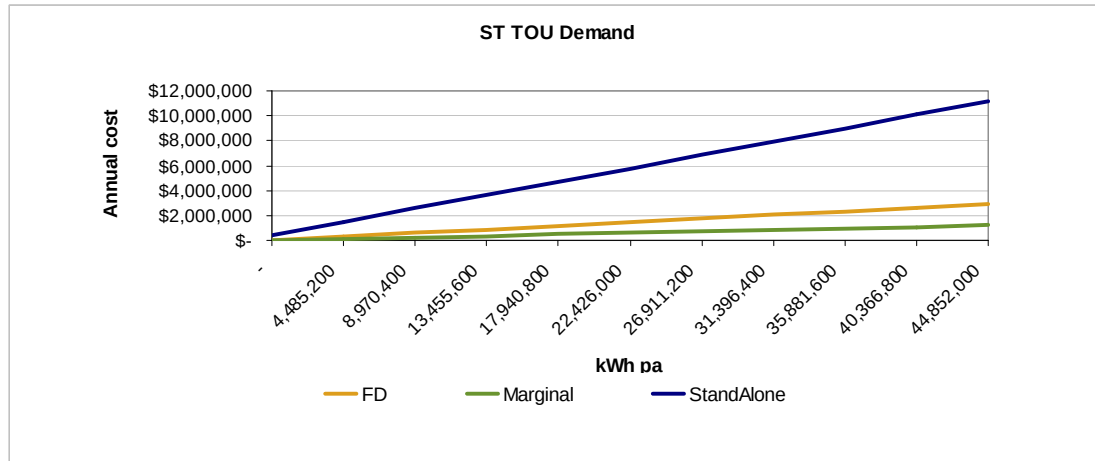

Miscellaneous services, monopoly services and emergency recoverable works are as set out in Appendices G and H of AER's NSW Distribution Determination 2009-10 to 2013-14. These Appendices can be found from page 4.

### Price schedule for miscellaneous services effective 1 July 2009

Miscellaneous services are 'non-routine' services related to the distribution of electricity such as meter test, special meter reading and disconnection visit and will be charged for at the AER determined rates in the table below.

**Table 1 Charges for Miscellaneous Services**

| Miscellaneous service                             | \$  |
|---------------------------------------------------|-----|
| Special meter reading                             | 44  |
| Meter test                                        | 73  |
| Supply of conveyancing information – desk inquiry | 37  |
| Supply of conveyancing information – field visit  | 73  |
| Off-peak conversion                               | 59  |
| Disconnection visit (acceptable payment received) | 44  |
| Disconnection at meter box                        | 88  |
| Disconnection at pole top/pillar box              | 148 |
| Rectification of illegal connection               | 221 |
| Reconnection outside business hours               | 95  |

*Prices are exclusive of GST*

### Charges for emergency recoverable works

Emergency recoverable works are defined by AER as emergency work undertaken by a DNSP to repair damage to the distribution system where the damage is the consequence of the act or omission of a person, for which that person is liable to another (which may include the DNSP) for that damage.

For example, emergency work undertaken by Country Energy to repair damage to Country Energy's distribution system resulting from a motor vehicle collision where the driver was negligent.

The charge that a DNSP may levy for emergency recoverable works must not exceed the sum of the following:

- 1) 110 per cent of the costs (other than labour costs) actually incurred in providing the emergency recoverable works and
- 2) the cost of labour actually used to undertake the emergency recoverable works determined by applying 150 per cent of the R2 labour rate for that labour

The above charges apply irrespective of whether the works are provided on a working day or the time of day at which they are provided.

## Charges for monopoly services

Monopoly Services are services performed by Country Energy to facilitate contestable works such as design certification, inspection of works and provision of access permits. These services are required to ensure an appropriate level of reliability, quality of supply and safety is maintained in operation of the network, and are charged for at the AER determined rates in the tables below.

**Table 2 Applicable Labour Rates**

| Labour Class  | Hourly rate | Overtime hourly rate* |
|---------------|-------------|-----------------------|
| Admin R1      | \$64        | \$112                 |
| Design R2a    | \$80        | \$140                 |
| Inspector R2b | \$80        | \$140                 |
| Engineer R3   | \$96        | \$168                 |

*Prices are exclusive of GST*

A DNSP may impose an overtime hourly rate for services provided outside the hours of 7.30am and 4.00pm on a working day.

Travel time permitted for work associated with level 1 work is 60 minutes at the R2 labour rate.

## Price schedule for Charges for monopoly services effective 1 July 2009

| Monopoly service                             | Underground urban residential<br>(vacant lots)                                                                      | Rural overhead subdivisions and rural                                                                                  | Underground commercial and industrial<br>rural subdivisions (vacant lots – no<br>development)         | Commercial and<br>industrial<br>developments | Asset relocation or<br>street lighting   |
|----------------------------------------------|---------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------|----------------------------------------------|------------------------------------------|
| Design information                           | Up to 5 \$159<br>6 to 10 \$239<br>11 to 40 \$398<br>Over 40 \$478                                                   | R2 per hour                                                                                                            | R2 per hour                                                                                           | R2 per hour                                  | R2 or R3 per hour<br>(see para 1.4.2)    |
| Design certification                         | Up to 5 \$80<br>6 to 10 \$159<br>11 to 40 \$239<br>Over 40 \$318                                                    | 1 - 5 \$80<br>6 - 10 \$159<br>11+ \$239                                                                                | Up to 10 \$159<br>11 to 40 \$239<br>Over 40 \$478                                                     | R3 per hour                                  | R2 or R3 per hour<br>(see para 1.4.2)    |
| Design rechecking                            | R2 per hour                                                                                                         | R2 per hour                                                                                                            | R2 per hour                                                                                           | R3 per hour                                  | R2 or R3 per hour<br>(see para 1.4.2)    |
| Inspection of service work<br>(level 1 work) | Grade A per B per C per lot<br>First 10 \$40 \$96 \$200<br>Next 40 \$24 \$56 \$120<br>\$8 \$32 \$56                 | Grade A per B per lot C per lot<br>1 - 5 \$48 \$96 \$176<br>6 - 10 \$40 \$80 \$159<br>11+ \$32 \$56 \$120<br>(see para | Grade A per B per lot C per<br>First 10 \$40 \$96 \$200<br>Next 40 \$40 \$96 \$200<br>\$40 \$96 \$200 | R2 or R3 per hour                            | R2 or R3 per hour<br>(see para 1.4.2)    |
| Access permit                                |                                                                                                                     | \$1181 maximum per access                                                                                              | \$1181 maximum per access                                                                             | \$1181 maximum per<br>access permit          | \$1181 maximum per<br>access permit      |
| Substation commissioning                     | Residential subdivisions: \$27 per lot combined fee                                                                 | \$886 per<br>(see para 1.4.2)                                                                                          | \$886 per<br>(see para 1.4.2)                                                                         | \$886 per substation<br>(see para 1.4.2)     | \$886 per substation<br>(see para 1.4.2) |
| Administration                               | Up to 5 \$193<br>6 to 10 \$258<br>11 to 40 \$322<br>Over 40 \$387                                                   | R1 per hour (max 6 hours)                                                                                              | R1 per hour<br>(max 6 hours)                                                                          | R1 per hour<br>(max 6 hours)                 | R1 per hour                              |
| Notice of arrangement                        | \$193                                                                                                               |                                                                                                                        |                                                                                                       |                                              |                                          |
| Re-inspection (level 1 and<br>2 work)        | R2 per hour (maximum 1 hour per level 2                                                                             |                                                                                                                        |                                                                                                       |                                              |                                          |
| Re-inspection (service<br>provider)          | \$80 For the purpose of para 1.2(b), a DNSP may charge a fee that is less than this fee, but not a fee that is more |                                                                                                                        |                                                                                                       |                                              |                                          |
| Access                                       | R1 per                                                                                                              |                                                                                                                        |                                                                                                       |                                              |                                          |
| Authorisation                                | \$159                                                                                                               |                                                                                                                        |                                                                                                       |                                              |                                          |
| Inspection of service work<br>(level 2 work) | All service connections:<br>A Grade: \$20 per NOSW<br>(NOSW = Notification of service work)                         | B Grade: \$33 per                                                                                                      | C Grade: \$96 per                                                                                     |                                              |                                          |
| Site establishment                           | \$139                                                                                                               |                                                                                                                        |                                                                                                       |                                              |                                          |

*Prices are exclusive of GST*

## Appendix G: Miscellaneous services, monopoly services and emergency recoverable works

### G.1 Miscellaneous services

#### G.1.1 Supply of Conveyancing Information desk inquiry

The provision of information regarding the availability of supply, presence of the DNSP's equipment, power lines and like information for property conveyancing purposes undertaken without any physical inspection of a site, other than the provision of information or the answering of inquiries relating to any matter under freedom of information legislation.

#### G.1.2 Supply of conveyancing information field visit

The provision of information regarding the availability of supply, presence of the DNSP's equipment, power lines and like information for property conveyancing purposes undertaken by a physical inspection of a site, other than the provision of information or the answering of inquiries relating to any matter under freedom of information legislation.

#### G.1.3 Meter test

The testing of a meter in accordance with clause 6.4 of the Market Operations Rule (NSW Rules for Electricity Metering) No. 3 of 2001 (except for metering installation types 1 to 4, the testing of which is an unregulated distribution service).

#### G.1.4 Special meter reading

This service:

1. has the same meaning as the meaning given to the expression 'special meter read' in the Market Operations Rule (NSW Rules for Electricity Metering) No. 3 of 2001 (but excludes any special meter reading of metering installation types 1 to 4, which is an unregulated distribution service);

and applies in each of the following circumstances:

2. where a customer or a retail supplier requests that the DNSP undertake a special Meter read, (but does not apply where the special meter read was requested solely to verify the accuracy of a scheduled meter read and the special meter read reveals that the scheduled meter read was inaccurate or in error) or
3. where the DNSP attends at a customer's premises for the sole purpose of discharging the DNSP's obligation to read the customer's meter within the period specified by law (but not where the DNSP merely chooses to read the customer's meter without being under a legal obligation to do so) and on attending the customer's premises the DNSP is unable (through no act or omission of the DNSP), to gain access to the meter or
4. where the DNSP and the customer agree on an appointed time at which the DNSP may attend the customer's premises to enable the DNSP to discharge the DNSP's legal obligation referred to in section G.1.4(3) and when the DNSP attended at the customer's premises at the appointed time the DNSP (through no act or omission of the DNSP), was unable to gain access to the customer's meter.

#### **G.1.5 Disconnection visit (acceptable payment received)**

A site visit to a customer's premises on an occasion for the purpose of disconnecting the customer's supply for breach by the customer of a customer supply contract or a customer connection contract, where the disconnection does not occur on that occasion.

#### **G.1.6 Disconnection at meter box**

A site visit to a customer's premises to:

1. disconnect the supply of electricity to a customer via either the main switch or service fuse removal for breach by the customer of a customer supply contract or a customer connection contract, or where a retail supplier has requested that the supply to the customer be disconnected and
2. reconnect the supply following the disconnection in section G.1.6(1).

#### **G.1.7 Disconnection at pole top/pillar box**

A site visit to a customer's premises:

1. to disconnect the supply of electricity to a customer at the pole top or pillar box for breach by the customer of a customer supply contract or a customer connection contract, or where a retailer supplier has requested that the supply to a customer be disconnected, where the customer has denied access to the meter or had prior to the visit, reconnected supply without authorisation by the DNSP following a previous disconnection and
2. to reconnect the supply, following the disconnection in section G.1.7(1).

#### **G.1.8 Rectification of illegal connection**

Work undertaken by a DNSP to the property of the DNSP or to the property of another person in order to:

1. rectify damage or
2. prevent injury to persons or property, resulting from conduct that constitutes an offence under part 6, division 1 of the *Electricity Supply Act 1995* (NSW).

#### **G.1.9 Off-peak conversion**

The alteration of the off-peak meter at a customer's premises for the purpose of changing the hours of the meter's operation.

#### **G.1.10 Reconnection outside normal business hours**

1. The provision of the reconnection component of the service described in sections G.1.6(2) and G.1.7(2) outside the hours of 7.30 am and 4.00 pm on a working day, at the request of a customer or
2. The connection of electricity to a new customer outside the hours of 7.30 am and 4.00 pm on a working day at the request of the customer.

### **G.2 Monopoly services**

#### **G.2.1 Design information**

The provision of information by a DNSP to enable an ASP accredited for level 3 work to prepare a design drawing and to submit it for certification.

This may include without limitation:

1. deriving the estimated loading on the system, technically known as the ADMD (after diversity maximum demand). This estimate depends on such factors as the number of customers served and specific features of the customer's demand
2. copying drawings that show existing low and high voltage circuitry geographically and schematically) and adjacent project drawings
3. specifying the preferred sizes for overhead wires (conductors) or underground wires (cables)
4. specifying switchgear configuration type, number of pillars, lights etc
5. determining the special requirements of the DNSP's planning departments necessary to make electrical supply available to a development and cater for future projects
6. any necessary liaison with designers associated with assistance in sourcing design information and developing designs
7. nominating network connection points.

#### **G.2.2 Design certification**

A certification by a DNSP that a design (if implemented) will not compromise the safety or operation of the DNSP's distribution system.

This may include, without limitation:

1. certifying that the design information/project definition have been incorporated in the design
2. certifying that easement requirements and earthing details are shown
3. considering design issues, including checking for over-design and mechanisms to permit work on high voltage systems without disruption to customers' supply (adequate low voltage parallels)
4. certifying that funding details for components in the scope of works are correct
5. certifying that there are no obvious errors that depart from the DNSP's design standards and specifications
6. certifying that shared assets are not over-utilised to minimise developer's connection costs and that all appropriate assets have been included in the design
7. auditing design calculations such as voltage drop calculations, conductor clearance (stringing) calculations etc
8. certifying that a bill of materials has been submitted
9. certifying that an environmental assessment has been submitted by an accredited person and appropriately checked.

### **G.2.3 Design rechecking**

The rechecking of a design submitted under section 1.2.2, except where the modifications to a design are of a trivial or minor nature.

### **G.2.4 Inspection of service work (level 1 work)**

The inspection by a DNSP of work undertaken by an ASP accredited to perform level 1 work, for the purpose of ensuring the quality of assets to be handed over to the DNSP.

### **G.2.5 Inspection of service work (level 2 work)**

The inspection by a DNSP of work performed by an ASP accredited to perform level 2 work, complying with the condition below.

#### **Condition**

The minimum number of inspections required must correspond to the grade of the DNSP in table G.1 below:

**Table G.1: Inspection rate**

| <b>Grade</b> | <b>Number of inspections</b> |
|--------------|------------------------------|
| A            | 1 inspection per 25 jobs     |
| B            | 1 inspection per 5 jobs      |
| C            | Each job to be inspected     |

### **G.2.6 Re-inspection of level 1 or level 2 work**

The re-inspection by a DNSP of work (other than customer installation work) undertaken by an ASP accredited to perform level 1 or level 2 work, for the reason that on first inspection the work was found not to be satisfactory.

### **G.2.7 Re-inspection of work of a service provider**

The re-inspection by a DNSP of customer installation work undertaken by a service provider for the reason that on first inspection the work was found not to be satisfactory.

### **G.2.8 Access permit**

The provision of a permit by a DNSP to a person authorised by law to work on, or near, a distribution system.

This may include without limitation:

1. researching and documenting the request for access
2. documenting the actual switching process
3. programming the work
4. control room activities

5. fitting and removing of operational earths
6. the actual switching together with any operator's transport costs
7. identification of any customers who will be interrupted
8. low voltage switching and paralleling of substations that permits high voltage work without disrupting supply to other customers.

#### **G.2.9 Substation commissioning**

The commissioning by a DNSP of a new substation, (whether it is a single pole, padmount/kiosk or indoor/chamber) and includes:

1. all necessary pre-commissioning checks and tests prior to energising the substation via the high voltage switchgear and closing the low voltage circuit breaker, links or fuses and
2. the setting or resetting of protection equipment.

#### **G.2.10 Administration**

Work of an administrative nature (not including work of an administrative nature described in section G.2.11), involving the processing of level 1 and/or level 3 work where the customer is lawfully required to pay for the level 1 and /or level 3 work.

This may include without limitation:

1. checking supply availability
2. processing applications
3. correspondence from application to completion
4. record-keeping
5. requesting and receiving fees (initially, then prior to design and after certification)
6. receiving design drawings (registering and copying)
7. raising an order for high voltage work
8. calculating high voltage reimbursements
9. calculating the cost of a project and warranty/maintenance bond
10. organising refunds to developers for high voltage work
11. liaising with developers via phone and facsimile
12. updating geographic information systems (GIS) and mapping.

#### **G.2.11 Notice of arrangement**

Work of an administrative nature performed by a DNSP where a local council requires evidence in writing from the DNSP that all necessary arrangements have been made to supply electricity to a development.

This may include without limitation:

1. receiving and checking linen plans and 88B Instruments
2. copying linen plans
3. checking and recording easement details
4. preparing files for conveyancing officers
5. liaising with developers if errors or changes are required
6. checking and receiving duct declarations and any amended linen plans and 88B Instruments approved by a conveyancing officer
7. preparing notifications of arrangement.

#### **G.2.12 Access**

The provision of access to switchrooms, substations and the like to an ASP who is accompanied by a member of staff of a DNSP, but does not include the circumstance where an ASP is provided with keys for the purpose of securing access and is not accompanied by a member of staff of the DNSP.

#### **G.2.13 Authorisation**

The annual authorisation by a DNSP of individual employees or sub-contractors of an ASP to carry out work on or near the DNSP's distribution system. This may include without limitation:

1. familiarisation and training in the DNSP's safety rules and access permit requirements
2. induction in the unique aspects of the network
3. verification that the applicant has undertaken the necessary safety training (resuscitation etc) within the last 12 months
4. conducting interviews/examinations for access permit recipients
5. issuing authorisation cards.

#### **G.2.14 Site establishment**

The issue of a meter by a DNSP and its co-ordination with NEMMCO for the purpose of establishing a NMI in MSATS for new premises or for any existing premises for which NEMMCO requires a new NMI and for checking and updating network load data.

### **G.3 Emergency recoverable works**

Emergency work undertaken by a DNSP to repair damage to the distribution system of the DNSP, where the damage is the consequence of the act or omission of a person, for which that person is liable to another (which may include the DNSP) for that damage. For example, emergency work

undertaken by a DNSP to repair damage to the DNSP's distribution system resulting from a motor vehicle collision where the driver was negligent.

## G.4 Definitions and interpretation

### G.4.1 Definitions

- (1) In this appendix:

**ASP** means an accredited service provider and is a person who has been accredited under Part 10 Electricity Supply (General) Regulation 2001 (NSW)

**MSATS** means the market settlement and transfer system operated by NEMMCO

**NMI** means a national metering identifier

**service provider** means a person who may lawfully undertake customer installation work

- (2) In this appendix the following expressions have the meaning given to them in the *Electricity Supply Act 1995* (NSW):

**electricity supply contract**

**electricity connection contract**

**retail supplier.**

- (3) References to sections are references to sections in this appendix.

### G.4.2 Interpretation of grade or level of accreditation

1. In this appendix, the reference to a grade or level, means the grade or level for which an ASP is accredited, applying the classification system in table 2 below.
2. If the classification system in table G.2 is amended during the next regulatory control period, the reference in this appendix to a grade or level will be taken to be a reference to the grade or level in the amended classification system that most closely approximates the grade or level in table G.2.

**Table G.2: Classification of accreditation**

| Accreditation | Type of work                                                                                                                                                        | Category                                                                                                                                                                                       |
|---------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Level 1       | Construction of transmission and distribution works, including high and low voltage, overhead and underground reticulation and substations.                         | Underground (UG)<br>Overhead (OH)                                                                                                                                                              |
| Level 2       | Service Work:<br>Construction and/or installation of the service line interface between the distribution system and consumer terminals, including metering services | Disconnection and reconnection<br>Underground (UG) service lines<br>Overhead (OH) service lines<br>Metering and energising new installations<br>Installing contestable metering – under review |
| Level 3       | Design of transmission and distribution works                                                                                                                       | Underground (UG)<br>Overhead (OH)                                                                                                                                                              |

## Appendix H: Fees and charges – miscellaneous services, monopoly services and emergency recoverable works

### H.1 Introduction

The miscellaneous services, monopoly services and emergency recoverable works in this appendix (having the abbreviated descriptions given to them in sections H.3, H.4 and H.5 respectively) have the full meaning given to them in appendix G of this final decision.

### H.2 Levying charges for miscellaneous services, monopoly services and emergency recoverable works

- a. The charge that may be levied by a DNSP for the provision of a miscellaneous service described in section H.3 or emergency recoverable works specified in section H.5, must not be more than (but may be less than) the charge specified or calculated for the miscellaneous service in section H.3 or the emergency recoverable work in section H.5 respectively.
- b. Unless otherwise specified, the charge that is to be levied by a DNSP for the provision of a monopoly service described in section H.4, must not be more than or less than the charge specified or calculated for that monopoly service in that section.
- c. The charges for miscellaneous services, monopoly services and emergency recoverable works in this appendix are to be levied in accordance with the conditions (if any) specified in appendix G of this final decision applying to each service and in accordance with the conditions accompanying the respective sections in this appendix.

### H.3 Miscellaneous services

Refer to AER miscellaneous services charges table 1 on page 1

#### H.3.2 Conditions relating to charges for miscellaneous services

- a. Disconnection at meter box and pole/top pillar box.  
  
For the avoidance of doubt, if, following a request from a customer, the reconnection component of the services described in section H.3.1 as 'disconnection at meter box' and 'disconnection at pole top/pillar box' are provided outside the hours of 7.30 am and 4.00 pm on a working day, the charge that the DNSP may levy for the provision of each of those services will be the charge for each service in section H.3.1 plus the charge for the service described as 'reconnection outside normal business hours', if applicable.
- b. Meter test.  
  
If the service described as 'meter test' is undertaken on premises serviced by more than one meter the following applies:
  - i. if the meter test reveals that all of the meters are operating satisfactorily, a DNSP may only levy one charge for the provision of the service as if the meter test were undertaken on a single meter
  - ii. if the meter test reveals that one or more of the meters are not operating satisfactorily, the DNSP may not levy any charge for the provision of the service.
- c. Special meter reading.

A charge may not be levied for the service described as 'special meter reading' in either of the following circumstances:

- i. where the customer is moving or is about to move premises or ii. where the service reveals that a scheduled meter reading was inaccurate.
- d. Off-peak conversion

A charge for the service described as 'off-peak conversion' may only be levied for each occasion that the service is provided in excess of once in any 12 month period.

## H.4 Monopoly services

Refer to the price schedule on page 3 for the AER's charges for monopoly services

### H.4.2 Conditions relating to charges for monopoly services

- a. Inspection

For the service described as 'inspection':

- i. in the case of 'commercial and industrial developments' and 'asset relocation or street lighting', the level of inspection is to be determined by the DNSP prior to performing the service
- ii. the grade specified is the grade of the ASP, accredited for that grade iii. in the case of 'rural overhead subdivisions and rural extensions', the charge applies to inspections (other than substation poles) and represents the total charge for three separate visits. For substation poles the charge for ASP grade A is \$279; for grade B is \$557 and for grade C is \$703.

- b. Substation commissioning

For the service described as 'substation commissioning' (other than in the case of 'underground urban residential subdivision vacant lots') the charge specified is to be levied only where it is a single transformer/RMI unit. In all other cases the service is to be charged at the R3 labour rate.

- c. Lots In table H.4, where the monopoly service relates to a service connection required for multiple dwelling subdivisions, the per lot fee in that table should be applied per service connection.

- d. Design information/design certification/ design rechecking

For the services described as 'design information', 'design certification' and 'design rechecking', the labour rate (R2 or R3) is to be applied based on the DNSP's assessment of the level of skill required to perform the service.

- e. Travel time

In addition to the charge specified or calculated under section H.4.1, a DNSP must charge for that amount of travel time (permitted for that DNSP in table H.5 below) associated with the inspection of level 1 work at the R2 labour rate.

**Table H.5: Travel time**

| <b>DNSP</b>     | <b>Amount of travel time permitted</b> |
|-----------------|----------------------------------------|
| EnergyAustralia | 30 minutes                             |
| Integral Energy | 30 minutes                             |
| Country Energy  | 60 minutes                             |

**f. Overtime**

If a monopoly service is provided outside the hours of 7.30 am and 4.00 pm on a working day at the request of an ASP (other than where the DNSP requires that the work be performed outside those hours) the charge that the DNSP may impose for the provision of that service will be an amount up to 175 per cent of the charge for that service in section H.4.1.

**g. Labour rates**

- i. In section H.4.1 the references to R1, R2 and R3 denote the class of labour which performs the service at the hourly rate corresponding to the class in table 6 below.
- ii. For the purpose of the labour class R2 in the table, the DNSP will determine whether the service is to be provided by an inspector or an engineer at that class, depending on the nature and complexity of the service.

**Refer to Table 2 page 2 for AER labour rates**

## **H.5 Emergency recoverable works**

### **H.5.1 Charges for emergency recoverable works**

- a. The charge that a DNSP may levy for emergency recoverable works must not exceed the sum of the following:
  - i. 110 per cent of the costs (other than labour costs) actually incurred in providing the emergency recoverable works and
  - ii. the cost of labour actually used to undertake the emergency recoverable works determined by applying 150 per cent of the R2 labour rate for that labour.
- b. For the avoidance of doubt, in the application of section H.5.1(a)(2), where a DNSP retains labour for a specified period for the purpose of that labour undertaking emergency recoverable works, the DNSP may only charge for so much of that specified period during which the labour actually undertakes the emergency recoverable works. For example, if a DNSP retains labour for a minimum specified period of four hours and the time required to actually undertake the emergency recoverable works is only one hour, the DNSP may only charge for the one hour and not the four hours.

### **H.5.2 Conditions for emergency recoverable works**

The charges for emergency recoverable works in section H.5.1 apply irrespective of whether the works are provided on a working day or the time of day at which they are provided.

## H.6 Definitions and interpretation

In this appendix, unless the context requires otherwise:

- a. expressions used in this appendix that are defined in appendix G of this final decision, have the meaning given to them in that appendix G
- b. interpretation provisions in appendix G of this final decision apply to this appendix
- c. references to sections are references to sections of this appendix.

# Country Energy's Streetlighting Price List

Effective 1 July 2010

Applicable to assets constructed before 1 July 2009



| Tariff Code           | Description             | Dedicated Pole    | Number of lights per Construction | Tariff Description                             | 2010/2011 Tariff |
|-----------------------|-------------------------|-------------------|-----------------------------------|------------------------------------------------|------------------|
| FLU0010-ST-0010-002-B | Fluorescent 9           | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$38.15          |
| FLU0010-ST-0110-001-B | Fluorescent 9           | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$49.55          |
| FLU0020-ST-0010-001-B | Fluorescent 11          | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$62.15          |
| FLU0030-ST-0110-002-B | Fluorescent 13          | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$38.15          |
| FLU0040-ST-0010-002-B | Fluorescent 15          | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$38.15          |
| FLU0050-ST-0010-001-B | Fluorescent 20          | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$62.15          |
| FLU0050-ST-0010-002-B | Fluorescent 20          | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$38.15          |
| FLU0050-ST-0110-002-B | Fluorescent 20          | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$38.15          |
| FLU0060-ST-0010-001-B | Fluorescent Twin 20     | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$68.12          |
| FLU0060-ST-0010-002-B | Fluorescent Twin 20     | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$44.11          |
| FLU0060-ST-0740-002-B | Fluorescent Twin 20     | SHARED OR NO POLE |                                   | 2 2-Unmetered, Funded by Others, CE Maintained | \$44.11          |
| FLU0060-ST-0990-001-B | Fluorescent Twin 20     | STEEL POLE        |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$174.16         |
| FLU0070-ST-0010-001-B | Fluorescent 3x20        | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$74.08          |
| FLU0070-ST-0010-002-B | Fluorescent 3x20        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$50.07          |
| FLU0080-ST-0010-001-B | Fluorescent 4x20        | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$80.04          |
| FLU0080-ST-0010-002-B | Fluorescent 4x20        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$56.04          |
| FLU0080-ST-0990-001-B | Fluorescent 4x20        | STEEL POLE        |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$186.08         |
| FLU0100-ST-0010-001-B | Fluorescent 26          | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$62.15          |
| FLU0100-ST-0010-002-B | Fluorescent 26          | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$38.15          |
| FLU0110-ST-0010-002-B | Fluorescent 2x26        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$44.11          |
| FLU0130-ST-0010-001-B | Fluorescent 40          | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$60.89          |
| FLU0130-ST-0010-002-B | Fluorescent 40          | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$36.89          |
| FLU0130-ST-0110-001-B | Fluorescent 40          | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$48.28          |
| FLU0130-ST-0110-002-B | Fluorescent 40          | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$36.89          |
| FLU0130-ST-0740-001-B | Fluorescent 40          | SHARED OR NO POLE |                                   | 2 1-Unmetered, CE Funded, CE Maintained        | \$70.16          |
| FLU0130-ST-0740-002-B | Fluorescent 40          | SHARED OR NO POLE |                                   | 2 2-Unmetered, Funded by Others, CE Maintained | \$36.89          |
| FLU0130-ST-0810-001-B | Fluorescent 40          | WOOD POLE         |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$118.95         |
| FLU0130-ST-0810-002-B | Fluorescent 40          | WOOD POLE         |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$47.79          |
| FLU0130-ST-0820-002-B | Fluorescent 40          | SHARED OR NO POLE |                                   | 3 2-Unmetered, Funded by Others, CE Maintained | \$36.89          |
| FLU0130-ST-0990-001-B | Fluorescent 40          | STEEL POLE        |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$166.93         |
| FLU0130-ST-0990-002-B | Fluorescent 40          | STEEL POLE        |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$46.95          |
| FLU0140-ST-0010-001-B | Fluorescent 2x40        | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$65.59          |
| FLU0140-ST-0010-002-B | Fluorescent 2x40        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$41.59          |
| FLU0140-ST-0990-001-B | Fluorescent 2x40        | STEEL POLE        |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$171.63         |
| FLU0150-ST-0010-001-B | Fluorescent 3x40        | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$70.29          |
| FLU0150-ST-0010-002-B | Fluorescent 3x40        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$46.29          |
| FLU0150-ST-0810-002-B | Fluorescent 3x40        | WOOD POLE         |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$57.20          |
| FLU0160-ST-0010-001-B | Fluorescent 4x40        | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$74.99          |
| FLU0160-ST-0010-002-B | Fluorescent 4x40        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$50.99          |
| FLU0160-ST-0810-002-B | Fluorescent 4x40        | WOOD POLE         |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$61.90          |
| FLU0160-ST-0990-001-B | Fluorescent 4x40        | STEEL POLE        |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$181.03         |
| FLU0160-ST-0990-002-B | Fluorescent 4x40        | STEEL POLE        |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$61.06          |
| FLU0170-ST-0010-002-B | Fluorescent 6x40        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$60.39          |
| FLU0180-ST-0010-001-B | Fluorescent 58          | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$60.89          |
| FLU0190-ST-0010-001-B | Fluorescent 2x58        | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$65.59          |
| FLU0190-ST-0010-002-B | Fluorescent 2x58        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$41.59          |
| FLU0200-ST-0010-002-B | Fluorescent 4x58        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$50.99          |
| FLU0240-ST-0010-001-B | Fluorescent 80          | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$60.89          |
| FLU0240-ST-0010-002-B | Fluorescent 80          | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$36.89          |
| FLU0240-ST-0990-001-B | Fluorescent 80          | STEEL POLE        |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$166.93         |
| FLU0240-ST-0990-002-B | Fluorescent 80          | STEEL POLE        |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$46.95          |
| FLU0240-ST-1000-002-B | Fluorescent 80          | STEEL POLE        |                                   | 2 2-Unmetered, Funded by Others, CE Maintained | \$46.95          |
| FLU0240-ST-1260-002-B | Fluorescent 80          | WOOD POLE         |                                   | 2 2-Unmetered, Funded by Others, CE Maintained | \$47.79          |
| FLU0250-ST-0010-001-B | Fluorescent 2x80        | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$65.59          |
| FLU0250-ST-0010-002-B | Fluorescent 2x80        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$41.59          |
| FLU0260-ST-0010-002-B | Fluorescent 3x80        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$46.29          |
| FLU0270-ST-0010-002-B | Fluorescent 4x80        | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$50.99          |
| FLU0300-ST-0010-002-B | Fluorescent 2x125       | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$41.59          |
| HPS0010-ST-0040-001-B | High Pressure Sodium 50 | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$60.31          |
| HPS0010-ST-0040-002-B | High Pressure Sodium 50 | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$34.60          |
| HPS0010-ST-0090-002-B | High Pressure Sodium 50 | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$34.60          |
| HPS0010-ST-0350-001-B | High Pressure Sodium 50 | WOOD POLE         |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$118.37         |
| HPS0010-ST-0350-002-B | High Pressure Sodium 50 | WOOD POLE         |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$45.50          |
| HPS0010-ST-0360-001-B | High Pressure Sodium 50 | STEEL POLE        |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$166.35         |
| HPS0010-ST-0360-002-B | High Pressure Sodium 50 | STEEL POLE        |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$44.66          |
| HPS0010-ST-0750-001-B | High Pressure Sodium 50 | SHARED OR NO POLE |                                   | 3 1-Unmetered, CE Funded, CE Maintained        | \$82.27          |
| HPS0010-TA-0090-001-B | High Pressure Sodium 50 | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$54.45          |
| HPS0010-TA-0090-002-B | High Pressure Sodium 50 | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$27.24          |
| HPS0010-TA-0140-001-B | High Pressure Sodium 50 | WOOD POLE         |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$112.51         |
| HPS0010-TA-0170-001-B | High Pressure Sodium 50 | STEEL POLE        |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$160.49         |
| HPS0010-TA-0170-002-B | High Pressure Sodium 50 | STEEL POLE        |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$37.30          |
| HPS0010-TA-1180-001-B | High Pressure Sodium 50 | SHARED OR NO POLE |                                   | 2 1-Unmetered, CE Funded, CE Maintained        | \$66.93          |
| HPS0010-TA-1200-001-B | High Pressure Sodium 50 | SHARED OR NO POLE |                                   | 4 1-Unmetered, CE Funded, CE Maintained        | \$91.89          |
| HPS0020-ST-0040-001-B | High Pressure Sodium 70 | SHARED OR NO POLE |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$60.19          |
| HPS0020-ST-0040-002-B | High Pressure Sodium 70 | SHARED OR NO POLE |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$34.48          |
| HPS0020-ST-0170-002-B | High Pressure Sodium 70 | STEEL POLE        |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$44.54          |
| HPS0020-ST-0350-001-B | High Pressure Sodium 70 | WOOD POLE         |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$118.25         |
| HPS0020-ST-0350-002-B | High Pressure Sodium 70 | WOOD POLE         |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$45.39          |
| HPS0020-ST-0360-001-B | High Pressure Sodium 70 | STEEL POLE        |                                   | 1 1-Unmetered, CE Funded, CE Maintained        | \$166.23         |
| HPS0020-ST-0360-002-B | High Pressure Sodium 70 | STEEL POLE        |                                   | 1 2-Unmetered, Funded by Others, CE Maintained | \$44.54          |

|                       |                          |                   |  |   |                                              |          |
|-----------------------|--------------------------|-------------------|--|---|----------------------------------------------|----------|
| HPS0020-ST-0730-001-B | High Pressure Sodium 70  | STEEL POLE        |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$177.21 |
| HPS0020-ST-0730-002-B | High Pressure Sodium 70  | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0020-ST-0750-002-B | High Pressure Sodium 70  | SHARED OR NO POLE |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$34.48  |
| HPS0020-ST-0880-002-B | High Pressure Sodium 70  | STEEL POLE        |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0020-ST-0890-001-B | High Pressure Sodium 70  | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$71.17  |
| HPS0020-ST-0890-002-B | High Pressure Sodium 70  | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$34.48  |
| HPS0020-ST-0910-001-B | High Pressure Sodium 70  | WOOD POLE         |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$129.23 |
| HPS0020-ST-0910-002-B | High Pressure Sodium 70  | WOOD POLE         |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$45.39  |
| HPS0020-TA-0090-001-B | High Pressure Sodium 70  | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$59.36  |
| HPS0020-TA-0090-002-B | High Pressure Sodium 70  | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$32.15  |
| HPS0020-TA-0140-001-B | High Pressure Sodium 70  | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$117.42 |
| HPS0020-TA-0140-002-B | High Pressure Sodium 70  | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$43.06  |
| HPS0020-TA-0170-001-B | High Pressure Sodium 70  | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$165.40 |
| HPS0020-TA-0170-002-B | High Pressure Sodium 70  | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$42.21  |
| HPS0070-ST-0040-001-B | High Pressure Sodium 100 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$60.19  |
| HPS0070-ST-0040-002-B | High Pressure Sodium 100 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$34.48  |
| HPS0070-ST-0350-001-B | High Pressure Sodium 100 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$118.25 |
| HPS0070-ST-0360-001-B | High Pressure Sodium 100 | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$166.23 |
| HPS0070-ST-0360-002-B | High Pressure Sodium 100 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0080-ST-0050-001-B | High Pressure Sodium 120 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$83.85  |
| HPS0080-ST-0360-002-B | High Pressure Sodium 120 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.38  |
| HPS0090-ST-0050-001-B | High Pressure Sodium 150 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$81.26  |
| HPS0090-ST-0050-002-B | High Pressure Sodium 150 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$36.74  |
| HPS0090-ST-0220-001-B | High Pressure Sodium 150 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$139.32 |
| HPS0090-ST-0220-002-B | High Pressure Sodium 150 | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$47.64  |
| HPS0090-ST-0310-001-B | High Pressure Sodium 150 | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$175.04 |
| HPS0090-ST-0310-002-B | High Pressure Sodium 150 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-ST-0690-001-B | High Pressure Sodium 150 | STEEL POLE        |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$192.58 |
| HPS0090-ST-0690-002-B | High Pressure Sodium 150 | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-ST-0710-002-B | High Pressure Sodium 150 | STEEL POLE        |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-ST-0720-001-B | High Pressure Sodium 150 | STEEL POLE        |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$227.64 |
| HPS0090-ST-0720-002-B | High Pressure Sodium 150 | STEEL POLE        |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-ST-0980-002-B | High Pressure Sodium 150 | WOOD POLE         |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$47.64  |
| HPS0090-ST-1010-001-B | High Pressure Sodium 150 | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$98.80  |
| HPS0090-ST-1010-002-B | High Pressure Sodium 150 | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$36.74  |
| HPS0090-ST-1360-002-B | High Pressure Sodium 150 | R/BOUT COLUMN     |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-TA-0050-001-B | High Pressure Sodium 150 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$84.43  |
| HPS0090-TA-0050-002-B | High Pressure Sodium 150 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$39.91  |
| HPS0090-TA-0220-001-B | High Pressure Sodium 150 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$142.49 |
| HPS0090-TA-0310-001-B | High Pressure Sodium 150 | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$178.21 |
| HPS0100-ST-0060-001-B | High Pressure Sodium 220 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.26  |
| HPS0100-ST-0060-002-B | High Pressure Sodium 220 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$45.56  |
| HPS0100-ST-0230-002-B | High Pressure Sodium 220 | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$56.46  |
| HPS0100-ST-0320-001-B | High Pressure Sodium 220 | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$184.04 |
| HPS0100-ST-0320-002-B | High Pressure Sodium 220 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$55.62  |
| HPS0100-ST-0390-002-B | High Pressure Sodium 220 | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$55.62  |
| HPS0100-ST-0430-001-B | High Pressure Sodium 220 | STEEL POLE        |  | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$219.47 |
| HPS0110-ST-0060-001-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$82.60  |
| HPS0110-ST-0060-002-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-0230-001-B | High Pressure Sodium 250 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$140.66 |
| HPS0110-ST-0230-002-B | High Pressure Sodium 250 | WOOD POLE         |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$48.80  |
| HPS0110-ST-0320-001-B | High Pressure Sodium 250 | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$176.38 |
| HPS0110-ST-0320-002-B | High Pressure Sodium 250 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0390-001-B | High Pressure Sodium 250 | STEEL POLE        |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$194.09 |
| HPS0110-ST-0390-002-B | High Pressure Sodium 250 | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0430-002-B | High Pressure Sodium 250 | STEEL POLE        |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0470-001-B | High Pressure Sodium 250 | STEEL POLE        |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$229.52 |
| HPS0110-ST-0470-002-B | High Pressure Sodium 250 | STEEL POLE        |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0550-001-B | High Pressure Sodium 250 | R/BOUT COLUMN     |  | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$295.27 |
| HPS0110-ST-0550-002-B | High Pressure Sodium 250 | R/BOUT COLUMN     |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0590-001-B | High Pressure Sodium 250 | R/BOUT COLUMN     |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$312.98 |
| HPS0110-ST-0590-002-B | High Pressure Sodium 250 | R/BOUT COLUMN     |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0610-001-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$89.66  |
| HPS0110-ST-0610-002-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-0650-002-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-0760-001-B | High Pressure Sodium 250 | WOOD POLE         |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$158.38 |
| HPS0110-ST-0760-002-B | High Pressure Sodium 250 | WOOD POLE         |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$48.80  |
| HPS0110-ST-0930-002-B | High Pressure Sodium 250 | WOOD POLE         |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$48.80  |
| HPS0110-ST-0960-001-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$100.31 |
| HPS0110-ST-0960-002-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-0970-002-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-1070-001-B | High Pressure Sodium 250 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$147.73 |
| HPS0110-ST-1070-002-B | High Pressure Sodium 250 | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$48.80  |
| HPS0110-ST-1120-001-B | High Pressure Sodium 250 | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$183.44 |
| HPS0110-ST-1120-002-B | High Pressure Sodium 250 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-1160-001-B | High Pressure Sodium 250 | WOOD POLE         |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$172.50 |
| HPS0110-ST-1330-002-B | High Pressure Sodium 250 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-1340-002-B | High Pressure Sodium 250 | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-1380-002-B | High Pressure Sodium 250 | R/BOUT COLUMN     |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-1450-002-B | High Pressure Sodium 250 | R/BOUT COLUMN     |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-TA-0060-001-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$80.64  |
| HPS0110-TA-0060-002-B | High Pressure Sodium 250 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$35.93  |
| HPS0110-TA-0230-001-B | High Pressure Sodium 250 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$138.70 |
| HPS0110-TA-0320-001-B | High Pressure Sodium 250 | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$174.42 |
| HPS0110-TA-0320-002-B | High Pressure Sodium 250 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.00  |
| HPS0110-TA-0470-001-B | High Pressure Sodium 250 | STEEL POLE        |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$227.55 |
| HPS0110-TA-0590-001-B | High Pressure Sodium 250 | R/BOUT COLUMN     |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$311.01 |

|                       |                                             |                   |   |                                              |          |
|-----------------------|---------------------------------------------|-------------------|---|----------------------------------------------|----------|
| HPS0110-TA-0590-002-B | High Pressure Sodium 250                    | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$46.00  |
| HPS0110-TA-0960-001-B | High Pressure Sodium 250                    | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$98.35  |
| HPS0110-TA-1120-002-B | High Pressure Sodium 250                    | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.00  |
| HPS0120-ST-0860-002-B | High Pressure Sodium 2x250                  | R/BOUT COLUMN     | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$63.50  |
| HPS0120-ST-0870-002-B | High Pressure Sodium 2x250                  | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$63.50  |
| HPS0140-ST-0070-001-B | High Pressure Sodium 310 (Retrofit)         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$94.31  |
| HPS0140-ST-0070-002-B | High Pressure Sodium 310 (Retrofit)         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0140-ST-0240-002-B | High Pressure Sodium 310 (Retrofit)         | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$55.44  |
| HPS0140-ST-0330-002-B | High Pressure Sodium 310 (Retrofit)         | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$54.60  |
| HPS0140-ST-0400-002-B | High Pressure Sodium 310 (Retrofit)         | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$54.60  |
| HPS0140-ST-1030-001-B | High Pressure Sodium 310 (Retrofit)         | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$117.10 |
| HPS0160-ST-0070-001-B | High Pressure Sodium 360                    | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$98.86  |
| HPS0160-ST-0070-002-B | High Pressure Sodium 360                    | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.09  |
| HPS0160-ST-0240-001-B | High Pressure Sodium 360                    | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$156.93 |
| HPS0160-ST-0240-002-B | High Pressure Sodium 360                    | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$59.99  |
| HPS0160-ST-0330-001-B | High Pressure Sodium 360                    | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$192.65 |
| HPS0160-ST-0330-002-B | High Pressure Sodium 360                    | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$59.15  |
| HPS0160-ST-1020-001-B | High Pressure Sodium 360                    | SHARED OR NO POLE | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$129.22 |
| HPS0160-ST-1030-001-B | High Pressure Sodium 360                    | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$121.65 |
| HPS0170-ST-0070-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$91.52  |
| HPS0170-ST-0070-002-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.75  |
| HPS0170-ST-0240-001-B | High Pressure Sodium 400                    | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$149.58 |
| HPS0170-ST-0240-002-B | High Pressure Sodium 400                    | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$52.65  |
| HPS0170-ST-0270-002-B | High Pressure Sodium 400                    | R/BOUT COLUMN     | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0330-001-B | High Pressure Sodium 400                    | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$185.30 |
| HPS0170-ST-0330-002-B | High Pressure Sodium 400                    | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0400-001-B | High Pressure Sodium 400                    | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$208.09 |
| HPS0170-ST-0400-002-B | High Pressure Sodium 400                    | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0440-001-B | High Pressure Sodium 400                    | STEEL POLE        | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$230.87 |
| HPS0170-ST-0440-002-B | High Pressure Sodium 400                    | STEEL POLE        | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0480-002-B | High Pressure Sodium 400                    | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0560-002-B | High Pressure Sodium 400                    | R/BOUT COLUMN     | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0600-002-B | High Pressure Sodium 400                    | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0620-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$89.67  |
| HPS0170-ST-0620-002-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.75  |
| HPS0170-ST-0660-002-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.75  |
| HPS0170-ST-0770-002-B | High Pressure Sodium 400                    | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$52.65  |
| HPS0170-ST-0900-002-B | High Pressure Sodium 400                    | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$52.65  |
| HPS0170-ST-1030-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$114.31 |
| HPS0170-ST-1030-002-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.75  |
| HPS0170-ST-1100-001-B | High Pressure Sodium 400                    | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$154.93 |
| HPS0170-ST-1100-002-B | High Pressure Sodium 400                    | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$52.65  |
| HPS0170-ST-1130-001-B | High Pressure Sodium 400                    | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$218.78 |
| HPS0170-ST-1170-001-B | High Pressure Sodium 400                    | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$190.65 |
| HPS0170-ST-1170-002-B | High Pressure Sodium 400                    | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-1250-001-B | High Pressure Sodium 400                    | WOOD POLE         | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$211.19 |
| HPS0170-TA-0070-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.34  |
| HPS0180-ST-0860-001-B | High Pressure Sodium 2x400                  | R/BOUT COLUMN     | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$349.76 |
| HPS0180-ST-0870-001-B | High Pressure Sodium 2x400                  | R/BOUT COLUMN     | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$377.88 |
| HPS0180-ST-0870-002-B | High Pressure Sodium 2x400                  | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$71.20  |
| HPS0210-ST-0250-001-B | High Pressure Sodium 600 (Internal Ignitor) | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$340.18 |
| HPS0250-ST-0120-001-B | High Pressure Sodium 1000                   | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$248.79 |
| HPS0250-ST-0120-002-B | High Pressure Sodium 1000                   | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$164.83 |
| HPS0250-ST-0850-001-B | High Pressure Sodium 1000                   | R/BOUT COLUMN     | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$425.32 |
| HPS0250-ST-1050-001-B | High Pressure Sodium 1000                   | R/BOUT COLUMN     | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$481.58 |
| HPS0250-ST-1050-002-B | High Pressure Sodium 1000                   | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$174.90 |
| INC0010-ST-0010-002-B | Incandescent 30                             | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INC0010-ST-0810-001-B | Incandescent 30                             | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$148.45 |
| INC0020-ST-0010-001-B | Incandescent 40                             | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.39  |
| INC0020-ST-0010-002-B | Incandescent 40                             | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INC0020-ST-0810-001-B | Incandescent 40                             | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$148.45 |
| INC0020-ST-0830-002-B | Incandescent 40                             | SHARED OR NO POLE | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INC0030-ST-0010-001-B | Incandescent 60                             | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.39  |
| INC0030-ST-0010-002-B | Incandescent 60                             | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INC0040-ST-0010-001-B | Incandescent 75                             | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.39  |
| INC0040-ST-0010-002-B | Incandescent 75                             | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INC0040-ST-0810-001-B | Incandescent 75                             | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$148.45 |
| INC0040-ST-0990-001-B | Incandescent 75                             | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$196.43 |
| INC0050-ST-0010-001-B | Incandescent 100                            | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.39  |
| INC0050-ST-0010-002-B | Incandescent 100                            | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INC0050-ST-0110-002-B | Incandescent 100                            | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INC0050-ST-0810-001-B | Incandescent 100                            | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$148.45 |
| INC0050-ST-0990-001-B | Incandescent 100                            | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$196.43 |
| INC0070-ST-0740-002-B | Incandescent 130                            | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INC0080-ST-0010-001-B | Incandescent 150                            | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |
| INC0080-ST-0010-002-B | Incandescent 150                            | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INC0080-ST-0110-002-B | Incandescent 150                            | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INC0080-ST-0810-001-B | Incandescent 150                            | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$151.45 |
| INC0090-ST-0010-001-B | Incandescent 200                            | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |
| INC0090-ST-0010-002-B | Incandescent 200                            | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INC0090-ST-0810-001-B | Incandescent 200                            | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$151.45 |
| INC0100-ST-0010-001-B | Incandescent 300                            | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |
| INC0100-ST-0010-002-B | Incandescent 300                            | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INC0100-ST-0610-001-B | Incandescent 300                            | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$121.16 |
| INC0100-ST-0810-001-B | Incandescent 300                            | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$151.45 |
| INC0100-ST-0990-001-B | Incandescent 300                            | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$199.43 |
| INC0110-ST-0010-001-B | Incandescent 500                            | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |

|                       |                                          |                   |   |                                              |          |
|-----------------------|------------------------------------------|-------------------|---|----------------------------------------------|----------|
| INC0110-ST-0010-002-B | Incandescent 500                         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INC0110-ST-0110-001-B | Incandescent 500                         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$80.78  |
| INC0110-ST-0810-001-B | Incandescent 500                         | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$151.45 |
| INC0130-ST-0010-001-B | Incandescent 800                         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |
| INC0140-ST-0680-002-B | Incandescent 1000                        | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INC0140-ST-0900-002-B | Incandescent 1000                        | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$80.30  |
| INC0140-ST-1130-002-B | Incandescent 1000                        | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$79.45  |
| INC0160-ST-0640-001-B | Incandescent 1500                        | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$117.32 |
| INC0160-ST-0640-002-B | Incandescent 1500                        | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INC0160-ST-1170-002-B | Incandescent 1500                        | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$79.45  |
| LPS0010-ST-0040-001-B | Low Pressure Sodium 18                   | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$74.81  |
| LPS0010-ST-0350-001-B | Low Pressure Sodium 18                   | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$132.87 |
| LPS0010-ST-0350-002-B | Low Pressure Sodium 18                   | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$60.00  |
| LPS0020-ST-0040-001-B | Low Pressure Sodium 35                   | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$74.81  |
| LPS0020-ST-0040-002-B | Low Pressure Sodium 35                   | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.09  |
| LPS0030-ST-0040-001-B | Low Pressure Sodium 55                   | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$74.81  |
| LPS0030-ST-0040-002-B | Low Pressure Sodium 55                   | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.09  |
| LPS0030-ST-0360-001-B | Low Pressure Sodium 55                   | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.85 |
| LPS0040-ST-0050-001-B | Low Pressure Sodium 90/100               | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$95.94  |
| LPS0040-ST-0050-002-B | Low Pressure Sodium 90/100               | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$51.41  |
| LPS0040-ST-0060-001-B | Low Pressure Sodium 90/100               | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$96.11  |
| LPS0040-ST-0220-001-B | Low Pressure Sodium 90/100               | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$154.00 |
| LPS0040-ST-0310-001-B | Low Pressure Sodium 90/100               | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$189.72 |
| LPS0050-ST-0060-001-B | Low Pressure Sodium 135                  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$98.94  |
| LPS0050-ST-0060-002-B | Low Pressure Sodium 135                  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$54.23  |
| LPS0050-ST-0230-001-B | Low Pressure Sodium 135                  | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$157.00 |
| LPS0050-ST-0230-002-B | Low Pressure Sodium 135                  | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$65.14  |
| LPS0060-ST-0060-002-B | Low Pressure Sodium 150                  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$58.18  |
| LPS0060-ST-0230-002-B | Low Pressure Sodium 150                  | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.08  |
| LPS0060-ST-0320-002-B | Low Pressure Sodium 150                  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$68.24  |
| LPS0080-ST-0070-001-B | Low Pressure Sodium 180                  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$107.95 |
| LPS0080-ST-0230-001-B | Low Pressure Sodium 180                  | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$160.94 |
| LPS0080-ST-0240-001-B | Low Pressure Sodium 180                  | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$166.01 |
| LPS0090-ST-0070-002-B | Low Pressure Sodium 310                  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$58.18  |
| MHR0010-ST-0040-002-B | Metal Halide (Reactor Control Gear) 70   | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$58.71  |
| MHR0010-ST-0360-002-B | Metal Halide (Reactor Control Gear) 70   | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$68.77  |
| MHR0030-ST-0050-002-B | Metal Halide (Reactor Control Gear) 150  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$62.65  |
| MHR0030-ST-0310-002-B | Metal Halide (Reactor Control Gear) 150  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-0060-002-B | Metal Halide (Reactor Control Gear) 250  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$62.65  |
| MHR0060-ST-0320-001-B | Metal Halide (Reactor Control Gear) 250  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$201.13 |
| MHR0060-ST-0320-002-B | Metal Halide (Reactor Control Gear) 250  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-0390-002-B | Metal Halide (Reactor Control Gear) 250  | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-0430-002-B | Metal Halide (Reactor Control Gear) 250  | STEEL POLE        | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-0610-001-B | Metal Halide (Reactor Control Gear) 250  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$114.42 |
| MHR0060-ST-0610-002-B | Metal Halide (Reactor Control Gear) 250  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$62.65  |
| MHR0060-ST-0960-002-B | Metal Halide (Reactor Control Gear) 250  | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$62.65  |
| MHR0060-ST-1120-002-B | Metal Halide (Reactor Control Gear) 250  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-1270-002-B | Metal Halide (Reactor Control Gear) 250  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-1280-002-B | Metal Halide (Reactor Control Gear) 250  | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-1290-002-B | Metal Halide (Reactor Control Gear) 250  | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0070-ST-0070-001-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$116.26 |
| MHR0070-ST-0070-002-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-0620-001-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$114.42 |
| MHR0070-ST-0640-001-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$114.42 |
| MHR0070-ST-0640-002-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-0680-002-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-1100-001-B | Metal Halide (Reactor Control Gear) 400  | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$179.67 |
| MHR0070-ST-1100-002-B | Metal Halide (Reactor Control Gear) 400  | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$77.39  |
| MHR0100-ST-0120-001-B | Metal Halide (Reactor Control Gear) 1000 | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$247.79 |
| MHR0100-ST-0120-002-B | Metal Halide (Reactor Control Gear) 1000 | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$163.83 |
| MVA0010-ST-0010-001-B | Mercury Vapour 50                        | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$55.02  |
| MVA0010-ST-0010-002-B | Mercury Vapour 50                        | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$31.01  |
| MVA0010-ST-0810-002-B | Mercury Vapour 50                        | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.92  |
| MVA0010-ST-0990-001-B | Mercury Vapour 50                        | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$161.06 |
| MVA0010-ST-0990-002-B | Mercury Vapour 50                        | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.08  |
| MVA0020-ST-0010-001-B | Mercury Vapour 80                        | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$55.31  |
| MVA0020-ST-0010-002-B | Mercury Vapour 80                        | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$31.31  |
| MVA0020-ST-0110-002-B | Mercury Vapour 80                        | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$31.31  |
| MVA0020-ST-0740-001-B | Mercury Vapour 80                        | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$64.58  |
| MVA0020-ST-0740-002-B | Mercury Vapour 80                        | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$31.31  |
| MVA0020-ST-0810-001-B | Mercury Vapour 80                        | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$113.37 |
| MVA0020-ST-0810-002-B | Mercury Vapour 80                        | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$42.21  |
| MVA0020-ST-0990-001-B | Mercury Vapour 80                        | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$161.35 |
| MVA0020-ST-0990-002-B | Mercury Vapour 80                        | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.37  |
| MVA0020-ST-1000-002-B | Mercury Vapour 80                        | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.37  |
| MVA0020-ST-1260-002-B | Mercury Vapour 80                        | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$42.21  |
| MVA0080-ST-0010-001-B | Mercury Vapour 125                       | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$55.72  |
| MVA0080-ST-0010-002-B | Mercury Vapour 125                       | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$31.72  |
| MVA0080-ST-0810-002-B | Mercury Vapour 125                       | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$42.62  |
| MVA0080-ST-0990-001-B | Mercury Vapour 125                       | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$161.76 |
| MVA0080-ST-0990-002-B | Mercury Vapour 125                       | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.78  |
| MVA0120-ST-0010-002-B | Mercury Vapour 160                       | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$35.97  |
| MVA0120-ST-0740-002-B | Mercury Vapour 160                       | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$35.97  |
| MVA0120-ST-1000-002-B | Mercury Vapour 160                       | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$46.03  |
| MVA0170-ST-0020-001-B | Mercury Vapour 175                       | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$81.18  |
| MVA0190-ST-0020-001-B | Mercury Vapour 250                       | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$86.46  |
| MVA0190-ST-0020-002-B | Mercury Vapour 250                       | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.25  |

|                       |                          |                   |   |                                              |          |
|-----------------------|--------------------------|-------------------|---|----------------------------------------------|----------|
| MVA0190-ST-0200-001-B | Mercury Vapour 250       | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$144.52 |
| MVA0190-ST-0200-002-B | Mercury Vapour 250       | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$52.16  |
| MVA0190-ST-0290-001-B | Mercury Vapour 250       | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.24 |
| MVA0190-ST-0290-002-B | Mercury Vapour 250       | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$51.32  |
| MVA0190-ST-0370-001-B | Mercury Vapour 250       | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$198.46 |
| MVA0190-ST-0370-002-B | Mercury Vapour 250       | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$51.32  |
| MVA0190-ST-0940-001-B | Mercury Vapour 250       | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$104.68 |
| MVA0220-ST-0030-001-B | Mercury Vapour 400       | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$102.38 |
| MVA0220-ST-0030-002-B | Mercury Vapour 400       | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$56.98  |
| MVA0220-ST-0210-001-B | Mercury Vapour 400       | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$160.45 |
| MVA0220-ST-0210-002-B | Mercury Vapour 400       | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$67.88  |
| MVA0220-ST-0300-001-B | Mercury Vapour 400       | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$196.16 |
| MVA0220-ST-0300-002-B | Mercury Vapour 400       | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0380-002-B | Mercury Vapour 400       | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0420-002-B | Mercury Vapour 400       | STEEL POLE        | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0460-002-B | Mercury Vapour 400       | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0540-002-B | Mercury Vapour 400       | R/BOU T COLUMN    | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0580-002-B | Mercury Vapour 400       | R/BOU T COLUMN    | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0790-001-B | Mercury Vapour 400       | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$178.86 |
| MVA0220-ST-0950-001-B | Mercury Vapour 400       | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$120.80 |
| MVA0220-ST-0950-002-B | Mercury Vapour 400       | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$56.98  |
| MVA0250-ST-0300-001-B | Mercury Vapour 500       | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$181.69 |
| MVA0260-ST-0190-001-B | Mercury Vapour 700       | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$242.70 |
| MVA0260-ST-0190-002-B | Mercury Vapour 700       | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$50.79  |
| MVA0260-ST-0250-002-B | Mercury Vapour 700       | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$61.70  |
| MVA0260-ST-0340-002-B | Mercury Vapour 700       | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$60.85  |
| MVA0260-ST-0700-001-B | Mercury Vapour 700       | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| MVA0290-ST-0120-002-B | Mercury Vapour 1000      | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$92.78  |
| FLU0350-ST-1620-001-B | Compact Fluorescent 1x42 | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$61.97  |
| FLU0350-ST-1620-002-B | Compact Fluorescent 1x42 | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$35.24  |
| FLU0350-ST-1630-001-B | Compact Fluorescent 1x42 | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0350-ST-1630-002-B | Compact Fluorescent 1x42 | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$35.24  |
| FLU0350-ST-1640-001-B | Compact Fluorescent 1x42 | SHARED OR NO POLE | 3 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0350-ST-1640-002-B | Compact Fluorescent 1x42 | SHARED OR NO POLE | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$35.24  |
| FLU0350-ST-1650-001-B | Compact Fluorescent 1x42 | SHARED OR NO POLE | 4 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0350-ST-1650-002-B | Compact Fluorescent 1x42 | SHARED OR NO POLE | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$35.24  |
| FLU0350-ST-1660-001-B | Compact Fluorescent 1x42 | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0350-ST-1660-002-B | Compact Fluorescent 1x42 | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.14  |
| FLU0350-ST-1670-001-B | Compact Fluorescent 1x42 | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0350-ST-1670-002-B | Compact Fluorescent 1x42 | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$46.14  |
| FLU0350-ST-1680-001-B | Compact Fluorescent 1x42 | WOOD POLE         | 3 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0350-ST-1680-002-B | Compact Fluorescent 1x42 | WOOD POLE         | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$46.14  |
| FLU0350-ST-1690-001-B | Compact Fluorescent 1x42 | WOOD POLE         | 4 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0350-ST-1690-002-B | Compact Fluorescent 1x42 | WOOD POLE         | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$46.14  |
| FLU0350-ST-1700-001-B | Compact Fluorescent 1x42 | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$168.01 |
| FLU0350-ST-1700-002-B | Compact Fluorescent 1x42 | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$45.30  |
| FLU0350-ST-1710-001-B | Compact Fluorescent 1x42 | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0350-ST-1710-002-B | Compact Fluorescent 1x42 | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$45.30  |
| FLU0350-ST-1720-001-B | Compact Fluorescent 1x42 | STEEL POLE        | 3 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0350-ST-1720-002-B | Compact Fluorescent 1x42 | STEEL POLE        | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$45.    |

|                       |                                         |                   |   |                                              |          |
|-----------------------|-----------------------------------------|-------------------|---|----------------------------------------------|----------|
| FLU0370-ST-1920-002-B | T5 2x24W                                | WOOD POLE         | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$62.16  |
| FLU0370-ST-1930-001-B | T5 2x24W                                | WOOD POLE         | 4 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0370-ST-1930-002-B | T5 2x24W                                | WOOD POLE         | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$62.16  |
| FLU0370-ST-1940-001-B | T5 2x24W                                | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0370-ST-1940-002-B | T5 2x24W                                | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$61.32  |
| FLU0370-ST-1950-001-B | T5 2x24W                                | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0370-ST-1950-002-B | T5 2x24W                                | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$61.32  |
| FLU0370-ST-1960-001-B | T5 2x24W                                | STEEL POLE        | 3 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0370-ST-1960-002-B | T5 2x24W                                | STEEL POLE        | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$61.32  |
| FLU0370-ST-1970-001-B | T5 2x24W                                | STEEL POLE        | 4 | 1-Unmetered, CE Funded, CE Maintained        | #N/A     |
| FLU0370-ST-1970-002-B | T5 2x24W                                | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$61.32  |
| HPS0020-ST-0005-001-B | High Pressure Sodium 70                 | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$34.48  |
| HPS0090-ST-0005-001-B | High Pressure Sodium 150                | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$36.74  |
| HPS0140-ST-0330-001-B | High Pressure Sodium 310 (Retrofit)     | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$188.09 |
| FLU0130-ST-0001-001-B | Fluorescent 40                          | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$36.89  |
| HPS0090-ST-0005-001-B | High Pressure Sodium 150                | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$36.74  |
| HPS0110-TA-0390-001-B | High Pressure Sodium 250                | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$192.13 |
| MVA0220-ST-0580-001-B | Mercury Vapour 400                      | R/BOUT COLUMN     | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$334.87 |
| MVA0220-ST-0460-001-B | Mercury Vapour 400                      | STEEL POLE        | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$251.41 |
| MVA0020-ST-0005-001-B | Mercury Vapour 80                       | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$31.31  |
| MVA0080-ST-0005-001-B | Mercury Vapour 125                      | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$31.72  |
| FLU0050-ST-0990-001-B | Fluorescent 20                          | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$168.20 |
| FLU0070-ST-0990-001-B | Fluorescent 3x20                        | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.12 |
| HPS0170-ST-0660-001-B | High Pressure Sodium 400                | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$110.61 |
| LPS0010-ST-0360-001-B | Low Pressure Sodium 18                  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.85 |
| MVA0020-ST-0820-001-B | Mercury Vapour 80                       | SHARED OR NO POLE | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$73.85  |
| INC0110-ST-0990-001-B | Incandescent 500                        | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$199.43 |
| MVA0190-ST-0450-001-B | Mercury Vapour 250                      | STEEL POLE        | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$234.89 |
| HPS0140-ST-0330-001-B | High Pressure Sodium 310 (Retrofit)     | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$188.09 |
| HPS0140-ST-0330-001-B | High Pressure Sodium 310 (Retrofit)     | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$188.09 |
| LPS0050-ST-0320-001-B | Low Pressure Sodium 135                 | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$192.72 |
| FLU0050-ST-0990-001-B | Fluorescent 20                          | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$168.20 |
| FLU0070-ST-0990-001-B | Fluorescent 3x20                        | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.12 |
| LPS0010-ST-0360-001-B | Low Pressure Sodium 18                  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.85 |
| LPS0020-ST-0360-001-B | Low Pressure Sodium 35                  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.85 |
| HPS0090-ST-0005-001-B | High Pressure Sodium 150                | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$36.74  |
| MHR0070-ST-0330-001-B | Metal Halide (Reactor Control Gear) 400 | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$210.04 |
| MVA0220-ST-0380-001-B | Mercury Vapour 400                      | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$214.58 |
| HPS0110-ST-0005-001-B | High Pressure Sodium 250                | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$37.90  |
| HPS0250-ST-0840-001-B | High Pressure Sodium 1000               | R/BOUT COLUMN     | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$453.45 |
| MVA0020-ST-0005-001-B | Mercury Vapour 80                       | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$31.31  |
| FLU0010-ST-0990-001-B | Fluorescent 9                           | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$168.20 |
| FLU0010-ST-0990-002-B | Fluorescent 9                           | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$48.22  |
| FLU0050-ST-0740-001-B | Fluorescent 20                          | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$71.42  |
| FLU0050-ST-0810-002-B | Fluorescent 20                          | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.06  |
| FLU0050-ST-0990-002-B | Fluorescent 20                          | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$48.22  |
| FLU0050-ST-1000-001-B | Fluorescent 20                          | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$177.47 |
| FLU0050-ST-1260-002-B | Fluorescent 20                          | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$49.06  |
| FLU0050-ST-1500-002-B | Fluorescent 20                          | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$48.22  |
| FLU0060-ST-0740-001-B | Fluorescent Twin 20                     | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$77.39  |
| FLU0060-ST-0810-001-B | Fluorescent Twin 20                     | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$126.18 |
| FLU0060-ST-0810-002-B | Fluorescent Twin 20                     | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$55.02  |
| FLU0060-ST-0830-002-B | Fluorescent Twin 20                     | SHARED OR NO POLE | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$44.11  |
| FLU0060-ST-0990-002-B | Fluorescent Twin 20                     | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$54.18  |
| FLU0060-ST-1000-002-B | Fluorescent Twin 20                     | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$54.18  |
| FLU0060-ST-1260-002-B | Fluorescent Twin 20                     | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$55.02  |
| FLU0060-ST-1500-002-B | Fluorescent Twin 20                     | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$54.18  |
| FLU0070-ST-0990-002-B | Fluorescent 3x20                        | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$60.14  |
| FLU0070-ST-1000-002-B | Fluorescent 3x20                        | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$60.14  |
| FLU0080-ST-0990-002-B | Fluorescent 4x20                        | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.10  |
| FLU0100-ST-0990-002-B | Fluorescent 26                          | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$48.22  |
| FLU0100-ST-1000-002-B | Fluorescent 26                          | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$48.22  |
| FLU0120-ST-0990-002-B | Fluorescent 6x36                        | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$54.18  |
| FLU0130-ST-1000-001-B | Fluorescent 40                          | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$176.20 |
| FLU0130-ST-1000-002-B | Fluorescent 40                          | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$46.95  |
| FLU0130-ST-1260-001-B | Fluorescent 40                          | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$128.22 |
| FLU0140-ST-0740-002-B | Fluorescent 2x40                        | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.59  |
| FLU0140-ST-0810-001-B | Fluorescent 2x40                        | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$123.65 |
| FLU0140-ST-0810-002-B | Fluorescent 2x40                        | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$52.50  |
| FLU0140-ST-0820-002-B | Fluorescent 2x40                        | SHARED OR NO POLE | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$41.59  |
| FLU0140-ST-0830-002-B | Fluorescent 2x40                        | SHARED OR NO POLE | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$41.59  |
| FLU0140-ST-0990-002-B | Fluorescent 2x40                        | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$51.65  |
| FLU0140-ST-1260-002-B | Fluorescent 2x40                        | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$52.50  |
| FLU0150-ST-0990-002-B | Fluorescent 3x40                        | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$56.35  |
| FLU0150-ST-1000-002-B | Fluorescent 3x40                        | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$56.35  |
| FLU0160-ST-0830-002-B | Fluorescent 4x40                        | SHARED OR NO POLE | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$50.99  |
| FLU0160-ST-1000-002-B | Fluorescent 4x40                        | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$61.06  |
| FLU0220-ST-0990-002-B | Fluorescent 65                          | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.95  |
| FLU0240-ST-0810-002-B | Fluorescent 80                          | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$47.79  |
| FLU0350-ST-1620-001-B | Compact Fluorescent 1x42                | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$61.97  |
| FLU0350-ST-1700-001-B | Compact Fluorescent 1x42                | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$168.01 |
| HPS0010-ST-0730-002-B | High Pressure Sodium 50                 | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$44.66  |
| HPS0010-ST-0890-002-B | High Pressure Sodium 50                 | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$34.60  |
| HPS0010-ST-0910-002-B | High Pressure Sodium 50                 | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$45.50  |
| HPS0010-TA-0140-002-B | High Pressure Sodium 50                 | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$38.14  |
| HPS0010-TA-1210-001-B | High Pressure Sodium 50                 | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$124.99 |
| HPS0020-ST-0750-001-B | High Pressure Sodium 70                 | SHARED OR NO POLE | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$82.15  |

|                       |                                             |                   |   |                                              |          |
|-----------------------|---------------------------------------------|-------------------|---|----------------------------------------------|----------|
| HPS0070-ST-0350-002-B | High Pressure Sodium 100                    | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$45.39  |
| HPS0070-ST-0730-001-B | High Pressure Sodium 100                    | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$177.21 |
| HPS0070-ST-0730-002-B | High Pressure Sodium 100                    | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0080-ST-0050-002-B | High Pressure Sodium 120                    | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$39.32  |
| HPS0080-ST-0220-002-B | High Pressure Sodium 120                    | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$50.23  |
| HPS0080-ST-0310-002-B | High Pressure Sodium 120                    | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.38  |
| HPS0090-ST-0710-001-B | High Pressure Sodium 150                    | STEEL POLE        | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$210.11 |
| HPS0090-ST-0980-001-B | High Pressure Sodium 150                    | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$156.86 |
| HPS0090-ST-1360-001-B | High Pressure Sodium 150                    | R/BOUT COLUMN     | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$293.57 |
| HPS0090-ST-1370-002-B | High Pressure Sodium 150                    | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-TA-0220-002-B | High Pressure Sodium 150                    | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$50.81  |
| HPS0090-TA-0310-002-B | High Pressure Sodium 150                    | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.97  |
| HPS0090-TA-0690-001-B | High Pressure Sodium 150                    | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$195.75 |
| HPS0090-TA-1010-001-B | High Pressure Sodium 150                    | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$101.97 |
| HPS0090-TA-1370-001-B | High Pressure Sodium 150                    | R/BOUT COLUMN     | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$314.27 |
| HPS0100-ST-0230-001-B | High Pressure Sodium 220                    | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$148.33 |
| HPS0100-ST-0610-001-B | High Pressure Sodium 220                    | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$97.33  |
| HPS0100-ST-0610-002-B | High Pressure Sodium 220                    | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$45.56  |
| HPS0100-ST-0760-001-B | High Pressure Sodium 220                    | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$166.04 |
| HPS0100-ST-0930-002-B | High Pressure Sodium 220                    | WOOD POLE         | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$56.46  |
| HPS0100-ST-1020-002-B | High Pressure Sodium 220                    | SHARED OR NO POLE | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$45.56  |
| HPS0100-ST-1070-001-B | High Pressure Sodium 220                    | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$155.39 |
| HPS0100-ST-1070-002-B | High Pressure Sodium 220                    | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$56.46  |
| HPS0100-ST-1120-002-B | High Pressure Sodium 220                    | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$55.62  |
| HPS0100-ST-1160-002-B | High Pressure Sodium 220                    | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$56.46  |
| HPS0110-ST-0510-002-B | High Pressure Sodium 250                    | R/BOUT COLUMN     | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0930-001-B | High Pressure Sodium 250                    | WOOD POLE         | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$176.09 |
| HPS0110-ST-1020-002-B | High Pressure Sodium 250                    | SHARED OR NO POLE | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-1140-002-B | High Pressure Sodium 250                    | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-1160-002-B | High Pressure Sodium 250                    | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$48.80  |
| HPS0110-ST-1450-001-B | High Pressure Sodium 250                    | R/BOUT COLUMN     | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$341.23 |
| HPS0110-TA-0230-002-B | High Pressure Sodium 250                    | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.84  |
| HPS0110-TA-1070-002-B | High Pressure Sodium 250                    | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.84  |
| HPS0110-TA-1120-001-B | High Pressure Sodium 250                    | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$181.48 |
| HPS0110-TA-1450-001-B | High Pressure Sodium 250                    | R/BOUT COLUMN     | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$339.27 |
| HPS0120-ST-1490-002-B | High Pressure Sodium 2x250                  | R/BOUT COLUMN     | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$63.50  |
| HPS0140-ST-0240-001-B | High Pressure Sodium 310 (Retrofit)         | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$152.38 |
| HPS0140-ST-0400-001-B | High Pressure Sodium 310 (Retrofit)         | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$210.88 |
| HPS0160-ST-0400-002-B | High Pressure Sodium 360                    | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$59.15  |
| HPS0160-ST-0620-001-B | High Pressure Sodium 360                    | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$97.02  |
| HPS0160-ST-0620-002-B | High Pressure Sodium 360                    | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.09  |
| HPS0160-ST-0770-001-B | High Pressure Sodium 360                    | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$179.71 |
| HPS0160-ST-1130-002-B | High Pressure Sodium 360                    | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$59.15  |
| HPS0160-ST-1170-002-B | High Pressure Sodium 360                    | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$59.15  |
| HPS0170-ST-0480-001-B | High Pressure Sodium 400                    | STEEL POLE        | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$253.65 |
| HPS0170-ST-0560-001-B | High Pressure Sodium 400                    | R/BOUT COLUMN     | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$314.33 |
| HPS0170-ST-0600-001-B | High Pressure Sodium 400                    | R/BOUT COLUMN     | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$337.11 |
| HPS0170-ST-0770-001-B | High Pressure Sodium 400                    | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$172.37 |
| HPS0170-ST-0900-001-B | High Pressure Sodium 400                    | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$183.06 |
| HPS0170-ST-1060-002-B | High Pressure Sodium 400                    | WOOD POLE         | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$52.65  |
| HPS0170-ST-1080-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$144.02 |
| HPS0170-ST-1080-002-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.75  |
| HPS0170-ST-1130-002-B | High Pressure Sodium 400                    | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-TA-0240-001-B | High Pressure Sodium 400                    | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$151.40 |
| HPS0170-TA-0330-001-B | High Pressure Sodium 400                    | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$187.12 |
| HPS0170-TA-0400-001-B | High Pressure Sodium 400                    | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$209.91 |
| HPS0170-TA-0600-002-B | High Pressure Sodium 400                    | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$53.63  |
| HPS0170-TA-1080-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$145.84 |
| HPS0180-ST-1490-001-B | High Pressure Sodium 2x400                  | R/BOUT COLUMN     | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$321.63 |
| HPS0190-ST-1470-001-B | High Pressure Sodium 3x400                  | R/BOUT COLUMN     | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$388.00 |
| HPS0190-ST-1470-002-B | High Pressure Sodium 3x400                  | R/BOUT COLUMN     | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$90.59  |
| HPS0210-ST-0190-001-B | High Pressure Sodium 600 (Internal Ignitor) | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$282.12 |
| INCO010-ST-0990-002-B | Incandescent 30                             | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$76.45  |
| INCO030-ST-0810-002-B | Incandescent 60                             | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$77.29  |
| INCO030-ST-0820-002-B | Incandescent 60                             | SHARED OR NO POLE | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INCO030-ST-0990-002-B | Incandescent 60                             | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$76.45  |
| INCO050-ST-0810-002-B | Incandescent 100                            | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$77.29  |
| INCO050-ST-0990-002-B | Incandescent 100                            | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$76.45  |
| INCO080-ST-0820-002-B | Incandescent 150                            | SHARED OR NO POLE | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INCO080-ST-1000-002-B | Incandescent 150                            | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$79.45  |
| INCO100-ST-0740-002-B | Incandescent 300                            | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INCO160-ST-0620-001-B | Incandescent 1500                           | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$117.32 |
| INCO160-ST-0620-002-B | Incandescent 1500                           | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| LPS0030-ST-0350-001-B | Low Pressure Sodium 55                      | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$132.87 |
| LPS0030-ST-0350-002-B | Low Pressure Sodium 55                      | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$60.00  |
| LPS0030-ST-0360-002-B | Low Pressure Sodium 55                      | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$59.16  |
| LPS0030-ST-0890-001-B | Low Pressure Sodium 55                      | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$85.78  |
| LPS0030-ST-0890-002-B | Low Pressure Sodium 55                      | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$49.09  |
| LPS0040-ST-0220-002-B | Low Pressure Sodium 90/100                  | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$62.32  |
| LPS0040-ST-0310-002-B | Low Pressure Sodium 90/100                  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$61.47  |
| LPS0050-ST-0320-002-B | Low Pressure Sodium 135                     | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$64.30  |
| LPS0060-ST-0060-001-B | Low Pressure Sodium 150                     | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$102.88 |
| LPS0060-ST-0230-001-B | Low Pressure Sodium 150                     | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$160.94 |
| LPS0060-ST-0320-001-B | Low Pressure Sodium 150                     | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$196.66 |
| LPS0060-ST-0390-002-B | Low Pressure Sodium 150                     | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$68.24  |
| LPS0060-ST-0470-002-B | Low Pressure Sodium 150                     | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$68.24  |
| LPS0060-ST-0590-002-B | Low Pressure Sodium 150                     | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$68.24  |

|                       |                                          |                   |   |                                              |          |
|-----------------------|------------------------------------------|-------------------|---|----------------------------------------------|----------|
| LPS0060-ST-0960-002-B | Low Pressure Sodium 150                  | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$58.18  |
| LPS0080-ST-0060-001-B | Low Pressure Sodium 180                  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$102.88 |
| LPS0080-ST-0060-002-B | Low Pressure Sodium 180                  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$58.18  |
| MHR0010-ST-0730-002-B | Metal Halide (Reactor Control Gear) 70   | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$68.77  |
| MHR0020-ST-0730-001-B | Metal Halide (Reactor Control Gear) 100  | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$201.44 |
| MHR0030-ST-0220-002-B | Metal Halide (Reactor Control Gear) 150  | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$73.55  |
| MHR0030-ST-0690-002-B | Metal Halide (Reactor Control Gear) 150  | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0030-ST-0710-002-B | Metal Halide (Reactor Control Gear) 150  | STEEL POLE        | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-0060-001-B | Metal Halide (Reactor Control Gear) 250  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$107.35 |
| MHR0060-ST-0590-002-B | Metal Halide (Reactor Control Gear) 250  | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-0650-002-B | Metal Halide (Reactor Control Gear) 250  | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$62.65  |
| MHR0060-ST-1070-001-B | Metal Halide (Reactor Control Gear) 250  | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$172.48 |
| MHR0060-ST-1070-002-B | Metal Halide (Reactor Control Gear) 250  | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$73.55  |
| MHR0060-ST-1120-001-B | Metal Halide (Reactor Control Gear) 250  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$208.20 |
| MHR0060-ST-1160-002-B | Metal Halide (Reactor Control Gear) 250  | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$73.55  |
| MHR0070-ST-0060-001-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$111.19 |
| MHR0070-ST-0060-002-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-0270-001-B | Metal Halide (Reactor Control Gear) 400  | R/BOUT COLUMN     | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$355.11 |
| MHR0070-ST-0320-001-B | Metal Halide (Reactor Control Gear) 400  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$204.97 |
| MHR0070-ST-0320-002-B | Metal Halide (Reactor Control Gear) 400  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$76.55  |
| MHR0070-ST-0390-002-B | Metal Halide (Reactor Control Gear) 400  | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$76.55  |
| MHR0070-ST-0470-002-B | Metal Halide (Reactor Control Gear) 400  | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$76.55  |
| MHR0070-ST-0620-002-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-0660-001-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$135.35 |
| MHR0070-ST-0660-002-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-1080-001-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$168.77 |
| MHR0070-ST-1080-002-B | Metal Halide (Reactor Control Gear) 400  | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-1130-001-B | Metal Halide (Reactor Control Gear) 400  | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$243.52 |
| MHR0070-ST-1170-001-B | Metal Halide (Reactor Control Gear) 400  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$215.39 |
| MHR0070-ST-1170-002-B | Metal Halide (Reactor Control Gear) 400  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$76.55  |
| MHR0110-ST-0120-002-B | Metal Halide (Reactor Control Gear) 1500 | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$163.83 |
| MVA0010-ST-0740-001-B | Mercury Vapour 50                        | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$64.29  |
| MVA0010-ST-0740-002-B | Mercury Vapour 50                        | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$31.01  |
| MVA0010-ST-0810-001-B | Mercury Vapour 50                        | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$113.08 |
| MVA0010-ST-1000-002-B | Mercury Vapour 50                        | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.08  |
| MVA0010-ST-1260-002-B | Mercury Vapour 50                        | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.92  |
| MVA0020-ST-0820-002-B | Mercury Vapour 80                        | SHARED OR NO POLE | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$31.31  |
| MVA0020-ST-0830-002-B | Mercury Vapour 80                        | SHARED OR NO POLE | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$31.31  |
| MVA0020-ST-1000-001-B | Mercury Vapour 80                        | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$170.62 |
| MVA0020-ST-1260-001-B | Mercury Vapour 80                        | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$122.64 |
| MVA0020-ST-1460-002-B | Mercury Vapour 80                        | STEEL POLE        | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$41.37  |
| MVA0020-ST-1500-002-B | Mercury Vapour 80                        | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$41.37  |
| MVA0080-ST-0740-002-B | Mercury Vapour 125                       | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$31.72  |
| MVA0080-ST-0810-001-B | Mercury Vapour 125                       | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$113.78 |
| MVA0080-ST-0820-001-B | Mercury Vapour 125                       | SHARED OR NO POLE | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$74.26  |
| MVA0080-ST-1000-001-B | Mercury Vapour 125                       | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$171.03 |
| MVA0080-ST-1000-002-B | Mercury Vapour 125                       | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.78  |
| MVA0170-ST-0290-002-B | Mercury Vapour 175                       | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.03  |
| MVA0190-ST-0450-002-B | Mercury Vapour 250                       | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$51.32  |
| MVA0190-ST-0570-002-B | Mercury Vapour 250                       | R/BOUT COLUMN     | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$51.32  |
| MVA0190-ST-0780-001-B | Mercury Vapour 250                       | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$162.74 |
| MVA0190-ST-0780-002-B | Mercury Vapour 250                       | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$52.16  |
| MVA0190-ST-0940-002-B | Mercury Vapour 250                       | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.25  |
| MVA0220-ST-0540-001-B | Mercury Vapour 400                       | R/BOUT COLUMN     | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$316.45 |
| MVA0220-ST-0790-002-B | Mercury Vapour 400                       | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$67.88  |
| MVA0290-ST-1040-002-B | Mercury Vapour 1000                      | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$92.78  |
| FLU0010-ST-0010-002-B | Fluorescent 9                            | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$38.15  |
| FLU0020-ST-0010-001-B | Fluorescent 11                           | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$62.15  |
| FLU0040-ST-0010-002-B | Fluorescent 15                           | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$38.15  |
| FLU0050-ST-0010-001-B | Fluorescent 20                           | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$62.15  |
| FLU0050-ST-0010-002-B | Fluorescent 20                           | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$38.15  |
| FLU0050-ST-0110-002-B | Fluorescent 20                           | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$38.15  |
| FLU0050-ST-0990-001-B | Fluorescent 20                           | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$168.20 |
| FLU0060-ST-0010-001-B | Fluorescent Twin 20                      | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$68.12  |
| FLU0060-ST-0010-002-B | Fluorescent Twin 20                      | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$44.11  |
| FLU0060-ST-0740-002-B | Fluorescent Twin 20                      | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$44.11  |
| FLU0060-ST-0990-001-B | Fluorescent Twin 20                      | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$174.16 |
| FLU0070-ST-0010-001-B | Fluorescent 3x20                         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$74.08  |
| FLU0070-ST-0010-002-B | Fluorescent 3x20                         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$50.07  |
| FLU0070-ST-0990-001-B | Fluorescent 3x20                         | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.12 |
| FLU0080-ST-0010-001-B | Fluorescent 4x20                         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$80.04  |
| FLU0080-ST-0010-002-B | Fluorescent 4x20                         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$56.04  |
| FLU0080-ST-0990-001-B | Fluorescent 4x20                         | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$186.08 |
| FLU0100-ST-0010-001-B | Fluorescent 26                           | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$62.15  |
| FLU0100-ST-0010-002-B | Fluorescent 26                           | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$38.15  |
| FLU0110-ST-0010-002-B | Fluorescent 2x26                         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$44.11  |
| FLU0130-ST-0010-001-B | Fluorescent 40                           | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$60.89  |
| FLU0130-ST-0010-002-B | Fluorescent 40                           | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$36.89  |
| FLU0130-ST-0740-001-B | Fluorescent 40                           | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$70.16  |
| FLU0130-ST-0740-002-B | Fluorescent 40                           | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$36.89  |
| FLU0130-ST-0810-002-B | Fluorescent 40                           | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$47.79  |
| FLU0130-ST-0820-002-B | Fluorescent 40                           | SHARED OR NO POLE | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$36.89  |
| FLU0130-ST-0990-001-B | Fluorescent 40                           | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$166.93 |
| FLU0130-ST-0990-002-B | Fluorescent 40                           | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.95  |
| FLU0140-ST-0010-001-B | Fluorescent 2x40                         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$65.59  |
| FLU0140-ST-0010-002-B | Fluorescent 2x40                         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.59  |
| FLU0140-ST-0990-001-B | Fluorescent 2x40                         | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$171.63 |

|                       |                          |                   |   |                                              |          |
|-----------------------|--------------------------|-------------------|---|----------------------------------------------|----------|
| FLU0150-ST-0010-001-B | Fluorescent 3x40         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$70.29  |
| FLU0150-ST-0010-002-B | Fluorescent 3x40         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.29  |
| FLU0150-ST-0810-002-B | Fluorescent 3x40         | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$57.20  |
| FLU0160-ST-0010-001-B | Fluorescent 4x40         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$74.99  |
| FLU0160-ST-0010-002-B | Fluorescent 4x40         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$50.99  |
| FLU0160-ST-0990-001-B | Fluorescent 4x40         | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$181.03 |
| FLU0160-ST-0990-002-B | Fluorescent 4x40         | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$61.06  |
| FLU0170-ST-0010-002-B | Fluorescent 6x40         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$60.39  |
| FLU0190-ST-0010-001-B | Fluorescent 2x58         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$65.59  |
| FLU0190-ST-0010-002-B | Fluorescent 2x58         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.59  |
| FLU0200-ST-0010-002-B | Fluorescent 4x58         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$50.99  |
| FLU0240-ST-0010-001-B | Fluorescent 80           | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$60.89  |
| FLU0240-ST-0010-002-B | Fluorescent 80           | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$36.89  |
| FLU0240-ST-0990-001-B | Fluorescent 80           | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$166.93 |
| FLU0240-ST-0990-002-B | Fluorescent 80           | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.95  |
| FLU0240-ST-1000-002-B | Fluorescent 80           | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$46.95  |
| FLU0240-ST-1260-002-B | Fluorescent 80           | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$47.79  |
| FLU0250-ST-0010-001-B | Fluorescent 2x80         | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$65.59  |
| FLU0250-ST-0010-002-B | Fluorescent 2x80         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.59  |
| FLU0260-ST-0010-002-B | Fluorescent 3x80         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.29  |
| FLU0270-ST-0010-002-B | Fluorescent 4x80         | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$50.99  |
| FLU0300-ST-0010-002-B | Fluorescent 2x125        | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.59  |
| HPS0010-ST-0040-001-B | High Pressure Sodium 50  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$60.31  |
| HPS0010-ST-0040-002-B | High Pressure Sodium 50  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$34.60  |
| HPS0010-ST-0090-002-B | High Pressure Sodium 50  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$34.60  |
| HPS0010-ST-0350-002-B | High Pressure Sodium 50  | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$45.50  |
| HPS0010-ST-0360-001-B | High Pressure Sodium 50  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$166.35 |
| HPS0010-ST-0360-002-B | High Pressure Sodium 50  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$44.66  |
| HPS0010-ST-0750-001-B | High Pressure Sodium 50  | SHARED OR NO POLE | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$82.27  |
| HPS0010-TA-0090-001-B | High Pressure Sodium 50  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$54.45  |
| HPS0010-TA-0090-002-B | High Pressure Sodium 50  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$27.24  |
| HPS0010-TA-0140-001-B | High Pressure Sodium 50  | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$112.51 |
| HPS0010-TA-0170-002-B | High Pressure Sodium 50  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$37.30  |
| HPS0010-TA-1180-001-B | High Pressure Sodium 50  | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$66.93  |
| HPS0010-TA-1200-001-B | High Pressure Sodium 50  | SHARED OR NO POLE | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$91.89  |
| HPS0020-ST-0040-001-B | High Pressure Sodium 70  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$60.19  |
| HPS0020-ST-0040-002-B | High Pressure Sodium 70  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$34.48  |
| HPS0020-ST-0170-002-B | High Pressure Sodium 70  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0020-ST-0350-001-B | High Pressure Sodium 70  | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$118.25 |
| HPS0020-ST-0350-002-B | High Pressure Sodium 70  | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$45.39  |
| HPS0020-ST-0360-001-B | High Pressure Sodium 70  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$166.23 |
| HPS0020-ST-0360-002-B | High Pressure Sodium 70  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0020-ST-0730-001-B | High Pressure Sodium 70  | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$177.21 |
| HPS0020-ST-0730-002-B | High Pressure Sodium 70  | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0020-ST-0750-002-B | High Pressure Sodium 70  | SHARED OR NO POLE | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$34.48  |
| HPS0020-ST-0880-002-B | High Pressure Sodium 70  | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0020-ST-0890-001-B | High Pressure Sodium 70  | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$71.17  |
| HPS0020-ST-0890-002-B | High Pressure Sodium 70  | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$34.48  |
| HPS0020-ST-0910-001-B | High Pressure Sodium 70  | WOOD POLE         | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$129.23 |
| HPS0020-ST-0910-002-B | High Pressure Sodium 70  | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$45.39  |
| HPS0020-TA-0090-001-B | High Pressure Sodium 70  | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$59.36  |
| HPS0020-TA-0090-002-B | High Pressure Sodium 70  | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$32.15  |
| HPS0020-TA-0140-002-B | High Pressure Sodium 70  | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$43.06  |
| HPS0020-TA-0170-001-B | High Pressure Sodium 70  | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$165.40 |
| HPS0020-TA-0170-002-B | High Pressure Sodium 70  | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$42.21  |
| HPS0070-ST-0040-001-B | High Pressure Sodium 100 | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$60.19  |
| HPS0070-ST-0040-002-B | High Pressure Sodium 100 | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$34.48  |
| HPS0070-ST-0360-002-B | High Pressure Sodium 100 | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0080-ST-0050-001-B | High Pressure Sodium 120 | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$83.85  |
| HPS0090-ST-0005-001-B | High Pressure Sodium 150 | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$36.74  |
| HPS0090-ST-0050-001-B | High Pressure Sodium 150 | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$81.26  |
| HPS0090-ST-0050-002-B | High Pressure Sodium 150 | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$36.74  |
| HPS0090-ST-0220-001-B | High Pressure Sodium 150 | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$139.32 |
| HPS0090-ST-0220-002-B | High Pressure Sodium 150 | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$47.64  |
| HPS0090-ST-0310-001-B | High Pressure Sodium 150 | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$175.04 |
| HPS0090-ST-0310-002-B | High Pressure Sodium 150 | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-ST-0690-001-B | High Pressure Sodium 150 | STEEL POLE        | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$192.58 |
| HPS0090-ST-0690-002-B | High Pressure Sodium 150 | STEEL POLE        | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-ST-0710-002-B | High Pressure Sodium 150 | STEEL POLE        | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-ST-0720-001-B | High Pressure Sodium 150 | STEEL POLE        | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$227.64 |
| HPS0090-ST-0720-002-B | High Pressure Sodium 150 | STEEL POLE        | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-ST-0980-002-B | High Pressure Sodium 150 | WOOD POLE         | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$47.64  |
| HPS0090-ST-1010-001-B | High Pressure Sodium 150 | SHARED OR NO POLE | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$98.80  |
| HPS0090-ST-1010-002-B | High Pressure Sodium 150 | SHARED OR NO POLE | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$36.74  |
| HPS0090-ST-1360-002-B | High Pressure Sodium 150 | R/BOUT COLUMN     | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$46.80  |
| HPS0090-TA-0050-001-B | High Pressure Sodium 150 | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$84.43  |
| HPS0090-TA-0050-002-B | High Pressure Sodium 150 | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$39.91  |
| HPS0090-TA-0220-001-B | High Pressure Sodium 150 | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$142.49 |
| HPS0090-TA-0310-001-B | High Pressure Sodium 150 | STEEL POLE        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$178.21 |
| HPS0100-ST-0060-001-B | High Pressure Sodium 220 | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.26  |
| HPS0100-ST-0060-002-B | High Pressure Sodium 220 | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$45.56  |
| HPS0100-ST-0230-002-B | High Pressure Sodium 220 | WOOD POLE         | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$56.46  |
| HPS0100-ST-0320-002-B | High Pressure Sodium 220 | STEEL POLE        | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$55.62  |
| HPS0110-ST-0005-001-B | High Pressure Sodium 250 | NO CAPITAL        | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$37.90  |
| HPS0110-ST-0060-001-B | High Pressure Sodium 250 | SHARED OR NO POLE | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$82.60  |
| HPS0110-ST-0060-002-B | High Pressure Sodium 250 | SHARED OR NO POLE | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-0230-001-B | High Pressure Sodium 250 | WOOD POLE         | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$140.66 |

|                       |                                             |                   |  |   |                                              |          |
|-----------------------|---------------------------------------------|-------------------|--|---|----------------------------------------------|----------|
| HPS0110-ST-0230-002-B | High Pressure Sodium 250                    | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$48.80  |
| HPS0110-ST-0320-001-B | High Pressure Sodium 250                    | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$176.38 |
| HPS0110-ST-0320-002-B | High Pressure Sodium 250                    | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0390-001-B | High Pressure Sodium 250                    | STEEL POLE        |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$194.09 |
| HPS0110-ST-0390-002-B | High Pressure Sodium 250                    | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0470-001-B | High Pressure Sodium 250                    | STEEL POLE        |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$229.52 |
| HPS0110-ST-0470-002-B | High Pressure Sodium 250                    | STEEL POLE        |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0550-001-B | High Pressure Sodium 250                    | R/BOUT COLUMN     |  | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$295.27 |
| HPS0110-ST-0550-002-B | High Pressure Sodium 250                    | R/BOUT COLUMN     |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0590-001-B | High Pressure Sodium 250                    | R/BOUT COLUMN     |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$312.98 |
| HPS0110-ST-0590-002-B | High Pressure Sodium 250                    | R/BOUT COLUMN     |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-0610-001-B | High Pressure Sodium 250                    | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$89.66  |
| HPS0110-ST-0610-002-B | High Pressure Sodium 250                    | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-0650-002-B | High Pressure Sodium 250                    | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-0760-001-B | High Pressure Sodium 250                    | WOOD POLE         |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$158.38 |
| HPS0110-ST-0760-002-B | High Pressure Sodium 250                    | WOOD POLE         |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$48.80  |
| HPS0110-ST-0960-001-B | High Pressure Sodium 250                    | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$100.31 |
| HPS0110-ST-0960-002-B | High Pressure Sodium 250                    | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-0970-002-B | High Pressure Sodium 250                    | SHARED OR NO POLE |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$37.90  |
| HPS0110-ST-1070-001-B | High Pressure Sodium 250                    | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$147.73 |
| HPS0110-ST-1070-002-B | High Pressure Sodium 250                    | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$48.80  |
| HPS0110-ST-1120-001-B | High Pressure Sodium 250                    | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$183.44 |
| HPS0110-ST-1120-002-B | High Pressure Sodium 250                    | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-1160-001-B | High Pressure Sodium 250                    | WOOD POLE         |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$172.50 |
| HPS0110-ST-1380-002-B | High Pressure Sodium 250                    | R/BOUT COLUMN     |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-ST-1450-002-B | High Pressure Sodium 250                    | R/BOUT COLUMN     |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$47.96  |
| HPS0110-TA-0060-001-B | High Pressure Sodium 250                    | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$80.64  |
| HPS0110-TA-0060-002-B | High Pressure Sodium 250                    | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$35.93  |
| HPS0110-TA-0230-001-B | High Pressure Sodium 250                    | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$138.70 |
| HPS0110-TA-0320-001-B | High Pressure Sodium 250                    | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$174.42 |
| HPS0110-TA-0320-002-B | High Pressure Sodium 250                    | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.00  |
| HPS0110-TA-0390-001-B | High Pressure Sodium 250                    | STEEL POLE        |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$192.13 |
| HPS0110-TA-0470-001-B | High Pressure Sodium 250                    | STEEL POLE        |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$227.55 |
| HPS0110-TA-0590-001-B | High Pressure Sodium 250                    | R/BOUT COLUMN     |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$311.01 |
| HPS0110-TA-0590-002-B | High Pressure Sodium 250                    | R/BOUT COLUMN     |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$46.00  |
| HPS0110-TA-0960-001-B | High Pressure Sodium 250                    | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$98.35  |
| HPS0110-TA-1120-002-B | High Pressure Sodium 250                    | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$46.00  |
| HPS0120-ST-0860-002-B | High Pressure Sodium 2x250                  | R/BOUT COLUMN     |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$63.50  |
| HPS0120-ST-0870-002-B | High Pressure Sodium 2x250                  | R/BOUT COLUMN     |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$63.50  |
| HPS0140-ST-0070-001-B | High Pressure Sodium 310 (Retrofit)         | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$94.31  |
| HPS0140-ST-0070-002-B | High Pressure Sodium 310 (Retrofit)         | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$44.54  |
| HPS0140-ST-0240-002-B | High Pressure Sodium 310 (Retrofit)         | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$55.44  |
| HPS0140-ST-0330-001-B | High Pressure Sodium 310 (Retrofit)         | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$188.09 |
| HPS0140-ST-0330-002-B | High Pressure Sodium 310 (Retrofit)         | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$54.60  |
| HPS0140-ST-0400-002-B | High Pressure Sodium 310 (Retrofit)         | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$54.60  |
| HPS0140-ST-1030-001-B | High Pressure Sodium 310 (Retrofit)         | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$117.10 |
| HPS0160-ST-0070-001-B | High Pressure Sodium 360                    | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$98.86  |
| HPS0160-ST-0070-002-B | High Pressure Sodium 360                    | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.09  |
| HPS0160-ST-0240-001-B | High Pressure Sodium 360                    | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$156.93 |
| HPS0160-ST-0240-002-B | High Pressure Sodium 360                    | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$59.99  |
| HPS0160-ST-0330-001-B | High Pressure Sodium 360                    | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$192.65 |
| HPS0160-ST-0330-002-B | High Pressure Sodium 360                    | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$59.15  |
| HPS0160-ST-1020-001-B | High Pressure Sodium 360                    | SHARED OR NO POLE |  | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$129.22 |
| HPS0160-ST-1030-001-B | High Pressure Sodium 360                    | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$121.65 |
| HPS0170-ST-0070-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$91.52  |
| HPS0170-ST-0070-002-B | High Pressure Sodium 400                    | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.75  |
| HPS0170-ST-0240-001-B | High Pressure Sodium 400                    | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$149.58 |
| HPS0170-ST-0240-002-B | High Pressure Sodium 400                    | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$52.65  |
| HPS0170-ST-0330-001-B | High Pressure Sodium 400                    | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$185.30 |
| HPS0170-ST-0330-002-B | High Pressure Sodium 400                    | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0400-001-B | High Pressure Sodium 400                    | STEEL POLE        |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$208.09 |
| HPS0170-ST-0400-002-B | High Pressure Sodium 400                    | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0440-001-B | High Pressure Sodium 400                    | STEEL POLE        |  | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$230.87 |
| HPS0170-ST-0440-002-B | High Pressure Sodium 400                    | STEEL POLE        |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0480-002-B | High Pressure Sodium 400                    | STEEL POLE        |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0560-002-B | High Pressure Sodium 400                    | R/BOUT COLUMN     |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0600-002-B | High Pressure Sodium 400                    | R/BOUT COLUMN     |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-0620-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$89.67  |
| HPS0170-ST-0620-002-B | High Pressure Sodium 400                    | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.75  |
| HPS0170-ST-0660-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$110.61 |
| HPS0170-ST-0660-002-B | High Pressure Sodium 400                    | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.75  |
| HPS0170-ST-0770-002-B | High Pressure Sodium 400                    | WOOD POLE         |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$52.65  |
| HPS0170-ST-0900-002-B | High Pressure Sodium 400                    | WOOD POLE         |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$52.65  |
| HPS0170-ST-1030-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$114.31 |
| HPS0170-ST-1030-002-B | High Pressure Sodium 400                    | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.75  |
| HPS0170-ST-1100-001-B | High Pressure Sodium 400                    | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$154.93 |
| HPS0170-ST-1100-002-B | High Pressure Sodium 400                    | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$52.65  |
| HPS0170-ST-1130-001-B | High Pressure Sodium 400                    | STEEL POLE        |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$218.78 |
| HPS0170-ST-1170-001-B | High Pressure Sodium 400                    | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$190.65 |
| HPS0170-ST-1170-002-B | High Pressure Sodium 400                    | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$51.81  |
| HPS0170-ST-1250-001-B | High Pressure Sodium 400                    | WOOD POLE         |  | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$211.19 |
| HPS0170-TA-0070-001-B | High Pressure Sodium 400                    | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.34  |
| HPS0180-ST-0860-001-B | High Pressure Sodium 2x400                  | R/BOUT COLUMN     |  | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$349.76 |
| HPS0180-ST-0870-001-B | High Pressure Sodium 2x400                  | R/BOUT COLUMN     |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$377.88 |
| HPS0210-ST-0250-001-B | High Pressure Sodium 600 (Internal Ignitor) | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$340.18 |
| HPS0250-ST-0120-001-B | High Pressure Sodium 1000                   | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$248.79 |
| HPS0250-ST-0120-002-B | High Pressure Sodium 1000                   | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$164.83 |

|                       |                                         |                   |  |   |                                              |          |
|-----------------------|-----------------------------------------|-------------------|--|---|----------------------------------------------|----------|
| HP50250-ST-0840-001-B | High Pressure Sodium 1000               | R/BOU COLUMN      |  | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$453.45 |
| HP50250-ST-0850-001-B | High Pressure Sodium 1000               | R/BOU COLUMN      |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$425.32 |
| HP50250-ST-1050-001-B | High Pressure Sodium 1000               | R/BOU COLUMN      |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$481.58 |
| INCO010-ST-0010-002-B | Incandescent 30                         | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INCO020-ST-0010-001-B | Incandescent 40                         | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.39  |
| INCO020-ST-0010-002-B | Incandescent 40                         | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INCO020-ST-0810-001-B | Incandescent 40                         | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$148.45 |
| INCO020-ST-0830-002-B | Incandescent 40                         | SHARED OR NO POLE |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INCO030-ST-0010-001-B | Incandescent 60                         | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.39  |
| INCO030-ST-0010-002-B | Incandescent 60                         | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INCO040-ST-0010-001-B | Incandescent 75                         | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.39  |
| INCO040-ST-0010-002-B | Incandescent 75                         | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INCO040-ST-0810-001-B | Incandescent 75                         | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$148.45 |
| INCO040-ST-0990-001-B | Incandescent 75                         | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$196.43 |
| INCO050-ST-0010-001-B | Incandescent 100                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$90.39  |
| INCO050-ST-0010-002-B | Incandescent 100                        | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INCO050-ST-0110-002-B | Incandescent 100                        | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INCO050-ST-0810-001-B | Incandescent 100                        | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$148.45 |
| INCO070-ST-0740-002-B | Incandescent 130                        | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$66.39  |
| INCO080-ST-0010-001-B | Incandescent 150                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |
| INCO080-ST-0010-002-B | Incandescent 150                        | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INCO080-ST-0110-002-B | Incandescent 150                        | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INCO080-ST-0810-001-B | Incandescent 150                        | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$151.45 |
| INCO090-ST-0010-001-B | Incandescent 200                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |
| INCO090-ST-0010-002-B | Incandescent 200                        | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INCO090-ST-0810-001-B | Incandescent 200                        | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$151.45 |
| INCO100-ST-0010-001-B | Incandescent 300                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |
| INCO100-ST-0010-002-B | Incandescent 300                        | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INCO100-ST-0610-001-B | Incandescent 300                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$121.16 |
| INCO100-ST-0810-001-B | Incandescent 300                        | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$151.45 |
| INCO100-ST-0990-001-B | Incandescent 300                        | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$199.43 |
| INCO110-ST-0010-001-B | Incandescent 500                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |
| INCO110-ST-0010-002-B | Incandescent 500                        | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INCO110-ST-0110-001-B | Incandescent 500                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$80.78  |
| INCO110-ST-0990-001-B | Incandescent 500                        | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$199.43 |
| INCO130-ST-0010-001-B | Incandescent 800                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$93.39  |
| INCO140-ST-0680-002-B | Incandescent 1000                       | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INCO140-ST-0900-002-B | Incandescent 1000                       | WOOD POLE         |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$80.30  |
| INCO140-ST-1130-002-B | Incandescent 1000                       | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$79.45  |
| INCO160-ST-0640-001-B | Incandescent 1500                       | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$117.32 |
| INCO160-ST-0640-002-B | Incandescent 1500                       | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.39  |
| INCO160-ST-1170-002-B | Incandescent 1500                       | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$79.45  |
| LPS0010-ST-0040-001-B | Low Pressure Sodium 18                  | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$74.81  |
| LPS0010-ST-0350-001-B | Low Pressure Sodium 18                  | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$132.87 |
| LPS0010-ST-0360-001-B | Low Pressure Sodium 18                  | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.85 |
| LPS0020-ST-0040-001-B | Low Pressure Sodium 35                  | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$74.81  |
| LPS0020-ST-0360-001-B | Low Pressure Sodium 35                  | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.85 |
| LPS0030-ST-0040-001-B | Low Pressure Sodium 55                  | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$74.81  |
| LPS0030-ST-0040-002-B | Low Pressure Sodium 55                  | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$49.09  |
| LPS0030-ST-0360-001-B | Low Pressure Sodium 55                  | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.85 |
| LPS0040-ST-0050-001-B | Low Pressure Sodium 90/100              | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$95.94  |
| LPS0040-ST-0050-002-B | Low Pressure Sodium 90/100              | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$51.41  |
| LPS0040-ST-0060-001-B | Low Pressure Sodium 90/100              | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$96.11  |
| LPS0040-ST-0220-001-B | Low Pressure Sodium 90/100              | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$154.00 |
| LPS0040-ST-0310-001-B | Low Pressure Sodium 90/100              | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$189.72 |
| LPS0050-ST-0060-001-B | Low Pressure Sodium 135                 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$98.94  |
| LPS0050-ST-0060-002-B | Low Pressure Sodium 135                 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$54.23  |
| LPS0050-ST-0230-001-B | Low Pressure Sodium 135                 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$157.00 |
| LPS0050-ST-0320-001-B | Low Pressure Sodium 135                 | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$192.72 |
| LPS0060-ST-0060-002-B | Low Pressure Sodium 150                 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$58.18  |
| LPS0060-ST-0230-002-B | Low Pressure Sodium 150                 | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$69.08  |
| LPS0060-ST-0320-002-B | Low Pressure Sodium 150                 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$68.24  |
| LPS0080-ST-0070-001-B | Low Pressure Sodium 180                 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$107.95 |
| LPS0080-ST-0230-001-B | Low Pressure Sodium 180                 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$160.94 |
| LPS0080-ST-0240-001-B | Low Pressure Sodium 180                 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$166.01 |
| LPS0090-ST-0070-002-B | Low Pressure Sodium 310                 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$58.18  |
| MHR0010-ST-0040-002-B | Metal Halide (Reactor Control Gear) 70  | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$58.71  |
| MHR0010-ST-0360-002-B | Metal Halide (Reactor Control Gear) 70  | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$68.77  |
| MHR0030-ST-0050-002-B | Metal Halide (Reactor Control Gear) 150 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$62.65  |
| MHR0030-ST-0310-002-B | Metal Halide (Reactor Control Gear) 150 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-0060-002-B | Metal Halide (Reactor Control Gear) 250 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$62.65  |
| MHR0060-ST-0390-002-B | Metal Halide (Reactor Control Gear) 250 | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-0430-002-B | Metal Halide (Reactor Control Gear) 250 | STEEL POLE        |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-0610-002-B | Metal Halide (Reactor Control Gear) 250 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$62.65  |
| MHR0060-ST-0960-002-B | Metal Halide (Reactor Control Gear) 250 | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$62.65  |
| MHR0060-ST-1120-002-B | Metal Halide (Reactor Control Gear) 250 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-1270-002-B | Metal Halide (Reactor Control Gear) 250 | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-1280-002-B | Metal Halide (Reactor Control Gear) 250 | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0060-ST-1290-002-B | Metal Halide (Reactor Control Gear) 250 | STEEL POLE        |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$72.71  |
| MHR0070-ST-0070-001-B | Metal Halide (Reactor Control Gear) 400 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$116.26 |
| MHR0070-ST-0070-002-B | Metal Halide (Reactor Control Gear) 400 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-0330-001-B | Metal Halide (Reactor Control Gear) 400 | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$210.04 |
| MHR0070-ST-0620-001-B | Metal Halide (Reactor Control Gear) 400 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$114.42 |
| MHR0070-ST-0640-001-B | Metal Halide (Reactor Control Gear) 400 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$114.42 |
| MHR0070-ST-0640-002-B | Metal Halide (Reactor Control Gear) 400 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-0680-002-B | Metal Halide (Reactor Control Gear) 400 | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$66.49  |
| MHR0070-ST-1100-001-B | Metal Halide (Reactor Control Gear) 400 | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$179.67 |

|                       |                                          |                   |  |   |                                              |          |
|-----------------------|------------------------------------------|-------------------|--|---|----------------------------------------------|----------|
| MHR0070-ST-1100-002-B | Metal Halide (Reactor Control Gear) 400  | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$77.39  |
| MHR0100-ST-0120-001-B | Metal Halide (Reactor Control Gear) 1000 | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$247.79 |
| MHR0100-ST-0120-002-B | Metal Halide (Reactor Control Gear) 1000 | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$163.83 |
| MVA0010-ST-0010-001-B | Mercury Vapour 50                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$55.02  |
| MVA0010-ST-0010-002-B | Mercury Vapour 50                        | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$31.01  |
| MVA0010-ST-0810-002-B | Mercury Vapour 50                        | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.92  |
| MVA0010-ST-0990-001-B | Mercury Vapour 50                        | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$161.06 |
| MVA0010-ST-0990-002-B | Mercury Vapour 50                        | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.08  |
| MVA0020-ST-0005-001-B | Mercury Vapour 80                        | NO CAPITAL        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$31.31  |
| MVA0020-ST-0010-001-B | Mercury Vapour 80                        | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$55.31  |
| MVA0020-ST-0010-002-B | Mercury Vapour 80                        | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$31.31  |
| MVA0020-ST-0740-001-B | Mercury Vapour 80                        | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$64.58  |
| MVA0020-ST-0740-002-B | Mercury Vapour 80                        | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$31.31  |
| MVA0020-ST-0810-001-B | Mercury Vapour 80                        | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$113.37 |
| MVA0020-ST-0810-002-B | Mercury Vapour 80                        | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$42.21  |
| MVA0020-ST-0820-001-B | Mercury Vapour 80                        | SHARED OR NO POLE |  | 3 | 1-Unmetered, CE Funded, CE Maintained        | \$73.85  |
| MVA0020-ST-0990-001-B | Mercury Vapour 80                        | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$161.35 |
| MVA0020-ST-0990-002-B | Mercury Vapour 80                        | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.37  |
| MVA0020-ST-1000-002-B | Mercury Vapour 80                        | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$41.37  |
| MVA0020-ST-1260-002-B | Mercury Vapour 80                        | WOOD POLE         |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$42.21  |
| MVA0080-ST-0005-001-B | Mercury Vapour 125                       | NO CAPITAL        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$31.72  |
| MVA0080-ST-0010-001-B | Mercury Vapour 125                       | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$55.72  |
| MVA0080-ST-0010-002-B | Mercury Vapour 125                       | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$31.72  |
| MVA0080-ST-0810-002-B | Mercury Vapour 125                       | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$42.62  |
| MVA0080-ST-0990-001-B | Mercury Vapour 125                       | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$161.76 |
| MVA0080-ST-0990-002-B | Mercury Vapour 125                       | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.78  |
| MVA0120-ST-0010-002-B | Mercury Vapour 160                       | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$35.97  |
| MVA0120-ST-0740-002-B | Mercury Vapour 160                       | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$35.97  |
| MVA0120-ST-1000-002-B | Mercury Vapour 160                       | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$46.03  |
| MVA0170-ST-0020-001-B | Mercury Vapour 175                       | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$81.18  |
| MVA0190-ST-0020-001-B | Mercury Vapour 250                       | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$86.46  |
| MVA0190-ST-0020-002-B | Mercury Vapour 250                       | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$41.25  |
| MVA0190-ST-0200-001-B | Mercury Vapour 250                       | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$144.52 |
| MVA0190-ST-0200-002-B | Mercury Vapour 250                       | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$52.16  |
| MVA0190-ST-0290-001-B | Mercury Vapour 250                       | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$180.24 |
| MVA0190-ST-0290-002-B | Mercury Vapour 250                       | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$51.32  |
| MVA0190-ST-0370-001-B | Mercury Vapour 250                       | STEEL POLE        |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$198.46 |
| MVA0190-ST-0370-002-B | Mercury Vapour 250                       | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$51.32  |
| MVA0190-ST-0450-001-B | Mercury Vapour 250                       | STEEL POLE        |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$234.89 |
| MVA0190-ST-0940-001-B | Mercury Vapour 250                       | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$104.68 |
| MVA0220-ST-0030-001-B | Mercury Vapour 400                       | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$102.38 |
| MVA0220-ST-0030-002-B | Mercury Vapour 400                       | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$56.98  |
| MVA0220-ST-0210-001-B | Mercury Vapour 400                       | WOOD POLE         |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$160.45 |
| MVA0220-ST-0210-002-B | Mercury Vapour 400                       | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$67.88  |
| MVA0220-ST-0300-001-B | Mercury Vapour 400                       | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$196.16 |
| MVA0220-ST-0300-002-B | Mercury Vapour 400                       | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0380-001-B | Mercury Vapour 400                       | STEEL POLE        |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$214.58 |
| MVA0220-ST-0380-002-B | Mercury Vapour 400                       | STEEL POLE        |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0420-002-B | Mercury Vapour 400                       | STEEL POLE        |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0460-001-B | Mercury Vapour 400                       | STEEL POLE        |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$251.41 |
| MVA0220-ST-0460-002-B | Mercury Vapour 400                       | STEEL POLE        |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0540-002-B | Mercury Vapour 400                       | R/BOUT COLUMN     |  | 3 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0580-001-B | Mercury Vapour 400                       | R/BOUT COLUMN     |  | 4 | 1-Unmetered, CE Funded, CE Maintained        | \$334.87 |
| MVA0220-ST-0580-002-B | Mercury Vapour 400                       | R/BOUT COLUMN     |  | 4 | 2-Unmetered, Funded by Others, CE Maintained | \$67.04  |
| MVA0220-ST-0790-001-B | Mercury Vapour 400                       | WOOD POLE         |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$178.86 |
| MVA0220-ST-0950-001-B | Mercury Vapour 400                       | SHARED OR NO POLE |  | 2 | 1-Unmetered, CE Funded, CE Maintained        | \$120.80 |
| MVA0220-ST-0950-002-B | Mercury Vapour 400                       | SHARED OR NO POLE |  | 2 | 2-Unmetered, Funded by Others, CE Maintained | \$56.98  |
| MVA0250-ST-0300-001-B | Mercury Vapour 500                       | STEEL POLE        |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$181.69 |
| MVA0260-ST-0190-001-B | Mercury Vapour 700                       | SHARED OR NO POLE |  | 1 | 1-Unmetered, CE Funded, CE Maintained        | \$242.70 |
| MVA0260-ST-0190-002-B | Mercury Vapour 700                       | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$50.79  |
| MVA0260-ST-0250-002-B | Mercury Vapour 700                       | WOOD POLE         |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$61.70  |
| MVA0260-ST-0340-002-B | Mercury Vapour 700                       | STEEL POLE        |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$60.85  |
| MVA0290-ST-0120-002-B | Mercury Vapour 1000                      | SHARED OR NO POLE |  | 1 | 2-Unmetered, Funded by Others, CE Maintained | \$92.78  |

# Country Energy's Streetlighting Price List

Effective 1 July 2010

Applicable to assets constructed post 1 July 2009



| Tariff Code           | Description              | Dedicated Pole    | Number of Lights per Construction | Tariff Description                           | 2010/2011 Tariff |
|-----------------------|--------------------------|-------------------|-----------------------------------|----------------------------------------------|------------------|
| HPS0020-ST-0040-003-B | High Pressure Sodium 70  | SHARED OR NO POLE | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 103.40        |
| HPS0020-ST-0040-004-B | High Pressure Sodium 70  | SHARED OR NO POLE | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 34.25         |
| HPS0020-ST-0170-004-B | High Pressure Sodium 70  | STEEL POLE        | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 44.25         |
| HPS0020-ST-0350-003-B | High Pressure Sodium 70  | WOOD POLE         | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 239.48        |
| HPS0020-ST-0350-004-B | High Pressure Sodium 70  | WOOD POLE         | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.09         |
| HPS0020-ST-0360-003-B | High Pressure Sodium 70  | STEEL POLE        | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 340.26        |
| HPS0020-ST-0360-004-B | High Pressure Sodium 70  | STEEL POLE        | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 44.25         |
| HPS0020-ST-0730-003-B | High Pressure Sodium 70  | STEEL POLE        | 2                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 366.98        |
| HPS0020-ST-0730-004-B | High Pressure Sodium 70  | STEEL POLE        | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 44.25         |
| HPS0020-ST-0750-004-B | High Pressure Sodium 70  | SHARED OR NO POLE | 3                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 34.25         |
| HPS0020-ST-0880-004-B | High Pressure Sodium 70  | STEEL POLE        | 4                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 44.25         |
| HPS0020-ST-0890-003-B | High Pressure Sodium 70  | SHARED OR NO POLE | 2                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 130.13        |
| HPS0020-ST-0890-004-B | High Pressure Sodium 70  | SHARED OR NO POLE | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 34.25         |
| HPS0020-ST-0910-003-B | High Pressure Sodium 70  | WOOD POLE         | 2                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 266.21        |
| HPS0020-ST-0910-004-B | High Pressure Sodium 70  | WOOD POLE         | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.09         |
| HPS0020-ST-0090-003-B | High Pressure Sodium 70  | SHARED OR NO POLE | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 104.79        |
| HPS0020-TA-0090-004-B | High Pressure Sodium 70  | SHARED OR NO POLE | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 31.94         |
| HPS0020-TA-0140-003-B | High Pressure Sodium 70  | WOOD POLE         | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 240.87        |
| HPS0020-TA-0140-004-B | High Pressure Sodium 70  | WOOD POLE         | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 42.77         |
| HPS0020-TA-0170-003-B | High Pressure Sodium 70  | STEEL POLE        | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 341.64        |
| HPS0020-TA-0170-004-B | High Pressure Sodium 70  | STEEL POLE        | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 41.94         |
| HPS0090-ST-0050-003-B | High Pressure Sodium 150 | SHARED OR NO POLE | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 147.30        |
| HPS0090-ST-0050-004-B | High Pressure Sodium 150 | SHARED OR NO POLE | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 36.49         |
| HPS0090-ST-0220-003-B | High Pressure Sodium 150 | WOOD POLE         | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 283.38        |
| HPS0090-ST-0220-004-B | High Pressure Sodium 150 | WOOD POLE         | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.33         |
| HPS0090-ST-0310-003-B | High Pressure Sodium 150 | STEEL POLE        | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 358.65        |
| HPS0090-ST-0310-004-B | High Pressure Sodium 150 | STEEL POLE        | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 46.49         |
| HPS0090-ST-0690-003-B | High Pressure Sodium 150 | STEEL POLE        | 2                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 401.53        |
| HPS0090-ST-0690-004-B | High Pressure Sodium 150 | STEEL POLE        | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 46.49         |
| HPS0090-ST-0710-004-B | High Pressure Sodium 150 | STEEL POLE        | 3                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 46.49         |
| HPS0090-ST-0720-003-B | High Pressure Sodium 150 | STEEL POLE        | 4                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 487.29        |
| HPS0090-ST-0720-004-B | High Pressure Sodium 150 | STEEL POLE        | 4                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 46.49         |
| HPS0090-ST-0980-004-B | High Pressure Sodium 150 | WOOD POLE         | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.33         |
| HPS0090-ST-1010-003-B | High Pressure Sodium 150 | SHARED OR NO POLE | 2                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 190.18        |
| HPS0090-ST-1010-004-B | High Pressure Sodium 150 | SHARED OR NO POLE | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 36.49         |
| HPS0090-ST-1360-004-B | High Pressure Sodium 150 | R/BOUT COLUMN     | 3                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 46.49         |
| HPS0090-TA-0050-003-B | High Pressure Sodium 150 | SHARED OR NO POLE | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 150.45        |
| HPS0090-TA-0050-004-B | High Pressure Sodium 150 | SHARED OR NO POLE | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 39.64         |
| HPS0090-TA-0220-003-B | High Pressure Sodium 150 | WOOD POLE         | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 286.52        |
| HPS0090-TA-0310-003-B | High Pressure Sodium 150 | STEEL POLE        | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 361.80        |
| HPS0110-ST-0060-003-B | High Pressure Sodium 250 | SHARED OR NO POLE | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 148.89        |
| HPS0110-ST-0060-004-B | High Pressure Sodium 250 | SHARED OR NO POLE | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 37.65         |
| HPS0110-ST-0230-003-B | High Pressure Sodium 250 | WOOD POLE         | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 284.97        |
| HPS0110-ST-0230-004-B | High Pressure Sodium 250 | WOOD POLE         | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 48.48         |
| HPS0110-ST-0320-003-B | High Pressure Sodium 250 | STEEL POLE        | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 360.24        |
| HPS0110-ST-0320-004-B | High Pressure Sodium 250 | STEEL POLE        | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64         |
| HPS0110-ST-0390-003-B | High Pressure Sodium 250 | STEEL POLE        | 2                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 403.56        |
| HPS0110-ST-0390-004-B | High Pressure Sodium 250 | STEEL POLE        | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64         |
| HPS0110-ST-0430-004-B | High Pressure Sodium 250 | STEEL POLE        | 3                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64         |
| HPS0110-ST-0470-003-B | High Pressure Sodium 250 | STEEL POLE        | 4                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 490.21        |
| HPS0110-ST-0470-004-B | High Pressure Sodium 250 | STEEL POLE        | 4                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64         |
| HPS0110-ST-0550-003-B | High Pressure Sodium 250 | R/BOUT COLUMN     | 3                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 619.18        |
| HPS0110-ST-0550-004-B | High Pressure Sodium 250 | R/BOUT COLUMN     | 3                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64         |
| HPS0110-ST-0590-003-B | High Pressure Sodium 250 | R/BOUT COLUMN     | 4                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 662.50        |
| HPS0110-ST-0590-004-B | High Pressure Sodium 250 | R/BOUT COLUMN     | 4                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64         |
| HPS0110-ST-0610-003-B | High Pressure Sodium 250 | SHARED OR NO POLE | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 166.30        |
| HPS0110-ST-0610-004-B | High Pressure Sodium 250 | SHARED OR NO POLE | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 37.65         |
| HPS0110-ST-0650-004-B | High Pressure Sodium 250 | SHARED OR NO POLE | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 37.65         |
| HPS0110-ST-0760-003-B | High Pressure Sodium 250 | WOOD POLE         | 2                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 328.29        |
| HPS0110-ST-0760-004-B | High Pressure Sodium 250 | WOOD POLE         | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 48.48         |
| HPS0110-ST-0930-004-B | High Pressure Sodium 250 | WOOD POLE         | 3                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 48.48         |
| HPS0110-ST-0960-003-B | High Pressure Sodium 250 | SHARED OR NO POLE | 2                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 192.21        |
| HPS0110-ST-0960-004-B | High Pressure Sodium 250 | SHARED OR NO POLE | 2                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 37.65         |
| HPS0110-ST-0970-004-B | High Pressure Sodium 250 | SHARED OR NO POLE | 4                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 37.65         |
| HPS0110-ST-1070-003-B | High Pressure Sodium 250 | WOOD POLE         | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 302.37        |
| HPS0110-ST-1070-004-B | High Pressure Sodium 250 | WOOD POLE         | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 48.48         |
| HPS0110-ST-1120-003-B | High Pressure Sodium 250 | STEEL POLE        | 1                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 377.65        |
| HPS0110-ST-1120-004-B | High Pressure Sodium 250 | STEEL POLE        | 1                                 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64         |
| HPS0110-ST-1160-003-B | High Pressure Sodium 250 | WOOD POLE         | 2                                 | 3-Unmetered, CE Funded, CE Maintained        | \$ 363.10        |

|                       |                                          |                   |   |                                              |           |
|-----------------------|------------------------------------------|-------------------|---|----------------------------------------------|-----------|
| HPS0110-ST-1330-004-B | High Pressure Sodium 250                 | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64  |
| HPS0110-ST-1340-004-B | High Pressure Sodium 250                 | STEEL POLE        | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64  |
| HPS0110-ST-1380-004-B | High Pressure Sodium 250                 | R/BOUT COLUMN     | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64  |
| HPS0110-ST-1450-004-B | High Pressure Sodium 250                 | R/BOUT COLUMN     | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 47.64  |
| HPS0110-TA-0060-003-B | High Pressure Sodium 250                 | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 146.94 |
| HPS0110-TA-0060-004-B | High Pressure Sodium 250                 | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 35.69  |
| HPS0110-TA-0230-003-B | High Pressure Sodium 250                 | WOOD POLE         | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 283.02 |
| HPS0110-TA-0320-003-B | High Pressure Sodium 250                 | STEEL POLE        | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 358.29 |
| HPS0110-TA-0320-004-B | High Pressure Sodium 250                 | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.69  |
| HPS0110-TA-0470-003-B | High Pressure Sodium 250                 | STEEL POLE        | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 488.25 |
| HPS0110-TA-0590-003-B | High Pressure Sodium 250                 | R/BOUT COLUMN     | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 660.55 |
| HPS0110-TA-0590-004-B | High Pressure Sodium 250                 | R/BOUT COLUMN     | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.69  |
| HPS0110-TA-0960-003-B | High Pressure Sodium 250                 | SHARED OR NO POLE | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 190.26 |
| HPS0110-TA-1120-004-B | High Pressure Sodium 250                 | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.69  |
| HPS0170-ST-0070-003-B | High Pressure Sodium 400                 | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 165.21 |
| HPS0170-ST-0070-004-B | High Pressure Sodium 400                 | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 41.47  |
| HPS0170-ST-0240-003-B | High Pressure Sodium 400                 | WOOD POLE         | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 301.29 |
| HPS0170-ST-0240-004-B | High Pressure Sodium 400                 | WOOD POLE         | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 52.30  |
| HPS0170-ST-0270-004-B | High Pressure Sodium 400                 | R/BOUT COLUMN     | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 51.47  |
| HPS0170-ST-0330-003-B | High Pressure Sodium 400                 | STEEL POLE        | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 376.56 |
| HPS0170-ST-0330-004-B | High Pressure Sodium 400                 | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 51.47  |
| HPS0170-ST-0400-003-B | High Pressure Sodium 400                 | STEEL POLE        | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 432.38 |
| HPS0170-ST-0400-004-B | High Pressure Sodium 400                 | STEEL POLE        | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 51.47  |
| HPS0170-ST-0440-003-B | High Pressure Sodium 400                 | STEEL POLE        | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 488.20 |
| HPS0170-ST-0440-004-B | High Pressure Sodium 400                 | STEEL POLE        | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 51.47  |
| HPS0170-ST-0480-004-B | High Pressure Sodium 400                 | STEEL POLE        | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 51.47  |
| HPS0170-ST-0560-004-B | High Pressure Sodium 400                 | R/BOUT COLUMN     | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 51.47  |
| HPS0170-ST-0600-004-B | High Pressure Sodium 400                 | R/BOUT COLUMN     | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 51.47  |
| HPS0170-ST-0620-003-B | High Pressure Sodium 400                 | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 160.66 |
| HPS0170-ST-0620-004-B | High Pressure Sodium 400                 | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 41.47  |
| HPS0170-ST-0660-004-B | High Pressure Sodium 400                 | SHARED OR NO POLE | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 41.47  |
| HPS0170-ST-0770-004-B | High Pressure Sodium 400                 | WOOD POLE         | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 52.30  |
| HPS0170-ST-0900-004-B | High Pressure Sodium 400                 | WOOD POLE         | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 52.30  |
| HPS0170-ST-1030-003-B | High Pressure Sodium 400                 | SHARED OR NO POLE | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 221.03 |
| HPS0170-ST-1030-004-B | High Pressure Sodium 400                 | SHARED OR NO POLE | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 41.47  |
| HPS0170-ST-1100-003-B | High Pressure Sodium 400                 | WOOD POLE         | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 314.46 |
| HPS0170-ST-1100-004-B | High Pressure Sodium 400                 | WOOD POLE         | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 52.30  |
| HPS0170-ST-1130-003-B | High Pressure Sodium 400                 | STEEL POLE        | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 458.73 |
| HPS0170-ST-1170-003-B | High Pressure Sodium 400                 | STEEL POLE        | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 389.73 |
| HPS0170-ST-1170-004-B | High Pressure Sodium 400                 | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 51.47  |
| HPS0170-ST-1250-003-B | High Pressure Sodium 400                 | WOOD POLE         | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 452.44 |
| HPS0170-TA-0070-003-B | High Pressure Sodium 400                 | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 167.02 |
| MHR0060-ST-0060-004-B | Metal Hallide (Reactor Control Gear) 250 | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 62.24  |
| MHR0060-ST-0320-003-B | Metal Hallide (Reactor Control Gear) 250 | STEEL POLE        | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 384.83 |
| MHR0060-ST-0320-004-B | Metal Hallide (Reactor Control Gear) 250 | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 72.23  |
| MHR0060-ST-0390-004-B | Metal Hallide (Reactor Control Gear) 250 | STEEL POLE        | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 72.23  |
| MHR0060-ST-0430-004-B | Metal Hallide (Reactor Control Gear) 250 | STEEL POLE        | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 72.23  |
| MHR0060-ST-0610-003-B | Metal Hallide (Reactor Control Gear) 250 | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 190.89 |
| MHR0060-ST-0610-004-B | Metal Hallide (Reactor Control Gear) 250 | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 62.24  |
| MHR0060-ST-0960-004-B | Metal Hallide (Reactor Control Gear) 250 | SHARED OR NO POLE | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 62.24  |
| MHR0060-ST-1120-004-B | Metal Hallide (Reactor Control Gear) 250 | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 72.23  |
| MHR0060-ST-1270-004-B | Metal Hallide (Reactor Control Gear) 250 | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 72.23  |
| MHR0060-ST-1280-004-B | Metal Hallide (Reactor Control Gear) 250 | STEEL POLE        | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 72.23  |
| MHR0060-ST-1290-004-B | Metal Hallide (Reactor Control Gear) 250 | STEEL POLE        | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 72.23  |
| MHR0070-ST-0070-003-B | Metal Hallide (Reactor Control Gear) 400 | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 189.79 |
| MHR0070-ST-0070-004-B | Metal Hallide (Reactor Control Gear) 400 | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 66.05  |
| MHR0070-ST-0620-003-B | Metal Hallide (Reactor Control Gear) 400 | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 185.24 |
| MHR0070-ST-0640-003-B | Metal Hallide (Reactor Control Gear) 400 | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 185.24 |
| MHR0070-ST-0640-004-B | Metal Hallide (Reactor Control Gear) 400 | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 66.05  |
| MHR0070-ST-0680-004-B | Metal Hallide (Reactor Control Gear) 400 | SHARED OR NO POLE | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 66.05  |
| MHR0070-ST-1100-003-B | Metal Hallide (Reactor Control Gear) 400 | WOOD POLE         | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 339.04 |
| MHR0070-ST-1100-004-B | Metal Hallide (Reactor Control Gear) 400 | WOOD POLE         | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 76.88  |
| FLU0350-ST-1620-003-B | Compact Fluorescent 1x42                 | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 106.68 |
| FLU0350-ST-1620-004-B | Compact Fluorescent 1x42                 | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 35.01  |
| FLU0350-ST-1630-003-B | Compact Fluorescent 1x42                 | SHARED OR NO POLE | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 135.93 |
| FLU0350-ST-1630-004-B | Compact Fluorescent 1x42                 | SHARED OR NO POLE | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 35.01  |
| FLU0350-ST-1640-003-B | Compact Fluorescent 1x42                 | SHARED OR NO POLE | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 165.18 |
| FLU0350-ST-1640-004-B | Compact Fluorescent 1x42                 | SHARED OR NO POLE | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 35.01  |
| FLU0350-ST-1650-003-B | Compact Fluorescent 1x42                 | SHARED OR NO POLE | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 194.43 |
| FLU0350-ST-1650-004-B | Compact Fluorescent 1x42                 | SHARED OR NO POLE | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 35.01  |
| FLU0350-ST-1660-003-B | Compact Fluorescent 1x42                 | WOOD POLE         | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 242.75 |
| FLU0350-ST-1660-004-B | Compact Fluorescent 1x42                 | WOOD POLE         | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.84  |
| FLU0350-ST-1670-003-B | Compact Fluorescent 1x42                 | WOOD POLE         | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 272.00 |
| FLU0350-ST-1670-004-B | Compact Fluorescent 1x42                 | WOOD POLE         | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.84  |
| FLU0350-ST-1680-003-B | Compact Fluorescent 1x42                 | WOOD POLE         | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 301.25 |
| FLU0350-ST-1680-004-B | Compact Fluorescent 1x42                 | WOOD POLE         | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.84  |

|                       |                                           |                   |   |                                              |           |
|-----------------------|-------------------------------------------|-------------------|---|----------------------------------------------|-----------|
| FLU0350-ST-1690-003-B | Compact Fluorescent 1x42                  | WOOD POLE         | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 330.50 |
| FLU0350-ST-1690-004-B | Compact Fluorescent 1x42                  | WOOD POLE         | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.84  |
| FLU0350-ST-1700-003-B | Compact Fluorescent 1x42                  | STEEL POLE        | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 343.53 |
| FLU0350-ST-1700-004-B | Compact Fluorescent 1x42                  | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.00  |
| FLU0350-ST-1710-003-B | Compact Fluorescent 1x42                  | STEEL POLE        | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 372.78 |
| FLU0350-ST-1710-004-B | Compact Fluorescent 1x42                  | STEEL POLE        | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.00  |
| FLU0350-ST-1720-003-B | Compact Fluorescent 1x42                  | STEEL POLE        | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 402.03 |
| FLU0350-ST-1720-004-B | Compact Fluorescent 1x42                  | STEEL POLE        | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.00  |
| FLU0350-ST-1730-003-B | Compact Fluorescent 1x42                  | STEEL POLE        | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 431.28 |
| FLU0350-ST-1730-004-B | Compact Fluorescent 1x42                  | STEEL POLE        | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.00  |
| FLU0360-ST-1740-003-B | T5 2x14W                                  | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 120.76 |
| FLU0360-ST-1740-004-B | T5 2x14W                                  | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 35.38  |
| FLU0360-ST-1750-003-B | T5 2x14W                                  | SHARED OR NO POLE | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 163.72 |
| FLU0360-ST-1750-004-B | T5 2x14W                                  | SHARED OR NO POLE | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 35.38  |
| FLU0360-ST-1760-003-B | T5 2x14W                                  | SHARED OR NO POLE | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 206.67 |
| FLU0360-ST-1760-004-B | T5 2x14W                                  | SHARED OR NO POLE | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 35.38  |
| FLU0360-ST-1770-003-B | T5 2x14W                                  | SHARED OR NO POLE | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 249.63 |
| FLU0360-ST-1770-004-B | T5 2x14W                                  | SHARED OR NO POLE | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 35.38  |
| FLU0360-ST-1780-003-B | T5 2x14W                                  | WOOD POLE         | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 256.84 |
| FLU0360-ST-1780-004-B | T5 2x14W                                  | WOOD POLE         | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 46.22  |
| FLU0360-ST-1790-003-B | T5 2x14W                                  | WOOD POLE         | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 299.79 |
| FLU0360-ST-1790-004-B | T5 2x14W                                  | WOOD POLE         | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 46.22  |
| FLU0360-ST-1800-003-B | T5 2x14W                                  | WOOD POLE         | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 342.75 |
| FLU0360-ST-1800-004-B | T5 2x14W                                  | WOOD POLE         | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 46.22  |
| FLU0360-ST-1810-003-B | T5 2x14W                                  | WOOD POLE         | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 385.70 |
| FLU0360-ST-1810-004-B | T5 2x14W                                  | WOOD POLE         | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 46.22  |
| FLU0360-ST-1820-003-B | T5 2x14W                                  | STEEL POLE        | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 357.61 |
| FLU0360-ST-1820-004-B | T5 2x14W                                  | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.38  |
| FLU0360-ST-1830-003-B | T5 2x14W                                  | STEEL POLE        | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 400.57 |
| FLU0360-ST-1830-004-B | T5 2x14W                                  | STEEL POLE        | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.38  |
| FLU0360-ST-1840-003-B | T5 2x14W                                  | STEEL POLE        | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 443.52 |
| FLU0360-ST-1840-004-B | T5 2x14W                                  | STEEL POLE        | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.38  |
| FLU0360-ST-1850-003-B | T5 2x14W                                  | STEEL POLE        | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 486.48 |
| FLU0360-ST-1850-004-B | T5 2x14W                                  | STEEL POLE        | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.38  |
| MHR0100-ST-0120-004-B | Metal Hallide (Reactor Control Gear) 1000 | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 162.75 |
| FLU0355-ST-1980-003-B | Compact Fluorescent 1x32                  | SHARED OR NO POLE | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 106.46 |
| FLU0355-ST-1980-004-B | Compact Fluorescent 1x32                  | SHARED OR NO POLE | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 34.87  |
| FLU0355-ST-1990-003-B | Compact Fluorescent 1x32                  | SHARED OR NO POLE | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 135.62 |
| FLU0355-ST-1990-004-B | Compact Fluorescent 1x32                  | SHARED OR NO POLE | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 34.87  |
| FLU0355-ST-2000-003-B | Compact Fluorescent 1x32                  | SHARED OR NO POLE | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 164.78 |
| FLU0355-ST-2000-004-B | Compact Fluorescent 1x32                  | SHARED OR NO POLE | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 34.87  |
| FLU0355-ST-2010-003-B | Compact Fluorescent 1x32                  | SHARED OR NO POLE | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 193.94 |
| FLU0355-ST-2010-004-B | Compact Fluorescent 1x32                  | SHARED OR NO POLE | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 34.87  |
| FLU0355-ST-2020-003-B | Compact Fluorescent 1x32                  | WOOD POLE         | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 242.53 |
| FLU0355-ST-2020-004-B | Compact Fluorescent 1x32                  | WOOD POLE         | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.71  |
| FLU0355-ST-2030-003-B | Compact Fluorescent 1x32                  | WOOD POLE         | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 271.69 |
| FLU0355-ST-2030-004-B | Compact Fluorescent 1x32                  | WOOD POLE         | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.71  |
| FLU0355-ST-2040-003-B | Compact Fluorescent 1x32                  | WOOD POLE         | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 300.85 |
| FLU0355-ST-2040-004-B | Compact Fluorescent 1x32                  | WOOD POLE         | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.71  |
| FLU0355-ST-2050-003-B | Compact Fluorescent 1x32                  | WOOD POLE         | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 330.01 |
| FLU0355-ST-2050-004-B | Compact Fluorescent 1x32                  | WOOD POLE         | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 45.71  |
| FLU0355-ST-2060-003-B | Compact Fluorescent 1x32                  | STEEL POLE        | 1 | 3-Unmetered, CE Funded, CE Maintained        | \$ 343.31 |
| FLU0355-ST-2060-004-B | Compact Fluorescent 1x32                  | STEEL POLE        | 1 | 4-Unmetered, Funded by Others, CE Maintained | \$ 44.87  |
| FLU0355-ST-2070-003-B | Compact Fluorescent 1x32                  | STEEL POLE        | 2 | 3-Unmetered, CE Funded, CE Maintained        | \$ 372.47 |
| FLU0355-ST-2070-004-B | Compact Fluorescent 1x32                  | STEEL POLE        | 2 | 4-Unmetered, Funded by Others, CE Maintained | \$ 44.87  |
| FLU0355-ST-2080-003-B | Compact Fluorescent 1x32                  | STEEL POLE        | 3 | 3-Unmetered, CE Funded, CE Maintained        | \$ 401.63 |
| FLU0355-ST-2080-004-B | Compact Fluorescent 1x32                  | STEEL POLE        | 3 | 4-Unmetered, Funded by Others, CE Maintained | \$ 44.87  |
| FLU0355-ST-2090-003-B | Compact Fluorescent 1x32                  | STEEL POLE        | 4 | 3-Unmetered, CE Funded, CE Maintained        | \$ 430.79 |
| FLU0355-ST-2090-004-B | Compact Fluorescent 1x32                  | STEEL POLE        | 4 | 4-Unmetered, Funded by Others, CE Maintained | \$ 44.87  |