



NETWORK TARIFF & NEGOTIATED SERVICES

Manual No. 18

Published: June 2013

Published Amendments: October 2013

SA Power Networks

www.sapowernetworks.com.au



Copyright © 2013 SA Power Networks.

This publication is copyright. Except as permitted under the Copyright Act 1968 no part of this publication may be reproduced by any process without the specific written permission of the copyright owner.

All rights reserved.

Amendments 2013:

DATE	EXPLANATION
August 2012	Updated Public Lighting tables on pages 87-89.
3 September 2012	Company name changed from ETSA Utilities to SA Power Networks. No other content of this Manual has been altered. Any revision markings are from the August 2012 edition.
18 March 2013	- Section 9 - Page 65 Removed charges for pre-payment metering. - Page 68 added new Meter Test and Meter Inspection charges where a customer/retailer has requested an appointment. - Page 68 changed title category for PV Meter Test. - Page 73 changes wording for AH appointments back to original terminology of Priority Appointment.
June 2013	- Section 1 1.2 Terms & Definitions – added Excess kVAr charge. - Section 4 (4.3 Network Tariffs). - Section 5 (5.1 Marketing Types). - Section 7 (7.2 Process – Residential Customer, 7.3.3 Residential House – Meter/Tariff). - Section 8 (8.1 Excess kVAr Charges). - Section 9 Network Distribution Services - Added 9.3.3. - Section 10 Feeder Charges. - Section 11 Tariff Schedule.
October 2013	- Section 11 - Clarification to Sub-Transmission and Back-up Tariffs. - Section 12 – Added note 2 (p).

Contents

1. INTRODUCTION	6
1.1 Scope and Purpose.....	6
1.2 Terms and Definitions	6
1.3 Referenced Documents, Codes and Regulations	10
2. REQUIREMENTS OF THE NATIONAL ELECTRICITY RULES AND THE AER'S 2010 DISTRIBUTION DETERMINATION.....	11
3. TARIFF CLASS ASSIGNMENT PROCEDURES	11
3.1 Tariffs and Tariff Classes	11
3.2 Assignment of new customers to a tariff class	12
3.3 Reassignment of existing customers to another existing or a new tariff class during the next regulatory control period.....	13
3.4 Objections to proposed tariff class assignments and reassignments.....	13
4. TARIFFS.....	14
4.1 General.....	14
4.2 Categories	16
4.2.1 Residential Use.....	16
4.2.2 Business Use.....	16
4.2.3 Combined Business/Residential Use.....	16
4.2.4 Controlled Load.....	17
4.3 Network Tariffs	17
4.3.1 Residential Tariffs.....	18
4.3.2 Business Tariffs – Energy Only	19
4.3.3 Business Tariffs – Demand	21
4.3.4 Solar Generation Tariffs	23
4.3.5 Un-metered.....	24
5. METERING	26
5.1 Market Types	26
5.2 Terminology	26
5.3 Regulated / Excluded / Contestable Meter Provision.....	28
5.4 NER Metering Requirements	29
5.5 Metering for Tariff Requirements.....	30
5.6 Parent / Child Metering	30
5.7 Meter Reading	31
6. NMIS.....	31
6.1 Background	31
6.2 NER Requirements	32

6.3	Allocation Process	32
6.4	NMIs and Meter Grouping	33
6.5	NMIs and Connections	34
6.5.1	Upgrades	34
6.5.2	New Supply	34
7.	PROCESS	35
7.1	General Principles	35
7.2	Process	36
7.2.1	NMI Allocation Check List for Upgrades	37
7.2.2	Meter Selection for New NMIs (Non Residential)	39
7.2.3	Meter Selection for Existing NMIs (Non Residential).....	40
7.2.4	Demand Tariff Selection (LV)	41
7.3	Examples	42
7.3.1	Residential House – New Connection	42
7.3.2	Residential House – Alteration	42
7.3.3	Residential House – Meter / Tariff Change Request.....	43
7.3.4	Small Commercial – New Connection	44
7.3.5	Small Commercial – Alteration	44
7.3.6	Small Commercial – Meter / Tariff Change Request.....	45
7.3.7	Large Commercial – New Connection	46
7.3.8	Large Commercial – Alteration	47
7.3.9	Large Commercial – Meter / Tariff Change Request	48
7.3.10	Commercial – Meter / Tariff Change Request	48
8.	POWER FACTOR	50
8.1	Excess kVAr Charges.....	50
9.	NEGOTIATED DISTRIBUTION SERVICES	52
9.1	Basic Connection Services	52
9.1.1	Purpose	52
9.1.2	Discussion.....	52
	Basic Connection Services Indicative Price List.....	53
9.2	Negotiated Connection Services	60
9.2.1	Purpose	60
9.2.2	Discussion.....	60
	Negotiated Connection Services Indicative Price List.....	61
9.3	Negotiated Distribution Services (Non Connection).....	62
9.3.1	Purpose	62
9.3.2	Discussion.....	62
9.3.3	Pre-payment Metering.....	62

Negotiated Distribution Services (Non Connection) Indicative Price List.....	63
Fees for Provision of Public Lighting	78
10. FEEDER CHARGES	81
10.1 Background to these charges.....	81
11. TARIFF SCHEDULE FOR 2013-14	82
Back up supply tariffs:.....	85
12. Notes Accompanying 2013/14 Tariffs.....	87

1. INTRODUCTION

1.1 Scope and Purpose

SA Power Networks May 2010 Pricing Proposal has established five tariff classes into which the tariffs that its customers for direct control services have been separated:

- Major Business;
- High Voltage Business;
- Residential (including Controlled Load); and
- Metering Services.

SA Power Networks is required to assign a Network tariff to each of a customer's connection points, on the basis of a number of factors set out in the National Electricity Rules (the Rules) and procedures established by the AER. SA Power Networks is also permitted to reassign a customer's tariff class, if appropriate. This assignment and reassignment of customers to tariff classes is required by the Rules to be subject to an effective system of assessment and review.

This document sets out:

- The factors to be considered in assessing how customer connections are assigned to Network tariffs and tariff classes in a consistent and appropriate manner;
- The information that will be provided to customers concerning their tariff class assignment and reassignment;
- The process by which a tariff class assignment or reassignment may be reviewed and
- Default fees associated with basic connection services and negotiated services.

This Tariff Manual is published on SA Power Networks website and will be made available to any customer or intending customer upon request.

While this document's primary purpose is to describe Network tariffs, negotiated services and the process for their assignment, it also is designed to ensure that the NMI allocation and metering requirements are consistent, as a number of interdependencies exist between these three core areas.

1.2 Terms and Definitions

Note: Specific metering terminology is located in the metering section of the document.

Term	Definition
AEMO	Australian Energy Market Operator. Incorporates the functions of NEMMCO (National Electricity Market Management Company).
AER	Australian Energy Regulator.
Agreed Additional Demand	Is the amount that the Agreed Anytime Demand exceeds the Agreed Annual Demand. If the Agreed Anytime Demand is less than Agreed Annual Demand then the Agreed Additional Demand is zero.
Agreed Annual Demand	Is the highest demand expected to be required in the period 12:00 to 20:00 on working days in December through March (Central Standard Summer Time). This may be determined by agreement or by recorded demand.

Term	Definition
Agreed Anytime Demand	Is the highest demand expected to be required outside of the times that the Agreed Annual Demand applies. This may be determined by agreement or by recorded demand. This may be equal or higher than the Agreed Annual Demand but not less.
Augmentation	Means works to enlarge the capability of the SA Power Network's distribution network to distribute electricity.
Authorised Capacity	Is the supply capacity that the customer is authorised to use. This is generally the demand capacity specified in SA Power Networks offer letter up to the first three years from connection. The capacity then becomes the agreed demand and could be less than what was agreed to in the offer letter. Where a customer requests a reduction in their Agreed Demands then subject to approval the reduced Agreed Demands also becomes the Authorised Capacity.
Basic Connection Service	Means a connection service related to a connection (or proposed connection) no greater than 63 Amps per phase low voltage between SA Power Networks distribution system and a customer's premises (including a small embedded generator no more than 10kVA per phase and a total of 5kVA SWER connections). The provision of this connection service involves minimal or no augmentation of the distribution network.
Connection	Means a physical link between SA Power Networks distribution system and a customer's premises to allow the flow of electricity.
Connection Point	The physical location of connection between a customer's electrical installation and SA Power Networks distribution system assets.
Customer	Distribution Network User.
DLF	Distribution Loss Factor – measure of the percentage of energy lost through line losses on the distribution network between the transmission connection point and the customer connection point.
Entry Point	The physical point at which SA Power Networks distribution system (feeder) or the customer's consumers mains cross the property boundary operated or owned by the customer and where the energy flow is from the outside to the inside of the property.
Excess kVAr charge	If a customer installation is not power factor compliant at times of the NMI monthly peak demand, then an annual charge is applied. The charge equates to the amount of kVAr's required to make the site complaint times a fixed charge.

Term	Definition
Exit Point	The physical point at which SA Power Networks distribution system (feeder) crosses the customers property boundary operated or occupied by the customer and where the energy flow is from the inside to the outside of the property.
Expedited Connection	A basic connection service can be expedited by accepting both the Terms and Conditions of the MSO and the default price when the application is made.
Extension	This term applies to extending the distribution network into areas not previously supplied at that voltage. The extension is likely to be used by more customers than those initially being supplies. This includes building new HV mains above existing LV mains, new radial extensions of HV mains, LV mains and SWER lines and may include new transformers.
FRMP	Financially Responsible Market Participant ie the Retailer.
Indicative Price List	A set of default connection service charges that indicates the average price for the provision of each service. These charges do not apply if you choose a negotiated service.
kVA	kVA essentially represents demand. kVA includes both Active and Reactive power to give a better indication of the demand on an electrical supply system. (Apparent Power).
kW	Watts are the electrical unit of power, 1kW = 1,000 Watts – A measure of demand however this unit only includes the electrical properties that actually perform electrical work (Also known as Active or Real power).
kWh	The unit used for electrical energy consumed eg 1kW of load used for 1 hour equals 1kWh.
kVAr	The unit used for the measurement of reactive power.
LNSP	Local Network Service Provider – For customers directly connected to SA Power Networks distribution system the LNSP is SA Power Networks.
MDP	Metering Data Provider – the organisation responsible for collecting and ‘publishing’ meter readings or consumption data.
MLF	Marginal Loss Factor – a measure of the percentage of energy lost through line losses in the Transmission system compared to that lost in supplying the Reference Node.
Model Standing Offers (MSO)	Provides the Terms and Conditions of a basic connection service which have been approved by the AER.
MPB	Meter Provider – the organisation responsible for providing and/or maintaining the metering installation under the NER.
Negotiated Services	All services that are not a basic connection service.

Term	Definition
Negotiated Connection Services	Are all services that relate to a connection (or a proposed connection) between SA Power Networks distribution system and the customers premises but are not basic connection services.
Negotiated Distribution Services	Are all services that are not related to a connection (or a proposed connection) between SA Power Networks distribution system and the customers premises.
NER	National Electricity Rules – formerly called NEC.
NMI	National Metering Identifier. A unique number for a customer's metered connection point or points. A customer may have more than one metered connection point; therefore a customer could have more than one NMI. A NMI is 10 characters long with an additional check digit eg SAAAAAXXXX / X or 200XXXXXXX / X
Off-peak Energy	Energy consumed that is other than peak energy.
Peak Energy	Energy consumed on business days between the hours of 0700 and 2100 (Central Standard Time). For customers with metering that does not recognise specific days, peak energy is energy consumed on each day between the hours of 0700 and 2100 (Central Standard Time).
PF	Power Factor is essentially a type of efficiency measure and is the ratio of Active and Apparent power. ie $PF = kW/kVA$.
PV	Photovoltaic.
PV JSO	This is a charge to recover the SA Government solar feed in subsidy provided to customers that qualify for the solar feed in tariff.
Real Estate Development	Means the commercial development of land including its development in one or more of the following ways: Residential, industrial or commercial subdivision; The construction of multi tenanted commercial or industrial premises (or both); The construction of multiple new residential premises ie multi tenanted apartment building.
RP	Responsible Person – the organisation responsible for managing a metering installation under the NER.
Sub-Transmission	Is the SA Power Networks 33kV backbone and 66kV network.
Sub-Transmission Tariff	To be eligible for a Sub-Transmission Tariff the customer must take direct supply from the SA Power Networks Sub-Transmission network.

Term	Definition
SWER	Single Wire Earth Return.
Termination Point	The physical point at which SA Power Networks distribution system (feeder) terminates within the customers property boundary.
URD	Underground Residential Development.
Zone Substation	A Zone Substation is an SA Power Networks premise in which HV supply is converted, controlled or transferred.
Zone Substation Tariff	To be eligible for a Zone Substation Tariff the customer must take direct supply from an SA Power Networks Zone Substation. The supply is taken from the secondary side of the transformer located at the substation.

1.3 Referenced Documents, Codes and Regulations

The following documents have been referenced in this Network Tariff & Negotiated Services manual:

- The South Australian Distribution Code ¹;
- South Australian Metering Code ²;
- National Electricity Rules ³;
- AER Final Determination for South Australia ⁴; and
- SA Power Networks Pricing Proposal ⁵.

¹ Available at: <http://www.aer.gov.au/node/11641>

² Available at: <http://www.escosa.sa.gov.au/library/101221-ElectricityMeteringCode EMTC07.pdf>

³ National Electricity Rules Version 49, 5 April 2012.

⁴ Australian Energy Regulator, Final decision – South Australia distribution determination 2010-11 to 2014-15, May 2010.

⁵ SA Power Networks Pricing Proposal, April 2012.

2. REQUIREMENTS OF THE NATIONAL ELECTRICITY RULES AND THE AER'S 2010 DISTRIBUTION DETERMINATION

SA Power Networks May 2010 Pricing Proposal was prepared in accordance with Clause 6.18.2 of the Rules. That Pricing Proposal defined the five tariff classes into which the customers of its direct control services were separated.

Pursuant to the principles set out in clause 6.18.4 of the Rules, the AER agreed to assign all existing SA Power Networks customers to these five tariff classes in 2010/11.

Appendix B of the AER's Final Decision set out the procedures which SA Power Networks must follow in assigning customers to tariff classes or reassigning customers from one tariff class to another during the 2010-15 regulatory control period. The procedures also cover the following matters pertaining to tariff class assignment and reassignment:

- Assignment of new customers to a tariff class;
- Reassignment of existing customers to another existing or a new tariff class; and
- Objections to proposed assignments and reassignments.

3. TARIFF CLASS ASSIGNMENT PROCEDURES

This section sets out the tariff and tariff class assignment procedures to be followed by SA Power Networks 2010/11.

3.1 Tariffs and Tariff Classes

SA Power Networks regulated services are classified in accordance with the Rules as direct control services and include its network services and some metering services. These services have been further divided into:

- Standard control services (network services); and
- Alternative control services (certain specified metering services).

Each of these classifications of service is subject to separate regulatory determinations by the AER.

SA Power Networks 25 standard control services tariffs have been grouped into four tariff classes. This grouping is illustrated below.

SA Power Networks standard control services tariff classes

Type 1-4 meter Monthly billing	Type 5,6 meter		Type 7 (unmetered)
	Monthly billing	Quarterly billing	Monthly billing
Major business (11, 33, 66 kV) kVA demand (locational TUoS) kVA demand (loc'l TUoS) >10MW kVA demand Zone ZVS			
High voltage business (11 kV) kVA demand VHVS kVA demand VHLVS (<1000kVA) 2 rate B2R124HV			
Low voltage business kVA demand VLVS 2 rate B2R124	2 rate MB2R	2 rate QB2R	LVUU LVUU24 OUU
Low voltage residential MRSRI With cont. load MRSRCLI	MRSR With cont. load MRSROPCL	QRSR With cont. load QRSROPCL	

SA Power Networks alternative control services tariffs have all been grouped into a single tariff class. This arrangement is illustrated below.

SA Power Networks alternative control services tariff classes

Metering services tariff class
Meter provision type 6 DCC
Meter provision type 6 CTC
Meter provision Type 1–4 Exceptional
Meter service other meter provider customer
Meter service exit fee type 6 CTC
Meter service exit fee type 1–4

3.2 Assignment of new customers to a tariff class

Upon receipt of an Application for Connection/Alteration and Removal of Supply ([Form A](#)) for the provision of a new or altered network connection⁶, the SA Power Networks Project Officer responsible for managing the Application for Connection will determine the tariff and tariff class to be applied to the new or upgraded customer connection.

The tariff and tariff class to be assigned, or reassigned, to a customer will be chosen by the Project Officer in accordance with the requirements set out in Sections 4 and 5 of this Network Tariff & Negotiated Services manual. This tariff and tariff class assignment takes into account one or more of the following factors⁷:

- Customers with similar connection and usage profiles are treated equally; and
- Customers that have micro-generation facilities are not treated less favourably than customers with similar load profiles without such facilities.

⁶ Form A is available at: www.sapowernetworks.com.au/centric/contractors_and_designers/contractor_forms_and_guides.jsp

⁷ In the event that a future regulatory obligation requires remotely-read interval metering or other similar metering technology to be installed at the customer's premises, this procedure may be modified.

Customer notification of tariff class assignment

The Project Officer is responsible for notifying the retailer, customer or intending customer who lodged the Application to Connect, of the proposed network tariff and tariff class assignment. These details are to be provided together with SA Power Networks connection offer to the customer.

The connection offer will include the additional information set out in Section 3.4.

3.3 Reassignment of existing customers to another existing or a new tariff class during the next regulatory control period.

SA Power Networks Major Customer & Metering Manager is required to carry out a bi-annual review of the consumption of customer. This review is intended to identify whether:

- An existing customer's load or connection characteristics have changed, such that it is no longer appropriate for that customer to be assigned to the current tariff class; or
- A customer no longer has the same or materially similar load or connection characteristics as other customers on the customer's existing tariff class.

In the event that this review identifies customers whose tariff class is no longer appropriate, then SA Power Networks Major Customer & Metering Manager may propose to reassign that customer to another tariff class.

Customer notification of tariff class reassignment

The Major Customer & Metering Manager is responsible for notifying any customers in writing of the proposed reassignment of their network tariff. If the identity of the customer is not known, then the customer's retailer is to be notified instead.

The tariff reassignment advice will include the additional information set out in Section 3.4.

One months notice is to be provided to the customer of a proposed tariff class reassignment.

3.4 Objections to proposed tariff class assignments and reassignments

Information provided to customers concerning tariff class assignment and reassignment

Where SA Power Networks notifies customers of a tariff class assignment or reassignment in Sections 3.1 and 3.2 above, such notification will include reference to the web address from which this Tariff Manual may be obtained and also include the following advice that:

- The customer may request further information from SA Power Networks Regulatory Manager;
- The customer may object in writing to SA Power Networks Regulatory Manager concerning the proposed tariff or tariff class assignment;
- In the event that the customer is not satisfied with SA Power Networks internal resolution of such an objection, the customer may be entitled to appeal to the Energy Industry Ombudsman (South Australia); and
- In the event that an objection is not resolved to the satisfaction of the customer under SA Power Networks internal review system, then the customer is entitled to seek resolution via the dispute resolution process available under Part 10 of the NEL.

Upon receipt of a request for further information concerning a tariff class assignment or reassignment, SA Power Networks Regulatory Manager is to arrange the provision of relevant information to the customer concerning the tariff class assignment or reassignment, provided that such information is not confidential.

Internal review process of tariff class assignment and reassignment

Upon receipt of an objection by a customer to a tariff class assignment or reassignment, SA Power Networks Regulatory Manager will reconsider the relevant tariff class assignment or reassignment, having regard to the following:

- The basis of the customer's objection;
- The principles for tariff assignment and reassignment set out in clauses 6.18.3 and 6.18.4 of the Rules;
- The procedures for tariff assignment and reassignment set out in Appendix B, of the AER's Determination; and
- The process and guidelines for tariff assignment and reassignment set out in Sections 3 and 4 of this Tariff Manual.

The Regulatory Manager will notify the customer of the outcome of SA Power Networks internal review and the reasons for accepting or rejecting the customer's objection to the tariff class assignment or reassignment. The notification by the Regulatory Manager will also advise that:

- In the event that the customer is not satisfied with SA Power Networks internal resolution of such an objection, the customer may be entitled to appeal to the Energy Industry Ombudsman (South Australia); and
- In the event that an objection is not resolved to the satisfaction of the customer under the SA Power Networks internal review system, then the customer is entitled to seek resolution via the dispute resolution process available under Part 10 of the NEL.

External review of tariff class assignment and reassignment

If a customer's objection to a tariff class assignment or reassignment is upheld by a relevant external dispute resolution body, then any adjustment which needs to be made to prices will be done by SA Power Networks as part of the next annual review of prices.

4. TARIFFS

4.1 General


A customer's retail electricity bill will generally comprise the following components, although particularly for smaller customers, these components may not be separately itemised:

- Retail charges;
- NEM charges;
- Network charges; and
- Metering charges.

Retail charges cover the cost of a retailer buying energy from the national pool or directly from a generator and selling it to the customer. The retail charge is the component that a customer negotiates a pricing plan for when entering into a market contract.

The components of a customer's retail electricity bill are shown in the following illustration. With regard to metering services, certain components of the metering service may be provided by SA Power Networks, may be supplied by the retailer or may be procured directly by the customer.

Components of a retail electricity bill

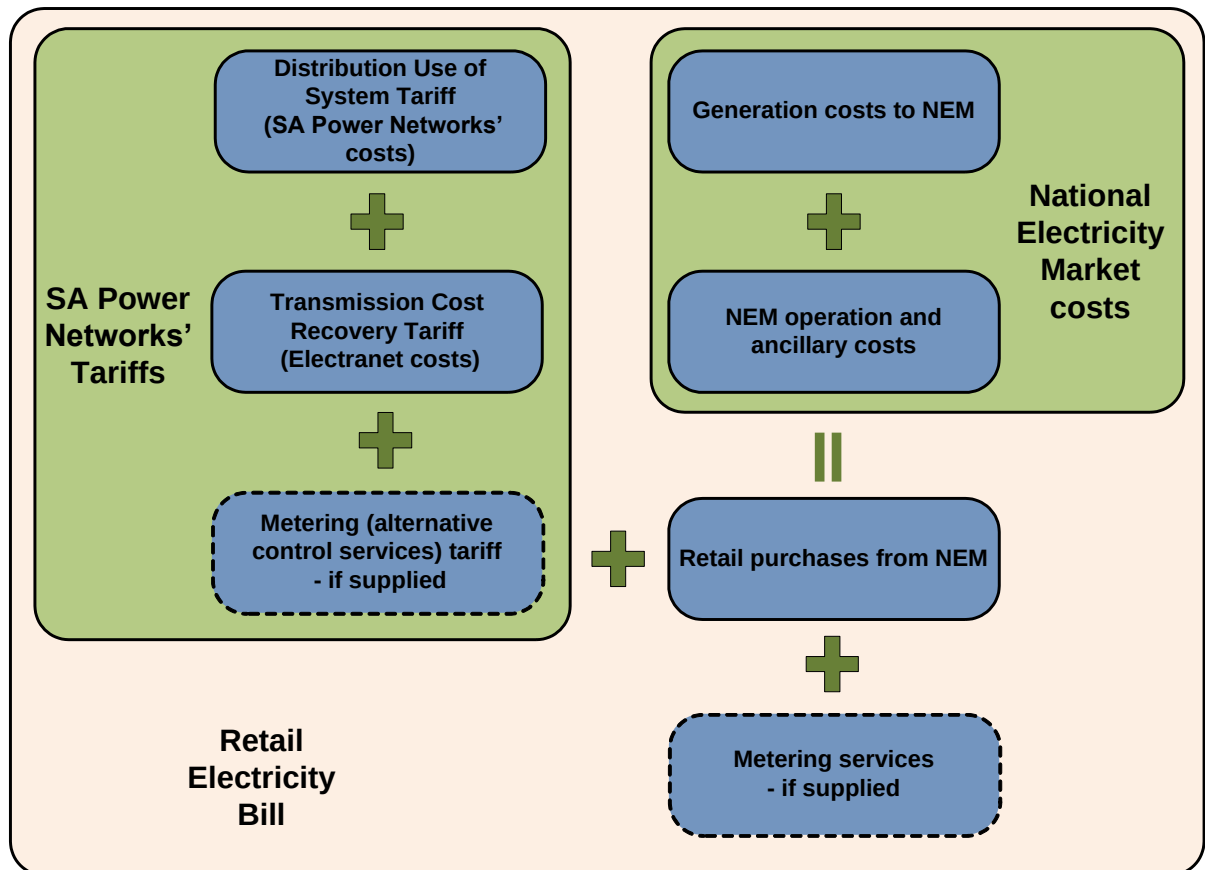

Network Tariffs are set in accordance with the requirements of:

- The Electricity Act;
- The NER; and
- The AER's Determination.

SA Power Networks is required to assign a network tariff and tariff class to each customer using the procedure set out in Appendix B of the AER's determination. In practical terms, the following factors determine the nature and extent of the customer's usage and the nature of the customer's network connection:

- Type of use (ie residential or business);
- The connection point characteristics (eg low or high voltage); and
- The maximum electrical demand.

Network tariffs include components for:

- Distribution (DUoS – Distribution Use of System);
- Transmission (TUoS – Transmission Use of System); and may also include
- Metering Services.

In some cases a network tariff is required to be assigned and in other cases the customer or retailer can elect a tariff subject to meeting eligibility criteria.

4.2 Categories

Tariffs are to be assigned subject to the requirements specified in the “Notes accompanying the Distribution Tariffs” as issued from time to time. Customers must advise SA Power Networks of their particular circumstances in order for the correct tariff(s) to be assigned (Distribution Code). For situations not specifically covered, the following general principles apply.

4.2.1 Residential Use

Residential use is electricity consumed by a Customer at a domestic dwelling and who lives in that dwelling. This may include consumption from an office located within the home so long as there is no more than one employee normally working within the dwelling. Note: For the purposes of this definition hired domestic help or carers are not to be considered employees.

Residential use can also include:

- Electricity used in outbuildings etc located on the same property as the Customers dwelling and where the primary use of the outbuilding is domestic;
- Short term accommodation provided due to the nature and location of the property eg shearing quarters (accommodation provided as term of employment); and
- Electricity used in the pumping of water for domestic use (or effluent) for a single premises of the same Customer and on the same property (or multiple premises where eligible for residential tariff – as above.

Residential use does not include:

- Boarding houses, nursing homes or accommodation of motel or bed and breakfast type ie short term accommodation or where a fee is charged for the use of facilities;
- A clearly public office or shop attached to a dwelling;
- Temporary supplies; and
- One metered connection for three or more independent (or semi independent) dwelling(s).

4.2.2 Business Use

Business use is electricity used for any purpose other than residential. This includes industrial, commercial, accommodation, hospitality and agricultural uses.

4.2.3 Combined Business/Residential Use

The customer is responsible for ensuring that facilities are provided for metering the use of electricity for each purpose. Where such facilities are impractical or not provided the distribution tariff can be assigned on the basis of majority use.

Where it is known that a connection to a dwelling is subject to dual business/residential usage (and separate metering can not be installed) then, in the absence of any detailed information, the category should be determined by the majority floor space usage of the building for which the electricity supply is provided for.

4.2.4 Controlled Load

Controlled load tariff is permitted to be used in conjunction with another tariff for specific thermal storage applications. Controlled Load tariff is available for new or existing supplies in conjunction with Residential Single Rate tariff only. Where an existing supply has some other tariff in conjunction with Controlled Load then the combination may remain as is however, if the customer seeks to change tariff or make alterations to their electrical installation (eg from BSROPLC to VLVS or shift of meter position) then they can no longer retain the OPCL component.

OPCL tariff is available for approved applications via a time switch controlled by SA Power Networks. The timing of night time availability is set in accordance with SA Power Networks requirements. If the customer requests any additional time (eg afternoon boost) then that is subject to approval from their retailer. Existing OPCL installations with afternoon boost are maintained with no change to their timing.

Where dual element system has switched OPCL supply for the bottom element and continuous OPCL supply for the top element then that arrangement can be retained as is. For new or additional OPCL installations continuous supply on OPCL tariff is no longer available only switched supply.

Approved applications of OPCL are permanently installed storage water heaters with a capacity of 125 litres or more, underfloor (slab heating), heat bank, swimming pool or spa heating. For swimming pool or spa applications only the heating element is permitted to be connected to OPCL, pumps and auxiliaries are to be on the accompanying tariff.

4.3 Network Tariffs

The network tariff is independent of any retail pricing plan, contract or tariff.

There are only a few core tariffs in each group with minor variants.

The variants allow for:

- Optional metering needs (eg type 1-5);
- Monthly/quarterly readings; and
- Combination with controlled load tariff.

The current tariffs and eligibility criteria are listed on the SA Power Networks internet and intranet sites: Please go to Section 11 for 2013/2014 Network Tariffs.

4.3.1 Residential Tariffs

Tariff Name	Tariff Description	Tariff Code
Low Voltage Residential - Single Rate	Low Voltage Residential - Single Rate - Quarterly	QRSR
	Low Voltage Residential - Single Rate Quarterly with Controlled Load	QRSROPCL
	Low Voltage Residential - Single Rate - Quarterly with Controlled Load - interval	QRSROPCLi
	Low Voltage Residential - Single Rate Quarterly interval	QRSRi
	Low Voltage Residential - Single Rate - Monthly	MRSR
	Low Voltage Residential - Single Rate – Monthly- with Controlled Load	MRSROPCL
	Low Voltage Residential - Single Rate – Monthly- with Controlled Load - interval	MRSROPCLi
	Low Voltage Residential - Single Rate Monthly interval	MRSRi
	Low Voltage Residential - Single Rate – type 1-4 meter	
	Low Voltage Residential - Single Rate – type 1-4 meter with Controlled Load	MRSRI
	Low Voltage Residential - Single Rate – type 1-4 meter with Controlled Load interval	MRSRIOPCL
	Low Voltage Residential - Single Rate – type 1-4 meter interval	MRSRIOPCLi
		MRSRli
OPCL	Controlled Load - Tariff Component	Included above

Note: A retailer may offer a residential customer a two rate contract which will require a two rate meter to be installed however, the network tariff will remain as RSR.

4.3.2 Business Tariffs – Energy Only

These tariffs are generally for business customers where the Service Capacity is <75kVA or 100 amps. They are not available to new customers with a service capacity or demand greater than 75kVA eg 100 amps. Existing customers between 75kVA or 100 amps and 250kVA connected before 1 July 2011 can remain on their existing tariff.

Not available to residential customers.

Business single rate tariffs have become obsolete tariffs only available to existing customers who remain on that tariff.

Tariff Name	Tariff Description	Tariff Codes
Obsolete tariff only available to existing customers connected before 1 July 2010 Low Voltage Business Single Rate	Low Voltage - Business - Single Rate - Quarterly	QBSR
	Low Voltage - Business - Single Rate – Quarterly with Controlled Load	QBSROPCL
	Low Voltage - Business - Single Rate – Quarterly with Controlled Load interval	QBSROPCLi
	Low Voltage - Business - Single Rate – Quarterly interval	QBSRi
	Low Voltage - Business - Single Rate - Monthly	MBSR
	Low Voltage - Business - Single Rate – Monthly with Controlled Load	MBSROPCL
	Low Voltage - Business - Single Rate – Monthly with Controlled Load - interval	BSROPCLi
	Low Voltage - Business - Single Rate – Monthly - interval	MBSRi
	Low Voltage - Business - Single Rate –Type 1 – 4 Meter	
	Low Voltage - Business - Single Rate –Type 1 – 4 Meter with Controlled Load	BSR124
	Low Voltage - Business - Single Rate –Type 1 – 4 Meter with Controlled Load - interval	BSR124OPCL
	Low Voltage - Business - Single Rate –Type 1 – 4 Meter - interval	BSR124OPCi
		BSR124i

Tariff Name	Tariff Description	Tariff Codes
Low Voltage Business - 2 Rate	Low Voltage Business - 2 Rate - Quarterly	QB2R
	Low Voltage Business - 2 Rate – Quarterly with Controlled Load	<i>QB2ROPCL *</i>
	Low Voltage Business - 2 Rate – Quarterly with Controlled Load - interval	<i>QB2ROPCLi *</i>
	Low Voltage Business - 2 Rate – Quarterly - interval	QB2Ri
	Low Voltage Business - 2 Rate - Monthly	MB2R
	Low Voltage Business - 2 Rate – Monthly with Controlled Load	<i>MB2ROPCL *</i>
	Low Voltage Business - 2 Rate – Monthly - interval	MB2Ri
	Low Voltage Business - 2 Rate Type 1-4 Meter	B2R124
	Low Voltage Business - 2 Rate Type 1-4 Meter with Controlled Load	<i>B2R124OPCL *</i>
	Low Voltage Business - 2 Rate Type 1-4 Meter with Controlled Load - interval	<i>B2R124OPCLi *</i>
	Low Voltage Business - 2 Rate Type 1-4 Meter - interval	B2R124i
	Low Voltage Business - 2 Rate Type 1-4 Meter - interval	B2R124N
Controlled Load - Tariff Component	Included above (subject to qualification	OPCL

* These combinations are only available to existing customers taking supply under this tariff arrangement prior to 30 June 2003.

Tariff Name	Tariff Description	Tariff Code
High Voltage Business - Two Rate	High Voltage Business - Two Rate	B2R124H
	High Voltage Business - Two Rate - interval	B2R124Hi

4.3.3 Business Tariffs – Demand

These tariffs are for customers with a Service Capacity or an Agreed Maximum Demand > 75kVA or 100 amps. Customers on business two rate tariff connected at 30 June 2011 with a demand less than 250kVA will also be able to remain on the business two rate tariff conditional that if the customer seeks to change tariff or make alterations to their electrical installation (eg Solar installed requiring an embedded generation tariff or a shift of meter position).

These tariffs all require a Type 1-3 meter, or a Type 4 or Type 5 meter with kV Ar functionality.

The setting of the agreed demand is a very important part of the tariff as this then becomes a contractual agreement with the customer for the capacity in kVA that is available to the NMI. The customer can negotiate changes to this agreed demand or capacity and there are processes for these requests. SA Power Networks Network Customer Manager or Customer Solutions need to be part of these negotiations.

If a customer requests a reduction in demand then they need to apply in writing and if their demand increases within 12 months of the change, then SA Power Networks will back date the increased demand network charges to the date of the reduction. If the customer increases demand beyond 12 month from the requested reduction in demand then normal processes will be followed and all charges and rebates will be applied.

If the customer wishes to increase their agreed demand or they breach their existing agreed demand, the customer manager will consult with Customer Solutions who will provide an offer letter with all applicable charges for the customer.

Tariff Name	Tariff Description	Tariff Code
Low Voltage Stepped Demand KVA	Low Voltage Stepped Demand KVA	VLVS
	Low Voltage Stepped Demand KVA - interval	VLVSi
	Low Voltage Stepped Demand KVA - interval	VLVSN
High Voltage - Stepped Demand KVA	High Voltage - Stepped Demand KVA < 1,000KVA	VHLVS
	High Voltage - Stepped Demand KVA < 1,000KVA - interval	VHLVSi
	High Voltage - Stepped Demand KVA	VHVS
	High Voltage - Stepped Demand KVA - interval	VHVSi
	High Voltage - Stepped Demand KVA - interval	VHVSN
Zone Sub-station (KVA)	Zone Sub-station (KVA) (load<10MW and consumption <40GWh pa)	VZS
	Zone Sub-station (KVA) (load<10MW and consumption <40GWh pa) - interval	VZSi
	Zone Sub-station (KVA) with locational transmission charges (the NMI numbers are shown on these tariffs)	VZSN
Sub Transmission (KVA)	Sub Transmission (KVA) with locational transmission charges (the NMI numbers are shown on these tariffs)	VSTN
High Voltage Obsolete (KVA)	High Voltage Obsolete (KVA)	VHVO*
	High Voltage Obsolete (KVA) - interval	VHVOi*

Note:

- There are a few variants used in the billing process to allow for some legacy situations without adversely affecting the customer.
- For connections with very large usage where individual transmission charges apply XXX is replaced with the last three digits of the specific NMI.

Demand and Energy Time Periods

Annual Demand Period 12:00pm to 8:00pm on working days between December to March
December to March

	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday	Sunday
1:00							
2:00							
3:00							
4:00							
5:00							
6:00							
7:00							
8:00							
9:00							
10:00							
11:00							
12:00							
13:00							
14:00							
15:00							
16:00							
17:00							
18:00							
19:00							
20:00							
21:00							
22:00							
23:00							
0:00							

Except on Public Holiday

Additional Demand is the difference between the Anytime Demand and the Annual Demand only when the result is positive
ie where the the Anytime Demand is greater than the Annual Demand

Additional Demand = Anytime Demand - Annual Demand

Example

Annual Demand = 157 kVA

Anytime Demand = 170 kVA

Additional Demand = 170 - 157 = 13 kVA

Peak Energy 7:00am to 9:00pm during working days

	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday	Sunday
1:00							
2:00							
3:00							
4:00							
5:00							
6:00							
7:00							
8:00							
9:00							
10:00							
11:00							
12:00							
13:00							
14:00							
15:00							
16:00							
17:00							
18:00							
19:00							
20:00							
21:00							
22:00							
23:00							
0:00							

These time periods are based on SA Power Networks tariffs effective 1 July 2012

v1.2

4.3.4 Solar Generation Tariffs

SA Power Networks is obliged by the provisions of the Electricity (Feed-in Scheme – Solar Systems) Amendment Act to provide a credit in accordance with the Electricity Act requirements for each kWh for power fed back into the grid. The system shall only measure export when the PV system output exceeds the instantaneous load requirements of the customers' load at the installation (Net metering).

General Requirements

- Customer needs to qualify for small market status (less than 160MWh per annum).
- Customer to first enter into a Small Embedded Generator Agreement with SA Power Networks.
- Customer using an 'approved' inverter supplied via a solar panel array.
- Have an approved import / export meter.
- No other generation connected to the export meter.

Note:

- This includes both residential and business customers.
- Business customers on an energy only business tariff with a capacity >75kVA or 100 amps will be shifted to a demand tariff as this is the applicable tariff for a customer with this capacity.

Tariff Name	Tariff Description	Tariff Code
Solar Co - Gen	Solar Co Generation	GENR GENR2028 GENR2028S GENR2016
	Solar Co Generation - interval	GENRi GENR2028i GENR2028Si GENR2016i
Zero Rate Solar Co Gen	Zero Rate Solar Co Gen	ZGENR
	Zero Rate Solar Co Gen - interval	ZGENRi

Government Feed-in Tariff as per Electricity Act

Tariff Name	Tariff Rebate Description
GENR2028	The original Scheme which closed to new applicants in August 2010. The Scheme requires payments to qualifying generators of 44 cents per kWh for all export until 20 June 2028.
GENR2028S	The Scheme announced by the Government in August 2012, for all subsequent qualifying applications and installations till September 2011. The Scheme requires payments to qualifying generators of 44 cents per kWh for all export until 30 June 2028, up to a daily export of 45kWh.
GENR2016	The Scheme introduced by the Government during 2011 for all subsequent qualifying applications and installations from October 2011. The Scheme requires payments to qualifying generators of 16 cents per kWh for all export until 30 June 2016, up to a daily export of 45kWh.

4.3.5 Un-metered

The default supply is metered. Only where a load is too small (<5 amps) to register on a meter or where metering would be impractical, may a customer apply to have the load connected as un-metered. SA Power Networks is not under any obligation to accept an un-metered load until its suitability is established. In considering the suitability of a load for un-metered tariff SA Power Networks must be satisfied that the electrical usage can be accurately estimated and that the load will not vary.

General requirements

- Load to be located in a accessible public area (to permit inspection and validation);
- Load limiting circuit break with provision for SA Power Networks seal must be provided and the circuit breaker is to be set at the load level being requested eg 0.5 amps;
- Loads must be hard wired. Socket outlets are not permitted (unless specifically authorised by the responsible SA Power Networks manager for that specific application);
- The connected equipment must not be changed or altered without prior written notice to, and acceptance from SA Power Networks (other than repair or replace like for like ie same electrical ratings);
- The characteristics, timing or programming of the load must not be altered without prior written notice to and acceptance by SA Power Networks; and
- Equipment specifications, inventory tables and test results must be provided prior to a load being considered for connection.

There are many variants used in the billing process which primarily identify the type of un-metered load and the electrical rating. Irrespective of the billing tariff used the network (energy delivery) component is based on one of the two tariffs below. The billing tariff may include additional consideration for excluded services such as lamp replacement (CLER lighting).

Generic Tariff	Tariff Name
LVUU	Low Voltage Un-Metered Usage (Overnight Usage)
LVUUi	Low Voltage Un-Metered Usage (Overnight Usage) - interval
LVUU24	Low Voltage Un-Metered Usage (24 Hour Usage)
LVUU24i	Low Voltage Un-Metered Usage (24 Hour Usage) - interval

Type 7 Loads

Unmetered loads are described as having “Type 7” metering in the Rules and their consumption is estimated for the purposes of market settlements.

Approved Type 7 loads are contestable in the NEM ie choice of retailer. Type 7 load tables are published on AEMO’s website at <http://www.aemo.com.au/electricityops/640-0138.html>. The current approved Type 7 loads include loads of the following types:

- **Street lighting** – Where SA Power Networks owns and maintains the light fittings. The lighting is installed by SA Power Networks on SA Power Networks poles for illumination of public roads. This category also includes lighting standards installed to SA Power Networks specifications in URDs;
- **CLER** (Customer Lantern Equipment Rate) – Lighting for public areas where the customer (Council) own the luminaire and SA Power Networks has the responsibility for changing globes only;
- **Energy only** – Where the Council / Customer own the fitting and are responsible for all maintenance;
- Traffic signals; and
- **Traffic signalling equipment** – of a type specified in the approved Type 7 load tables.

The approval of a Type 7 load is dependent on the assessment of the load characteristics as well as the processes used to maintain an inventory of the loads. Consequently, only loads of types in the published load tables and belonging to Transport SA, Adelaide City Council or SA Power Networks are suitable for acceptance as a Type 7 load. The TUoS and DUoS charges are levied in accordance with the published network tariffs however, street lighting and CLER both require an additional component for provision of excluded services (eg lamp replacement with CLER) – the pricing for these services is termed negotiated and is described in Section 9 of this manual.

Other Un-Metered Loads

Other un-metered loads are not Type 7. These other loads include:

- Night sight lighting;
- Phone booths;
- Telstra CMUX; and
- Bus shelters.

These can only be with the Tier 1 retailer (AGL in SA). These loads all require individual consideration by the responsible SA Power Networks manager. There are many system codes used in CIS-OV as ‘tariffs’ – these are not separate tariffs as such rather just the above tariffs calculated as a fixed charge based on a load type. For the current list of system codes for un-metered loads refer to Revenue Management Group.

These un-metered loads may become contestable (as Type 7) at the request of the customer. This will require the development of load tables to meet the requirements of a type 7.

5. METERING


5.1 Market Types

Type	Description	Min Data Type As per NER	Provision
Type 1	Remotely read interval meter	Interval kWh & kVArh	Contestable
Type 2	Remotely read interval meter	Interval kWh & kVArh	Contestable
Type 3	Remotely read interval meter	Interval kWh & kVArh	Contestable
Type 4	Remotely read interval meter	Interval kWh	Contestable
Type 5R	Remotely read interval meter	Interval kWh	SA Power Networks Only
Type 5M	Manually read interval meter	Interval kWh	SA Power Networks Only
Type 6	Manually read basic meter	Basic kWh	SA Power Networks Only
Type 7	Virtual interval meter	Calculated Interval kWh	N/A
UMS*	Virtual basic meter	Calculated Basic kWh	N/A

* not actually a NEM meter type but listed to illustrate difference to type 7.

ie Type 1 is the highest class and Type 6 is the lowest class of meter.

5.2 Terminology

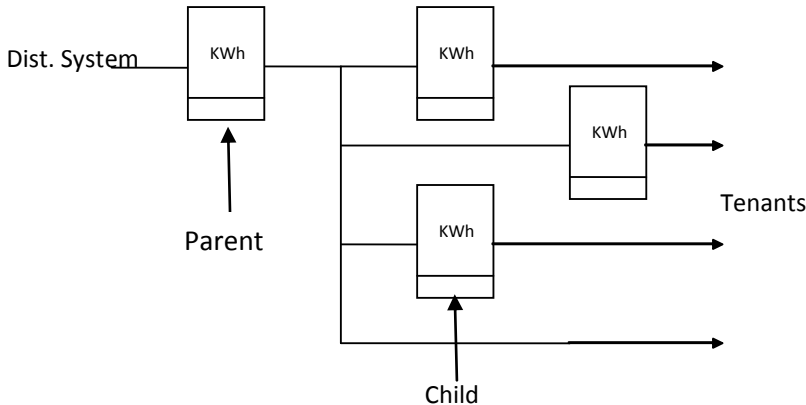Term	Description
Advanced	Electronic metering where additional functionality is provided. This may provide a user interface with additional information regarding daily use, peak usage, graphs, CO2 etc
Basic	A meter which records the usage as a cumulative total (like an odometer). May be single or two rate, may be rotating disc or electronic
Bulk Meter	Sometimes used to refer to as a parent meter in other cases the term is used in respect of a high voltage metering installation.
Child Meter	Where the meter is downstream of a parent meter. ie where electricity is resold eg larger shopping centres, caravan parks etc 

Term	Description
Combination Meter	A single meter which can separately meter several tariffs. Eg an EMS meter which is used for residential tariff and controlled load tariff.
CT Meter	Current Transformer (CT) connected metering is where the load current is too large to be practically passed through a whole current meter (ie where the load is greater than 100Amps). The load current is passed through Current transformers and the output current from the transformers is metered. The metered current is substantially smaller than the load current and its relationship is determined by the transformer ratio which is used to determine the K factor or multiplier.
Direct	A parent meter. Note: some may use the term to refer to whole current meters.
Electronic Meter	A meter where the current flow is measured by means of an electronic device with the reading or consumption data stored in electronic memory. May be Basic or Interval.
Import / Export	A meter which will record imported and exported energy in separate registers. As required for grid connected generators where a retailer buys the surplus energy generated by the customer.
Interval	A meter which records the usage in half hour intervals. This enables demand measurement and load profiles. Note – some meters use 15 minute intervals.
Master Meter	Refer parent meter.
Multi Phase	Where the meter can record the usage for the load on two or three active conductors.
Parent Meter	Where the meter is the first meter downstream from the distribution network.
PV metering	Is Import/ export metering.
Register	A set of dials, a counter or electronic memory used to store consumption data.
Rotating Disc Meter	A meter where the load current runs through a coil. This generates a magnetic field which drives a rotating disc at a speed proportional to the current flow. The disk drives a set of dials which records the total electricity used. These are Basic meters.
Single Phase	Where the meter records the usage for the load on one active conductor.
Single Rate Meter	A single register basic meter.
Smart	Not a defined term in the NEM. Market participants tend to use the term for Type 1-4 metering while media and residential customers generally use the term to refer to advanced metering.
Sub Meter	A Child meter.
Three Phase	Where the meter can record the usage for load on three active conductors.
Two Rate	A two register basic meter where the usage is recorded on a peak register at peak tariff times and the off-peak register during off- peak tariff times.
Whole Current	A meter where the entire load current runs though the meter.

5.3 Regulated / Excluded / Contestable Meter Provision

Types of metering

The different specifications of metering that are established in the NEM are provided as follows:

- **Type 1-4 metering** is a contestable service;
- **Type 5 metering** can only be provided by SA Power Networks as a negotiated service; and
- **Type 6 metering** can only be provided by SA Power Networks as a regulated (alternative control) service. Where a customer requests extra functionality eg advanced metering, that becomes a negotiated service).

Default fees for negotiated services are contained in Section 9 of this manual.

Responsibilities


In the National Market the retailer can be responsible for the metering or request that the distributor be 'responsible person'.

The 'responsible person' (RP) commissions a registered meter provider to install the appropriate class of metering. The 'responsible person' also is charged with ensuring that metering installation is maintained to the standards required by the NER.

The Meter Provider is essentially an accredited metering contractor who undertakes the installation, maintenance and testing of the metering installation.

Refer to Section 3.7 for Child metering responsibilities.

Metering Responsibility / Choices

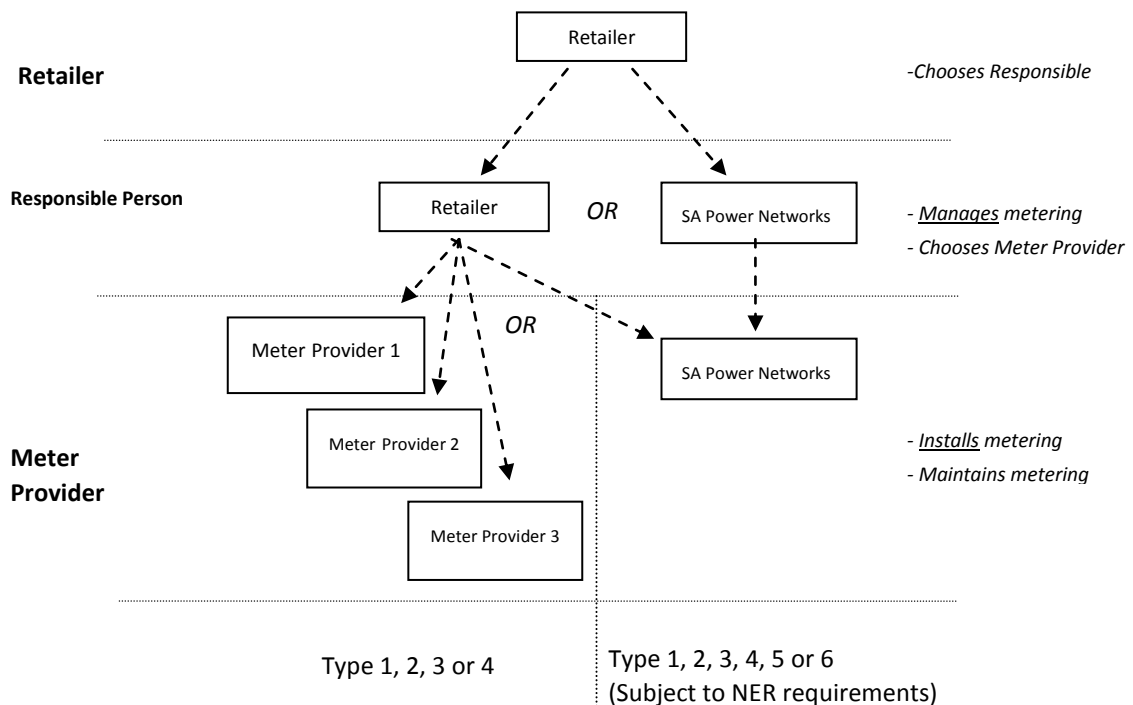

Note: Metering services group contract as installers (only) to some of the other meter providers.

5.4 NER Metering Requirements

The NER requires different accuracy classes for specified energy throughputs. The code also requires a Type 1-4 for all Tier 2 connections where the energy throughput is greater than 160MWh pa (160,000 kWh).

- An interval meter must not be replaced with a basic meter.
- The correct metering is determined on a case by case basis for each NMI.
- All metering at a NMI must be of the same type.

Tier 1 (Retailer AGL)

Energy Use	Minimum Meter Type	Installed By	Type Description	Alternative Types
>= 100GWh pa	Type 2	Contestable	Remotely read interval meter	1, 2
750MWh to 100GWh pa	Type 3	Contestable	Remotely read interval meter	1, 2
160 to 750MWh pa	Type 5M	SA Power Networks	Manually read interval meter	1, 2, 3, 4, 5R
0 to 750MWh pa	Type 6	SA Power Networks	Manually read accumulation (basic)	1, 2, 3, 4, 5R, 5M

Tier 2 (Retailer NOT AGL)

Energy Use	Minimum Meter Type	Installed By	Type Description	Alternative Types
>= 100GWh pa	Type 2	Contestable	Remotely read interval meter	1, 2
750MWh to 100GWh pa	Type 3	Contestable	Remotely read interval meter	1, 2
160 to 750MWh pa	Type 4	Contestable	Remotely read interval meter	1, 2, 3
0 to 160MWh pa	Type 5M	SA Power Networks	Manually read interval meter	1, 2, 3, 4, 5R
0 to 160MWh pa	Type 6	SA Power Networks	Manually read accumulation (basic)	1, 2, 3, 4, 5R, 5M

5.5 Metering for Tariff Requirements

Basic meters need to have the right register configuration to capture usage data applicable to each tariff rate.

With interval meters the data is collected as a 'table' and processed into individual rate periods or demand values in the various billing systems.

Tariff	Min Meter requirement	Acceptable Alternative Type
RSR	Type 6 with Single Register	Types 1, 2, 3, 4, 5R, 5M
BSR (obsolete)	Type 6 with Single Register	Types 1, 2, 3, 4, 5R, 5M
B2R	Type 6 with Two Registers	Types 1, 2, 3, 4, 5R, 5M
OPCL	As per associated tariff	
Any kVA based demand tariffs	Type 4 or 5 with additional kVAr functionality	or Types 1,2, 3
Any kW based demand tariff eg WLV (obsolete)	Type 4 or 5 with additional kVAr functionality	Types 1, 2, 3

5.6 Parent / Child Metering

In some situation (eg shopping centres) the end user purchases electricity from their landlord. This is usually done via a private child meter. Subject to regulatory requirements these end users can buy electricity from a retailer of choice.

Where the end user elects to contract to a retailer of choice their retailer will need to engage an authorised meter provider to install the suitable type of market metering. SA Power Networks connection and metering processes are for direct connection of customers to the distribution network and are not suitable for child metering purposes. Please note that network charges are only billed to the parent meters retailer and therefore the parent (landlord) will recover these charges from the child metered tenancies.

SA Power Networks does not manage connections or metering for child NMIs.

Customers seeking advice in relation the child metering and their rights should be referred to web sit of The Essential Services Commission of SA for a copy of the 'Advisory Bulletin 1: Electricity Reselling'.

Where a service order is received in relation to child metering then a Network Customer Manager must be consulted.

Child metering must not be installed by SA Power Networks staff without specific authorisation from a Network Customer Manager.

5.7 Meter Reading

Tariff	Min Meter requirement	Acceptable Alternative Type	Reading frequency	Billed
RSR	Type 6 with Single Register	Types 1, 2, 3, 4, 5R, 5M	90 days for type 5 & 6 Daily read for all other types	Generally quarterly billed
BSR	Type 6 with Single Register	Types 1, 2, 3, 4, 5R, 5M	Type 1 to 4 are read daily and type 5 & 6 can be read monthly or quarterly 90 days	Generally quarterly but larger sites can be monthly
B2R	Type 6 with Two Registers	Types 1, 2, 3, 4, 5R, 5M	Type 1 to 4 are read daily and type 5 & 6 can be read monthly or quarterly 90 days	Generally quarterly but larger sites can be monthly
OPCL	As per associated tariff		quarterly 90 days for type 5 & 6	Generally quarterly but larger sites can be monthly
Any kVA based demand tariffs	Type 4 or 5 with additional kVA functionality	or Types 1, 2, 3	Type 1 to 4 are read daily and type 5 can be read monthly or quarterly 90 days	monthly
Any kW based demand tariff eg WLV (obsolete)	Type 4 or 5 with additional kVA functionality	Types 1, 2, 3	Type 1 to 4 are read daily and type 5 can be read monthly or quarterly 90 days	monthly

6. NMIS

6.1 Background

Under the NER SA Power Networks is required to assign a 'National Metering Identified' (NMI) to each customer connection point. The NMI is the common identifier for the supply address, metering installation and account for each customer's supplies.

SA Power Networks registers its customers' NMIs and the relevant standing data in AEMO's MSATS (Market Settlement and Transfers System) which enables retailers and other market participants to obtain information about the NMIs for which they are responsible and thus undertake their responsibilities.

Information registered in MSATS includes:

- NMI;
- Address;
- Network Tariff;
- Distribution Loss Factor;
- Marginal Loss Factor;
- Market roles for the NMI ie:
 - Retailer (FRMP);
 - Responsible Person (RP);
 - Distributor (LNSP);
 - Meter Provider (MPB); and
 - Data Provider (MDP, MPC).

6.2 NER Requirements

The NMI is assigned to the unique combination of connection point (to distribution system) and customer premises. Should the connection point be changed eg through upgrade then a new NMI is required.

The NMI remains with the installation as long as the metering and tenancy relationships remain in the initial configuration.

If a single tenancy is split into two each with individual direct meters, then new NMIs are required similarly when a supply is withdrawn (demolition) the NMI is retired permanently.

6.3 Allocation Process

A NMI is to be assigned to each individual connect/customer/tenancy combination.

Examples

Example & Tariff	No of connection Points	No of (direct) meters	No of customers / tenancies	No of NMIs	Notes
Single house RSR	1	1	1	1	
Single house RSROPCL	1	2 (1 RSR & 1 OPCL)	1	1	
House and granny flat RSROPCL x1	1	2 (1 RSR & 1 OPCL)	1	1	Not separately metered
House and granny flat RSROPCL x 2	1	4 (2 RSR & 2 OPCL)	2	2	Separately metered
High rise 50 x RSR 6 x B2R 1 x BSR	1	57	57	57	
House with 3 EMS RSROPCL x1	1	3	1	1	Combination meters for underfloor heating
5 Factory units supplied from 1 padmount transformer	1	5	5	5	

6.4 NMIs and Meter Grouping

Metering that can be grouped (or consolidated) on an individual NMI on application.

- Where it is known that the usage of a series of meters relates to common area usage (eg communal lighting) and all meters have the same point of connection to SA Power Networks distribution system.
- Metering located in the same meter box relating to one commercial or residential premise that was installed for old lighting and power tariffs (prior to 1970).
- Where SA Power Networks agrees to provide alternative metering arrangements for an individual premises (eg 3 x EMS for underfloor heating or Import/Export for photo voltaic) and the meters are connected to the same connection point).

Note: Controlled Load metering will always be associated with another meter. It shall be grouped with the meter that relates to the same customer and tenancy or outbuilding.


Grouping cannot be performed where:

- The premises are tenancies within a commercial office/retail complex;
- The metering relates to a number of individual independent residential premises;
- It is likely that changes in tenancies may occur;
- The retailers are different; and
- The metering types are different.

Where grouping cannot be undertaken the customer can however engage an electrical contractor (to transfer load) in order to reduce the number of metering points required.


The following example illustrates meter consolidation. Communal lighting meters in meter boxes A and B may be grouped as they relate to same connection point. Metering for tenancies 2 and 3 (each individually metered) can not be grouped due to the transient nature of the occupancies. The customer may undertake physical consolidation with the assistance of an electrician to transfer load to one meter with the subsequent removal of the redundant meter by SA Power Networks (or meter provider).

eg Retail or office complex

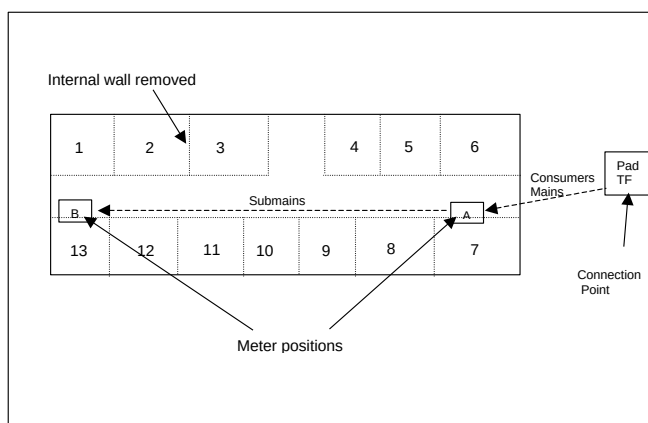

Where multiple meters relate to multiple tenancies or dwellings the metering must be assigned to separate NMIs; as explained by the following diagram:

eg Multiple residential

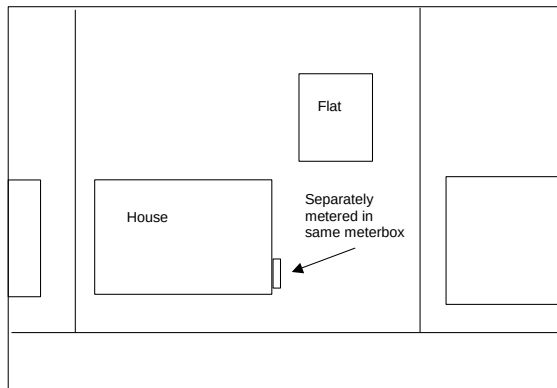

Note: The above arrangements must be in accordance with the Service & Installation Rules.

6.5 NMIs and Connections

Where connection work is undertaken the NMI allocation is likely to be affected.

6.5.1 Upgrades

Where an installation undergoes an upgrade the original NMI may remain where:

- The connection point location remains the same;
- The original supply is disconnected before the replacement is connected;
- There is no substantial change in the connection point characteristics.

Some examples of this would be:

- For an upgrade from 45 Amps to 63 Amps from the same pole; or
- A change of tariff and/or metering only (eg from single rate to two rate).

Slow Changeover

This is where a connection project involves the connection of the new supply while the original supply remains connected. By doing this the electrical contractor can transfer the customers circuits to the new supply one at a time and minimise the disruption to the customers business. Where this occurs a new NMI must be issued for the replacement supply and the original NMI will be discontinued when the original supply is disconnected.

In all other cases a new NMI is required. For example:

- Change from street service to padmount transformer service;
- Change from low voltage supply to high voltage; and
- Where a parent / child network is converted to direct metering.

6.5.2 New Supply

In all cases a new NMI is required.

Note: For Dual and back up supplies individual consideration for compliance with AEMO's NMI Allocation Procedure.

7. PROCESS

The tariff and metering is assigned to a NMI with unique consideration for the characteristics at the NMI. These characteristics are:

- Estimated or measured maximum demand;
- Estimated or actual annual energy throughput;
- Retailer (Tier 1 or 2);
- Physical configuration of the connection point;
- Changes to the connection point configuration;
- Existing tariff;
- Existing metering;
- Meter provider;
- Retailer / customer choice; and
- Type of installation.

7.1 General Principles

NMIs

For purposes of tariffs and metering selection a new supply will be referred to as 'New NMI'. For an alteration a decision has to be made as to whether the altered or replacement connection is to be considered as a 'New NMI' or as an altered NMI.

Metering

An interval meter must not be replaced with basic meter (SA Metering Code).

All meters for a NMI must be the same type (ie Type 6, Type 5, or Type 1-4).

All newly installed interval meters are charged to the customer via the normal periodic bill (via retailer).

The responsibility for metering is determined by market rules on a connection by connection basis.

Where SA Power Networks is not the meter provider a type 1-4 meter will be installed by the other provider.

A tier 2 (Non AGL) connection with estimated or actual energy use >160MWh pa requires type 1-4 meter (NER).

SA Power Networks Metering Charges

Type	Description	Required for Tier 1 (AGL)	Required for Tier 2 (non AGL)	Typical Cost to Customer Refer to Default Fees in Section 9 of this manual
1-4	Remotely read interval meter	Demand >250kVA	Demand >250 kVA OR Usage >160MWh pa	
5	Manually read interval meter	Demand <250 kVA	Usage <160MWh pa	
6	Basic, Accumulation meter	Demand <250 kVA	Usage <160MWh pa	Install* \$0 Annual \$0

**Note: charges apply for additional functions eg import / export, replace rotating disc with electronic for customer convenience, temporary supplies, pulse output etc – refer Pricing Reference Manual.*

Tariffs

A demand tariff requires a type 1-4 or type 5 meter.

A business NMI with a demand greater than 75kVA or 100 amps requires a demand tariff.

For new supplies controlled load tariff is only permitted with a residential tariff. For existing supplies the addition of controlled load tariff is only permitted with RSR.

7.2 Process**Residential Customer**

For residential installations the tariff will be RSR with or without the OPCL option.

The meter type will be the highest class of what is currently installed and what is requested. (Highest is type 1-4, lowest is type 6).

For all single residential installations a type 6 meter is adequate, but if the residential customer has a capacity >100amps and has a CT metered installation, then type 5 meter is required unless a higher class of meter is either already installed or requested.

Where the retailer requests a Two Rate meter, the meter (type 5) can be provided (charges apply), however, the Network Tariff will remain as RSR (Network tariffs must be applied as per the rules while retailers are free to offer 'flexible' plans – the meter must be able to adequately capture the data to satisfy both pricing requirements).

Non Residential Customer

ie commercial, rural, industrial, accommodation etc.

Steps

1. Determine whether the project will require a new NMI, Section 5.2.1.
2. For non residential refer to the relevant flowchart to select meter type and tariff class:
 - New NMI 5.2.2.
 - Existing NMI 5.2.3.
3. If demand tariff is required then refer to section 5.2.4 for tariff selection.


For any new or upgraded CT metered non residential installation, the minimum class of metering required is type 5.

Multiple Customers

For multiple customer supply (ie where each tenant contracts directly to their own chosen retailer) the metering and tariff requirements are determined individually for each particular tenancy / metering point / NMI.

The estimated demand and energy figures in 5.2.2 and 5.2.3 refer to the estimates for each separately metered tenancy and not the total aggregate supply.

7.2.1 NMI Allocation Check List for Upgrades

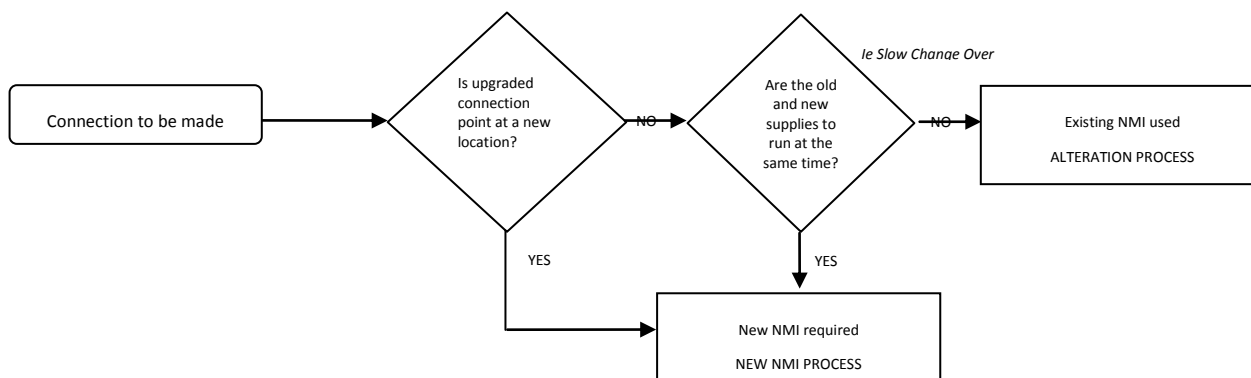

Specific Examples

If any of the criteria are met with a resulting action of “New NMI required” then that is the required action.


Criteria	Description	NMI Action	Example
New Connection Point	A new supply at a new site.	New NMI required	New padmount
Additional Connection Point	An additional supply at a different or adjacent location on an existing site.	New NMI required *	New padmount to independently feed additional building on industrial site.
New connection point location	Where the connection point is relocated to a different pole or pit.	New NMI required	PLEC, Service relocation, upgrade from street feed to pad mount supply
Slow Changeover - Additional or replacement connection	Existing and new supplies run simultaneously throughout a portion of the changeover period	New NMI required *	Upgrade where continuous supply is maintained.
Whole Current to Whole Current (meter relocation)	Meter relocated to new location/enclosure	No Change	Domestic meter relocation (inside to outside)
Whole Current to CT Metered	Increase in load	No Change	Upgrade of installation (same connection point used)
CT to Whole current	Reduction in load	No Change	Downgrade of installation (same connection point used)
CT Ratio Change	Increase in load	No Change	Transformer ‘swap’ (same pad)

Criteria	Description	NMI Action	Example
Relocate CTs	Physical location of CTs altered	New NMI required	Relocation of switchboard
Consolidation of meters	Removal of surplus meters (where already grouped on one NMI)	No Change	Consolidation of meters or surplus tariff
Additional Meter with no change in use type ** (ie no change between business and residential)	Addition of meter for tariff not previously on NMI or Addition of meter due to supply/ tariff requirements	No Change	J Add, Or 3x EMS for underfloor or PV import metering
Additional Meter	New tenancy within existing installation.	New NMI required	Multistorey offices - portion of floor redistributed to new tenant Shop subdivided into 2
Upgrade consumers mains	Replacement for maintenance or increase in load	No change	Replacement of damaged consumer's mains.


** Refer to Network Customer Manager for case by case decision for supplies where the existing NMI has multiple meters.*

*** Subject to tariff eligibility criteria.*

7.2.2 Meter Selection for New NMIs (Non Residential)

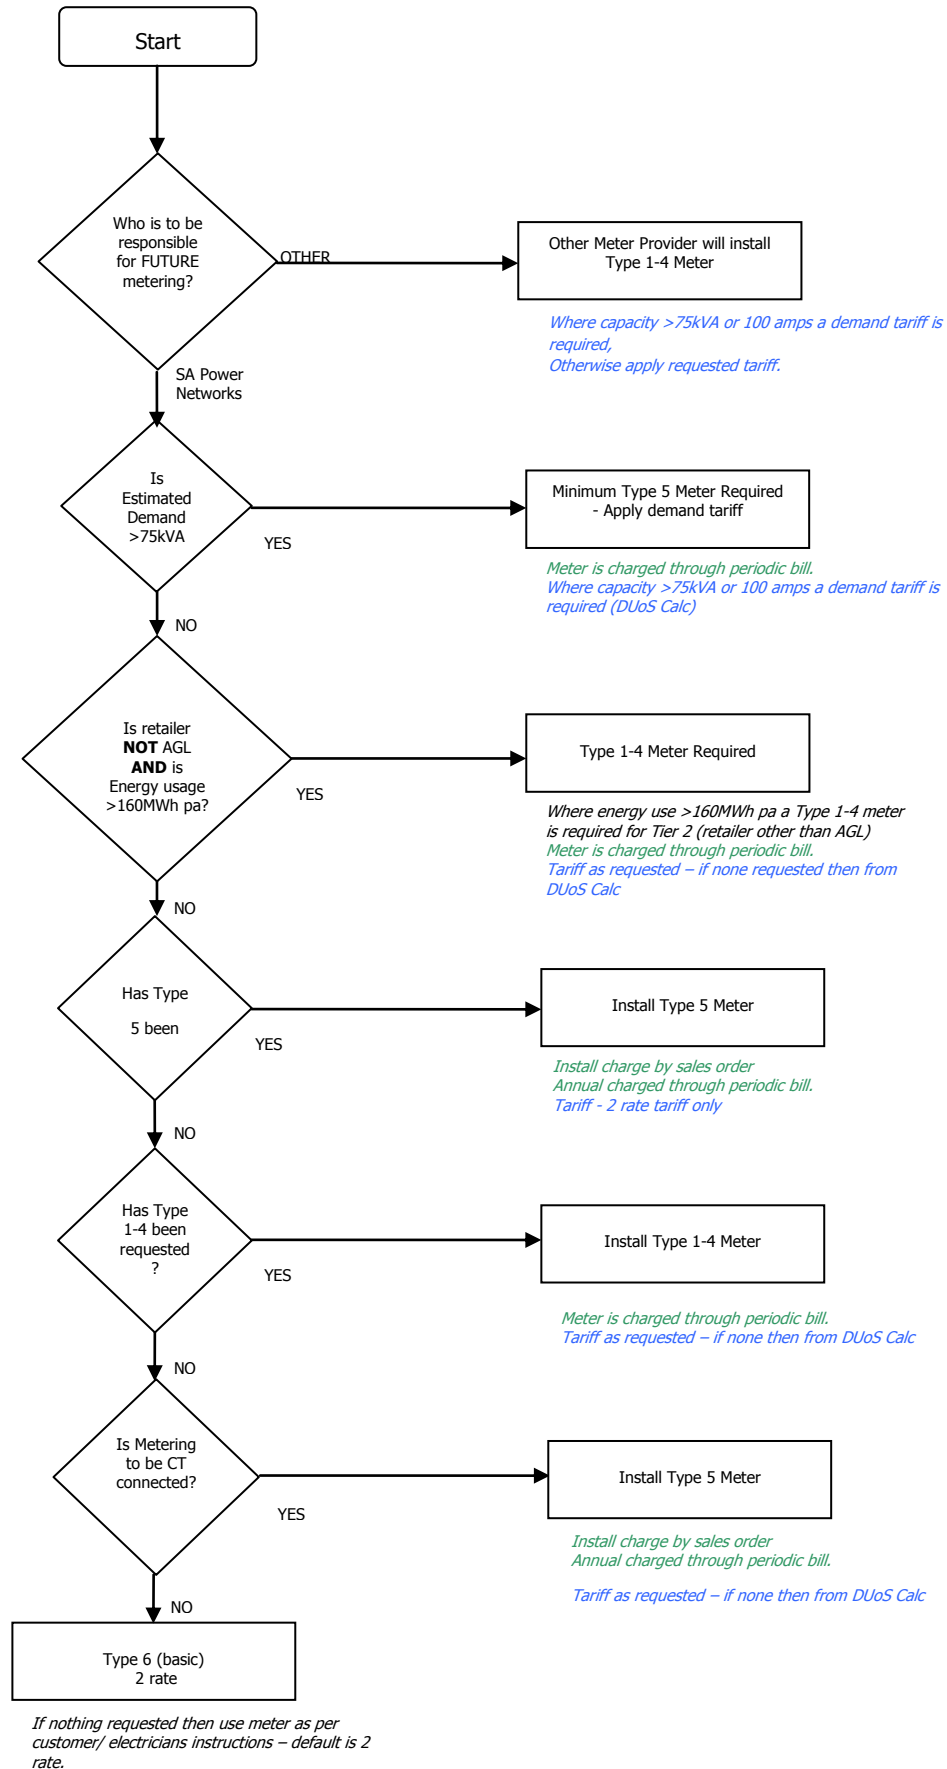


7.2.3 Meter Selection for Existing NMIs (Non Residential)

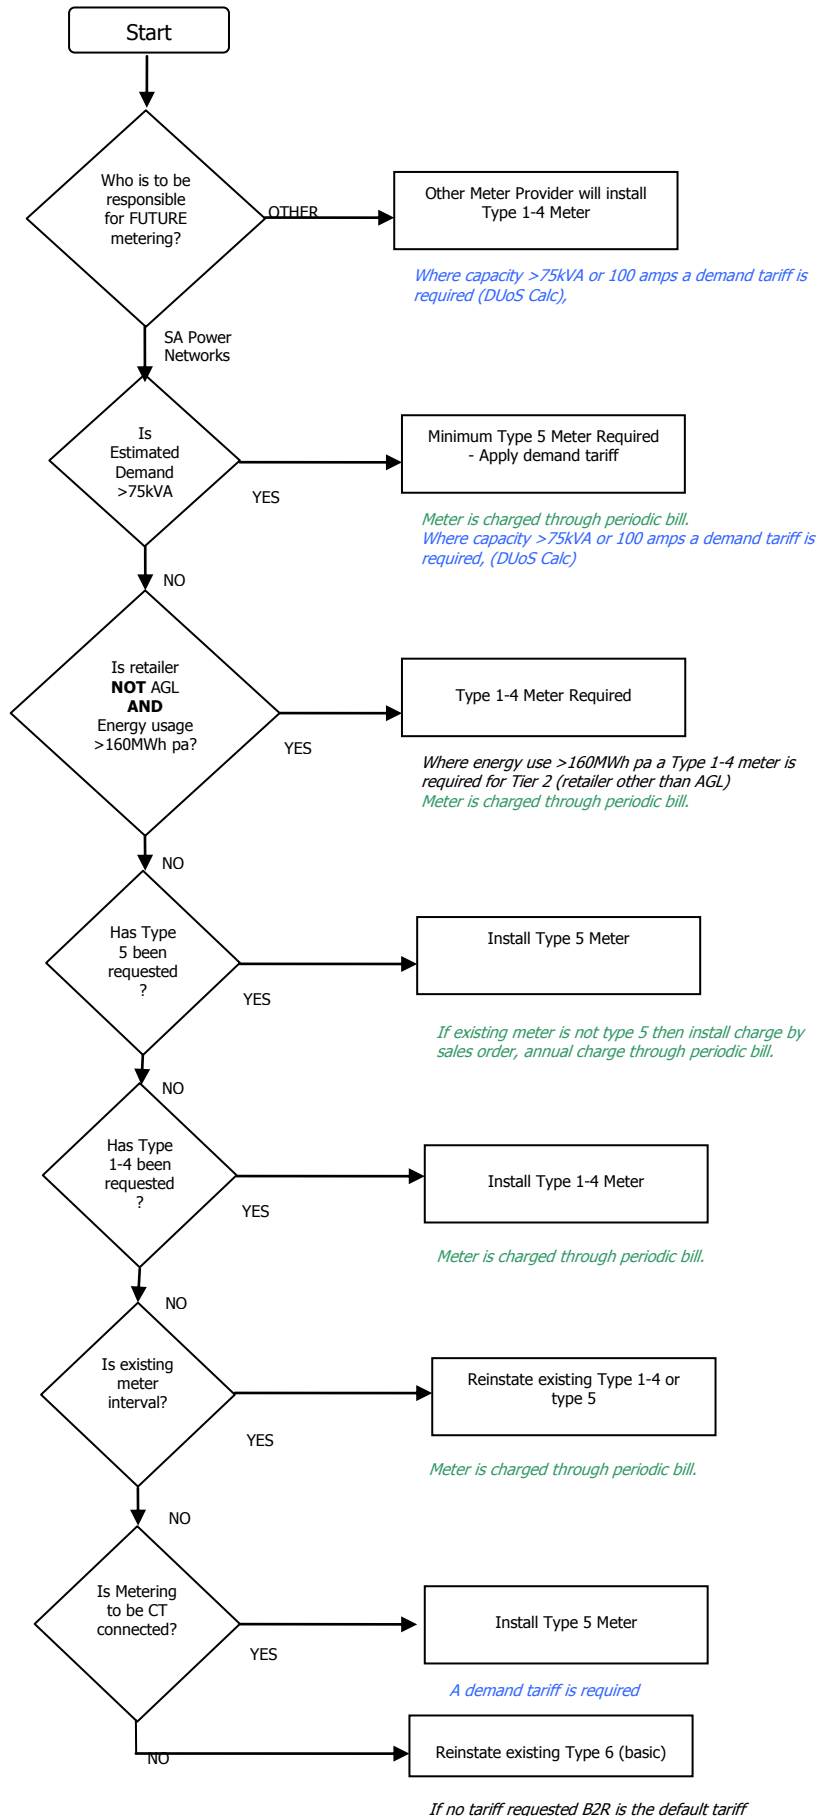

7.2.4 Demand Tariff Selection (LV)

The following flowchart can be used for determining the tariff for low voltage connections where the estimated demand is greater than 75kVA or 100 amps and therefore requiring a demand tariff to be applied. Decisions regarding the applications high voltage tariffs should be referred to a Customer Manager or Manager Regulation.

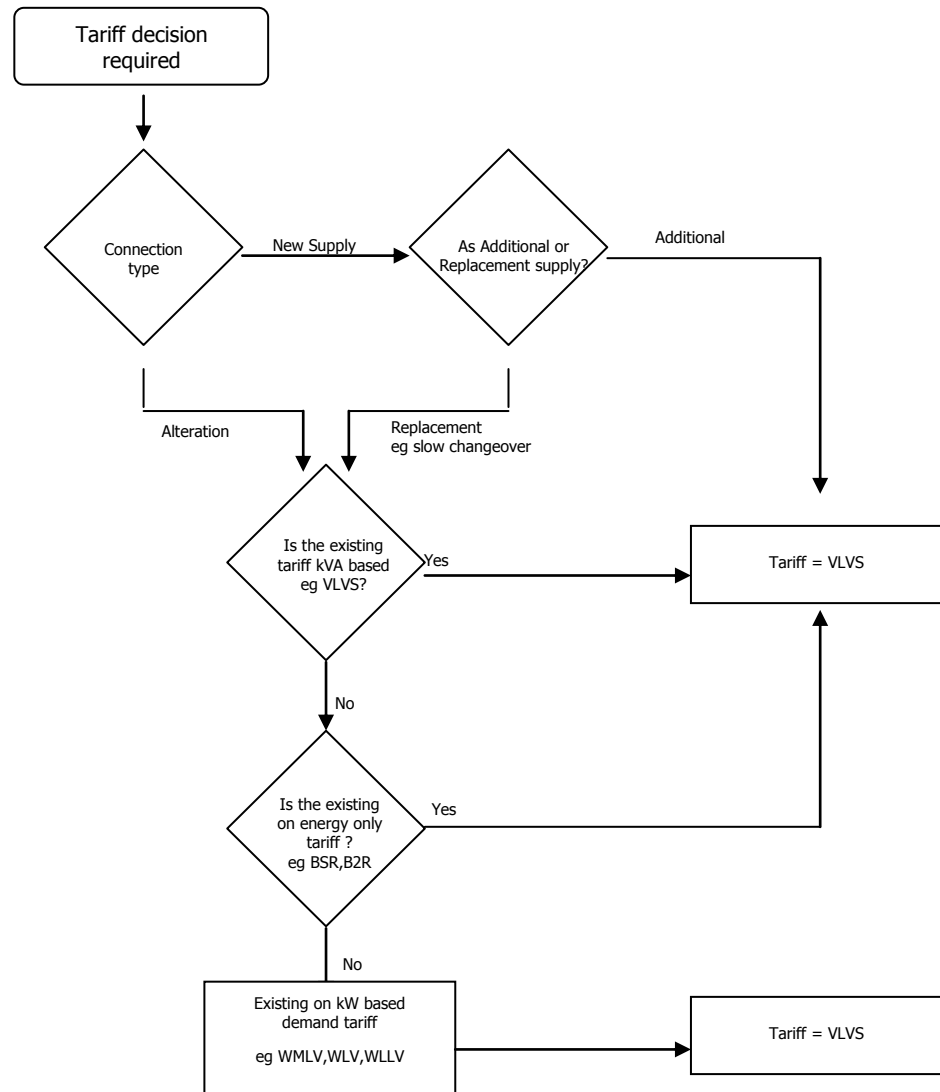

7.3 Examples

7.3.1 Residential House – New Connection

Job Type	New Supply	
Installation Type	Residential	

Retailer request	Current	Requested
Retailer	-	TRU
Meter Provider	-	SA Power Networks
Meter Type	-	Type 6
Tariff	-	QRSROPCL

Project Info	Value	Source
Estimated Demand	60 Amps 1ph (ie14kVA)	Form A / B or SIF
Estimated Energy	Not known	
Service Info	New supply from pit	

Assessment	Action	Reason
NMI	New	
Tariff	QRSROPCL	
Meter	Type 6 – Combination meter	

Comments: As the supply is for a residential premise the tariff will be RSR. Although the energy use is not known it is safe to assume the energy used for conventional residential premises is less than 160MWh per annum and therefore a type 1-4 meter is not required (the average usage for single residential premises is SA is around 5MWh pa for RSR and 8MWh pa for RSROPCL).

7.3.2 Residential House – Alteration

Alteration for new meter position and increase in maximum demand.

Job Type	Alteration	
Installation Type	Residential	

Retailer request	Current	Requested
Retailer	Origin	Origin
Meter Provider	SA Power Networks	SA Power Networks
Meter Type	Type 6	Type 6
Tariff	QRSROPCL	QRSROPCL

Project Info	Value	Source
Estimated Demand	50 Amps 1ph (ie12kVA)	Form A / B or SIF
Estimated Energy	Not known	
Service Info	Replace o/h service with o/u on pole	

Assessment	Action	Reason
NMI	Existing	Old supply is removed before replacement connected and supply from same pole.
Tariff	QRSROPCL	No change requested or required
Meter	Type 6	No change requested or required

7.3.3 Residential House – Meter / Tariff Change Request

Job Type	Meter Work	
Installation Type	Residential	

Retailer request	Current	Requested
Retailer	AGL	AGL
Meter Provider	SA Power Networks	SA Power Networks
Meter Type	Type 6	Type 5 – 2 rate
Tariff	QRSR	QR2R

Project Info	Value	Source
Estimated Demand	Not known	
Estimated Energy	Not known	
Service Info	Existing	

Assessment	Action	Reason
NMI	No Change	
Tariff	QRSR	There is no residential 2 rate Network tariff however a retailer is able to offer a 2 rate Retail tariff.
Meter	Type 5 – Two rate	

Comments: If a retailer does offer a two rate tariff then the meter will need to be changed to accommodate this (costs as per Pricing Reference Manual). The network tariff however, will remain as RSR. ie the meter needs to be suitable or better than the network tariff requirement.

7.3.4 Small Commercial – New Connection

Job Type	New Supply	
Installation Type	Commercial	

Retailer request	Current	Requested
Retailer	-	Aurora
Meter Provider	-	SA Power Networks
Meter Type	-	Type 6
Tariff	-	QBSR

Project Info	Value	Source
Estimated Demand	60 Amps 1ph (ie14kVA)	Form A / B or SIF
Estimated Energy	Not known	
Service Info	New supply from pit	

Assessment	Action	Reason
NMI	New	
Tariff	QB2R	
Meter	Type 6	

Comments: As the capacity/demand is clearly less than 75kVA or 100 amps a demand tariff is not required.

7.3.5 Small Commercial – Alteration

Alteration for new meter position and increase in maximum demand.

Job Type	Alteration	
Installation Type	Commercial	

Retailer request	Current	Requested
Retailer	Origin	Origin
Meter Provider	SA Power Networks	SA Power Networks
Meter Type	Type 6	Type 6
Tariff	QB2R	QB2R

Project Info	Value	Source
Estimated Demand	100 Amps 3ph (ie75kVA)	Form A / B or SIF
Estimated Energy	Not known	
Service Info	Replace 3ph o/h service with 100 o/u on pole	

Assessment	Action	Reason
NMI	Existing	Old supply is removed before replacement connected and supply from same pole.
Tariff	QB2R	No change requested or required
Meter	Type 6	No change requested or required

Comments: As the capacity/demand is clearly less than 75kVA or 100 amps a demand tariff is not required. Even though the future energy use is not known, it is safe to assume that it will be less than 160MWh pa for a less than 100Amp connection.

7.3.6 Small Commercial – Meter / Tariff Change Request

Job Type	Meter Work	
Installation Type	Commercial	

Retailer request	Current	Requested
Retailer	AGL	AGL
Meter Provider	SA Power Networks	SA Power Networks
Meter Type	Type 6-	Type 6 – 2 rate
Tariff	QBSROPCL	QB2ROPCL

Project Info	Value	Source
Estimated Demand	Not known	
Estimated Energy	Not known	
Service Info	Existing	

Assessment	Action	Reason
NMI	No Change	
Tariff	QB2R	As the customer does not currently have OPCL with B2R they are not eligible for the tariff. The customer change to B2R tariff.
Meter	Type 6 – Two rate	As required by selected tariff

Comments: As the customer does not currently have OPCL with B2R they are not eligible for the tariff. The customer must change to B2R for network tariff as the BSR tariff is obsolete.

7.3.7 Large Commercial – New Connection

Job Type	New Supply	
Installation Type	Commercial	

Retailer request	Current	Requested
Retailer	-	TRU
Meter Provider	-	SA Power Networks
Meter Type	-	Type 6
Tariff	-	QB2R

Project Info	Value	Source
Estimated Demand	600kVA	DUoS Rebate estimate
Estimated Energy	1300MWh pa	DUoS Rebate estimate
Service Info	New supply from new padmount	

Assessment	Action	Reason
NMI	New	
Tariff	VLVS	Capacity/Demand greater than 75kVA or 100 amps therefore demand tariff required.
Agreed Demand	600kVA	Required for demand tariff use ADMD (ie demand from DUoS rebate)
Meter	Type 1-4	Type 1-4 required for demand tariff and Type 1-4 required because estimated energy use greater than 160MWh pa.

7.3.8 Large Commercial – Alteration

Alteration for new meter position and increase in maximum demand. The old connection will be remaining connected for approximately one week to minimise disruption to the customer while the contractor transfers load to the new connection.

Job Type	Alteration	
Installation Type	Commercial	

Retailer request	Current	Requested
Retailer	Origin	Origin
Meter Provider	Infomet	Infomet
Meter Type	Type 1-4	
Tariff	VLVS	VLVS

Project Info	Value	Source
Estimated Total Demand	600kVA (570kW)	DUoS Rebate estimate
Estimated Energy	1300MWh pa	DUoS Rebate estimate
Service Info	New padmount installed for increased demand	

Assessment	Action	Reason
NMI	New NMI and abolish old NMI	Replacement supply is from different connection point and old supply will still be connected when replacement energised.
Tariff	VLVSi	KVA tariff is applied to the new NMI.
Agreed Demand	600KVA	kVA demand .
Meter	Type 1-4	Type 1-4 required due to demand tariff and other meter provider can only install Type 1-4.

Comments: Where the customer installs power factor correction as part of the upgrade process the customer should be advised to submit a tariff change request via their retailer. Validation of correct power factor is incorporated in the tariff change process.

7.3.9 Large Commercial – Meter / Tariff Change Request

Customer is downgrading site from production to warehousing. Want to save on metering and demand charges.

Job Type	Meter work	
Installation Type	Commercial	

Retailer request	Current	Requested
Retailer	Powerdirect	Powerdirect
Meter Provider	Powerdirect	SA Power Networks
Meter Type	Type 1-4	Type 5
Tariff	VLVS	MB2R

Project Info	Value	Source
Estimated Demand	Existing Agreed Demand 320kVA Future requirement 100kVA	CIS OV or NESS for current Form A or tariff change form for future
Estimated Energy	100MWh pa	CIS OV or NESS (look at usage since production ceased scaled for annual)
Service Info	Existing	

Assessment	Action	Reason
NMI	No Change	
Tariff	VLVS	As reduced Agreed demand is greater than 75kVA or 100 amps a demand tariff is mandatory.
Meter	Type 5	Ok to downgrade meter as energy less than 160MWh pa – cannot go to type 6 due to non reversion requirement.

Comments: The reduction of agreed maximum demand needs to be approved by Customer Manager (tariff change process) before tariff or meter can be changed. The customer remains on VLVS with an agreed capacity/demand of 100kVA.

7.3.10 Commercial – Meter / Tariff Change Request

Customer is downgrading site from production to warehousing. Want to save on metering and demand charges and propose to limit load to < 100amps.

Job Type	Meter work
Installation Type	Commercial

Retailer request	Current	Requested
Retailer	Powerdirect	Powerdirect
Meter Provider	Powerdirect	SA Power Networks
Meter Type	Type 1-4	Type 5
Tariff	VLVS	MB2R

Project Info	Value	Source
Estimated Demand	Existing Agreed Demand 320kVA Future requirement 70kVA controlled by meter isolator	CIS OV or NESS for current Form A or tariff change form for future
Estimated Energy	100MWh pa	CIS OV or NESS (look at usage since production ceased scaled for annual)
Service Info	Existing	

Assessment	Action	Reason
NMI	No Change	
Tariff	VLVS	As reduced Agreed demand is less than 75kVA or 100 amps a change to Business two rate tariff is acceptable
Meter	Type 5 whole current meter	Ok to downgrade meter as energy less than 160MWh pa – cannot go to type 6 due to non reversion requirement.

Comments: The reduction of agreed maximum demand needs to be approved by Customer Manager (tariff change process) before tariff or meter can be changed. The customer can change to business two rate but load limited and using a whole current meter.

8. POWER FACTOR

8.1 Excess kVAR Charges

Customers must comply with the South Australian Distribution Code requirements in particular Part B Connection and Supply Contract Power Factor. If a customer installation is not compliant at times of their monthly peak demand then an annual charge is applied of \$46.13 per kVAR excluding GST that SA Power Networks calculates that would be required to make the site compliant.

NMI	Excess kVAR 2013/14 excl GST \$ pa	NMI	Excess kVAR 2013/14 excl GST \$ pa	NMI	Excess kVAR 2013/14 excl GST \$ pa
2001000015	\$1,793	2001510498	\$1,190	2002130604	\$1,529
2001000037	\$1,516	2001548972	\$1,684	2002131783	\$3,411
2001000238	\$1,732	2001600967	\$1,560	2002132493	\$2,083
2001000264	\$3,900	2001614019	\$1,972	2002133171	\$1,370
2001000352	\$1,783	2001637910	\$1,357	2002134097	\$1,212
2001000367	\$1,037	2001676222	\$1,956	2002134474	\$6,502
2001000371	\$6,251	2001678019	\$1,391	2002135010	\$3,406
2001000381	\$10,351	2001679309	\$1,143	2002136097	\$1,308
2001000409	\$3,125	2001680160	\$1,422	2002138235	\$2,629
2001000595	\$1,224	2001682184	\$2,204	2002138677	\$1,256
2001000624	\$1,077	2001690275	\$1,357	2002146432	\$974
2001000675	\$2,138	2001692061	\$2,354	2002148144	\$1,043
2001000741	\$8,490	2001693979	\$1,882	2002149755	\$1,882
2001000769	\$2,053	2001695197	\$1,421	2002150864	\$1,474
2001000770	\$1,041	2001701898	\$1,263	2002165011	\$946
2001003108	\$942	2001705303	\$1,372	2002171029	\$4,277
2001004598	\$1,389	2001707190	\$1,297	2002175466	\$1,670
2001004647	\$934	2001715435	\$1,769	2002182020	\$11,023
2001004842	\$1,122	2001715784	\$956	2002187203	\$1,468
2001004844	\$932	2001718841	\$1,262	2002187426	\$1,649
2001004880	\$1,422	2001728102	\$1,421	2002188613	\$1,647
2001005077	\$1,161	2001730393	\$1,085	2002192912	\$1,083
2001005110	\$2,473	2001733244	\$2,905	2002196085	\$1,793
2001005226	\$1,252	2001733825	\$1,096	2002196090	\$1,186
2001005395	\$1,477	2001734682	\$1,338	2002197791	\$1,170
2001005647	\$1,238	2001738496	\$1,059	2002199862	\$3,104
2001005733	\$3,633	2001738611	\$1,092	2002200842	\$1,369
2001005775	\$2,249	2001738744	\$1,229	2002203416	\$966
2001005789	\$1,668	2001753386	\$1,517	2002204924	\$3,565
2001006418	\$1,730	2001753604	\$2,575	2002215222	\$1,429
2001007006	\$2,200	2001753637	\$2,341	2002216803	\$3,240
2001008075	\$1,026	2001761001	\$1,174	2002219768	\$5,034
2001008216	\$1,031	2001762676	\$928	2002221451	\$1,212
2001008428	\$1,008	2001782623	\$1,043	2002228553	\$1,937
2001160542	\$1,017	2002106430	\$12,905	2002230382	\$3,281
2001212208	\$1,089	2002115113	\$1,363	2002230443	\$2,463
2001314465	\$1,090	2002122723	\$2,707	2002233093	\$1,122
2001417609	\$2,025	2002125966	\$2,594	2002235933	\$2,098
2001486076	\$983	2002127173	\$1,084	2002246732	\$1,342
2001504332	\$1,129	2002127179	\$4,526	2002247192	\$1,275

NMI	Excess kVAR 2013/14 excl GST \$ pa	NMI	Excess kVAR 2013/14 excl GST \$ pa	NMI	Excess kVAR 2013/14 excl GST \$ pa
2002248724	\$1,055	SAAAAA999	\$1,790	SAAAAAC434	\$2,726
SAAAAA035	\$1,551	SAAAAAB048	\$3,488	SAAAAAC471	\$2,224
SAAAAA036	\$1,012	SAAAAAB069	\$1,264	SAAAAAC473	\$1,889
SAAAAA043	\$4,007	SAAAAAB082	\$1,793	SAAAAAC475	\$1,063
SAAAAA048	\$45,617	SAAAAAB153	\$931	SAAAAAC476	\$1,430
SAAAAA049	\$10,109	SAAAAAB187	\$1,561	SAAAAAC477	\$2,049
SAAAAA082	\$4,309	SAAAAAB197	\$1,146	SAAAAAC493	\$3,558
SAAAAA098	\$1,060	SAAAAAB266	\$1,060	SAAAAAC500	\$2,548
SAAAAA145	\$2,194	SAAAAAB267	\$1,017	SAAAAAC511	\$2,375
SAAAAA164	\$6,349	SAAAAAB338	\$1,737	SAAAAAC520	\$1,192
SAAAAA165	\$3,144	SAAAAAB346	\$1,693	SAAAAAC523	\$952
SAAAAA177	\$6,177	SAAAAAB420	\$1,504	SAAAAAC524	\$967
SAAAAA186	\$19,673	SAAAAAB446	\$2,496	SAAAAAC527	\$957
SAAAAA191	\$10,493	SAAAAAB447	\$1,536	SAAAAAC564	\$1,574
SAAAAA196	\$17,405	SAAAAAB451	\$1,500	SAAAAAC710	\$962
SAAAAA208	\$1,083	SAAAAAB453	\$1,378	SAAAAAC741	\$1,085
SAAAAA245	\$4,136	SAAAAAB458	\$4,180	SAAAAAC807	\$1,711
SAAAAA274	\$3,856	SAAAAAB485	\$3,372	SAAAAAC827	\$1,979
SAAAAA296	\$949	SAAAAAB518	\$1,571	SAAAAAC829	\$995
SAAAAA308	\$994	SAAAAAB551	\$1,521	SAAAAAC882	\$1,787
SAAAAA314	\$1,291	SAAAAAB552	\$1,680	SAAAAAC886	\$1,276
SAAAAA329	\$1,545	SAAAAAB555	\$3,421	SAAAAAC904	\$1,682
SAAAAA330	\$3,526	SAAAAAB598	\$1,462	SAAAAAD028	\$1,030
SAAAAA350	\$13,158	SAAAAAB604	\$1,346	SAAAAAD099	\$1,870
SAAAAA396	\$2,696	SAAAAAB609	\$1,749	SAAAAAD183	\$2,706
SAAAAA439	\$26,280	SAAAAAB675	\$1,190	SAAAAAD263	\$8,954
SAAAAA484	\$11,124	SAAAAAB704	\$966	SAAAAAD324	\$2,417
SAAAAA503	\$1,504	SAAAAAB708	\$3,054	SAAAAAD401	\$1,499
SAAAAA584	\$1,171	SAAAAAB878	\$2,380	SAAAAAD436	\$1,611
SAAAAA595	\$1,419	SAAAAAB883	\$946	SAAAAAD500	\$1,523
SAAAAA610	\$1,410	SAAAAAB892	\$976	SAAAAAD639	\$1,988
SAAAAA675	\$1,486	SAAAAAB900	\$1,060	SAAAAAD665	\$2,100
SAAAAA698	\$943	SAAAAAB901	\$1,309	SAAAAAE043	\$1,140
SAAAAA715	\$1,240	SAAAAAB904	\$2,009	SAAAAAE072	\$1,132
SAAAAA753	\$1,811	SAAAAAC271	\$2,145	SAAAAAE110	\$1,000
SAAAAA761	\$7,747	SAAAAAC352	\$1,522	SAAAAAE300	\$7,094
SAAAAA793	\$2,242	SAAAAAC410	\$1,168	SAAAAAE377	\$1,726
SAAAAA891	\$2,760	SAAAAAC425	\$1,148	SAAAAAE381	\$2,269
SAAAAA940	\$935	SAAAAAC431	\$1,007	SAAAAAE483	\$1,223
SAAAAA978	\$1,564	SAAAAAC433	\$1,647	SAAAAAE494	\$976
SAAAAAE626	\$1,351	SAAAAAE725	\$4,177	SAAAAAE760	\$3,939
SAAAAAE641	\$961	SAAAAAE752	\$7,395		

9. NEGOTIATED DISTRIBUTION SERVICES

9.1 Basic Connection Services

9.1.1 Purpose

This section details the basic connection services provided to customers for which a default fee will be charged. These connection services are of such a nature that a default charge can be calculated and listed in the indicative price list below.

9.1.2 Discussion

Basic connection services relate to a connection (or a proposed connection) between SA Power Networks distribution system and the customers premises.

The basic connection services offered by SA Power Networks are listed in the table on indicative prices below. The provision of these services involve minimal or no augmentation of the distribution network.

Under the National Energy Customer Framework (NECF), there are two categories of connection contracts which are:

1. Connection contract – which is associated with establishing or altering the physical connection to the distribution system.

SA Power Networks has two connection contracts for basic connection services and each have a model standing offer (MSO):

- i. Basic connection service with no embedded generators: and/or
- ii. Small embedded generators (SEG).

2. Customer connection contract – which is associated with the ongoing supply of energy to a retail customer's premises and are normally deemed (ie customer does not need to sign or agree to the contract) to apply. These contracts commence on energisation or when a customer starts consuming energy.

The two model standing offers along with the table of Basic Connection Services indicative prices have been approved by the Australian Energy Regulator (AER) and are published on our website at www.sapowernetworks.com.au.

The customer connection contract is a Deemed Standard Connection Contract (DSCC) that applies to all small customer (ie electricity consumption less than 160MWh pa).

A request for a basic connection service can be expedited by not requesting a formal offer and when signing our application form you can accept both the Terms and Conditions of the MSO and the default charge when the application is made.

The charge recovers the average cost of performing such work including labour, materials, vehicles, other services, overheads and a return on investment.

SA Power Networks default service is a low voltage single phase up to 63Amps. This service is provided by the installation of an over to under service on an existing low voltage stobie pole or from an existing service pit/pillar that is located up to 25 metres from the property boundary on the same side of the street.

Variations to the default service may include a combination of the charges in the tables below. For example, a new multi phase service (using over to under or existing service pit) with import export metering to suit would require 2 charges combined, being fee codes BCS 101 and BCS 115.

Basic Connection Services Indicative Price List
New Supply

Category	Service Type	Service Description	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
1 phase 63Amp	Over to under service (see diagram 1) or Existing pit/pillar (see diagram 2)	Provision of an over to under service on an existing low voltage stobie pole or from an existing service pit/pillar that is located up to 25 metres from the customers property boundary on the same side of the street	No charge	No charge	BCS 100	NSC02
multi phase 63Amp	Over to under service (see diagram 1) or Existing pit/pillar (see diagram 2)	Provision of an over to under service on an existing low voltage stobie pole or from an existing service pit/pillar that is located up to 25 metres from the customers property boundary on the same side of the street and the requested number of phases are available	\$266.00	\$292.60	BCS 101	NSC03
1 phase or multi phase 63Amps	Overhead service (see diagram 3)	Provision of a multi phase overhead service from an existing low voltage stobie pole in lieu of an over to under or underground connection and the requested number of phases are available	\$302.00	\$332.20	BCS 102	NSC06
Temporary supply 63Amp 1 phase	Over to under service (see diagram 1) or Overhead Service (see diagram 3)	Provision of an over to under service on an existing low voltage stobie pole or an overhead service from an existing low voltage stobie pole to a structure provided by the customer i.e. customer installs a temporary pole and meter box	\$312.00	\$343.20	BCS 103	NSC12

New Supply (cont.)

Category	Service Type	Service Description	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Temporary supply 63Amp multi phase	Over to under service (see diagram 1) or Overhead Service (see diagram 3)	Provision of an over to under service on an existing low voltage stobie pole or an overhead service from an existing low voltage stobie pole to a structure provided by the customer i.e. customer installs a temporary pole and meter box and the requested number of phases are available	\$885.00	\$973.50	BCS 104	NSC14
Temporary supply 63Amp 1 phase or multi phase (existing connection point available)	Over to under service (see diagram 1) or Existing pit/pillar (see diagram 2)	Connection from an existing over to under service or from an existing service pit / pillar and the requested number of phases are available	\$115.00	\$126.50	BCS 105	NSC13

Alterations

Category	Service Type	Service Description	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Replace existing 63Amp 1phase service or multi phase 63Amp service	Over to under service (see diagram 1) or Existing pit/pillar (see diagram 2) or Overhead service (see diagram 3)	replacement of an existing overhead, over to under or underground service "like with like" or a reduction in the number of phases (1 phase with 1 phase or multi phase with multi phase) SA Power Networks agreement required	No Charge	No charge	BCS 106	N/A
Relocate existing 1 phase 63Amp or multi phase 63Amp overhead service	Overhead service (see diagram 3)	Customer request for Relocation of an existing overhead service to accommodate building extensions, verandas, carports etc	\$302.00	\$332.20	BCS 107	AAC02
Relocate existing metering outside to outside	Over to under service (see diagram 1) or Existing pit/pillar (see diagram 2) or Overhead service (see diagram 3)	Reinstall metering from an existing outside location to a new outside metering enclosure with no change to the existing service as a result of building alterations i.e. customer convenience	\$94.00	\$103.40	BCS 108	AAC08
Upgrade to a multi phase 63Amp service	Over to under service (see diagram 1) or Overhead Service (see diagram 3)	Provision of an over to under service on an existing low voltage stobie pole or an overhead service from an existing low voltage stobie pole and the requested number of phases are available	\$479.00	\$526.90	BCS 109	AAC03
Upgrade to a multi phase 63Amp service	Existing service pit/pillar (see diagram 2)	Connection provided from an existing suitable low voltage service pit / pillar and the requested number of phases are available at the service point	\$104.00	\$114.40	BCS 110	AAC04

Alterations (cont.)

Category	Service Type	Service Description	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Additional 63Amp service for a duplex split i.e. Existing metered strata title split into two Torrens titles (no additional load)	Over to under service (see diagram 1) or Existing pit/pillar (see diagram 2)	Provision of an over to under service on an existing low voltage stobie pole or from an existing service pit/pillar that is located up to 25 metres from the customers property boundary on the same side of the street and the requested number of phases are available	\$384.00	\$422.40	BCS 111	N/A

Unmetered Supply

Category	Service Type	Service Description	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
1 phase unmetered supply only for approved applications eg public telephones, traffic signals, council lighting, parking machines, bus shelters	Over to under service (see diagram 1) or Existing pit/pillar (see diagram 2)	Provision of an over to under service on an existing low voltage stobie pole or from an existing service pit/pillar	\$302.00	\$332.20	BCS 112	NSC09

Metering – New Installation

Category	Service Type	Service Description	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Whole current type 6 meter (manually read basic accumulation meter)	1 phase	Installation of a single phase meter (includes off peak controlled load)	No charge	No charge	BCS 113	N/A
Import / Export Whole Current type 6 meter (manually read basic accumulation meter)	1 phase	Installation of a single phase import/export meter (includes off peak controlled load)	No charge	No charge	BCS 114	N/A
Connection of an embedded generator up to 10kW single phase and 30kW three phase (up to 5kW SWER)	multi phase	Installation of a three phase import/export meter	\$135.00	\$148.50	BCS 115	N/A
Type 5 metering (manually read interval meter) Whole current up to 100amps	1 phase 1 element	Installation of a single phase single element manually read interval meter	\$89.00	\$97.90	BCS 116	N/A
		Annual fee for processing the interval data	\$63.00	\$69.30	BCS 117	N/A
	1 phase 2 element	Installation of a single phase dual element manually read interval meter eg off peak controlled load	\$89.00	\$97.90	BCS 118	N/A
		Annual fee for processing the interval data	\$88.00	\$96.80	BCS 119	N/A
	multi phase	Installation of a multi phase single element manually read interval meter	\$44.00	\$48.40	BCS 120	N/A
		Annual fee for processing the interval data	\$144.00	\$158.40	BCS 121	N/A

Metering – Existing Installation

Category	Service Type	Service Description	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Import / Export Whole Current type 6 meter (manually read basic accumulation meter) Connection of an embedded generator up to 10kW single phase and 30kW three phase (up to 5kW SWER)	1 phase	Installation of a single phase import/export meter includes off peak controlled load	\$286.00	\$314.60	BCS 122	N/A
	multi phase	Installation of a three phase import/export meter	\$618.00	\$679.80	BCS 123	N/A
Type 5 metering (manually read interval meter) Whole current up to 100amps	1 phase 1 element	Installation of a single phase single element manually read interval meter	\$141.00	\$155.10	BCS 124	N/A
		Annual fee for processing the interval data	\$63.00	\$69.30	BCS 125	N/A
	1 phase 2 element	Installation of a single phase dual element manually read interval meter eg off peak controlled load	\$151.00	\$166.10	BCS 126	N/A
		Annual fee for processing the interval data	\$88.00	\$96.80	BCS 127	N/A
	multi phase	Installation of a multi phase single element manually read interval meter	\$209.00	\$229.90	BCS 128	N/A
		Annual fee for processing the interval data	\$144.00	\$158.40	BCS 129	N/A
Import / Export & Type 5 metering (manually read interval meter)	Reprogram meter	Existing meters that are able to be reprogrammed for import/export	\$83.00	\$91.30	BCS 130	N/A


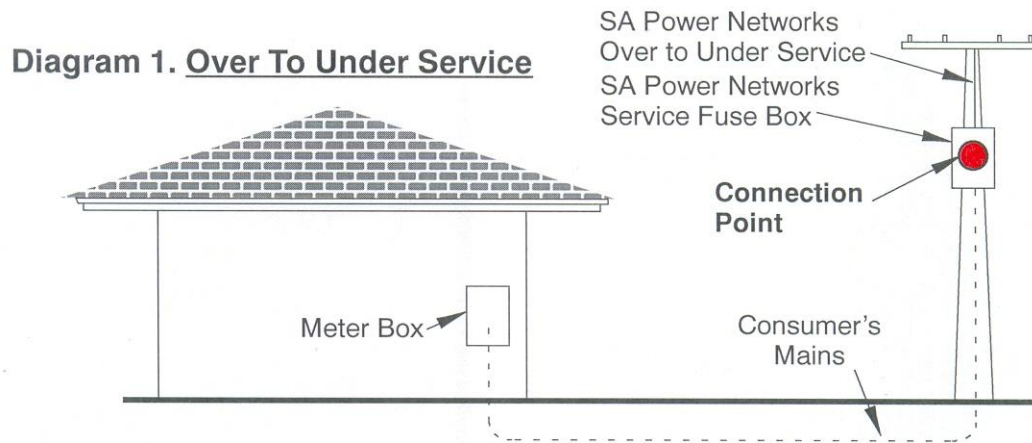



Diagram 2. Underground Service

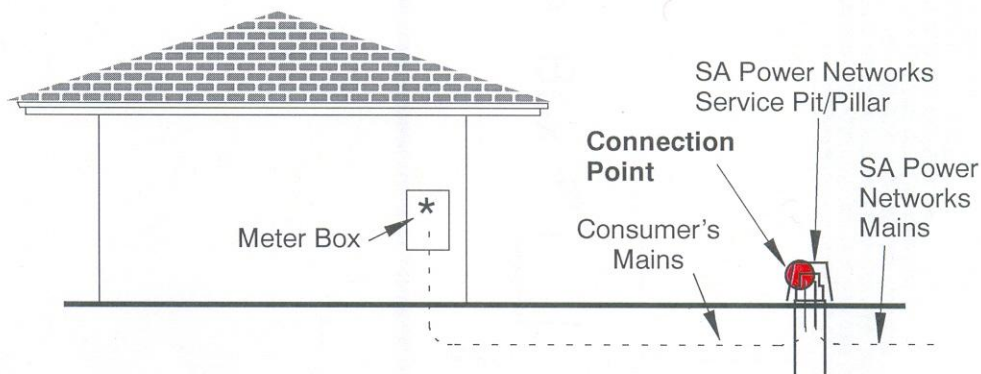

NOTE:

In some cases *SA Power Networks Service Fuse may be installed in Meter box

Diagram 3. Overhead Service

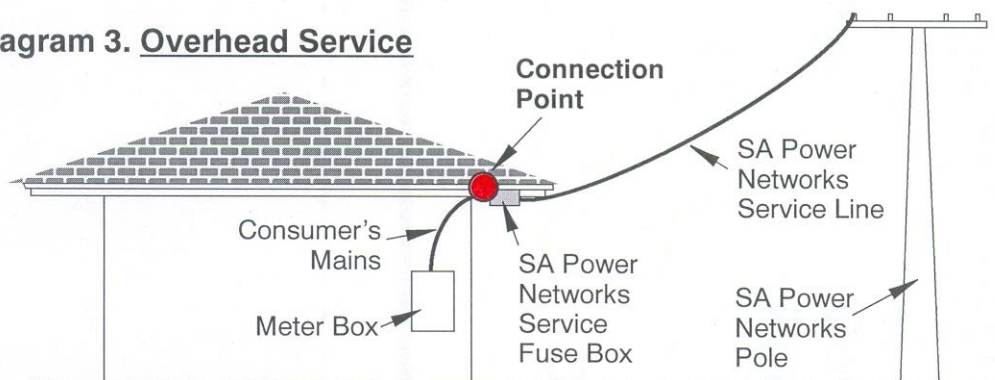

9.2 Negotiated Connection Services

9.2.1 Purpose

This section details the negotiated connection services provided to customers. A fee will normally be charged for the provision of an offer. This fee is deducted from the connection service charge and is non-refundable if you don't proceed with the connection.

9.2.2 Discussion

Negotiated connection services are all services that relate to a connection (or a proposed connection) between SA Power Networks distribution system and the customers premises but are not basic connection services as outlined in 9.1 above.

In relation to a negotiated connection service for a customers supply, SA Power Networks offer will be based on our most technically feasible and minimum cost option for our works to make the connection. Any requested work in excess of the most technically feasible option will be at the customer's expense.

The negotiated connection contract is SA Power Networks formal written offer and the associated terms and conditions. Note: this contract is separate to the ongoing customer connection contract which commences upon energisation.

The work (if over \$1,000), will not be undertaken until the necessary fee is paid by the customer. If the charges are less than \$1,000 payment will be charged at the completion of work.

Negotiated Connection Services Indicative Price List

Negotiated Connection Services

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Installation of a service pit / pillar	Work to provide a supply by installing a low voltage service pit / pillar		Full cost less Rebate (if applicable)	Full cost less Rebate (if applicable)	NCS 200	N/A
Installation of a service pole	Work to provide a supply by installing a low voltage stobie pole, mains and service		Full cost less Rebate (if applicable)	Full cost less Rebate (if applicable)	NCS 201	N/A
1 Phase or multi phase 63Amp	Provision of one span of LV ABC Mains (up to 20m for 4X50mm ² or 40M of 2X50mm ²) and installation of an over to under service on a steel tubular pole with type 6 meters. (Includes \$3,000 rebate)	1 phase	No charge	No charge	NCS 202	NSC04
		Multi phase 63Amp	\$266.00	\$292.60	NCS 203	N/A
Flying service	Provision of a flying service where technically feasible in lieu of an over to under service on an existing stobie pole that is located up to 25 metres from the property boundary and the requested number of phases are available	1 phase or multi phase 63Amp	\$563.00	\$619.30	NCS 204	NSC08
Overhead service	Change from an existing over to under or underground service to an overhead service and the requested number of phases are available	1 phase 63Amp	Full cost	Full cost	NCS 205	N/A
		Multi phase 63Amp	Full cost	Full cost	NCS 206	N/A

9.3 Negotiated Distribution Services (Non Connection)

9.3.1 Purpose

This section details the negotiated distribution services provided to customers. A fee will normally be charged for these services.

9.3.2 Discussion

Negotiated distribution services are all services that are not related to a connection (or proposed connection) between SA Power Networks distribution system and the customer's premises.

SA Power Networks charge will be based on the cost of the works to provide the service. The work (if over \$1,000), will not be undertaken until the necessary fee is paid by the customer. If the charges are less than \$1,000 payment will be charged at the completion of work.

The application of all connection and/or disconnection default fees are NMI based, and are applied to each and every NMI impacted by the work undertaken by SA Power Networks, irrespective of the number of service connection points to a property. Alterations and changes to specific metering types can only be provided where permitted under the National Electricity Rules and by the relevant market participants.

9.3.3 Pre-payment Metering

Pre-payment metering is not currently being offered by any retailer in the South Australian market. As a result prices relating to pre-payment metering will depend upon the future product being offered by a retailer.

Negotiated Distribution Services (Non Connection) Indicative Price List

Mains & Services

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Additional service 1 phase or multi phase	Provision of an additional service - SA Power Networks agreement required Augmentation may apply	Over to under, underground or overhead	Full cost	Full cost	NDS 300	N/A
Permanent Removal of LV Supply (Abolishment)	Request from customer for the permanent abolishment of supply/NMI (May include removal of O/H service or disconnection of O/U or U/G service but not the removal of additional distribution assets i.e. poles and transformers		\$115.00	\$126.50	NDS 301	N/A
Temporary Disconnect and Reconnect for safety of customer or their contractor.	For requests for a temporary D/C & R/C of LV service for facia or gutter replacement		\$115.00	\$126.50	NDS 302	N/A
	Temporary isolation of customers supply eg For periodic inspection of switchboard		Full cost	Full cost	NDS 303	N/A

Metering Charges

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Charge for Meter Removal	Includes both single and multi phase meters eg removal of redundant Controlled Load tariff meter (Not permanent removal of supply or NMI)	First meter	\$83.00	\$91.30	NDS 304	RMFE
		Each additional meter	No charge	No charge	NDS 305	RMFA
Upgrade of meters	Request by a customer to change meters to Electronic meter eg to make room in a meter box for an RCD or extra. Equipment thereby avoiding the need to increase the size of the meter box or replace the board.	One single phase electronic meter	\$411.00	\$452.10	NDS 306	AAC05
		Cost per additional single phase electronic meter	\$260.00	\$286.00	NDS 307	AAC06
Meter Reconfiguration	On-site reconfiguration of meters in response to customer requests for changes to tariffs, two-rate meter settings or timeclocks.	First meter	\$83.00	\$91.30	NDS 308	MRFE
		Each additional meter	No charge	No charge	NDS 309	MRFA
Install 2 Rate Meter	Installation of 2 rate metering at an existing installation with no Service work (eg Remove flat rate and install 2 rate only).		\$250.00	\$275.00	NDS 310	N/A
Import / Export Whole Current type 6 meter (manually read basic accumulation meter) where customer has multiphase controlled load.	Supply and install Basic Multi phase import/export metering equipment (type 6) at customer request - in normal time, where customer also has multiphase controlled load.	Multi phase dual register meter to measure import consumption against export and replace controlled load metering to suit	\$618.00	\$679.80	NDS 311	N/A

Metering Charges (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Type 1-4 Type Meter Charges Meter provision only. (Not reads)	Installation where reliable mobile telecommunications service is available		No charge	No charge	NDS 312	N/A
	Installation where reliable mobile telecommunications service is not available		Full cost	Full cost	NDS 313	N/A
	Annual Fee (Type 4 meter).	Charge per meter per annum	\$625.00	\$687.50	NDS 314	N/A
	Exit Fee where meter is removed within the first 12 months of installation.		\$1,042.00	\$1,146.20	NDS 315	N/A
	Annual Fee (Type 3 meter).		Full cost	Full cost	NDS 316	N/A
	Annual Fee (Type 2 meter).				NDS 317	N/A
	Annual Fee (Type 1 meter).				NDS 318	N/A
	Exit Fee - Applies to network customers with Type 1-4 (non-exceptional) meter where the meter is removed any time after the first 12 months of installation.	Charge per meter per exit transaction	\$555.00	\$610.50	NDS 319	N/A

Metering Charges (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Type 5 Meter Charges	Applies for a customer or their agent requesting the installation of a three phase CT connected type 5 meter. (includes import / export metering)	Existing premise installation charge	\$186.00	\$204.60	NDS 320	N/A
		New premise installation charge	\$44.00	\$48.40	NDS 321	N/A
		Annual fee	\$208.00	\$228.80	NDS 322	N/A
	Exit Fee - Applies to network customers with Type 5 meter churning to another meter provider	Charge per meter per exit transaction	\$249.00	\$273.90	NDS 323	N/A
Type 5 Meter - communications device	Installation of communications device for Type 5 CT connected and whole current meters (Where operational difficulties reasonably require the metering installation to be capable of remote acquisition)	New premise installation charge	\$60.00	\$66.00	NDS 324	N/A
		Existing premise installation charge	\$178.00	\$195.80	NDS 325	N/A
		Annual fee - this is in addition to the Type 5 Meter annual fee	\$349.00	\$383.90	NDS 326	N/A
		Exit fee for the communications device	\$178.00	\$195.80	NDS 327	N/A
Type 6 Meter Charges	Applies to large customers (>160MWh pa) having a Type 6 meter	Charge per meter per annum	\$227.00	\$249.70	NDS 328	N/A
	Exit Fee - Applies to large network customers with Type 6 meter churning to another meter provider	Charge per meter per exit transaction	\$249.00	\$273.90	NDS 329	N/A

Third Party Connection Works Charges

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Specification Fees	This covers the costs of work undertaken in preparing and issuing the specification including 1 site visit (within 100km of regional head office) for customer extension works.	\$20 - \$85k project	\$1,700.00	\$1,870.00	NDS 340	N/A
		\$85 - \$150k project	\$2,820.00	\$3,102.00	NDS 341	N/A
		> \$150k project	Full cost	Full cost	NDS 342	N/A
Specification re-compliance	Resubmission of a design which previously did not satisfy the SA Power Networks spec.		Full cost	Full cost	NDS 343	N/A
Works/Design compliance	Works/design compliance of an asset to be vested by a customer/developer to SA Power Networks. This includes administration, design compliance against specification and vesting. Applies to contestable works such as RDs (real estate developments) and contestable connections where SA Power Networks is not the constructor.		Full cost	Full cost	NDS 344	N/A
Works re-inspection for compliance	Re-inspection of an asset issued with a non-compliance notice, (including travelling time).	Minimum (up to 3 hours) normal time	\$292.00	\$321.20	NDS 345	N/A
		Hourly rate after 3 hrs normal time	\$94.00	\$103.40	NDS 346	N/A
		Hourly rate out of hours or part thereof	\$115.00	\$126.50	NDS 347	N/A
			Full cost	Full cost	NDS 348	N/A

Third Party Connection Works Charges (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Indicative Letter	This covers the costs of work undertaken in preparing and issuing an indicative estimate letter for customer projects. Includes customer extension works, asset connection and network augmentation charges (excludes rebates). The indicative fee is non-refundable and non-deductible should the applicant proceed to a firm offer.	< 6 hours work	No charge	No charge	NDS 349	N/A
	Larger jobs and multiple requests	> 6 hours work or part thereof	\$82.73/Hr	\$91.00/Hr	NDS 350	N/A
Offer Letter	These are MAXIMUM amounts that can be charged. This covers the costs of work undertaken in preparing and issuing an offer letter for customer projects. Includes customer extension works, asset connection and network augmentation charges. This includes rebates but may exclude underground development extension costs. Firm offer is non-refundable but deductible from the final project amount should the connection proceed within the validity period of the first quote. For all subsequent quotes for the same project the initial fee will be non-deductible, each additional quote will be charged using the initial firm offer principles (i.e. non-refundable but deductible).	> \$20k < \$85k project	\$500.00	\$550.00	NDS 351	N/A
		\$85k - \$150k project	\$1,680.00	\$1,848.00	NDS 352	N/A
		> \$150k project	Full cost	Full cost	NDS 353	N/A

Miscellaneous Fees

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Monthly Meter Reading Fee (extra cost of monthly meter reading)	Daily Charge		\$0.122634/day	\$0.134897/day	NDS 354	N/A
Install pulsed output from existing SA Power Networks metering capable of this functionality (Existing metering may need to be changed for this functionality which will incur the relevant additional metering costs listed for Type 1-4 and Type 5 meters)	Customer requests a pulsed output from the meter for energy management or to display consumption in some form.	Annual charge	\$104.00	\$114.40	NDS 355	N/A
Charge for Meter Test	Charge only applicable when a customer requests a meter test due to high account or a suspected incorrect functioning PV installation and the SA Power Networks meter is found not to be faulty.	Single phase	\$121.82	\$134.00	NDS 356	SPFE
		Each additional single phase meter	No charge	No charge	NDS 357	SPFA
		3 Phase Meter	\$121.82	\$134.00	NDS 358	MPFE
		Each additional multi phase meter	No charge	No charge	NDS 359	MPFA

Miscellaneous Fees (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Charge for Meter Test (where an appointment has been requested by the customer's retailer)	Charge only applicable when a customer requests a meter test due to high account or a suspected incorrect functioning PV installation and the SA Power Networks meter is found not to be faulty.	Single phase	\$285.00	\$313.50	N/A	APTMT
		Each additional single phase meter	No charge	No charge	N/A	APTMT
		3 Phase Meter	\$285.00	\$313.50	N/A	APTMT
		Each additional multi phase meter	No charge	No charge	N/A	APTMT
Charge for PV Installation Enquiry	Charge applicable when customer requests SA Power Networks to attend a PV installation which is not functioning correctly and it is determined by the SA Power Networks personnel the problem is a result of the customer's PV installation being incorrectly set/malfunctioning.	Single phase Installation	\$121.82	\$134.00	NDS 360	N/A
		3 phase Installation	\$121.82	\$134.00	NDS 362	N/A
Meter Inspection Fee	This charge applies when a physical inspection is requested due to suspected meter tampering, equipment damage or requested by customer or their retailer	First meter	\$30.91	\$34.00	NDS 364	MIFE
		Each additional meter	No charge	No charge	NDS 365	N/A
Meter Inspection Fee (where an appointment has been requested by the customer's retailer)	This charge applies when a physical inspection is requested due to suspected meter tampering, equipment damage or requested by customer or their retailer	First meter	\$160.00	\$176.00	N/A	APTIN
		Each additional meter	No charge	No charge	N/A	APTIN

Miscellaneous Fees (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Excess kVAr Incentive Charge	The Excess kVAr Incentive Charge rate is applied to each excess kVAr required over and above the implied kVAr allowance provided in the South Australian Electricity Distribution Code to meet a customer's Agreed Maximum Demand based on their recorded power factor at the time of their Actual Maximum Demand. The charge is applied to customers currently assigned to a network demand tariff who are not code compliant with respect to power factor at the time of their Actual Maximum Demand requiring greater than 10kVAr of correction. The charge is reviewed annually after the completion of the maximum demand period and is invoiced monthly (i.e. the annual charge divided by 12) effective 1 July following the maximum demand period. Customers will cease being levied the charge once the site has become compliant by installation of power factor correction equipment or other measures deemed acceptable to SA Power Networks and have also notified SA Power Networks of the compliance.	Rate applied per amount of excess kVAr	\$46.13/kVAr	\$50.74/kVAr	NDS 366	N/A
Back up feeder charge	This charge is applied when a customer has two connection points supplying their site and full supply can be taken from either supply point	These charges are negotiated with the Major Customer Manager	Full cost	Full cost	NDS 367	N/A
Pole Relocation	Relocation of an existing electricity pole for a customer convenience		Full cost	Full cost	NDS 368	N/A

Miscellaneous Fees (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Service pit / pillar Relocation	Relocation of an existing electricity pit / pillar customer convenience		Full cost	Full cost	NDS 369	N/A
Service pit / pillar Raising/Lowering	Raise or lower a pit / pillar including a driveway pit. (Where pit was at satisfactory level when installed and vested to SA Power Networks). Price can vary dependent on crew travelling time.		Full cost	Full cost	NDS 370	N/A
Temporary Insulation (not full insulation) of LV Mains (excluding road crossings which will be estimated as required based on number of units and time).	Work to erect and remove 'Tiger Tails' from LV Mains. Costs are based on replacement costs and a 2 year life of 'Tiger Tails'. (NOTE: Price is for a 3 month period only and an additional charge(s) of the same amount will be applied for each subsequent 3 month period beyond the initial installation date until the tails are removed).	Normal Time	\$8.36 per unit (min fee \$114.36)	\$9.20 per unit (min fee \$125.80)	NDS 371	N/A
		Overtime	\$8.36 per unit plus \$571.82	\$9.20 per unit plus \$629.00	NDS 372	N/A
Location of underground mains at the request of a customer	Provision of plans from the office		No charge	No charge	NDS 373	N/A
	Site visit	Under 1 hour in Normal time	No charge	No charge	NDS 374	N/A
		Over 1 hour in Normal Time	\$97.00 Per hour or part thereof	\$106.70 Per hour or part thereof	NDS 375	N/A
		Out of Normal Time	\$141.00 Per hour or part thereof	\$155.10 Per hour or part thereof	NDS 376	N/A
Asset Information Requests	Provision of asset information relating to condition, rating or available capacity to engineering consultants and electrical contractors and the supply of GIS information to customers or authorities	Less than 1hrs work - per request	\$78.00	\$85.80	NDS 377	N/A
		Over 1 hours work	Full cost	Full cost	NDS 378	N/A
	Confirmation of available equipment in ground level transformers where the door needs to be opened by a Customer Service Officer		\$125.00	\$137.50	NDS 379	N/A

Miscellaneous Fees (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Network Access Request	Organisation of switching requirements and field work to allow 3rd party access to de-energised assets.		Full cost plus \$250 for admin & billing	Full cost plus \$275 for admin & billing	NDS 380	N/A
Network Access Management Fee	Management of access request	Where under 1/2 day of planning required	\$250.00	\$275.00	NDS 381	N/A
Repeated Call Outs for Repairs to SA Power Networks equipment caused by the customer (not first call out)	Following notification of requirement to upgrade service size. Typically \$452 + GST for LV and \$803 + GST for HV fuses.	LV fuse	Full cost	Full cost	NDS 382	N/A
		HV fuse	Full cost	Full cost	NDS 383	N/A
	Wasted visit where not able to perform service or discharge obligation due to customer or agent's fault.	Wasted Visit - Business Hrs	Full cost	Full cost	NDS 384	N/A
		Wasted Visit - A/Hrs	Full cost	Full cost	NDS 385	N/A
Special Meter Reader Visit	A Special Meter Reading Visit occurs when a customer requests a check read or special read at a Service Provision.		\$11.61	\$12.77	NDS 386	SRFE
	A Special Meter Reading Visit occurs when a customer requests a check read or special read at a Service Provision after business hours.		\$71.00	\$78.10	NDS 387	N/A
	A Special Meter Reading visit which is subsequently cancelled.		\$11.61	\$12.77	NDS 388	N/A

Miscellaneous Fees (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Subsequent Attempt to Read Meter	This relates to subsequent attempts to read a meter after a reasonable attempt has been made but has been unsuccessful due to access difficulties.		\$11.61	\$12.77	NDS 389	SUB
High Load Escorts	Assistance to a third party to transport a large vehicular load. Includes provision of labour and equipment to temporarily raise or remove mains to allow load to pass freely.	Hourly rate for administration & checking of route if over 1 hour	\$101.00	\$111.10	NDS 390	N/A
		Minimum Charge	No charge	No charge	NDS 391	N/A
Connection of Security Cameras NOTE: SA Power Networks pole rental extra, also energy tariff to retailer for unmetered supply	Security camera fitted to Stobie pole. Single connection (Multiple connections at the one location will incur additional costs)		\$209.00	\$229.90	NDS 392	N/A
	Security camera fitted to light column		\$474.00	\$521.40	NDS 393	N/A
Larceny of Supply - remedial work	Remedial costs where larceny or tampering of SA Power Networks equipment is established (does not include investigation)		Full cost	Full cost	NDS 394	N/A
Responsible Person as defined in NEM	Customers via their retailers may designate SA Power Networks in MSATS to be responsible for this role. If SA Power Networks choose to accept this role in MSATS then it would be implied that the customer / retailer will accept the annual charge	Annual fee charged monthly	\$2,083.00	\$2,291.30	NDS 395	N/A
Wasted Visit – Customer Connection Appointment	Where SA Power Networks was unable to complete the connection or metering works due to the customers installation not being ready or compliant		\$76.00	\$83.60	NDS 396	N/A

Miscellaneous Fees (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Late Cancellation of Connection Appointment	Where a connection appointment is cancelled within less than 48 hours of the connection date by the customer or their agent.		\$76.00	\$83.60	NDS 397	N/A
Site inspection	A site inspection in order to determine the nature of the requested connection service	Allows 2 hours with travelling	\$209.00	\$229.90	NDS 398	N/A
Negotiation Fee	This fee covers the SA Power Networks Management costs when a customer elects to negotiate the Terms and Conditions of the On Going Connection Contract. The fee includes the cost of resources in the negotiation process. This is in addition to the offer letter fee	Minimum fee \$400 for up to 4 hours	\$372.73 plus \$93.18 per hour thereafter	\$410 plus \$102.50 per hour thereafter	NDS 399	N/A
Late payment fee	A late payment fee is charged for non payment of an invoice by the due date The late fee is for processing and sending a new invoice Further costs will be incurred if further debt recovery is required		\$65.00	\$71.50	NDS 400	N/A

Miscellaneous Fees (cont.)

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Priority Appointment or Pre-arranged out of hours appointment for new connection or alternation of supply (fixed or anytime)	Provision of a priority connection at the customer's request. Work will be undertaken out of hours or during normal business hours in which case another job will be done after hours to accommodate the requested connection date. Note. When calculating the charge apply the appropriate dollar figure per person having to attend site. Example given below is for a Fixed Appointment time eg 2 Linesman being 2X\$350 = \$700 eg 1 Electrical Mechanic 1X\$350 = \$350 eg Combination 1 Mechanic & 2 Linesman 3X\$350 = \$1,050	Fixed appointment up to 3hrs (inc requests for specific time and weekends). Additional hours charged at the "no fixed appt." rate below	\$364.00 per person	\$400.40 per person	NDS 401	NSC15 / AAC09
		No fixed appointment – arranged next available time i.e. straight after last job	\$104.00 per person per hour	\$114.40 per person per hour	NDS 402	NSC16 / AAC10
Fee for Reconnection and Disconnection (Retailer Fee)	Includes fee for disconnection and reconnection of supply	D/N at meter	\$32.00	\$35.20	NDS 403	DNFE
		R/C at meter	\$32.00	\$35.20	NDS 404	RCFE
		R/C at meter A/Hours	\$71.00	\$78.10	NDS 405	RCAH
	The fee for reconnection or disconnection at the meter assumes replacement or removal of the fuse at an existing supply point.	D/N at Pole	Full cost	Full cost	NDS 406	PDNFE
		R/C at Pole	Full cost	Full cost	NDS 407	PRCFE
		R/C at Pole A/Hours	Full cost	Full cost	NDS 408	PDNAH

Public Lighting

Category	Service Description	Option	Price (GST Exclusive)	Price (GST Inclusive)	Fee Code	Retail Product Code
Temporary Public Lighting NB: SA Power Networks must notify Council's retailer.	Erection and removal of a second light on an existing lighting pole.	80W MV	\$233.00	\$256.30	NDS 409	N/A
		360W HPS	\$233.00	\$256.30	NDS 410	N/A
	Erection and removal of a light on an existing pole or column.	360W HPS	\$181.00	\$199.10	NDS 411	N/A
Night Security Lighting NB: Retailer authorisation must be sighted before connection.	Install a security light where requested, (includes future removal cost).	360W & 400W (HPS or MV)	\$370.00	\$407.00	NDS 412	N/A
		360W HPS & 400W MV	\$115.00	\$126.50	NDS 414	N/A
	Where a school requests light and agrees to retain it for a minimum 5 years.		\$78.00 plus remaining SLUoS if less than 15 years old	\$85.80 plus remaining SLUoS if less than 15 years old	NDS 415	N/A
Installation of an Aeroscreen	Conversion of existing fitting to reduce glare.	80W MV, 50 HPS or 42W CF	\$83.00	\$91.30	NDS 416	N/A
	New Installation.		\$515.00	\$566.50	NDS 417	N/A
Installation of Long Pipe Bracket	For installations after 1/7/05 an upfront capital contribution is in place of the ongoing tariff	Per Hour	\$91.00	\$100.10	NDS 418	N/A
Charge For Road Lighting Design Compliance To AS 1158 Assessment	This charge may be applied to a council which uses a service provider external to SA Power Networks to supply road lighting schemes/designs, which when constructed, will be vested to or installed on SA Power Networks plant, i.e. non CLER.					

Fees for Provision of Public Lighting

Street Lighting

ID	SERVICE	OPTION	PRICE (Excl GST)	PRICE (Incl GST)
PPL 502	SLUos (\$ pa)	Fluorescent 40	\$ 87.50	\$ 96.25
PPL 503		Compact Fluorescent 32	\$ 91.00	\$ 100.10
PPL 504		Compact Fluorescent 42	\$ 91.00	\$ 100.10
PPL 506		Fluorescent 2x20	\$ 106.70	\$ 117.37
PPL 507		Fluorescent 2x40	\$ 106.70	\$ 117.37
PPL 508		Fluorescent 4x40	\$ 106.70	\$ 117.37
PPL 509		Fluorescent 4x20	\$ 106.70	\$ 117.37
PPL 510		Fluorescent T5 X 2 tubes	\$ 78.30	\$ 86.13
PPL 511		Sodium 18 LP	\$ 79.10	\$ 87.01
PPL 512		Sodium 26 LP	\$ 79.10	\$ 87.01
PPL 513		Sodium 50 HP	\$ 84.90	\$ 93.39
PPL 514		Mercury 50	\$ 66.60	\$ 73.26
PPL 516		Mercury 80	\$ 66.60	\$ 73.26
PPL 517		Incandescent 60	\$ 95.20	\$ 104.72
PPL 518		Incandescent 100	\$ 97.10	\$ 106.81
PPL 519		Metal Halide 50	\$ 108.10	\$ 118.91
PPL 520		Metal Halide 70	\$ 108.10	\$ 118.91
PPL 525	CLER (\$ pa)	Fluorescent 20	\$ 42.20	\$ 46.42
PPL 526		Fluorescent 40	\$ 42.20	\$ 46.42
PPL 527		Compact Fluorescent 32	\$ 36.50	\$ 40.15
PPL 528		Compact Fluorescent 42	\$ 36.50	\$ 40.15
PPL 530		Fluor/Gas Tube 2x8	\$ 47.80	\$ 52.58
PPL 531		Fluorescent 2x20	\$ 47.80	\$ 52.58
PPL 532		Fluorescent 2x40	\$ 47.80	\$ 52.58
PPL 533		Fluorescent 4x40	\$ 47.80	\$ 52.58
PPL 534		Fluorescent 4x20	\$ 47.80	\$ 52.58
PPL 535		Fluorescent T5 X 2 tubes	\$ 29.10	\$ 32.01
PPL 536		Sodium 18 LP	\$ 42.60	\$ 46.86
PPL 537		Sodium 26 LP	\$ 42.60	\$ 46.86
PPL 538		Sodium 50 HP	\$ 26.10	\$ 28.71
PPL 539		Mercury 50	\$ 26.10	\$ 28.71
PPL 540		Mercury 70	\$ 26.10	\$ 28.71
PPL 541		Mercury 80	\$ 24.40	\$ 26.84
PPL 542		Metal Halide 50	\$ 61.80	\$ 67.98
PPL 543		Metal Halide 70	\$ 61.80	\$ 67.98
PPL 548	Energy Only (\$ pa)	Sodium 50 HP	\$ 6.90	\$ 7.59
PPL 549		LED Ribbon Flex Strip	\$ 6.90	\$ 7.59
PPL 550		Metal Halide 70	\$ 6.90	\$ 7.59
PPL 551		Metal Halide 150	\$ 6.90	\$ 7.59
PPL 552		RUUD LED 20x1.3W	\$ 6.90	\$ 7.59
PPL 553		RUUD LED 30x1.3W	\$ 6.90	\$ 7.59
PPL 554		Sodium 18	\$ 6.90	\$ 7.59

Fees for Provision of Public Lighting (cont.)
Road Lighting

ID	SERVICE	OPTION	PRICE (Excl GST)	PRICE (Incl GST)
PPL 555	SLUos (\$ pa)	Sodium 55 LP	\$ 101.60	\$ 111.76
PPL 556		Sodium 70 HP	\$ 99.00	\$ 108.90
PPL 557		Sodium 90 LP	\$ 99.00	\$ 108.90
PPL 558		Sodium 135 LP	\$ 99.00	\$ 108.90
PPL 560		Mercury 125	\$ 81.50	\$ 89.65
PPL 561		Mercury 250	\$ 81.50	\$ 89.65
PPL 562		Mercury 400	\$ 84.30	\$ 92.73
PPL 563		Mercury 2x400	\$ 84.10	\$ 92.51
PPL 565		Sodium 100 HP	\$ 95.20	\$ 104.72
PPL 566		Sodium 150 HP	\$ 84.30	\$ 92.73
PPL 567		Sodium 250 HP	\$ 85.10	\$ 93.61
PPL 568		Sodium 400 HP	\$ 87.00	\$ 95.70
PPL 521		Metal Halide 100	\$ 108.10	\$ 118.91
PPL 522		Metal Halide 150	\$ 108.10	\$ 118.91
PPL 523		Metal Halide 250	\$ 103.70	\$ 114.07
PPL 524		Metal Halide 400	\$ 103.70	\$ 114.07
PPL 569	CLER (\$ pa)	Sodium 55 LP	\$ 50.60	\$ 55.66
PPL 570		Sodium 70 HP	\$ 41.70	\$ 45.87
PPL 571		Sodium 90 LP	\$ 41.90	\$ 46.09
PPL 572		Sodium 135 LP	\$ 45.70	\$ 50.27
PPL 573		Mercury 100	\$ 26.30	\$ 28.93
PPL 574		Mercury 125	\$ 26.30	\$ 28.93
PPL 575		Mercury 250	\$ 27.30	\$ 30.03
PPL 576		Mercury 400	\$ 28.10	\$ 30.91
PPL 577		Mercury 2x400	\$ 28.10	\$ 30.91
PPL 578		Mercury 3x125	\$ 28.10	\$ 30.91
PPL 579		Sodium 100 HP	\$ 32.80	\$ 36.08
PPL 580		Sodium 150 HP	\$ 31.60	\$ 34.76
PPL 581		Sodium 250 HP	\$ 32.80	\$ 36.08
PPL 582		Sodium 400 HP	\$ 32.80	\$ 36.08
PPL 544		Metal Halide 100	\$ 61.80	\$ 67.98
PPL 545		Metal Halide 150	\$ 61.80	\$ 67.98
PPL 546		Metal Halide 250	\$ 57.00	\$ 62.70
PPL 547		Metal Halide 400	\$ 57.00	\$ 62.70
PPL 583	Energy Only (\$ pa)	Sodium 100 HP	\$ 6.90	\$ 7.59

Fees for Provision of Public Lighting (cont.)

Flood Lighting

ID	SERVICE	OPTION	PRICE (Excl GST)	PRICE (Incl GST)
PPL 584	SLUos (\$ pa)	Mercury Flood 80	\$ 177.30	\$ 195.03
PPL 585		Mercury Flood 250	\$ 177.30	\$ 195.03
PPL 586		Mercury Flood 400	\$ 177.30	\$ 195.03
PPL 588		Mercury Flood 1000	\$ 177.30	\$ 195.03
PPL 589		Sodium Flood 360 HP	\$ 177.30	\$ 195.03
PPL 590		Sodium Flood 400 HP	\$ 177.30	\$ 195.03
PPL 591		Incandescent Flood 150	\$ 177.30	\$ 195.03
PPL 593		Incandescent Flood 500	\$ 177.30	\$ 195.03
PPL 594		Incandescent Flood 750	\$ 177.30	\$ 195.03
PPL 597	CLER (\$ pa)	Mercury Flood 80	\$ 99.00	\$ 108.90
PPL 598		Mercury Flood 250	\$ 99.00	\$ 108.90
PPL 599		Mercury Flood 400	\$ 99.00	\$ 108.90
PPL 600		Mercury Flood 750	\$ 99.00	\$ 108.90
PPL 601		Mercury Flood 1000	\$ 99.00	\$ 108.90
PPL 602		Sodium Flood 360 HP	\$ 99.00	\$ 108.90
PPL 603		Sodium Flood 400 HP	\$ 99.00	\$ 108.90
PPL 604		Incandescent Flood 150	\$ 99.00	\$ 108.90
PPL 609		Incandescent Flood 1500	\$ 99.00	\$ 108.90
PPL 610	Other Items (\$ pa)	Long pipe	\$ 18.10	\$ 19.91
PPL 611		Closed Circuit Television	\$ 54.60	\$ 60.06

10. FEEDER CHARGES

10.1 Background to these charges

Some large customers have negotiated with SA Power Networks for the use of existing SA Power Networks assets to supply more reliability or access to a better tariff. These customers are aware of these negotiated charges that are increased by CPI annually on 1 July. The prices exclude GST.

Standby Feeder and Asset Charges 2013/14

\$ per month excl GST

NMI Number	Charge type	Monthly charge
2002108649	Standby Feeder Charge	\$2,033.83
2002108650	Standby Feeder Charge	\$959.83
2002147255	Standby Feeder Charge	\$16,374.53
SAAAAAA104	Standby Feeder Charge	\$14,525.03
SAAAAAA177	Standby Feeder Charge	\$9,528.60
SAAAAAA323	Standby Feeder Charge	\$6,135.74
SAAAAAA814	Standby Feeder Charge	\$3,264.87
SAAAAAA891	Standby Feeder Charge	\$3,538.40
SAAAAAB123	Standby Feeder Charge	\$2,183.27
2002174265	Standby Feeder Charge	\$11,031.79
SAAAAAC195	Standby Feeder Charge	\$2,509.51
SAAAAAB017	Standby Feeder Charge	\$5,671.49
SAAAAAA256	Standby Feeder Charge	\$18,357.04
2002106430	Dedicated Asset Charge	\$5,948.98
SAAAAAA022	Dedicated Feed Charge	\$19,155.17
SAAAAAA026	Dedicated Feed Charge	\$4,040.82
2002155381	Dedicated Feed Charge	\$9,355.53
2001000608	Dedicated Feed Charge	\$2,244.90
2002112609	Substation Charge	\$52,381.00

11. TARIFF SCHEDULE FOR 2013-14

The 2013-14 tariff schedule is provided on the following pages.

Clarification to Sub-Transmission and Back-up tariffs from 1 October 2013.

Tariff Rates effective from 1 July 2013 – 30 September 2013 are still available via SA Power Networks website.

SA Power Networks NETWORK TARIFFS APPLIES TO USAGE FROM 1 JULY 2013									
Customer Category	Units	Min Qty.	DUOS excl GST	METER excl GST	Total SA-PN excl GST	TUOS excl GST	PV JSO excl GST	Total excl GST	Total incl GST
Low Voltage Residential - Single Rate									
Supply Rate	\$/day		0.278752	0.084115	0.362867		0.000000	0.362867	0.399154
Block 1 Usage Rate	\$/kWh	First 333.3 kWh/m	0.092466		0.092466	0.023339	0.017816	0.133622	0.146984
Block 2 Usage Rate	\$/kWh	Next 500 kWh/mth	0.120487		0.120487	0.033559	0.018207	0.172253	0.189478
Block 3 Usage Rate	\$/kWh	Next 833.3 kWh/m	0.143338		0.143338	0.040832	0.021660	0.205830	0.226413
Block 4 Usage Rate	\$/kWh	Balance Usage	0.143338		0.143338	0.040832	0.021660	0.205830	0.226413
Low Voltage Residential - Single Rate with Controlled Load									
Supply Rate	\$/day		0.278752	0.084115	0.362867		0.000000	0.362867	0.399154
Block 1 Usage Rate	\$/kWh	First 333.3 kWh/m	0.092466		0.092466	0.023339	0.017816	0.133622	0.146984
Block 2 Usage Rate	\$/kWh	Next 500 kWh/mth	0.120487		0.120487	0.033559	0.018207	0.172253	0.189478
Block 3 Usage Rate	\$/kWh	Next 833.3 kWh/m	0.143338		0.143338	0.040832	0.021660	0.205830	0.226413
Block 4 Usage Rate	\$/kWh	Balance Usage	0.143338		0.143338	0.040832	0.021660	0.205830	0.226413
Controlled Load Block 1 Usage	\$/kWh	First 666.7 kWh/m	0.035194		0.035194	0.007853	0.005318	0.048365	0.053201
Controlled Load Block 2 Usage	\$/kWh	Balance Usage	0.047780		0.047780	0.007853	0.007220	0.062854	0.069139
Low Voltage Business - 2 Rate									
Supply Rate	\$/day		0.278752	0.084115	0.362867		0.000000	0.362867	0.399154
Peak Block 1 Usage Rate	\$/kWh	First 1,666.7 kWh/	0.136322		0.136322	0.040391	0.021368	0.198082	0.217890
Peak Block 2 Usage Rate	\$/kWh	Next 6,666.7 kWh/	0.136322		0.136322	0.040391	0.020600	0.197313	0.217044
Peak Block 3 Usage Rate	\$/kWh	Next 8,333.3 kWh/	0.136322		0.136322	0.040391	0.020600	0.197313	0.217044
Peak Block 4 Usage Rate	\$/kWh	Balance Usage	0.136322		0.136322	0.040391	0.020600	0.197313	0.217044
Off-Peak Usage Rate	\$/kWh		0.043043		0.043043	0.007540	0.006504	0.057087	0.062796
High Voltage Business - 2 Rate									
Supply Rate	\$/day		0.278752	0.084115	0.362867		0.000000	0.362867	0.399154
Peak Block 1 Usage Rate	\$/kWh	First 1,666.7 kWh/	0.136322		0.136322	0.040391	0.021368	0.198082	0.217890
Peak Block 2 Usage Rate	\$/kWh	Next 6,666.7 kWh/	0.136322		0.136322	0.040391	0.020600	0.197313	0.217044
Peak Block 3 Usage Rate	\$/kWh	Next 8,333.3 kWh/	0.136322		0.136322	0.040391	0.020600	0.197313	0.217044
Peak Block 4 Usage Rate	\$/kWh	Balance Usage	0.136322		0.136322	0.040391	0.020600	0.197313	0.217044
Off-Peak Usage Rate	\$/kWh		0.043043		0.043043	0.007540	0.006504	0.057087	0.062796
Low Voltage Unmetered Usage (Overnight Usage)									
Anytime Usage Rate	\$/kWh		0.059341		0.059341	0.014558	0.008967	0.082866	0.091153
Low Voltage Unmetered Usage (24 Hour Usage)									
Anytime Usage Rate	\$/kWh		0.052792		0.052792	0.012412	0.007977	0.073181	0.080500
Low Voltage Stepped Demand (KVA)									
Supply Rate	\$/day	min 80 KVA	0.000000		0.000000		0.000000	0.000000	0.000000
Annual Block 1 Demand Rate	\$/kVA/mth	First 100 KVA	13.095927		13.095927	3.338488	1.978925	18.413340	20.254674
Annual Block 2 Demand Rate	\$/kVA/mth	Next 150 KVA	7.639836		7.639836	3.338488	1.154455	12.132780	13.346058
Annual Block 3 Demand Rate	\$/kVA/mth	Next 750 KVA	5.593598		5.593598	3.338488	0.845248	9.777334	10.755068
Annual Block 4 Demand Rate	\$/kVA/mth	Balance KVA	4.228347		4.228347	3.338488	0.638945	8.205781	9.026359
Additional Demand	\$/kVA/mth		4.228347		4.228347	0.000000	0.638945	4.867293	5.354022
Peak Usage Rate	\$/kWh		0.027010		0.027010	0.007146	0.004082	0.038237	0.042061
Off-Peak Usage Rate	\$/kWh		0.027010		0.027010	0.007146	0.004082	0.038237	0.042061
High Voltage Stepped Demand (KVA) <1,000kVA									
Supply Rate	\$/day	min 80 KVA	0.000000		0.000000		0.000000	0.000000	0.000000
Annual Block 1 Demand Rate	\$/kVA/mth	First 100 KVA	13.095927		13.095927	3.338488	1.978925	18.413340	20.254674
Annual Block 2 Demand Rate	\$/kVA/mth	Next 150 KVA	7.639836		7.639836	3.338488	1.154455	12.132780	13.346058
Annual Block 3 Demand Rate	\$/kVA/mth	Next 750 KVA	5.593598		5.593598	3.338488	0.845248	9.777334	10.755068
Annual Block 4 Demand Rate	\$/kVA/mth	Balance KVA	4.228347		4.228347	3.338488	0.638945	8.205781	9.026359
Additional Demand	\$/kVA/mth		4.228347		4.228347	0.000000	0.638945	4.867293	5.354022
Peak Usage Rate	\$/kWh		0.027010		0.027010	0.007146	0.004082	0.038237	0.042061
Off-Peak Usage Rate	\$/kWh		0.027010		0.027010	0.007146	0.004082	0.038237	0.042061
High Voltage Stepped Demand (KVA)									
Supply Rate	\$/day	min 1,000 KVA	0.000000		0.000000		0.000000	0.000000	0.000000
Annual Block 1 Demand Rate	\$/kVA/mth	First 1,000 KVA	5.384063		5.384063	3.267728	0.813586	9.465376	10.411914
Annual Block 2 Demand Rate	\$/kVA/mth	Next 2,000 KVA	3.260886		3.260886	3.267728	0.492752	7.021366	7.723503
Annual Block 3 Demand Rate	\$/kVA/mth	Balance KVA	2.509507		2.509507	3.267728	0.379212	6.156446	6.772091
Additional Demand	\$/kVA/mth		2.509507		2.509507	0.000000	0.379212	2.888718	3.177599
Peak Usage Rate	\$/kWh		0.023278		0.023278	0.006983	0.003518	0.033779	0.037157
Off-Peak Usage Rate	\$/kWh		0.023278		0.023278	0.006983	0.003518	0.033779	0.037157
Zone Sub-station (KVA) (Load <10MW and Consumption <40GWh pa)									
Supply Rate	\$/day								
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA	2.509507		2.509507	3.190008	0.379212	6.078726	6.686599
Additional Demand	\$/kVA/mth		1.746669		1.746669	0.000000	0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa	0.008185		0.008185	0.006867	0.001237	0.016289	0.017918
Off-Peak Usage Rate	\$/kWh		0.008185		0.008185	0.006867	0.001237	0.016289	0.017918
Subtransmission (KVA) (Load <10MW and Consumption <40GWh pa)									
Supply Rate	\$/day								
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA	0.764475		0.764475	3.190008	0.115520	4.070002	4.477002
Additional Demand	\$/kVA/mth		0.764475		0.764475	0.000000	0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh		0.002734		0.002734	0.006867	0.000413	0.010014	0.011016
Off-Peak Usage Rate	\$/kWh		0.002734		0.002734	0.006867	0.000413	0.010014	0.011016
Zone Sub-station (KVA) Locational									
TUoS Supply Charge	\$/day					locational		locational	locational
Supply Rate	\$/day								
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA	2.509507		2.509507	locational	0.379212	locational	locational
Additional Demand	\$/kVA/mth		1.746669		1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa	0.008185		0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh		0.008185		0.008185		0.001237	0.009422	0.010364
Subtransmission (KVA) Locational									
TUoS Supply Charge	\$/day					locational		locational	locational
Supply Rate	\$/day								
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA	0.764475		0.764475	locational	0.115520	locational	locational
Additional Demand	\$/kVA/mth		0.764475		0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh		0.002734		0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh		0.002734		0.002734		0.000413	0.003147	0.003462

SA Power Networks NETWORK TARIFFS									
APPLIES TO USAGE FROM 1 JULY 2013									
Zone Substation (KVA) Locational			NMI						
TUoS Supply Charge	\$/day		2001000608	0.000000	0.000000	40.352210	0.000000	40.352210	44.387431
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA		2.509507	2.509507	4.412730	0.379212	7.301448	8.031593
Additional Demand	\$/kVA/mth			1.746669	1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa		0.008185	0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh			0.008185	0.008185		0.001237	0.009422	0.010364
TUoS Supply Charge	\$/day		2002133131	0.000000	0.000000	134.297790	0.000000	134.297790	147.727669
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA		2.509507	2.509507	4.382000	0.379212	7.270718	7.997790
Additional Demand	\$/kVA/mth			1.746669	1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa		0.008185	0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh			0.008185	0.008185		0.001237	0.009422	0.010364
TUoS Supply Charge	\$/day		SAAAAAA021	0.000000	0.000000	378.394460	0.000000	378.394460	416.233906
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA		2.509507	2.509507	6.012780	0.379212	8.901498	9.791648
Additional Demand	\$/kVA/mth			1.746669	1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa		0.008185	0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh			0.008185	0.008185		0.001237	0.009422	0.010364
TUoS Supply Charge	\$/day		SAAAAAA022	0.000000	0.000000	122.330660	0.000000	122.330660	134.563726
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA		2.509507	2.509507	4.390680	0.379212	7.279398	8.007338
Additional Demand	\$/kVA/mth			1.746669	1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa		0.008185	0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh			0.008185	0.008185		0.001237	0.009422	0.010364
TUoS Supply Charge	\$/day		SAAAAAA024	0.000000	0.000000	151.903210	0.000000	151.903210	167.093531
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA		2.509507	2.509507	4.390910	0.379212	7.279628	8.007691
Additional Demand	\$/kVA/mth			1.746669	1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa		0.008185	0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh			0.008185	0.008185		0.001237	0.009422	0.010364
TUoS Supply Charge	\$/day		SAAAAAA026	0.000000	0.000000	30.942550	0.000000	30.942550	34.036805
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA		2.509507	2.509507	4.456380	0.379212	7.345098	8.079608
Additional Demand	\$/kVA/mth			1.746669	1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa		0.008185	0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh			0.008185	0.008185		0.001237	0.009422	0.010364
TUoS Supply Charge	\$/day		SAAAAAA035	0.000000	0.000000	177.883970	0.000000	177.883970	195.672367
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA		2.509507	2.509507	5.927880	0.379212	8.816598	9.698258
Additional Demand	\$/kVA/mth			1.746669	1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa		0.008185	0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh			0.008185	0.008185		0.001237	0.009422	0.010364
TUoS Supply Charge	\$/day		SAAAAAA438	0.000000	0.000000	70.639870	0.000000	70.639870	77.703857
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA		2.509507	2.509507	4.408370	0.379212	7.297088	8.026797
Additional Demand	\$/kVA/mth			1.746669	1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa		0.008185	0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh			0.008185	0.008185		0.001237	0.009422	0.010364
Sub-Transmission (KVA) Locational			NMI						
TUoS Supply Charge	\$/day		2001000378	0.000000	0.000000	363.554550	0.000000	363.554550	399.910005
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	5.347580	0.115520	6.227574	6.850332
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
TUoS Supply Charge	\$/day		2002112609	0.000000	0.000000	1,546.530770	0.000000	1,546.530770	1,701.183847
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	6.135770	0.115520	7.016764	7.717341
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
TUoS Supply Charge	\$/day		2002213788	0.000000	0.000000	1,099.214520	0.000000	1,099.214520	1,209.135972
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	0.903110	0.115520	1.783104	1.961415
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
TUoS Supply Charge	\$/day		2002213796	0.000000	0.000000	121.125370	0.000000	121.125370	133.237907
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	4.347420	0.115520	5.227414	5.750156
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
TUoS Supply Charge	\$/day		2002216840	0.000000	0.000000	805.184860	0.000000	805.184860	885.703362
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	1.074920	0.115520	1.954914	2.150406
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
TUoS Supply Charge	\$/day		2002217226	0.000000	0.000000	271.233950	0.000000	271.233950	298.357345
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	4.553500	0.115520	5.433494	5.976844
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
TUoS Supply Charge	\$/day		2002246502	0.000000	0.000000	2,525.327580	0.000000	2,525.327580	2,777.860338
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	1.074920	0.115520	1.954914	2.150406
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
TUoS Supply Charge	\$/day		SAAAAAA018	0.000000	0.000000	568.262300	0.000000	568.262300	625.088530
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	5.970990	0.115520	6.850984	7.536083
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
TUoS Supply Charge	\$/day		SAAAAAA084	0.000000	0.000000	881.446110	0.000000	881.446110	969.590721
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	5.347580	0.115520	6.227574	6.850332
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
TUoS Supply Charge	\$/day		SAAAAAA567	0.000000	0.000000	1,267.640890	0.000000	1,267.640890	1,394.404979
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA		0.764475	0.764475	2.523800	0.115520	3.403794	3.744174
Additional Demand	\$/kVA/mth			0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh			0.002734	0.002734		0.000413	0.003147	0.003462

SA Power Networks NETWORK TARIFFS
APPLIES TO USAGE FROM 1 JULY 2013

OBSOLETE TARIFFS									
High Voltage Obsolete (KVA)									
Supply Rate	\$/day				0.000000			0.000000	0.000000
Annual Demand Rate	\$/kVA/mth	min 100 KVA	5.384063	5.384063	3.267728	0.813586	9.465376	10.411914	
Additional Demand	\$/kVA/mth		2.509507	2.509507	0.000000	0.379212	2.888718	3.177590	
Peak Usage Rate	\$/kWh		0.023278	0.023278	0.006983	0.003518	0.033779	0.037157	
Off-Peak Usage Rate	\$/kWh		0.023278	0.023278	0.006983	0.003518	0.033779	0.037157	
Low Voltage Business - Single Rate									
Supply Rate	\$/day		0.278752	0.084115	0.362867	0.000000	0.000000	0.362867	0.399154
Block 1 Usage Rate	\$/kWh	First 833.3 kWh/m	0.103622	0.103622	0.029116	0.017196	0.149933	0.164927	
Block 2 Usage Rate	\$/kWh	Next 7,500 kWh/m	0.122365	0.122365	0.033756	0.018491	0.174612	0.192073	
Block 3 Usage Rate	\$/kWh	Next 8,333.3 kWh/m	0.129650	0.129650	0.036598	0.019591	0.185839	0.204423	
Block 4 Usage Rate	\$/kWh	Balance Usage	0.129650	0.129650	0.036598	0.019591	0.185839	0.204423	
Low Voltage Business - Single Rate with Controlled Load									
Supply Rate	\$/day		0.278752	0.084115	0.362867	0.000000	0.000000	0.362867	0.399154
Block 1 Usage Rate	\$/kWh	First 833.3 kWh/m	0.103622	0.103622	0.029116	0.017196	0.149933	0.164927	
Block 2 Usage Rate	\$/kWh	Next 7,500 kWh/m	0.122365	0.122365	0.033756	0.018491	0.174612	0.192073	
Block 3 Usage Rate	\$/kWh	Next 8,333.3 kWh/m	0.129650	0.129650	0.036598	0.019591	0.185839	0.204423	
Block 4 Usage Rate	\$/kWh	Balance Usage	0.129650	0.129650	0.036598	0.019591	0.185839	0.204423	
Controlled Load Block 1 Usage	\$/kWh	First 666.7 kWh/m	0.035194	0.035194	0.007853	0.005318	0.048366	0.053201	
Controlled Load Block 2 Usage	\$/kWh	Balance Usage	0.047780	0.047780	0.007853	0.007220	0.062854	0.069139	
Low Voltage Business - 2 Rate with Controlled Load									
Supply Rate	\$/day		0.278752	0.084115	0.362867	0.000000	0.000000	0.362867	0.399154
Peak Block 1 Usage Rate	\$/kWh	First 1,666.7 kWh/m	0.136322	0.136322	0.040391	0.021368	0.198082	0.217890	
Peak Block 2 Usage Rate	\$/kWh	Next 6,666.7 kWh/m	0.136322	0.136322	0.040391	0.020600	0.197313	0.217044	
Peak Block 3 Usage Rate	\$/kWh	Next 8,333.3 kWh/m	0.136322	0.136322	0.040391	0.020600	0.197313	0.217044	
Peak Block 4 Usage Rate	\$/kWh	Balance Usage	0.136322	0.136322	0.040391	0.020600	0.197313	0.217044	
Off-Peak Usage Rate	\$/kWh		0.043043	0.043043	0.007540	0.006504	0.057087	0.062796	
Controlled Load Block 1 Usage	\$/kWh	First 666.7 kWh/m	0.035194	0.035194	0.007853	0.005318	0.048366	0.053201	
Controlled Load Block 2 Usage	\$/kWh	Balance Usage	0.047780	0.047780	0.007853	0.007220	0.062854	0.069139	
Low Voltage Controlled Load									
Controlled Load Block 1 Usage	\$/kWh	First 666.7 kWh/m	0.035194	0.035194	0.007853	0.005318	0.048366	0.053201	
Controlled Load Block 2 Usage	\$/kWh	Balance Usage	0.047780	0.047780	0.007853	0.007220	0.062854	0.069139	

Back up supply tariffs:

These tariffs are only available for sites with more than one National Market Meter Identifier where the second NMI is for a back up supply to the site on a stepped demand tariff. Typically these sites are customers with greater than 4MVA demands and for critical infrastructure; eg Water assets, Hospitals, telecommunications sites or data centre's. These tariffs recognise that the primary NMI demand charges are contributing to the transmission costs for the site. The back up NMI's are charging for the demand at the Distribution Use of System charge and the energy component of the tariff is equal to the primary NMI tariff rates.

Low Voltage Stepped Demand (KVA) Back up supply								
		min 80 KVA						
Supply Rate	\$/day		0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 1 Demand Rate	\$/kVA/mth	First 100 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 2 Demand Rate	\$/kVA/mth	Next 150 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 3 Demand Rate	\$/kVA/mth	Next 750 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 4 Demand Rate	\$/kVA/mth	Balance KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Additional Demand	\$/kVA/mth		4.228347	4.228347	0.000000	0.638945	4.867293	5.354022
Peak Usage Rate	\$/kWh		0.027010	0.027010	0.007146	0.004082	0.038237	0.042061
Off-Peak Usage Rate	\$/kWh		0.027010	0.027010	0.007146	0.004082	0.038237	0.042061
High Voltage Stepped Demand (KVA) Back up supply								
		min 80 KVA						
Supply Rate	\$/day		0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 1 Demand Rate	\$/kVA/mth	First 100 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 2 Demand Rate	\$/kVA/mth	Next 150 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 3 Demand Rate	\$/kVA/mth	Next 750 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 4 Demand Rate	\$/kVA/mth	Balance KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Additional Demand	\$/kVA/mth		4.228347	4.228347	0.000000	0.638945	4.867293	5.354022
Peak Usage Rate	\$/kWh		0.027010	0.027010	0.007146	0.004082	0.038237	0.042061
Off-Peak Usage Rate	\$/kWh		0.027010	0.027010	0.007146	0.004082	0.038237	0.042061
High Voltage Stepped Demand (KVA) Back up Supply								
		min 1,000 KVA						
Supply Rate	\$/day		0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 1 Demand Rate	\$/kVA/mth	First 1,000 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 2 Demand Rate	\$/kVA/mth	Next 2,000 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Annual Block 3 Demand Rate	\$/kVA/mth	Balance KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Additional Demand	\$/kVA/mth		2.509507	2.509507	0.000000	0.379212	2.888718	3.177590
Peak Usage Rate	\$/kWh		0.023278	0.023278	0.006983	0.003518	0.033779	0.037157
Off-Peak Usage Rate	\$/kWh		0.023278	0.023278	0.006983	0.003518	0.033779	0.037157
Zone Sub-station (KVA) (Load <10MW and Consumption <40GWh pa) Back up Supply								
Supply Rate	\$/day		0.000000	0.000000	0.000000	0.000000	0.000000	
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Additional Demand	\$/kVA/mth		1.746669	1.746669	0.000000	0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa	0.008185	0.008185	0.006867	0.001237	0.016289	0.017918
Off-Peak Usage Rate	\$/kWh		0.008185	0.008185	0.006867	0.001237	0.016289	0.017918
Subtransmission (KVA) (Load <10MW and Consumption <40GWh pa) Back up Supply								
Supply Rate	\$/day							
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA	0.000000	0.000000	0.000000	0.000000	0.000000	0.000000
Additional Demand	\$/kVA/mth		0.764475	0.764475	0.000000	0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh		0.002734	0.002734	0.006867	0.000413	0.010014	0.011016
Off-Peak Usage Rate	\$/kWh		0.002734	0.002734	0.006867	0.000413	0.010014	0.011016
Zone Sub-station (KVA) Locational Back up Supply								
TUoS Supply Charge	\$/day				locational		locational	locational
Supply Rate	\$/day							
Annual Demand Rate	\$/kVA/mth	min 5,000 KVA	0.000000	0.000000	locational	0.000000	locational	locational
Additional Demand	\$/kVA/mth		1.746669	1.746669		0.263939	2.010608	2.211669
Peak Usage Rate	\$/kWh	min 25 GWh pa	0.008185	0.008185		0.001237	0.009422	0.010364
Off-Peak Usage Rate	\$/kWh		0.008185	0.008185		0.001237	0.009422	0.010364
Subtransmission (KVA) Locational Back up Supply								
TUoS Supply Charge	\$/day				locational		locational	locational
Supply Rate	\$/day							
Annual Demand Rate	\$/kVA/mth	min 10,000 KVA	0.000000	0.000000	locational	0.000000	locational	locational
Additional Demand	\$/kVA/mth		0.764475	0.764475		0.115520	0.879994	0.967994
Peak Usage Rate	\$/kWh		0.002734	0.002734		0.000413	0.003147	0.003462
Off-Peak Usage Rate	\$/kWh		0.002734	0.002734		0.000413	0.003147	0.003462

12. NOTES ACCOMPANYING 2013/14 TARIFFS

Notes:

1. Distribution tariffs are determined on a GST exclusive basis. GST is added to the distribution tariffs.
2. SA Power Networks must assign each Distribution Network User to a distribution tariff in respect of each of its connection points in accordance with the following principles.
 - (a) A Distribution Network User connected to the Distribution Network from 1 July 2010 requiring more than 100 amps (75kVA) supply must be assigned to a distribution network tariff that includes a demand component in respect of that connection point.
 - (b) A Distribution Network User connected to the Distribution Network at 30 June 2011 that has a maximum demand of 250kVA or more in respect of a connection point, must be assigned to a distribution tariff that includes a demand component in respect of that connection point.
 - (c) A Sub-Transmission (kVA) Network User is a Distribution Network User taking supply at 66kV, or at 33kV outside of the Adelaide Metropolitan area. A minimum annual demand of 10 MVA applies. A NEM compliant type 1-4 interval meter is required with the ability to measure both active and reactive power. These tariffs are invoiced monthly.
 - (d) A Zone Substation (kVA) customer is a Distribution Network User taking supply generally at 11kV from the low voltage transformer terminals. Supply may also be taken at lower voltages that exceed 1kV. A minimum annual demand of 5 MVA and a minimum annual usage of 25GWh apply. A NEM compliant type 1-4 interval meter is required with the ability to measure both active and reactive power. These tariffs are invoiced monthly.
 - (e) A High Voltage Stepped Demand (kVA) customer is a Distribution Network User taking supply generally at 11kV. Supply may also be taken at lower voltages that exceed 1kV or at 33kV in metropolitan Adelaide. A minimum annual demand of 1 MVA applies. The steps to be applied to the annual demand are detailed in the Tariff Schedule. A NEM compliant type 1-4 interval meter is required with the ability to measure both active and reactive power. These tariffs are invoiced monthly.
 - (f) A High Voltage Stepped Demand (kVA) <1,000 kVA customer is a Distribution Network User taking supply generally at 11kV with a kVA demand generally less than 1,000 kVA. Supply may also be taken at lower voltages that exceed 1kV or at 33kV in metropolitan Adelaide. A minimum annual demand of 80kVA applies. The steps to be applied to the annual demand are detailed in the Tariff Schedule. A NEM compliant type 1-4 interval meter is required with the ability to measure both active and reactive power. These tariffs are invoiced monthly.
 - (g) A High Voltage (kVA) (Obsolete) customer is a Distribution Network User taking supply generally at 11kV. This tariff is available only to Distribution Network Users that were taking supply under the High Voltage Demand (kW) (Obsolete) tariff as at 11 October 1999. Supply may also be taken at lower voltages that exceed 1kV or at 33kV in metropolitan Adelaide. A minimum annual demand of 100kVA applies. A NEM compliant type 1-5 interval meter is required with the ability to measure both active and reactive power. An excluded charge applies for the monthly reading of Type 5 meters. These tariffs are invoiced monthly.
 - (h) A High Voltage Business 2 rate customer is a Distribution Network User taking supply generally at 11kV. Supply may also be taken at lower voltages that exceed 1kV or at 33kV in metropolitan Adelaide. A NEM compliant type 1-5 interval meter is required with the ability to measure both active and reactive power. Peak consumption is charged at four blocks of consumption and is detailed in the Tariff Schedule. Off Peak consumption is charged at a flat rate. An excluded service charge applies where SA Power Networks is required to read the type 1-4 meter (eg for tier one customers and for tier two customers < 160MWh pa). This tariff is available only to Distribution Network Users requiring less than 80kVA demand, except where a Distribution Network User was taking supply under this tariff as at 30 June 2010. This tariff is invoiced monthly. An excluded charge applies for the monthly reading of Type 5 meters.
 - (i) A Low Voltage Stepped Demand (kVA) customer is a Distribution Network User generally taking supply at less than 1kV and generally from the low voltage distribution transformer

terminals. A minimum agreed maximum demand of 80KVA applies. The steps to be applied to the annual demand are detailed in the Tariff Schedule. A NEM compliant type 1-5 interval meter is required with the ability to measure both active and reactive power. An excluded charge applies for the monthly reading of Type 5 meters. These tariffs are invoiced monthly.

- (j) A Low Voltage Business 2 rate customer is a Distribution Network User that is not a residential customer generally taking supply at less than 1kV and using peak and off-peak network charges. The User utilises a type 1-6 NEM compliant meter. Where a Type 1-5 meter is utilised, the meter must have the ability to measure both active and reactive power. Peak consumption is charged at four blocks of consumption and is detailed in the Tariff Schedule. Off Peak consumption is charged at a flat rate. An excluded service charge applies where SA Power Networks is required to read the type 1-4 meter (eg for tier one customers and for tier two customers < 160MWh pa). This tariff is available only to Distribution Network Users requiring less than 80kVA demand, except where a Distribution Network User was taking supply under this tariff as at 30 June 2010 and where the customer's supply arrangements have not altered. An excluded charge also applies for the monthly reading of Type 5-6 meters. This tariff is invoiced monthly or quarterly.
- (k) A Low Voltage Business single rate customer is a Distribution Network User that is not a residential customer generally taking supply at less than 1kV. Consumption is charged at four blocks of consumption and is detailed in the Tariff Schedule. The User utilises a type 1-6 NEM compliant meter. Where a Type 1-5 meter is utilised, the meter must have the ability to measure both active and reactive power. Consumption is charged at four blocks of consumption and is detailed in the Tariff Schedule. An excluded service charge applies where SA Power Networks is required to read the type 1-4 meter (eg for tier one customers and for tier two customers < 160MWh pa). An excluded charge also applies for the monthly reading of Type 5-6 meters. This tariff is available only to Distribution Network Users that were taking supply under this tariff as at 30 June 2010 and where the customer's supply arrangements have not altered. This tariff is invoiced monthly or quarterly.
- (l) A Low Voltage Residential single rate customer is a Distribution Network User that is a residential customer taking supply at less than 1kV. Consumption is charged at four blocks of consumption and is detailed in the Tariff Schedule. The User utilises a type 1-6 NEM compliant meter. Where a Type 1-5 meter is utilised, the meter must have the ability to measure both active and reactive power. Consumption is charged at four blocks of consumption and is detailed in the Tariff Schedule. An excluded service charge applies where SA Power Networks is required to read the type 1-4 meter (eg for tier one customers and for tier two customers < 160MWh pa). An excluded charge also applies for the monthly reading of Type 5-6 meters. This tariff is invoiced monthly or quarterly.
- (m) A Low Voltage Controlled Load is used by a Distribution Network User for permanently installed storage water heaters with a rated delivery of not less than 125 litres, storage space heaters and other approved applications involving a time switch and separate metering where the timing has been set in accordance with SA Power Networks' requirements regarding the timing of loads. Consumption is charged at two rates, one rate for consumption up to and including 666.7 kWh/mth[#] and another rate for the balance of consumption. This tariff is available only to Distribution Network Users that were taking supply under the Controlled Load tariff as at 30 June 2003, or are utilising a business single or residential tariff at the NMI in conjunction with the controlled load. This tariff is invoiced at the same frequency as other tariffs used by the Distribution Network User at that NMI.
- (n) Unmetered Overnight Usage supply is defined as overnight use by a Distribution Network User for public lighting. These tariffs are generally invoiced monthly, unless otherwise agreed by SA Power Networks.
- (o) Unmetered 24 Hour Usage supply is defined as constant 24 hour per day use by a Distribution Network User, typically public phones, traffic lights and telecommunications installations. These tariffs are generally invoiced monthly, unless otherwise agreed by SA Power Networks.

(p) Back up tariffs are only available to sites that have a primary supply with a NMI on a demand tariff described above. These tariffs have a B in the description eg VLVSBI. The steps to be applied to the annual demand are detailed in the Tariff Schedule. A NEM compliant type 1-4 interval meter is required with the ability to measure both active and reactive power. These tariffs are invoiced monthly.

3. The supply and demand charges are levied and billed to Distribution Network Users periodically on a pro-rata basis.

4. Demand charges are determined on the basis of:

- (a) Agreed maximum demand (Annual Demand); and
- (b) Agreed additional maximum demand (Additional Demand), determined in accordance with Schedule 2 of Part B of the 2005-2010 Electricity Distribution Price Determination.

5. Peak energy is energy consumed on business days between the hours of 0700 and 2100 (Central Standard Time). For Distribution Network Users with metering that does not recognise specific days, peak energy is energy consumed on each day between the hours of 0700 and 2100 (Central Standard Time).

6. Off-peak energy is energy consumed other than peak energy.

7.

- (a) 333.3 kWh/mth approximates 4,000 kWh per annum;
- (b) 500 kWh/mth approximates 6,000 kWh per annum;
- (c) 666.7 kWh/mth approximates 8,000 kWh per annum;
- (d) 833.3 kWh/mth approximates 10,000 kWh per annum;
- (e) 6,666.7 kWh/mth approximates 80,000 kWh per annum;
- (f) 7,500 kWh/mth approximates 90,000 kWh per annum; and
- (g) 8,333.3 kWh/mth approximates 100,000 kWh per annum.

8. The following meter charges apply

- | | |
|--|-----------------------------------|
| • Meter Provision Type 6 Direct Current Connected | \$30.7021 per annum excl GST. |
| • Meter Provision Type 6 Current Transformer Connected | \$133.0950 per annum excl GST. |
| • Meter Provision Type 1-4 Exceptional | \$472.6027 per annum excl GST. |
| • Meter Service Other Meter Provider Customer | \$0.0000 per annum |
| • Meter Service Exit Fee Type 6 CT | \$256.84 excl GST per transaction |
| • Meter Service Exit Fee Type 1-4 | \$573.46 excl GST per transaction |

Residential, Business Single Rate and Business Two Rate tariffs incorporate the Type 6 Direct Current Connected Meter Charge. If a customer assigned to these tariffs is using that meter then no further adjustments are required.

If a customer assigned to a Residential, Business Single Rate or Business Two Rate tariff is using a Type 6 Current Transformer Connected Meter, then an additional charge of the difference from the Type 6 Direct Current Connected Meter will apply.

If a customer assigned to a Residential, Business Single Rate or Business Two Rate tariff is using another meter provider's meter, then the Type 6 Direct Current Connected Meter charge will be rebated.

For those customers on demand tariffs that are using a Type 1-4 Exceptional meter then an additional charge of the Type 1-4 Exceptional Meter will apply. A Type 1-4 Exceptional Meter is meter provision services provided in respect of meters meeting the requirements of a metering installation type 1, metering installation type 2, metering installation type 3 or metering installation type 4 installed prior to 1 July 2000 provided in accordance with the requirement of clause 27 of SA Power Networks' distribution licence as in force at 30 June 2005.

Exit fees apply to type 6 CT meters and to Type 1-4 Exceptional meters where customers elect to switch to another meter type and/or meter provider.

Tariff Mapping Table

Current Tariffs

Tariff	Applicable Tariff Code
Low Voltage Residential – Single Rate	QSR QSRi MSR MSRi MSRi MSRii
Low Voltage Residential – Single Rate with Controlled Load	QSRPCL QSRiPCL MSRPCL MSRiPCL MSRiPCL MSRiiPCL
Low Voltage Business – Single Rate	QBSR QBSRi MSR MSRi BSR124 BSR124i BSR124Ni
Low Voltage Business – Single Rate with Controlled Load	QBSROPCL QBSROPCLi MSROPCL MSROPCLi BSR124OPCL BSR124OPCLi
Low Voltage Business – Two Rate	QB2R QB2Ri MB2R MB2Ri B2R124 B2R124i B2R124Ni
High Voltage Business – Two Rate	B2R124H B2R124Hi
Low Voltage Unmetered Usage (Overnight Usage)	LVUU LVUUi
Low Voltage Unmetered Usage (24 Hour Usage)	LVUU24 LVUU24i
Low Voltage Stepped Demand (KVA)	VLVS VLVSi VLVSNi
High Voltage Stepped Demand (KVA) <1,000KVA	VHLVS VHLVSi
High Voltage Stepped Demand (KVA)	VHVS VHVSi VHVSNi
Zone Sub-station (KVA) (Load <10MW and Consumption <40GWh pa)	VZS VZSi
Zone Sub-station (KVA) Locational	VZSNXXX VZSNXXXi
Subtransmission (KVA) Locational	VSTNXXX VSTNXXXi

Obsolete Tariffs

Tariff	Applicable Tariff Code
High Voltage Obsolete (KVA)	VHVO VHVOi
Low Voltage Business – Two Rate with Controlled Load	QB2ROPCL QB2ROPCLi MB2ROPCL MB2ROPCLi B2R124OPCL B2R124OPCLi
Low Voltage Controlled Load	QOPCL QOPCLi MOPCL MOPCLi