



TXU NETWORKS

NETWORK TARIFF REPORT

2004



TABLE OF CONTENTS

2004 Network Tariff Report	3
NETWORK TARIFFS	3
DISTRIBUTION USE OF SYSTEM TARIFFS	4
TARIFF PRINCIPLES	4
<i>Allocation of Charges between levels of supply</i>	4
ALLOCATION OF CHARGES BETWEEN FIXED AND VARIABLE COMPONENTS	5
<i>Standing Charge - Fixed</i>	5
<i>Peak Energy Charge - Variable</i>	5
<i>Shoulder Energy Charge - Variable</i>	6
<i>Off Peak Energy Charge - Variable</i>	6
<i>Demand Charge - Variable</i>	6
<i>Deep System Assets</i>	6
<i>Common Service Assets</i>	6
DERIVATION OF DUOS TARIFFS	6
TRANSMISSION TARIFFS	7
2004 NETWORK TARIFFS	7
CLOSED TARIFFS	8
<i>Tariffs Closed & Customers Transferred</i>	8
<i>Tariffs Closed to New Entrants</i>	8
IMPACT OF NETWORK TARIFFS	8
2004 NETWORK TARIFF DESCRIPTION	9
<i>Small Low Voltage Tariffs (Nominal Voltage < 1000 Volts), < 50 kVA and < 160MWh</i>	9
<i>Residential Tariffs</i>	9
<i>Dedicated Supplies (Storage Water and Space Heating)</i>	12
<i>Small Business Tariffs</i>	16
<i>Medium Customer Tariffs > 50 kVA & < 150 kVa and > 160MWh & < 400MWh</i>	19
<i>Voltage Customer Tariffs > 150 kVA and > 400MWh</i>	26
<i>Large Low Voltage Customer Tariffs > 150 kVA and > 400MWh</i>	27
<i>High Voltage Tariffs (NOMINAL VOLTAGE > 1000 VOLTS)</i>	32
<i>Sub-transmission Customer Tariffs</i>	35
RULES APPLYING TO DEMAND TARIFFS	37
RULES APPLYING TO REASSIGNMENT OF NETWORK TARIFFS	37
AVOIDABLE COST OF SERVICE AND STAND ALONE COST CONSIDERATIONS	37

Published by the
Network Pricing Team
TXU Networks
Level 35, 385 Bourke Street
Melbourne 3000

Telephone (03) 8628 1381 Facsimile (03) 8628 1388



2004 Network Tariff Report

As part of the Essential Services Commission's (ESC) Electricity Distribution Price Review, the ESC placed an obligation on each distribution business to publish an annual Tariff Report. The Tariff Report should include the following:

- a) The distribution and transmission tariffs charged by the distributor;
- b) A discussion of the policy framework and tariff principles adopted by the distributor in framing the structures and level of its tariffs;
- c) An explanation of the basis on which the distributor has determined the appropriate breakdown between fixed and variable charges;
- d) The rationale for the introduction of any new tariffs, or the withdrawal of tariffs;
- e) An explanation of how the distributor has had regard to the consideration of upper and lower bounds in determining its distribution tariffs;
- f) The extent to which the tariff structures adopted provide efficient consumption signals to distribution customers;
- g) The methodology adopted for allocating transmission-related costs to distribution customers through its transmission tariffs; and
- h) An estimate of the average annual distribution and transmission charge (in \$) for each combination of distribution and transmission tariff.

Network Tariffs

TXU Networks levies Network Tariffs on customers supplied with electricity within its Distribution Area outlined in Schedule 2 of its Distribution Licence as varied on 28th August 2001. Through the application of network tariffs TXU Networks recovers revenue for the ownership, operation and management of its Distribution system, as well as payments for access to and use of transmission services provided by SPI Powernet, VENCorp and approved embedded generators.

TXU Networks' Distribution System receives electricity at 66,000 and 22,000 volts, at Terminal stations. The TXU Networks system then transforms the electricity to 22,000 volts, 11,000 volts, 6,600 volts, 415 volts or 240/230 volts and transports the electricity to individual customer connection points for use by customers.

Network Tariffs consist of two components:

- 1. Distribution Use of System Charges (DUoS) to recover revenue associated with regulated services for the distribution business; and
- 2. Transmission Use of System Charges (TUoS) to recover the costs of transmission use of system services (discussed in section Transmission Tariffs below).



Distribution Use of System Tariffs

The DUoS Tariffs set out the Distribution component of the Network Tariffs that apply throughout TXU Networks distribution area. DUoS tariffs are designed to recover:

- a) The costs of operating, maintaining and augmenting the distribution network; and
- b) A return on asset that allows the distributor to earn a rate of return determined by the ESC.

TXU Networks uses a cost of supply model to allocate DUoS costs to the different tariff classes and components according to their use of the distribution network. The distribution network consists of five voltage levels of supply. These are:

1. Sub-transmission Lines;
2. Sub-transmission-to-high voltage transformation;
3. High voltage lines;
4. High voltage-to-low voltage transformation; and
5. Low voltage lines.

Costs are allocated to customer tariff classes based on the point the customer connects to the network and the use of assets to that connection point. For example, a large sub-transmission customer is connected directly to the sub-transmission lines and therefore incurs the costs and assets associated with the use of sub-transmission assets only. A small residential customer, on the other hand, is connected to the low voltage line and therefore uses all five voltage levels of supply and associated assets. The cost of supplying smaller customers is therefore higher, which is why smaller customers at low voltage levels have higher tariffs compared to larger customers at high voltage levels.

Tariff Principles

Allocation of Charges between levels of supply

TXU Networks DUoS tariffs are established for the three levels of transformation. These are:

1. Sub-transmission, >22,000 volts;
2. High Voltage, >1,000 volts and $\leq$ 22,000 volts; and
3. Low Voltage, <1,000 volts.

Individual DUoS tariffs are made up of a number of price components to reflect different times of use and levels of usage. TXU Networks' Tariffs consist of up to five of the following different price components:



- Standing Charge;
- Block 1 Energy Charge;
- Block 2 Energy Charge;
- Peak Energy Charge;
- Shoulder Energy Charge;
- Off Peak Energy Charge; and
- Demand Charge.

The individual components used in each of the tariffs are largely dependent on the type of metering installed. Low voltage customers with basic single register meters have been assigned to single rate network tariffs; or block network tariffs. A block tariff is where one rate applies for the first block of usage, and another rate applies for the second block of usage.

Where meters with multiple registers are installed with mechanical switching a two-rate seven-day tariff may be assigned. For a two rate five day tariff to be assigned a customer must have a multiple register meter and an electronic time switch or an interval meter capable of recording use over thirty minute or fifteen minute intervals. For large Low Voltage, High Voltage and Sub-transmission customers, current transformer and interval meters, or multiple register meters capable of recording a customer's maximum demand, are required to enable billing of all tariff components.

Allocation of Charges between Fixed and Variable Components

Standing Charge - Fixed

The Standing Charge is a fixed charge that recovers the network unavoidable customer costs. These costs are typically infrastructure costs such as service connection, standard metering, Use of System billing and collection. Meter reading costs are now recovered as an excluded service charge to retailers for whom the service is provided.

Peak Energy Charge - Variable

For single rate customers, the Peak Energy Charge recovers all other non-standing charge costs associated with use of the distribution system. Where customers are assigned to a two-rate tariff without a demand component the peak energy charge recovers the costs associated with the customer's local system demand and a contribution to deep system demand. A portion of the common use asset cost is also recovered from the peak energy charge. For those customers where a demand component is included in the tariff structure, the peak energy charge recovers a portion of the deep system demand costs and a portion of the common use asset costs.



Shoulder Energy Charge - Variable

The Shoulder Energy Charge was introduced in 2003. The shoulder rate is intended to recover the same costs as a peak energy charge, with a reduced rate (relative to the peak rate) to reflect the system load profile of TXU's network.

Off Peak Energy Charge - Variable

The off peak energy charge recovers costs associated with common use assets alone.

Demand Charge - Variable

The demand charge, where applied, recovers from customers the costs associated with infrastructure assets installed to meet local demand and a portion of deep system demand. TXU Networks only applies a demand charge to customers who use more than 160 MWh per annum, as these customers contribute more to network usage at peak times.

Deep System Assets

For low voltage customers, distribution deep system assets are high voltage line and protection assets, zone substation assets, and sub-transmission assets. For high voltage customers, distribution deep system assets are zone substation assets and sub-transmission assets. For sub-transmission customers, distribution deep system assets are sub-transmission connection assets at Terminal stations. For all customers, all transmission assets are deep system assets.

Common Service Assets

Common Service Assets for each customer group are those assets that support the supply to all customers supplied from the network in the customers' local area.

Derivation of DUoS Tariffs

Once costs of the distribution network (operation & maintenance, return on assets) have been isolated at each voltage level and allocated between fixed and variable components, DUoS tariffs can be derived.

Cost reflective DUoS tariffs are derived by dividing the costs by the associated quantities (customer numbers, energy, and maximum demands). For example, the standing charge costs, such as provision of metering equipment and service line to the customer's premises, are divided by the total number of customers supplied within a tariff class. This calculation derives a dollar amount per customer, which becomes the standing charge.

Once cost reflective tariffs have been derived, tariffs are further adjusted to comply with the ESC's electricity distribution price controls, which allow tariffs to be adjusted, on average, by CPI-1%. In order to recover the required revenue, as set by the ESC, some tariffs are adjusted upwards, while other tariffs must be adjusted downwards so that the overall price control is met.

In 2004 an adjustment was made to the electricity distribution price controls through the addition of an 'S Factor'. The S Factor is a service adjustment made to the price controls that is designed to provide a reward to distribution businesses for improving



reliability above pre-established benchmarks. In 2002, TXU did not meet the benchmarks set for unplanned interruption duration, unplanned interruption frequency and planned minutes off supply such that a 2.56% decrease was made to the 2004 distribution price control.

The schedule of DUoS tariffs as approved by the ESC that apply throughout TXU Networks distribution area is set out in Attachment 1.

Transmission Tariffs

Transmission Use of System (TUoS) Charges are set by TXU Networks to recover the costs associated with the transmission system. These are pass-through amounts payable to VENCORP and SPI PowerNet and approved embedded generators and cover:

- The costs incurred by SPI PowerNet to provide and maintain the transmission system;
- The costs incurred by VENCORP in operating the transmission system;
- Equalisation Receipt payable by VENCORP;
- Settlement Residue, which causes a reduction in TUoS charges;
- Prescribed connection services charge payable to SPI PowerNet for connection to the transmission system;
- Excluded connection services payable to SPI PowerNet;
- Inter-network provider distribution service charges receivable from or payable to other distribution businesses for connection to and use of other networks.
- Embedded generator payments, where approved by the ESC.

TXU Networks recovers these pass-through costs from customers through a peak, off-peak and, where applicable, shoulder charge. The off-peak charge has been set at 0.1 cents per kilowatt-hour. The remaining revenue required has been allocated to tariff classes based on the proportion of cost associated with supplying those customers. Dividing the allocated revenue by the total number of peak kilowatt-hours distributed derives the peak unit rate.

The schedule of TUoS tariffs as approved by the ESC that apply throughout TXU Networks distribution area is set out in Attachment 2.

2004 Network Tariffs

In 2004 TXU Networks has thirty-five Network Tariffs. The schedule of Network tariffs (combined DUoS and TUoS Tariffs) as approved by the ESC that apply throughout TXU Networks distribution area is set out in Attachment 3.



Closed Tariffs

Tariffs Closed & Customers Transferred

TXU Networks has not closed any tariffs in 2004 (except for those closed to new entrants, as discussed below).

Tariffs Closed to New Entrants


TXU Networks has closed three Network Tariffs to new entrants:

- NEE30
- NEE31
- NEE32

The closure of the above Network Tariffs also affects combination tariffs NEE13, NEE14, NEE15, NEE16, NEE17, NEE18, NEE41, NEE42 and NEE43.

Impact of Network Tariffs

The following section includes a brief description of TXU's Network Tariffs and provides a comparison of the impact of 2003 and 2004 Network Tariffs on customers by using five usage levels – very low, low, average, high and very high. Average consumption is calculated by dividing energy by the number of customers.¹ The remaining usage levels are calculated by applying a percentage, as shown below, to the average rate.

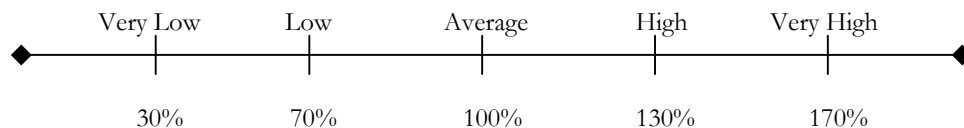

To assess the impact of demand tariffs, a demand level was estimated according to the calculated consumption level in proportion to totals for the network tariff concerned. The demand charge used is the highest of either the calculated amount or the minimum demand for the tariff.

It should be noted that the calculated charges are based on TXU Networks customers and therefore are not comparable to the charges applicable to similar network tariffs for other Distribution Businesses.

¹ Energy and customer numbers used relate to 2002, which are consistent with those submitted to the Essential Services Commission as part of the 2004 Network Tariff Submission.



2004 Network Tariff Description

Small Low Voltage Tariffs (Nominal Voltage < 1000 Volts), < 50 kVA and < 160MWh

Residential Tariffs

NEE11 – Small Residential Block Tariff

This Network Tariff applies only to residential customers who consume less than 160 MWh per annum. The minimum meter requirement for a customer on this tariff is a basic type 6 single register meter.


The Small Residential Block tariff consists of a standing charge and a block usage rate. The first block applies to all usage less than 1,020 kWh per quarter. The second block rate is higher than the first block rate and applies to all usage greater than 1,020 kWh per quarter. The consumption level of 1,020 kWh for the first block was based on the original retail Maximum Uniform Tariff GD/GR.

The two-part block tariff is targeted to allocating more of the demand-related costs to customers with larger annual energy consumption. The higher usage rate for the second block provides a pricing signal to these higher usage customers that relates to the increased demand these customers place on the network at peak times.

The impact of 2003 and 2004 network tariff NEE11 – Small Residential Block on customers is shown below.

	Very Low 1,300 kWh	Low 3,034 kWh	Average 4,334 kWh	High 5,634 kWh	Very High 7,368 kWh
2003	\$110.89	\$199.54	\$267.85	\$342.22	\$441.37
2004	\$111.07	\$200.76	\$269.82	\$344.82	\$444.82
Change	0.16%	0.61%	0.74%	0.76%	0.78%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

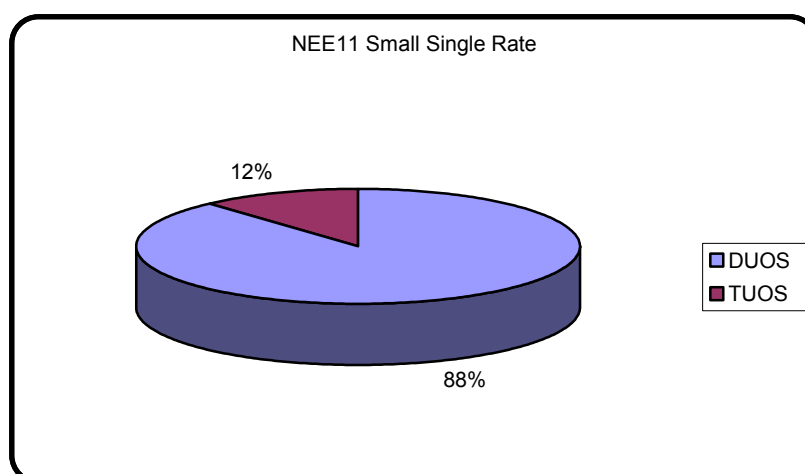



NEE20 – Small Residential Two Rate


The Small Residential two-rate tariff was originally based on the retail Maximum Uniform Tariff GH/GL for residential customers. These customers require, as a minimum, a basic type 6 dual register with an electronic timeswitch, capable of switching all load to off-peak overnight and at weekends.

The two-rate tariff provides customers with incentives to manage load, and is the optimum tariff for small residential customers who are able to move a high proportion of energy consumption to off-peak times over night and on weekends.

The impact of 2003 and 2004 network tariff NEE20 - Small Residential Two Rate on customers is shown below.

	Very Low 2,305 kWh	Low 5,378 kWh	Average 7,682 kWh	High 9,987 kWh	Very High 13,060 kWh
2003	\$140.46	\$223.75	\$286.21	\$348.67	\$431.95
2004	\$145.07	\$232.10	\$297.37	\$362.64	\$449.66
Change	3.28%	3.73%	3.90%	4.01%	4.10%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

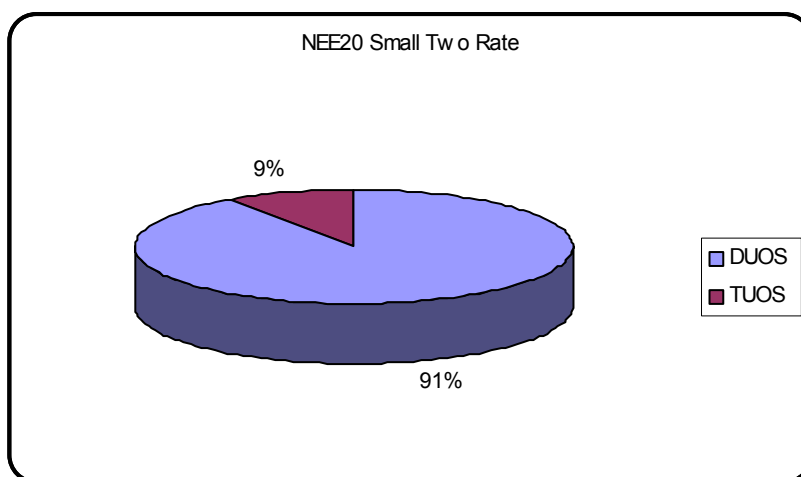



NEE23 – Photovoltaic Tariff

This tariff applies to small customers with grid-connected photovoltaic cells less than or equal to 2kW. Prior to 2003, these customers were placed on a standard network tariff and received payment for the electricity they generated equal to the price that was paid for electricity consumed, that is, export energy equally offset the energy consumed. The diversity of tariffs applied to these customers and offset arrangements created billing and administrative difficulties. NEE23 was introduced to formalise photovoltaic cell billing arrangements and reduce administrative complexity.


Photovoltaic cells customers continue to receive an equal offset for electricity generation, as well as an additional payment for excess generation during summer peak periods (1 November – 30 March).

The impact of 2003 and 2004 network tariff NEE23 - Photovoltaic on customers is shown below.

	Very Low 2,634 kWh	Low 7,777 kWh	Average 11,635 kWh	High 15,493 kWh	Very High 20,636 kWh
2003	\$138.52	\$226.52	\$292.52	\$358.52	\$446.52
2004	\$139.02	\$228.44	\$295.50	\$362.57	\$451.99
Change	0.36%	0.85%	1.02%	1.13%	1.23%

Note that an average offset generation rate was used for all customers.

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user. Note that NEE23 has a slightly lower TUoS component than NEE20, recognising the contribution that photovoltaic customers make towards reducing TUoS costs.

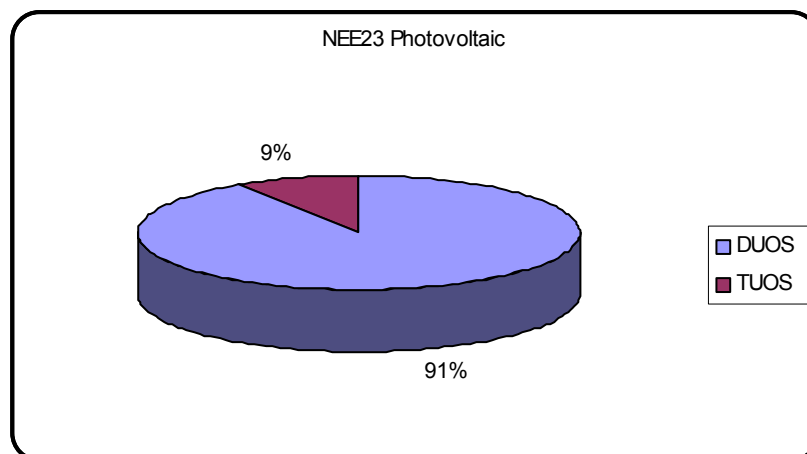



Dedicated Supplies (Storage Water and Space Heating)

TXU Networks has three network tariffs for dedicated supplies. These tariffs are available for controlled loads such as storage water heating and space heating for residential and small business purposes only.


NEE30 – Small Dedicated Circuit (closed to new entrants)

This small dedicated circuit tariff applies to customers with off-peak hot water heating between 11pm and 7am each day. The minimum meter requirements are a basic type 6 single register meter switched by timing device, or a basic type 6 dual register meter with second register switched by timing device.

The impact of 2003 and 2004 network tariff NEE30 - Small Dedicated Circuit on customers is shown below.

	Very Low 895 kWh	Low 2,089 kWh	Average 2,984 kWh	High 3,879 kWh	Very High 5,072 kWh
2003	\$33.55	\$50.28	\$62.83	\$75.38	\$92.11
2004	\$33.04	\$49.89	\$62.53	\$75.17	\$92.02
Change	-1.5%	-0.78%	-0.48%	-0.28%	-0.09%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

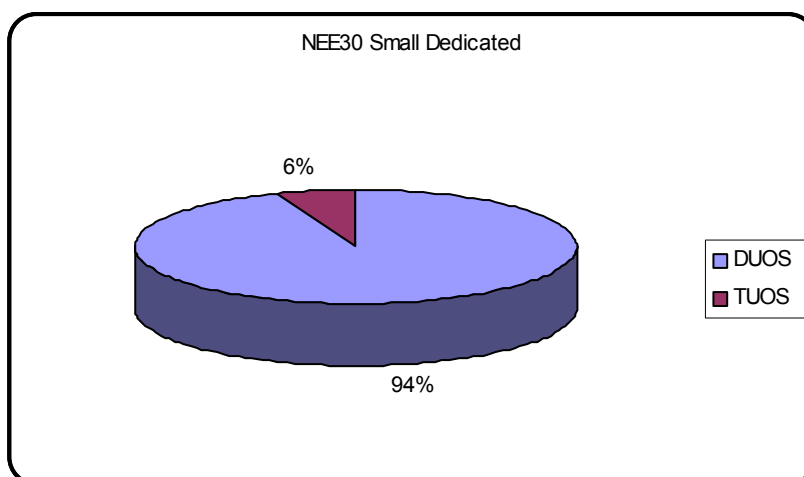



NEE31 – Small Dedicated Circuit Afternoon Boost (closed to new entrants)


The Small Dedicated Circuit Afternoon Boost tariff applies to customers with off-peak space heating, with or without off peak hot water. This tariff has an afternoon heating boost for three hours in addition to heating between 11pm and 7am each day.

The minimum meter requirements are a basic type 6 single register meter switched by timing device, or a basic type 6 dual register meter with second register switched by timing device.

The impact of 2003 and 2004 network tariff NEE31 - Small Dedicated Circuit Afternoon Boost on customers is shown below.

	Very Low 2,239 kWh	Low 5,223 kWh	Average 7,462 kWh	High 9,701 kWh	Very High 12,686 kWh
2003	\$48.08	\$90.58	\$122.46	\$154.34	\$196.84
2004	\$48.59	\$91.78	\$124.18	\$156.57	\$199.76
Change	1.06%	1.32%	1.40%	1.44%	1.48%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

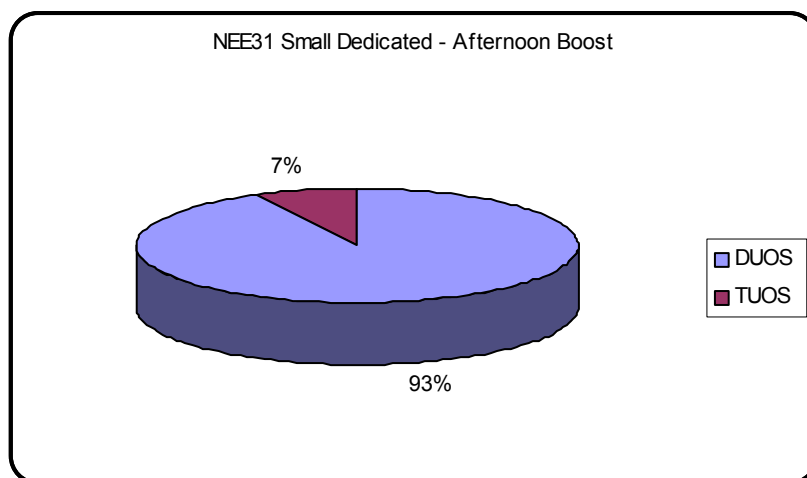



NEE32 - Dedicated Circuit 8pm to 8am (closed to new entrants)


The Small Dedicated Circuit 8pm to 8am tariff was introduced in 2001 and allows TXU Networks to heat hot water for six to eight hours at any time between 8pm and 8am. This may be in two heating blocks of three to four hours. This arrangement allows TXU Networks to manage peak loads better, and is helpful in reducing peak constraint in rural areas. The minimum meter requirements are a basic type 6 single register meter switched by timing device, or a basic type 6 dual register meter with second register switched by timing device.

TXU Networks has over 160,000 customers with dedicated circuits for off peak water heating and space heating requirements. Many of these customers are in rural areas where there are limited alternative energy supplies. As a result the TXU Networks' local network experiences high levels of demand when these appliances switch on for their overnight heating. By introducing the Dedicated Circuit 8pm to 8am tariff which has a twelve hour period available for heating TXU Networks will have the flexibility to vary these switching times without impacting on the customers heating needs. In return for allowing TXU Networks this flexibility customers will in turn receive the benefit of lower charges that are the result of being able to defer some capital investment.

The impact of 2003 and 2004 network tariff NEE32 – Dedicated Circuit 8pm to 8am on customers is shown below.

	Very Low 875 kWh	Low 2,043 kWh	Average 2,918 kWh	High 3,793 kWh	Very High 4,960 kWh
2003	\$31.34	\$45.93	\$56.87	\$67.82	\$82.41
2004	\$31.54	\$46.40	\$57.54	\$68.69	\$83.55
Change	0.64%	1.02%	1.18%	1.28%	1.38%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

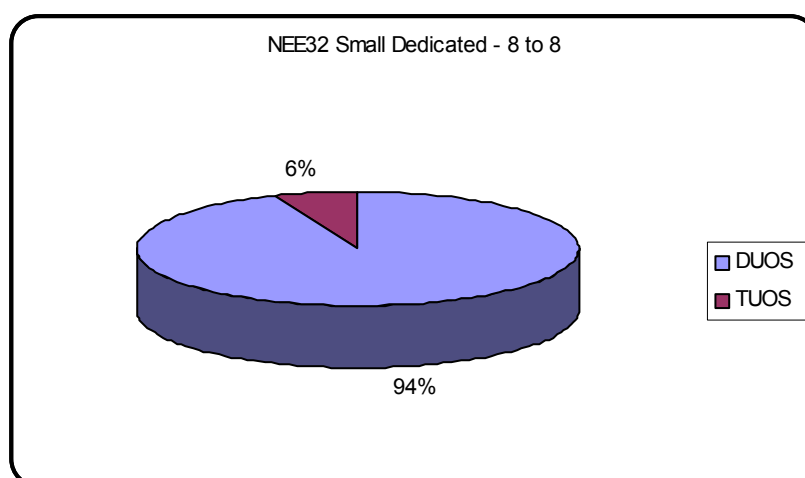



NEE13 – Small Residential Block Tariff & Dedicated Circuit (closed to new entrants)

This tariff was introduced in 2002. It is a combination of the Small Residential Block tariff and Dedicated Circuit tariffs. The rates and metering requirements are the same as the individual tariffs. It was introduced to assist in the contestable market.

The impact of this network tariff on customers is equivalent to the impact of Network Tariffs NEE11 and NEE30.

NEE14 – Small Residential Block Tariff & Dedicated Circuit Afternoon Boost (closed to new entrants)

This tariff was introduced in 2002. It is a combination of the Small Residential Block tariff and Dedicated Circuit Afternoon Boost tariffs. The rates and metering requirements are the same as the individual tariffs. This tariff was introduced to assist in the contestable market.

The impact of this network tariff on customers is equivalent to the impact of Network Tariffs NEE11 and NEE31.

NEE15 – Small Residential Block Tariff & Dedicated Circuit 8am to 8pm (closed to new entrants)

This tariff was introduced in 2002. It is a combination of the Small Residential Block tariff and Dedicated Circuit 8pm to 8am tariffs. The rates and metering requirements are the same as the individual tariffs. It was introduced to assist in the contestable market.

The impact of this network tariff on customers is equivalent to the impact of Network Tariffs NEE11 and NEE32.



Small Business Tariffs

NEE12 - Small Business Block Tariff


The Small Business block Tariff has been designed for TXU Networks small business customers with annual usage of less than 160MWh, and who have, as a minimum, a basic type 6 single register meter.

The Small Business Block tariff has lower energy charges for the first block, which applies to the first 1,020 kWh per quarter, to reflect the lower contribution these small business customers make to peak demand. As consumption increases the contribution to peak demand also increases. By having a higher rate for the second block (all consumption greater than 1,020 kWh) TXU Networks is able to recover the higher costs associated with greater peak demand on the system, and provide appropriate pricing signals to customers.

The impact of 2003 and 2004 network tariff NEE12 - Small Business on customers is shown below.

	Very Low 1,628 kWh	Low 3,798 kWh	Average 5,426 kWh	High 7,054 kWh	Very High 9,224 kWh
2003	\$156.91	\$283.73	\$378.84	\$479.12	\$615.14
2004	\$156.12	\$283.48	\$379.00	\$479.58	\$615.95
Change	-0.50%	-0.08%	0.04%	0.10%	0.13%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

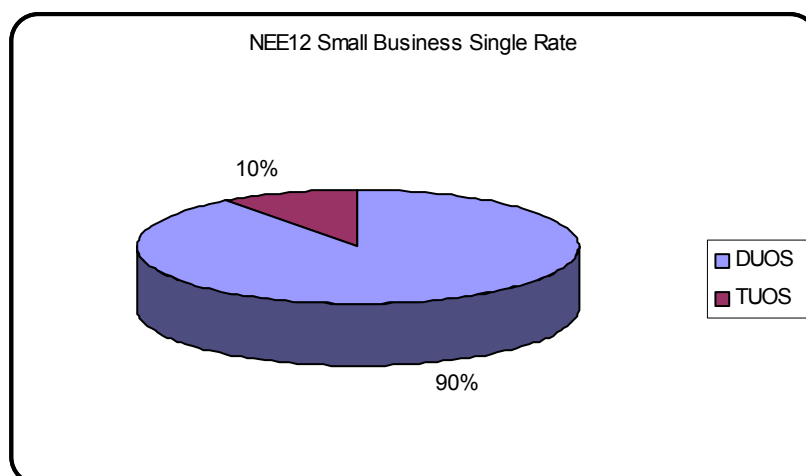



NEE21 - Small Business two rate


TXU Networks has over 26,000 small business customers who are on the Small Business two-rate tariff. Customers on this tariff require, as a minimum, a basic type 6 dual register with an electronic timeswitch, capable of switching all load to off-peak overnight and at weekends.

The Small Business Tariff was opened in 2001 and is intended for businesses that use less than 160MWh per annum. These businesses tend to operate seven days a week and have a high proportion of overnight and weekend consumption. The Small Business tariff was opened to facilitate appropriate pricing to reflect the demand characteristics of these customers.

The impact of 2003 and 2004 network tariff NEE21 - Small Business Two Rate on customers is shown below.

	Very Low 6,334 kWh	Low 14,779 kWh	Average 21,113 kWh	High 27,447 kWh	Very High 35,893 kWh
2003	\$525.48	\$984.52	\$1,328.80	\$1,673.07	\$2,132.11
2004	\$540.84	\$1,017.96	\$1,375.80	\$1,733.65	\$2,210.77
Change	2.92%	3.40%	3.54%	3.62%	3.69%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

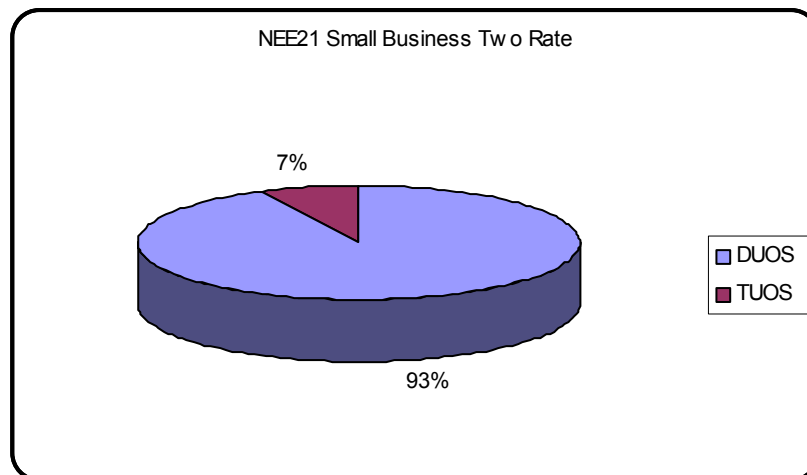



NEE16 – Small Business Block Tariff & Dedicated Circuit (closed to new entrants)

This tariff was introduced in 2002. It is a combination of the Small Business Block tariff and Dedicated Circuit tariffs. The rates and metering requirements are the same as the individual tariffs. This tariff was introduced to assist in the contestable market.

The impact of this network tariff on customers is equivalent to the impact of Network Tariffs NEE12 and NEE30.

NEE17 – Small Business Block Tariff & Dedicated Circuit Afternoon Boost (closed to new entrants)

This tariff was introduced in 2002. It is a combination of the Small Business Block tariff and Dedicated Circuit Afternoon Boost tariffs. The rates and metering requirements are the same as the individual tariffs. This tariff was introduced to assist in the contestable market.

The impact of this network tariff on customers is equivalent to the impact of Network Tariffs NEE12 and NEE31.

NEE18 – Small Business Single Rate & Dedicated Circuit 8am to 8pm (closed to new entrants)

This tariff was introduced in 2002. It is a combination of the Small Business Block tariff and Dedicated Circuit 8am to 8pm tariffs. The rates and metering requirements are the same as the individual tariffs. This tariff was introduced to assist in the contestable market.

The impact of this network tariff on customers is equivalent to the impact of Network Tariffs NEE12 and NEE32.



Medium Customer Tariffs > 50 kVA & < 150 kVa and > 160MWh & < 400MWh

Medium customers are customers that consume between 160MWh and 400MWh per annum, with a maximum demand less than 150 kVA. Examples of this customer class are medium sized commercial and light industrial businesses.


NEE40 – Medium Single Rate Tariff (closed to new entrants)

The Medium Single Rate tariff is available to business and industrial customers that consume between 160MWh and 400MWh per annum. The minimum meter requirements are a basic type 6 single register meter. This network tariff is most suitable for business customers with little overnight or weekend usage.

The impact of 2003 and 2004 network tariff NEE40 – Medium Single Rate on customers is shown below.

	Very Low 3,043 kWh	Low 7,101 kWh	Average 10,145 kWh	High 13,188 kWh	Very High 17,246 kWh
2003	\$244.51	\$492.12	\$677.83	\$863.54	\$1,111.16
2004	\$251.35	\$504.89	\$695.05	\$885.20	\$1,138.74
Change	2.80%	2.59%	2.54%	2.51%	2.48%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

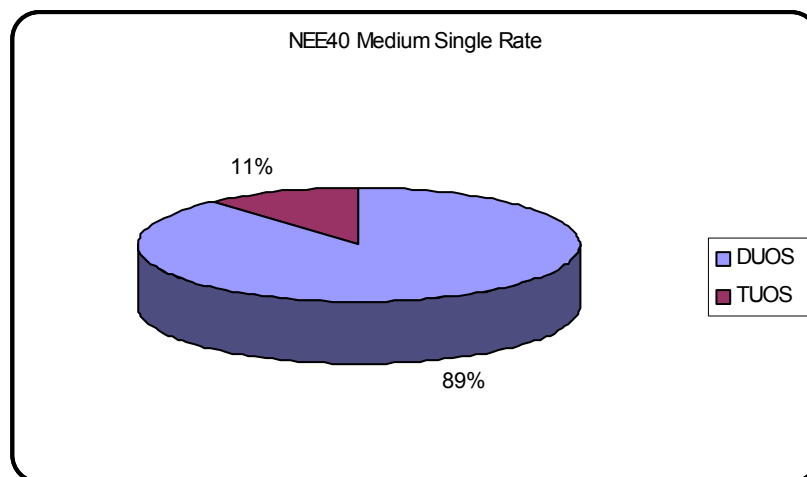



NEE41 – Medium Business Single Rate & Dedicated Circuit (closed to new entrants)

This tariff was introduced in 2002. It is a combination of the Medium Business Single Rate tariff and Dedicated Circuit tariffs. The rates and metering requirements are the same as the individual tariffs. This tariff was introduced to assist in the contestable market.

This network tariff is most suitable for business customers with little overnight or weekend usage, and customers with off-peak hot water services between 11pm and 7am each day.

The metering requirements are basic type 6 dual register meter, with one register capable of being switched for the dedicated circuit.

The impact of this network tariff on customers is equivalent to the impact of Network Tariffs NEE40 and NEE30.

NEE42 – Medium Business Single Rate & Dedicated Circuit Afternoon Boost (closed to new entrants)

This tariff was introduced in 2002. It is a combination of the Medium Business Single Rate tariff and Dedicated Circuit Afternoon Boost tariffs. The rates and metering requirements are the same as the individual tariffs. This tariff was introduced to assist in the contestable market.

This network tariff is most suitable for business customers with little overnight or weekend usage, and customers with off-peak load and off-peak space heating services between 11pm and 7am each day.

The metering requirements are basic type 6 dual register meter, with one register capable of being switched for the dedicated circuit.

The impact of this network tariff on customers is equivalent to the impact of Network Tariffs NEE40 and NEE31.

NEE43 – Medium Business Single Rate & Dedicated Circuit 8am to 8pm (closed to new entrants)

This tariff was introduced in 2002. It is a combination of the Medium Business Single Rate tariff and Dedicated Circuit 8am to 8pm tariffs. The rates and metering requirements are the same as the individual tariffs. This tariff was introduced to assist in the contestable market.

This network tariff is most suitable for business customers with little overnight or weekend usage, and customers with off-peak load and off-peak hot water heating services between 8pm and 8am each day.

The metering requirements are basic type 6 dual register meter, with one register capable of being switched for the dedicated circuit.

The impact of this network tariff on customers is equivalent to the impact of Network Tariffs NEE40 and NEE32.



NEE51 – Medium Two Rate 5-day (closed to new entrants)


The Medium Two Rate 5-day tariff is suitable for businesses with some overnight or weekend usage. Customers benefit from off-peak evening prices and weekend prices.

Customers on this tariff require, as a minimum, a basic type 6 dual register with an electronic timeswitch, capable of switching all load to off-peak overnight and at weekends.

The impact of 2003 and 2004 network tariff NEE51 - Medium Two Rate 5-day on customers is shown below.

	Very Low 21,012 kWh	Low 49,029 kWh	Average 70,041 kWh	High 91,054 kWh	Very High 119,070 kWh
2003	\$1,266.01	\$2,712.41	\$3,797.22	\$4,882.03	\$6,328.44
2004	\$1,283.25	\$2,752.66	\$3,854.71	\$4,956.77	\$6,426.17
Change	1.36%	1.48%	1.51%	1.53%	1.54%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

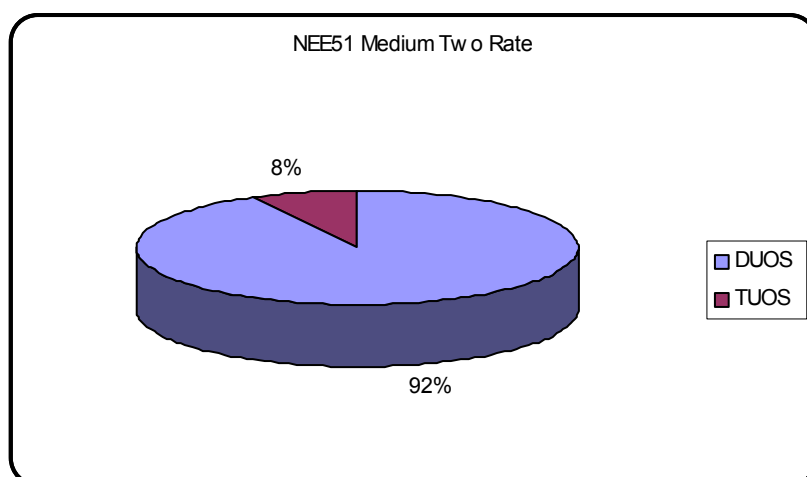



NEE52 – Unmetered Supplies


The unmetered supplies tariff applies to approved supplies up to 50 watts, public lighting, traffic control system and other nominated installations.

There is no physical meter for this tariff. Contestable metrology procedures apply to public lighting installations and deemed loads for all other installations to determine usage.

The impact of 2003 and 2004 network tariff NEE52 – Unmetered Supplies on customers is shown below.

	Very Low 245,465 kWh	Low 572,752 kWh	Average 818,217 kWh	High 1,063 MWh	Very High 1,390 MWh
2003	\$10,631.62	\$24,807.11	\$35,438.73	\$46,070.34	\$60,245.83
2004	\$10,774.43	\$25,140.33	\$35,914.75	\$46,689.18	\$61,055.08
Change	1.34%	1.34%	1.34%	1.34%	1.34%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

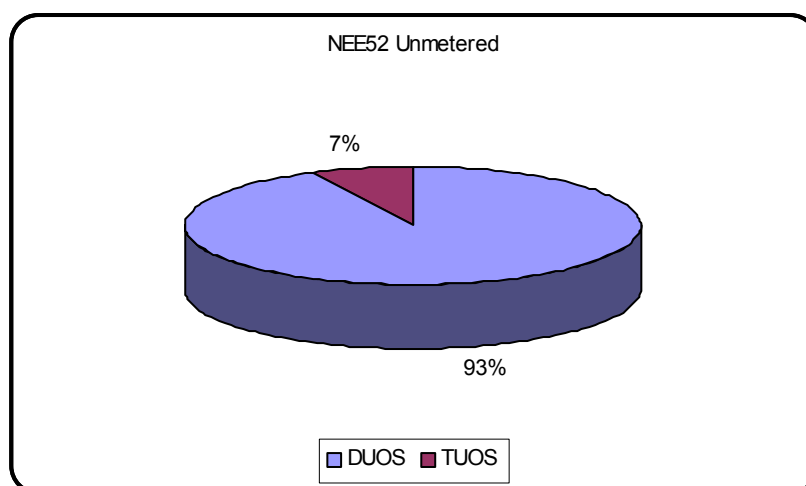



NEE54 - Small & Medium two rate 5 day Interruptible

TXU Networks has over 26,000 customers on small and medium two rate five day tariffs, a further 9,000 customers are on medium two rate seven day tariffs. These customers represent a significant portion of TXU Networks load in the rural network where there are a number of emerging supply constraints. Where these customers are able to allow TXU Networks to switch off a portion of their load for short periods of time during times of high local demand the benefit will be passed on to these customers through lower network charges. The maximum decrease in charges has been set at 12% of the peak energy charge that currently applies to Network Tariffs NEE21 and NEE51.

There are no customers currently on network tariff NEE54 - Small & Medium Two Rate 5 Day. No changes were made to the distribution tariff component of network tariff NEE54 in 2004.



NEE55 – Snowfields Tariff

The Snowfields tariff was introduced in 2002. It applies to customers in specified alpine regions with off-peak (non-winter) consumption, that consume less than 400MWh per annum with maximum demand less than 150kVA.


The Snowfields tariff has been designed to reflect customer usage patterns in the alpine regions. The peak period is from the 1st of May to 30th September each year, and the off-peak period applies to all other times. The Snowfield tariff provides opportunities for tourism and businesses in alpine regions to expand during traditional low-season periods at reduced energy rates.

Customers in alpine regions who use off-peak electricity will benefit from a significantly reduced off-peak charge.

The minimum metering requirement is a basic type 6 single register meter.

As there is only one customer presently on network tariff NEE55, it is not considered appropriate to include an impact analysis. No changes were made to the distribution tariff component of network tariff NEE55 in 2004.

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

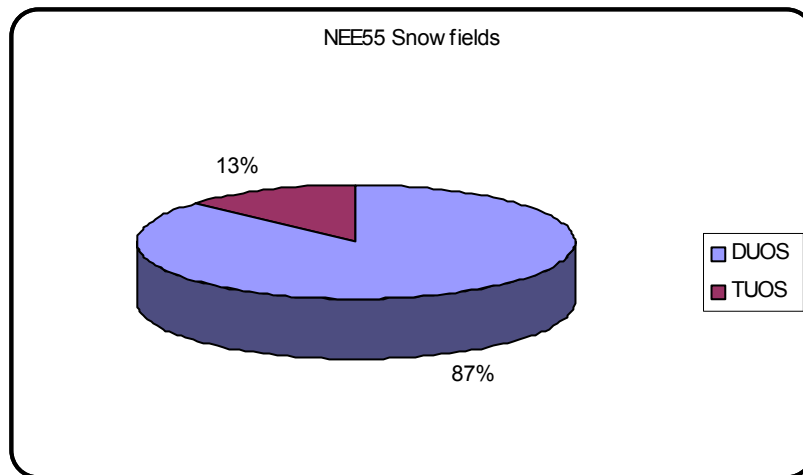



NEE56 – Medium Demand Multi-rate Tariff


This tariff was introduced in 2003 and is applicable to all customers with metering installations capable of recording kVA, as required for all new customers consuming greater than 160 MWh per annum. The structure of this tariff ensures that customers are charged appropriately for the network unavoidable costs associated with these customers and, through the introduction of a shoulder rate, gives pricing signals that more appropriately capture the system load profile of TXU's network.

The impact of 2003 and 2004 network tariff NEE56 – Medium Demand Multi-rate on customers is shown below.

	Very Low kWh	Low 170,351 kWh	Average 243,358 kWh	High 316,366 kWh	Very High 413,709 kWh
2003	N/A	\$10,627.72	\$15,104.81	\$19,581.89	\$25,551.33
2004	N/A	\$10,559.09	\$13,199.61	\$16,635.15	\$21,215.88
Change	N/A	-0.65%	-12.61%	-15.05%	-16.97%

No comparison is given for 'Very Low' consumption, as this would be below the minimum consumption for network tariff NEE56.

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

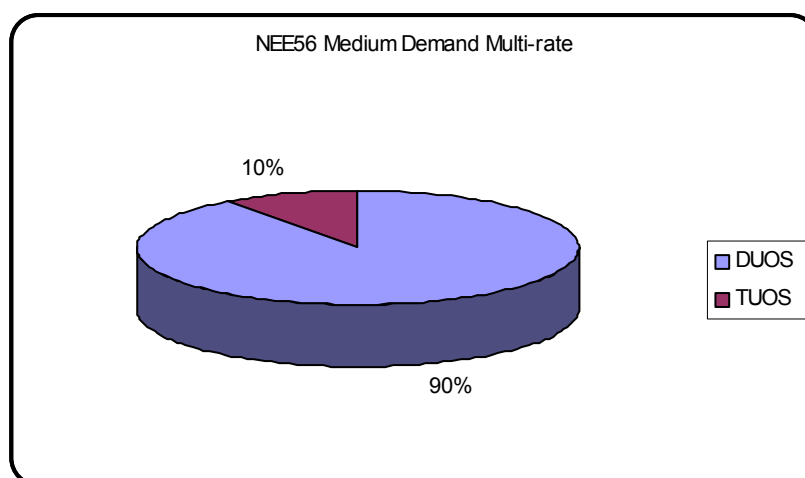



NEE60 – Medium Two Rate 7-day Tariff (closed to new entrants)


Medium two rate 7-day tariff is most suited to 5-day operational businesses. The peak charge applies between 7pm and 11am, Monday to Sunday.

The minimum metering requirements is a basic type 6 dual register, with standard time switching capacity.

The impact of 2003 and 2004 network tariff NEE60 - Medium Two Rate 7-day on customers is shown below.

	Very Low 6,029 kWh	Low 14,069 kWh	Average 20,098 kWh	High 26,128 kWh	Very High 34,167 kWh
2003	\$621.88	\$1,181.45	\$1,601.13	\$2,020.80	\$2,580.37
2004	\$627.19	\$1,193.85	\$1,618.85	\$2,043.84	\$2,610.50
Change	0.85%	1.05%	1.11%	1.14%	1.17%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

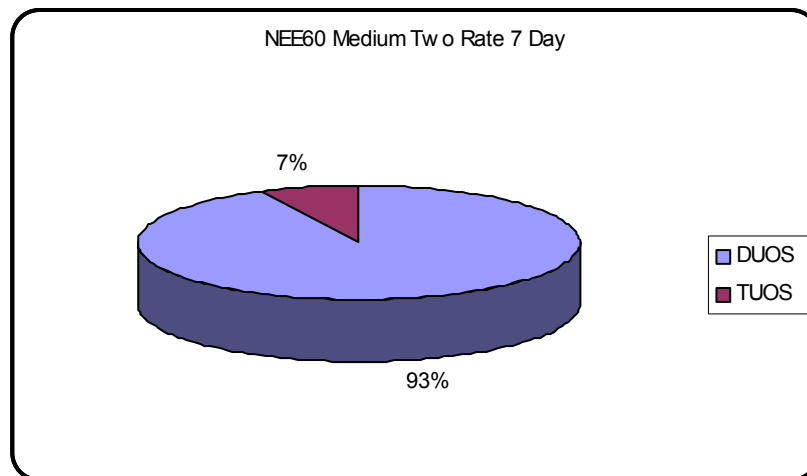



Large Low Voltage Customer Tariffs > 150 kVA and > 400MWh

Large customers are those customers who consume more than 400 MWh per annum, or a demand of greater than 150 kVA. Examples of large customers are large industrial sites, commercial buildings, and large public owned enterprises.

NEE71 – LV Large < 750 MWh Tariff (closed to new entrants)

NEE71 - LV Large < 750 MWh tariff applies to all large customers who either consume between 400 and 750 MWh per annum and more than 150 kVA, or less than 280 kVA and more than 750 MWh.


The minimum metering requirement is an interval meter, capable of measuring kWh and kVA integrated over a 30-minute period.

The impact of 2003 and 2004 network tariff NEE71- LV Large on customers is shown below.

	Very Low N/a	Low 455,300 kWh	Average 650,428 kWh	High 845,557 kWh	Very High 1,106 MWh
2003		\$26,451.45	\$36,508.50	\$46,565.55	\$59,974.95
2004		\$27,462.09	\$37,922.19	\$48,382.28	\$61,055.08
Change		3.82%	3.87%	3.90%	1.80%

No comparison is given for 'Very Low' consumption, as this would be below the minimum consumption for network tariff NEE71.

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

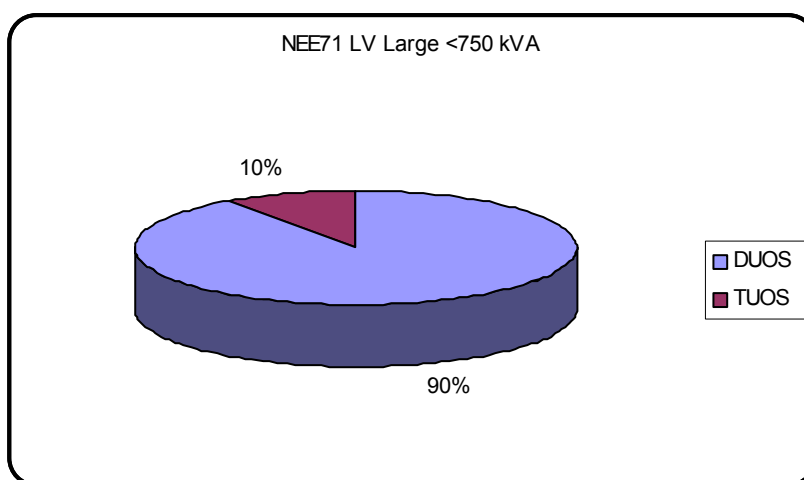



NEE72 – LV Large > 750 MWh Tariff (closed to new entrants)

NEE72 - LV Large > 750 MWh tariff applies to customers who consume more than 280 kVA per annum and more than 750 MWh per annum.


The minimum metering requirement is an interval meter, capable of measuring kWh and kVA integrated over a 30-minute period.

The impact of 2003 and 2004 network tariff NEE72 – LV Large on customers is shown below.

	Very Low N/a	Low 1,427 MWh	Average 2,038 MWh	High 2,650 MWh	Very High 3,465 MWh
2003		\$68,588.54	\$96,704.34	\$124,820.15	\$162,307.88
2004		\$71,221.46	\$100,435.57	\$129,649.68	\$168,601.38
Change		3.84%	3.86%	3.87%	3.88%

No comparison is given for ‘Very Low’ consumption, as this would be below the minimum consumption for network tariff NEE72.

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

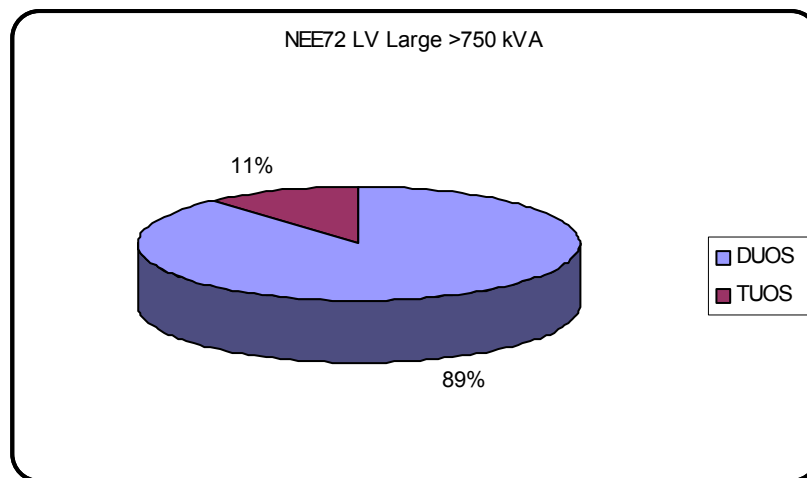



NEE74 – LV Large Two Rate 5-day Tariff (closed to new entrants)

The LV Large two rate 5-day tariff is for network customers who consume between 400 MWh and 750 MWh, and who were originally on the franchise retail maximum uniform tariff DH/DL.


The minimum metering requirement is an interval meter, capable of measuring kWh and kVA integrated over a 30-minute period.

The impact of 2003 and 2004 network tariff NEE74 – Large Two Rate 5-day on customers is shown below.

	Very Low N/a	Low 419,571 kWh	Average 599,387 kWh	High 779,203 kWh	Very High 1,019 MWh
2003		\$28,346.00	\$40,408.92	\$52,471.84	\$68,555.72
2004		\$29,278.81	\$41,740.99	\$54,203.17	\$70,819.40
Change		3.29%	3.30%	3.30%	3.30%

No comparison is given for ‘Very Low’ consumption, as this would be below the minimum consumption for network tariff NEE74.

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

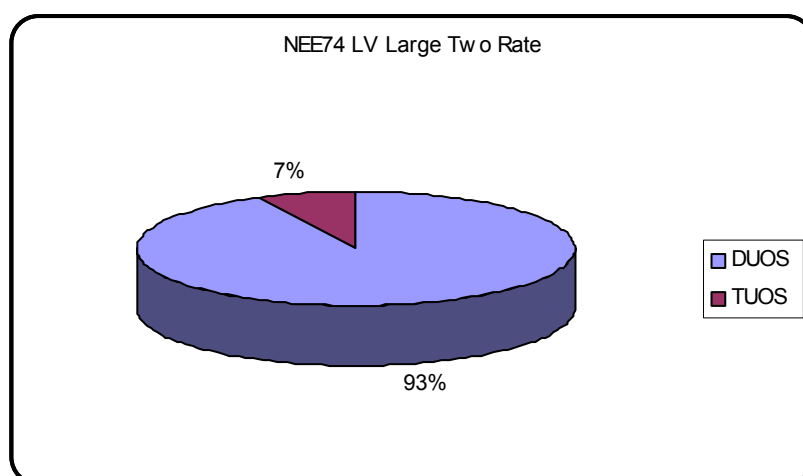



NEE75 – LV Large Multi-rate <750 MWh Tariff

NEE75 - LV Large Multi-rate < 750 MWh tariff was introduced in 2003. NEE75 applies to all large customers who either consume between 400 and 750 MWh per annum and more than 150 kVA, or less than 280 kVA and more than 750 MWh. It includes a shoulder component, aimed at giving pricing signals that more appropriately capture the system load profile of TXU's network.


The minimum metering requirement is an interval meter, capable of measuring kWh and kVA integrated over a 30-minute period.

The impact of 2003 and 2004 network tariff NEE75 – LV Large Multi-rate on customers is shown below.

	Very Low N/a	Low 455,300 kWh	Average 650,428 kWh	High 845,557 kWh	Very High 1,106 MWh
2003		\$27,096.27	\$37,472.10	\$47,847.93	\$61,682.37
2004		\$28,012.84	\$38,728.26	\$49,443.68	\$63,730.91
Change		3.38%	3.35%	3.34%	3.32%

No comparison is given for 'Very Low' consumption, as this would be below the minimum consumption for network tariff NEE75.

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

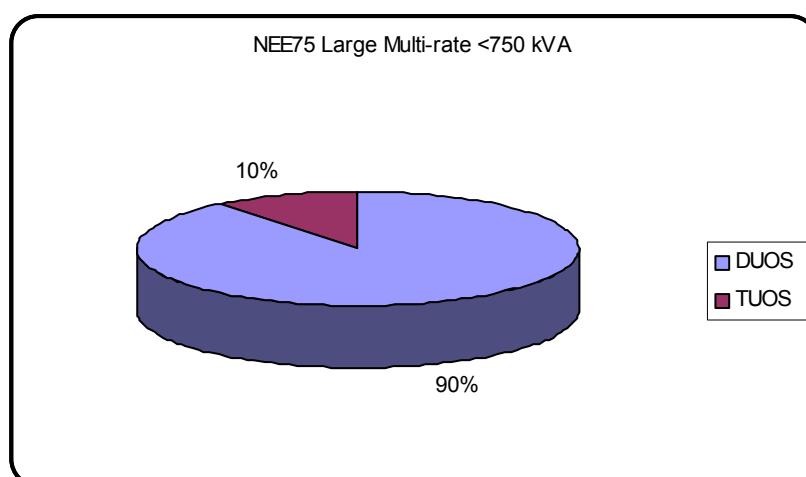



NEE76 – LV Large Multi-rate >750 MWh Tariff

NEE76 - LV Large Multi-rate > 750 MWh tariff was introduced in 2003. NEE76 applies to all large customers who consume more than 280 kVA per annum and more than 750 MWh per annum. It includes a shoulder component, aimed at giving pricing signals that more appropriately capture the system load profile of TXU's network.


The minimum metering requirement is an interval meter, capable of measuring kWh and kVA integrated over a 30-minute period.

The impact of 2003 and 2004 network tariff NEE76 – LV Large Multi-rate on customers is shown below.

	Very Low N/a	Low 1,427 MWh	Average 2,038 MWh	High 2,649 MWh	Very High 3,465 MWh
2003		\$67,783.32	\$95,596.46	\$123,409.59	\$160,493.78
2004		\$70,081.29	\$98,826.05	\$127,570.80	\$165,897.14
Change		3.39%	3.38%	3.38%	3.37%

No comparison is given for 'Very Low' consumption, as this would be below the minimum consumption for network tariff NEE76.

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

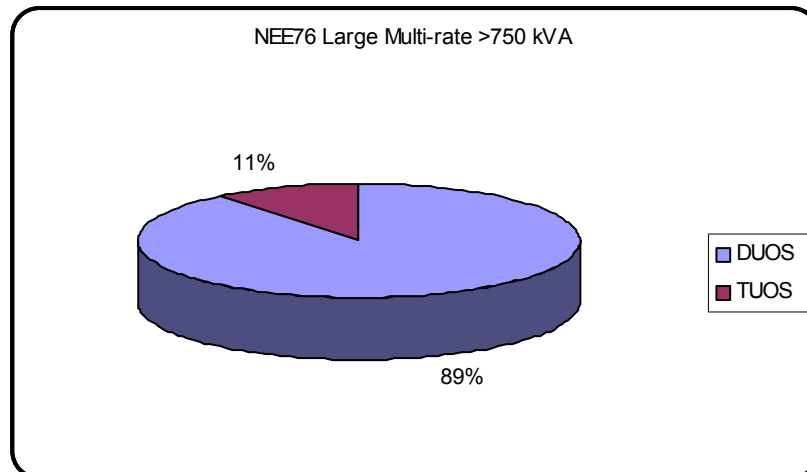



High Voltage Tariffs (NOMINAL VOLTAGE > 1000 VOLTS)

NEE81 – High Voltage Tariff


The High Voltage Demand tariff applies to high voltage customers such as large processors, manufacturers, and refineries. These customers receive supply at 6.6 kV or above and have a maximum demand of at least 1.15 MVA.

The minimum metering requirement is an interval meter, capable of measuring kWh and kVA integrated over a 30-minute period.

The impact of 2003 and 2004 network tariff NEE81 – High Voltage on customers is shown below.

	Very Low 3,025 MWh	Low 7,058 MWh	Average 10,082 MWh	High 13,107 MWh	Very High 17,140 MWh
2003	\$106,955.04	\$183,676.41	\$261,044.36	\$338,412.31	\$441,569.57
2004	\$109,425.97	\$189,441.93	\$269,280.81	\$349,119.70	\$455,571.54
Change	2.31%	3.14%	3.16%	3.16%	3.17%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

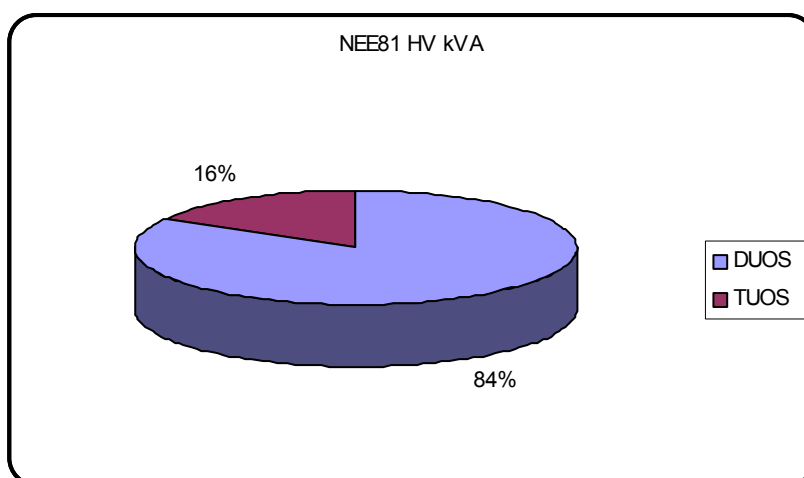




NEE82 – Traction Tariff

NEE82 was introduced in 2003 and includes a shoulder rate that reflects daily usage patterns. All High Voltage traction sites were reassigned to this tariff.

The impact of 2003 and 2004 network tariff NEE82 – Traction Tariff on customers is shown below.

	Very Low 1,113 MWh	Low 2,599 MWh	Average 3,712 MWh	High 4,826 MWh	Very High 6,311 MWh
2003	\$83,656.41	\$133,553.46	\$189,440.15	\$245,326.83	\$319,842.41
2004	\$84,832.75	\$136,298.24	\$193,361.26	\$250,424.28	\$326,508.30
Change	1.41%	2.06%	2.07%	2.08%	2.08%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

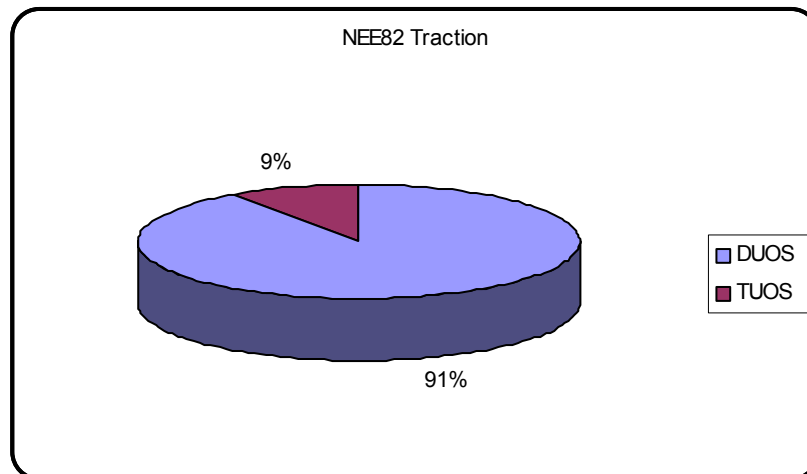




NEE83 – Small High Voltage Demand Tariff

This tariff applies to HV (NEE81) customers who have only small levels of consumption and demand. Assignment to this tariff is limited to customers with low load and energy requirements.

The impact of 2003 and 2004 network tariff NEE83 - Small High Voltage Demand on customers is shown below.

	Very Low 83,022 kWh	Low 193,718 kWh	Average 276,740 kWh	High 359,762 kWh	Very High 470,458 kWh
2003	\$21,108.36	\$33,429.10	\$46,405.34	\$59,381.58	\$76,683.24
2004	\$21,189.07	\$33,617.42	\$46,674.37	\$59,731.32	\$77,140.59
Change	0.38%	0.56%	0.58%	0.59%	0.60%

The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for an average user.

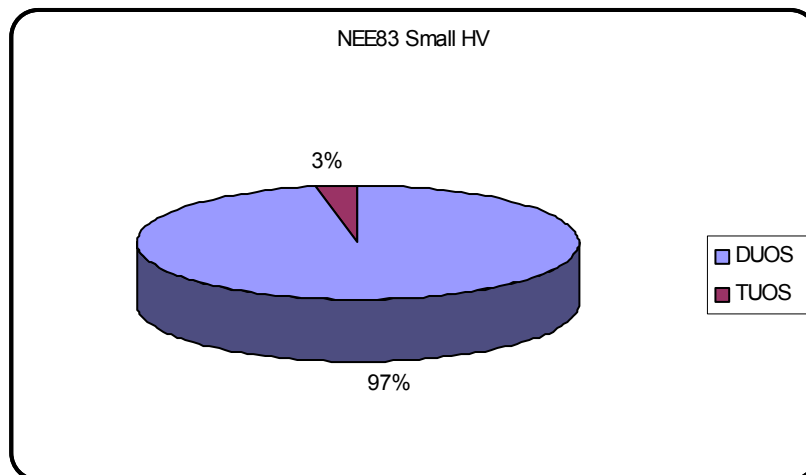



Sub-transmission Customer Tariffs

TXU Networks has only a small number of customers taking supply directly from the sub-transmission system. These customers are very diverse in terms of their location, the size of their load and their annual energy use. In recognition of this diversity TXU Networks has developed a pricing methodology that is based on customer's size and distance from Terminal Stations.

NEE91 – Sub-transmission Tariff

NEE91 – Sub-transmission tariff applies to customers who have a maximum demand less than 25000kVa and less than 20 km's from the terminal station.

The minimum metering requirement is an interval meter, capable of measuring kWh and kVA integrated over a 30-minute period.

NEE94 - Sub-transmission >25000kVA <20km from Terminal Station

This network tariff recognises that customers with very high load and usage located less than 20km from a Terminal Station impose a lower cost per kVA and kWh than do those with either lower load and usage or longer lines required to supply them. The 20km limit was chosen, as it is consistent with other market definitions of long and short sub-transmission lines.

NEE95 - Sub-transmission <25000kVA >20km from Terminal Station

TXU Networks owns and operates an extensive sub-transmission system in South west Gippsland and East Gippsland out of Morwell West Terminal Station and in North East Victoria out of Glenrowan Terminal Station, Mount Beauty Terminal Station and Thomastown Terminal Station. The urban network in the outer eastern suburbs of Melbourne is also quite extensive. Sub-transmission customers require a significant portion of these line assets to be held in reserve for their use. Furthermore, if high voltage customers transfer to sub-transmission supply they reduce the utilisation of significant portions of zone substation investment in these areas. TXU Networks has introduced this tariff in recognition of the higher costs associated with supplying remote sub-transmission customers as opposed to those that are relatively close to a Terminal Station.


The impact of 2003 and 2004 subtransmission tariffs on customers is shown below as a single average.²

	Average
2003	\$338,771
2004	\$338,539
Change	-0.07%

² A single average is given for subtransmission customers as further disaggregated information may be commercially sensitive.



The chart below shows 2004 DUoS and TUoS charges as a proportion of the network charge for subtransmission customers.

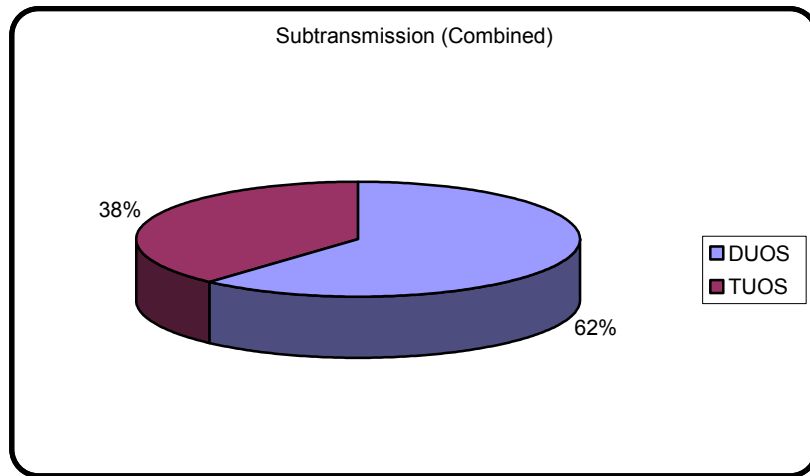



Rules Applying to Demand Tariffs

For the purposes of determining a customer's Maximum Demand for Network Tariffs TXU Networks has developed a number of rules. For 2004 these rules are unchanged from 2003 and are set out in Attachment 4. The Network Tariffs are set out in Attachment 3.

Rules Applying to Reassignment of Network Tariffs

Provisions relating to the assignment of distribution customers to distribution tariffs can be found under section 2.1 of the Essential Services Commission *Electricity Distribution Price Determination 2001 – 2005, Volume II Price Controls*.

As part of its 2002 Network Tariff Submission, TXU Networks requested the Essential Services Commission to approve a tariff condition that customers seeking tariff reassignment must remain on the reassigned tariff for a minimum 12-month period. This request was approved and a 12-month timeframe now applies to all tariff reassignment requests, with exceptions made at TXU Networks' discretion. For example, TXU may waive this requirement where it can be demonstrated that to not do so would result in unreasonable penalties or impose hardship on a customer.

This condition prevents customers changing tariffs to take advantage of seasonal variations in prices according to their individual load, thereby bypassing payment that reflects use of the distribution network over a full 12-month cycle.

Avoidable Cost of Service and Stand Alone Cost Considerations.

The ESC requires Distribution Businesses to have regard for the avoidable costs of serving distribution customers and the stand-alone cost of providing the service. The avoidable cost of service is considered to be the marginal cost of supply and the stand alone cost is the price for which the customer could find the equivalent service from an alternative source.

TXU Networks uses a tariff cost allocation model that collates all the costs associated with the network. These include, the capital costs – return on capital, and depreciation; operating costs – network management and administration costs, maintenance costs, customer administration costs. These costs are allocated to each of the Network Tariffs on the basis of customer numbers, energy consumption, transformation level, and contribution to local and system peak demands.

Customer costs are converted to standing charges on the basis of the annualised cost per customer. The annualised costs associated with the common use of the network are converted to a rate per kWh for both the peak and off peak periods. The annualised costs associated with customers' contribution to peak loading is converted to a rate per kVA and, where tariffs are energy only tariffs, this rate is then expressed as a rate per kWh and added to the peak energy component.

TXU Networks model treats Transmission charges in a similar manner, however the total annualised cost is converted to a rate per kWh and applied to energy use only. The off-peak price for transmission charges reflects the common service charge for all units of energy in the network.



In order to comply with rebalancing requirements it may sometimes be necessary to make some adjustments to some Network Tariffs or Network Tariff components that are not in line with TXU Networks' tariff model. Such adjustments are minor and TXU Networks' Network Tariffs do not breach either the upper or lower limit as required by the Regulator.

ATTACHMENT 1

SCHEDULE OF DISTRIBUTION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST



Small Customer Tariffs

Applies to < 50kVA & < 160 MWh/pa

NEE11	Small Residential single rate		
	<i>Franchise Tariffs GD,GR</i>		
	Standing Charge	\$/customer pa	\$43.80
	Energy – First 1020/Quarter	c/kWh	4.441
	Energy – Balance	c/kWh	5.029
NEE12	Small Business single rate		
	<i>Franchise Tariffs B,E,G,N</i>		
	Standing Charge	\$/customer pa	\$60.60
	Energy – First 1020/Quarter	c/kWh	5.151
	Energy – Balance	c/kWh	5.745
NEE13	Small Residential single rate & Dedicated Circuit (closed to new entrants)		
	<i>Franchise Tariffs GD,GR & Y6,YT,Y8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$64.20
	Energy – First 1020/Quarter	c/kWh	4.441
	Energy – Balance	c/kWh	5.029
	Off Peak Energy	c/kWh	1.289
NEE14	Small Residential single rate & Dedicated Circuit – afternoon boost (closed to new entrants)		
	<i>Franchise Tariffs GD,GR & J,J6,JT,J8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$60.00
	Energy – First 1020/Quarter	c/kWh	4.441
	Energy – Balance	c/kWh	5.029
	Off Peak Energy	c/kWh	1.324
NEE15	Small Residential single rate & Dedicated circuit 8 to 8 (closed to new entrants)		
	<i>Franchise Tariffs GD,GR & Y6,YT,Y8</i>		
	Off Peak – 6 or 8 hrs 8:00PM to 8:00AM each day		
	Standing Charge	\$/customer pa	\$64.20
	Energy – First 1020/Quarter	c/kWh	4.441
	Energy – Balance	c/kWh	5.029
	Off Peak Energy	c/kWh	1.150
NEE16	Small Business single rate & Dedicated Circuit (closed to new entrants)		
	<i>Franchise Tariffs B,E,G,N & Y6,YT,Y8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$81.00
	Energy – First 1020/Quarter	c/kWh	5.151
	Energy – Balance	c/kWh	5.745
	Off Peak Energy	c/kWh	1.289
NEE17	Small Business single rate & Dedicated Circuit – afternoon boost (closed to new entrants)		
	<i>Franchise Tariffs B,E,G,N & J,J6,JT,J8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$76.80
	Energy – First 1020/Quarter	c/kWh	5.151
	Energy – Balance	c/kWh	5.745
	Off Peak Energy	c/kWh	1.324

SCHEDULE OF DISTRIBUTION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST



NEE18	Small Business single rate & Dedicated circuit 8 to 8 (closed to new entrants)		
	Franchise Tariffs B,E,G,N & Y6,YT,Y8		
	Off Peak – 6 or 8 hrs 8:00PM to 8:00AM each day		
	Standing Charge	\$/customer pa	\$81.00
	Energy – First 1020/Quarter	c/kWh	5.151
	Energy – Balance	c/kWh	5.745
	Off Peak Energy	c/kWh	1.150
NEE20	Small Residential two rate		
	Franchise Tariffs GH/GL		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Standing Charge	\$/customer pa	\$79.80
	Peak Energy	c/kWh	5.100
	Off Peak Energy	c/kWh	1.219
NEE21	Small Business two rate		
	Franchise Tariffs DH/DL		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Standing Charge	\$/customer pa	\$183.00
	Peak Energy	c/kWh	7.650
	Off Peak Energy	c/kWh	2.300
NEE23	Photovoltaic		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Summer Peak Payment – 1 November to 30 March		
	Standing Charge	\$/customer pa	\$130.20
	Peak Energy	c/kWh	5.050
	Off Peak Energy	c/kWh	1.080
	Summer peak payment	c/kWh	4.759
NEE30	Dedicated circuit (closed to new entrants)		
	Franchise Tariffs Y6,YT,Y8		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$20.40
	Off Peak Energy	c/kWh	1.289
NEE31	Dedicated circuit – afternoon boost (closed to new entrants)		
	Franchise Tariffs J,J6,JT,J8		
	Off Peak – 3 hours per afternoon 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$16.20
	Off Peak Energy	c/kWh	1.324
NEE32	Dedicated circuit 8 to 8 (closed to new entrants)		
	Franchise Tariffs Y6,YT,Y8		
	Off Peak – 6 or 8 hrs 8:00PM to 8:00AM each day		
	Standing Charge	\$/customer pa	\$20.40
	Off Peak Energy	c/kWh	1.150

ATTACHMENT 1



SCHEDULE OF DISTRIBUTION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE40	Medium single rate (closed to new entrants)		
	Franchise Tariffs B,E,G,N		
	Standing Charge	\$/customer pa	\$61.20
	Energy - All Consumption	c/kWh	5.470
NEE41	Medium single rate & Dedicated Circuit (closed to new entrants)		
	Franchise Tariffs B,E,G,N & Y6,YT,Y8		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$81.60
	Peak Energy	c/kWh	5.470
	Off Peak Energy	c/kWh	1.289
NEE42	Medium single rate & Dedicated Circuit – afternoon boost (closed to new entrants)		
	Franchise Tariffs B,E,G,N & J,J6,JT,J8		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$77.40
	Peak Energy	c/kWh	5.470
	Off Peak Energy	c/kWh	1.324
NEE43	Medium single rate & Dedicated circuit 8 to 8 (closed to new entrants)		
	Franchise Tariffs B,E,G,N & J,J6,JT,J8		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$81.60
	Peak Energy	c/kWh	5.470
	Off Peak Energy	c/kWh	1.150

Medium Customer Tariffs

Applies to > 50kVA & > 160 MWh/pa and < 400 MWh/pa

NEE51	Medium two rate 5 Day (closed to new entrants)		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Standing Charge	\$/customer pa	\$181.20
	Peak Energy	c/kWh	7.500
	Off Peak Energy	c/kWh	2.201
NEE52	Unmetered supplies		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Peak Energy	c/kWh	5.576
	Off Peak Energy	c/kWh	3.457
NEE54	Medium two rate 5 Day Interruptible		
	Available as an alternative to NEE21 or NEE51 in locations TXU Networks interruptibility infrastructure is established. Further conditions available from TXU Networks Pty Ltd		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Standing Charge	\$/customer pa	\$181.20
	Peak Energy (Max Chg 10kVA)	c/kWh	7.067
	Peak Energy (Min Chg 100kVA)	c/kWh	6.687
	Off Peak Energy	c/kWh	2.201

ATTACHMENT 1



SCHEDULE OF DISTRIBUTION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE55 *Snowfields*

Peak Times – 1 May to 30 September

Off Peak – All other times

Standing Charge	\$/customer pa	\$126.60
-----------------	----------------	----------

Peak Energy	c/kWh	6.425
-------------	-------	-------

Off Peak Energy	c/kWh	0.335
-----------------	-------	-------

NEE56 *Medium demand multi-rate*

Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM

Monday – Friday

Shoulder Times – 10:00AM to 4:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$1747.80
-----------------	----------------	-----------

Peak Energy	c/kWh	3.695
-------------	-------	-------

Shoulder Energy	c/kWh	3.301
-----------------	-------	-------

Off Peak Energy	c/kWh	2.193
-----------------	-------	-------

Contract Demand	\$/kVA pa	\$53.00
-----------------	-----------	---------

Minimum Demand 50kVA

NEE60 *Medium two rate 7 Day (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Sunday

Off Peak – All other times

Standing Charge	\$/customer pa	\$202.20
-----------------	----------------	----------

Peak Energy	c/kWh	7.893
-------------	-------	-------

Off Peak Energy	c/kWh	2.525
-----------------	-------	-------

Large Customer Tariffs

Applies to > 150kVA & > 400 MWh/pa

NEE71 *Large demand - Either > 150kVA & > 400 MWh/pa & < 750MWh/pa Or <280kVA & >750MWh (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$3055.20
-----------------	----------------	-----------

Peak Energy	c/kWh	2.847
-------------	-------	-------

Off Peak Energy	c/kWh	1.480
-----------------	-------	-------

Contract Demand	\$/kVA pa	\$57.35
-----------------	-----------	---------

Minimum Demand 150kVA

NEE72 *Large demand - > 280kVA & > 750MWh/pa (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$3055.20
-----------------	----------------	-----------

Peak Energy	c/kWh	1.885
-------------	-------	-------

Off Peak Energy	c/kWh	1.480
-----------------	-------	-------

Contract Demand	\$/kVA pa	\$67.40
-----------------	-----------	---------

Minimum Demand 280kVA

NEE74 *Large two rate 5 Day (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$200.40
-----------------	----------------	----------

Peak Energy	c/kWh	9.060
-------------	-------	-------

Off Peak Energy	c/kWh	2.695
-----------------	-------	-------

ATTACHMENT 1



SCHEDULE OF DISTRIBUTION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE75 Large demand multi-rate - Either > 150kVA & > 400 MWh/pa & < 750MWh/pa Or <280kVA & >750MWh		
Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday Shoulder Times – 10:00AM to 4:00PM Monday – Friday Off Peak – All other times		
Standing Charge	\$/customer pa	\$3010.20
Peak Energy	c/kWh	3.000
Shoulder Energy	c/kWh	2.556
Off Peak Energy	c/kWh	1.400
Contract Demand	\$/kVA pa	\$57.90
Minimum Demand 150kVA		

NEE76 Large demand multi-rate - > 280kVA & > 750MWh/pa		
Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday Shoulder Times – 10:00AM to 4:00PM Monday – Friday Off Peak – All other times		
Standing Charge	\$/customer pa	\$3010.20
Peak Energy	c/kWh	2.150
Shoulder Energy	c/kWh	1.589
Off Peak Energy	c/kWh	1.400
Contract Demand	\$/kVA pa	\$67.20
Minimum Demand 280 kVA		

High Voltage Tariffs

Applies to 22,000 Volt supplies

NEE81 High Voltage demand		
Peak Times – 7:00AM to 11:00PM Monday – Friday Off Peak – All other times		
Standing Charge	\$/customer pa	\$3151.20
Peak Energy	c/kWh	0.831
Off Peak Energy	c/kWh	0.505
Contract Demand	\$/kVA pa	\$62.84
Minimum Demand 1150kVA		

NEE82 Traction		
Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday Shoulder Times – 10:00AM to 4:00PM Monday – Friday Off Peak – All other times		
Standing Charge	\$/customer pa	\$3151.20
Peak Energy	c/kWh	1.005
Shoulder Energy	c/kWh	0.746
Off Peak Energy	c/kWh	0.595
Contract Demand	\$/kVA pa	\$58.52
Minimum Demand 1150kVA		

ATTACHMENT 1



SCHEDULE OF DISTRIBUTION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE83 *Small High Voltage demand (Available from 1 March 2003)*

Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday		
Shoulder Times – 10:00AM to 4:00PM Monday – Friday		
Off Peak – All other times		
Standing Charge	\$/customer pa	\$3151.20
Peak Energy	c/kWh	6.770
Shoulder Energy	c/kWh	6.452
Off Peak Energy	c/kWh	0.528
Contract Demand	\$/kVA pa	\$11.84
Minimum Demand 150kVA		

Applies to 66,000 Volt supplies

NEE91 *Subtransmission demand - <25000kVA and < 20km from Terminal Station*

Peak Times – 7:00AM to 11:00PM Monday – Friday		
Off Peak – All other times		
Standing Charge	\$/customer pa	\$18,066.00
Peak Energy	c/kWh	0.290
Off Peak Energy	c/kWh	0.040
Contract Demand	\$/kVA pa	\$9.36
Minimum Demand 10500kVA		

NEE94 *Subtransmission demand - >25000kVA and < 20km from Terminal Station*

Peak Times – 7:00AM to 11:00PM Monday – Friday		
Off Peak – All other times		
Standing Charge	\$/customer pa	\$18,066.00
Peak Energy	c/kWh	0.278
Off Peak Energy	c/kWh	0.039
Contract Demand	\$/kVA pa	\$6.52
Minimum Demand 25000kVA		

NEE95 *Subtransmission demand - <25000kVA and > 20km from Terminal Station*

Peak Times – 7:00AM to 11:00PM Monday – Friday		
Off Peak – All other times		
Standing Charge	\$/customer pa	\$18,066.00
Peak Energy	c/kWh	0.325
Off Peak Energy	c/kWh	0.041
Contract Demand	\$/kVA pa	\$8.72
Minimum Demand 10500kVA		

ATTACHMENT 2

SCHEDULE OF TRANSMISSION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST



Small Customer Tariffs

Applies to < 90kVA & < 160 MWh/pa

NEE11	Small Residential single rate		
	<i>Franchise Tariffs GD,GR</i>		
	Standing Charge	\$/customer pa	\$0.00
	Energy – First 1020/Quarter	c/kWh	0.733
	Energy – Balance	c/kWh	0.733
NEE12	Small Business single rate		
	<i>Franchise Tariffs B,E,G,N</i>		
	Standing Charge	\$/customer pa	\$0.00
	Energy – First 1020/Quarter	c/kWh	0.717
	Energy – Balance	c/kWh	0.717
NEE13	Small Residential single rate & Dedicated Circuit (closed to new entrants)		
	<i>Franchise Tariffs GD,GR & Y6,YT,Y8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$0.00
	Energy – First 1020/Quarter	c/kWh	0.733
	Energy – Balance	c/kWh	0.733
	Off Peak Energy	c/kWh	0.123
NEE14	Small Residential single rate & Dedicated Circuit – afternoon boost (closed to new entrants)		
	<i>Franchise Tariffs GD,GR & J,J6,JT,J8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$0.00
	Energy – First 1020/Quarter	c/kWh	0.733
	Energy – Balance	c/kWh	0.733
	Off Peak Energy	c/kWh	0.123
NEE15	Small Residential single rate & Dedicated circuit 8 to 8 (closed to new entrants)		
	<i>Franchise Tariffs GD,GR & Y6,YT,Y8</i>		
	Off Peak – 6 or 8 hrs 8:00PM to 8:00AM each day		
	Standing Charge	\$/customer pa	\$0.00
	Energy – First 1020/Quarter	c/kWh	0.733
	Energy – Balance	c/kWh	0.733
	Off Peak Energy	c/kWh	0.123
NEE16	Small Business single rate & Dedicated Circuit (closed to new entrants)		
	<i>Franchise Tariffs B,E,G,N & Y6,YT,Y8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$0.00
	Energy – First 1020/Quarter	c/kWh	0.717
	Energy – Balance	c/kWh	0.717
	Off Peak Energy	c/kWh	0.123
NEE17	Small Business single rate & Dedicated Circuit – afternoon boost (closed to new entrants)		
	<i>Franchise Tariffs B,E,G,N & J,J6,JT,J8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$0.00
	Energy – First 1020/Quarter	c/kWh	0.717
	Energy – Balance	c/kWh	0.717
	Off Peak Energy	c/kWh	0.123

SCHEDULE OF TRANSMISSION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST



NEE18	Small Business single rate & Dedicated circuit 8 to 8 (closed to new entrants)		
	Franchise Tariffs B,E,G,N & Y6,YT,Y8		
	Off Peak – 6 or 8 hrs 8:00PM to 8:00AM each day		
	Standing Charge	\$/customer pa	\$0.00
	Energy – First 1020/Quarter	c/kWh	0.717
	Energy – Balance	c/kWh	0.717
	Off Peak Energy	c/kWh	0.123
NEE20	Small Residential two rate		
	Franchise Tariffs GH/GL		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Standing Charge	\$/customer pa	\$0.00
	Peak Energy	c/kWh	0.865
	Off Peak Energy	c/kWh	0.123
NEE21	Small Business two rate		
	Franchise Tariffs DH/DL		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Standing Charge	\$/customer pa	\$0.00
	Peak Energy	c/kWh	0.757
	Off Peak Energy	c/kWh	0.123
NEE23	Photovoltaic		
	Franchise Tariffs GH/GL		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Summer demand – 1 November to 30 March		
	Standing Charge	\$/customer pa	\$0.00
	Peak Energy	c/kWh	0.869
	Off Peak Energy	c/kWh	0.123
	Summer peak payment	c/kWh	
NEE30	Dedicated circuit (closed to new entrants)		
	Franchise Tariffs Y6,YT,Y8		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$0.00
	Off Peak Energy	c/kWh	0.123
NEE31	Dedicated circuit – afternoon boost (closed to new entrants)		
	Franchise Tariffs J,J6,JT,J8		
	Off Peak – 3 hours per afternoon 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$0.00
	Off Peak Energy	c/kWh	0.123
NEE32	Dedicated circuit 8 to 8 (closed to new entrants)		
	Franchise Tariffs Y6,YT,Y8		
	Off Peak – 6 or 8 hrs 8:00PM to 8:00AM each day		
	Standing Charge	\$/customer pa	\$0.00
	Off Peak Energy	c/kWh	0.123

ATTACHMENT 2



SCHEDULE OF TRANSMISSION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE40 *Medium single rate (closed to new entrants)*

Franchise Tariffs B,E,G,N

Standing Charge	\$/customer pa	\$0.00
Energy - All Consumption	c/kWh	0.778

NEE41 *Medium single rate & Dedicated Circuit (closed to new entrants)*

Franchise Tariffs B,E,G,N & Y6,YT,Y8

Off Peak – 11:00PM to 7:00AM each day

Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.778
Off Peak Energy	c/kWh	0.123

NEE42 *Medium single rate & Dedicated Circuit – afternoon boost (closed to new entrants)*

Franchise Tariffs B,E,G,N & J,J6,JT,J8

Off Peak – 11:00PM to 7:00AM each day

Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.778
Off Peak Energy	c/kWh	0.123

NEE43 *Medium single rate & Dedicated circuit 8 to 8 (closed to new entrants)*

Franchise Tariffs B,E,G,N & J,J6,JT,J8

Off Peak – 11:00PM to 7:00AM each day

Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.778
Off Peak Energy	c/kWh	0.123

Medium Customer Tariffs

Applies to > 50kVA & > 160 MWh/pa and < 400 MWh/pa

NEE51 *Medium two rate 5 Day (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.758
Off Peak Energy	c/kWh	0.123

NEE52 *Unmetered supplies*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Peak Energy	c/kWh	0.766
Off Peak Energy	c/kWh	0.123

NEE54 *Medium two rate 5 Day Interruptible*

Available as an alternative to NEE21 or NEE51 in locations TXU Networks interruptibility infrastructure is established. Further conditions available from TXU Networks Pty Ltd

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
Peak Energy (Max Chg 10kVA)	c/kWh	0.709
Peak Energy (Min Chg 100kVA)	c/kWh	0.666
Off Peak Energy	c/kWh	0.123

ATTACHMENT 2



SCHEDULE OF TRANSMISSION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE55 **Snowfields**

Peak Times – 1 May to 30 September

Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
-----------------	----------------	--------

Peak Energy	c/kWh	0.660
-------------	-------	-------

Off Peak Energy	c/kWh	0.660
-----------------	-------	-------

NEE56 **Medium demand multi-rate**

Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM

Monday – Friday

Shoulder Times – 10:00AM to 4:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
-----------------	----------------	--------

Peak Energy	c/kWh	0.758
-------------	-------	-------

Shoulder Energy	c/kWh	0.758
-----------------	-------	-------

Off Peak Energy	c/kWh	0.123
-----------------	-------	-------

Contract Demand	\$/kVA pa	0.000
-----------------	-----------	-------

Minimum Demand 50kVA

NEE60 **Medium two rate 7 Day (closed to new entrants)**

Peak Times – 7:00AM to 11:00PM Monday – Sunday

Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
-----------------	----------------	--------

Peak Energy	c/kWh	0.764
-------------	-------	-------

Off Peak Energy	c/kWh	0.123
-----------------	-------	-------

Large Customer Tariffs

Applies to > 150kVA & > 400 MWh/pa

NEE71 **Large demand - Either > 150kVA & > 400 MWh/pa & < 750MWh/pa Or < 280kVA & > 750MWh (closed to new entrants)**

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
-----------------	----------------	--------

Peak Energy	c/kWh	0.884
-------------	-------	-------

Off Peak Energy	c/kWh	0.123
-----------------	-------	-------

Contract Demand	\$/kVA pa	0.000
-----------------	-----------	-------

Minimum Demand 150kVA

NEE72 **Large demand - > 280kVA & > 750MWh/pa (closed to new entrants)**

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
-----------------	----------------	--------

Peak Energy	c/kWh	0.884
-------------	-------	-------

Off Peak Energy	c/kWh	0.123
-----------------	-------	-------

Contract Demand	\$/kVA pa	0.000
-----------------	-----------	-------

Minimum Demand 280kVA

NEE74 **Large two rate 5 Day (closed to new entrants)**

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
-----------------	----------------	--------

Peak Energy	c/kWh	0.762
-------------	-------	-------

Off Peak Energy	c/kWh	0.123
-----------------	-------	-------

ATTACHMENT 2



SCHEDULE OF TRANSMISSION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE75 Large demand multi-rate - Either > 150kVA & > 400 MWh/pa & < 750MWh/pa Or <280kVA & >750MWh		
Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday Shoulder Times – 10:00AM to 4:00PM Monday – Friday Off Peak – All other times		
Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.885
Shoulder Energy	c/kWh	0.885
Off Peak Energy	c/kWh	0.123
Contract Demand	\$/kVA pa	0.000
Minimum Demand 150kVA		
NEE76 Large demand multi-rate - > 280kVA & > 750MWh/pa		
Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday Shoulder Times – 10:00AM to 4:00PM Monday – Friday Off Peak – All other times		
Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.885
Shoulder Energy	c/kWh	0.885
Off Peak Energy	c/kWh	0.123
Contract Demand	\$/kVA pa	0.000
Minimum Demand 280kVA		

Applies to 22,000 Volt supplies

NEE81 High Voltage demand		
Peak Times – 7:00AM to 11:00PM Monday – Friday Off Peak – All other times		
Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.685
Off Peak Energy	c/kWh	0.123
Contract Demand	\$/kVA pa	0.000
Minimum Demand 1150kVA		
NEE82 Traction		
Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday Shoulder Times – 10:00AM to 4:00PM Monday – Friday Off Peak – All other times		
Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.686
Shoulder Energy	c/kWh	0.686
Off Peak Energy	c/kWh	0.123
Contract Demand	\$/kVA pa	0.000
Minimum Demand 1150kVA		

ATTACHMENT 2



SCHEDULE OF TRANSMISSION USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE83 *Small High Voltage demand*

Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM
Monday – Friday
Shoulder Times – 10:00AM to 4:00PM Monday – Friday
Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.686
Shoulder Energy	c/kWh	0.686
Off Peak Energy	c/kWh	0.123
Contract Demand	\$/kVA pa	0.000
Minimum Demand 150kVA		

Subtransmission Tariffs

Applies to 66,000 Volt supplies

NEE91 *Subtransmission demand - <25000kVA and < 20km from Terminal Station*

Peak Times – 7:00AM to 11:00PM Monday – Friday
Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.689
Off Peak Energy	c/kWh	0.123
Contract Demand	\$/kVA pa	0.000
Minimum Demand 10500kVA		

NEE94 *Subtransmission demand - >25000kVA and < 20km from Terminal Station*

Peak Times – 7:00AM to 11:00PM Monday – Friday
Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.656
Off Peak Energy	c/kWh	0.123
Contract Demand	\$/kVA pa	0.000
Minimum Demand 25000kVA		

NEE95 *Subtransmission demand - <25000kVA and > 20km from Terminal Station*

Peak Times – 7:00AM to 11:00PM Monday – Friday
Off Peak – All other times

Standing Charge	\$/customer pa	\$0.00
Peak Energy	c/kWh	0.687
Off Peak Energy	c/kWh	0.123
Contract Demand	\$/kVA pa	0.000
Minimum Demand 10500kVA		

ATTACHMENT 3

SCHEDULE OF NETWORK USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST



Small Customer Tariffs

Applies to < 90kVA & < 160 MWh/pa

NEE11	Small Residential single rate		
	<i>Franchise Tariffs GD,GR</i>		
	Standing Charge	\$/customer pa	\$43.80
	Energy – First 1020/Quarter	c/kWh	5.174
	Energy – Balance	c/kWh	5.762
NEE12	Small Business single rate		
	<i>Franchise Tariffs B,E,G,N</i>		
	Standing Charge	\$/customer pa	\$60.60
	Energy – First 1020/Quarter	c/kWh	5.868
	Energy – Balance	c/kWh	6.462
NEE13	Small Residential single rate & Dedicated Circuit (closed to new entrants)		
	<i>Franchise Tariffs GD,GR & Y6,YT,Y8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$64.20
	Energy – First 1020/Quarter	c/kWh	5.174
	Energy – Balance	c/kWh	5.762
	Off Peak Energy	c/kWh	1.412
NEE14	Small Residential single rate & Dedicated Circuit – afternoon boost (closed to new entrants)		
	<i>Franchise Tariffs GD,GR & J,J6,JT,J8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$60.00
	Energy – First 1020/Quarter	c/kWh	5.174
	Energy – Balance	c/kWh	5.762
	Off Peak Energy	c/kWh	1.447
NEE15	Small Residential single rate & Dedicated circuit 8 to 8 (closed to new entrants)		
	<i>Franchise Tariffs GD,GR & Y6,YT,Y8</i>		
	Off Peak – 6 or 8 hrs 8:00PM to 8:00AM each day		
	Standing Charge	\$/customer pa	\$64.20
	Energy – First 1020/Quarter	c/kWh	5.174
	Energy – Balance	c/kWh	5.762
	Off Peak Energy	c/kWh	1.273
NEE16	Small Business single rate & Dedicated Circuit (closed to new entrants)		
	<i>Franchise Tariffs B,E,G,N & Y6,YT,Y8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$81.00
	Energy – First 1020/Quarter	c/kWh	5.868
	Energy – Balance	c/kWh	6.462
	Off Peak Energy	c/kWh	1.412
NEE17	Small Business single rate & Dedicated Circuit – afternoon boost (closed to new entrants)		
	<i>Franchise Tariffs B,E,G,N & J,J6,JT,J8</i>		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$76.80
	Energy – First 1020/Quarter	c/kWh	5.868
	Energy – Balance	c/kWh	6.462
	Off Peak Energy	c/kWh	1.447



SCHEDULE OF NETWORK USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE18	Small Business single rate & Dedicated circuit 8 to 8 (closed to new entrants)		
	Franchise Tariffs B,E,G,N & Y6,YT,Y8		
	Off Peak – 6 or 8 hrs 8:00PM to 8:00AM each day		
	Standing Charge	\$/customer pa	\$81.00
	Energy – First 1020/Quarter	c/kWh	5.868
	Energy – Balance	c/kWh	6.462
	Off Peak Energy	c/kWh	1.273
NEE20	Small Residential two rate		
	Franchise Tariffs GH/GL		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Standing Charge	\$/customer pa	\$79.80
	Peak Energy	c/kWh	5.965
	Off Peak Energy	c/kWh	1.342
NEE21	Small Business two rate		
	Franchise Tariffs DH/DL		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Standing Charge	\$/customer pa	\$183.00
	Peak Energy	c/kWh	8.407
	Off Peak Energy	c/kWh	2.423
NEE23	Photovoltaic		
	Franchise Tariffs GH/GL		
	Peak Times – 7:00AM to 11:00PM Monday – Friday		
	Off Peak – All other times		
	Summer demand – 1 November to 30 March		
	Standing Charge	\$/customer pa	\$130.20
	Peak Energy	c/kWh	5.919
	Off Peak Energy	c/kWh	1.203
	Summer peak payment	c/kWh	4.759
NEE30	Dedicated circuit (closed to new entrants)		
	Franchise Tariffs Y6,YT,Y8		
	Off Peak – 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$20.40
	Off Peak Energy	c/kWh	1.412
NEE31	Dedicated circuit – afternoon boost (closed to new entrants)		
	Franchise Tariffs J,J6,JT,J8		
	Off Peak – 3 hours per afternoon 11:00PM to 7:00AM each day		
	Standing Charge	\$/customer pa	\$16.20
	Off Peak Energy	c/kWh	1.447
NEE32	Dedicated circuit 8 to 8 (closed to new entrants)		
	Franchise Tariffs Y6,YT,Y8		
	Off Peak – 6 or 8 hrs 8:00PM to 8:00AM each day		
	Standing Charge	\$/customer pa	\$20.40
	Off Peak Energy	c/kWh	1.273



SCHEDULE OF NETWORK USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE40 *Medium single rate (closed to new entrants)*

Franchise Tariffs B,E,G,N

Standing Charge	\$/customer pa	\$61.20
Energy - All Consumption	c/kWh	6.248

NEE41 *Medium single rate & Dedicated Circuit (closed to new entrants)*

Franchise Tariffs B,E,G,N & Y6,YT,Y8

Off Peak – 11:00PM to 7:00AM each day

Standing Charge	\$/customer pa	\$81.60
Peak Energy	c/kWh	6.248
Off Peak Energy	c/kWh	1.412

NEE42 *Medium single rate & Dedicated Circuit – afternoon boost (closed to new entrants)*

Franchise Tariffs B,E,G,N & J,J6,JT,J8

Off Peak – 11:00PM to 7:00AM each day

Standing Charge	\$/customer pa	\$77.40
Peak Energy	c/kWh	6.248
Off Peak Energy	c/kWh	1.447

NEE43 *Medium single rate & Dedicated circuit 8 to 8 (closed to new entrants)*

Franchise Tariffs B,E,G,N & J,J6,JT,J8

Off Peak – 11:00PM to 7:00AM each day

Standing Charge	\$/customer pa	\$81.60
Peak Energy	c/kWh	6.248
Off Peak Energy	c/kWh	1.273

Medium Customer Tariffs

Applies to > 50kVA & > 160 MWh/pa and < 400 MWh/pa

NEE51 *Medium two rate 5 Day (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$181.20
Peak Energy	c/kWh	8.258
Off Peak Energy	c/kWh	2.324

NEE52 *Unmetered supplies*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Peak Energy	c/kWh	6.341
Off Peak Energy	c/kWh	3.580

NEE54 *Medium two rate 5 Day Interruptible*

Available as an alternative to NEE21 or NEE51 in locations TXU Networks interruptability infrastructure is established. Further conditions available from TXU Networks Pty Ltd

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$181.20
Peak Energy (Max Chg 10kVA)	c/kWh	7.776
Peak Energy (Min Chg 100kVA)	c/kWh	7.353
Off Peak Energy	c/kWh	2.324



SCHEDULE OF NETWORK USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

NEE55 *Snowfields*

Peak Times – 1 May to 30 September

Off Peak – All other times

Standing Charge	\$/customer pa	\$126.60
-----------------	----------------	----------

Peak Energy	c/kWh	7.085
-------------	-------	-------

Off Peak Energy	c/kWh	0.995
-----------------	-------	-------

NEE56 *Medium demand multi-rate*

Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM

Monday – Friday

Shoulder Times – 10:00AM to 4:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$1747.80
-----------------	----------------	-----------

Peak Energy	c/kWh	4.453
-------------	-------	-------

Shoulder Energy	c/kWh	4.059
-----------------	-------	-------

Off Peak Energy	c/kWh	2.316
-----------------	-------	-------

Contract Demand	\$/kVA pa	\$53.00
-----------------	-----------	---------

Minimum Demand 50 kVA

NEE60 *Medium two rate 7 Day (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Sunday

Off Peak – All other times

Standing Charge	\$/customer pa	\$202.20
-----------------	----------------	----------

Peak Energy	c/kWh	8.657
-------------	-------	-------

Off Peak Energy	c/kWh	2.648
-----------------	-------	-------

Large Customer Tariffs

Applies to > 150kVA & > 400 MWh/pa

NEE71 *Large demand - Either > 150kVA & > 400 MWh/pa & < 750MWh/pa Or < 280kVA & > 750MWh (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$3055.20
-----------------	----------------	-----------

Peak Energy	c/kWh	3.731
-------------	-------	-------

Off Peak Energy	c/kWh	1.603
-----------------	-------	-------

Contract Demand	\$/kVA pa	\$57.35
-----------------	-----------	---------

Minimum Demand 150kVA

NEE72 *Large demand - > 280kVA & > 750MWh/pa (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$3055.20
-----------------	----------------	-----------

Peak Energy	c/kWh	2.769
-------------	-------	-------

Off Peak Energy	c/kWh	1.603
-----------------	-------	-------

Contract Demand	\$/kVA pa	\$67.40
-----------------	-----------	---------

Minimum Demand 280kVA

NEE74 *Large two rate 5 Day (closed to new entrants)*

Peak Times – 7:00AM to 11:00PM Monday – Friday

Off Peak – All other times

Standing Charge	\$/customer pa	\$200.40
-----------------	----------------	----------

Peak Energy	c/kWh	9.822
-------------	-------	-------

Off Peak Energy	c/kWh	2.818
-----------------	-------	-------

SCHEDULE OF NETWORK USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST



NEE75	Large demand multi-rate - Either > 150kVA & > 400 MWh/pa & < 750MWh/pa Or <280kVA & >750MWh		
	Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday Shoulder Times – 10:00AM to 4:00PM Monday – Friday Off Peak – All other times		
	Standing Charge	\$/customer pa	\$3010.20
	Peak Energy	c/kWh	3.885
	Shoulder Energy	c/kWh	3.442
	Off Peak Energy	c/kWh	1.523
	Contract Demand	\$/kVA pa	\$57.90
	Minimum Demand 150kVA		

NEE76	Large demand multi-rate - > 280kVA & > 750MWh/pa		
	Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday Shoulder Times – 10:00AM to 4:00PM Monday – Friday Off Peak – All other times		
	Standing Charge	\$/customer pa	\$3010.20
	Peak Energy	c/kWh	3.035
	Shoulder Energy	c/kWh	2.474
	Off Peak Energy	c/kWh	1.523
	Contract Demand	\$/kVA pa	\$67.20
	Minimum Demand 280kVA		

High Voltage Tariffs

Applies to 22,000 Volt supplies

NEE81	High Voltage demand		
	Peak Times – 7:00AM to 11:00PM Monday – Friday Off Peak – All other times		
	Standing Charge	\$/customer pa	\$3151.20
	Peak Energy	c/kWh	1.516
	Off Peak Energy	c/kWh	0.628
	Contract Demand	\$/kVA pa	\$62.84
	Minimum Demand 1150kVA		

NEE82	Traction		
	Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM Monday – Friday Shoulder Times – 10:00AM to 4:00PM Monday – Friday Off Peak – All other times		
	Standing Charge	\$/customer pa	\$3151.20
	Peak Energy	c/kWh	1.691
	Shoulder Energy	c/kWh	1.432
	Off Peak Energy	c/kWh	0.718
	Contract Demand	\$/kVA pa	\$58.52
	Minimum Demand 1150kVA		

SCHEDULE OF NETWORK USE OF SYSTEM TARIFFS

Date of Application - 1 January 2004

Excludes GST

**NEE83 Small High Voltage demand**

Peak Times – 7:00AM to 10:00AM and 4:00PM to 11:00PM		
Monday – Friday		
Shoulder Times – 10:00AM to 4:00PM Monday – Friday		
Off Peak – All other times		
Standing Charge	\$/customer pa	\$3151.20
Peak Energy	c/kWh	7.456
Shoulder Energy	c/kWh	7.138
Off Peak Energy	c/kWh	0.651
Contract Demand	\$/kVA pa	\$11.84
Minimum Demand 150kVA		

Subtransmission Tariffs

Applies to 66,000 Volt supplies

NEE91 Subtransmission demand - <25000kVA and < 20km from Terminal Station

Peak Times – 7:00AM to 11:00PM Monday – Friday		
Off Peak – All other times		
Standing Charge	\$/customer pa	\$18,066.00
Peak Energy	c/kWh	0.979
Off Peak Energy	c/kWh	0.163
Contract Demand	\$/kVA pa	\$9.36
Minimum Demand 10500kVA		

NEE94 Subtransmission demand - >25000kVA and < 20km from Terminal Station

Peak Times – 7:00AM to 11:00PM Monday – Friday		
Off Peak – All other times		
Standing Charge	\$/customer pa	\$18,066.00
Peak Energy	c/kWh	0.934
Off Peak Energy	c/kWh	0.162
Contract Demand	\$/kVA pa	\$6.52
Minimum Demand 25000kVA		

NEE95 Subtransmission demand - <25000kVA and > 20km from Terminal Station

Peak Times – 7:00AM to 11:00PM Monday – Friday		
Off Peak – All other times		
Standing Charge	\$/customer pa	\$18,066.00
Peak Energy	c/kWh	1.012
Off Peak Energy	c/kWh	0.164
Contract Demand	\$/kVA pa	\$8.72
Minimum Demand 10500kVA		

ATTACHMENT 4

RULES FOR DETERMINING A CUSTOMERS MAXIMUM DEMAND

For the purposes of determining a customer's Maximum Demand for Network Tariffs the following rules apply:

Definitions:

“Maximum Demand” means the demand determined in accordance with paragraphs (1) and (2) below which is made available by a Distributor for use by a customer at the Supply Point and is the basis for setting maximum demand charges to be paid by the customer to the Distributor each billing period. The Maximum demand is measured in kilo volt amps (kVA) and is calculated as the energy consumption recorded over the demand integration period divided by the demand integration period in hours. The demand integration period is 30 minutes. The Maximum Demand for a Supply Point is always more than or equal to the minimum chargeable demand applicable to the tariff, as specified in the Distribution Tariff Schedule (Attachment 1).

The formula for determining kVA is:

$$kVA = \sqrt{(KW^2 + kVAR^2)}$$

Where:

kW = kilo watts recorded over a 30 minute period

KVAR = kilo volt amp reactive recorded over a 30 minute period.

1. Initial Selection of Maximum Demand

(a) Supply Points not previously supplied under a contract demand tariff:

If a customer requests a supply of electricity under a demand metered Network Tariff, then an initial level of Maximum Demand must be agreed between the customer and TXU Networks as set out below:

(i) For existing Supply Points: during the third month of supply, the customer and TXU Networks must negotiate a Maximum Demand to apply for the following 12 months having regard to:

(A) the minimum chargeable demand applicable to the relevant Distribution Tariff as set out in the schedule of Distribution Tariffs (Attachment 1).

(B) the actual highest metered maximum demand recorded since supply commenced.

(ii) For new Supply Points: the customer and TXU Networks must negotiate a Maximum Demand to apply for a minimum of the following 12 months having regard to:

- (A) the minimum chargeable demand applicable to the relevant Distribution Tariff as set out in the schedule of Distribution Tariffs (Attachment 1).
- (B) the expected maximum demand of the relevant Supply Point.

(b) **Supply Points previously supplied under a demand tariff**

The records of metered demand for the customer in respect of the relevant Supply Point for the preceding 12 months must be examined. The Maximum Demand, for the customer in respect of the relevant Supply Point, is the highest of:

- (i) the maximum recorded demand that occurred in the preceding 12 month period; and
- (ii) the minimum chargeable demand applicable to the relevant Distribution Tariff (as specified in Attachment 1); and
- (iii) the contract demand under the previous tariff.

Where (i) is the highest and the customer satisfies TXU Networks that the maximum recorded demand was due to an unusual situation that is unlikely to recur, then the customer and TXU Networks must negotiate a Maximum Demand to apply for a minimum of the following 12 months having regard to:

- (iv) the minimum chargeable demand applicable to the relevant Distribution Tariff as set out in Attachment 1; and
- (v) the expected maximum demand of the relevant Supply Point.

2. **Changes to Maximum Demand**

(a) **Increases in Maximum Demand**

- (i) Where a customer requires an increase in Maximum Demand at a Supply Point, the customer must make a written request to TXU Networks. The increased level of Contract Demand shall apply from the requested date or as near as possible thereafter, subject to any required work being completed by TXU Networks.
- (ii) Temporary increases in Maximum Demand may be made available by TXU Networks to the customer in respect of the relevant Supply Point to cover specific, short-term needs, such as the commissioning of new plant, subject to:
 - (A) a minimum of one month's written notice from the customer; and

- (B) prior agreement from the local DB (which agreement will be conditional upon the necessary capacity being available in TXU Networks Distribution System).

(b) **Temporary Increases in Maximum Demand**

Temporary increases in Maximum Demand will:

- (i) be defined in terms of “additional demand” for a specific period;
- (ii) apply for one full billing period, except in the case of commissioning of new plant, in which case the duration of the temporary increase may be extended for the duration of the commissioning;
- (iii) be charged at the standard Maximum Demand price; and
- (iv) be limited to once occurrence in any 12 month period unless otherwise agreed by the local DB.

(c) **Reduction in Maximum Demand**

- (i) Where a customer requires a reduction in Maximum Demand at Supply Point, the customer must give 12 months written notice of this requirement. If TXU Networks agrees to reduce the Maximum Demand to any level down to the level sought by the customer, TXU Networks must notify the customer in writing within the 12-month notice period of a new Maximum Demand. The new Maximum Demand is to be applied from the reading date following the reading date that falls at the end of that 12-month notice period.

However, following installation by the customer of load management equipment approved by TXU Networks or the implementation of a demand management initiative approved by TXU Networks, the 12-month notice period may be reduced at the discretion of TXU Networks.

- (ii) If, in the 12 months following any reduction in Maximum Demand under sub-paragraph (i), the reduced Maximum Demand is exceeded, then the demand so recorded becomes the Maximum Demand applicable from the time of the reduction. This shall not apply to temporary increases in demand negotiated under clause 2(a)(ii).

(d) **Changes following Maximum Demand being exceeded**

In the event that the metered maximum demand in a billing period exceeds the Maximum Demand for that customer in respect of the relevant Supply Point;

- (i) a new Maximum Demand is established equal to the metered demand in that billing period;
- (ii) the new Maximum Demand shall apply for at least 12 months unless an exemption is obtained under sub-paragraph (iii) below;
- (iii) If the new Maximum Demand is established as a result of a fault in the customer's electrical installation in respect of the relevant Supply Point, then TXU Networks may reduce the Maximum Demand back to the previous level after 3 months, provided:
 - (A) TXU Networks receives a written application for such a reduction from the customer within 30 days of billing following the fault; and
 - (B) TXU Networks is satisfied that:
 - (I) the fault has been diagnosed; and
 - (II) action has been taken to avoid a recurrence of that or similar faults; and
- (iv) Where the capacity of TXU Networks Distribution System is inadequate to make supply available at a higher rate on a continuous basis, TXU Networks may advise the customer that the new Maximum Demand will apply only for the billing period in which it was established, pending augmentation of TXU Networks Distribution System and renegotiation of a revised Maximum Demand. The maximum demand thereafter is limited to the available capacity of TXU Networks Distribution System, as determined by TXU Networks, by suitable load limiting equipment installed by the customer to the satisfaction of TXU Networks.

3. Multiple Supplies

Where TXU Networks provides multiple supplies, including alternative supplies to a customer in respect of a particular Supply Point, each supply shall be separately metered and billed under the Network Tariff selected by the customer for each supply. However, where such multiple supplies are taken from and metered at a single Supply Point they are to be treated as a single supply for Network Tariff and billing purposes.