



Network Tariff Report for 2004 Calendar Year

March 2004

Contacts

Inquiries relating to this Report may be directed to:

➤ General Manager Infrastructure Management

Agility Management

For and on behalf of

AGL Electricity Limited

PO Box 14120,

MCMC VIC 8001

Telephone: 03 9201 7006

Fax: 03 9201 7699

or

➤ Essential Services Commission, Victoria

2nd Floor, 35 Spring Street

MELBOURNE VIC 3000

Telephone: 03 9651 0222

Fax: 03 9651 3688

E-mail: reception@esc.vic.gov.au

Website: www.esc.vic.gov.au

This report has been prepared by Agility Management for and on behalf of AGL Electricity Limited.

Table of Contents

1	<i>Introduction</i>	<i>1</i>
2	<i>Pricing Objectives/Principles</i>	<i>1</i>
3	<i>Tariff Structures</i>	<i>2</i>
4	<i>Tariff Categories.....</i>	<i>2</i>
5	<i>Pricing Methodology</i>	<i>3</i>
5.1	Distribution Use of System Pricing	3
5.2	Transmission Pricing.....	4
6	<i>Economically Efficient Tariffs.....</i>	<i>5</i>
7	<i>Network Tariffs.....</i>	<i>7</i>
7.1	Residential – General Purpose	8
7.2	Residential – Time of Use.....	9
7.3	Residential – Off Peak Heating Only	10
7.4	Small Business – General Purpose	11
7.5	Small Business – Time of Use Weekdays.....	12
7.6	Small Business – Time of Use Weekdays Demand	13
7.7	Small Business – Time of Use Extended	14
7.8	Small Business – Time of Use Extended Demand.....	15
7.9	Large Business – LV 0.4 - 0.8 GWh.....	16
7.10	Large Business – LV 0.8 ⁺ - 2.2 GWh.....	17
7.11	Large Business – LV 2.2 ⁺ - 6.0 GWh.....	18
7.12	Large Business – LV 6.0 ⁺ GWh.....	19
7.13	Large Business – HV	20
Appendix 1	<i>Network Tariffs for 2004 (exclusive of GST).....</i>	<i>21</i>
Appendix 2	<i>Distribution Tariffs for 2004 (exclusive of GST).....</i>	<i>27</i>
Appendix 3	<i>Transmission Tariffs for 2004 (exclusive of GST)</i>	<i>33</i>

1 INTRODUCTION

The Essential Services Commission, Victoria (ESC), formerly the Office of the Regulator General, has been established as an independent economic jurisdictional regulator to promote competitive market conduct, prevent misuse of monopoly or market power, facilitate entry into relevant markets, facilitate efficiency in regulated industries and ensure that users and consumers benefit from competition and efficiency.

In its Price Determination¹, the ESC placed an obligation on each Distribution Business (DB) to prepare and publish a Tariff Report, by 1 March of each calendar year containing sufficient information to enable customers to understand the basis of the tariff policies adopted by their respective DB. The ESC specified that the tariff report should include (but is not limited to):

- a) The distribution and transmission tariffs charged by the DB;
- b) A discussion of the policy framework and tariff principles adopted by the DB in framing the structures and levels of its tariffs;
- c) An explanation of the basis on which the DB has determined the appropriate breakdown between fixed and variable charges;
- d) The rationale for the introduction of any new tariffs, or the withdrawal of tariffs;
- e) An explanation of how the DB has had regard to the consideration of upper and lower bounds of efficient pricing in determining its distribution tariffs;
- f) The extent to which the tariff structures adopted provide efficient consumption signals to distribution customers;
- g) The methodology adopted for allocating transmission-related costs to distribution customers through its transmission tariffs; and
- h) An estimate of the average annual distribution and transmission charge (in \$) for each combination of distribution and transmission tariff.

This report details the network tariffs applicable to customers connected to the AGL Electricity Limited (AGLE) electricity network for the calendar year 2004.

2 PRICING OBJECTIVES/PRINCIPLES

Prices should be designed to recover the appropriate level of costs in a manner that best reflects the incidence of costs and enables their allocation amongst customer groups. The approach should avoid price discrimination and cross-subsidies whilst promoting the efficient use of the distribution assets. The principal objectives in setting network prices are as follows:

- **Economic efficiency** – prices should send appropriate signals to network customers regarding their use of the network and should encourage efficient consumption.

¹ Electricity Distribution Price Determination 2001-05, Volume II Price Controls, Clause 2.3.13, Office of the Regulator-General, Victoria, September 2000.

- **Financial sufficiency** – prices should raise adequate revenue to sustain distribution business viability.
- **Cost Reflectivity** – pricing method should be as cost reflective as possible, recognising that the distribution network supplies large numbers of customers of various sizes and load patterns at different voltage levels.
- **Equity** – pricing must be fair and provide non-discriminatory access to the distribution system. This means that network prices must be published to provide transparency and charges to any particular customer must be the same regardless of their contestability status or which Retailer the customer is taking supply from.
- **Simplicity** – prices should be comprehensible to customers so that they can react to tariff signals.
- **Certainty** – prices should remain stable over time to permit customers to conduct long term planning.

AGLE endeavours to satisfy the above objectives through its approach to setting Network Prices.

3 TARIFF STRUCTURES

To address the above pricing objectives/principles AGLE has adopted the following three tariff structures:

- a) **General Purpose** – single rate tariff (¢/kWh) applicable for all times of the day with a fixed charge (known as a standing charge). This tariff generally applies to customers that consume small amounts of electricity, such as residential customers;
- b) **Time of Use** – two rate tariff (¢/kWh) applicable to peak and off-peak periods with a standing charge. This tariff is applicable to 'Residential' and 'Small Business' customers; and
- c) **Time of Use Demand** – two rate tariff (¢/kWh) applicable to peak and off-peak periods, a demand charge (\$/kW pa) and a fixed charge. This tariff is applicable to 'Large Business' customers and 'Small Business' customers with meters capable of measuring demand.

4 TARIFF CATEGORIES

AGLE tariffs are grouped into the following three categories:

- a) **Residential** – This category includes three network tariffs designed to meet the needs of residential customers;
- b) **Small Business (SB)** – This category refers to low voltage customers consuming an annual amount of electricity less than 400 MWh (ie 400,000 kWh) and having a maximum demand of less than 150 kVA (or 120 kW). Unmetered supply is also included in this category. AGLE offers five SB network tariffs, including two demand tariffs, to meet the needs of customers belonging to this category. Customers are encouraged to assess their usage and load pattern in order to determine the network tariff that best meets their needs; and

- c) **Large Business (LB)** – This category refers to subtransmission customers, high voltage customers and low voltage customers either consuming an annual amount of electricity greater than or equal to 400 MWh or having a maximum demand greater than or equal to 150 kVA (or 120 kW). Low voltage customers supplied from an on-site or dedicated substation also belong to this category. Large Business customers are initially assigned to a network tariff depending on their annual consumption and the voltage level at which supply is taken. Customers are encouraged to assess their annual usage on a regular basis to determine whether they are entitled to change their tariff and take advantage of the different rates available.

The full details of network tariff names, codes and rates are in Appendix 1. These tariffs were approved by the ESC on 24 December 2003 and were effective as of 1 January 2004.

5 PRICING METHODOLOGY

Network Tariffs consist of two components:

- Distribution related charges , and
- Transmission related charges.

5.1 Distribution Use of System Pricing

Distribution Use of System (DUoS) tariffs are designed to recover:

- a) the costs of operating, maintaining and augmenting the distribution network. In other words, DUoS tariffs recover the cost of providing the network from the point at which the distributor is connected to the Transmission system to an end-user;
- b) a required return on capital (including new capital expenditure) which allows the distributor to earn a reasonable rate of return (determined by the ESC); and
- c) a return of capital.

In order to produce DUoS tariffs, a cost of supply model is used to allocate DUoS costs to different tariff categories according to the use of the distribution network by customers within each category.

Costs are divided between fixed and variable costs. The fixed cost element, incorporated into the standing charge component of the tariff, is made up of customer-related costs such as the provision of metering equipment and service line to customers' premises. The variable element (divided between a unit charge and a demand charge) depends on the voltage at which supply is taken. The unit charge reflects the cost of providing a customer with access to the network at voltages above which supply is taken. The demand charge reflects the cost of providing the network, during peak periods, at the voltage level from which supply is taken. In other words, it is the cost to the distributor of installing a network capable of handling the load placed on it by the end-user. The higher the demand, the greater is the cost of the network implemented to handle the load.

For customers without demand metering it is necessary to recast demand-related costs as a unit charge.

The pricing methodology adopted by AGLE to develop its annual DUoS tariffs is explained in detail in AGLE's Network Tariff Report for 2001 Calendar year available on the ESC website.

The AGLE distribution tariffs schedule for the calendar year 2004 is shown in Appendix 2.

5.2 Transmission Pricing

AGLE incurs costs associated with the use of and connection to the Transmission system as well as Inter-network provider distribution charges and embedded generator payments. These costs are passed onto network customers and the transmission prices are designed to recover the following '*Pass Through costs*':

- Transmission Use of System charges - These charges are payable to VenCorp and cover the costs incurred by SPI PowerNet to provide and maintain the transmission system and the costs incurred by VenCorp in operating the transmission system;
- Equalisation payment payable to VenCorp;
- Settlement residue that causes a reduction in VenCorp charges;
- Prescribed connection services charge payable to SPI PowerNet for connection to the transmission system;
- Excluded connection services charges payable to SPI PowerNet;
- Inter-network provider distribution service charges receivable from or payable to other DB's for connection to and use of their network; and
- Embedded generator payments –These are the amounts the distributor pays to embedded generators to reflect a share of the amount of expenditure that would otherwise be required if the generator was not supplying into the network.

Generally, in formulating the transmission tariffs, the 'Pass Through Costs' adjusted for the K factor (Adjusted Pass through Costs) are allocated to the different tariffs in accordance with the allocation methodology described below.

The 'Adjusted Pass through Costs' can be separated into fixed, demand based and energy based components as follows:

- a) **Fixed component** – Equalisation Factor. This component is assigned to the 'Standing Charge' element of the transmission tariffs.
- b) **Demand based component** – TUoS Usage charge², K factor and inter-network provider distribution service charge. This component is assigned to the demand charge element (or peak rate element for non-demand tariffs) of the transmission tariffs.
- c) **Energy based component** – Prescribed Connection charge, Excluded Transmission Services charges, General Service charge and Common Service charge³. Part of the Common Service charge is assigned to the off peak rate element of the transmission tariffs. The balance of this component is assigned to the peak rate element of the tariffs.

² TUoS usage charge is a component of VenCorp charges.

³ General Service and Common Service charges are components of VenCorp charges

These components are then allocated to each transmission tariff class based on the following ratios:

- a) **Fixed component** - The ratio of the total energy distributed to a particular tariff over the total energy for all customers
- b) **Demand based component** - The ratio of the total peak energy distributed to a particular tariff over the total peak energy for all customers.
- c) **Energy based component** - The ratio of the total peak (or off peak) energy for a particular tariff over the total peak (or off peak) energy for all customers

The transmission prices are then established to recover the individual amounts allocated to each tariff on the basis of available metering data. For example, the energy price for 'Residential – General Purpose' single rate tariff is derived by dividing the demand and energy (peak and off peak) based amounts allocated to that tariff by the forecast energy. The standing charge is calculated by dividing the fixed amount allocated to that tariff by the forecast number of customers. In the case of 'Large Business HV', the standing charge is derived by dividing the fixed component allocated to that tariff by the forecast number of HV customers. The demand charge is calculated by dividing the demand-based component allocated to that tariff by the forecast demand. A similar methodology is applied to derive the peak and off peak rates.

However, since there has been a material increase in the TUoS charges applicable to AGLE in 2004, the Essential Services Commission has allowed AGLE to use a Y equal to 20% for the purpose of complying with the $(1+CPI)*(1+Y)$ re-balancing constraints in the 2004 calendar year. As a consequence, AGLE's 2004 Transmission Tariffs have been calculated by indexing 2003 average Transmission Tariffs by an amount not exceeding $(1+CPI)*(1+20\%)$ where CPI equals 2.6% (ie 23.1%). This has impacted all network tariffs.

AGLE transmission tariffs schedule for the calendar year 2004 is shown in Appendix 3.

6 ECONOMICALLY EFFICIENT TARIFFS

AGLE is required under Clauses 2.3.12 of the Distribution Price Determination 2001-05, Volume II Price Controls to demonstrate that its distribution tariffs are economically efficient by illustrating that its distribution prices fall within a cost window bounded by the following lower and upper bounds:

- a) **Lower bound** – The ESC defined the lower bound, with regards to a specific distribution tariff, as being the avoidable cost of serving distribution customers assigned to that distribution tariff; and
- b) **Upper bound** – The ESC defined the upper bound, with regards to a specific distribution tariff, as being the cost of providing the service on a stand-alone basis to distribution customers assigned to that distribution tariff.

As part of developing the 2001 AGLE Network Tariff Report, AGLE engaged Cap Gemini Ernst & Young to provide an assessment of the avoidable and stand-alone distribution costs for 2001⁴. In order to determine the avoidable and stand alone costs for 2004, the 2001 avoidable and stand-alone costs as produced by Cap Gemini Ernst & Young were indexed by $(1+CPI_{2002})*(1+CPI_{2003})*(1+CPI_{2004})$.

⁴ This report is attached to the AGLE Network Tariff Report for Calendar year 2001.

The table below summarises the results for 2004.

Table 4. Economically efficient DUoS tariffs – Lower & Upper bounds.

DUoS tariff	Avoidable cost (¢/kWh)	2004 Average charge ⁵ (¢/kWh)	Stand-alone cost (¢/kWh)	Scale index ⁶
Residential – General Purpose	1.579	5.677	8.078	63.1%
Residential – Time of Use	0.638	3.170	8.078	34.0%
Residential – Off Peak Heating Only	0.381	1.025	8.078	8.4%
SB – General Purpose	1.915	6.294	6.432	96.9%
SB – Time of Use Weekdays	0.871	4.817	6.432	71.0%
SB – Time of Use Weekdays Demand	0.823	4.004	6.432	56.7%
SB – Time of Use Extended	0.955	5.208	6.432	77.7%
SB – Time of Use Extended Demand	0.822	4.273	6.432	61.5%
SB – Unmetered Supply	0.428	2.969	6.432	42.3%
LB – LV 0.4 – 0.8 GWh	1.446	3.612	4.989	61.1%
LB – LV_{MS} 0.4 – 0.8 GWh	1.446	2.940	4.989	42.2%
LB – LV 0.8⁺ – 2.2 GWh	0.854	2.891	4.989	49.3%
LB – LV_{MS} 0.8⁺ – 2.2 GWh	0.854	3.003	4.989	52.0%
LB – LV_{RF} 0.8⁺ – 2.2 GWh	0.854	2.488	4.989	39.5%
LB – LV 2.2⁺ – 6.0 GWh	0.669	2.231	4.989	36.2%
LB – LV_{MS} 2.2⁺ – 6.0 GWh	0.669	2.297	4.989	37.7%
LB – LV_{RF} 2.2⁺ – 6.0 GWh	0.669	2.485	4.989	42.1%
LB – LV 6.0⁺ GWh	0.521	1.772	4.989	28.0%
LB – LV_{MS} 6.0⁺ GWh	0.521	1.737	4.989	27.2%
LB – LV_{RF} 6.0⁺ GWh	0.521	1.447	4.989	20.7%
LB – HV	0.729	1.810	3.734	36.0%
LB – HV_{RF}	0.729	1.319	3.734	19.6%
LB – Annual Consumption ≥ 55 GWh	0.511	1.088	3.734	17.9%
LB – Subtransmission	0.268	0.318	1.471	4.2%

The above table demonstrates that AGL's average distribution prices for 2004 fall within the avoidable and stand-alone costs and therefore are economically efficient.

⁵ Average charges were calculated by applying 2004 DUoS tariffs to 2002 quantities.

⁶ The scale index indicates the relative position of the average charge with respect to the avoidable and stand-alone costs. A scale index value of 0% denotes that the average charge is equal to the avoidable cost. A scale index of 100% indicates that the average charge is equal to the stand-alone cost.

7 NETWORK TARIFFS

Network tariffs incorporate the rates that AGLE applies to customer's usage in order to produce their electricity network bill. They are the aggregate of two sets of tariffs namely DUoS and Transmission tariffs.

The sections below provide a brief description of individual tariffs and compare the 2003 and 2004 network tariffs by using five usage levels per network tariff namely *very low*, *low*, *average*, *high* and *very high*. The *average* consumption is calculated by dividing forecast energy by the number of customers. Once the average consumption is calculated the other four usage levels can be derived by applying a percentage to the *average* usage as shown below.

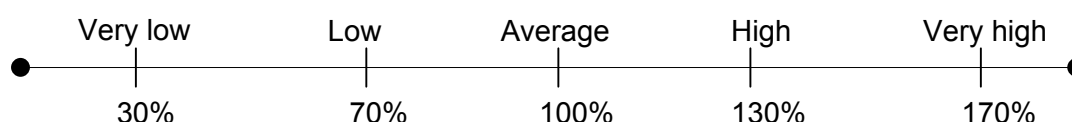


Fig 1. Usage levels as a percentage of average consumption.

To assess the impact of demand based tariffs on customers it is necessary to assume a load factor to estimate the customer's chargeable demand. The demand charge is then applied to the higher of the estimated value or the tariff's minimum chargeable demand.

7.1 Residential – General Purpose


This is a single rate tariff applicable to residential customers on GD or GR deemed retail tariff or residential contestable customers who have chosen to remain on a single rate tariff.

A comparison of the 2003 and 2004 'Residential – General Purpose' network tariff charges for the five usage levels is shown below.


	Very Low 1,242 kWh	Low 2,898 kWh	Average 4,140 kWh	High 5,382 kWh	Very high 7,039 kWh
2003	\$90	\$178	\$244	\$309	\$397
2004	\$94	\$185	\$252	\$320	\$411
Change	4.1%	3.7%	3.6%	3.5%	3.5%

The increase in charges varies from 3.5% to 4.1% depending on usage level, with larger users experiencing a smaller increase.

The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user.

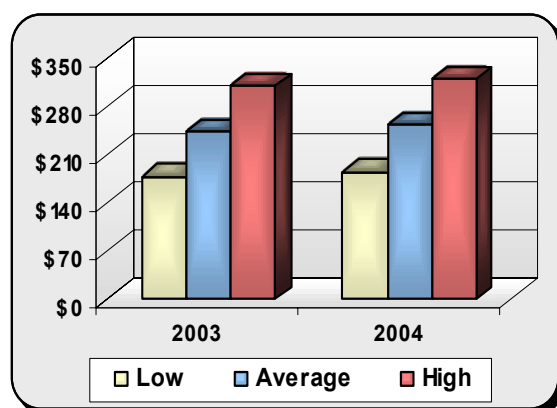

**Network Tariff charge comparison
2003 vs 2004.**

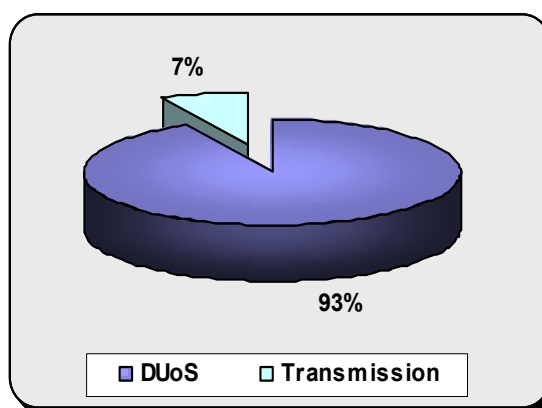

**2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

7.2 Residential – Time of Use


This is a two-rate tariff applicable to residential customers on GH/GL deemed retail tariff or residential contestable customers who have chosen this tariff. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times. Customers who are able to shift some of their peak load to the off-peak period may benefit from being on this tariff. Customers should, however, assess the benefits against the metering cost.

A comparison of the 2003 and 2004 'Residential – Time of Use' network tariff charges for the five usage levels is shown below.


Peak to Total Energy Ratio: 30%					
	Very Low 2,471 kWh	Low 5,766 kWh	Average 8,237 kWh	High 10,708 kWh	Very high 14,002 kWh
2003	\$112	\$203	\$271	\$339	\$430
2004	\$118	\$213	\$284	\$356	\$451
Change	5.7%	5.1%	4.9%	4.8%	4.7%

Peak to Total Energy Ratio: 50%					
	Very Low 2,471 kWh	Low 5,766 kWh	Average 8,237 kWh	High 10,708 kWh	Very high 14,002 kWh
2003	\$139	\$267	\$363	\$458	\$586
2004	\$147	\$280	\$380	\$480	\$613
Change	5.4%	4.9%	4.8%	4.7%	4.6%

The above tables indicate that the increase in the network tariff charge varies from 4.6% to 5.7% depending on customers' consumption and load patterns. Consistent with customers on 'Residential – General Purpose' tariff, larger users experience a lesser increase than small users. The Charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 30%.

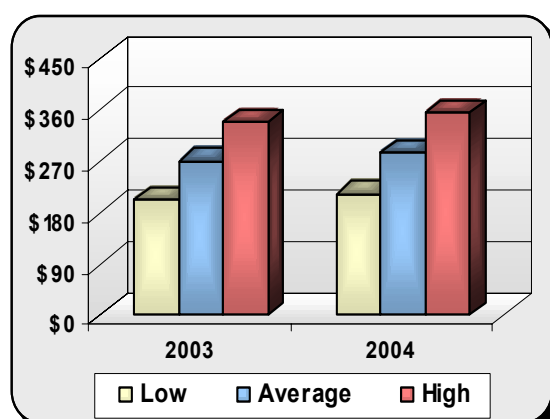

**Network Tariff charge comparison
2003 vs 2004.**

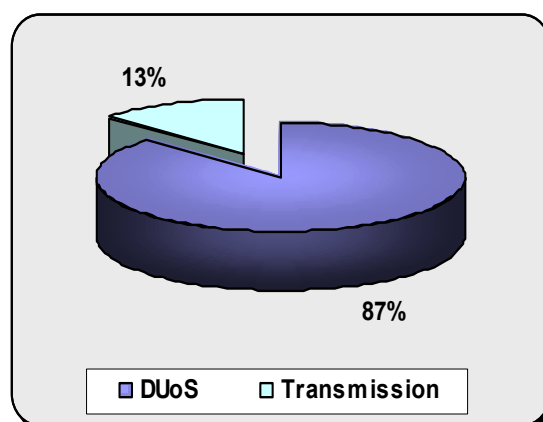

**2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

7.3 Residential – Off Peak Heating Only


This is a complementary tariff to the ‘Residential – General Purpose’ network tariff. It relates to controlled loads such as storage water heating and space heating. It is applicable to customers on J or Y deemed retail tariff or residential contestable customers with controlled loads who have selected this tariff.

A comparison of the 2003 and 2004 ‘Residential – Off Peak Heating Only’ network tariff charges for the five usage levels is shown below.


	Very Low 918 kWh	Low 2,141 kWh	Average 3,059 kWh	High 3,976 kWh	Very high 5,200 kWh
2003	\$10	\$23	\$33	\$44	\$57
2004	\$11	\$25	\$35	\$46	\$60
Change	4.6%	4.6%	4.6%	4.6%	4.6%

The above table indicates that the increase in the network tariff charge is 4.6%.

The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user.

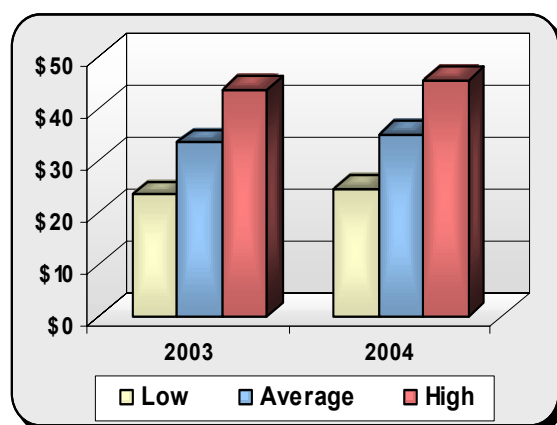

**Network Tariff charge comparison
2003 vs 2004.**

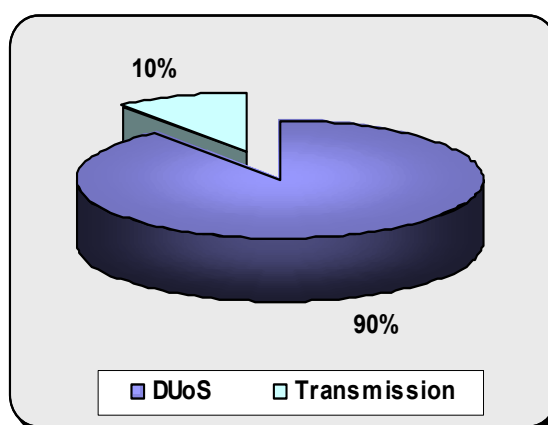

**2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

7.4 Small Business – General Purpose


Generally, this single rate tariff is suitable for small users or customers with very low consumption during off-peak periods. It is applicable to 'Small Business' customers currently on B, E, G and N deemed retail tariff or contestable customers who have chosen this tariff.

A comparison of the 2003 and 2004 'Small Business – General Purpose' network tariff charges for the five usage levels is shown below.


	Very Low 3,016 kWh	Low 7,037 kWh	Average 10,053 kWh	High 13,069 kWh	Very high 17,090 kWh
2003	\$237	\$477	\$656	\$836	\$1,076
2004	\$252	\$507	\$698	\$888	\$1,143
Change	6.5%	6.3%	6.3%	6.2%	6.2%

Consistent with previous observations, larger users experience a lesser increase than smaller users. The increase in charges varies between 6.2% and 6.5% depending on consumption.

The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user.

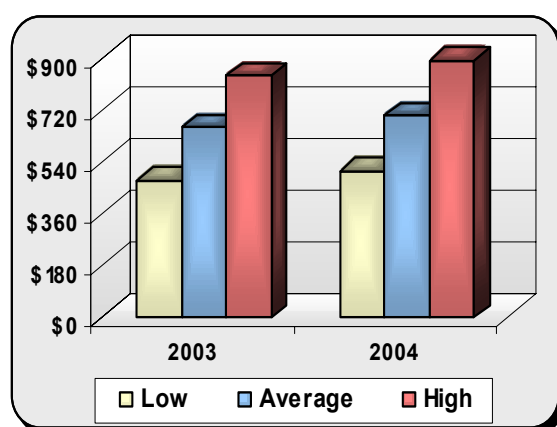

**Network Tariff charge comparison
2003 vs 2004.**

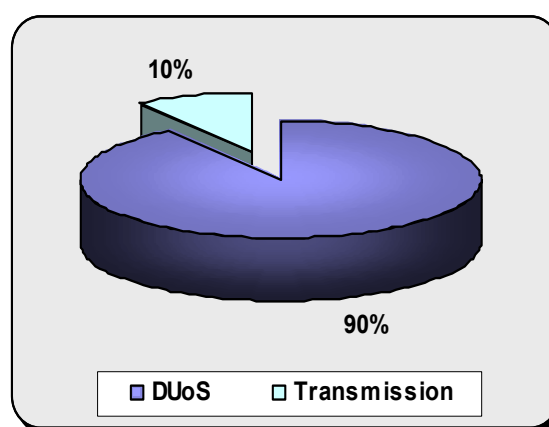

**2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

7.5 Small Business – Time of Use Weekdays

This is a two-rate tariff applicable to 'Small Business' customers on DH/DL deemed retail tariff or contestable customers who have chosen this time of use tariff. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times. Generally, this tariff is suitable for customers who operate 6 or 7 days a week or customers who operate 5 days a week but with large equipment, such as refrigeration units, running during the off peak periods.


A comparison of the 2003 and 2004 'Small Business –Time of Use Weekdays' network tariff charges for the five usage levels is shown below.

Peak to Total Energy Ratio: 40%					
	Very Low 14,854 kWh	Low 34,660 kWh	Average 49,514 kWh	High 64,368 kWh	Very high 84,173 kWh
2003	\$645	\$1,346	\$1,872	\$2,397	\$3,099
2004	\$689	\$1,436	\$1,996	\$2,556	\$3,303
Change	6.8%	6.7%	6.6%	6.6%	6.6%


Peak to Total Energy Ratio: 70%					
	Very Low 14,854 kWh	Low 34,660 kWh	Average 49,514 kWh	High 64,368 kWh	Very high 84,173 kWh
2003	\$912	\$1,969	\$2,762	\$3,555	\$4,612
2004	\$974	\$2,101	\$2,946	\$3,791	\$4,918
Change	6.8%	6.7%	6.7%	6.6%	6.6%

As can be observed from the above tables, the increase in charges varies from 6.6% to 6.8% depending on consumption and load patterns with larger users experiencing a lesser increase than smaller users.

The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 70%.

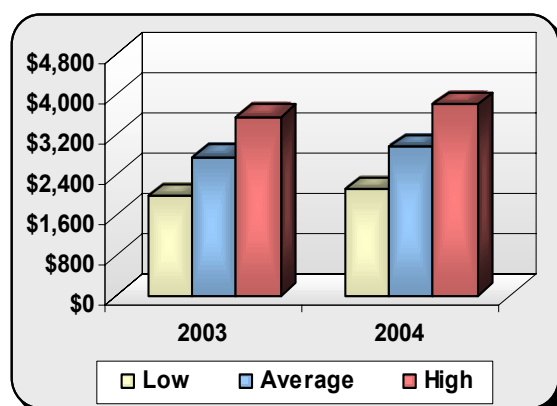

Network Tariff charge comparison
2003 vs 2004.

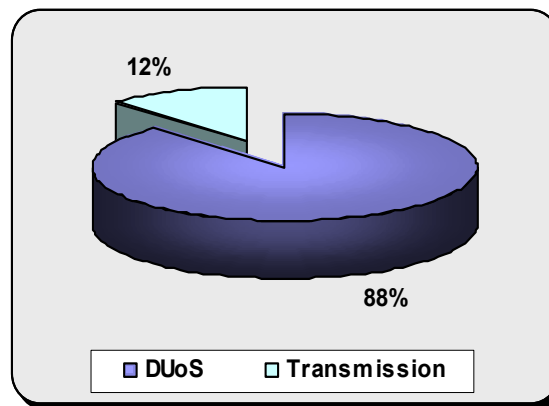

2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.6 Small Business – Time of Use Weekdays Demand


This time of use demand based network tariff attracts a minimum chargeable demand of 60 kW and requires the installation of a meter capable of measuring demand. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2003 and 2004 'Small Business – Time of Use Weekdays Demand' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 40% Load factor 55%				
	Very Low 80,449 kWh	Low 187,714 kWh	Average 268,163 kWh	High 348,612 kWh	Very high ⁷ 455,878 kWh
2003	\$4,443	\$6,939	\$8,811	\$11,135	N/A
2004	\$4,759	\$7,422	\$9,419	\$11,897	N/A
Change	7.1%	7.0%	6.9%	6.8%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 80,449 kWh	Low 187,714 kWh	Average 268,163 kWh	High 348,612 kWh	Very high 455,878 kWh
2003	\$5,152	\$8,595	\$11,177	\$14,210	N/A
2004	\$5,523	\$9,205	\$11,966	\$15,208	N/A
Change	7.2%	7.1%	7.1%	7.0%	N/A

The above tables indicate that the increase in the network tariff charge varies from 6.8% to 7.2% depending on customers' consumption and load patterns. The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 70%.

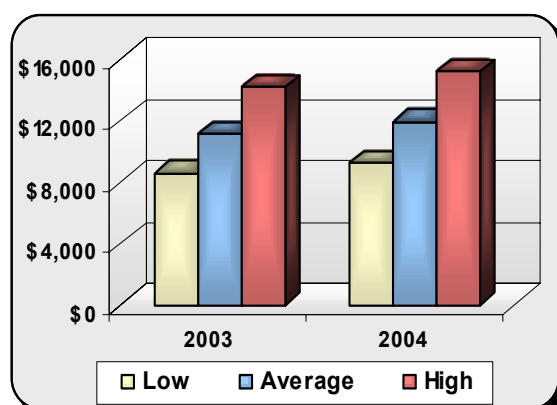

**Network Tariff charge comparison
2003 vs 2004.**

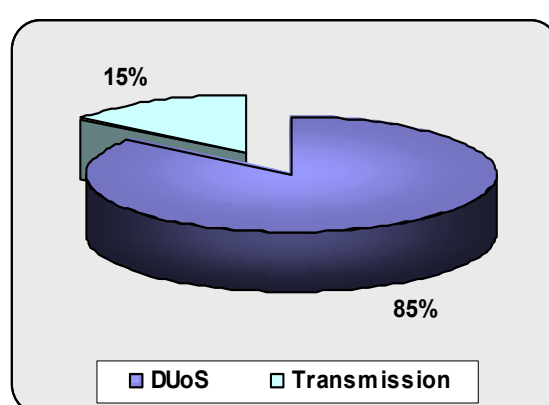

**2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

⁷ This usage is not applicable for this tariff as the usage level is greater than 400,000 kWh, which is the threshold for Small Business tariff category.

7.7 Small Business – Time of Use Extended


This is a two-rate tariff applicable to 'Small Business' customers on B1/B2, E1/E2 and N1/2 deemed retail tariff or contestable customers who have chosen this time of use Tariff. Unlike the previous two tariffs, the peak rate applies to the period 7.00 AM to 11.00 PM all days and the off-peak rate applies to all other times. Generally, this tariff is suitable for customers who operate 5 days a week with no or little equipment running during the weekends.

A comparison of the 2003 and 2004 'Small Business –Time of Use Extended' network tariff charges for the five usage levels is shown below.


Peak to Total Energy Ratio: 60%					
	Very Low 7,946 kWh	Low 18,541 kWh	Average 26,487 kWh	High 34,434 kWh	Very high 45,028 kWh
2003	\$454	\$902	\$1,238	\$1,573	\$2,021
2004	\$486	\$963	\$1,321	\$1,678	\$2,155
Change	7.0%	6.8%	6.7%	6.7%	6.6%

Peak to Total Energy Ratio: 80%					
	Very Low 7,946 kWh	Low 18,541 kWh	Average 26,487 kWh	High 34,434 kWh	Very high 45,028 kWh
2003	\$532	\$1,082	\$1,495	\$1,908	\$2,458
2004	\$568	\$1,154	\$1,594	\$2,034	\$2,620
Change	6.9%	6.7%	6.6%	6.6%	6.6%

The above tables indicate that the increase in the network tariff charge varies from 6.6% to 7.0% depending on customers' consumption and load patterns. The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 80%.

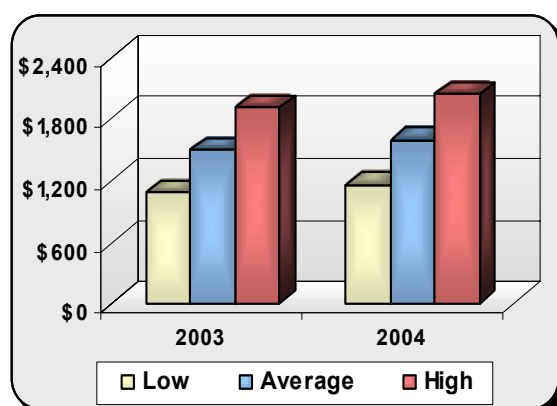

Network Tariff charge comparison
2003 vs 2004.

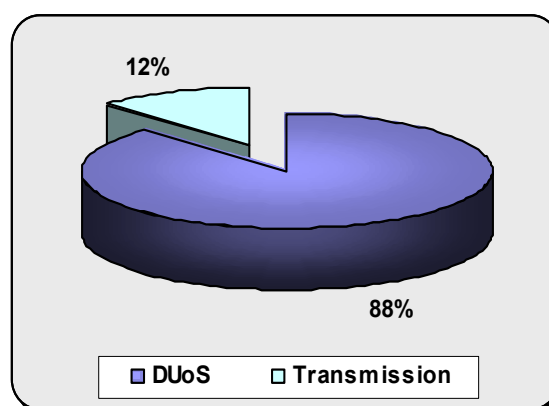

2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.8 Small Business – Time of Use Extended Demand


Like the 'Small Business – Time of use Weekday Demand' tariff, this two rate demand based network tariff also attracts a minimum chargeable demand of 60 kW and requires a metering installation capable of measuring demand. However, the peak rate applies to the period 7.00 AM to 11.00 PM all days and the off-peak rate applies to all other times.

A comparison of the 2003 and 2004 'Small business –Time of Use Extended Demand' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 60% Load factor 55%				
	Very Low 83,174 kWh	Low 194,072 kWh	Average 277,245 kWh	High 360,419 kWh	Very high 471,317 kWh
2003	\$4,647	\$7,415	\$9,492	\$12,109	N/A
2004	\$4,982	\$7,943	\$10,163	\$12,960	N/A
Change	7.2%	7.1%	7.1%	7.0%	N/A

	Peak to Total Energy Ratio: 80% Load factor: 55%				
	Very Low 83,174 kWh	Low 194,072 kWh	Average 277,245 kWh	High 360,419 kWh	Very high 471,317 kWh
2003	\$4,971	\$8,173	\$10,574	\$13,515	N/A
2004	\$5,329	\$8,751	\$11,317	\$14,460	N/A
Change	7.2%	7.1%	7.0%	7.0%	N/A

The above tables indicate that the increase in the network tariff charge varies from 7.0% to 7.2% depending on customers' consumption and load patterns. The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 80%.

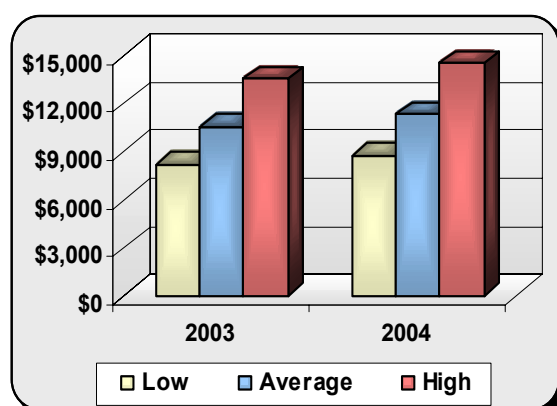

Network Tariff charge comparison
2003 vs 2004.

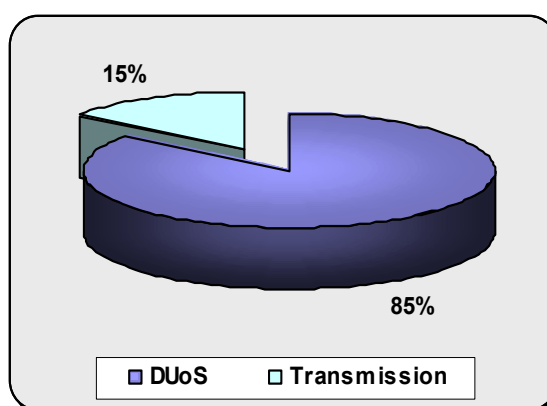

2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.9 Large Business – LV 0.4 - 0.8 GWh


This is a time of use demand based network tariff applicable to LV commercial/industrial customers with annual consumption greater than or equal to 0.4 GWh (400 MWh) but less than or equal to 0.8 GWh (800 MWh). It is also available to customers with an annual consumption less than 400 MWh but a maximum demand greater than or equal to 120 kW (150 kVA). The minimum chargeable demand is 120 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2003 and 2004 'Large Business – LV 0.4 – 0.8 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 157,306 kWh	Low 367,047 kWh	Average 524,354 kWh	High 681,660 kWh	Very high 891,401 kWh
2003	N/A	N/A	\$15,954	\$19,300	N/A
2004	N/A	N/A	\$17,275	\$20,901	N/A
Change	N/A	N/A	8.3%	8.3%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 157,306 kWh	Low 367,047 kWh	Average 524,354 kWh	High 681,660 kWh	Very high 891,401 kWh
2003	N/A	N/A	\$17,618	\$21,464	N/A
2004	N/A	N/A	\$19,150	\$23,339	N/A
Change	N/A	N/A	8.7%	8.7%	N/A

The above tables indicate that the increase in the network tariff charge varies from 8.3% to 8.7% depending on customers' consumption and load patterns. The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 70%.

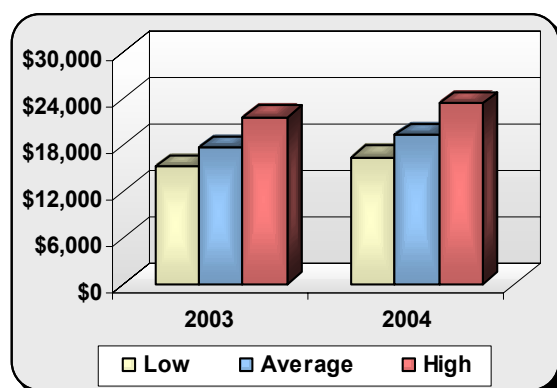

Network Tariff charge comparison
2003 vs 2004.

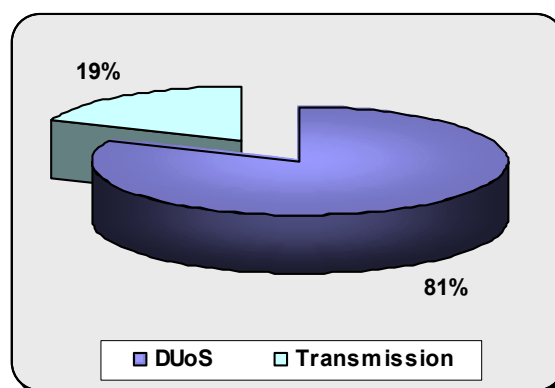

2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.10 Large Business – LV 0.8⁺ - 2.2 GWh


This network tariff has similar structure to the 'Large Business – LV 0.4 – 0.8 GWh' tariff. It is available to LV commercial/industrial customers with annual consumption greater than 0.8 GWh (800 MWh) but less than or equal to 2.2 GWh (2,200 MWh). The minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2003 and 2004 'Large Business – LV 0.8⁺ – 2.2 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 425,314 kWh	Low 992,400 kWh	Average 1,417,714 kWh	High 1,843,028 kWh	Very high 2,410,113 kWh
2003	N/A	\$28,104	\$35,450	\$45,317	N/A
2004	N/A	\$30,587	\$38,664	\$49,421	N/A
Change	N/A	8.8%	9.1%	9.1%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 425,314 kWh	Low 992,400 kWh	Average 1,417,714 kWh	High 1,843,028 kWh	Very high 2,410,113 kWh
2003	N/A	\$30,760	\$39,244	\$50,249	N/A
2004	N/A	\$33,659	\$43,053	\$55,127	N/A
Change	N/A	9.4%	9.7%	9.7%	N/A

The above tables indicate that the increase in the network tariff charge varies from 8.8% to 9.7% depending on customers' consumption and load patterns. The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 70%.

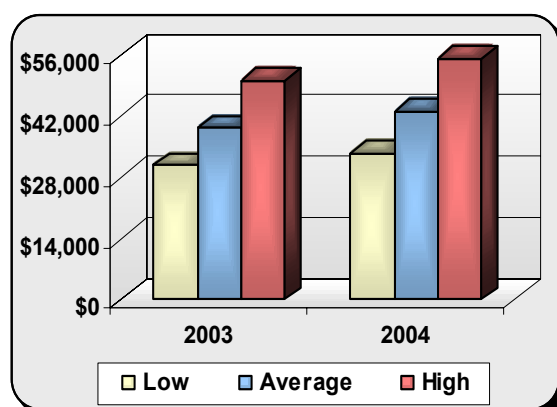

Network Tariff charge comparison
2003 vs 2004.

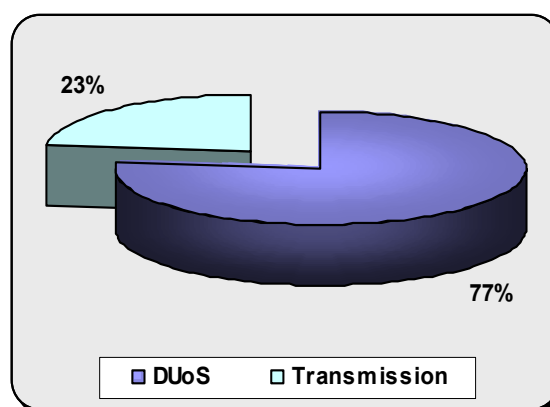

2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.11 Large Business – LV 2.2⁺ - 6.0 GWh


This time of use demand based network tariff is applicable to large LV commercial/industrial customers with annual consumption greater than 2.2 GWh (2,200 MWh) but less than or equal to 6.0 GWh (6,000 MWh). The minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2003 and 2004 'Large Business – LV 2.2⁺ – 6.0 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 911,364 kWh	Low 2,126,516 kWh	Average 3,037,880 kWh	High 3,949,243 kWh	Very high 5,164,395 kWh
2003	N/A	N/A	\$73,247	\$93,352	\$120,159
2004	N/A	N/A	\$80,027	\$101,919	\$131,108
Change	N/A	N/A	9.3%	9.2%	9.1%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 911,364 kWh	Low 2,126,516 kWh	Average 3,037,880 kWh	High 3,949,243 kWh	Very high 5,164,395 kWh
2003	N/A	N/A	\$81,425	\$103,983	\$134,061
2004	N/A	N/A	\$89,481	\$114,209	\$147,179
Change	N/A	N/A	9.9%	9.8%	9.8%

The above tables indicate that the increase in the network tariff charge varies from 9.1% to 9.9% depending on customers' consumption and load patterns. The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 50%.

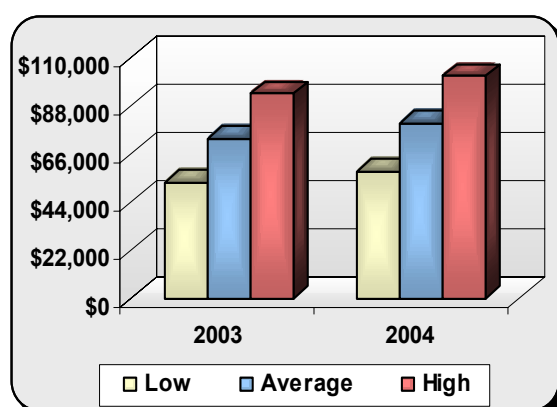

Network Tariff charge comparison
2003 vs 2004.

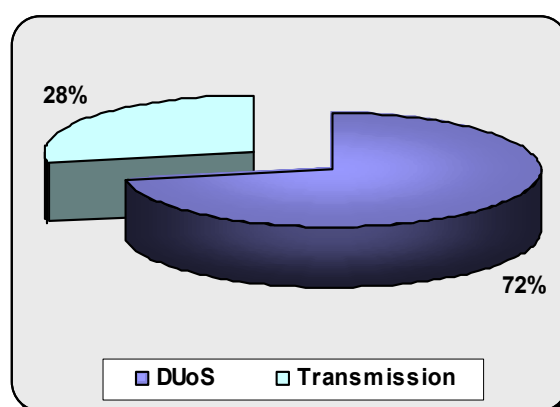

2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.12 Large Business – LV 6.0⁺ GWh


This time of use demand based network tariff is available to very large LV commercial or industrial customers that consume an annual amount of electricity in excess of 6.0 GWh (6,000 MWh). The minimum chargeable demand is 450 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2003 and 2004 'Large Business – LV 6.0⁺ GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 2,743,374 kWh	Low 6,401,206 kWh	Average 9,144,579 kWh	High 11,887,953 kWh	Very high 15,545,785 kWh
2003	N/A	\$144,565	\$203,485	\$262,404	\$340,964
2004	N/A	\$156,959	\$220,831	\$284,703	\$369,866
Change	N/A	8.6%	8.5%	8.5%	8.5%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 2,743,374 kWh	Low 6,401,206 kWh	Average 9,144,579 kWh	High 11,887,953 kWh	Very high 15,545,785 kWh
2003	N/A	\$161,989	\$228,376	\$294,763	\$383,280
2004	N/A	\$177,251	\$249,819	\$322,388	\$419,146
Change	N/A	9.4%	9.4%	9.4%	9.4%

The above tables indicate that the increase in the network tariff charge varies from 8.5% to 9.4% depending on customers' consumption and load patterns. The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 50%.

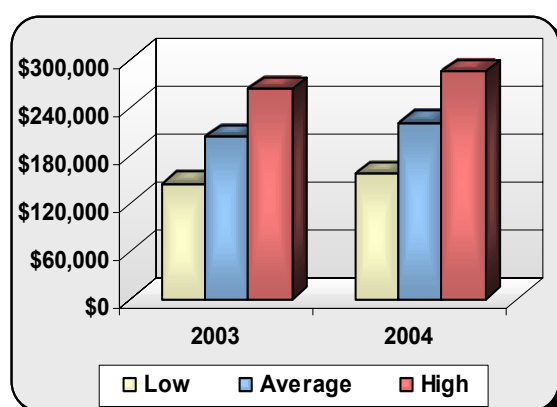

Network Tariff charge comparison
2003 vs 2004.

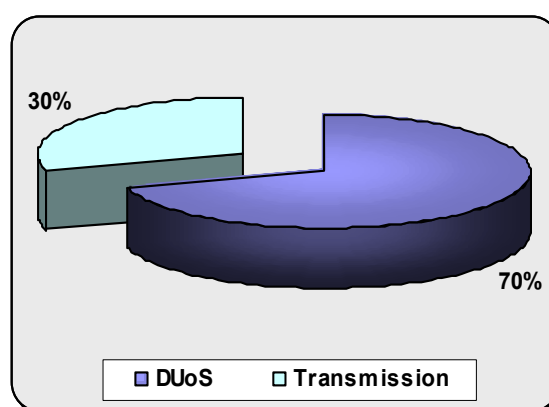

2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.13 Large Business – HV


This is a Time of Use demand based network tariff applicable to HV commercial or industrial customers with annual consumption less than 55.0 GWh (55,000 MWh). The minimum chargeable demand is 1,000 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

The impact of 2003 and 2004 'Large Business – HV' network tariff on customers is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 2,784,717 kWh	Low 6,497,674 kWh	Average 9,282,392 kWh	High 12,067,109 kWh	Very high 15,780,066 kWh
2003	\$78,888	\$126,356	\$177,545	\$228,735	\$296,987
2004	\$86,761	\$138,839	\$194,788	\$250,737	\$325,337
Change	10.0%	9.9%	9.7%	9.6%	9.5%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 2,784,717 kWh	Low 6,497,674 kWh	Average 9,282,392 kWh	High 12,067,109 kWh	Very high 15,780,066 kWh
2003	\$86,228	\$143,483	\$202,013	\$260,543	\$338,583
2004	\$94,876	\$157,773	\$221,837	\$285,901	\$371,320
Change	10.0%	10.0%	9.8%	9.7%	9.7%

The above tables indicate that the increase in the network tariff charge varies from 9.5% to 10.0% depending on customers' consumption and load patterns. The charts below compare 2003 and 2004 network tariff charges for low, average and high users and show 2004 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 50%.

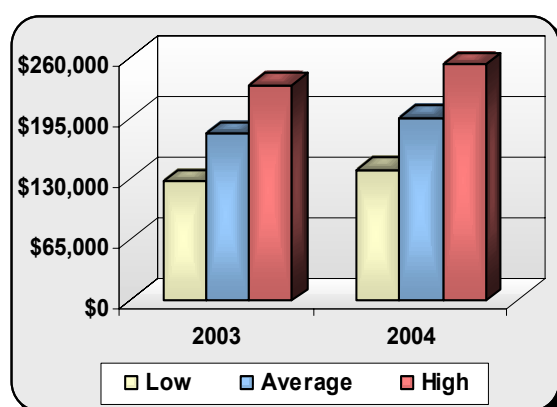

Network Tariff charge comparison
2003 vs 2004.

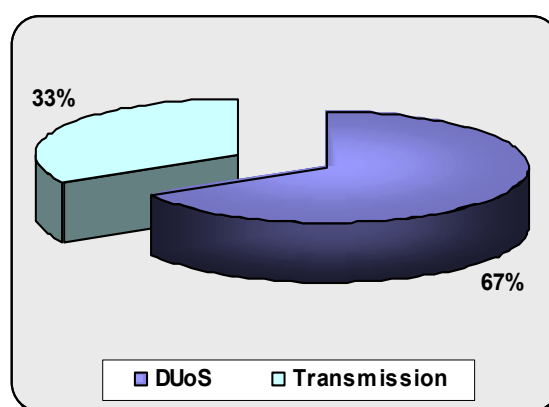

2004 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

APPENDIX 1 NETWORK TARIFFS FOR 2004 (EXCLUSIVE OF GST)

Customer Class	Code	Tariff Name	Units	Rate
Residential				
Available to residential customers.				
	A100	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$26.100
		- Unit rate	¢/kWh	5.467
	A140	Time of Use		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$46.800
		- Peak Unit rate	¢/kWh	6.945
		- Off Peak Unit rate	¢/kWh	1.145
	A180	Off Peak Heating Only		
		<i>11.00 PM to 7.00 AM all days.</i>		
		- Standing charge	\$/customer pa	\$0.000
		- Off Peak Unit rate	¢/kWh	1.145
Small Business				
Available to customers with annual consumption < 0.4 GWh AND maximum demand < 150 kVA (120 kW).				
	A200	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$61.400
		- Unit rate	¢/kWh	6.328
	A210	Time of Use Weekdays		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$128.400
		- Peak Unit rate	¢/kWh	7.609
		- Off Peak Unit rate	¢/kWh	1.213
	A230	Time of Use Weekdays - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$427.100
		- Peak Unit rate	¢/kWh	4.382
		- Off Peak Unit rate	¢/kWh	1.216
		- Demand rate	\$/kW pa	\$38.916
		Minimum Chargeable Demand	60 kW	
	A250	Time of Use Extended		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$128.400
		- Peak Unit rate	¢/kWh	6.566
		- Off Peak Unit rate	¢/kWh	1.405

Customer Class	Code	Tariff Name	Units	Rate
	A270	Time of Use Extended - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$427.100
		- Peak Unit rate	¢/kWh	3.502
		- Off Peak Unit rate	¢/kWh	1.421
		- Demand rate	\$/kW pa	\$38.916
		Minimum Chargeable Demand	60 kW	
	A290	Unmetered Supply		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Peak Unit rate	¢/kWh	7.024
		- Off Peak Unit rate	¢/kWh	1.229

Large Business

Low Voltage Tariffs (nominal voltage < 1000 Volts)

Available to customers:

- a) with annual consumption ≥ 0.4 GWh OR maximum demand ≥ 150 kVA (120 kW); or
- b) taking supply from an on-site OR dedicated substation.

	A300	LV 0.4 - 0.8 GWh		
		Available to customers with annual consumption ≤ 0.8 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,968.900
		- Peak Unit rate	¢/kWh	2.291
		- Off Peak Unit rate	¢/kWh	0.503
		- Demand rate	\$/kW pa	\$66.506
		Minimum Chargeable Demand	120 kW	
	A30M	LV_{MS} 0.4 - 0.8 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is ≥ 0.4 GWh BUT ≤ 0.8 GWh.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,135.100
		- Peak Unit rate	¢/kWh	1.939
		- Off Peak Unit rate	¢/kWh	0.478
		- Demand rate	\$/kW pa	\$46.547
		Minimum Chargeable Demand	250 kW	
	A320	LV 0.8⁺ - 2.2 GWh		
		Available to customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$2,809.400
		- Peak Unit rate	¢/kWh	2.040
		- Off Peak Unit rate	¢/kWh	0.492
		- Demand rate	\$/kW pa	\$60.854
		Minimum Chargeable Demand	250 kW	

Customer Class	Code	Tariff Name	Units	Rate
	A32M	LV_{MS} 0.8⁺ - 2.2 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 0.8 GWh BUT ≤ 2.2 GWh.*		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$1,760.100
		- Peak Unit rate	¢/kWh	1.866
		- Off Peak Unit rate	¢/kWh	0.481
		- Demand rate	\$/kW pa	\$42.655
		Minimum Chargeable Demand	250 kW	
	A32R	LV_{RF} 0.8⁺ - 2.2 GWh		
		Available to existing customers as at 31 Dec. 2001 with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh AND a Reserve Feeder connection.*		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$2,809.400
		- Peak Unit rate	¢/kWh	2.010
		- Off Peak Unit rate	¢/kWh	0.492
		- Demand rate	\$/kW pa	\$48.044
		Minimum Chargeable Demand	250 kW	
	A340	LV 2.2⁺ - 6.0 GWh		
		Available to customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh.		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$7,054.900
		- Peak Unit rate	¢/kWh	1.939
		- Off Peak Unit rate	¢/kWh	0.383
		- Demand rate	\$/kW pa	\$59.795
		Minimum Chargeable Demand	250 kW	
	A34M	LV_{MS} 2.2⁺ - 6.0 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 2.2 GWh BUT ≤ 6.0 GWh.*		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$4,833.300
		- Peak Unit rate	¢/kWh	1.697
		- Off Peak Unit rate	¢/kWh	0.367
		- Demand rate	\$/kW pa	\$41.909
		Minimum Chargeable Demand	250 kW	

Customer Class	Code	Tariff Name	Units	Rate
	A34R	LV_{RF} 2.2⁺ - 6.0 GWh		
		Available to existing customers as at 31 Dec. 2001 with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh AND a Reserve Feeder connection.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$7,054.900
		- Peak Unit rate	¢/kWh	1.911
		- Off Peak Unit rate	¢/kWh	0.383
		- Demand rate	\$/kW pa	\$46.985
		Minimum Chargeable Demand	250 kW	
	A370	LV 6.0⁺ GWh		
		Available to customers with annual consumption > 6.0 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$7,923.600
		- Peak Unit rate	¢/kWh	1.928
		- Off Peak Unit rate	¢/kWh	0.343
		- Demand rate	\$/kW pa	\$57.466
		Minimum Chargeable Demand	450 kW	
	A37M	LV_{MS} 6.0⁺ GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 6.0 GWh.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$5,882.300
		- Peak Unit rate	¢/kWh	1.866
		- Off Peak Unit rate	¢/kWh	0.341
		- Demand rate	\$/kW pa	\$40.335
		Minimum Chargeable Demand	450 kW	
	A37R	LV_{RF} 6.0⁺ GWh		
		Available to existing customers as at 31 Dec. 2001 with annual consumption > 6.0 GWh AND a Reserve Feeder connection.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$7,923.600
		- Peak Unit rate	¢/kWh	1.895
		- Off Peak Unit rate	¢/kWh	0.343
		- Demand rate	\$/kW pa	\$44.656
		Minimum Chargeable Demand	450 kW	

Customer Class	Code	Tariff Name	Units	Rate
High Voltage Tariffs (nominal voltage ≥ 1000 Volts AND $\leq 22,000$ Volts)				
	A400	HV		
		Available to customers with annual consumption < 55 GWh		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$8,290.000
		- Peak Unit rate	¢/kWh	1.630
		- Off Peak Unit rate	¢/kWh	0.173
		- Demand rate	\$/kW pa	\$53.367
		Minimum Chargeable Demand	1,000 kW	
	A40R	HV_{RF}		
		Available to existing customers as at 31 Dec. 2001 with annual consumption < 55 GWh AND a Reserve Feeder connection.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$8,290.000
		- Peak Unit rate	¢/kWh	1.616
		- Off Peak Unit rate	¢/kWh	0.173
		- Demand rate	\$/kW pa	\$40.557
		Minimum Chargeable Demand	1,000 kW	
	A480	HV - Annual Consumption ≥ 55 GWh		
		Available to customers with annual consumption ≥ 55 GWh		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$8,532.600
		- Peak Unit rate	¢/kWh	1.626
		- Off Peak Unit rate	¢/kWh	0.134
		- Demand rate	\$/kW pa	\$49.947
		Minimum Chargeable Demand	10,000 kW	

Customer Class	Code	Tariff Name	Units	Rate
Subtransmission Tariffs (nominal voltage > 22,000 Volts)				
	A500	Subtransmission		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$30,773.200
		- Peak Unit rate	¢/kWh	0.813
		- Off Peak Unit rate	¢/kWh	0.037
		- Demand rate	\$/kW pa	\$16.302
		Minimum Chargeable Demand	15,000 kW	
	A50A	Subtransmission MA		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$30,773.200
		- Peak Unit rate	¢/kWh	0.813
		- Off Peak Unit rate	¢/kWh	0.037
		- Demand rate	\$/kW pa	\$16.302
		Minimum Chargeable Demand	15,000 kW	
	A50E	Subtransmission EG		
		Available to Embedded Generators connected to TTS-SSS-ST-EPG-TTS Loop.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$31,881.600
		- Peak Unit rate	¢/kWh	0.907
		- Off Peak Unit rate	¢/kWh	0.043
		- Demand rate	\$/kW pa	\$5.280
		Minimum Chargeable Demand	15,000 kW	

* Other terms and conditions apply

APPENDIX 2 DISTRIBUTION TARIFFS FOR 2004 (EXCLUSIVE OF GST)

Customer Class	Code	Tariff Name	Units	Rate
Residential				
Available to residential customers.				
	A100	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$20.600
		- Unit rate	¢/kWh	5.146
	A140	Time of Use		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$34.000
		- Peak Unit rate	¢/kWh	6.223
		- Off Peak Unit rate	¢/kWh	1.025
	A180	Off Peak Heating Only		
		<i>11.00 PM to 7.00 AM all days.</i>		
		- Standing charge	\$/customer pa	\$0.000
		- Off Peak Unit rate	¢/kWh	1.025
Small Business				
Available to customers with annual consumption < 0.4 GWh AND maximum demand < 150 kVA (120 kW).				
	A200	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$50.000
		- Unit rate	¢/kWh	5.780
	A210	Time of Use Weekdays		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$70.000
		- Peak Unit rate	¢/kWh	6.818
		- Off Peak Unit rate	¢/kWh	1.096
	A230	Time of Use Weekdays - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$47.000
		- Peak Unit rate	¢/kWh	3.571
		- Off Peak Unit rate	¢/kWh	1.099
		- Demand rate	\$/kW pa	\$37.716
		Minimum Chargeable Demand	60 kW	
	A250	Time of Use Extended		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$70.000
		- Peak Unit rate	¢/kWh	5.976
		- Off Peak Unit rate	¢/kWh	1.202

Customer Class	Code	Tariff Name	Units	Rate
	A270	Time of Use Extended - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$47.000
		- Peak Unit rate	¢/kWh	2.882
		- Off Peak Unit rate	¢/kWh	1.218
		- Demand rate	\$/kW pa	\$37.716
		Minimum Chargeable Demand	60 kW	
	A290	Unmetered Supply		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Peak Unit rate	¢/kWh	6.658
		- Off Peak Unit rate	¢/kWh	1.083

Large Business

Low Voltage Tariffs (nominal voltage < 1000 Volts)

Available to customers:

- a) with annual consumption ≥ 0.4 GWh OR maximum demand ≥ 150 kVA (120 kW); or
- b) taking supply from an on-site OR dedicated substation.

	A300	LV 0.4 - 0.8 GWh		
		Available to customers with annual consumption ≤ 0.8 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,117.000
		- Peak Unit rate	¢/kWh	1.206
		- Off Peak Unit rate	¢/kWh	0.428
		- Demand rate	\$/kW pa	\$66.273
		Minimum Chargeable Demand	120 kW	
	A30M	LV_{MS} 0.4 - 0.8 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is ≥ 0.4 GWh BUT ≤ 0.8 GWh.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$559.000
		- Peak Unit rate	¢/kWh	1.206
		- Off Peak Unit rate	¢/kWh	0.428
		- Demand rate	\$/kW pa	\$46.391
		Minimum Chargeable Demand	250 kW	
	A320	LV 0.8⁺ - 2.2 GWh		
		Available to customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,833.000
		- Peak Unit rate	¢/kWh	0.772
		- Off Peak Unit rate	¢/kWh	0.411
		- Demand rate	\$/kW pa	\$60.505
		Minimum Chargeable Demand	250 kW	

Customer Class	Code	Tariff Name	Units	Rate
	A32M	LV_{MS} 0.8⁺ - 2.2 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 0.8 GWh BUT ≤ 2.2 GWh.*		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$917.000
		- Peak Unit rate	¢/kWh	0.772
		- Off Peak Unit rate	¢/kWh	0.411
		- Demand rate	\$/kW pa	\$42.354
		Minimum Chargeable Demand	250 kW	
	A32R	LV_{RF} 0.8⁺ - 2.2 GWh		
		Available to existing customers as at 31 Dec. 2001 with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh AND a Reserve Feeder connection.*		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$1,833.000
		- Peak Unit rate	¢/kWh	0.772
		- Off Peak Unit rate	¢/kWh	0.411
		- Demand rate	\$/kW pa	\$47.695
		Minimum Chargeable Demand	250 kW	
	A340	LV 2.2⁺ - 6.0 GWh		
		Available to customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh.		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$2,807.000
		- Peak Unit rate	¢/kWh	0.707
		- Off Peak Unit rate	¢/kWh	0.301
		- Demand rate	\$/kW pa	\$59.307
		Minimum Chargeable Demand	250 kW	
	A34M	LV_{MS} 2.2⁺ - 6.0 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 2.2 GWh BUT ≤ 6.0 GWh.*		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$1,404.000
		- Peak Unit rate	¢/kWh	0.707
		- Off Peak Unit rate	¢/kWh	0.301
		- Demand rate	\$/kW pa	\$41.516
		Minimum Chargeable Demand	250 kW	

Customer Class	Code	Tariff Name	Units	Rate
	A34R	LV_{RF} 2.2⁺ - 6.0 GWh		
		Available to existing customers as at 31 Dec. 2001 with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh AND a Reserve Feeder connection.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$2,807.000
		- Peak Unit rate	¢/kWh	0.707
		- Off Peak Unit rate	¢/kWh	0.301
		- Demand rate	\$/kW pa	\$46.497
		Minimum Chargeable Demand	250 kW	
	A370	LV 6.0⁺ GWh		
		Available to customers with annual consumption > 6.0 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$3,655.000
		- Peak Unit rate	¢/kWh	0.688
		- Off Peak Unit rate	¢/kWh	0.262
		- Demand rate	\$/kW pa	\$57.034
		Minimum Chargeable Demand	450 kW	
	A37M	LV_{MS} 6.0⁺ GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 6.0 GWh.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,828.000
		- Peak Unit rate	¢/kWh	0.688
		- Off Peak Unit rate	¢/kWh	0.262
		- Demand rate	\$/kW pa	\$39.924
		Minimum Chargeable Demand	450 kW	
	A37R	LV_{RF} 6.0⁺ GWh		
		Available to existing customers as at 31 Dec. 2001 with annual consumption > 6.0 GWh AND a Reserve Feeder connection.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$3,655.000
		- Peak Unit rate	¢/kWh	0.688
		- Off Peak Unit rate	¢/kWh	0.262
		- Demand rate	\$/kW pa	\$44.224
		Minimum Chargeable Demand	450 kW	

Customer Class	Code	Tariff Name	Units	Rate
High Voltage Tariffs (nominal voltage $\geq$ 1000 Volts AND $\leq$ 22,000 Volts)				
	A400	HV		
		Available to customers with annual consumption < 55 GWh		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,946.000
		- Peak Unit rate	¢/kWh	0.552
		- Off Peak Unit rate	¢/kWh	0.128
		- Demand rate	\$/kW pa	\$47.407
		Minimum Chargeable Demand	1,000 kW	
	A40R	HV_{RF}		
		Available to existing customers as at 31 Dec. 2001 with annual consumption < 55 GWh AND a Reserve Feeder connection.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,946.000
		- Peak Unit rate	¢/kWh	0.552
		- Off Peak Unit rate	¢/kWh	0.128
		- Demand rate	\$/kW pa	\$34.597
		Minimum Chargeable Demand	1,000 kW	
	A480	HV - Annual Consumption ≥ 55 GWh		
		Available to customers with annual consumption ≥ 55 GWh		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,939.000
		- Peak Unit rate	¢/kWh	0.531
		- Off Peak Unit rate	¢/kWh	0.093
		- Demand rate	\$/kW pa	\$44.046
		Minimum Chargeable Demand	10,000 kW	

Customer Class	Code	Tariff Name	Units	Rate
Subtransmission Tariffs (nominal voltage > 22,000 Volts)				
	A500	Subtransmission		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$14,622.000
		- Peak Unit rate	¢/kWh	0.075
		- Off Peak Unit rate	¢/kWh	0.011
		- Demand rate	\$/kW pa	\$12.369
		Minimum Chargeable Demand	15,000 kW	
	A50A	Subtransmission MA		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$14,622.000
		- Peak Unit rate	¢/kWh	0.075
		- Off Peak Unit rate	¢/kWh	0.011
		- Demand rate	\$/kW pa	\$12.369
		Minimum Chargeable Demand	15,000 kW	
	A50E	Subtransmission EG		
		Available to Embedded Generators connected to TTS-SSS-ST-EPG-TTS Loop.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$17,068.000
		- Peak Unit rate	¢/kWh	0.114
		- Off Peak Unit rate	¢/kWh	0.017
		- Demand rate	\$/kW pa	\$2.600
		Minimum Chargeable Demand	15,000 kW	

* Other terms and conditions apply

APPENDIX 3 TRANSMISSION TARIFFS FOR 2004 (EXCLUSIVE OF GST)

Customer Class	Code	Tariff Name	Units	Rate
Residential				
Available to residential customers.				
	A100	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$5.500
		- Unit rate	¢/kWh	0.321
	A140	Time of Use		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$12.800
		- Peak Unit rate	¢/kWh	0.722
		- Off Peak Unit rate	¢/kWh	0.120
	A180	Off Peak Heating Only		
		<i>11.00 PM to 7.00 AM all days.</i>		
		- Standing charge	\$/customer pa	\$0.000
		- Off Peak Unit rate	¢/kWh	0.120
Small Business				
Available to customers with annual consumption < 0.4 GWh AND maximum demand < 150 kVA (120 kW).				
	A200	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$11.400
		- Unit rate	¢/kWh	0.548
	A210	Time of Use Weekdays		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$58.400
		- Peak Unit rate	¢/kWh	0.791
		- Off Peak Unit rate	¢/kWh	0.117
	A230	Time of Use Weekdays - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$380.100
		- Peak Unit rate	¢/kWh	0.811
		- Off Peak Unit rate	¢/kWh	0.117
		- Demand rate	\$/kW pa	\$1.200
		Minimum Chargeable Demand	60 kW	
	A250	Time of Use Extended		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$58.400
		- Peak Unit rate	¢/kWh	0.590
		- Off Peak Unit rate	¢/kWh	0.203

Customer Class	Code	Tariff Name	Units	Rate
	A270	Time of Use Extended - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$380.100
		- Peak Unit rate	¢/kWh	0.620
		- Off Peak Unit rate	¢/kWh	0.203
		- Demand rate	\$/kW pa	\$1.200
		Minimum Chargeable Demand	60 kW	
	A290	Unmetered Supply		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Peak Unit rate	¢/kWh	0.366
		- Off Peak Unit rate	¢/kWh	0.146

Large Business

Low Voltage Tariffs (nominal voltage < 1000 Volts)

Available to customers:

- a) with annual consumption ≥ 0.4 GWh OR maximum demand ≥ 150 kVA (120 kW); or
- b) taking supply from an on-site OR dedicated substation.

	A300	LV 0.4 - 0.8 GWh		
		Available to customers with annual consumption ≤ 0.8 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$851.900
		- Peak Unit rate	¢/kWh	1.085
		- Off Peak Unit rate	¢/kWh	0.075
		- Demand rate	\$/kW pa	\$0.233
		Minimum Chargeable Demand	120 kW	
	A30M	LV_{MS} 0.4 - 0.8 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is ≥ 0.4 GWh BUT ≤ 0.8 GWh.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$576.100
		- Peak Unit rate	¢/kWh	0.733
		- Off Peak Unit rate	¢/kWh	0.050
		- Demand rate	\$/kW pa	\$0.156
		Minimum Chargeable Demand	250 kW	
	A320	LV 0.8⁺ - 2.2 GWh		
		Available to customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$976.400
		- Peak Unit rate	¢/kWh	1.268
		- Off Peak Unit rate	¢/kWh	0.081
		- Demand rate	\$/kW pa	\$0.349
		Minimum Chargeable Demand	250 kW	

Customer Class	Code	Tariff Name	Units	Rate
	A32M	LV_{MS} 0.8⁺ - 2.2 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 0.8 GWh BUT ≤ 2.2 GWh.*		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$843.100
		- Peak Unit rate	¢/kWh	1.094
		- Off Peak Unit rate	¢/kWh	0.070
		- Demand rate	\$/kW pa	\$0.301
		Minimum Chargeable Demand	250 kW	
	A32R	LV_{RF} 0.8⁺ - 2.2 GWh		
		Available to existing customers as at 31 Dec. 2001 with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh AND a Reserve Feeder connection.*		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$976.400
		- Peak Unit rate	¢/kWh	1.238
		- Off Peak Unit rate	¢/kWh	0.081
		- Demand rate	\$/kW pa	\$0.349
		Minimum Chargeable Demand	250 kW	
	A340	LV 2.2⁺ - 6.0 GWh		
		Available to customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh.		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$4,247.900
		- Peak Unit rate	¢/kWh	1.232
		- Off Peak Unit rate	¢/kWh	0.082
		- Demand rate	\$/kW pa	\$0.488
		Minimum Chargeable Demand	250 kW	
	A34M	LV_{MS} 2.2⁺ - 6.0 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 2.2 GWh BUT ≤ 6.0 GWh.*		
		Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.		
		- Standing charge	\$/customer pa	\$3,429.300
		- Peak Unit rate	¢/kWh	0.990
		- Off Peak Unit rate	¢/kWh	0.066
		- Demand rate	\$/kW pa	\$0.393
		Minimum Chargeable Demand	250 kW	

Customer Class	Code	Tariff Name	Units	Rate
	A34R	LV_{RF} 2.2⁺ - 6.0 GWh		
		Available to existing customers as at 31 Dec. 2001 with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh AND a Reserve Feeder connection.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$4,247.900
		- Peak Unit rate	¢/kWh	1.204
		- Off Peak Unit rate	¢/kWh	0.082
		- Demand rate	\$/kW pa	\$0.488
		Minimum Chargeable Demand	250 kW	
	A370	LV 6.0⁺ GWh		
		Available to customers with annual consumption > 6.0 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$4,268.600
		- Peak Unit rate	¢/kWh	1.240
		- Off Peak Unit rate	¢/kWh	0.081
		- Demand rate	\$/kW pa	\$0.432
		Minimum Chargeable Demand	450 kW	
	A37M	LV_{MS} 6.0⁺ GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 6.0 GWh.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$4,054.300
		- Peak Unit rate	¢/kWh	1.178
		- Off Peak Unit rate	¢/kWh	0.079
		- Demand rate	\$/kW pa	\$0.411
		Minimum Chargeable Demand	450 kW	
	A37R	LV_{RF} 6.0⁺ GWh		
		Available to existing customers as at 31 Dec. 2001 with annual consumption > 6.0 GWh AND a Reserve Feeder connection.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$4,268.600
		- Peak Unit rate	¢/kWh	1.207
		- Off Peak Unit rate	¢/kWh	0.081
		- Demand rate	\$/kW pa	\$0.432
		Minimum Chargeable Demand	450 kW	

Customer Class	Code	Tariff Name	Units	Rate
High Voltage Tariffs (nominal voltage $\geq$ 1000 Volts AND $\leq$ 22,000 Volts)				
	A400	HV		
		Available to customers with annual consumption < 55 GWh		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$6,344.000
		- Peak Unit rate	¢/kWh	1.078
		- Off Peak Unit rate	¢/kWh	0.045
		- Demand rate	\$/kW pa	\$5.960
		Minimum Chargeable Demand	1,000 kW	
	A40R	HV_{RF}		
		Available to existing customers as at 31 Dec. 2001 with annual consumption < 55 GWh AND a Reserve Feeder connection.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$6,344.000
		- Peak Unit rate	¢/kWh	1.064
		- Off Peak Unit rate	¢/kWh	0.045
		- Demand rate	\$/kW pa	\$5.960
		Minimum Chargeable Demand	1,000 kW	
	A480	HV - Annual Consumption ≥ 55 GWh		
		Available to customers with annual consumption ≥ 55 GWh		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$6,593.600
		- Peak Unit rate	¢/kWh	1.095
		- Off Peak Unit rate	¢/kWh	0.041
		- Demand rate	\$/kW pa	\$5.901
		Minimum Chargeable Demand	10,000 kW	

Customer Class	Code	Tariff Name	Units	Rate
Subtransmission Tariffs (nominal voltage > 22,000 Volts)				
	A500	Subtransmission		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$16,151.200
		- Peak Unit rate	¢/kWh	0.738
		- Off Peak Unit rate	¢/kWh	0.026
		- Demand rate	\$/kW pa	\$3.933
		Minimum Chargeable Demand	15,000 kW	
	A50A	Subtransmission MA		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$16,151.200
		- Peak Unit rate	¢/kWh	0.738
		- Off Peak Unit rate	¢/kWh	0.026
		- Demand rate	\$/kW pa	\$3.933
		Minimum Chargeable Demand	15,000 kW	
	A50E	Subtransmission EG		
		Available to Embedded Generators connected to TTS-SSS-ST-EPG-TTS Loop.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$14,813.600
		- Peak Unit rate	¢/kWh	0.793
		- Off Peak Unit rate	¢/kWh	0.026
		- Demand rate	\$/kW pa	\$2.680
		Minimum Chargeable Demand	15,000 kW	

* Other terms and conditions apply