



Network Tariff Report for 2005 Calendar Year

March 2005

Contacts

Inquiries relating to this Report may be directed to:

➤ General Manager Infrastructure Management

Agility Management

For and on behalf of

AGL Electricity Limited

PO Box 14120,

MCMC VIC 8001

Telephone: 03 9201 7006

Fax: 03 9201 7699

or

➤ Essential Services Commission, Victoria

2nd Floor, 35 Spring Street

MELBOURNE VIC 3000

Telephone: 03 9651 0222

Fax: 03 9651 3688

E-mail: reception@esc.vic.gov.au

Website: www.esc.vic.gov.au

This report has been prepared by Agility Management for and on behalf of AGL Electricity Limited.

Table of Contents

1	<i>Introduction</i>	<i>1</i>
2	<i>Pricing Objectives/Principles</i>	<i>1</i>
3	<i>Tariff Structures</i>	<i>2</i>
4	<i>Tariff Categories.....</i>	<i>3</i>
5	<i>Pricing Methodology</i>	<i>4</i>
5.1	Distribution Use of System Pricing	4
5.2	Transmission Pricing.....	4
6	<i>Economically Efficient Tariffs.....</i>	<i>7</i>
7	<i>Network Tariffs.....</i>	<i>9</i>
7.1	Residential – General Purpose	10
7.2	Residential – Time of Use.....	11
7.3	Residential – Off Peak Heating Only	12
7.4	Small Business – General Purpose	13
7.5	Small Business – Time of Use Weekdays.....	14
7.6	Small Business – Time of Use Weekdays Demand	15
7.7	Small Business – Time of Use Extended	16
7.8	Small Business – Time of Use Extended Demand.....	17
7.9	Large Business – LV 0.4 - 0.8 GWh	18
7.10	Large Business – LV _{MS} 0.4 - 0.8 GWh	19
7.11	Large Business – LV 0.8 ⁺ - 2.2 GWh.....	20
7.12	Large Business – LV _{MS} 0.8 ⁺ - 2.2 GWh.....	21
7.13	Large Business – LV _{RF} 0.8 ⁺ - 2.2 GWh	22
7.14	Large Business – LV 2.2 ⁺ - 6.0 GWh.....	23
7.15	Large Business – LV _{MS} 2.2 ⁺ - 6.0 GWh.....	24
7.16	Large Business – LV _{RF} 2.2 ⁺ - 6.0 GWh	25
7.17	Large Business – LV 6.0 ⁺ GWh	26
7.18	Large Business – LV _{MS} 6.0 ⁺ GWh	27
7.19	Large Business – LV _{RF} 6.0 ⁺ GWh.....	28
7.20	Large Business – HV	29
7.21	Large Business – HV _{RF}	30
Appendix 1	<i>Network Tariffs for 2005 (exclusive of GST).....</i>	<i>31</i>
Appendix 2	<i>Distribution Tariffs for 2005 (exclusive of GST).....</i>	<i>37</i>
Appendix 3	<i>Transmission Tariffs for 2005 (exclusive of GST)</i>	<i>43</i>

1 INTRODUCTION

The Essential Services Commission, Victoria (ESC), formerly the Office of the Regulator General, has been established as an independent economic jurisdictional regulator, to promote competitive market conduct, prevent misuse of monopoly or market power, facilitate entry into the relevant market, facilitate efficiency in regulated industries and ensure that users and consumers benefit from competition and efficiency.

In its Price Determination¹, the ESC placed an obligation on each Distribution Business (DB) to prepare and publish a public Tariff Report, by 1 March of each calendar year containing sufficient information to enable customers to understand the basis of the tariff policies adopted by their respective DB. The ESC specified that the tariff report should include (but is not limited to):

- a) The distribution and transmission tariffs charged by the DB;
- b) A discussion of the policy framework and tariff principles adopted by the DB in framing the structures and level of its tariffs;
- c) An explanation of the basis on which the DB has determined the appropriate breakdown between fixed and variable charges;
- d) The rationale for the introduction of any new tariffs, or the withdrawal of tariffs;
- e) An explanation of how the DB has had regard to the consideration of upper and lower bounds of efficient pricing in determining its distribution tariffs;
- f) The extent to which the tariff structures adopted provide efficient consumption signals to distribution customers;
- g) The methodology adopted for allocating transmission-related costs to distribution customers through its transmission tariffs; and
- h) An estimate of the average annual distribution and transmission charge (in \$) for each combination of distribution and transmission tariff.

This report details the network tariffs applicable to customers connected to the AGL Electricity Limited (AGLE) electricity network for the calendar year 2005.

2 PRICING OBJECTIVES/PRINCIPLES

Prices should be designed to recover the appropriate level of costs in a manner that best reflects the incidence of costs and enables their allocation amongst customer groups. The approach should avoid price discrimination and cross-subsidies whilst promoting the efficient use of the distribution assets. The principal objectives in setting network prices are as follow:

- **Economic efficiency** – prices should send appropriate signals to network customers regarding their use of the network and should encourage efficient consumption.

¹ Electricity Distribution Price Determination 2001-05, Volume II Price Controls, Clause 2.3.13, Office of the Regulator-General, Victoria, September 2000.

- **Financial sufficiency** – prices should raise adequate revenue to sustain distribution business viability.
- **Cost Reflectivity** – pricing method should be as cost reflective as possible, recognising that the distribution network supplies large numbers of customers of various sizes and load patterns at different voltage levels.
- **Equity** – pricing must be fair and provide non-discriminatory access to the distribution system. This means that network prices must be published to provide transparency and charges to any particular customer must be the same regardless of their contestability status or which Retailer the customer is taking supply from.
- **Simplicity** – prices should be comprehensible to customers so that they can react to tariff signals.
- **Certainty** – prices should remain stable over time to permit customers to conduct long term planning.

AGLE meets its pricing objectives through the manner by which its tariffs are structured & categorised and through its approach to setting its *Distribution* and *Transmission* tariffs. The following sections address AGLE tariff structures, tariff categories and the methodology used to develop AGLE *Distribution* and *Transmission* tariffs.

3 TARIFF STRUCTURES

AGLE has adopted the following three tariff structures:

- a) **General Purpose** – single rate tariff (¢/kWh) applicable for all times of the day with a fixed charge (known as a standing charge). This tariff generally applies to customers that consume small amounts of electricity, such as residential customers and farms;
- b) **Time of Use** – two rate tariff (¢/kWh) applicable to peak and off-peak periods with a standing charge. This tariff is applicable to ‘Residential’ and ‘Small Business’ customers; and
- c) **Time of Use Demand** – two rate tariff (¢/kWh) applicable to peak and off-peak periods, a demand charge (\$/kW pa) and a fixed charge. This tariff is applicable to ‘Large Business’ customers and ‘Small Business’ customers with meters capable of measuring demand.

The tariff structures have been made simple to meet the capability of the meters installed at the customers’ premises and also to ensure they are comprehensible by customers so that they can react to tariff signals. While conflicts may arise between cost reflectivity and simplicity, AGLE is of the view that customers react better to simple and stable tariff structures than to complicated tariff structures. As a result AGLE has not changed its network tariff structures over the years.

4 TARIFF CATEGORIES

AGLE tariffs are grouped into the following three categories:

- a) **Residential** – This category includes three network tariffs designed to meet the needs of residential customers;
- b) **Small Business (SB)** – This category refers to low voltage customers:
- consuming an annual amount of electricity less than 400 MWh (ie 400,000 kWh); and
 - having a maximum demand of less than 150 kVA (or 120 kW); and
 - where supply is not taken from an on-site or dedicated substation.

Unmetered supply is also included in this category. AGLE offers five SB network tariffs, including two demand tariffs, to meet the needs of customers belonging to this category. Customers are encouraged to assess their usage and load pattern in order to determine the network tariff that best meets their needs; and

- c) **Large Business (LB)** – This category refers to:
- subtransmission customers,
 - high voltage customers; and
 - low voltage customers:
 - consuming an annual amount of electricity greater than or equal to 400 MWh; or
 - having a maximum demand greater than or equal to 150 kVA (120 kW); or
 - where supply is taken from an on-site or dedicated substation.

The published annual tariff schedule, as approved by the Commission, clearly defines each category in terms of the customer's load and connection characteristics. In addition, it describes the criterion applicable to each network tariff. AGLE consistently uses the tariff category and criterion in order to assign or re-assign customers to the appropriate network tariff to provide equity between customers.

Customers are encouraged to assess their annual usage on a regular basis to determine whether they are entitled to change their tariff and take advantage of the different rates available.

The full details of network tariff names, codes and rates are in Appendix 1. These tariffs were approved by the ESC on 16 December 2004 and were effective as of 1 January 2005.

5 PRICING METHODOLOGY

Network Tariffs consist of two components:

- Distribution related charges , and
- Transmission related charges.

5.1 Distribution Use of System Pricing

Distribution Use of System (DUoS) tariffs are designed to recover:

- a) the costs of operating, maintaining and augmenting the distribution network. In other words, DUoS tariffs recover the cost of providing the network from the point at which the distributor is connected to the Transmission system to an end-user;
- b) a required return on asset (including new capital expenditure) which allows the distributor to earn a reasonable rate of return (determined by the ESC); and
- c) a return of asset.

In order to produce DUoS tariffs, a cost of supply model is used to allocate DUoS costs to different tariff categories according to the use of the distribution network by customers within each category.

Costs are divided between fixed and variable costs. The fixed cost element, incorporated into the standing charge component of the tariff, is made up of customer-related costs such as the provision of metering equipment and service line to customers' premises. The variable element (divided between a unit charge and a demand charge) depends on the voltage at which supply is taken. The unit charge reflects the cost of providing a customer with access to the network at voltages above which supply is taken. The demand charge reflects the cost of providing the network, during peak periods, at the voltage level from which supply is taken. In other words, it is the cost to the distributor of installing a network capable of handling the load placed on it by the end-user. The higher the demand, the greater is the cost of the network implemented to handle the load.

For customers without demand metering it is necessary to recast demand-related costs as a unit charge.

The pricing methodology adopted by AGLE to develop its annual DUoS tariffs is explained in detail in AGLE's Network Tariff Report for 2001 Calendar year available on the ESC website.

The AGLE distribution tariffs schedule for the calendar year 2005 is shown in Appendix 2.

5.2 Transmission Pricing

AGLE incurs costs associated with the use of and connection to the Transmission system as well as Inter-network provider distribution charges and Embedded generator payments. These costs are passed onto network customers and the transmission prices are designed to recover the following '*Pass Through costs*':

- Transmission Use of System charges - These charges are payable to VenCorp and cover the costs incurred by SPI PowerNet to provide and maintain the transmission system and the costs incurred by VenCorp in operating the transmission system;
- Equalisation payment payable to VenCorp;
- Prescribed connection services charge payable to SPI PowerNet for connection to the transmission system;

- Excluded connection services charges payable to SPI PowerNet;
- Inter-network provider distribution service charges receivable from or payable to other DB's for connection to and use of other DBs network; and
- Embedded generator payments –These are the amounts the distributor pays to embedded generators to reflect a share of the amount of expenditure that would otherwise be required if the generator was not supplying into the network.

Generally, in formulating the transmission tariffs, the 'Pass Through Costs' adjusted for the K factor (Adjusted Pass through Costs) are allocated to the different tariffs in accordance with the allocation methodology described below.

The 'Adjusted Pass through Costs' can be separated into fixed, demand based and energy based components as follows:

- Fixed component* – Equalisation Factor. This component is assigned to the 'Standing Charge' element of the transmission tariffs.
- Demand based component* – TUoS Usage charge, K factor and inter-network provider distribution service charge. This component is assigned to the demand charge element (or peak rate element for non-demand tariffs) of the transmission tariffs.
- Energy based component* – Prescribed Connection charge, Excluded Transmission Services charges, General Service charge and Common Service charge. Part of the General and Common Service charges is assigned to the off peak rate element of the transmission tariffs while the balance of the energy based component is assigned to the peak rate element of the tariffs.

These components are then allocated to each transmission tariff class based on the following ratios:

- Fixed component* - The ratio of the total energy for a particular tariff over the total energy for all customers
- Demand based component* - The ratio of the total peak energy for a particular tariff over the total peak energy for all customers.
- Energy based component* - The ratio of the total peak (or off peak) energy for a particular tariff over the total peak (or off peak) energy for all customers

The transmission prices are then established to recover the individual amounts allocated to each tariff on the basis of available metering data. For example, the energy price for 'Residential – General Purpose' single rate tariff is derived by dividing the demand and energy (peak and off peak) based amounts allocated to that tariff by the forecast energy. The standing charge is calculated by dividing the fixed amount allocated to that tariff by the forecast number of customers. In the case of 'Large Business HV', the standing charge is derived by dividing the fixed component allocated to that tariff by the forecast number of HV customers. The demand charge is calculated by dividing the demand-based component allocated to that tariff by forecast demand. A similar process is applied to derive the peak and off peak rates.

However, since there has been a material increase in the TUoS charges applicable to AGLE in 2005, the Essential Services Commission has required AGLE to use different Y factors for different tariffs (refer to Table 1 below) to ensure that:

1. The land tax allocated to each tariff is calculated based on a pre-determined price. In relation to AGLE this was 0.314 ¢/kWh; and
2. Increases in pass through costs, other than those related to land tax, are capped at 20%.

As a consequence, AGLE's 2005 Transmission Tariffs have been calculated by indexing 2004 average Transmission Tariffs by an amount not exceeding $(1+CPI)*(1+Y_i)$ where CPI equals 2.3% and Y_i is the Y factor applicable to tariff "i" as determined by the ESC. However, the component of the price increase, which relates to the land tax has been allocated to the energy rate of the tariff.

Table 1. List of Y factors applicable to AGLE in 2005.

Network Tariff	Land tax impact on Y factor	Other	Y factor
Residential - General Purpose	67.7%	20%	87.7%
Residential – Time of Use	64.1%	20%	84.1%
Residential - Off Peak Only	255.9%	20%	275.9%
SB - General Purpose	46.3%	20%	66.3%
SB – Time of Use Weekdays	46.7%	20%	66.7%
SB - Time of Use Weekdays Demand	44.1%	20%	64.1%
SB - Time of Use Extended	44.4%	20%	64.4%
SB - Time of Use Extended Demand	42.4%	20%	62.4%
SB - Unmetered Supply	133.7%	20%	153.7%
LB - LV 0.4 - 0.8 GWh	36.0%	20%	56.0%
LB - LV_{MS} 0.4 - 0.8 GWh	44.2%	20%	64.2%
LB - LV 0.8+ - 2.2 GWh	34.5%	20%	54.5%
LB - LV_{MS} 0.8+ - 2.2 GWh	35.2%	20%	55.2%
LB - LV_{RF} 0.8+ - 2.2 GWh	39.0%	20%	59.0%
LB - LV 2.2+ - 6.0 GWh	33.8%	20%	53.8%
LB - LV_{MS} 2.2+ - 6.0 GWh	33.9%	20%	53.9%
LB - LV_{RF} 2.2+ - 6.0 GWh	31.7%	20%	51.7%
LB - LV 6.0+ GWh	39.6%	20%	59.6%
LB - LV_{MS} 6.0+ GWh	34.4%	20%	54.4%
LB - LV_{RF} 6.0+ GWh	41.6%	20%	61.6%
LB - HV	35.9%	20%	55.9%
LB – HV_{RF}	40.9%	20%	60.9%
LB - HV Annual Consumption >= 55GWh	41.9%	20%	61.9%
LB - Subtransmission	69.7%	20%	89.7%
LB - Subtransmission MA	64.2%	20%	84.2%
LB - Subtransmission EG	8.1%	20%	28.1%

AGLE transmission tariffs schedule for the calendar year 2005 is shown in Appendix 3.

6 ECONOMICALLY EFFICIENT TARIFFS

AGLE is required under Clauses 2.3.12 of the Distribution Price Determination 2001-05, Volume II Price Controls to demonstrate that its distribution tariffs are economically efficient by illustrating that its distribution prices fall within a cost window bounded by the following lower and upper bounds:

- Lower bound* – The ESC defined the lower bound, with regards to a specific distribution tariff, as being the avoidable cost of serving distribution customers assigned to that distribution tariff; and
- Upper bound* – The ESC defined the upper bound, with regards to a specific distribution tariff, as being the cost of providing the service on a stand-alone basis to distribution customers assigned to that distribution tariff.

As part of developing the 2001 AGLE Network Tariff Report, AGLE engaged Cap Gemini Ernst & Young to provide an assessment of the avoidable and stand-alone distribution costs for 2001². In order to determine the avoidable and stand alone costs for 2005, the 2001 avoidable and stand-alone costs as produced by Cap Gemini Ernst & Young were indexed by:

$$(1+CPI_{2002})*(1+CPI_{2003})*(1+CPI_{2004})*(1+CPI_{2005}).$$

The table below summarises the results for 2005 and demonstrates that AGLE's average distribution prices for 2005 fall within the avoidable and stand-alone costs and therefore are economically efficient.

Table 2. Economically efficient DUoS tariffs – Lower & Upper bounds.

DUoS tariff	Avoidable cost (¢/kWh)	2005 Average charge ³ (¢/kWh)	Stand-alone cost (¢/kWh)	Scale index ⁴
Residential – General Purpose	1.615	5.715	8.265	61.6%
Residential – Time of Use	0.653	3.372	8.265	35.7%
Residential – Off Peak Heating Only	0.389	1.038	8.265	8.2%
SB – General Purpose	1.960	6.341	6.581	94.8%
SB – Time of Use Weekdays	0.891	4.865	6.581	69.8%
SB - Time of Use Weekdays Demand	0.842	4.025	6.581	55.5%
SB – Time of Use Extended	0.977	5.211	6.581	75.5%
SB – Time of Use Extended Demand	0.841	4.356	6.581	61.2%
SB – Unmetered Supply	0.438	3.154	6.581	44.2%
LB – LV 0.4 – 0.8 GWh	1.479	3.906	5.104	66.9%
LB – LV_{MS} 0.4 – 0.8 GWh	1.479	3.186	5.104	47.1%
LB – LV 0.8⁺ – 2.2 GWh	0.873	3.019	5.104	50.7%
LB – LV_{MS} 0.8⁺ – 2.2 GWh	0.873	2.764	5.104	44.7%
LB – LV_{RF} 0.8⁺ – 2.2 GWh	0.873	2.170	5.104	30.6%

² This report is attached to the AGLE Network Tariff Report for Calendar year 2001.

³ Average charges were calculated by applying 2005 DUoS tariffs to 2003 quantities.

⁴ The scale index indicates the relative position of the average charge with respect to the avoidable and stand-alone costs. A scale index value of 0% denotes that the average charge is equal to the avoidable cost. A scale index of 100% indicates that the average charge is equal to the stand-alone cost.

DUoS tariff	Avoidable cost (¢/kWh)	2005 Average charge³ (¢/kWh)	Stand-alone cost (¢/kWh)	Scale index⁴
LB – LV 2.2⁺ – 6.0 GWh	0.684	2.433	5.104	39.6%
LB – LV_{MS} 2.2⁺ – 6.0 GWh	0.684	2.300	5.104	36.6%
LB – LV_{RF} 2.2⁺ – 6.0 GWh	0.684	2.276	5.104	36.0%
LB – LV 6.0⁺ GWh	0.533	1.836	5.104	28.5%
LB – LV_{MS} 6.0⁺ GWh	0.533	1.797	5.104	27.6%
LB – LV_{RF} 6.0⁺ GWh	0.533	1.448	5.104	20.0%
LB – HV	0.746	1.748	3.821	32.6%
LB – HV_{RF}	0.746	1.399	3.821	21.2%
LB – Annual Consumption ≥ 55 GWh	0.523	1.100	3.821	17.5%
LB – Subtransmission	0.274	0.330	1.505	4.6%

Since 2001, AGLE has given consideration to balance its distribution tariffs that are close to either the avoidable or stand-alone costs. AGLE addressed this issue in 2002 by applying larger increases to the distribution tariffs that were close to avoidable costs than those close to stand-alone costs. As a consequence, large business customers experienced larger average distribution price increases than those experienced by small business or residential customers. For example, while the scale index⁵ for the small business general purpose tariff moved from 86% in 2001 to 88.4% in 2002 (an increase of 2.8%), the scale index of the large business subtransmission tariff moved from 6% to 7% (an increase of 16.7%). Similarly, the scale index of the small business time of use extended tariff increased by 2.9% (from 70% to 72%) compared to the scale index of the large business LV 6.0⁺ GWh tariff, which increased by 9.6% (from 26% to 28.5%).

In 2003 and 2004, due to the significant increase in the transmission costs payable by AGLE, the Commission allowed AGLE to increase its transmission tariffs by $(1+CPI) \times (1+Y)$, where $Y=20\%$. However, the transmission component of the total network tariff charge payable by a large business customer is relatively larger than that paid by a small business or residential customer (refer to section 7 for the breakdown between DUoS and transmission components of the customer's bill). This caused AGLE a conflict in pursuing its pricing objectives. If AGLE continued to balance its distribution prices to produce more economically efficient tariffs, large business customers would have experienced a price shock. AGLE felt that it was not appropriate to continue balancing tariffs in 2003 and 2004 in order to produce more economically efficient tariffs. Instead, tariffs were re-balanced to minimise price shock for large business customers.

Given that transmission costs have increased substantially in 2005 due to the introduction of land tax on transmission easements, AGLE maintained this pricing strategy in 2005. However, once the transmission costs payable by AGLE stabilise, AGLE will restart the process of balancing its distribution tariffs that are close to either the avoidable or stand-alone costs in order to produce more economically efficient tariffs.

⁵ The scale index indicates the relative position of the average charge with respect to the avoidable and stand-alone costs. A scale index value of 0% denotes that the average charge is equal to the avoidable cost. A scale index of 100% indicates that the average charge is equal to the stand-alone cost

7 NETWORK TARIFFS

Network tariffs incorporate the rates that AGLE applies to customer's usage in order to produce their electricity network bill. They are the aggregate of two sets of tariffs namely DUoS and Transmission tariffs.

The sections below provide a brief description of individual tariffs and compare the 2004 and 2005 network tariffs by using five usage levels per network tariff namely *very low*, *low*, *average*, *high* and *very high*. The *average* consumption is calculated by dividing forecast energy by the number of customers. Once the average consumption is calculated the other four usage levels can be derived by applying a percentage to the *average* usage as shown below.

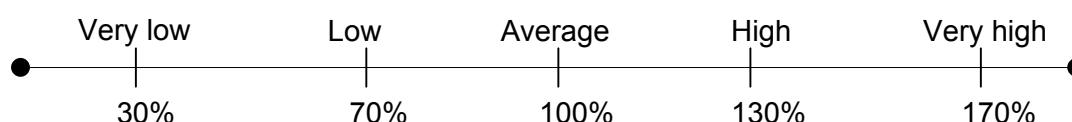


Fig 1. Usage levels as a percentage of average consumption.

To assess the impact of demand based tariffs on customers it is necessary to assume a load factor to estimate the customer's chargeable demand. The demand charge is then applied to the higher of the estimated value or the tariff's minimum chargeable demand.

7.1 Residential – General Purpose


This is a single rate tariff applicable to residential customers on GD or GR deemed retail tariff or residential contestable customers who have chosen to remain on a single rate tariff.

A comparison of the 2004 and 2005 'Residential – General Purpose' network tariff charges for the five usage levels is shown below.


	Very Low 1,244 kWh	Low 2,903 kWh	Average 4,147 kWh	High 5,392 kWh	Very high 7,050 kWh
2004	\$94	\$185	\$253	\$321	\$412
2005	\$101	\$199	\$273	\$347	\$445
Change	7.6%	7.9%	8.0%	8.1%	8.1%

The increase in charges varies from 7.6% to 8.1% depending on usage level, with larger users experiencing a greater reduction.

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

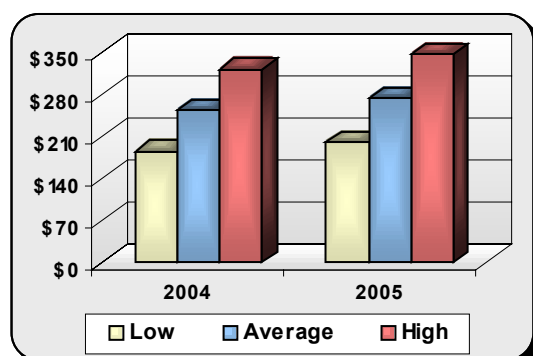

**Network Tariff charge comparison
2004 vs 2005.**

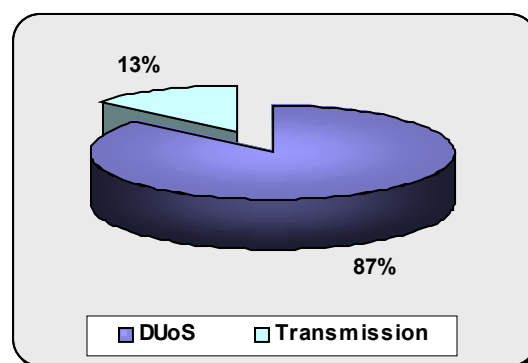

**2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

7.2 Residential – Time of Use


This is a two-rate tariff applicable to residential customers on GH/GL deemed retail tariff or residential contestable customers who have chosen this tariff. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times. Customers who are able to shift some of their peak load to the off-peak period may benefit from being on this tariff. Customers should, however, assess the benefits against the metering cost.

A comparison of the 2004 and 2005 'Residential – Time of Use' network tariff charges for the five usage levels is shown below.


Peak to Total Energy Ratio: 30%					
	Very Low 2,684 kWh	Low 6,263 kWh	Average 8,947 kWh	High 11,631 kWh	Very high 15,210 kWh
2004	\$124	\$227	\$305	\$382	\$486
2005	\$138	\$256	\$345	\$433	\$552
Change	11.3%	12.7%	13.1%	13.4%	13.6%

Peak to Total Energy Ratio: 50%					
	Very Low 2,684 kWh	Low 6,263 kWh	Average 8,947 kWh	High 11,631 kWh	Very high 15,210 kWh
2004	\$155	\$300	\$409	\$517	\$662
2005	\$170	\$332	\$452	\$573	\$734
Change	9.7%	10.5%	10.7%	10.8%	10.9%

The above tables indicate that the increase in the network tariff charge varies from 9.7% to 13.6% depending on customers' consumption and load patterns. Consistent with customers on 'Residential – General Purpose' tariff, larger users experience a greater reduction than small users. The Charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 30%.

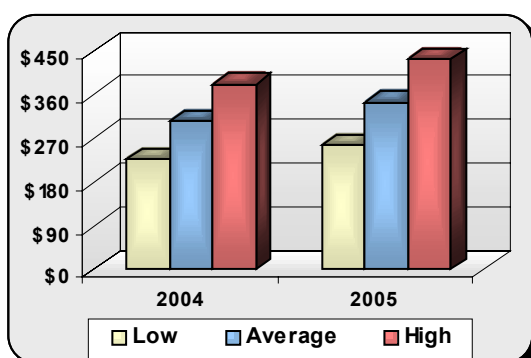

Network Tariff charge comparison
2004 vs 2005.

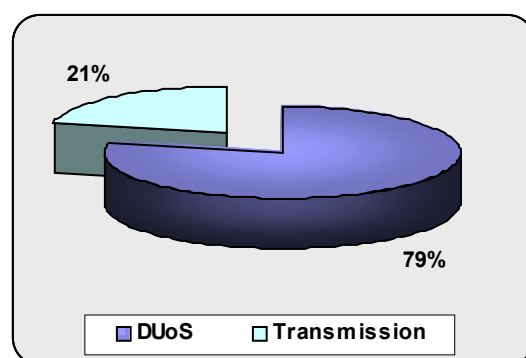

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.


7.3 Residential – Off Peak Heating Only

This is a complementary tariff to the ‘Residential – General Purpose’ network tariff. It relates to controlled loads such as storage water heating and space heating. It is applicable to customers on J or Y deemed retail tariff or residential contestable customers with controlled loads who have selected this tariff.


A comparison of the 2004 and 2005 ‘Residential – Off Peak Heating Only’ network tariff charges for the five usage levels is shown below.

	Very Low 961 kWh	Low 2,241 kWh	Average 3,202 kWh	High 4,163 kWh	Very high 5,443 kWh
2004	\$11	\$26	\$37	\$48	\$62
2005	\$14	\$34	\$48	\$62	\$82
Change	30.9%	30.9%	30.9%	30.9%	30.9%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

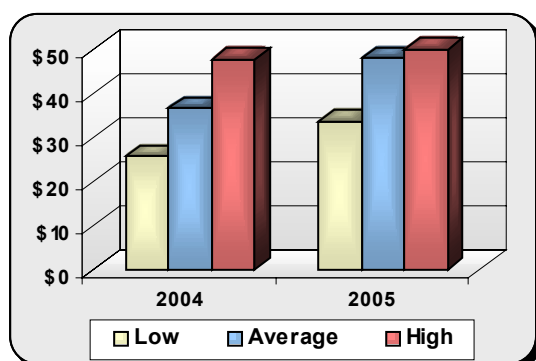

**Network Tariff charge comparison
2004 vs 2005.**

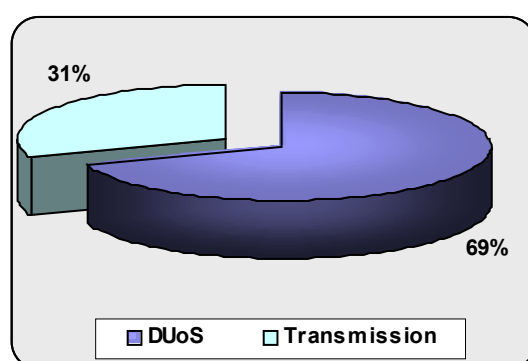

**2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

7.4 Small Business – General Purpose


Generally, this single rate tariff is suitable for small users or customers with very low consumption during off-peak periods. It is applicable to 'Small Business' customers currently on B, E, G and N deemed retail tariff or contestable customers who have chosen this tariff.

A comparison of the 2004 and 2005 'Small Business – General Purpose' network tariff charges for the five usage levels is shown below.


	Very Low 2,973 kWh	Low 6,936 kWh	Average 9,909 kWh	High 12,881 kWh	Very high 16,844 kWh
2004	\$250	\$500	\$688	\$877	\$1,127
2005	\$268	\$539	\$743	\$946	\$1,217
Change	7.5%	7.8%	7.9%	7.9%	7.9%

Consistent with previous observations, larger users experience higher reductions than smaller users. The increase in charges varies between 7.5% and 7.9% depending on consumption.

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

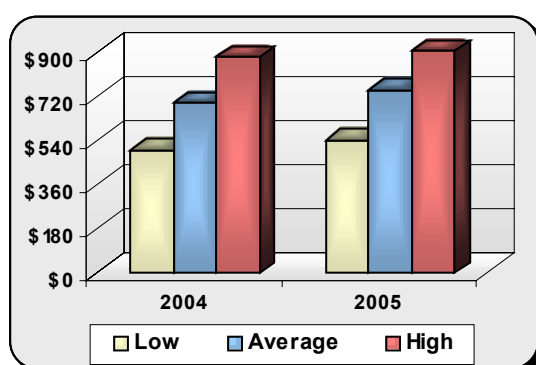

**Network Tariff charge comparison
2004 vs 2005.**

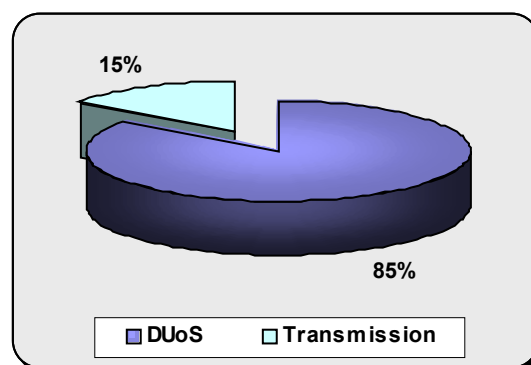

**2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

7.5 Small Business – Time of Use Weekdays

This is a two-rate tariff applicable to 'Small Business' customers on DH/DL deemed retail tariff or contestable customers who have chosen this time of use tariff. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times. Generally, this tariff is suitable for customers who operate 6 or 7 days a week or customers who operate 5 days a week but with large equipment, such as refrigeration units, running during the off peak periods.


A comparison of the 2004 and 2005 'Small Business –Time of Use Weekdays' network tariff charges for the five usage levels is shown below.

Peak to Total Energy Ratio: 40%					
	Very Low 14,466 kWh	Low 33,755 kWh	Average 48,222 kWh	High 62,688 kWh	Very high 81,977 kWh
2004	\$674	\$1,401	\$1,947	\$2,493	\$3,220
2005	\$743	\$1,551	\$2,158	\$2,765	\$3,573
Change	10.2%	10.7%	10.8%	10.9%	11.0%


Peak to Total Energy Ratio: 70%					
	Very Low 14,466 kWh	Low 33,755 kWh	Average 48,222 kWh	High 62,688 kWh	Very high 81,977 kWh
2004	\$952	\$2,049	\$2,872	\$3,695	\$4,793
2005	\$1,037	\$2,239	\$3,140	\$4,041	\$5,243
Change	9.0%	9.3%	9.3%	9.4%	9.4%

As can be observed from the above tables, the increase in charges varies from 9.0% to 11.0% depending on consumption and load patterns with larger users experiencing a greater reduction than smaller users.

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

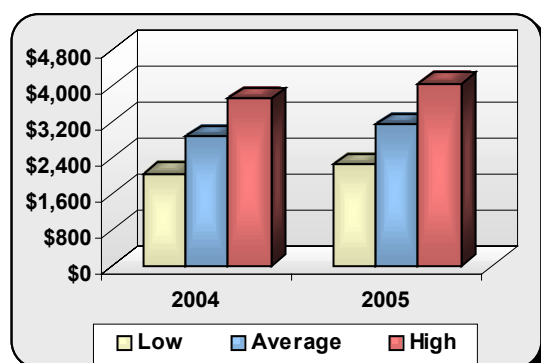

**Network Tariff charge comparison
2004 vs 2005.**

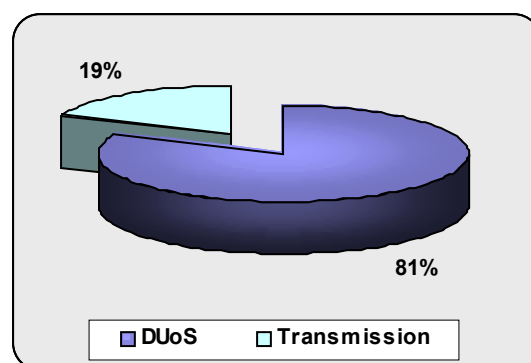

**2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

7.6 Small Business – Time of Use Weekdays Demand


This time of use demand based network tariff attracts a minimum chargeable demand of 60 kW and requires the installation of a meter capable of measuring demand. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Small Business – Time of Use Weekdays Demand' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 40% Load factor 55%				
	Very Low 85,160 kWh	Low 198,706 kWh	Average 283,866 kWh	High 369,025 kWh	Very high ⁶ 482,572 kWh
2004	\$4,876	\$7,695	\$9,809	\$12,568	N/A
2005	\$5,325	\$8,600	\$11,057	\$14,182	N/A
Change	9.2%	11.8%	12.7%	12.8%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 85,160 kWh	Low 198,706 kWh	Average 283,866 kWh	High 369,025 kWh	Very high 482,572 kWh
2004	\$5,685	\$9,582	\$12,505	\$16,073	N/A
2005	\$6,222	\$10,692	\$14,045	\$18,067	N/A
Change	9.4%	11.6%	12.3%	12.4%	N/A

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

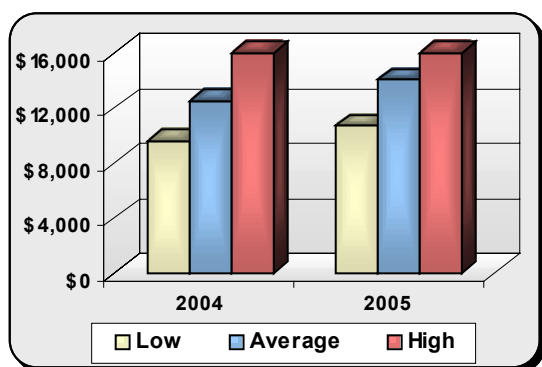

**Network Tariff charge comparison
2004 vs 2005.**

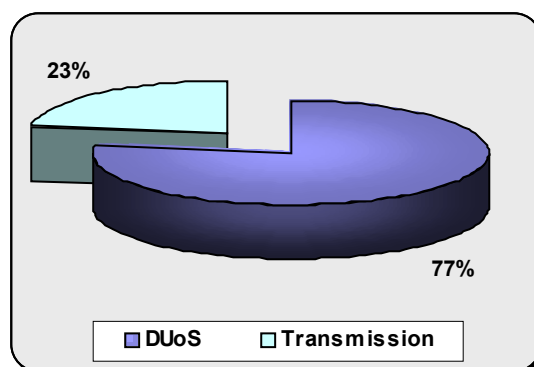

**2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

⁶ This usage is not applicable for this tariff as the usage level is greater than 400,000 kWh, which is the threshold for Small Business tariff category.

7.7 Small Business – Time of Use Extended


This is a two-rate tariff applicable to 'Small Business' customers on B1/B2, E1/E2 and N1/2 deemed retail tariff or contestable customers who have chosen this time of use Tariff. Unlike the previous two tariffs, the peak rate applies to the period 7.00 AM to 11.00 PM all days and the off-peak rate applies to all other times. Generally, this tariff is suitable for customers who operate 5 days a week with no or little equipment running during the weekends.

A comparison of the 2004 and 2005 'Small Business –Time of Use Extended' network tariff charges for the five usage levels is shown below.


Peak to Total Energy Ratio: 60%					
	Very Low 9,442 kWh	Low 22,032 kWh	Average 31,475 kWh	High 40,917 kWh	Very high 53,507 kWh
2004	\$553	\$1,120	\$1,545	\$1,970	\$2,537
2005	\$604	\$1,229	\$1,697	\$2,166	\$2,790
Change	9.2%	9.7%	9.8%	9.9%	10.0%

Peak to Total Energy Ratio: 80%					
	Very Low 9,442 kWh	Low 22,032 kWh	Average 31,475 kWh	High 40,917 kWh	Very high 53,507 kWh
2004	\$651	\$1,348	\$1,870	\$2,393	\$3,089
2005	\$707	\$1,469	\$2,041	\$2,612	\$3,374
Change	8.7%	9.0%	9.1%	9.2%	9.2%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

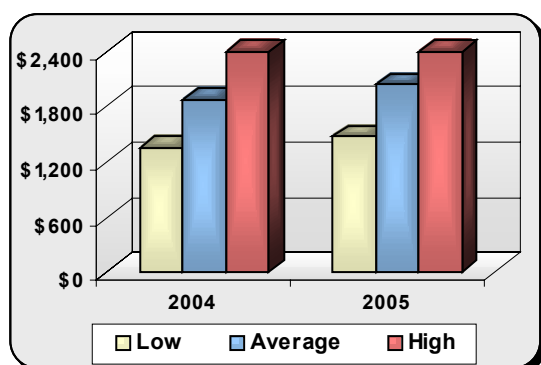

Network Tariff charge comparison
2004 vs 2005.

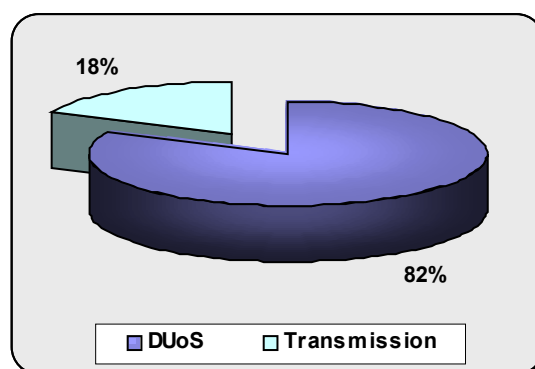

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.8 Small Business – Time of Use Extended Demand


Like the 'Small Business – Time of use Weekday Demand' tariff, this two rate demand based network tariff also attracts a minimum chargeable demand of 60 kW and requires a metering installation capable of measuring demand. However, the peak rate applies to the period 7.00 AM to 11.00 PM all days and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Small business –Time of Use Extended Demand' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 60% Load factor 55%				
	Very Low 78,686 kWh	Low 183,600 kWh	Average 262,285 kWh	High 340,971 kWh	Very high 445,885 kWh
2004	\$4,863	\$7,663	\$9,764	\$12,284	N/A
2005	\$5,299	\$8,541	\$10,972	\$13,837	N/A
Change	9.0%	11.4%	12.4%	12.6%	N/A

	Peak to Total Energy Ratio: 80% Load factor: 55%				
	Very Low 78,686 kWh	Low 183,600 kWh	Average 262,285 kWh	High 340,971 kWh	Very high 445,885 kWh
2004	\$5,190	\$8,428	\$10,856	\$13,703	N/A
2005	\$5,664	\$9,390	\$12,185	\$15,415	N/A
Change	9.1%	11.4%	12.2%	12.5%	N/A

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

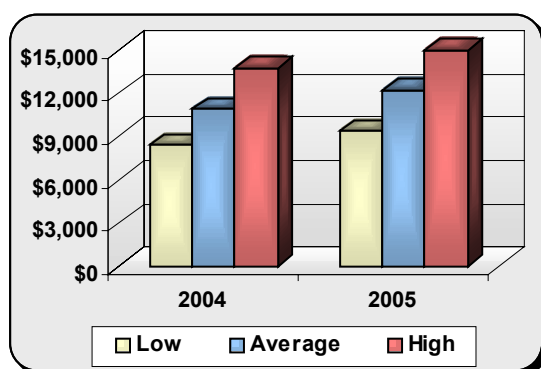

**Network Tariff charge comparison
2004 vs 2005.**

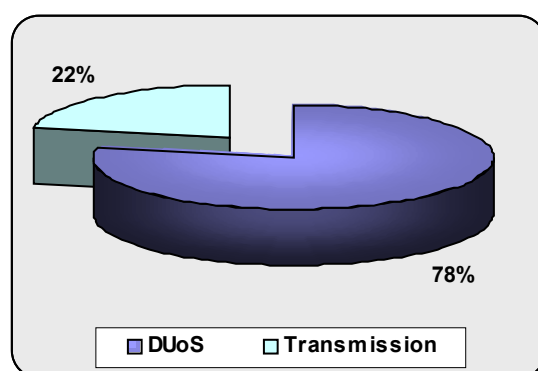

**2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

7.9 Large Business – LV 0.4 - 0.8 GWh


This is a time of use demand based network tariff applicable to LV commercial/industrial customers with annual consumption greater than or equal to 0.4 GWh (400 MWh) but less than or equal to 0.8 GWh (800 MWh). It is also applicable to customers with an annual consumption less than 400 MWh but either having a maximum demand greater than or equal to 120 kW (150 kVA) or taking supply from an on-site or dedicated substation. The minimum chargeable demand is 120 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Large Business – LV 0.4 – 0.8 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 180,531 kWh	Low 421,239 kWh	Average 601,770 kWh	High 782,300 kWh	Very high 1,023,008 kWh
2004	N/A	\$15,834	\$18,682	\$23,696	N/A
2005	N/A	\$17,917	\$21,554	\$27,404	N/A
Change	N/A	13.2%	15.4%	15.6%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 180,531 kWh	Low 421,239 kWh	Average 601,770 kWh	High 782,300 kWh	Very high 1,023,008 kWh
2004	N/A	\$17,341	\$20,834	\$26,494	N/A
2005	N/A	\$19,780	\$24,216	\$30,863	N/A
Change	N/A	14.1%	16.2%	16.5%	N/A

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

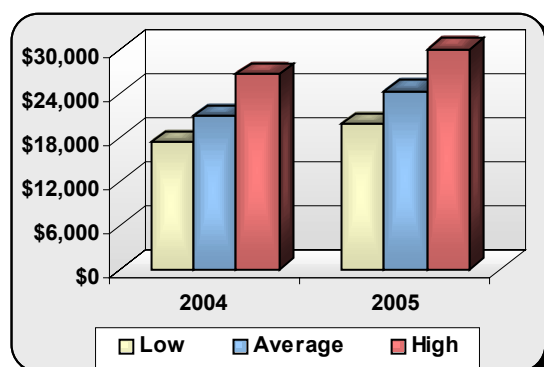

Network Tariff charge comparison
2004 vs 2005.

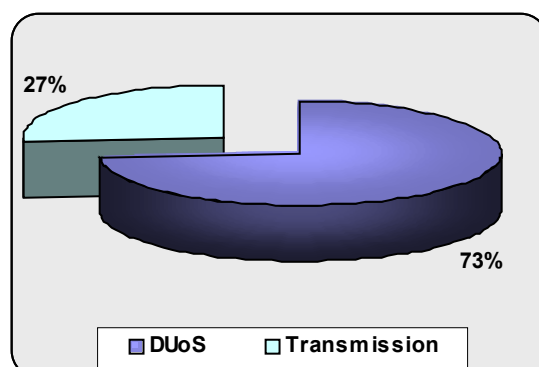

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.10 Large Business – LV_{MS} 0.4 - 0.8 GWh

This is a time of use demand based network tariff available to LV commercial/industrial customers taking supply from multiple supply points on a single site and the aggregated annual consumption from those supply points is greater than or equal to 0.4 GWh but less than or equal to 0.8 GWh. The aggregated minimum chargeable demand is 120 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

The terms and conditions for assignment to Multiple Supply ("MS") tariffs can be found at the following AGL Website link:


<http://www.agl.com.au/AGLNew/About+AGL/Energy+networks/AGL+Electricity+Networks/Energy+retailer+enquiries/Network+Tariffs.htm>

A comparison of the 2004 and 2005 'Large Business – LV_{MS} 0.4 – 0.8 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 180,531 kWh	Low 421,239 kWh	Average 601,770 kWh	High 782,300 kWh	Very high 1,023,008 kWh
2004	N/A	\$11,811	\$14,221	\$18,147	N/A
2005	N/A	\$13,713	\$16,850	\$21,546	N/A
Change	N/A	16.1%	18.5%	18.7%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 180,531 kWh	Low 421,239 kWh	Average 601,770 kWh	High 782,300 kWh	Very high 1,023,008 kWh
2004	N/A	\$13,042	\$15,980	\$20,433	N/A
2005	N/A	\$15,201	\$18,976	\$24,309	N/A
Change	N/A	16.5%	18.7%	19.0%	N/A

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

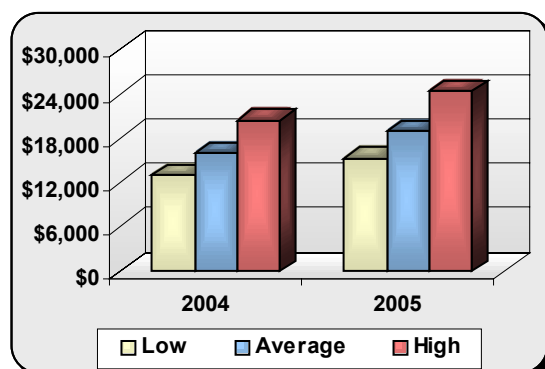

Network Tariff charge comparison
2004 vs 2005.

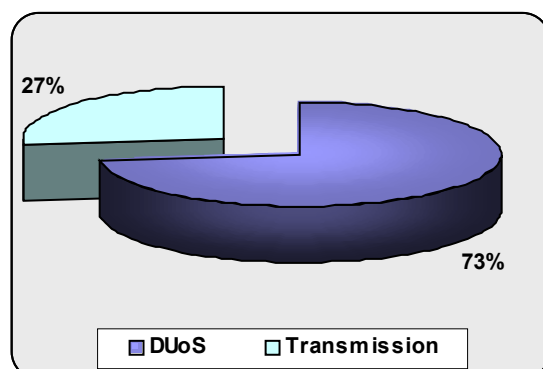

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.11 Large Business – LV 0.8⁺ - 2.2 GWh


This network tariff has similar structure to the 'Large Business – LV 0.4 – 0.8 GWh' tariff. It is available to LV commercial/industrial customers with annual consumption greater than 0.8 GWh (800 MWh) but less than or equal to 2.2 GWh (2,200 MWh). The minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Large Business – LV 0.8⁺ – 2.2 GWh' network tariff charges for the five usage levels is shown below.


Peak to Total Energy Ratio: 50% Load factor 55%					
	Very Low 427,086 kWh	Low 996,534 kWh	Average 1,423,621 kWh	High 1,850,707 kWh	Very high 2,420,155 kWh
2004	N/A	\$30,639.02	\$38,813.55	\$49,614.80	N/A
2005	N/A	\$35,544.34	\$45,700.64	\$58,530.37	N/A
Change	N/A	16.0%	17.7%	18.0%	N/A

Peak to Total Energy Ratio: 70% Load factor: 55%					
	Very Low 427,086 kWh	Low 996,534 kWh	Average 1,423,621 kWh	High 1,850,707 kWh	Very high 2,420,155 kWh
2004	N/A	\$33,724.29	\$43,221.08	\$55,344.59	N/A
2005	N/A	\$39,572.33	\$51,454.92	\$66,010.93	N/A
Change	N/A	17.3%	19.1%	19.3%	N/A

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

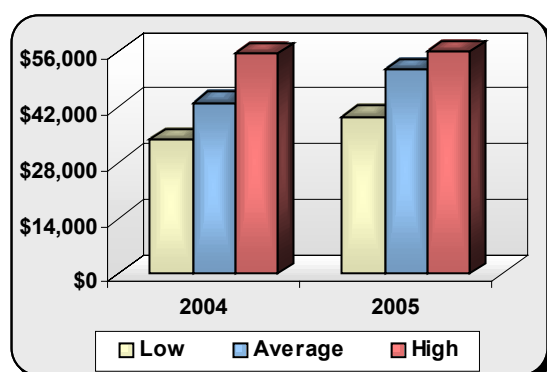

Network Tariff charge comparison
2004 Vs 2005.

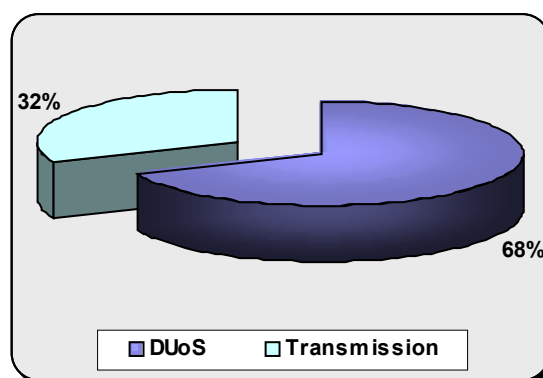

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.12 Large Business – LV_{MS} 0.8⁺ - 2.2 GWh

This is a time of use demand based network tariff available to LV commercial/industrial customers taking supply from multiple supply points on a single site and the aggregated annual consumption from those supply points is greater than 0.8 GWh but less than or equal to 2.2 GWh. The aggregated minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

The terms and conditions for assignment to Multiple Supply (“MS”) tariffs can be found at the following AGL Website link:


<http://www.agl.com.au/AGLNew/About+AGL/Energy+networks/AGL+Electricity+Networks/Energy+retailer+enquiries/Network+Tariffs.htm>

A comparison of the 2004 and 2005 ‘Large Business – LV_{MS} 0.8 – 2.2 GWh’ network tariff charges for the five usage levels is shown below.


Peak to Total Energy Ratio: 50% Load factor 55%					
	Very Low 427,086 kWh	Low 996,534 kWh	Average 1,423,621 kWh	High 1,850,707 kWh	Very high 2,420,155 kWh
2004	N/A	\$24,118.18	\$31,069.97	\$39,862.93	N/A
2005	N/A	\$28,758.34	\$37,594.90	\$48,314.41	N/A
Change	N/A	19.2%	21.0%	21.2%	N/A

Peak to Total Energy Ratio: 70% Load factor: 55%					
	Very Low 427,086 kWh	Low 996,534 kWh	Average 1,423,621 kWh	High 1,850,707 kWh	Very high 2,420,155 kWh
2004	N/A	\$26,878.58	\$35,013.40	\$44,989.39	N/A
2005	N/A	\$32,331.91	\$42,700.00	\$54,951.05	N/A
Change	N/A	20.3%	22.0%	22.1%	N/A

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

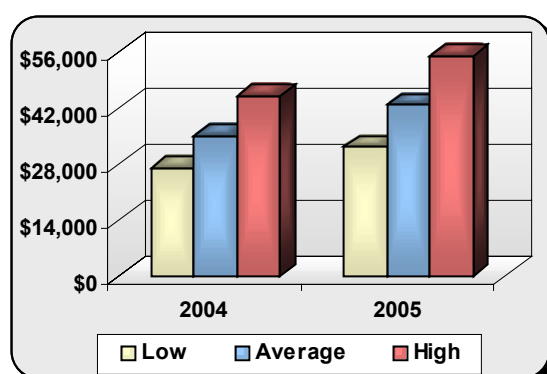

Network Tariff charge comparison
2004 vs 2005.

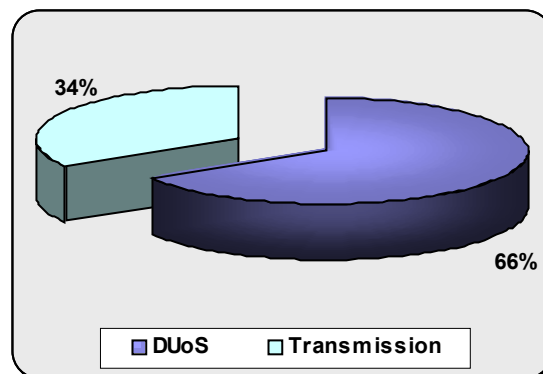

2005 DUoS and Transmission charges
as a proportion of the network charge
or an average user.

7.13 Large Business – LV_{RF} 0.8⁺ - 2.2 GWh


This is a time of use demand based network tariff available only to existing LV commercial/industrial customers as at 31 December 2001 with annual consumption greater than 0.8 GWh but less than or equal to 2.2 GWh and having a reserve feeder connection⁷. The minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Large Business – LV_{RF} 0.8 – 2.2 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 427,086 kWh	Low 996,534 kWh	Average 1,423,621 kWh	High 1,850,707 kWh	Very high 2,420,155 kWh
2004	N/A	\$27,287.04	\$34,814.92	\$44,416.57	N/A
2005	N/A	\$32,182.13	\$41,705.90	\$53,337.20	N/A
Change	N/A	17.9%	19.8%	20.1%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 427,086 kWh	Low 996,534 kWh	Average 1,423,621 kWh	High 1,850,707 kWh	Very high 2,420,155 kWh
2004	N/A	\$30,312.52	\$39,137.03	\$50,035.32	N/A
2005	N/A	\$36,176.24	\$47,411.77	\$60,754.84	N/A
Change	N/A	19.3%	21.1%	21.4%	N/A

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

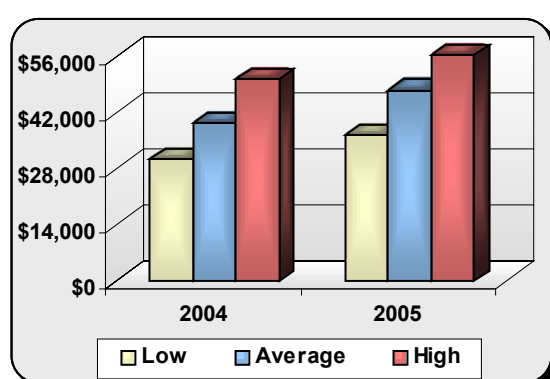

Network Tariff charge comparison
2004 vs 2005.

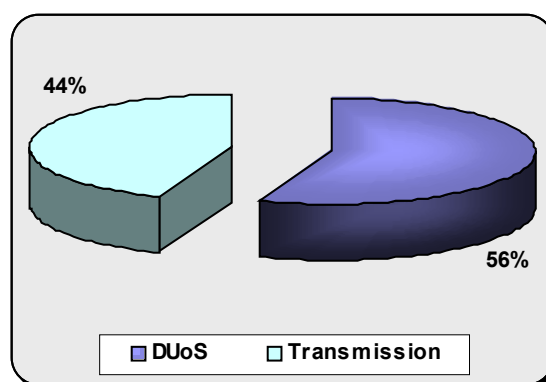

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

⁷ Other terms and conditions apply.

7.14 Large Business – LV 2.2⁺ - 6.0 GWh


This time of use demand based network tariff is applicable to large LV commercial/industrial customers with annual consumption greater than 2.2 GWh (2,200 MWh) but less than or equal to 6.0 GWh (6,000 MWh). The minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Large Business – LV 2.2⁺ – 6.0 GWh' network tariff charges for the five usage levels is shown below.


Peak to Total Energy Ratio: 50% Load factor 55%					
	Very Low 907,391 kWh	Low 2,117,245 kWh	Average 3,024,636 kWh	High 3,932,027 kWh	Very high 5,141,882 kWh
2004	N/A	N/A	\$79,709	\$101,505	\$130,567
2005	N/A	N/A	\$94,554	\$120,683	\$155,521
Change	N/A	N/A	18.6%	18.9%	19.1%

Peak to Total Energy Ratio: 70% Load factor: 55%					
	Very Low 907,391 kWh	Low 2,117,245 kWh	Average 3,024,636 kWh	High 3,932,027 kWh	Very high 5,141,882 kWh
2004	N/A	N/A	\$89,122	\$113,742	\$146,568
2005	N/A	N/A	\$107,348	\$137,315	\$177,272
Change	N/A	N/A	20.5%	20.7%	20.9%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

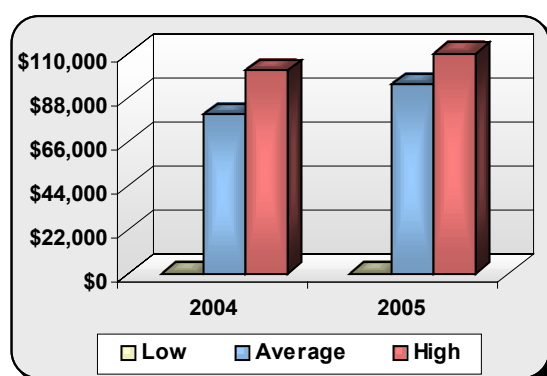

Network Tariff charge comparison
2004 vs 2005.

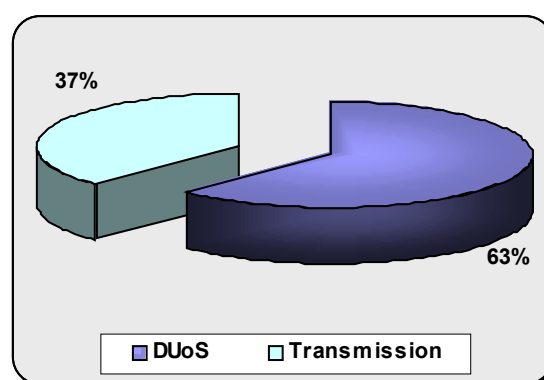

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.15 Large Business – LV_{MS} 2.2⁺ - 6.0 GWh

This is a time of use demand based network tariff available to LV commercial/industrial customers taking supply from multiple supply points on a single site and the aggregated annual consumption from those supply points is greater than 2.2 GWh but less than or equal to 6.0 GWh. The aggregated minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

The terms and conditions for assignment to Multiple Supply (“MS”) tariffs can be found at the following AGL Website link:


<http://www.agl.com.au/AGLNew/About+AGL/Energy+networks/AGL+Electricity+Networks/Energy+retailer+enquiries/Network+Tariffs.htm>

A comparison of the 2004 and 2005 ‘Large Business – LV_{MS} 2.2⁺ – 6.0 GWh’ network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 907,391 kWh	Low 2,117,245 kWh	Average 3,024,636 kWh	High 3,932,027 kWh	Very high 5,141,882 kWh
2004	N/A	N/A	\$62,357	\$79,614	\$102,624
2005	N/A	N/A	\$75,818	\$97,029	\$125,312
Change	N/A	N/A	21.6%	21.9%	22.1%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 907,391 kWh	Low 2,117,245 kWh	Average 3,024,636 kWh	High 3,932,027 kWh	Very high 5,141,882 kWh
2004	N/A	N/A	\$70,403	\$90,073	\$116,301
2005	N/A	N/A	\$86,561	\$110,996	\$143,576
Change	N/A	N/A	23.0%	23.2%	23.5%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

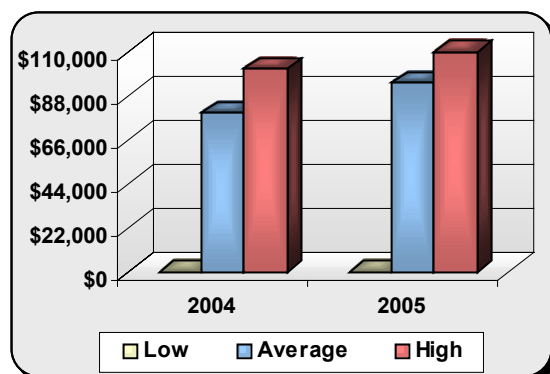

Network Tariff charge comparison
2004 vs 2005.

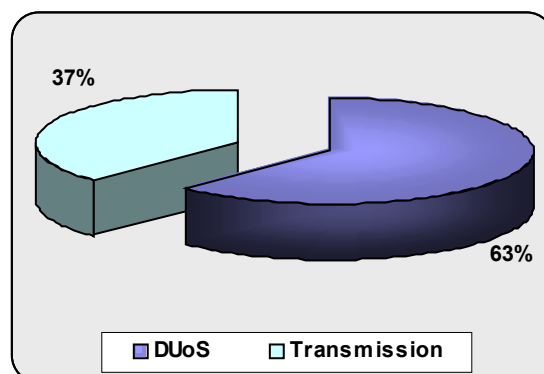

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.16 Large Business – LV_{RF} 2.2* - 6.0 GWh


This is a time of use demand based network tariff available only to existing LV commercial/industrial customers as at 31 December 2001 with annual consumption greater than 2.2 GWh but less than or equal to 6.0 GWh and having a reserve feeder connection⁸. The minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Large Business – LV_{RF} 2.2* – 6.0 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 907,391 kWh	Low 2,117,245 kWh	Average 3,024,636 kWh	High 3,932,027 kWh	Very high 5,141,882 kWh
2004	N/A	N/A	\$71,244	\$90,500	\$116,176
2005	N/A	N/A	\$85,417	\$108,804	\$139,988
Change	N/A	N/A	19.9%	20.2%	20.5%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 907,391 kWh	Low 2,117,245 kWh	Average 3,024,636 kWh	High 3,932,027 kWh	Very high 5,141,882 kWh
2004	N/A	N/A	\$80,487	\$102,517	\$131,889
2005	N/A	N/A	\$97,848	\$124,965	\$161,121
Change	N/A	N/A	21.6%	21.9%	22.2%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

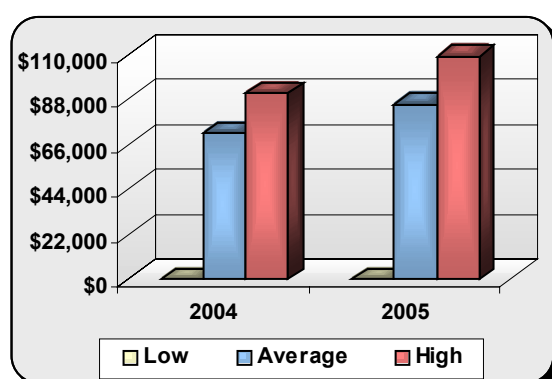

Network Tariff charge comparison
2004 vs 2005.

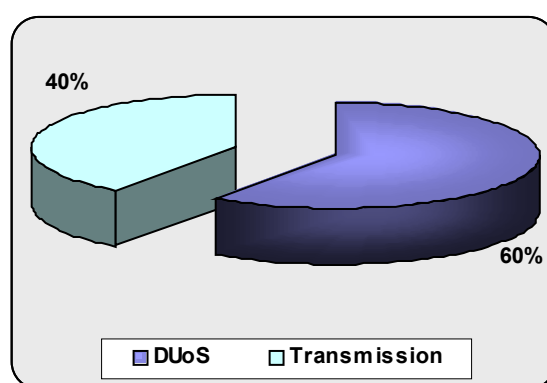

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

⁸ Other terms and conditions apply.

7.17 Large Business – LV 6.0⁺ GWh


This time of use demand based network tariff is available to very large LV commercial or industrial customers that consume an annual amount of electricity in excess of 6.0 GWh (6,000 MWh). The minimum chargeable demand is 450 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Large Business – LV 6.0⁺ GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 2,172,592 kWh	Low 5,069,382 kWh	Average 7,241,975 kWh	High 9,414,567 kWh	Very high 12,311,357 kWh
2004	N/A	N/A	\$176,534	\$227,117	\$294,561
2005	N/A	N/A	\$211,871	\$272,923	\$354,327
Change	N/A	N/A	20.0%	20.2%	20.3%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 2,172,592 kWh	Low 5,069,382 kWh	Average 7,241,975 kWh	High 9,414,567 kWh	Very high 12,311,357 kWh
2004	N/A	N/A	\$199,491	\$256,961	\$333,588
2005	N/A	N/A	\$243,287	\$313,764	\$407,734
Change	N/A	N/A	22.0%	22.1%	22.2%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

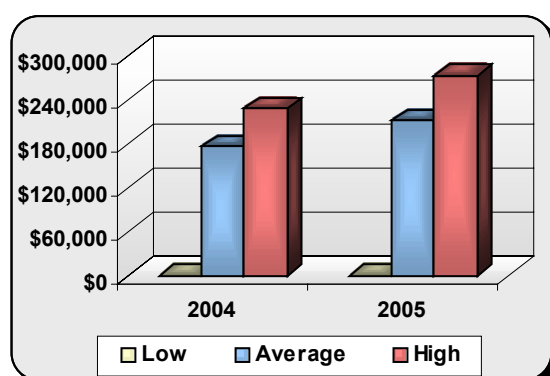

Network Tariff charge comparison
2004 vs 2005.

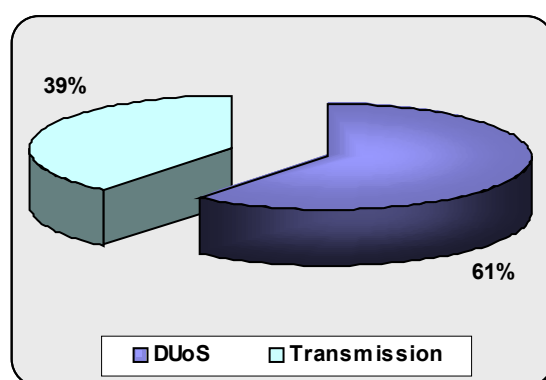

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.18 Large Business – LV_{MS} 6.0⁺ GWh

This is a time of use demand based network tariff available to LV commercial/industrial customers taking supply from multiple supply points on a single site and the aggregated annual consumption from those supply points is greater than 6.0 GWh. The aggregated minimum chargeable demand is 450 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

The terms and conditions for assignment to Multiple Supply (“MS”) tariffs can be found at the following AGL Website link:


<http://www.agl.com.au/AGLNew/About+AGL/Energy+networks/AGL+Electricity+Networks/Energy+retailer+enquiries/Network+Tariffs.htm>

A comparison of the 2004 and 2005 ‘Large Business – LV_{MS} 6.0⁺ GWh’ network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 2,172,592 kWh	Low 5,069,382 kWh	Average 7,241,975 kWh	High 9,414,567 kWh	Very high 12,311,357 kWh
2004	N/A	N/A	\$146,425	\$188,588	\$244,805
2005	N/A	N/A	\$180,968	\$233,390	\$303,286
Change	N/A	N/A	23.6%	23.8%	23.9%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 2,172,592 kWh	Low 5,069,382 kWh	Average 7,241,975 kWh	High 9,414,567 kWh	Very high 12,311,357 kWh
2004	N/A	N/A	\$168,513	\$217,303	\$282,355
2005	N/A	N/A	\$210,979	\$272,404	\$354,304
Change	N/A	N/A	25.2%	25.4%	25.5%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

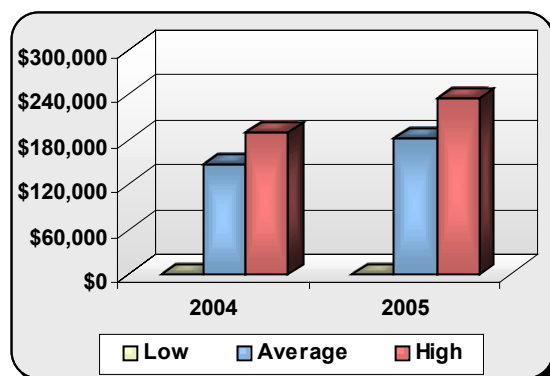

Network Tariff charge comparison
2004 vs 2005.

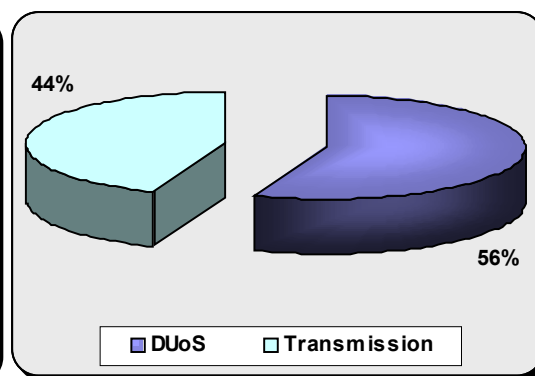

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.19 Large Business – LV_{RF} 6.0⁺ GWh


This is a time of use demand based network tariff available only to existing LV commercial/industrial customers as at 31 December 2001 with annual consumption greater than 6.0 GWh and having a reserve feeder connection⁹. The minimum chargeable demand is 450 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Large Business – LV_{RF} 6.0⁺ GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50%			Load factor 55%	
	Very Low 2,172,592 kWh	Low 5,069,382 kWh	Average 7,241,975 kWh	High 9,414,567 kWh	Very high 12,311,357 kWh
2004	N/A	N/A	\$156,084	\$200,532	\$259,796
2005	N/A	N/A	\$190,572	\$245,235	\$318,119
Change	N/A	N/A	22.1%	22.3%	22.4%

	Peak to Total Energy Ratio: 70%			Load factor: 55%	
	Very Low 2,172,592 kWh	Low 5,069,382 kWh	Average 7,241,975 kWh	High 9,414,567 kWh	Very high 12,311,357 kWh
2004	N/A	N/A	\$178,563	\$229,755	\$298,011
2005	N/A	N/A	\$221,350	\$285,247	\$370,442
Change	N/A	N/A	24.0%	24.2%	24.3%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

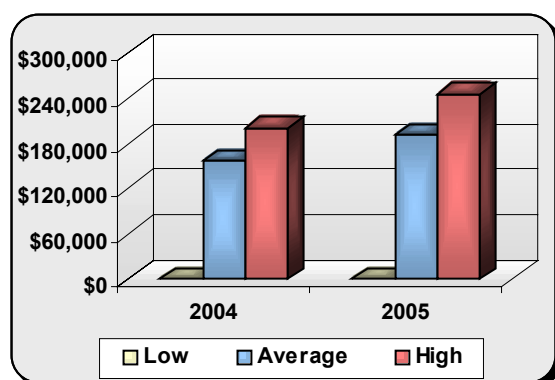

Network Tariff charge comparison
2004 vs 2005.

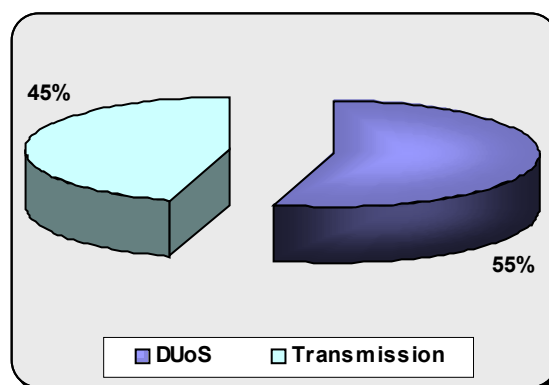

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

⁹ Other terms and conditions apply.

7.20 Large Business – HV


This is a Time of Use demand based network tariff applicable to HV commercial or industrial customers with annual consumption less than 55.0 GWh (55,000 MWh). The minimum chargeable demand is 1,000 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

The impact of 2004 and 2005 'Large Business – HV' network tariff on customers is shown below.


Peak to Total Energy Ratio: 50% Load factor 55%					
	Very Low 2,642,521 kWh	Low 6,165,882 kWh	Average 8,808,403 kWh	High 11,450,924 kWh	Very high 14,974,286 kWh
2004	\$85,479	\$132,172	\$185,265	\$238,357	\$309,147
2005	\$99,472	\$161,663	\$227,184	\$292,706	\$380,067
Change	16.4%	22.3%	22.6%	22.8%	22.9%

Peak to Total Energy Ratio: 70% Load factor: 55%					
	Very Low 2,642,521 kWh	Low 6,165,882 kWh	Average 8,808,403 kWh	High 11,450,924 kWh	Very high 14,974,286 kWh
2004	\$93,180	\$150,140	\$210,932	\$271,725	\$352,782
2005	\$110,629	\$187,696	\$264,374	\$341,051	\$443,289
Change	18.7%	25.0%	25.3%	25.5%	25.7%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

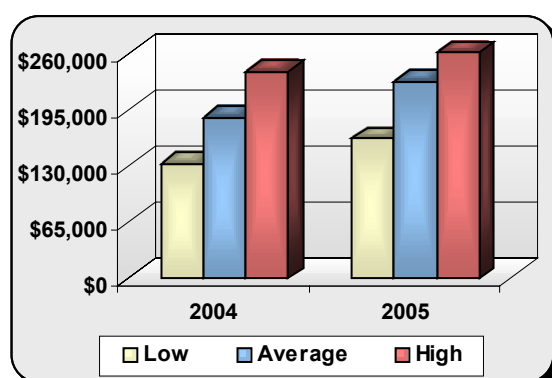

Network Tariff charge comparison
2004 vs 2005.

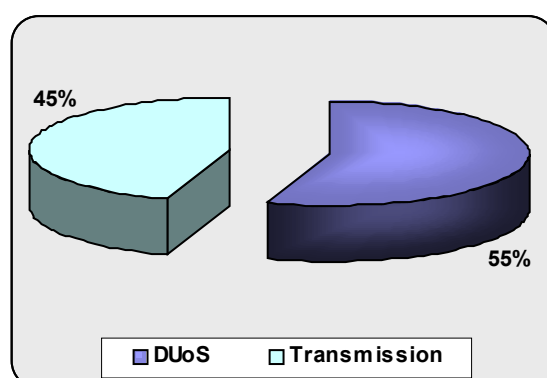

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

7.21 Large Business – HV_{RF}


This is a Time of Use demand based network tariff available only to existing HV commercial or industrial customers as at 31 December 2001 with annual consumption less than 55.0 GWh and having a reserve feeder connection¹⁰. The minimum chargeable demand is 1,000 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2004 and 2005 'Large Business – HV_{RF}' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 2,642,521 kWh	Low 6,165,882 kWh	Average 8,808,403 kWh	High 11,450,924 kWh	Very high 14,974,286 kWh
2004	\$72,484	\$115,347	\$161,229	\$207,110	\$268,286
2005	\$86,362	\$144,886	\$203,216	\$261,547	\$339,321
Change	19.1%	25.6%	26.0%	26.3%	26.5%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 2,642,521 kWh	Low 6,165,882 kWh	Average 8,808,403 kWh	High 11,450,924 kWh	Very high 14,974,286 kWh
2004	\$80,111	\$133,142	\$186,650	\$240,158	\$311,501
2005	\$97,519	\$170,918	\$240,405	\$309,893	\$402,543
Change	21.7%	28.4%	28.8%	29.0%	29.2%

The charts below compare 2004 and 2005 network tariff charges for low, average and high users and show 2005 DUoS and Transmission charges as a proportion of the network charge for an average user.

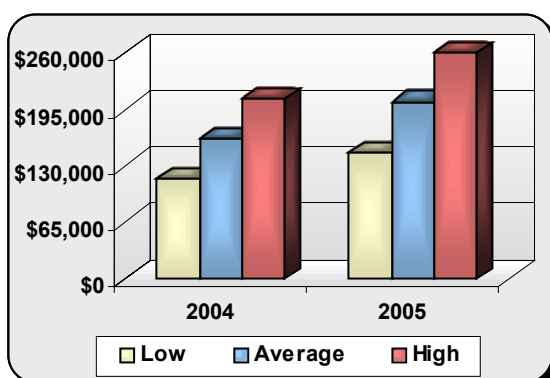

Network Tariff charge comparison
2004 vs 2005.

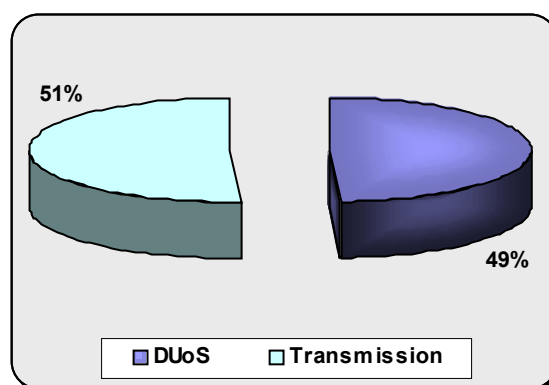

2005 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

¹⁰ Other terms and conditions apply.

APPENDIX 1 NETWORK TARIFFS FOR 2005 (EXCLUSIVE OF GST)

Customer Class	Code	Tariff Name	Units	Rate
Residential				
Available to residential customers.				
	A100	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$27.600
		- Unit rate	¢/kWh	5.919
	A140	Time of Use		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$49.700
		- Peak Unit rate	¢/kWh	7.501
		- Off Peak Unit rate	¢/kWh	1.499
	A180	Off Peak Heating Only		
		<i>11.00 PM to 7.00 AM all days.</i>		
		- Standing charge	\$/customer pa	\$0.000
		- Off Peak Unit rate	¢/kWh	1.499
Small Business				
Available to customers:				
a) with annual consumption < 0.4 GWh AND maximum demand < 150 kVA (120 kW); and				
b) where supply is not taken from an on-site OR dedicated substation.				
	A200	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$65.000
		- Unit rate	¢/kWh	6.838
	A210	Time of Use Weekdays		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$136.000
		- Peak Unit rate	¢/kWh	8.266
		- Off Peak Unit rate	¢/kWh	1.478
	A230	Time of Use Weekdays - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$449.800
		- Peak Unit rate	¢/kWh	4.990
		- Off Peak Unit rate	¢/kWh	1.481
		- Demand rate	\$/kW pa	\$40.312
		Minimum Chargeable Demand	60 kW	
	A250	Time of Use Extended		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$136.000
		- Peak Unit rate	¢/kWh	7.144
		- Off Peak Unit rate	¢/kWh	1.685

Customer Class	Code	Tariff Name	Units	Rate
	A270	Time of Use Extended - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun"; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$449.800
		- Peak Unit rate	¢/kWh	4.015
		- Off Peak Unit rate	¢/kWh	1.701
		- Demand rate	\$/kW pa	\$40.312
		Minimum Chargeable Demand	60 kW	
	A290	Unmetered Supply		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.</i>		
		- Peak Unit rate	¢/kWh	7.671
		- Off Peak Unit rate	¢/kWh	1.489

Large Business

Low Voltage Tariffs (nominal voltage < 1000 Volts)

Available to customers:

- a) with annual consumption ≥ 0.4 GWh OR maximum demand ≥ 150 kVA (120 kW); or
- b) taking supply from an on-site OR dedicated substation.

A300 LV 0.4 - 0.8 GWh

Available to customers with annual consumption ≥ 0.4 GWh BUT ≤ 0.8 GWh.

Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.

- Standing charge	\$/customer pa	\$2,057.000
- Peak Unit rate	¢/kWh	2.936
- Off Peak Unit rate	¢/kWh	0.725
- Demand rate	\$/kW pa	\$67.911
Minimum Chargeable Demand	120 kW	

A30M LV_{MS} 0.4 - 0.8 GWh

Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is ≥ 0.4 GWh BUT ≤ 0.8 GWh.*

Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.

- Standing charge	\$/customer pa	\$1,197.500
- Peak Unit rate	¢/kWh	2.491
- Off Peak Unit rate	¢/kWh	0.725
- Demand rate	\$/kW pa	\$47.849
Minimum Chargeable Demand	120 kW	

A320 LV 0.8* - 2.2 GWh

Available to customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh.

Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.

- Standing charge	\$/customer pa	\$2,934.900
- Peak Unit rate	¢/kWh	2.729
- Off Peak Unit rate	¢/kWh	0.708
- Demand rate	\$/kW pa	\$61.936
Minimum Chargeable Demand	250 kW	

Customer Class	Code	Tariff Name	Units	Rate
A32M		LV_{MS} 0.8⁺ - 2.2 GWh		
Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 0.8 GWh BUT ≤ 2.2 GWh.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$1,863.200
	- Peak Unit rate		¢/kWh	2.501
	- Off Peak Unit rate		¢/kWh	0.708
	- Demand rate		\$/kW pa	\$43.623
	Minimum Chargeable Demand		250 kW	
A32R		LV_{RF} 0.8⁺ - 2.2 GWh		
Available to existing customers as at 31 Dec. 2001 with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh AND a Reserve Feeder connection.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$2,934.900
	- Peak Unit rate		¢/kWh	2.712
	- Off Peak Unit rate		¢/kWh	0.708
	- Demand rate		\$/kW pa	\$48.826
	Minimum Chargeable Demand		250 kW	
A340		LV 2.2⁺ - 6.0 GWh		
Available to customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh.				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$7,457.900
	- Peak Unit rate		¢/kWh	2.664
	- Off Peak Unit rate		¢/kWh	0.549
	- Demand rate		\$/kW pa	\$61.336
	Minimum Chargeable Demand		250 kW	
A34M		LV_{MS} 2.2⁺ - 6.0 GWh		
Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 2.2 GWh BUT ≤ 6.0 GWh.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$5,111.700
	- Peak Unit rate		¢/kWh	2.325
	- Off Peak Unit rate		¢/kWh	0.549
	- Demand rate		\$/kW pa	\$43.394
	Minimum Chargeable Demand		250 kW	

Customer Class	Code	Tariff Name	Units	Rate
A34R		LV_{RF} 2.2* - 6.0 GWh		
Available to existing customers as at 31 Dec. 2001 with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh AND a Reserve Feeder connection.*				
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>				
- Standing charge			\$/customer pa	\$7,457.900
- Peak Unit rate			¢/kWh	2.604
- Off Peak Unit rate			¢/kWh	0.549
- Demand rate			\$/kW pa	\$48.226
Minimum Chargeable Demand			250 kW	
A370		LV 6.0* GWh		
Available to customers with annual consumption > 6.0 GWh.				
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>				
- Standing charge			\$/customer pa	\$8,362.300
- Peak Unit rate			¢/kWh	2.678
- Off Peak Unit rate			¢/kWh	0.509
- Demand rate			\$/kW pa	\$58.617
Minimum Chargeable Demand			450 kW	
A37M		LV_{MS} 6.0* GWh		
Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 6.0 GWh.*				
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>				
- Standing charge			\$/customer pa	\$6,228.600
- Peak Unit rate			¢/kWh	2.581
- Off Peak Unit rate			¢/kWh	0.509
- Demand rate			\$/kW pa	\$41.814
Minimum Chargeable Demand			450 kW	
A37R		LV_{RF} 6.0* GWh		
Available to existing customers as at 31 Dec. 2001 with annual consumption > 6.0 GWh AND a Reserve Feeder connection.*				
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>				
- Standing charge			\$/customer pa	\$8,362.300
- Peak Unit rate			¢/kWh	2.634
- Off Peak Unit rate			¢/kWh	0.509
- Demand rate			\$/kW pa	\$45.507
Minimum Chargeable Demand			450 kW	

Customer Class	Code	Tariff Name	Units	Rate
High Voltage Tariffs (nominal voltage ≥ 1000 Volts AND ≤ 22,000 Volts)				
A400	HV			
Available to customers with annual consumption < 55 GWh				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$8,780.600
- Peak Unit rate		¢/kWh		2.378
- Off Peak Unit rate		¢/kWh		0.267
- Demand rate		\$/kW pa		\$55.744
Minimum Chargeable Demand		1,000 kW		
A40R	HV _{RF}			
Available to existing customers as at 31 Dec. 2001 with annual consumption < 55 GWh				
AND a Reserve Feeder connection.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$8,780.600
- Peak Unit rate		¢/kWh		2.378
- Off Peak Unit rate		¢/kWh		0.267
- Demand rate		\$/kW pa		\$42.634
Minimum Chargeable Demand		1,000 kW		
A480	HV - Annual Consumption ≥ 55 GWh			
Available to customers with annual consumption ≥ 55 GWh				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$9,040.100
- Peak Unit rate		¢/kWh		2.374
- Off Peak Unit rate		¢/kWh		0.227
- Demand rate		\$/kW pa		\$52.596
Minimum Chargeable Demand		10,000 kW		

Customer Class	Code	Tariff Name	Units	Rate
Subtransmission Tariffs (nominal voltage > 22,000 Volts)				
	A500	Subtransmission		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$33,638.500
		- Peak Unit rate	¢/kWh	1.599
		- Off Peak Unit rate	¢/kWh	0.094
		- Demand rate	\$/kW pa	\$17.424
		Minimum Chargeable Demand	15,000 kW	
	A50A	Subtransmission MA		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$33,638.500
		- Peak Unit rate	¢/kWh	1.546
		- Off Peak Unit rate	¢/kWh	0.094
		- Demand rate	\$/kW pa	\$17.424
		Minimum Chargeable Demand	15,000 kW	
	A50E	Subtransmission EG		
		Available to Embedded Generators connected to TTS-SSS-ST-EPG-TTS Loop.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$35,473.100
		- Peak Unit rate	¢/kWh	1.688
		- Off Peak Unit rate	¢/kWh	0.100
		- Demand rate	\$/kW pa	\$5.924
		Minimum Chargeable Demand	15,000 kW	

* Other terms and conditions apply

APPENDIX 2 DISTRIBUTION TARIFFS FOR 2005 (EXCLUSIVE OF GST)

Customer Class	Code	Tariff Name	Units	Rate
----------------	------	-------------	-------	------

Residential

Available to residential customers.

A100	General Purpose			
	<i>Single rate all times.</i>			
	- Standing charge	\$/customer pa		\$20.900
	- Unit rate	¢/kWh		5.210
A140	Time of Use			
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>			
	- Standing charge	\$/customer pa		\$34.000
	- Peak Unit rate	¢/kWh		6.300
	- Off Peak Unit rate	¢/kWh		1.038
A180	Off Peak Heating Only			
	<i>11.00 PM to 7.00 AM all days.</i>			
	- Standing charge	\$/customer pa		\$0.000
	- Off Peak Unit rate	¢/kWh		1.038

Small Business

Available to customers:

- a) with annual consumption < 0.4 GWh AND maximum demand < 150 kVA (120 kW); and
- b) where supply is not taken from an on-site OR dedicated substation.

A200	General Purpose			
	Single rate all times.			
	- Standing charge	\$/customer pa		\$51.000
	- Unit rate	¢/kWh		5.851
A210	Time of Use Weekdays			
	Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.			
	- Standing charge	\$/customer pa		\$71.000
	- Peak Unit rate	¢/kWh		6.904
	- Off Peak Unit rate	¢/kWh		1.110
A230	Time of Use Weekdays - Demand			
	Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.			
	- Standing charge	\$/customer pa		\$48.000
	- Peak Unit rate	¢/kWh		3.616
	- Off Peak Unit rate	¢/kWh		1.113
	- Demand rate	\$/kW pa		\$38.189
	Minimum Chargeable Demand	60 kW		
A250	Time of Use Extended			
	Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.			
	- Standing charge	\$/customer pa		\$71.000
	- Peak Unit rate	¢/kWh		6.052
	- Off Peak Unit rate	¢/kWh		1.217

Customer Class	Code	Tariff Name	Units	Rate
	A270	Time of Use Extended - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$48.000
		- Peak Unit rate	¢/kWh	2.918
		- Off Peak Unit rate	¢/kWh	1.233
		- Demand rate	\$/kW pa	\$38.189
		Minimum Chargeable Demand	60 kW	
	A290	Unmetered Supply		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Peak Unit rate	¢/kWh	6.742
		- Off Peak Unit rate	¢/kWh	1.097

Large Business

Low Voltage Tariffs (nominal voltage < 1000 Volts)

Available to customers:

- a) with annual consumption ≥ 0.4 GWh OR maximum demand ≥ 150 kVA (120 kW); or
- b) taking supply from an on-site OR dedicated substation.

	A300	LV 0.4 - 0.8 GWh		
		Available to customers with annual consumption ≥ 0.4 GWh BUT ≤ 0.8 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,131.000
		- Peak Unit rate	¢/kWh	1.221
		- Off Peak Unit rate	¢/kWh	0.433
		- Demand rate	\$/kW pa	\$67.111
		Minimum Chargeable Demand	120 kW	
	A30M	LV_{MS} 0.4 - 0.8 GWh		
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is ≥ 0.4 GWh BUT ≤ 0.8 GWh.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$565.500
		- Peak Unit rate	¢/kWh	1.221
		- Off Peak Unit rate	¢/kWh	0.433
		- Demand rate	\$/kW pa	\$46.978
		Minimum Chargeable Demand	120 kW	
	A320	LV 0.8⁺ - 2.2 GWh		
		Available to customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,856.000
		- Peak Unit rate	¢/kWh	0.782
		- Off Peak Unit rate	¢/kWh	0.416
		- Demand rate	\$/kW pa	\$61.270
		Minimum Chargeable Demand	250 kW	

Customer Class	Code	Tariff Name	Units	Rate
A32M LV_{MS} 0.8* - 2.2 GWh				
Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 0.8 GWh BUT ≤ 2.2 GWh.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$928.000
	- Peak Unit rate		¢/kWh	0.782
	- Off Peak Unit rate		¢/kWh	0.416
	- Demand rate		\$/kW pa	\$42.890
	Minimum Chargeable Demand		250 kW	
A32R LV_{RF} 0.8* - 2.2 GWh				
Available to existing customers as at 31 Dec. 2001 with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh AND a Reserve Feeder connection.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$1,856.000
	- Peak Unit rate		¢/kWh	0.782
	- Off Peak Unit rate		¢/kWh	0.416
	- Demand rate		\$/kW pa	\$48.160
	Minimum Chargeable Demand		250 kW	
A340 LV 2.2* - 6.0 GWh				
Available to customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh.				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$2,842.000
	- Peak Unit rate		¢/kWh	0.716
	- Off Peak Unit rate		¢/kWh	0.305
	- Demand rate		\$/kW pa	\$60.057
	Minimum Chargeable Demand		250 kW	
A34M LV_{MS} 2.2* - 6.0 GWh				
Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 2.2 GWh BUT ≤ 6.0 GWh.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$1,421.000
	- Peak Unit rate		¢/kWh	0.716
	- Off Peak Unit rate		¢/kWh	0.305
	- Demand rate		\$/kW pa	\$42.041
	Minimum Chargeable Demand		250 kW	

Customer Class	Code	Tariff Name	Units	Rate
----------------	------	-------------	-------	------

A34R LV_{RF} 2.2⁺ - 6.0 GWh

Available to existing customers as at 31 Dec. 2001 with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh AND a Reserve Feeder connection.*

Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.

- Standing charge	\$/customer pa	\$2,842.000
- Peak Unit rate	¢/kWh	0.716
- Off Peak Unit rate	¢/kWh	0.305
- Demand rate	\$/kW pa	\$46.947
Minimum Chargeable Demand	250 kW	

A370 LV 6.0⁺ GWh

Available to customers with annual consumption > 6.0 GWh.

Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.

- Standing charge	\$/customer pa	\$3,701.000
- Peak Unit rate	¢/kWh	0.697
- Off Peak Unit rate	¢/kWh	0.265
- Demand rate	\$/kW pa	\$57.755
Minimum Chargeable Demand	450 kW	

A37M LV_{MS} 6.0⁺ GWh

Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 6.0 GWh.*

Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.

- Standing charge	\$/customer pa	\$1,850.500
- Peak Unit rate	¢/kWh	0.697
- Off Peak Unit rate	¢/kWh	0.265
- Demand rate	\$/kW pa	\$40.429
Minimum Chargeable Demand	450 kW	

A37R LV_{RF} 6.0⁺ GWh

Available to existing customers as at 31 Dec. 2001 with annual consumption > 6.0 GWh AND a Reserve Feeder connection.*

Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.

- Standing charge	\$/customer pa	\$3,701.000
- Peak Unit rate	¢/kWh	0.697
- Off Peak Unit rate	¢/kWh	0.265
- Demand rate	\$/kW pa	\$44.645
Minimum Chargeable Demand	450 kW	

Customer Class	Code	Tariff Name	Units	Rate
High Voltage Tariffs (nominal voltage ≥ 1000 Volts AND $\leq 22,000$ Volts)				
A400	HV			
Available to customers with annual consumption < 55 GWh				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$1,971.000
- Peak Unit rate		¢/kWh		0.559
- Off Peak Unit rate		¢/kWh		0.130
- Demand rate		\$/kW pa		\$48.006
Minimum Chargeable Demand		1,000 kW		
A40R	HV _{RF}			
Available to existing customers as at 31 Dec. 2001 with annual consumption < 55 GWh AND a Reserve Feeder connection.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$1,971.000
- Peak Unit rate		¢/kWh		0.559
- Off Peak Unit rate		¢/kWh		0.130
- Demand rate		\$/kW pa		\$34.896
Minimum Chargeable Demand		1,000 kW		
A480	HV - Annual Consumption ≥ 55 GWh			
Available to customers with annual consumption ≥ 55 GWh				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$1,964.000
- Peak Unit rate		¢/kWh		0.538
- Off Peak Unit rate		¢/kWh		0.094
- Demand rate		\$/kW pa		\$44.603
Minimum Chargeable Demand		10,000 kW		

Customer Class	Code	Tariff Name	Units	Rate
Subtransmission Tariffs (nominal voltage > 22,000 Volts)				
	A500	Subtransmission		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$14,807.000
		- Peak Unit rate	¢/kWh	0.076
		- Off Peak Unit rate	¢/kWh	0.011
		- Demand rate	\$/kW pa	\$12.525
		Minimum Chargeable Demand	15,000 kW	
	A50A	Subtransmission MA		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$14,807.000
		- Peak Unit rate	¢/kWh	0.076
		- Off Peak Unit rate	¢/kWh	0.011
		- Demand rate	\$/kW pa	\$12.525
		Minimum Chargeable Demand	15,000 kW	
	A50E	Subtransmission EG		
		Available to Embedded Generators connected to TTS-SSS-ST-EPG-TTS Loop.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$17,284.000
		- Peak Unit rate	¢/kWh	0.115
		- Off Peak Unit rate	¢/kWh	0.017
		- Demand rate	\$/kW pa	\$2.633
		Minimum Chargeable Demand	15,000 kW	

* Other terms and conditions apply

APPENDIX 3 TRANSMISSION TARIFFS FOR 2005 (EXCLUSIVE OF GST)

Customer Class	Code	Tariff Name	Units	Rate
Residential				
Available to residential customers.				
	A100	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$6.700
		- Unit rate	¢/kWh	0.709
	A140	Time of Use		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$15.700
		- Peak Unit rate	¢/kWh	1.201
		- Off Peak Unit rate	¢/kWh	0.461
	A180	Off Peak Heating Only		
		<i>11.00 PM to 7.00 AM all days.</i>		
		- Standing charge	\$/customer pa	\$0.000
		- Off Peak Unit rate	¢/kWh	0.461
Small Business				
Available to customers:				
a) with annual consumption < 0.4 GWh AND maximum demand < 150 kVA (120 kW); and				
b) where supply is not taken from an on-site OR dedicated substation.				
	A200	General Purpose		
		<i>Single rate all times.</i>		
		- Standing charge	\$/customer pa	\$14.000
		- Unit rate	¢/kWh	0.987
	A210	Time of Use Weekdays		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$65.000
		- Peak Unit rate	¢/kWh	1.362
		- Off Peak Unit rate	¢/kWh	0.368
	A230	Time of Use Weekdays - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$401.800
		- Peak Unit rate	¢/kWh	1.374
		- Off Peak Unit rate	¢/kWh	0.368
		- Demand rate	\$/kW pa	\$2.123
		Minimum Chargeable Demand	60 kW	
	A250	Time of Use Extended		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun"; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$65.000
		- Peak Unit rate	¢/kWh	1.092
		- Off Peak Unit rate	¢/kWh	0.468

Customer Class	Code	Tariff Name	Units	Rate
	A270	Time of Use Extended - Demand		
		<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$401.800
		- Peak Unit rate	¢/kWh	1.097
		- Off Peak Unit rate	¢/kWh	0.468
		- Demand rate	\$/kW pa	\$2.123
		Minimum Chargeable Demand	60 kW	
	A290	Unmetered Supply		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Peak Unit rate	¢/kWh	0.929
		- Off Peak Unit rate	¢/kWh	0.392

Large Business

Low Voltage Tariffs (nominal voltage < 1000 Volts)

Available to customers:

- a) with annual consumption ≥ 0.4 GWh OR maximum demand ≥ 150 kVA (120 kW); or
- b) taking supply from an on-site OR dedicated substation.

A300	LV 0.4 - 0.8 GWh			
		Available to customers with annual consumption ≥ 0.4 GWh BUT ≤ 0.8 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	
		- Peak Unit rate	¢/kWh	926.000
		- Off Peak Unit rate	¢/kWh	1.715
		- Demand rate	\$/kW pa	\$0.292
		Minimum Chargeable Demand	120 kW	0.800
A30M	LV_{MS} 0.4 - 0.8 GWh			
		Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is ≥ 0.4 GWh BUT ≤ 0.8 GWh.*		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$632.000
		- Peak Unit rate	¢/kWh	1.270
		- Off Peak Unit rate	¢/kWh	0.292
		- Demand rate	\$/kW pa	\$0.871
		Minimum Chargeable Demand	120 kW	
A320	LV 0.8* - 2.2 GWh			
		Available to customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$1,078.900
		- Peak Unit rate	¢/kWh	1.947
		- Off Peak Unit rate	¢/kWh	0.292
		- Demand rate	\$/kW pa	\$0.666
		Minimum Chargeable Demand	250 kW	

Customer Class	Code	Tariff Name	Units	Rate
A32M LV_{MS} 0.8* - 2.2 GWh				
Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 0.8 GWh BUT ≤ 2.2 GWh.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$935.200
	- Peak Unit rate		¢/kWh	1.719
	- Off Peak Unit rate		¢/kWh	0.292
	- Demand rate		\$/kW pa	\$0.733
	Minimum Chargeable Demand		250 kW	
A32R LV_{RF} 0.8* - 2.2 GWh				
Available to existing customers as at 31 Dec. 2001 with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh AND a Reserve Feeder connection.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$1,078.900
	- Peak Unit rate		¢/kWh	1.930
	- Off Peak Unit rate		¢/kWh	0.292
	- Demand rate		\$/kW pa	\$0.666
	Minimum Chargeable Demand		250 kW	
A340 LV 2.2* - 6.0 GWh				
Available to customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh.				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$4,615.900
	- Peak Unit rate		¢/kWh	1.948
	- Off Peak Unit rate		¢/kWh	0.244
	- Demand rate		\$/kW pa	\$1.279
	Minimum Chargeable Demand		250 kW	
A34M LV_{MS} 2.2* - 6.0 GWh				
Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 2.2 GWh BUT ≤ 6.0 GWh.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
	- Standing charge		\$/customer pa	\$3,690.700
	- Peak Unit rate		¢/kWh	1.609
	- Off Peak Unit rate		¢/kWh	0.244
	- Demand rate		\$/kW pa	\$1.353
	Minimum Chargeable Demand		250 kW	

Customer Class	Code	Tariff Name	Units	Rate
A34R	LV _{RF} 2.2 ⁺ - 6.0 GWh			
Available to existing customers as at 31 Dec. 2001 with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh AND a Reserve Feeder connection.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$4,615.900
- Peak Unit rate		¢/kWh		1.888
- Off Peak Unit rate		¢/kWh		0.244
- Demand rate		\$/kW pa		\$1.279
Minimum Chargeable Demand		250 kW		
A370	LV 6.0 ⁺ GWh			
Available to customers with annual consumption > 6.0 GWh.				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$4,661.300
- Peak Unit rate		¢/kWh		1.981
- Off Peak Unit rate		¢/kWh		0.244
- Demand rate		\$/kW pa		\$0.862
Minimum Chargeable Demand		450 kW		
A37M	LV _{MS} 6.0 ⁺ GWh			
Available to a customer taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 6.0 GWh.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$4,378.100
- Peak Unit rate		¢/kWh		1.884
- Off Peak Unit rate		¢/kWh		0.244
- Demand rate		\$/kW pa		\$1.385
Minimum Chargeable Demand		450 kW		
A37R	LV _{RF} 6.0 ⁺ GWh			
Available to existing customers as at 31 Dec. 2001 with annual consumption > 6.0 GWh AND a Reserve Feeder connection.*				
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.				
- Standing charge		\$/customer pa		\$4,661.300
- Peak Unit rate		¢/kWh		1.937
- Off Peak Unit rate		¢/kWh		0.244
- Demand rate		\$/kW pa		\$0.862
Minimum Chargeable Demand		450 kW		

Customer Class	Code	Tariff Name	Units	Rate
----------------	------	-------------	-------	------

High Voltage Tariffs (nominal voltage ≥ 1000 Volts AND $\leq 22,000$ Volts)

A400 HV

Available to customers with annual consumption < 55 GWh

Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.

- Standing charge	\$/customer pa	\$6,809.600
- Peak Unit rate	¢/kWh	1.819
- Off Peak Unit rate	¢/kWh	0.137
- Demand rate	\$/kW pa	\$7.738
Minimum Chargeable Demand	1,000 kW	

A40R HV_{RF}

Available to existing customers as at 31 Dec. 2001 with annual consumption < 55 GWh

AND a Reserve Feeder connection.*

Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.

- Standing charge	\$/customer pa	\$6,809.600
- Peak Unit rate	¢/kWh	1.819
- Off Peak Unit rate	¢/kWh	0.137
- Demand rate	\$/kW pa	\$7.738
Minimum Chargeable Demand	1,000 kW	

A480 HV - Annual Consumption ≥ 55 GWh

Available to customers with annual consumption ≥ 55 GWh

Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times.

- Standing charge	\$/customer pa	\$7,076.100
- Peak Unit rate	¢/kWh	1.836
- Off Peak Unit rate	¢/kWh	0.133
- Demand rate	\$/kW pa	\$7.993
Minimum Chargeable Demand	10,000 kW	

Customer Class	Code	Tariff Name	Units	Rate
Subtransmission Tariffs (nominal voltage > 22,000 Volts)				
	A500	Subtransmission		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$18,831.500
		- Peak Unit rate	¢/kWh	1.523
		- Off Peak Unit rate	¢/kWh	0.083
		- Demand rate	\$/kW pa	\$4.899
		Minimum Chargeable Demand	15,000 kW	
	A50A	Subtransmission MA		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$18,831.500
		- Peak Unit rate	¢/kWh	1.470
		- Off Peak Unit rate	¢/kWh	0.083
		- Demand rate	\$/kW pa	\$4.899
		Minimum Chargeable Demand	15,000 kW	
	A50E	Subtransmission EG		
		Available to Embedded Generators connected to TTS-SSS-ST-EPG-TTS Loop.		
		<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>		
		- Standing charge	\$/customer pa	\$18,189.100
		- Peak Unit rate	¢/kWh	1.573
		- Off Peak Unit rate	¢/kWh	0.083
		- Demand rate	\$/kW pa	\$3.291
		Minimum Chargeable Demand	15,000 kW	

* Other terms and conditions apply