



Jemena Electricity Networks (Vic) Ltd

Annual Network Tariff Report for 2008 Calendar Year

October 2007

Contacts

Inquiries relating to this Report may be directed to:

- Jemena Electricity Networks (Vic) Ltd
C/- Nabil Chemali
Manager Commercial Strategy & Performance
GPO Box 2982,
Melbourne VIC 3001
Telephone: 03 9201 7603
Fax: 03 9201 7602

or

- Essential Services Commission, Victoria
2nd Floor, 35 Spring Street
MELBOURNE VIC 3000
Telephone: 03 9651 0222
Fax: 03 9651 3688
E-mail: reception@esc.vic.gov.au
Website: www.esc.vic.gov.au

Table of Contents

1	CURRENT TARIFFS.....	1
1.1	Regulatory Arrangements.....	1
2	DESCRIPTION OF PROPOSED TARIFFS	3
2.2	Parent Tariff and Sub Categories	4
2.3	Expected Changes in Tariffs.....	5
2.4	How Each Tariff Meets Upper & Lower Bounds.....	5
2.5	Future Investment Requirements.....	6
2.6	Excluded Service Charges and Prescribed Metering Service Tariffs	7
2.7	Re-assignments of Tariffs.....	7
2.8	Contract Demand Based Charges.....	8
3	USAGE & QUANTITY INFORMATION	9
3.1	Usage and Customer Numbers	9
3.2	Future Network Constraints.....	9
4	ANNUAL ADJUSTMENT VARIABLES	11
4.1	Adjustment Variables	11
4.2	Impact of Application of Adjustment Variables	11
5	RATIONALE FOR AMENDMENT.....	29
6	CONSULTATION	29
	APPENDIX 1 PROPOSED NETWORK TARIFFS FOR 2008 (EXCLUSIVE OF GST)	
		30
	APPENDIX 2 PROPOSED DISTRIBUTION TARIFFS FOR 2007 (EXCLUSIVE OF GST)	
		37
	APPENDIX 3 PROPOSED TRANSMISSION TARIFFS FOR 2008 (EXCLUSIVE OF GST).....	43
	APPENDIX 4 EXCLUDED SERVICE CHARGES	49
	APPENDIX 5 PROPOSED PRESCRIBED METERING SERVICES CHARGES FOR 2008 (EXCLUSIVE OF GST)	59

1 CURRENT TARIFFS

1.1 Regulatory Arrangements

The Essential Services Commission, Victoria (Commission) has been established as an independent economic jurisdictional regulator, with the primary objective to protect the long term interests of Victorian consumers with regard to the price, quality and reliability of essential services.

The legal framework within which the Commission operates includes the Essential Services Act 2001, the Electricity Act 2000, and the Tariff Order. The Essential Services Act requires the Commission to promote competitive market conduct, prevent misuse of monopoly or market power, facilitate entry into the relevant market, facilitate efficiency in regulated industries and ensure that users and consumers benefit from competition and efficiency.

Network tariffs incorporate the rates that apply to the customer's usage in order to calculate the charges payable to the distributor by the customer's retailer. They are the aggregate of two sets of tariffs namely Distribution Use of System (DUoS) and Transmission tariffs¹. DUoS tariffs are designed to recover the cost of distribution through the electricity network, whereas Transmission tariffs are designed to recover specific pass through costs incurred by the distributor to be passed through to customers. These 'Pass Through Costs' include:

- Transmission use of system (TUoS) charges payable to VenCorp for each calendar year;
- Prescribed connection and excluded services transmission charges payable to SP AusNet for each calendar year;
- Payments to embedded generators during each calendar year; and
- Revenue earned for the calendar year from other distributors in respect of inter-network provider distribution service tariffs net of similar charges the distributor expects to pay other distributors during the same period.

DUoS and Transmission tariffs are subject to separate price controls as set out in the Electricity Distribution Price Review 2006-2010 Final Decision Volume 2 (Price Determination).

In addition when proposing tariffs², the distributor must have regard to the following pricing principles:

1. each tariff should be above the avoidable cost of serving the customers assigned to that tariff;
2. each tariff should be below the cost of providing the service on a stand alone basis to customers assigned to that tariff; and
3. each tariff should signal the impact of additional usage on future investment costs.

¹ For example if for a given tariff the DUoS rate is 5 ¢/unit and the Transmission rate is 2 ¢/unit then the network tariff rate would be 7 ¢/unit.

² Unless otherwise stated the term tariff means distribution tariff and transmission tariff

In its Price Determination³, the Commission placed an obligation on each distributor to prepare and publish a public Annual Tariff Report, by no later than 40 business days prior to the end of the preceding calendar year. The report must conform to the template described in Attachment 10 of the Price Determination containing the following sections:

- Section 1: Current Tariffs;
- Section 2: Usage/quantity information;
- Section 3: Annual adjustment variables;
- Section 4: Rationale for amendment;
- Section 5: Consultation.

This report details the proposed tariffs applicable to customers connected to the Jemena Electricity Networks (Vic) electricity network for the calendar year 2008. These tariffs are yet to be approved by the Commission and therefore should be used as a guide only. The approved tariffs will be published on the following website address:

<http://www.jemena.com.au/operations/distribution/JEN/>

³ Electricity Distribution Price 2006-10 Final Decision Volume 2 Price Determination, Clause 2.3.18, Essential Services Commission, Victoria, October 2005.

2 DESCRIPTION OF PROPOSED TARIFFS

2.1.1 Tariff Structures

JEN has adopted the following three tariff structures:

- a) **General Purpose** – single rate tariff (¢/kWh) applicable for all times of the day with a fixed charge (known as a standing charge). This tariff generally applies to customers that have a single rate accumulation meter and consume small amounts of electricity, such as residential customers, farms, etc.
- b) **Time of Use** – two rate tariff (¢/kWh) applicable to peak and off-peak periods with a standing charge. This tariff is applicable to ‘Residential’ customers that have an interval meter and ‘Small Business’⁴ customers that have either a two rate accumulation meter or an interval meter; and
- c) **Time of Use Demand** – two rate tariff (¢/kWh) applicable to peak and off-peak periods, a demand charge (\$/kW pa) and a fixed charge. This tariff is applicable to ‘Large Business’ customers and ‘Small Business’ customers that have a meter capable of measuring demand.

The tariff structures have been made simple to meet the capability of the meters installed at the customers’ premises and also to ensure they are comprehensible by customers so that they can react to tariff signals. While conflicts may arise between cost reflectivity and simplicity, JEN is of the view that customers react better to simple and stable tariff structures than to complicated tariff structures. As a result JEN has not changed its network tariff structures over the years.

2.1.2 Tariff Categories

JEN tariffs are grouped into the following three categories:

- a) **Residential** (Tariff Code starting with A1XX) – This category includes four network tariffs designed to meet the needs of residential customers.
- b) **Small Business (SB)** (Tariff Code starting with A2XX) – This category refers to low voltage customers:
 - consuming an annual amount of electricity less than 400 MWh⁵;
 - having a maximum demand of less than 120 kW; and
 - where supply is not taken from an on-site or dedicated substation.

Unmetered supply is also included in this category. JEN offers five ‘Small Business’ tariffs, including two demand tariffs, to meet the needs of customers belonging to this category. Customers are encouraged to assess their usage and load pattern in order to determine the network tariff that best meets their needs; and

⁴ Section 1.2.2 describes the term “Small Business”

⁵ One MWh is equivalent to 1,000 kWh

c) **Large Business (LB)** – This category refers to:

- subtransmission customers (Tariff Code starting with A5XX);
- high voltage customers (Tariff Code starting with A4XX); and
- low voltage customers (Tariff Code starting with A3XX):
 - consuming an annual amount of electricity greater than or equal to 400 MWh; or
 - having a maximum demand greater than or equal to 120 kW; or
 - where supply is taken from an on-site or dedicated substation.

Within the high voltage and low voltage tariff categories customers are assigned to tariffs based on their load characteristics. For example, a high voltage customer consuming less than 50 GWh⁶ pa would be assigned to tariff A400. Similarly, a low voltage non-embedded network customer consuming an amount of electricity greater than 6 GWh pa would be assigned to tariff A370.

The published annual tariff schedule, as approved by the Commission, clearly defines each category in terms of the customer's load and connection characteristics and where applicable the metering requirements. In addition, it describes the criterion applicable to each tariff. JEN consistently uses the tariff category and criterion in order to assign or re-assign customers to the appropriate tariff to provide equity between customers.

Customers are encouraged to assess their annual usage on a regular basis to determine whether they are entitled to change their tariff and take advantage of the different rates available.

The full details of tariff names, codes and rates are in Appendix 1, 2 and 3 of this report. These proposed tariffs were submitted to the Commission on 1st November 2007 and when approved will be effective from 1 January 2008.

2.2 Parent Tariff and Sub Categories

JEN uses a system of parent tariff categories with sub categories for some parent tariffs. A list of the parent tariff categories and sub categories is provided in Table 2-1.

Table 2-1 Parent tariff categories and Sub Categories

Tariff Category	Parent tariff	Sub category tariff
Residential	A100	- A10I
	A140	
	A180	
Small Business	A200	
	A210	
	A230	
	A250	
	A270	

⁶ One GWh is equivalent to 1,000 MWh

Tariff Category	Parent tariff	Sub category tariff
Large Business	A290	
	A300	- A30E
	A320	- A32E
	A340	- A34E - A34M
	A370	- A37E - A37M
	A400	- A40E - A40R - A42E
	A480	
	A500	- A50A - A50E

The tariff naming system uses an alpha numeric code for the parent tariff and related sub categories. The parent tariff codes begin with the letter A followed by three numerals for example A100, A180. The sub categories for each parent tariff replace the last numeral of the parent tariff with an alpha character defining the sub category.

2.3 Expected Changes in Tariffs

Tariff Structure:

JEN has not changed the structure of its tariffs for 2008. However, with respect to the new embedded network tariffs, which were introduced in 2007, the standing charge of each tariff has been set to a level above zero, as explained in the 2007 Annual Tariff report⁷.

2.4 How Each Tariff Meets Upper & Lower Bounds

JEN is required under Clause 2.3.16(i) of the Price Determination to demonstrate that its distribution tariffs are economically efficient by illustrating that its distribution prices fall within a cost window bounded by the following lower and upper bounds:

- Lower bound* – The Commission defined the lower bound, with regards to a specific distribution tariff, as being the avoidable cost of serving distribution customers assigned to that distribution tariff; and
- Upper bound* – The Commission defined the upper bound, with regards to a specific distribution tariff, as being the cost of providing the service on a stand-alone basis to distribution customers assigned to that distribution tariff.

The table below summarises the results for 2007 and demonstrates that JEN's average distribution prices for 2007 fall within the avoidable and stand-alone costs and therefore are economically efficient.

⁷ Refer to AGLE 2007 Annual Network Tariff Report, section 2.4, Tariff Structure, page 7.

Table 2-2 Economically efficient DUoS tariffs for 2008– Lower & Upper bounds

DUoS Tariff Code	Avoidable Cost (¢/kWh)	Average Price ⁸ (¢/kWh)	Stand alone Cost (¢/kWh)	Scale Index ⁹
A100 & A10I	1.695	5.747	8.673	58.1%
A140	0.685	3.678	8.673	37.5%
A180	0.409	1.063	8.673	7.9%
A200	2.057	6.423	6.906	90.0%
A210	0.935	5.064	6.906	69.2%
A230	0.883	4.004	6.906	51.8%
A250	1.025	5.457	6.906	75.4%
A270	0.882	4.336	6.906	57.3%
A290	0.460	3.444	6.906	46.3%
A300 & A30E	1.552	3.820	5.356	59.6%
A320 & A32E	0.916	2.756	5.356	41.4%
A340 & A34E	0.718	2.240	5.356	32.8%
A34M	0.718	2.973	5.356	48.6%
A370 & A37E	0.559	1.956	5.356	29.1%
A37M	0.559	1.970	5.356	29.4%
A400, A40E & A42E	0.783	1.840	4.009	32.8%
A40R	0.783	1.057	4.009	8.5%
A480	0.549	1.111	4.009	16.2%
A500 & A50A	0.288	0.298	1.580	0.8%

2.5 Future Investment Requirements

When proposing distribution tariffs JEN is required to consider future investment costs that may be required to cater for impact of additional usage by customers in various tariff categories. This requirement is outlined in the Commission's Final Determination Clause 2.3.16 (i) (c).

The analysis conducted by JEN's consultant (Cap Gemini/Ernst & Young) took future capital expenditure due to peak demand into account in calculating avoidable and standalone costs. The result of this analysis was a set of upper and lower bounds for each tariff category within which the average prices for each tariff category are required to fall. As demonstrated in section 2.4 the average price for all of JEN's proposed tariffs meet this criteria and are therefore considered to take into account future investment requirements.

⁸ Average prices were calculated by applying 2008 DUoS tariffs to 2006 quantities.

⁹ The scale index indicates the relative position of the average charge with respect to the avoidable and stand-alone costs. A scale index value of 0% denotes that the average charge is equal to the avoidable cost. A scale index of 100% indicates that the average charge is equal to the stand-alone cost.

2.6 Excluded Service Charges and Prescribed Metering Service Tariffs

2.6.1 Excluded Service Charges

JEN, under clauses 10.3 and 11.1 of the distribution licence must offer to provide excluded services for a charge and on terms and conditions that are fair and reasonable. The Commission regulates the maximum charge for such services set by distributors. However, customers may negotiate an alternate charge for an alternate level of service and for some services, there may be alternative service providers.

Excluded services include items such as: connection, field officer visits, provision of service fuses, elective underground services, covering of low voltage mains, service cable pulled down by high loads, public lighting, meter provision, meter data services, meter investigation, provision of a switching service, load profile for current transformer meters, load profile print out and miscellaneous charges. A description of each of these services, the standard terms and conditions and prices is included in Appendix 4.

2.6.2 Prescribed Metering Tariffs

Prescribed metering tariffs apply to:

- a) customers who consume less than 160 MWh per annum; and
- b) do not have an interval meter that is remotely read; or
- c) customers who have an unmetered supply.

JEN provides metering services to customers and these are divided into two main types: Metering provision; and Meter data services.

Metering Provision tariffs are based on a per meter annual charge for the various meter types including: Single phase non off peak meter; Single phase off peak meter; Three phase direct connect meter; and Three phase CT connected meter. Metering data services tariffs are based on a per NMI annual charge for monthly and quarterly read meters and a per light annual charge for unmetered supplies.

The 2008 prescribed metering tariffs are provided in Appendix 5 of this report.

2.7 Re-assignments of Tariffs

JEN does not intend to carry out tariff reassignments in 2008. Any tariff reassignments occurring during 2008 will be as a result of customer requests for tariff reassignment, which can be made by a customer at any time. All tariff reassignment requests must be made in writing using the appropriate form and must be sent to E-mail address LNSP@agility.net.au. Copy of the form can be downloaded from the following website:

<http://www.jemena.com.au/operations/distribution/JEN/>

2.8 Contract Demand Based Charges

Contract Demands¹⁰ are set for all customers assigned to or requesting to be assigned to a demand tariff. Once an initial contract demand is set the contract demand can permanently increase when the customer's Maximum Demand¹¹ exceeds its existing Contract Demand. The increase in Maximum Demand may result from a number of situations such as an increase in production, a change in equipment operation or the effect of weather conditions on the customer's load.

Customers who are able to manage their Maximum Demand are eligible to apply in writing for a Contract Demand reduction (reset). All Contract Demand reset applications are assessed in accordance with JEN Policy for Resetting Contract Demand. The policy describes the requirements which customers and their representatives¹² must comply with when requesting a review in the customer's Contract Demand at a particular supply point, how JEN will respond to such requests, and generally how a customer's Contract Demand may vary from time to time. The policy outlines how JEN, customers and their representatives implement:

- a permanent increase in the Customer's Contract Demand;
- a temporary increase in the Customer's Contract Demand; and
- a permanent decrease in the Customer's Contract Demand.

The policy was communicated to all Retailers in June 2003. The Retailers were also advised to distribute the policy to their customers who are connected to JEN distribution network. The policy and a Contract Demand Reset application form is published on and can be downloaded from the following website:

<http://www.jemena.com.au/operations/distribution/JEN/>

During the 2006 calendar year, 618 customers had their contract demand reset.

¹⁰ Contract Demand means the kW (or kVA) demand used to calculate the demand charge component of the tariff in each billing period. Contract demand is always greater than or equal to the Maximum Demand.

¹¹ In relation to a billing period, Maximum Demand is the demand calculated as being the highest energy consumption in kWh recorded over any 15-minute period multiplied by four.

¹² mean the Retailer, consultant, administrator, liquidator or third party contractor acting on the customer's behalf.

3 USAGE & QUANTITY INFORMATION

3.1 Usage and Customer Numbers

The number of customers served and quantity energy consumed by customers under each tariff code is provided in the table below. For tariffs with less than 10 customers these quantities have been aggregated into one line titled "Other". Actual quantities are provided for calendar year 2006, estimates for 2007 and forecasts for 2008.

Table 3-1 Usage and customer numbers by tariff code

	<i>Actual</i>		<i>Estimate</i>		<i>Forecast</i>	
	2006 calendar year		2007 calendar year		2008 calendar year	
	Customer Number	Energy GWh	Customer Number	Energy GWh	Customer Number	Energy GWh
A100	257,541	1,103	261,747	1,113	265,231	1,124
A10I	0	0	0	0	871	4
A140	1,916	17	2,042	18	2,042	19
A180	28,139	83	21,047	79	19,448	78
A200	12,680	125	11,681	125	11,492	125
A210	15,373	427	17,389	445	17,749	460
A230	191	56	216	60	224	61
A250	4,933	99	5,229	99	5,639	100
A270	96	26	107	30	110	31
A290	-	82	-	76	-	78
A300	437	247	472	256	476	256
A320	219	312	227	318	225	319
A340	92	294	94	293	92	294
A34M	15	26	17	29	17	29
A370	15	110	16	127	15	120
A37M	16	56	18	60	18	61
A400	69	544	65	560	64	549
Other	12	673	18	673	21	698

3.2 Future Network Constraints

JEN publishes an annual planning report which details how JEN plans to meet predicted demand for electricity supplied through its network over the following five calendar years. The report is available to the public via the JEN website¹³ and complies with clause 3.5 of the Victorian Electricity Distribution Code. The planning report is based on the information and estimates available at the time the report is prepared and is subject to review annually.

The 2005 JEN Planning Report indicates that during five years 2007 -2011, the JEN network has adequate capacity to meet anticipated maximum demand, even under extreme summer conditions. There is, however, a risk of inadequate supply capacity in some parts of the network if there is simultaneous occurrence of extreme summer temperatures and unexpected outage of critical plant.

¹³ <http://www.jemena.com.au/operations/distribution/JEN/>

JEN has a risk management system in place, which assesses the risk of supply failures. Augmentations are planned for those parts of the network where the risks justify the costs of augmentation. The summary tables in the planning report give the magnitude and probability of loss of load for zone substation and subtransmission line outage conditions. For those parts of the network where the risk is very low, contingency plans are in place to minimise adverse impacts on customers.

The planning report describes the preferred options of zone substation and line augmentation projects, which are required to increase the capacity of the network to meet the increasing customer demand and / or maintain adequate supply reliability. Table 3-2 shows major augmentation projects, planned for the next five years, to relieve the supply capacity constraints under plant or line outage conditions. Details regarding the consideration of options, selection of the preferred network solution and estimated costs for these projects is contained in the Network Planning Report.

Table 3-2 Energy and hours at risk per annum for a transformer or subtransmission line outage, with preferred network solution

	Year	MWh at risk ¹⁴	Hours at risk	Expected unserved MWh ¹⁵	Preferred network solution
Zone Substation ST	2007	414	90	2.7	New Zone Substation COO planned early 2007.
TTS-NEI-NH-WT-TTS	2007	250	57	0.1	Part re-conductor.
Zone Substation SBY	2008	516	167	2.2	New Zone Substation SHM planned early 2008.
BD 22kV Network & Zone Substation BD	2010 (tentative)	Risk assessment pending additional information.			New Zone Substation BMS
KTS-MAT-AW-PV-KTS 66 kV loop	2011 (tentative)	597	86	0.2	Part re-conductor of KTS-AW lines.
Zone Substation ST & ST 22kV Network	2011 (tentative)	Risk assessment pending additional information.			Install 2 nd COO transformer & re-arrange 22kV network.

Note: Details of abbreviations for station names referred to in this table are provided in the Annual Planning Report.

Contributions in the form of annual network support payments are available from JEN to proponents of non-network alternatives if they defer or avoid augmentations of JEN's distribution systems. Accordingly proponents of non-network alternatives, such as embedded generation or demand management are invited to discuss their proposals with JEN.

¹⁴ Energy and hours at risk apply to the following year if augmentation does not take place.

¹⁵ The expected unserved MWh takes into account the probability of an outage occurring during the peak demand period.

4 ANNUAL ADJUSTMENT VARIABLES

4.1 Adjustment Variables

The adjustment variables used by JEN in the tariff setting process include the Consumer Price Index (CPI), the service incentive mechanism “S” factor, the licence fee “L” factor, the “X” factor¹⁶ and the “Z” factor¹⁷. The CPI, S, L and X factors are used in setting DUoS prices, whereas the CPI and the Z factor are used in setting Transmission prices. The values for these variables for the 2008 calendar year are shown in Table 4-1

Table 4-1 Adjustment Variables

Adjustment Variable	Value for 2008
CPI	1.86%
S factor	100.0%
L factor	99.9%
X factor	2.5%
Z factor	2.1%

4.2 Impact of Application of Adjustment Variables

Tariff Prices:

The 2008 tariffs have changed in accordance with the requirements of the Commission's Final Determination. A summary of the percentage change in the DUoS and Transmission tariffs for each tariff category is provided in Table 1-2.

Table 4-2 Percentage Change in DUoS and Transmission Tariffs

Tariff	DUoS tariffs	Transmission tariffs
A100	-0.81%	-1.62%
A10I	-0.81%	-1.62%
A140	-0.81%	-1.57%
A180	-0.75%	-1.08%
A200	-0.69%	-1.25%
A210	-0.84%	-1.36%
A230	-0.55%	-1.43%

¹⁶ The X factor is an adjustment mechanism that aligns a distributor's current average tariff level with the average tariff level established by the Commission


¹⁷ The Z factor is an adjustment mechanism to allow the distributor to recover the annual increases in its 'Pass Through Costs' up to a limit of 18%

Tariff	DUoS tariffs	Transmission tariffs
A250	-0.84%	-1.41%
A270	-0.54%	-1.45%
A290	-0.74%	-1.60%
A300	-0.80%	-1.57%
A30E	-0.62%	-1.52%
A320	-0.73%	-1.61%
A32E	-0.54%	-1.63%
A340	-0.71%	-1.51%
A34E	-0.55%	-1.56%
A34M	-0.67%	-1.50%
A370	-0.70%	-1.47%
A37E	-0.79%	-1.43%
A37M	-0.71%	-1.37%
A400	-0.72%	-1.64%
A40E	-0.76%	-1.65%
A40R	-0.84%	-1.62%
A42E	-0.61%	-1.69%
A480	-0.71%	-1.49%
A500	3.37%	-1.93%
A50A	3.40%	-2.24%
A50E	-0.68%	-2.46%

Price Comparisons:

The sections below provide a brief description of individual tariffs and assess the impact of 2008 network tariffs on customers¹⁸ by using five usage levels per network tariff namely *very low*, *low*, *average*, *high* and *very high*. The *average* consumption is calculated by dividing forecast energy by the number of customers. Once the average consumption is calculated the other four usage levels can be derived by applying a percentage to the *average* usage as shown below.

Figure 4-1 Usage Levels as a Percentage of Average Consumption

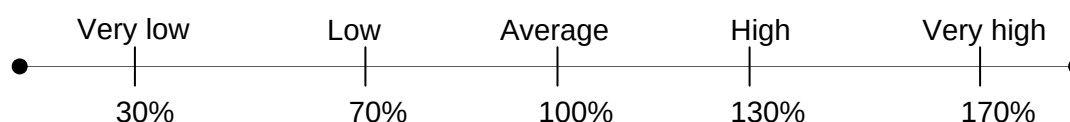

To assess the impact of demand based tariffs on customers it is necessary to assume a load factor to estimate the customer's chargeable demand. The demand charge is then applied to the higher of the estimated value or the tariff's minimum chargeable demand.

¹⁸ Where the number of customers assigned to a given tariff is less than 6 customers no comparison has been provided for that tariff.

4.2.1 Residential – General Purpose (A100)


This is a single rate tariff applicable to residential customers.

A comparison of the 2007 and 2008 'Residential – General Purpose' network tariff charges for the five usage levels is shown below.


	Very Low 1,272 kWh	Low 2,967 kWh	Average 4,239 kWh	High 5,510 kWh	Very high 7,206 kWh
2007	\$97	\$199	\$275	\$352	\$453
2008	\$96	\$197	\$273	\$349	\$450
Change	-1.7%	-1.1%	-0.9%	-0.8%	-0.7%

The reduction in the network tariff charge varies from 1.7% to 0.7% depending on usage level, with smaller users experiencing a larger percentage decrease than large users.

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user.

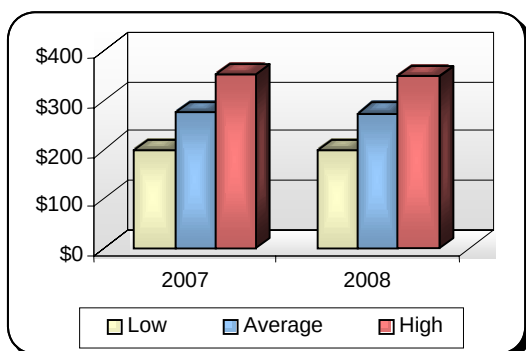

**Network Tariff charge comparison
2007 vs 2008.**

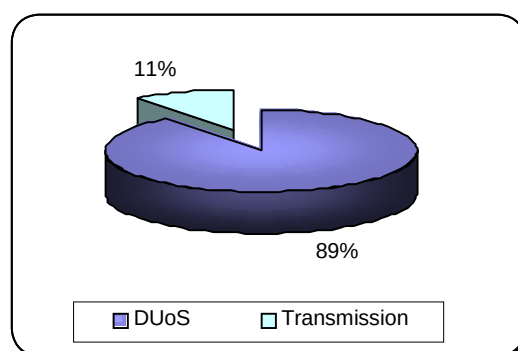

**2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

4.2.2 Residential – Time of Use (A140)

This tariff has been closed to new entrants effective from 1 January 2007. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.


A comparison of the 2007 and 2008 'Residential – Time of Use' network tariff charges for the five usage levels is shown below.

Peak to Total Energy Ratio: 30%					
	Very Low 2,767 kWh	Low 6,457 kWh	Average 9,224 kWh	High 11,991 kWh	Very high 15,680 kWh
2007	\$129	\$253	\$347	\$440	\$564
2008	\$127	\$250	\$343	\$436	\$559
Change	-1.9%	-1.2%	-1.0%	-0.9%	-0.8%


Peak to Total Energy Ratio: 50%					
	Very Low 2,767 kWh	Low 6,457 kWh	Average 9,224 kWh	High 11,991 kWh	Very high 15,680 kWh
2007	\$162	\$329	\$455	\$581	\$749
2008	\$159	\$326	\$451	\$576	\$743
Change	-1.6%	-1.0%	-0.9%	-0.8%	-0.7%

The above tables indicate that the reduction in the network tariff charge varies from 1.9% to 0.7% depending on customers' consumption and load patterns.

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 30%.

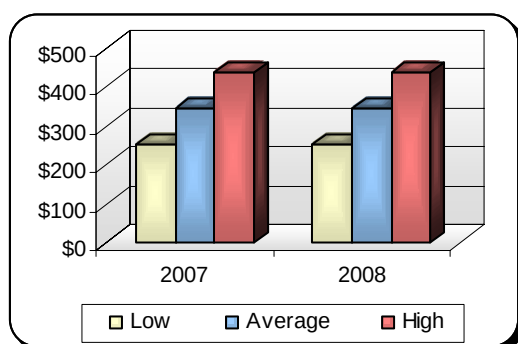

Network Tariff charge comparison
2007 vs 2008.

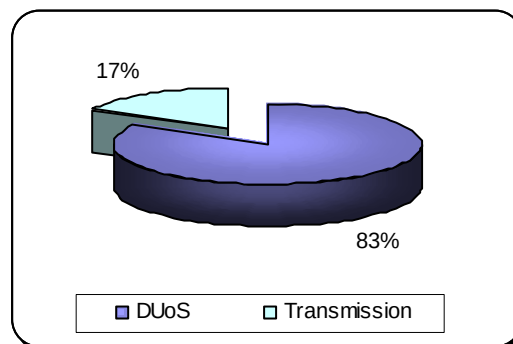

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.


4.2.3 Residential – Off Peak Heating Only (A180)

This is a complementary tariff to the ‘Residential – General Purpose’ network tariff. It relates to controlled loads such as storage water heating and space heating.


A comparison of the 2007 and 2008 ‘Residential – Off Peak Heating Only’ network tariff charges for the five usage levels is shown below.

	Very Low 1,207 kWh	Low 2,817 kWh	Average 4,024 kWh	High 5,231 kWh	Very high 6,841 kWh
2007	\$17	\$41	\$58	\$75	\$99
2008	\$17	\$40	\$58	\$75	\$98
Change	-0.8%	-0.8%	-0.8%	-0.8%	-0.8%

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user.

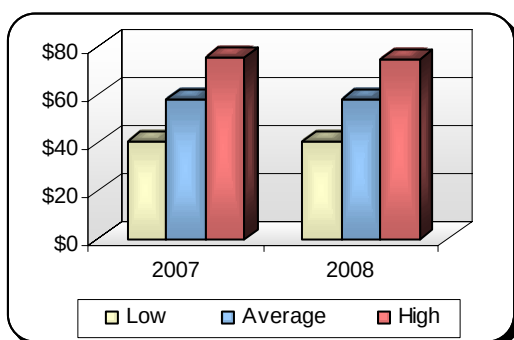

**Network Tariff charge comparison
2007 vs 2008.**

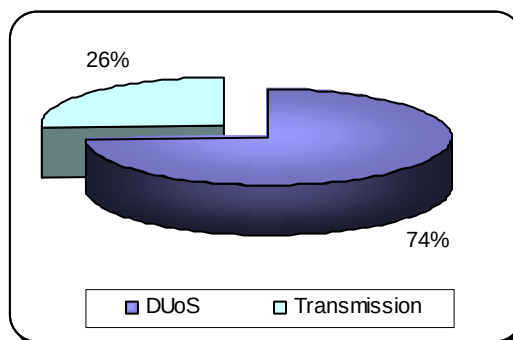

**2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

4.2.4 Small Business – General Purpose (A200)


This is a single rate tariff applicable to 'Small Business' customers. This single rate tariff will only be available to customers with a single rate accumulation meter.

A comparison of the 2007 and 2008 'Small Business – General Purpose' network tariff charges for the five usage levels is shown below.


	Very Low 3,266 kWh	Low 7,620 kWh	Average 10,886 kWh	High 14,151 kWh	Very high 18,506 kWh
2007	\$277	\$575	\$799	\$1,023	\$1,321
2008	\$273	\$570	\$793	\$1,016	\$1,313
Change	-1.3%	-0.8%	-0.7%	-0.7%	-0.6%

The reduction in network tariff charge varies between 1.3% and 0.6% depending on the consumption.

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user.

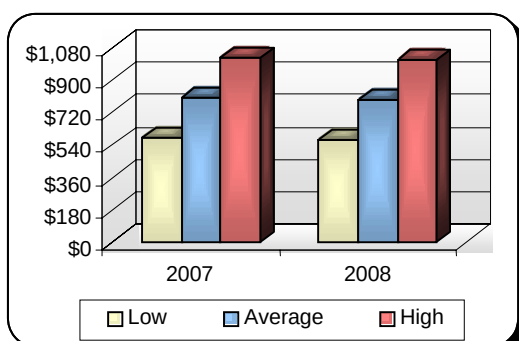

**Network Tariff charge comparison
2007 vs 2008.**

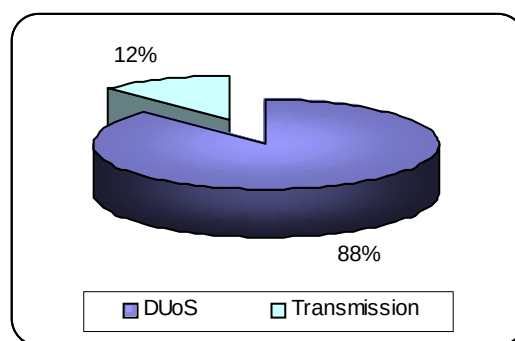

**2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

4.2.5 Small Business – Time of Use Weekdays (A210)

This is a two-rate tariff applicable to ‘Small Business’ customers. This tariff will only be available to customers who have a two-rate accumulation meter or consume less than 160MWh per annum and have a maximum demand of less than 60 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.


A comparison of the 2007 and 2008 ‘Small Business –Time of Use Weekdays’ network tariff charges for the five usage levels is shown below.

Peak to Total Energy Ratio: 40%					
	Very Low 7,772 kWh	Low 18,135 kWh	Average 25,907 kWh	High 33,679 kWh	Very high 44,041 kWh
2007	\$429	\$874	\$1,208	\$1,542	\$1,988
2008	\$420	\$863	\$1,195	\$1,528	\$1,970
Change	-1.9%	-1.2%	-1.1%	-0.9%	-0.9%


Peak to Total Energy Ratio: 70%					
	Very Low 7,772 kWh	Low 18,135 kWh	Average 25,907 kWh	High 33,679 kWh	Very high 44,041 kWh
2007	\$582	\$1,232	\$1,719	\$2,206	\$2,855
2008	\$573	\$1,219	\$1,703	\$2,187	\$2,833
Change	-1.6%	-1.1%	-0.9%	-0.8%	-0.8%

The reduction in charges varies from 1.9% to 0.8% depending on consumption and load patterns with smaller users experiencing a greater reduction than larger users.

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 70%.

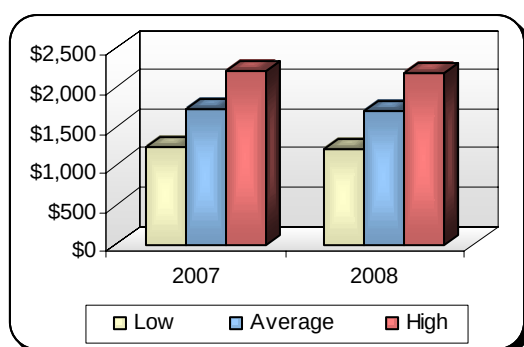

**Network Tariff charge comparison
2007 vs 2008.**

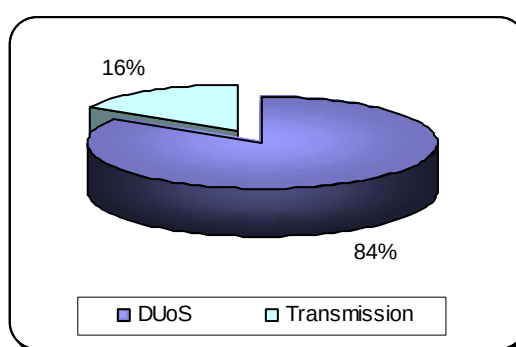

**2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.**

4.2.6 Small Business – Time of Use Weekdays Demand (A230)


This time of use demand based network tariff attracts a minimum chargeable demand of 60 kW and requires the installation of a meter capable of measuring demand. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2007 and 2008 'Small Business – Time of Use Weekdays Demand' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 40% Load factor 55%				
	Very Low 81,887 kWh	Low 191,069 kWh	Average 272,955 kWh	High 354,842 kWh	Very high ¹⁹ 464,024 kWh
2007	\$5,181	\$8,336	\$10,702	\$13,656	N/A
2008	\$5,144	\$8,277	\$10,627	\$13,560	N/A
Change	-0.7%	-0.7%	-0.7%	-0.7%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 81,887 kWh	Low 191,069 kWh	Average 272,955 kWh	High 354,842 kWh	Very high 464,024 kWh
2007	\$5,928	\$10,078	\$13,191	\$16,891	N/A
2008	\$5,884	\$10,003	\$13,093	\$16,766	N/A
Change	-0.7%	-0.7%	-0.7%	-0.7%	N/A

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 70% and the load factor is 55%.

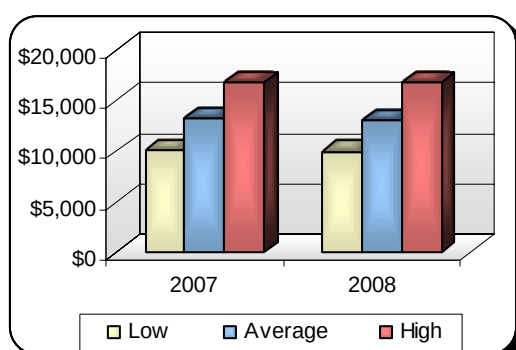

Network Tariff charge comparison
2007 vs 2008.

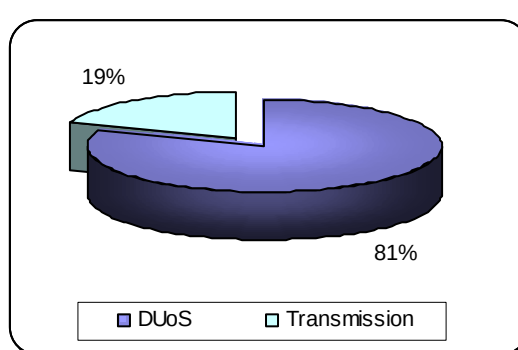

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

¹⁹ The "Very High" usage is not applicable for this tariff as the usage level is greater than 400,000 kWh, which is the threshold for the Small Business tariff category.

4.2.7 Small Business – Time of Use Extended (A250)

This is a two-rate tariff applicable to ‘Small Business’ customers. This tariff will only be available to customers who have a two-rate accumulation meter or consume less than 160MWh per annum and have a maximum demand of less than 60 kW. Unlike the previous two tariffs, the peak rate applies to the period 7.00 AM to 11.00 PM all days and the off-peak rate applies to all other times.


A comparison of the 2007 and 2008 ‘Small Business –Time of Use Extended’ network tariff charges for the five usage levels is shown below.

Peak to Total Energy Ratio: 60%					
	Very Low 5,304 kWh	Low 12,375 kWh	Average 17,679 kWh	High 22,982 kWh	Very high 30,054 kWh
2007	\$363	\$720	\$988	\$1,255	\$1,612
2008	\$355	\$710	\$977	\$1,243	\$1,599
Change	-2.1%	-1.3%	-1.1%	-0.9%	-0.8%


Peak to Total Energy Ratio: 80%					
	Very Low 5,304 kWh	Low 12,375 kWh	Average 17,679 kWh	High 22,982 kWh	Very high 30,054 kWh
2007	\$421	\$855	\$1,181	\$1,506	\$1,941
2008	\$413	\$845	\$1,169	\$1,493	\$1,926
Change	-1.9%	-1.2%	-1.0%	-0.9%	-0.8%

The reduction in charges varies from 1.2% to 0.8% depending on consumption and load patterns with smaller users experiencing a larger reduction than larger users.

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 80%.

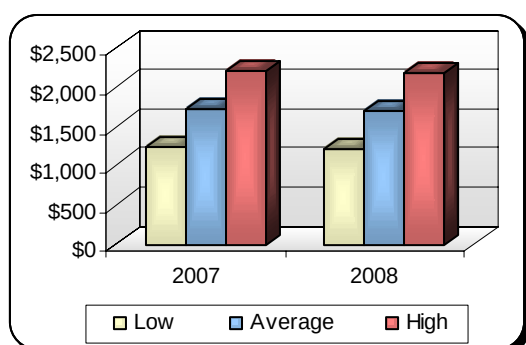

Network Tariff charge comparison
2007 vs 2008.

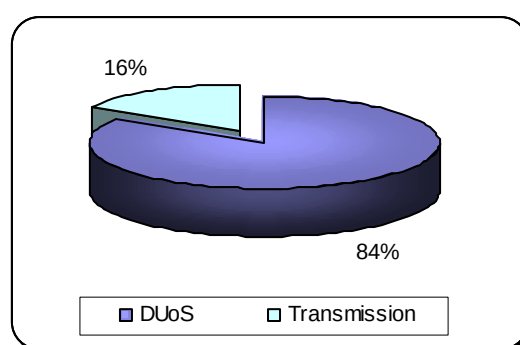

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

4.2.8 Small Business – Time of Use Extended Demand (A270)


This time of use demand based network tariff attracts a minimum chargeable demand of 60 kW and requires the installation of a meter capable of measuring demand. The peak rate applies to the period 7.00 AM to 11.00 PM all days and the off-peak rate applies to all other times.

A comparison of the 2007 and 2008 'Small business –Time of Use Extended Demand' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 60% Load factor 55%				
	Very Low 83,524 kWh	Low 194,890 kWh	Average 278,415 kWh	High 361,939 kWh	Very high 473,305 kWh
2007	\$5,347	\$8,722	\$11,254	\$14,436	N/A
2008	\$5,308	\$8,660	\$11,174	\$14,335	N/A
Change	-0.7%	-0.7%	-0.7%	-0.7%	N/A

	Peak to Total Energy Ratio: 80% Load factor: 55%				
	Very Low 83,524 kWh	Low 194,890 kWh	Average 278,415 kWh	High 361,939 kWh	Very high 473,305 kWh
2007	\$5,690	\$9,523	\$12,398	\$15,924	N/A
2008	\$5,648	\$9,454	\$12,309	\$15,809	N/A
Change	-0.7%	-0.7%	-0.7%	-0.7%	N/A

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 80% and the load factor is 55%.

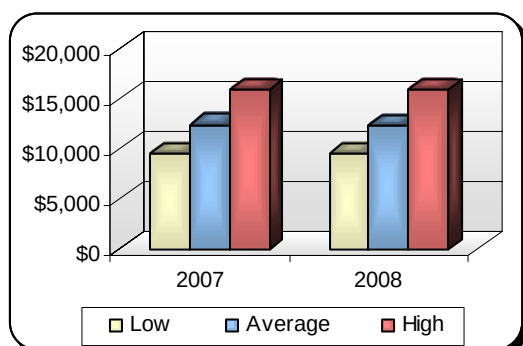

Network Tariff charge comparison
2007 vs 2008.

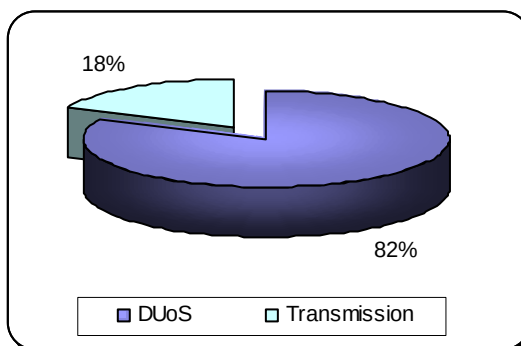

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

4.2.9 Large Business – LV 0.4 - 0.8 GWh (A300)


This is a time of use demand based network tariff applicable to LV commercial/industrial customers with annual consumption greater than or equal to 0.4 GWh but less than or equal to 0.8 GWh. It is also applicable to customers with an annual consumption less than 0.4 GWh but either having a maximum demand greater than or equal to 120 kW (150 kVA) or taking supply from an on-site or dedicated substation. The minimum chargeable demand is 120 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2007 and 2008 'Large Business – LV 0.4 – 0.8 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low	Low	Average	High	Very high
	161 MWh	377 MWh	538 MWh	700 MWh	915 MWh
2007	N/A	N/A	\$19,449	\$24,056	N/A
2008	N/A	N/A	\$19,303	\$23,871	N/A
Change	N/A	N/A	-0.7%	-0.8%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low	Low	Average	High	Very high
	161 MWh	377 MWh	538 MWh	700 MWh	915 MWh
2007	N/A	N/A	\$21,285	\$26,443	N/A
2008	N/A	N/A	\$21,022	\$26,106	N/A
Change	N/A	N/A	-1.2%	-1.3%	N/A

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 70% and the load factor is 55%.

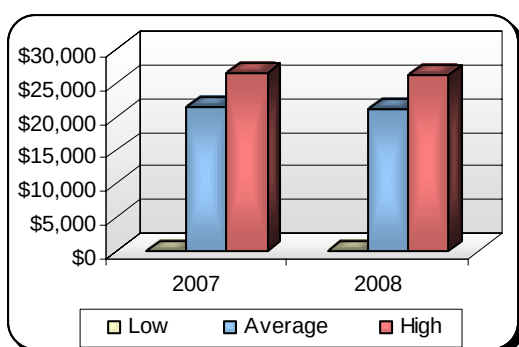

Network Tariff charge comparison
2007 vs 2008.

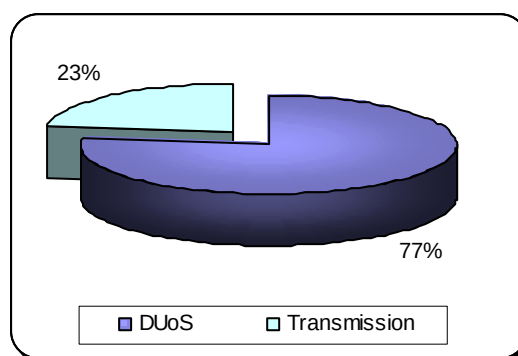

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

4.2.10 Large Business – LV 0.8⁺ - 2.2 GWh (A320)


This time of use demand based network tariff is applicable to LV commercial/industrial customers with annual consumption greater than 0.8 GWh but less than or equal to 2.2 GWh. The minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2007 and 2008 'Large Business – LV 0.8⁺ – 2.2 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 426 MWh	Low 994 MWh	Average 1,419 MWh	High 1,845 MWh	Very high 2,413 MWh
2007	N/A	\$34,447	\$43,831	\$56,128	N/A
2008	N/A	\$34,197	\$43,505	\$55,703	N/A
Change	N/A	-0.7%	-0.7%	-0.8%	N/A

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 426 MWh	Low 994 MWh	Average 1,419 MWh	High 1,845 MWh	Very high 2,413 MWh
2007	N/A	\$37,036	\$47,530	\$60,936	N/A
2008	N/A	\$36,586	\$46,917	\$60,139	N/A
Change	N/A	-1.2%	-1.3%	-1.3%	N/A

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 70% and the load factor is 55%.

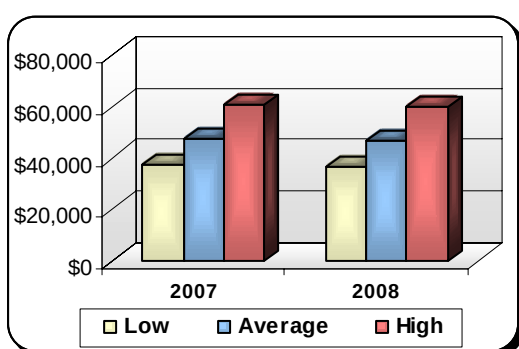

Network Tariff charge comparison
2007 vs 2008.

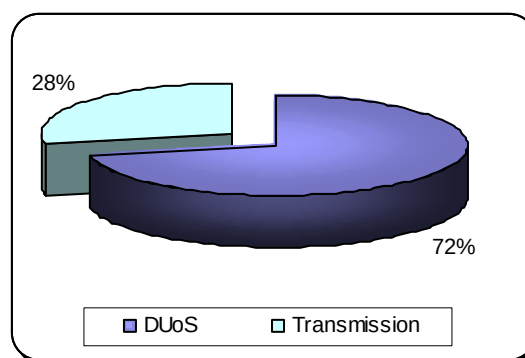

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

4.2.11 Large Business – LV 2.2⁺ - 6.0 GWh (A340)


This time of use demand based network tariff is applicable to large LV commercial/industrial customers with annual consumption greater than 2.2 GWh but less than or equal to 6.0 GWh. The minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2007 and 2008 'Large Business – LV 2.2⁺ – 6.0 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low	Low	Average	High	Very high
	960 MWh	2,240 MWh	3,201 MWh	4,161 MWh	5,441 MWh
2007	N/A	\$68,048	\$95,109	\$122,169	\$158,250
2008	N/A	\$67,535	\$94,390	\$121,246	\$157,053
Change	N/A	-0.8%	-0.8%	-0.8%	-0.8%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low	Low	Average	High	Very high
	960 MWh	2,240 MWh	3,201 MWh	4,161 MWh	5,441 MWh
2007	N/A	\$74,361	\$104,128	\$133,895	\$173,583
2008	N/A	\$73,382	\$102,744	\$132,106	\$171,255
Change	N/A	-1.3%	-1.3%	-1.3%	-1.3%

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 50% and the load factor is 55%.

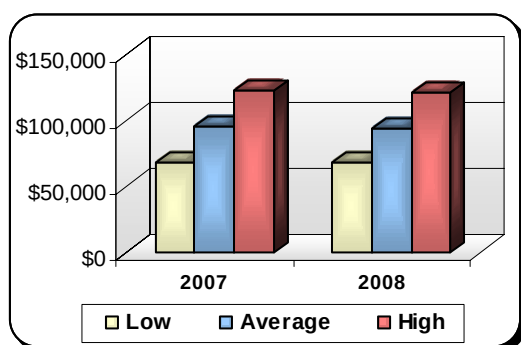

Network Tariff charge comparison
2007 vs 2008.

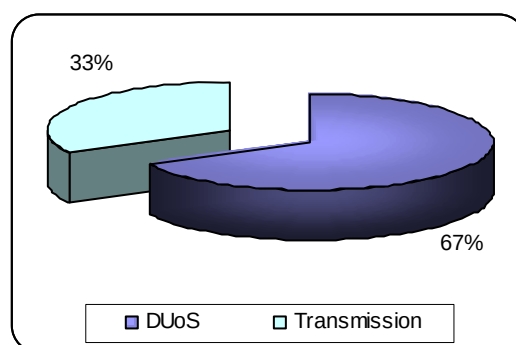

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

4.2.12 Large Business – LV_{MS} 2.2⁺ - 6.0 GWh (A34M)

This is a time of use demand based network tariff available to LV commercial/industrial customers, other than embedded network customers, taking supply from multiple supply points on a single site and the aggregated annual consumption from those supply points is greater than 2.2 GWh but less than or equal to 6.0 GWh. The aggregated minimum chargeable demand is 250 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

The terms and conditions for assignment to Multiple Supply ("MS") tariffs can be found at the following Website link:


<http://www.jemena.com.au/operations/distribution/JEN/>

A comparison of the 2007 and 2008 'Large Business – LVMS 2.2+ – 6.0 GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 1,039 MWh	Low 2,423 MWh	Average 3,462 MWh	High 4,501 MWh	Very high 5,885 MWh
2007	N/A	\$62,487	\$87,785	\$113,084	\$146,814
2008	N/A	\$62,172	\$87,338	\$112,504	\$146,059
Change	N/A	-0.5%	-0.5%	-0.5%	-0.5%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 1,039 MWh	Low 2,423 MWh	Average 3,462 MWh	High 4,501 MWh	Very high 5,885 MWh
2007	N/A	\$69,350	\$97,590	\$125,829	\$163,482
2008	N/A	\$68,594	\$96,512	\$124,431	\$161,656
Change	N/A	-1.1%	-1.1%	-1.1%	-1.1%

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 50% and the load factor is 55%.

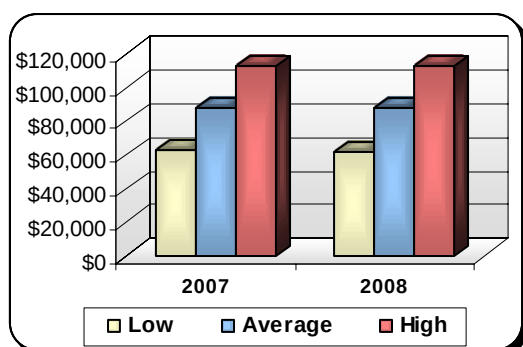

Network Tariff charge comparison
2007 vs 2008.

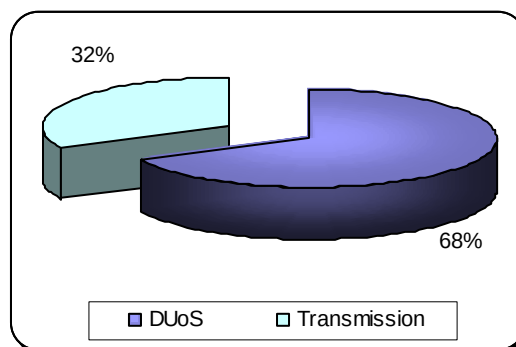

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

4.2.13 Large Business – LV 6.0⁺ GWh (A370)


This time of use demand based network tariff is available to very large LV commercial or industrial customers that consume an annual amount of electricity in excess of 6.0 GWh. The minimum chargeable demand is 450 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2007 and 2008 'Large Business – LV 6.0⁺ GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 2,393 MWh	Low 5,583 MWh	Average 7,975 MWh	High 10,368 MWh	Very high 13,558 MWh
2007	N/A	N/A	\$217,515	\$280,595	\$364,701
2008	N/A	N/A	\$215,676	\$278,171	\$361,499
Change	N/A	N/A	-0.8%	-0.9%	-0.9%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 2,393 MWh	Low 5,583 MWh	Average 7,975 MWh	High 10,368 MWh	Very high 13,558 MWh
2007	N/A	N/A	\$237,517	\$306,597	\$398,704
2008	N/A	N/A	\$233,827	\$301,768	\$392,357
Change	N/A	N/A	-1.6%	-1.6%	-1.6%

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 50% and the load factor is 55%.

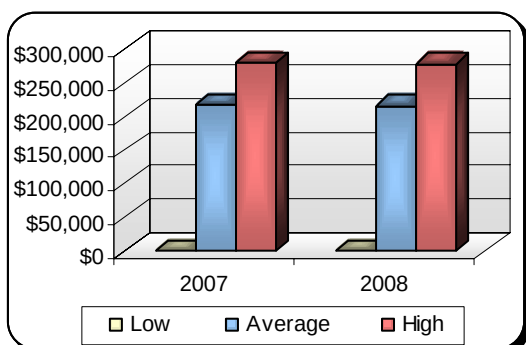

Network Tariff charge comparison
2007 vs 2008.

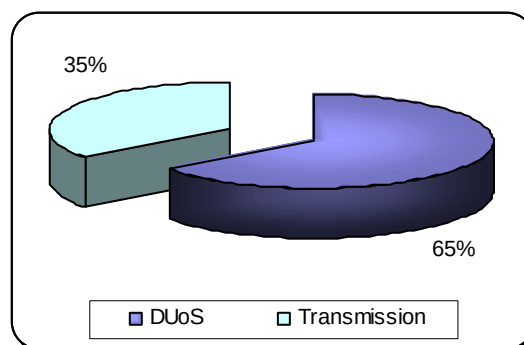

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

4.2.14 Large Business – LV_{MS} 6.0⁺ GWh (A37M)

This is a time of use demand based network tariff available to LV commercial/industrial customers, other than embedded network customers, taking supply from multiple supply points on a single site and the aggregated annual consumption from those supply points is greater than 6.0 GWh. The aggregated minimum chargeable demand is 450 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

The terms and conditions for assignment to Multiple Supply ("MS") tariffs can be found at the following Website link:


<http://www.jemena.com.au/operations/distribution/JEN/>

A comparison of the 2007 and 2008 'Large Business – LV_{MS} 6.0⁺ GWh' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 2,020 MWh	Low 4,714 MWh	Average 6,734 MWh	High 8,755 MWh	Very high 11,448 MWh
2007	N/A	N/A	\$158,022	\$203,820	\$264,883
2008	N/A	N/A	\$156,857	\$202,264	\$262,806
Change	N/A	N/A	-0.7%	-0.8%	-0.8%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 2,020 MWh	Low 4,714 MWh	Average 6,734 MWh	High 8,755 MWh	Very high 11,448 MWh
2007	N/A	N/A	\$174,953	\$225,829	\$293,664
2008	N/A	N/A	\$172,306	\$222,347	\$289,068
Change	N/A	N/A	-1.5%	-1.5%	-1.6%

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 50% and the load factor is 55%.

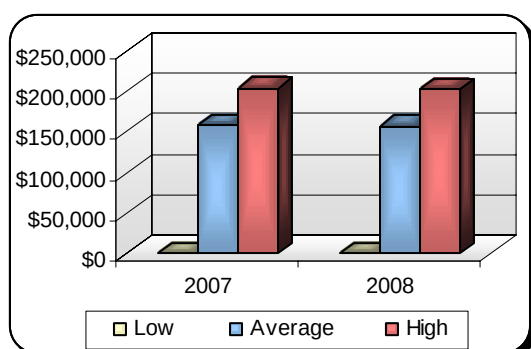

Network Tariff charge comparison
2007 vs 2008.

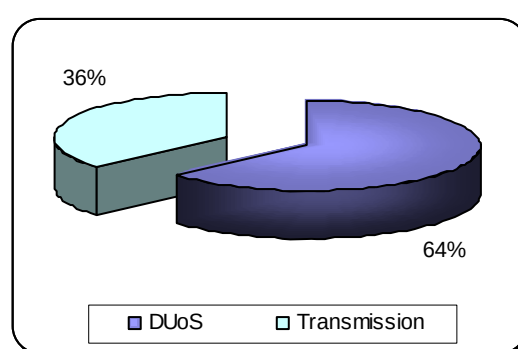

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

4.2.15 Large Business – HV (A400)


This is a Time of Use demand based network tariff applicable to HV commercial or industrial customers with annual consumption less than 55.0 GWh. The minimum chargeable demand is 1,000 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

The impact of 2007 and 2008 'Large Business – HV' network tariff on customers is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 2,574 MWh	Low 6,005 MWh	Average 8,579 MWh	High 11,152 MWh	Very high 14,583 MWh
2007	\$94,379	\$149,091	\$208,905	\$268,719	\$348,471
2008	\$93,177	\$147,537	\$206,931	\$266,325	\$345,516
Change	-1.3%	-1.0%	-0.9%	-0.9%	-0.8%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 2,574 MWh	Low 6,005 MWh	Average 8,579 MWh	High 11,152 MWh	Very high 14,583 MWh
2007	\$101,796	\$166,397	\$233,628	\$300,859	\$390,501
2008	\$100,162	\$163,835	\$230,213	\$296,591	\$385,096
Change	-1.6%	-1.5%	-1.5%	-1.4%	-1.4%

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 50% and the load factor is 55%.

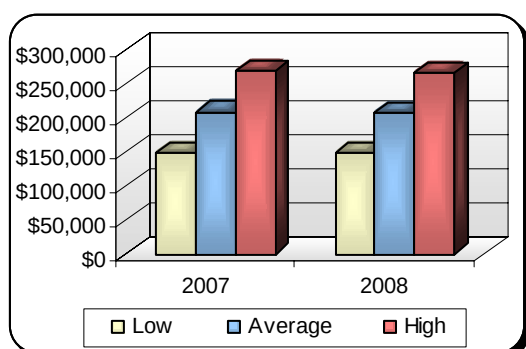

Network Tariff charge comparison
2007 vs 2008.

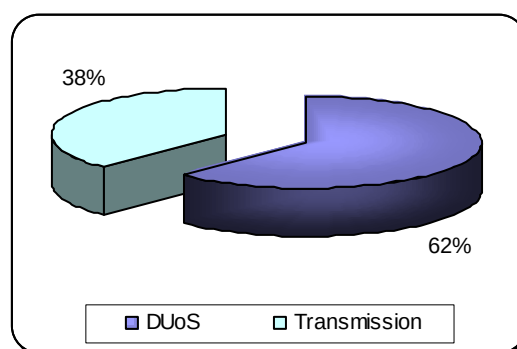

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

4.2.16 Large Business – HV_{RF} (A40R)


This Time of Use demand based network tariff has been closed to new entrants effective from 1 January 2007. The minimum chargeable demand is 1,000 kW. The peak rate applies to the period 7.00 AM to 11.00 PM Monday to Friday and the off-peak rate applies to all other times.

A comparison of the 2007 and 2008 'Large Business – HV_{RF}' network tariff charges for the five usage levels is shown below.


	Peak to Total Energy Ratio: 50% Load factor 55%				
	Very Low 7,966 MWh	Low 18,587 MWh	Average 26,553 MWh	High 34,519 MWh	Very high 45,140 MWh
2007	\$171,454	\$387,360	\$549,289	\$711,219	\$927,125
2008	\$169,150	\$382,747	\$542,945	\$703,143	\$916,741
Change	-1.3%	-1.2%	-1.2%	-1.1%	-1.1%

	Peak to Total Energy Ratio: 70% Load factor: 55%				
	Very Low 7,966 MWh	Low 18,587 MWh	Average 26,553 MWh	High 34,519 MWh	Very high 45,140 MWh
2007	\$194,411	\$440,928	\$625,815	\$810,702	\$1,057,218
2008	\$190,769	\$433,193	\$615,010	\$796,828	\$1,039,251
Change	-1.9%	-1.8%	-1.7%	-1.7%	-1.7%

The charts below compare 2007 and 2008 network tariff charges for low, average and high users and show 2008 DUoS and Transmission charges as a proportion of the network charge for an average user. For both charts the peak to total energy ratio is 50% and the load factor is 55%.

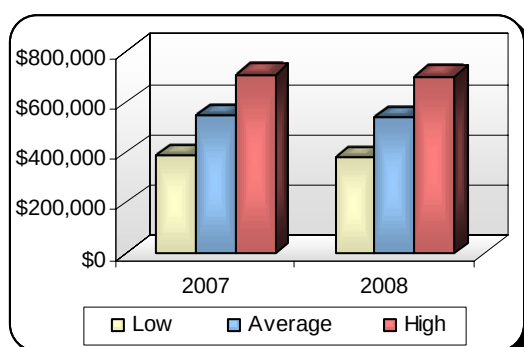

Network Tariff charge comparison
2007 vs 2008.

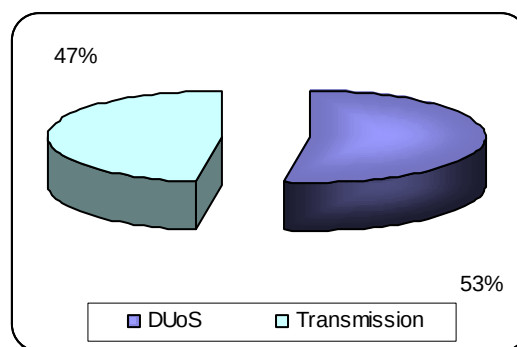

2008 DUoS and Transmission charges
as a proportion of the network charge
for an average user.

5 RATIONALE FOR AMENDMENT

The Commission requires the distributor to provide:

- details of any tariff amendment that has occurred in comparison with the Tariff Strategy Report;
- justification for proposed tariff amendments; and
- details as to how the proposed tariff amendment satisfies the pricing principles and rebalancing constraints.

JEN has not introduced new tariff structures in 2008. The tariffs that JEN has proposed in its 2008 tariff submission to the Commission are consistent with its 2006-2010 tariff strategy Report.

6 CONSULTATION

Distributors are required to provide details of consultation carried out with stakeholders for any amendment to the Tariff Strategy Report. Details must be provided including:

- who is on the stakeholder register and how it was established;
- what information was provided and how accessible it was;
- the timeliness of the provision of the information;
- the time which stakeholders were given to respond; and
- how issues raised by stakeholders were taken into account.

The tariffs that JEN has proposed in its 2008 tariff submission to the Commission are consistent with its 2006-2010 tariff strategy Report.

APPENDIX 1 PROPOSED NETWORK TARIFFS FOR 2008 (EXCLUSIVE OF GST)

Customer Class Code	Tariff Name	Units	Rate
---------------------	-------------	-------	------

Residential

Only available to residential customers

A100	General Purpose		
	<i>Single rate all times</i>		
	- Standing charge	\$/customer pa	\$19.800
	- Unit rate	¢/kWh	5.972
A10I	Time of Use Interval Meter		
	Available to customers with an interval meter		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$19.800
	- Peak Unit rate	¢/kWh	9.467
	- Off Peak Unit rate	¢/kWh	1.762
A140	Time of Use (closed to new entrants)		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$33.960
	- Peak Unit rate	¢/kWh	7.460
	- Off Peak Unit rate	¢/kWh	1.589
A180	Off Peak Heating Only		
	<i>11.00 PM to 7.00 AM all days</i>		
	- Standing charge	\$/customer pa	\$0.000
	- Off Peak Unit rate	¢/kWh	1.430

Small Business

Only available to customers:

- a) with annual consumption < 0.4 GWh AND maximum demand < 150 kVA (120 kW); and
- b) where supply is not taken from an on-site OR dedicated substation

A200	General Purpose		
	Only available to customers with a single rate accumulation meter		
	<i>Single rate all times</i>		
	- Standing charge	\$/customer pa	\$50.640
	- Unit rate	¢/kWh	6.822
A210	Time of Use Weekdays		
	Only available to customers with a two rate accumulation meter OR to customers with annual consumption < 160 MWh and having a maximum demand < 60 kW		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$88.320
	- Peak Unit rate	¢/kWh	8.192
	- Off Peak Unit rate	¢/kWh	1.661

Customer Class Code	Tariff Name	Units	Rate
A230	Time of Use Weekdays - Demand		
	Only available to customers with a meter capable of measuring demand		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$229.680
	- Peak Unit rate	¢/kWh	4.677
	- Off Peak Unit rate	¢/kWh	1.665
	- Demand rate	\$/kW pa	\$42.732
	Minimum Chargeable Demand	60 kW	
A250	Time of Use Extended		
	Only available to customers with a two rate accumulation meter OR to customers with annual consumption < 160 MWh and having a maximum demand < 60 kW		
	<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$88.320
	- Peak Unit rate	¢/kWh	7.200
	- Off Peak Unit rate	¢/kWh	1.766
A270	Time of Use Extended - Demand		
	Only available to customers with a meter capable of measuring demand		
	<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$229.680
	- Peak Unit rate	¢/kWh	3.825
	- Off Peak Unit rate	¢/kWh	1.788
	- Demand rate	\$/kW pa	\$42.732
	Minimum Chargeable Demand	60 kW	
A290	Unmetered Supply		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Peak Unit rate	¢/kWh	7.323
	- Off Peak Unit rate	¢/kWh	1.648

Large Business

Low Voltage Tariffs (nominal voltage < 1000 Volts)

Only available to customers:

- a) with annual consumption ≥ 0.4 GWh OR maximum demand ≥ 150 kVA (120 kW); or
- b) taking supply from an on-site OR dedicated substation

A300	LV 0.4 - 0.8 GWh		
	Only available to customers with annual consumption ≤ 0.8 GWh		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$1,500.000
	- Peak Unit rate	¢/kWh	2.508
	- Off Peak Unit rate	¢/kWh	0.911
	- Demand rate	\$/kW pa	\$71.688
	Minimum Chargeable Demand	120 kW	

Customer Class Code	Tariff Name	Units	Rate
A30E	LV_{EN} Annual Consumption ≤ 0.8 GWh		
Only available to embedded network customers with annual consumption ≤ 0.8 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge	\$/customer pa		\$1,500.000
- Peak Unit rate	¢/kWh		2.427
- Off Peak Unit rate	¢/kWh		0.911
- Demand rate	\$/kW pa		\$75.396
Minimum Chargeable Demand	120 kW		
A320	LV 0.8⁺ - 2.2 GWh		
Only available to customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge	\$/customer pa		\$2,844.000
- Peak Unit rate	¢/kWh		2.095
- Off Peak Unit rate	¢/kWh		0.893
- Demand rate	\$/kW pa		\$66.036
Minimum Chargeable Demand	250 kW		
A32E	LV_{EN} 0.8⁺ - 2.2 GWh		
Only available to embedded network customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge	\$/customer pa		\$2,844.000
- Peak Unit rate	¢/kWh		1.930
- Off Peak Unit rate	¢/kWh		0.893
- Demand rate	\$/kW pa		\$67.596
Minimum Chargeable Demand	250 kW		
A340	LV 2.2⁺ - 6.0 GWh		
Only available to customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge	\$/customer pa		\$4,872.000
- Peak Unit rate	¢/kWh		2.088
- Off Peak Unit rate	¢/kWh		0.783
- Demand rate	\$/kW pa		\$65.592
Minimum Chargeable Demand	250 kW		
A34E	LV_{EN} 2.2⁺ - 6.0 GWh		
Only available to embedded network customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge	\$/customer pa		\$4,872.000
- Peak Unit rate	¢/kWh		1.768
- Off Peak Unit rate	¢/kWh		0.783
- Demand rate	\$/kW pa		\$66.864
Minimum Chargeable Demand	250 kW		

Customer Class Code	Tariff Name	Units	Rate
A34M	LV_{MS} 2.2⁺ - 6.0 GWh		
Only available to a customer, other than an embedded network customer, taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 2.2 GWh BUT ≤ 6.0 GWh*			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge		\$/customer pa	\$3,450.000
- Peak Unit rate		¢/kWh	2.108
- Off Peak Unit rate		¢/kWh	0.783
- Demand rate		\$/kW pa	\$47.100
Minimum Chargeable Demand		250 kW	
A370	LV 6.0⁺ GWh		
Only available to customers with annual consumption > 6.0 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge		\$/customer pa	\$7,356.000
- Peak Unit rate		¢/kWh	1.881
- Off Peak Unit rate		¢/kWh	0.743
- Demand rate		\$/kW pa	\$62.640
Minimum Chargeable Demand		450 kW	
A37E	LV_{EN} 6.0⁺ GWh		
Only available to embedded network customers with annual consumption > 6.0 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge		\$/customer pa	\$7,356.000
- Peak Unit rate		¢/kWh	1.923
- Off Peak Unit rate		¢/kWh	0.743
- Demand rate		\$/kW pa	\$63.912
Minimum Chargeable Demand		450 kW	
A37M	LV_{MS} 6.0⁺ GWh		
Only available to a customer, other than an embedded network customer, taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 6.0 GWh*			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge		\$/customer pa	\$5,502.000
- Peak Unit rate		¢/kWh	1.890
- Off Peak Unit rate		¢/kWh	0.743
- Demand rate		\$/kW pa	\$44.856
Minimum Chargeable Demand		450 kW	

Customer Class Code	Tariff Name	Units	Rate
High Voltage Tariffs (nominal voltage ≥ 1000 Volts AND $\leq 22,000$ Volts)			
A400	HV		
Only available to customers with annual consumption < 55 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>			
	- Standing charge	\$/customer pa	\$8,952.000
	- Peak Unit rate	¢/kWh	1.880
	- Off Peak Unit rate	¢/kWh	0.523
	- Demand rate	\$/kW pa	\$53.304
	Minimum Chargeable Demand	1,000 kW	
A40E	HV_{EN} Annual Consumption ≤ 10 GWh		
Only available to embedded network customers with annual consumption ≤ 10 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$8,952.000
	- Peak Unit rate	¢/kWh	1.708
	- Off Peak Unit rate	¢/kWh	0.523
	- Demand rate	\$/kW pa	\$53.964
	Minimum Chargeable Demand	1,000 kW	
A40R	HV_{RF} (closed to new entrants)		
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>			
	- Standing charge	\$/customer pa	\$8,952.000
	- Peak Unit rate	¢/kWh	1.880
	- Off Peak Unit rate	¢/kWh	0.523
	- Demand rate	\$/kW pa	\$39.004
	Minimum Chargeable Demand	1,000 kW	
A42E	HV_{EN} 10⁺ GWh		
Only available to embedded network customers with annual consumption > 10 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$8,952.000
	- Peak Unit rate	¢/kWh	1.706
	- Off Peak Unit rate	¢/kWh	0.523
	- Demand rate	\$/kW pa	\$53.916
	Minimum Chargeable Demand	2,000 kW	
A480	HV - Annual Consumption ≥ 55 GWh		
Only available to customers with annual consumption ≥ 55 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$9,588.000
	- Peak Unit rate	¢/kWh	1.830
	- Off Peak Unit rate	¢/kWh	0.488
	- Demand rate	\$/kW pa	\$48.684
	Minimum Chargeable Demand	10,000 kW	

Customer Class Code	Tariff Name	Units	Rate
Subtransmission Tariffs (nominal voltage > 22,000 Volts)			
A500	Subtransmission		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$32,952.000
	- Peak Unit rate	¢/kWh	1.194
	- Off Peak Unit rate	¢/kWh	0.271
	- Demand rate	\$/kW pa	\$16.476
	Minimum Chargeable Demand	15,000 kW	
A50A	Subtransmission MA		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$32,952.000
	- Peak Unit rate	¢/kWh	1.194
	- Off Peak Unit rate	¢/kWh	0.271
	- Demand rate	\$/kW pa	\$16.476
	Minimum Chargeable Demand	15,000 kW	
A50E	Subtransmission EG		
	Available to Embedded Generators connected to TTS-SSS-ST-EPG-TTS Loop.		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$21,528.000
	- Peak Unit rate	¢/kWh	1.191
	- Off Peak Unit rate	¢/kWh	0.270
	- Demand rate	\$/kW pa	\$5.472
	Minimum Chargeable Demand	15,000 kW	

* Other terms and conditions apply

The *Deemed Distribution Contract* and *Alinta AE's Policy for Resetting Contract Demand* form part of the terms and conditions related to these prices. These documents can be viewed or downloaded from the following Website:
<http://www.alinta.net.au/operations/distribution/alintaVICElecNetworks/>

APPENDIX 2 PROPOSED DISTRIBUTION TARIFFS FOR 2008 (EXCLUSIVE OF GST)

Customer Class Code	Tariff Name	Units	Rate
---------------------	-------------	-------	------

Residential

Only available to residential customers

A100	General Purpose		
	<i>Single rate all times</i>		
	- Standing charge	\$/customer pa	\$16.440
	- Unit rate	¢/kWh	5.363
A10I	Time of Use Interval Meter		
	<i>Available to customers with an interval meter</i>		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$16.440
	- Peak Unit rate	¢/kWh	8.789
	- Off Peak Unit rate	¢/kWh	1.236
A140	Time of Use (closed to new entrants)		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$28.800
	- Peak Unit rate	¢/kWh	6.495
	- Off Peak Unit rate	¢/kWh	1.063
A180	Off Peak Heating Only		
	<i>11.00 PM to 7.00 AM all days</i>		
	- Standing charge	\$/customer pa	\$0.000
	- Off Peak Unit rate	¢/kWh	1.063

Small Business

Only available to customers:

- a) with annual consumption < 0.4 GWh AND maximum demand < 150 kVA (120 kW); and
- b) where supply is not taken from an on-site OR dedicated substation

A200	General Purpose		
	<i>Only available to customers with a single rate accumulation meter</i>		
	<i>Single rate all times</i>		
	- Standing charge	\$/customer pa	\$44.400
	- Unit rate	¢/kWh	5.973
A210	Time of Use Weekdays		
	<i>Only available to customers with a two rate accumulation meter OR to customers with annual consumption < 160 MWh and having a maximum demand < 60 kW</i>		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$62.400
	- Peak Unit rate	¢/kWh	7.099
	- Off Peak Unit rate	¢/kWh	1.133

Customer Class Code	Tariff Name	Units	Rate
A230	Time of Use Weekdays - Demand		
	Only available to customers with a meter capable of measuring demand		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$48.000
	- Peak Unit rate	¢/kWh	3.720
	- Off Peak Unit rate	¢/kWh	1.137
	- Demand rate	\$/kW pa	\$39.204
	Minimum Chargeable Demand	60 kW	
A250	Time of Use Extended		
	Only available to customers with a two rate accumulation meter OR to customers with annual consumption < 160 MWh and having a maximum demand < 60 kW		
	<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$62.400
	- Peak Unit rate	¢/kWh	6.228
	- Off Peak Unit rate	¢/kWh	1.238
A270	Time of Use Extended - Demand		
	Only available to customers with a meter capable of measuring demand		
	<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$48.000
	- Peak Unit rate	¢/kWh	3.001
	- Off Peak Unit rate	¢/kWh	1.260
	- Demand rate	\$/kW pa	\$39.204
	Minimum Chargeable Demand	60 kW	
A290	Unmetered Supply		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Peak Unit rate	¢/kWh	6.905
	- Off Peak Unit rate	¢/kWh	1.120

Large Business

Low Voltage Tariffs (nominal voltage < 1000 Volts)

Only available to customers:

- a) with annual consumption ≥ 0.4 GWh OR maximum demand ≥ 150 kVA (120 kW); or
- b) taking supply from an on-site OR dedicated substation

A300	LV 0.4 - 0.8 GWh		
	Only available to customers with annual consumption ≤ 0.8 GWh		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$1,128.000
	- Peak Unit rate	¢/kWh	1.235
	- Off Peak Unit rate	¢/kWh	0.438
	- Demand rate	\$/kW pa	\$68.892
	Minimum Chargeable Demand	120 kW	

Customer Class Code	Tariff Name	Units	Rate
A30E	LV_{EN} Annual Consumption ≤ 0.8 GWh		
	Only available to embedded network customers with annual consumption ≤ 0.8 GWh		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$1,128.000
	- Peak Unit rate	¢/kWh	1.288
	- Off Peak Unit rate	¢/kWh	0.438
	- Demand rate	\$/kW pa	\$72.600
	Minimum Chargeable Demand	120 kW	
A320	LV 0.8* - 2.2 GWh		
	Only available to customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$1,860.000
	- Peak Unit rate	¢/kWh	0.792
	- Off Peak Unit rate	¢/kWh	0.420
	- Demand rate	\$/kW pa	\$62.880
	Minimum Chargeable Demand	250 kW	
A32E	LV_{EN} 0.8* - 2.2 GWh		
	Only available to embedded network customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$1,860.000
	- Peak Unit rate	¢/kWh	0.801
	- Off Peak Unit rate	¢/kWh	0.420
	- Demand rate	\$/kW pa	\$64.440
	Minimum Chargeable Demand	250 kW	
A340	LV 2.2* - 6.0 GWh		
	Only available to customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$2,844.000
	- Peak Unit rate	¢/kWh	0.727
	- Off Peak Unit rate	¢/kWh	0.307
	- Demand rate	\$/kW pa	\$61.644
	Minimum Chargeable Demand	250 kW	
A34E	LV_{EN} 2.2* - 6.0 GWh		
	Only available to embedded network customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$2,844.000
	- Peak Unit rate	¢/kWh	0.733
	- Off Peak Unit rate	¢/kWh	0.307
	- Demand rate	\$/kW pa	\$62.916
	Minimum Chargeable Demand	250 kW	

Customer Class Code	Tariff Name	Units	Rate
A34M	LV_{MS} 2.2⁺ - 6.0 GWh		
Only available to a customer, other than an embedded network customer, taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 2.2 GWh BUT ≤ 6.0 GWh*			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge	\$/customer pa		\$1,422.000
- Peak Unit rate	¢/kWh		0.727
- Off Peak Unit rate	¢/kWh		0.307
- Demand rate	\$/kW pa		\$43.152
Minimum Chargeable Demand	250 kW		
A370	LV 6.0⁺ GWh		
Only available to customers with annual consumption > 6.0 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge	\$/customer pa		\$3,708.000
- Peak Unit rate	¢/kWh		0.706
- Off Peak Unit rate	¢/kWh		0.267
- Demand rate	\$/kW pa		\$59.280
Minimum Chargeable Demand	450 kW		
A37E	LV_{EN} 6.0⁺ GWh		
Only available to embedded network customers with annual consumption > 6.0 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge	\$/customer pa		\$3,708.000
- Peak Unit rate	¢/kWh		0.718
- Off Peak Unit rate	¢/kWh		0.267
- Demand rate	\$/kW pa		\$60.552
Minimum Chargeable Demand	450 kW		
A37M	LV_{MS} 6.0⁺ GWh		
Only available to a customer, other than an embedded network customer, taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 6.0 GWh*			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge	\$/customer pa		\$1,854.000
- Peak Unit rate	¢/kWh		0.706
- Off Peak Unit rate	¢/kWh		0.267
- Demand rate	\$/kW pa		\$41.496
Minimum Chargeable Demand	450 kW		

Customer Class Code	Tariff Name	Units	Rate
High Voltage Tariffs (nominal voltage ≥ 1000 Volts AND $\leq 22,000$ Volts)			
A400	HV		
Only available to customers with annual consumption < 55 GWh			
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.			
	- Standing charge	\$/customer pa	\$1,968.000
	- Peak Unit rate	¢/kWh	0.562
	- Off Peak Unit rate	¢/kWh	0.132
	- Demand rate	\$/kW pa	\$49.284
	Minimum Chargeable Demand	1,000 kW	
A40E	HV_{EN} Annual Consumption ≤ 10 GWh		
Only available to embedded network customers with annual consumption ≤ 10 GWh			
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times			
	- Standing charge	\$/customer pa	\$1,968.000
	- Peak Unit rate	¢/kWh	0.582
	- Off Peak Unit rate	¢/kWh	0.132
	- Demand rate	\$/kW pa	\$50.484
	Minimum Chargeable Demand	1,000 kW	
A40R	HV_{RF} (closed to new entrants)		
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.			
	- Standing charge	\$/customer pa	\$1,968.000
	- Peak Unit rate	¢/kWh	0.562
	- Off Peak Unit rate	¢/kWh	0.132
	- Demand rate	\$/kW pa	\$35.508
	Minimum Chargeable Demand	1,000 kW	
A42E	HV_{EN} 10⁺ GWh		
Only available to embedded network customers with annual consumption > 10 GWh			
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times			
	- Standing charge	\$/customer pa	\$1,968.000
	- Peak Unit rate	¢/kWh	0.585
	- Off Peak Unit rate	¢/kWh	0.132
	- Demand rate	\$/kW pa	\$50.100
	Minimum Chargeable Demand	2,000 kW	
A480	HV - Annual Consumption ≥ 55 GWh		
Only available to customers with annual consumption ≥ 55 GWh			
Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times			
	- Standing charge	\$/customer pa	\$1,956.000
	- Peak Unit rate	¢/kWh	0.546
	- Off Peak Unit rate	¢/kWh	0.094
	- Demand rate	\$/kW pa	\$45.756
	Minimum Chargeable Demand	10,000 kW	

Customer Class Code	Tariff Name	Units	Rate
Subtransmission Tariffs (nominal voltage > 22,000 Volts)			
A500	Subtransmission		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$15,420.000
	- Peak Unit rate	¢/kWh	0.090
	- Off Peak Unit rate	¢/kWh	0.017
	- Demand rate	\$/kW pa	\$13.980
	Minimum Chargeable Demand	15,000 kW	
A50A	Subtransmission MA		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$15,420.000
	- Peak Unit rate	¢/kWh	0.090
	- Off Peak Unit rate	¢/kWh	0.017
	- Demand rate	\$/kW pa	\$13.980
	Minimum Chargeable Demand	15,000 kW	
A50E	Subtransmission EG		
	Available to Embedded Generators connected to TTS-SSS-ST-EPG-TTS Loop.		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$15,420.000
	- Peak Unit rate	¢/kWh	0.087
	- Off Peak Unit rate	¢/kWh	0.016
	- Demand rate	\$/kW pa	\$2.856
	Minimum Chargeable Demand	15,000 kW	

* Other terms and conditions apply

The *Deemed Distribution Contract* and *Alinta AE's Policy for Resetting Contract Demand* form part of the terms and conditions related to these prices. These documents can be viewed or downloaded from the following Website:
<http://www.alinta.net.au/operations/distribution/alintaVICElecNetworks/>

APPENDIX 3 PROPOSED TRANSMISSION TARIFFS FOR 2008 (EXCLUSIVE OF GST)

Customer Class Code	Tariff Name	Units	Rate
Residential			
Only available to residential customers			
A100	General Purpose		
	<i>Single rate all times</i>		
	- Standing charge	\$/customer pa	\$3.360
	- Unit rate	¢/kWh	0.609
A10I	Time of Use Interval Meter		
	Available to customers with an interval meter		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$3.360
	- Peak Unit rate	¢/kWh	0.678
	- Off Peak Unit rate	¢/kWh	0.526
A140	Time of Use (closed to new entrants)		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$5.160
	- Peak Unit rate	¢/kWh	0.965
	- Off Peak Unit rate	¢/kWh	0.526
A180	Off Peak Heating Only		
	<i>11.00 PM to 7.00 AM all days</i>		
	- Standing charge	\$/customer pa	\$0.000
	- Off Peak Unit rate	¢/kWh	0.367

Small Business

Only available to customers:

- a) with annual consumption < 0.4 GWh AND maximum demand < 150 kVA (120 kW); and
- b) where supply is not taken from an on-site OR dedicated substation

A200	General Purpose		
	Only available to customers with a single rate accumulation meter		
	<i>Single rate all times</i>		
	- Standing charge	\$/customer pa	\$6.240
	- Unit rate	¢/kWh	0.849
A210	Time of Use Weekdays		
	Only available to customers with a two rate accumulation meter OR to customers with annual consumption < 160 MWh and having a maximum demand < 60 kW		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$25.920
	- Peak Unit rate	¢/kWh	1.093
	- Off Peak Unit rate	¢/kWh	0.528

Customer Class Code	Tariff Name	Units	Rate
A230	Time of Use Weekdays - Demand		
Only available to customers with a meter capable of measuring demand			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$181.680
	- Peak Unit rate	¢/kWh	0.957
	- Off Peak Unit rate	¢/kWh	0.528
	- Demand rate	\$/kW pa	\$3.528
	Minimum Chargeable Demand	60 kW	
A250	Time of Use Extended		
Only available to customers with a two rate accumulation meter OR to customers with annual consumption < 160 MWh and having a maximum demand < 60 kW			
<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$25.920
	- Peak Unit rate	¢/kWh	0.972
	- Off Peak Unit rate	¢/kWh	0.528
A270	Time of Use Extended - Demand		
Only available to customers with a meter capable of measuring demand			
<i>Peak: 7.00 AM to 11 PM "Mon - Sun" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$181.680
	- Peak Unit rate	¢/kWh	0.824
	- Off Peak Unit rate	¢/kWh	0.528
	- Demand rate	\$/kW pa	\$3.528
	Minimum Chargeable Demand	60 kW	
A290	Unmetered Supply		
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
	- Peak Unit rate	¢/kWh	0.418
	- Off Peak Unit rate	¢/kWh	0.528

Large Business

Low Voltage Tariffs (nominal voltage < 1000 Volts)

Only available to customers:

- a) with annual consumption ≥ 0.4 GWh OR maximum demand ≥ 150 kVA (120 kW); or
- b) taking supply from an on-site OR dedicated substation

A300	LV 0.4 - 0.8 GWh		
Only available to customers with annual consumption ≤ 0.8 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$372.000
	- Peak Unit rate	¢/kWh	1.273
	- Off Peak Unit rate	¢/kWh	0.473
	- Demand rate	\$/kW pa	\$2.796
	Minimum Chargeable Demand	120 kW	

Customer Class Code	Tariff Name	Units	Rate
A30E	LV_{EN} Annual Consumption ≤ 0.8 GWh		
	Only available to embedded network customers with annual consumption ≤ 0.8 GWh <i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$372.000
	- Peak Unit rate	¢/kWh	1.139
	- Off Peak Unit rate	¢/kWh	0.473
	- Demand rate	\$/kW pa	\$2.796
	Minimum Chargeable Demand	120 kW	
A320	LV 0.8⁺ - 2.2 GWh		
	Only available to customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh <i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$984.000
	- Peak Unit rate	¢/kWh	1.303
	- Off Peak Unit rate	¢/kWh	0.473
	- Demand rate	\$/kW pa	\$3.156
	Minimum Chargeable Demand	250 kW	
A32E	LV_{EN} 0.8⁺ - 2.2 GWh		
	Only available to embedded network customers with annual consumption > 0.8 GWh BUT ≤ 2.2 GWh <i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$984.000
	- Peak Unit rate	¢/kWh	1.129
	- Off Peak Unit rate	¢/kWh	0.473
	- Demand rate	\$/kW pa	\$3.156
	Minimum Chargeable Demand	250 kW	
A340	LV 2.2⁺ - 6.0 GWh		
	Only available to customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh <i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$2,028.000
	- Peak Unit rate	¢/kWh	1.361
	- Off Peak Unit rate	¢/kWh	0.476
	- Demand rate	\$/kW pa	\$3.948
	Minimum Chargeable Demand	250 kW	
A34E	LV_{EN} 2.2⁺ - 6.0 GWh		
	Only available to embedded network customers with annual consumption > 2.2 GWh BUT ≤ 6.0 GWh <i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$2,028.000
	- Peak Unit rate	¢/kWh	1.035
	- Off Peak Unit rate	¢/kWh	0.476
	- Demand rate	\$/kW pa	\$3.948
	Minimum Chargeable Demand	250 kW	

Customer Class Code	Tariff Name	Units	Rate
A34M	LV_{MS} 2.2⁺ - 6.0 GWh		
Only available to a customer, other than an embedded network customer, taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 2.2 GWh BUT ≤ 6.0 GWh*			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge		\$/customer pa	\$2,028.000
- Peak Unit rate		¢/kWh	1.381
- Off Peak Unit rate		¢/kWh	0.476
- Demand rate		\$/kW pa	\$3.948
Minimum Chargeable Demand		250 kW	
A370	LV 6.0⁺ GWh		
Only available to customers with annual consumption > 6.0 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge		\$/customer pa	\$3,648.000
- Peak Unit rate		¢/kWh	1.175
- Off Peak Unit rate		¢/kWh	0.476
- Demand rate		\$/kW pa	\$3.360
Minimum Chargeable Demand		450 kW	
A37E	LV_{EN} 6.0⁺ GWh		
Only available to embedded network customers with annual consumption > 6.0 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge		\$/customer pa	\$3,648.000
- Peak Unit rate		¢/kWh	1.205
- Off Peak Unit rate		¢/kWh	0.476
- Demand rate		\$/kW pa	\$3.360
Minimum Chargeable Demand		450 kW	
A37M	LV_{MS} 6.0⁺ GWh		
Only available to a customer, other than an embedded network customer, taking supply from multiple supply points on a single site AND the aggregated annual consumption from those supply points is > 6.0 GWh*			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
- Standing charge		\$/customer pa	\$3,648.000
- Peak Unit rate		¢/kWh	1.184
- Off Peak Unit rate		¢/kWh	0.476
- Demand rate		\$/kW pa	\$3.360
Minimum Chargeable Demand		450 kW	

Customer Class Code	Tariff Name	Units	Rate
High Voltage Tariffs (nominal voltage ≥ 1000 Volts AND $\leq 22,000$ Volts)			
A400	HV		
Only available to customers with annual consumption < 55 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>			
	- Standing charge	\$/customer pa	\$6,984.000
	- Peak Unit rate	¢/kWh	1.318
	- Off Peak Unit rate	¢/kWh	0.391
	- Demand rate	\$/kW pa	\$4.020
	Minimum Chargeable Demand	1,000 kW	
A40E	HV_{EN} Annual Consumption ≤ 10 GWh		
Only available to embedded network customers with annual consumption ≤ 10 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$6,984.000
	- Peak Unit rate	¢/kWh	1.126
	- Off Peak Unit rate	¢/kWh	0.391
	- Demand rate	\$/kW pa	\$3.480
	Minimum Chargeable Demand	1,000 kW	
A40R	HV_{RF} (closed to new entrants)		
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times.</i>			
	- Standing charge	\$/customer pa	\$6,984.000
	- Peak Unit rate	¢/kWh	1.318
	- Off Peak Unit rate	¢/kWh	0.391
	- Demand rate	\$/kW pa	\$3.496
	Minimum Chargeable Demand	1,000 kW	
A42E	HV_{EN} 10⁺ GWh		
Only available to embedded network customers with annual consumption > 10 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$6,984.000
	- Peak Unit rate	¢/kWh	1.121
	- Off Peak Unit rate	¢/kWh	0.391
	- Demand rate	\$/kW pa	\$3.816
	Minimum Chargeable Demand	2,000 kW	
A480	HV - Annual Consumption ≥ 55 GWh		
Only available to customers with annual consumption ≥ 55 GWh			
<i>Peak: 7.00 AM to 11 PM "Mon - Fri" ; Off peak all other times</i>			
	- Standing charge	\$/customer pa	\$7,632.000
	- Peak Unit rate	¢/kWh	1.284
	- Off Peak Unit rate	¢/kWh	0.394
	- Demand rate	\$/kW pa	\$2.928
	Minimum Chargeable Demand	10,000 kW	

Customer Class Code	Tariff Name	Units	Rate
Subtransmission Tariffs (nominal voltage > 22,000 Volts)			
A500	Subtransmission		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$17,532.000
	- Peak Unit rate	¢/kWh	1.104
	- Off Peak Unit rate	¢/kWh	0.254
	- Demand rate	\$/kW pa	\$2.496
	Minimum Chargeable Demand	15,000 kW	
A50A	Subtransmission MA		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$17,532.000
	- Peak Unit rate	¢/kWh	1.104
	- Off Peak Unit rate	¢/kWh	0.254
	- Demand rate	\$/kW pa	\$2.496
	Minimum Chargeable Demand	15,000 kW	
A50E	Subtransmission EG		
	Available to Embedded Generators connected to TTS-SSS-ST-EPG-TTS Loop.		
	<i>Peak: 7.00 AM to 11 PM "Mon - Fri"; Off peak all other times</i>		
	- Standing charge	\$/customer pa	\$6,108.000
	- Peak Unit rate	¢/kWh	1.104
	- Off Peak Unit rate	¢/kWh	0.254
	- Demand rate	\$/kW pa	\$2.616
	Minimum Chargeable Demand	15,000 kW	

* Other terms and conditions apply

The Deemed Distribution Contract and Jemena Electricity Networks (Vic) Ltd's Policy for Resetting Contract Demands form part of the terms and conditions related to these prices. These documents can be viewed or downloaded from the following Website:

<http://www.jemena.com.au/operations/distribution/JEN/>

APPENDIX 4 EXCLUDED SERVICE CHARGES

JEN holds a licence to distribute energy in the northern and western suburbs of Melbourne. Jemena Electricity Networks (Vic) Ltd is a wholly owned subsidiary of Jemena. Jemena personnel will deliver the prescribed and excluded services described in this document. These terms, conditions and charges are only applicable to the services delivered on the JEN network.

Introduction

This document sets out the Excluded Service Charges, Prescribed Service Charges, Terms and Conditions that apply for the JEN network.

A distributor is required to offer to provide excluded services for a charge and on terms and conditions that are fair and reasonable. The Essential Services Commission regulates the maximum charge for such services. However, customers may negotiate an alternate charge for an alternate level of service and for some services, there may be alternative service providers.

The service charges set out in this document are the commonly requested services. Other services are carried out as Recoverable Works. Recoverable Works are undertaken at hourly rates plus the cost of materials and any sub-contracted services (such as traffic control).

The charges in this Appendix include GST unless otherwise specified.

Requests for Service

Customers generally request services through their retailer. Retailers are invoiced for these services on a monthly basis through the established billing processes. Where a customer requests a service either directly or through a Registered Electrical Contractor, payment is required before the service is performed.

Hours of Operation

Most services are offered during both business hours and after business hours. These hours are defined as:

Business Hours	0830 - 1730
After Hours	1730 - 0830

Connection

These services apply to customers requesting connection to the existing electricity distribution network²⁰. The services are offered to customers requiring either a permanent or temporary connection to the network via either an overhead or underground connection.

The price for each of the services includes all reasonable material, transport, equipment and labour to connect the installation, but excludes an inspection of the electrical installation²¹.

Additional charges are applicable in circumstances where the connection works are delayed or cannot be completed due to problems such as:

- Access to the site is constrained
- Delays of more than 15 minutes caused by the customer or electrical contractor
- Debris over pit
- The installation does not comply with electrical or connection requirements
- The Electrical Work Request does not correctly specify all the work required
- Power Industry Lock not installed

Connection Services include the installation of a meter but the charges do not include the cost of the meter.

New premises

This charge applies where a customer, or a retailer on behalf of a customer, makes arrangements for a new supply connection at a specified address. The service charge is dependent on the type of installation.

Connection of new premises	Business Hours	After Hours
Residential single phase (no off-peak supply)	\$205.20	\$433.40
Residential single phase, off-peak meter	\$274.50	\$502.70
Residential 3 phase, direct connected meter	\$307.50	\$535.70
Residential where JEN is not the Responsible Person ²²	\$142.50	\$370.70
Non-residential single phase (no off-peak supply)	\$319.30	\$592.60
Non-residential single phase, off peak meter	\$388.60	\$661.90
Non-residential 3 phase, direct connected meter	\$421.60	\$694.90
Non-residential CT meter	\$784.60	\$1057.90
Non-residential where JEN is not the Responsible Person	\$256.60	\$529.90

²⁰ Where the electricity network must be extended or augmented before the customer can be connected additional charges apply. Refer to the Customer Connection Policy.

²¹ Electrical inspection services are unregulated.

²² Where JEN is not the Responsible Person (as defined in the National Electricity Code) the customer's Retailer is generally responsible for the meter and meter installation.

Temporary Supply

A temporary supply is provided where supply is requested for a known limited period – generally in the order of a few weeks – but may extend for up to 5 years. Temporary supplies may be provided for such purposes as:

- Construction of buildings, roads etc
- Supply to career, recruiting, health service, mobile X-Ray/dental/mobile library vans
- Carnivals, fetes, shows
- Camps

The charge for a temporary supply covers overhead or underground, single-phase or multi-phase supply.

Temporary supply	Business Hours	After Hours
Overhead supply – Coincident abolishment	\$204.10	\$396.00
Partial Supply in Permanent Position	\$222.70	\$425.70

A direct metered temporary supply is provided subject to the following:

- Sufficient supply capacity is available at the pillar, pit or distribution pole and within servicing distance of the desired location; and
- A completed and signed Electrical Work Request, together with the appropriate paperwork (a retailer request and a Certificate of Electrical Safety (CES)) from the Registered Electrical Contractor, is lodged.

All temporary supplies must be metered, except where specific approval has been given.

Temporary supplies attract a Temporary Supply charge *plus* the appropriate standard tariff charges based on energy consumption, including a supply charge.

The charge for temporary supplies is applicable to temporary installations not exceeding 100 amps. Larger temporary supplies may be arranged by negotiation at recoverable works rates.

These charges also apply where a customer, or a representative of customer (eg a builder), wishes to provide permanent or temporary supply to a new property under construction.

Coincident abolishment means that the cost of removing the temporary supply is included in the charge. The temporary supply will be abolished at the same time that the permanent service is established. If the customer requires the temporary supply to be removed before or after the permanent service is established an additional charge at the standard rate for a Service Vehicle is applied.

Field Officer Visit

Field Officers perform the following services:

- Collection of overdue accounts
- Re-energisation after de-energisation for non-payment
- Time switch adjustment
- Fuse removal/insertion at the request of electrical contractor
- Special meter reading, fuse insertion, fuse removal

Re-energisation after De-energisation for Non-Payment

This charge applies where a supply point is re-energised after a customer has been de-energised for non-payment. This charge assumes that all supply assets remain at the customer's installation when the supply point is de-energised. Re-energisation requests received prior to 3pm will incur normal hours fee and after hours fee applies to requests received after 3pm and before 9pm.

Other charges may apply if additional work is required or site problems exist eg. Access and safety and include wasted truck visit.

Adjust time switch

This charge applies when a customer or a customer's retailer requests that the hours of application of different meter registers (for example, off peak) be changed. In the case of a request to apply Daylight Saving hours, two charges apply to cover the costs of two visits, one at the commencement of Daylight Saving and one at the finish.

Fuse removal/insertion at request of Electrical Contractor

This charge applies where the electrical contractor requires the site to be de-energised or re-energised. The charge applies for each visit to site where the visit lasts no more than 15 minutes. The service is only available for installations with fuses rated at less than 100 amps.

Special Meter Reading, Fuse Insertion, Fuse Removal

This charge applies for the services provided by a Special Meter Reader. This includes meter reading, fuse insertion and fuse removal.

These services may be required in situations such as:

- A meter reading is required for the purpose of rendering an interim bill
- A customer has requested a meter reading following a bill based on an estimated reading
- A new customer has moved in to vacant premises
- A customer has vacated premises and the Retailer requests de-energisation of supply.

Field Officer Visits	Business Hours	After Hours
Re-energisation after de-energisation for non-payment	\$53.70 ²³	\$164.60 ²⁴
Adjust time switch	\$30.70	NA
Fuse removal/insertion at request of electrical contractor	\$30.70	\$133.80
Special read, fuse removal, fuse insertion	\$23.00	\$133.80

Generally re-energisation services are provided on the date requested by the retailer where the requested date of re-energisation is at least one day after the day the request is submitted. Where the retailer requests same day re-energisation and the request is received before 3.00pm the After Hours charge is applied. Where the request is made after 3.00pm there are two possible service charges. Where a Field Officer is available to action the request that day then the standard After Hours charge will apply. Where it is necessary to send a Service Vehicle to provide the re-energisation service a Service Vehicle Visit After Hours charge will be applied. The retailer will be advised at the time of the request which charge applies.

All re-energisation requests are undertaken on a best endeavours basis in accordance with the Electricity Distribution Code.

The special read charge applies in the following situations:

- a request is made to verify meter reading due to an account complaint and the original meter reading is found to be correct
- A separate charge applies to each separate installation within a multiple installation such as farms, villa units or combined commercial/residential establishment
- The charge is applied for each visit to site by a Field Officer. If the service cannot be performed due to difficulties such as locked gates or the customer is not at home then an additional charge is applied for each additional visit.

Service Truck or Van Visit

Service trucks or vans undertake a range of services such as electrical isolation of premises. The charge applies to all requests for services provided by service trucks and vans except where the service provided has a specific charge detailed in this document.

Field Truck or Van Visits	Business Hours	After Hours
Service Truck/Van visit	\$196.40	\$246.90

The charge applies for any task up to one-hour duration. Tasks that exceed one hour will be charged additional hours at the same rate.

These charges apply to all customer and contractor requested work involving a service vehicle except emergency and fault calls where the customer is clearly not at fault. Failure to check that the Main or Safety switch is turned ON – after being so advised – would attract a charge.

²³ Only applies where the request is received before 3.00pm

²⁴ Only applies where the request is received between 3.00pm and 9.00pm.

A service vehicle visit charge is also applied where:

- Scheduled work cannot be performed due to non-compliance of the customers installation such as an electrical defect or the site cannot be accessed
- On arrival, it is found that the scheduled work, or attendance, is not required
- A scheduled visit is cancelled within 24 hours of the scheduled time

Elective Underground Services

This charge applies to situations where a customer with an existing overhead service requests an underground service.

The distributor provides the electrical connection from the pole or underground mains to the pit located on the boundary. These works are undertaken as Recoverable Works and a quotation will be supplied for these works upon application.

The underground connection between the pit located on the boundary and the service fuse/meter panel located on the customer premises are the responsibility of the customer.

Elective Underground Service	Business Hours	After Hours
Elective underground service installation	RW	RW

Covering Low Voltage Mains

These charges apply where a builder or, other applicant, requests the power lines close to a site be covered to prevent electrocution during construction or other activities. There are two categories for this charge depending on the type of line being covered: street mains (two wires or all wire) and service cable. There are two components to each charge: a fixed charge for installation and removal of the temporary cover, and a variable charge for rental of the covers.

The charge includes the installation and removal of the covers and the first month's rental charge

Payment is required in advance for cover charges and rental is applied to the retailer/customer account.

Covering Low Voltage Mains	Business Hours	After Hours
Cover service cable	\$365.40	NA
Second and subsequent months rental of covers – service wire	\$65.80	
Cover low voltage mains – 2 wire	\$727.60	\$878.00
Second and subsequent month rental of covers – 2 wire	\$52.60	NA
Cover low voltage mains – all wires	\$740.80	\$891.00
Second and subsequent month rental of covers – all wires	\$65.80	NA

These charges do not apply to high voltage mains. High voltage mains are switched out of service when work is required in close proximity to the mains.

Service Cable pulled down by High Loads

The charge applies where a high load pulls down an overhead service cable. The charge is calculated for each instance based on the actual cost of the repairs.

Low Voltage Meter Conversion

These charges apply where a customer or retailer requests a change of metering so that the customer can take advantage of a different tariff.

Meter Conversion	Business Hours	After Hours
Conversion to Time of Use tariff	\$440.00	\$601.40
Installation of 5 day electronic time switch	\$299.60	\$400.40

Meter Test

This charge applies where a customer or retailer requests an investigation of the meter installation or meter accuracy. The charge depends upon the type and number of meters requiring test.

Meter Equipment Test	Business Hours	After Hours
Single phase meter test – first meter	\$178.80	\$229.30
Single phase meter test – second and subsequent meters	\$66.90	\$85.60
Multi phase meter test – first meter	\$268.80	\$343.50
Multi phase meter test – second and subsequent meters	\$113.00	\$145.90

This charge is refunded where JEN is responsible for the meter and the meter is found to be outside prescribed accuracy limits.

Meter or Connection Fraud Investigation

This charge applies where a retailer or other party requests an investigation of the meter installation and suspects that fraud or meter tampering has taken place.

Meter or Connection Fraud Investigation	Business Hours	After Hours
Fraud investigation	\$144.80	NA

Switching Service

This charge applies where a customer, retailer or contractor requires high or low voltage switching. Generally this service is required when a customer requires a section of line to be switched out so that work can be safely undertaken on a building or a crane can lift near power lines.

Switching Service	Business Hours	After Hours
Switching service	\$223.80	\$286.40

The charge covers the cost of modifying the metering equipment to provide time switched contacts. This work is undertaken in conjunction with other metering work.

Where the switching service is provided without other metering work being undertaken then a Service Vehicle Visit fee is also charged.

Electrical Services

This charge applies where a consultant or customer requests an on-site visit from an electrical compliance officer to discuss issues related to electrical compliance of the installation.

Electrical Inspection	Business Hours	After Hours
Electrical inspection service	\$167.90	\$219.50

Miscellaneous Services

These charges apply where a customer, contractor or retailer has made arrangements to pay by cheque or direct debit and the cheque or direct debit is dishonoured.

Miscellaneous Services	Business Hours	After Hours
Dishonoured cheque fee	\$17.50	NA
Dishonoured direct debit fee	\$8.70	NA

Meter Provision – Excluded Service

Excluded metering charges only apply to a small number of customers who consume more than 160MWh of energy per year AND have a manually read meter. Most customers that consume more than 160MWh per year have remotely read meters and the provision of services to these customers is contestable and does not have a regulated charge.

Meter Provision Charges (Customers consuming >160MWh per year)	Business Hours	After Hours
3 phase direct connected meter provision – manually read	\$162.29	NA
3 phase direct connected meter provision – manually read	\$282.21	NA

Public Lighting

In accordance with the August 2004 Final Decision – Review of Public Lighting Excluded Service Charges, JEN has included its revised Public Lighting Excluded Service Charges, as part of the 2008 tariff submission and approvals process, for application on 1 January 2008.

The proposed adjustments to the 2008 public lighting excluded service charges are designed to reflect a change to the regulatory weighted average cost of capital (WACC), and the change in the depreciation and return on assets for the increase in the asset base over time. The proposed charges do not include adjustments for any other factors. The proposed charges have been constructed in accordance with the approach adopted in the Final Decision of August 2004.

The revised 2008 public lighting excluded service charges also incorporate recovery of the depreciation and return on assets for the increase asset base for 2007 as there was no adjustment to the public lighting charges in 2007. The increase attributed to the 2007 year will be backed out from the excluded public lighting charges in 2009.

The proposed public lighting excluded service charges for 2008 apply to public lighting services provided for the purpose of lighting public places, and include the following services:

- The operation of public lighting assets, including handling enquiries and complaints about public lighting, and dispatching crews to repair public lighting assets; and
- The maintenance, repair and replacement of public lighting assets.
- The charges are excluded service charges that apply to the public lighting services provided unless an alternative charge has been negotiated and agreed in writing
- The charges are for the provision of operation, maintenance, repair and replacement of public lights in accordance with the Public Lighting Code.
- The charges apply to lights with standard or non-standard fittings.

Light Type	Annual Charge
Fluorescent 20 watt	\$50.12
Fluorescent 2 x 20 watt	\$50.12
Fluorescent 40 watt	\$50.12
Fluorescent 80 watt	\$50.12
Mercury Vapour 50 watt	\$50.12
Mercury Vapour 80 watt	\$37.47
Mercury Vapour 125 watt	\$58.82
Mercury Vapour 250 watt	\$71.83
Mercury Vapour 400 watt	\$80.53
Sodium Low Pressure 90 watt	\$75.15
Sodium High Pressure 100 watt	\$124.93
Sodium High Pressure 150 watt	\$67.57
Sodium High Pressure 250 watt	\$70.06
Sodium High Pressure 250 watt (24 hours)	\$116.88
Sodium High Pressure 400 watt	\$99.77

Light Type	Annual Charge
Incandescent 100 watt	\$62.47
Incandescent 150 watt	\$78.11
Metal Halide 70 watt	\$102.97
Metal Halide 100 watt	\$155.90
Metal Halide 250 watt	\$160.58

In addition to the charges detailed above there is a metering data service charge applicable to public lights (and other unmetered supplies). This charge is provided in Appendix 5 of this report.

APPENDIX 5 PROPOSED PRESCRIBED METERING SERVICES CHARGES FOR 2008 (EXCLUSIVE OF GST)

	Units	Rate
<u>Metering Data Services</u>		
- Monthly Read Meter	\$/NMI pa	\$55.210
- Quarterly Read Meter	\$/NMI pa	\$18.400
- Unmetered Supplies	\$/light pa	\$0.122
<u>Meter Provision</u>		
- Single Phase Non Off Peak Meter	\$/meter pa	\$3.050
- Single Phase Off Peak Meter*	\$/meter pa	\$31.440
- Three Phase Direct Connected Meter	\$/meter pa	\$52.300
- Three Phase Current Transformer Connected Meter	\$/meter pa	\$1.050

* A single phase off peak accumulation meter has one logical meter for charging but two physical single-phase meters