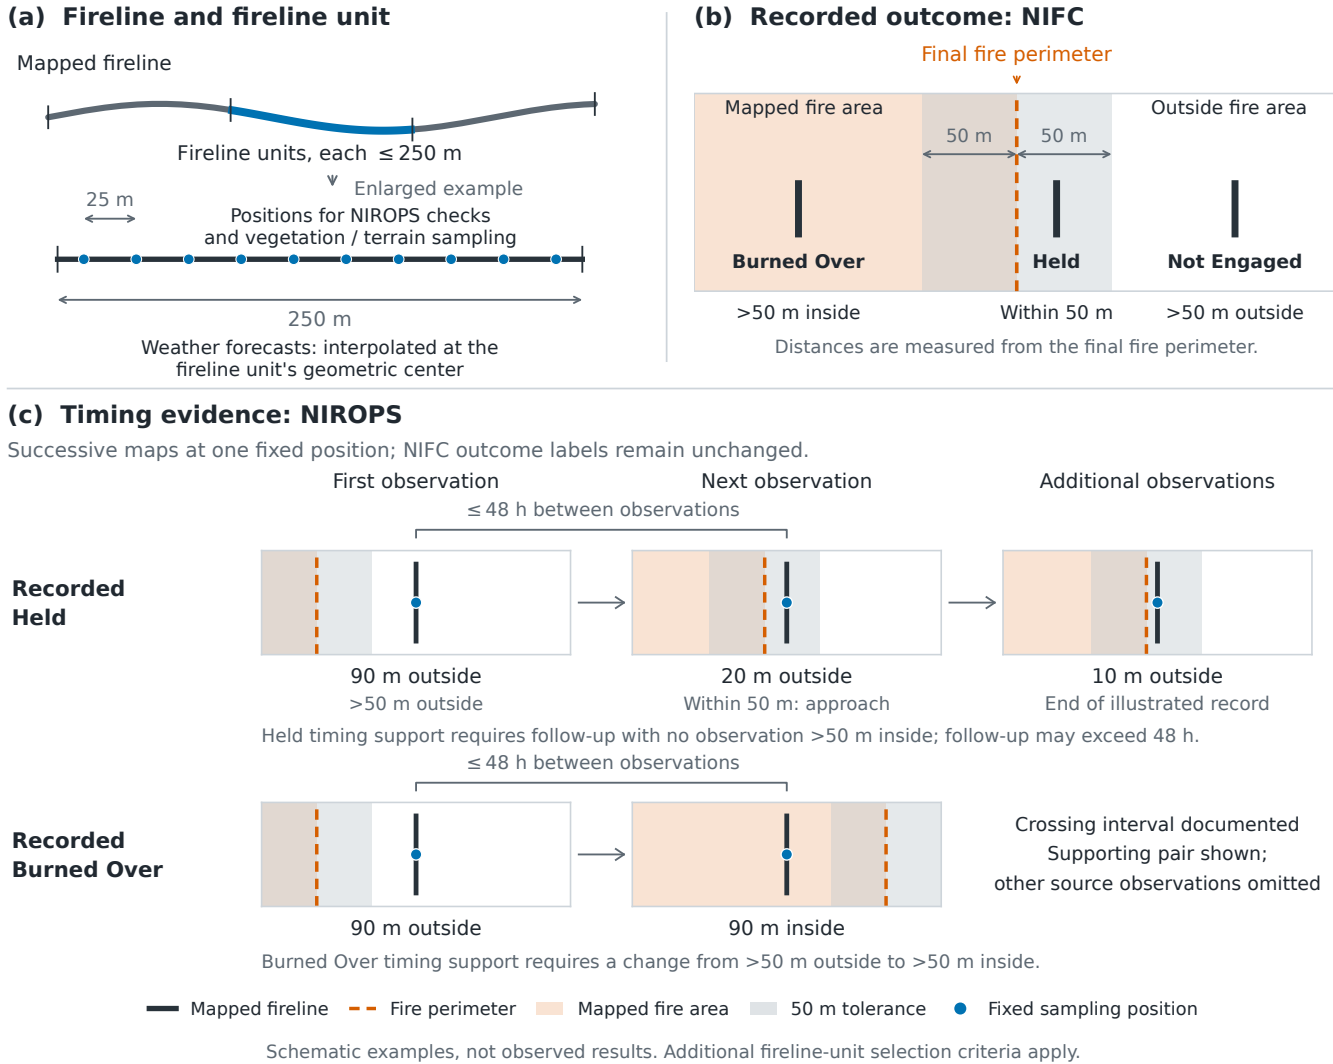
(a) Fireline and fireline unit
Mapped fireline
Fireline units, each ≤ 250 m
Enlarged example
25 m
Positions for NIROPS checks
and vegetation / terrain sampling
250 m
Weather forecasts: interpolated at the
fireline unit's geometric center
(b) Recorded outcome: NIFC
Final fire perimeter
Mapped fire area
50 m
50 m
Outside fire area
Burned Over
Held
Not Engaged
>50 m inside
Within 50 m
>50 m outside
Distances are measured from the final fire perimeter.
(c) Timing evidence: NIROPS
Successive maps at one fixed position; NIFC outcome labels remain unchanged.
First observation
Next observation
Additional observations
≤ 48 h between observations
Recorded
Held
90 m outside
>50 m outside
20 m outside
Within 50 m: approach
10 m outside
End of illustrated record
Held timing support requires follow-up with no observation >50 m inside; follow-up may exceed 48 h.
≤ 48 h between observations
Recorded
Burned Over
90 m outside
90 m inside
Crossing interval documented
Supporting pair shown;
other source observations omitted
Burned Over timing support requires a change from >50 m outside to >50 m inside.
Mapped fireline
Fire perimeter
Mapped fire area
50 m tolerance
Fixed sampling position
Schematic examples, not observed results. Additional fireline-unit selection criteria apply.