

CERTIFICATE OF ANALYSIS

Client Details

Company Gilba Solutions
Contact Jerry Spencer
Email herbycides@gmail.com
Phone 0499975819
Address PO Box 45
Maroubra NSW 2035

Purchase Order N°

Sample Details

Client Reference Wollongong Golf Club
Sample Name Bore & Riparian Mixed
Lab ID W20784
Test Code(s) W3
Sample Type Water

Date Sample Received

21/08/2025

Date Sample Analysed

30/08/2025

Report Date

3/09/2025

Comments

Signatories

Approved by: Chris George



Authorised by: Shane Harvey



Disclaimer: The results pertain to the particular sample(s) provided by the client, with samples processed and analysed as received. Westgate Labs does not take responsibility for the sample quality upon receipt.

Irrigation Water Nutrient Analysis


Client: Wollongong Golf Club
 Sample Name: Bore & Riparian Mixed
 Sample ID: W20784
 Report Date: 3 Sep 2025




Key Nutrient Indicators	Units	Result	Very Low	Low	Adequate	High	Very High
pH*	pH scale	7.3					
Electrical Conductivity (EC)*	dS/m	4.55					
Total Dissolved Salts (TDS)	ppm	2912.00					
Sodium Absorption Ratio (SAR)	meq/L ratio	25.23					
Adjusted SAR	meq/L ratio	55.51					
pHc	pH scale	7.20					
Residual Sodium Carbonate (RSC)	meq/L	7.74					
Water Hardness (ppm as CaCO ₃)	ppm	151.71					
Cation / Anion Ratio	meq/L ratio	3.12					

Cations	ppm	meq/L	%	Very Low	Low	Adequate	High	Very High
Calcium (Ca)	32.13	1.61	4.58					
Magnesium (Mg)	17.42	1.45	4.14					
Potassium (K)	15.64	0.4	1.14					
Sodium (Na)	717.84	31.21	89.06					
Iron (Fe)	8.29	0.37	1.06					
Manganese (Mn)	0.08	0.003	0.01					
Anions	ppm	meq/L	%	Very Low	Low	Adequate	High	Very High
Bicarbonate (HCO ₃)	658.75	10.8	24.69					
Chloride (Cl)	1153.76		74.32					
Sulphate (SO ₄ ²⁻)	20.78	0.43	0.99					

Cation Balance (%)

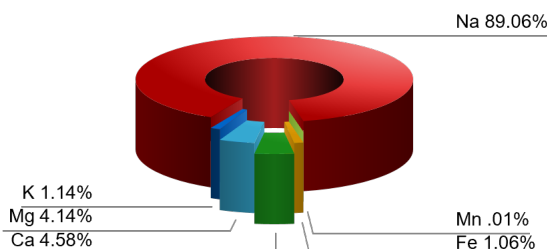

Anion Balance (%)

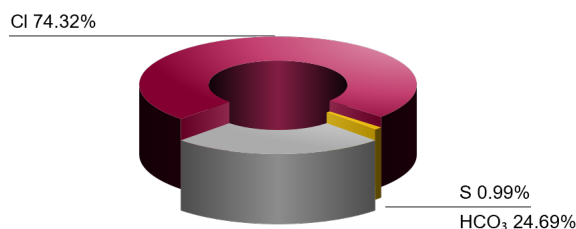

Other Nutrients	ppm	meq/L	Kg/m ³	Very Low	Low	Adequate	High	Very High
Nitrate (NO ₃)	2.16	N/A	0.00216					
Ammonia (NH ₄)	6.32	N/A	0.00632					
Phosphorus (P)	0.01	N/A	0.00001					
Boron (B)	0.18	N/A	0.00018					
Copper (Cu)	0.01	N/A	0.00001					
Zinc (Zn)	<0.01	N/A	<0.00001					

* NATA accreditation only applies to the tests marked with an asterisk (*), which have been performed in accordance with ISO/IEC 17025. All other results are not covered by NATA accreditation.

ANALYSIS METHODS REFERENCE

METHOD ID	METHOD SUMMARY
WAT-PRO-2	Electrical conductivity measured via conductivity probe and meter. pH measurement via pH probe and meter.
WAT-PRO-3	Elemental analysis of water via ICP-OES.
WAT-PRO-4	Analysis of dissolved anions via liquid chromatography.
WAT-PRO-5	Alkalinity of water determined via titration.
WAT-PRO-6	Ammonia levels in water determined with ion selective probe.