

CERTIFICATE OF ANALYSIS

Client Details

Company Gilba Solutions
Contact Jerry Spencer
Email herbycides@gmail.com
Phone 0499975819
Address PO Box 45
Maroubra NSW 2035

Purchase Order N°

Sample Details

Client Reference Federal Golf Club
Sample Name Shed Dam
Lab ID W23996
Test Code(s) WS-3
Sample Type Water

Date Sample Received

6/02/2026

Date Sample Analysed

10/02/2026

Report Date

12/02/2026

Comments

Signatories

Approved by: Chris George



Authorised by: Shane Harvey



Disclaimer: The results pertain to the particular sample(s) provided by the client, with samples processed and analysed as received. Westgate Labs does not take responsibility for the sample quality upon receipt.

Irrigation Water Nutrient Analysis


Client: Federal Golf Club
 Sample Name: Shed Dam
 Sample ID: W23996
 Report Date: 12 Feb 2026




Key Nutrient Indicators	Units	Result	Very Low	Low	Adequate	High	Very High
pH*	pH scale	6.96					
Electrical Conductivity (EC)*	dS/m	1.11					
Total Dissolved Salts (TDS)	ppm	711.68					
Sodium Absorption Ratio (SAR)	meq/L ratio	1.32					
Adjusted SAR	meq/L ratio	3.43					
pHc	pH scale	6.80					
Residual Sodium Carbonate (RSC)	meq/L	-3.60					
Water Hardness (ppm as CaCO ₃)	ppm	483.64					
Cation / Anion Ratio	meq/L ratio	1.96					

Cations	ppm	meq/L	%	Very Low	Low	Adequate	High	Very High
Calcium (Ca)	118.16	5.91	46.26					
Magnesium (Mg)	45.99	3.83	30.01					
Potassium (K)	4.74	0.12	0.95					
Sodium (Na)	66.88	2.91	22.77					
Iron (Fe)	0.01	00	00					
Manganese (Mn)	<0.01	<00	<00					
Anions	ppm	meq/L	%	Very Low	Low	Adequate	High	Very High
Bicarbonate (HCO ₃)	374.38	6.14	61.47					
Chloride (Cl)	123.15		34.75					
Sulphate (SO ₄ ²⁻)	18.11	0.38	3.78					

Cation Balance (%)

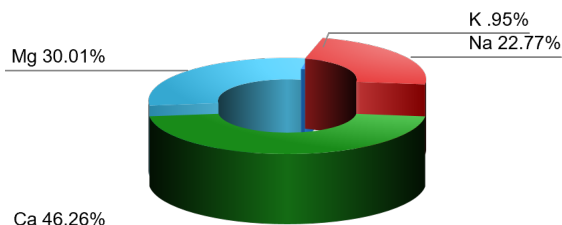

Anion Balance (%)

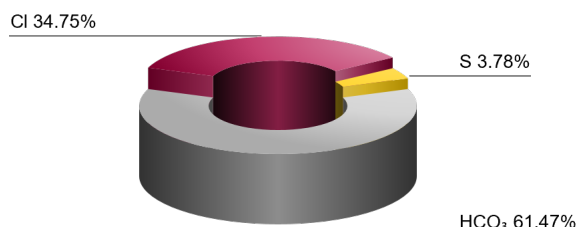

Other Nutrients	ppm	meq/L	Kg/m ³	Very Low	Low	Adequate	High	Very High
Nitrate (NO ₃)	4.21	N/A	0.00421					
Ammonia (NH ₄)	0.74	N/A	0.00074					
Phosphorus (P)	0.03	N/A	0.00003					
Boron (B)	0.01	N/A	0.00001					
Copper (Cu)	<0.01	N/A	0.00001					
Zinc (Zn)	<0.01	N/A	<0.00001					

* NATA accreditation only applies to the tests marked with an asterisk (*), which have been performed in accordance with ISO/IEC 17025. All other results are not covered by NATA accreditation.

ANALYSIS METHODS REFERENCE

METHOD ID	METHOD SUMMARY
WAT-PRO-2	Electrical conductivity measured via conductivity probe and meter. pH measurement via pH probe and meter.
WAT-PRO-3	Elemental analysis of water via ICP-OES.
WAT-PRO-4	Analysis of dissolved anions via liquid chromatography.
WAT-PRO-5	Alkalinity of water determined via titration.
WAT-PRO-6	Ammonia levels in water determined with ion selective probe.