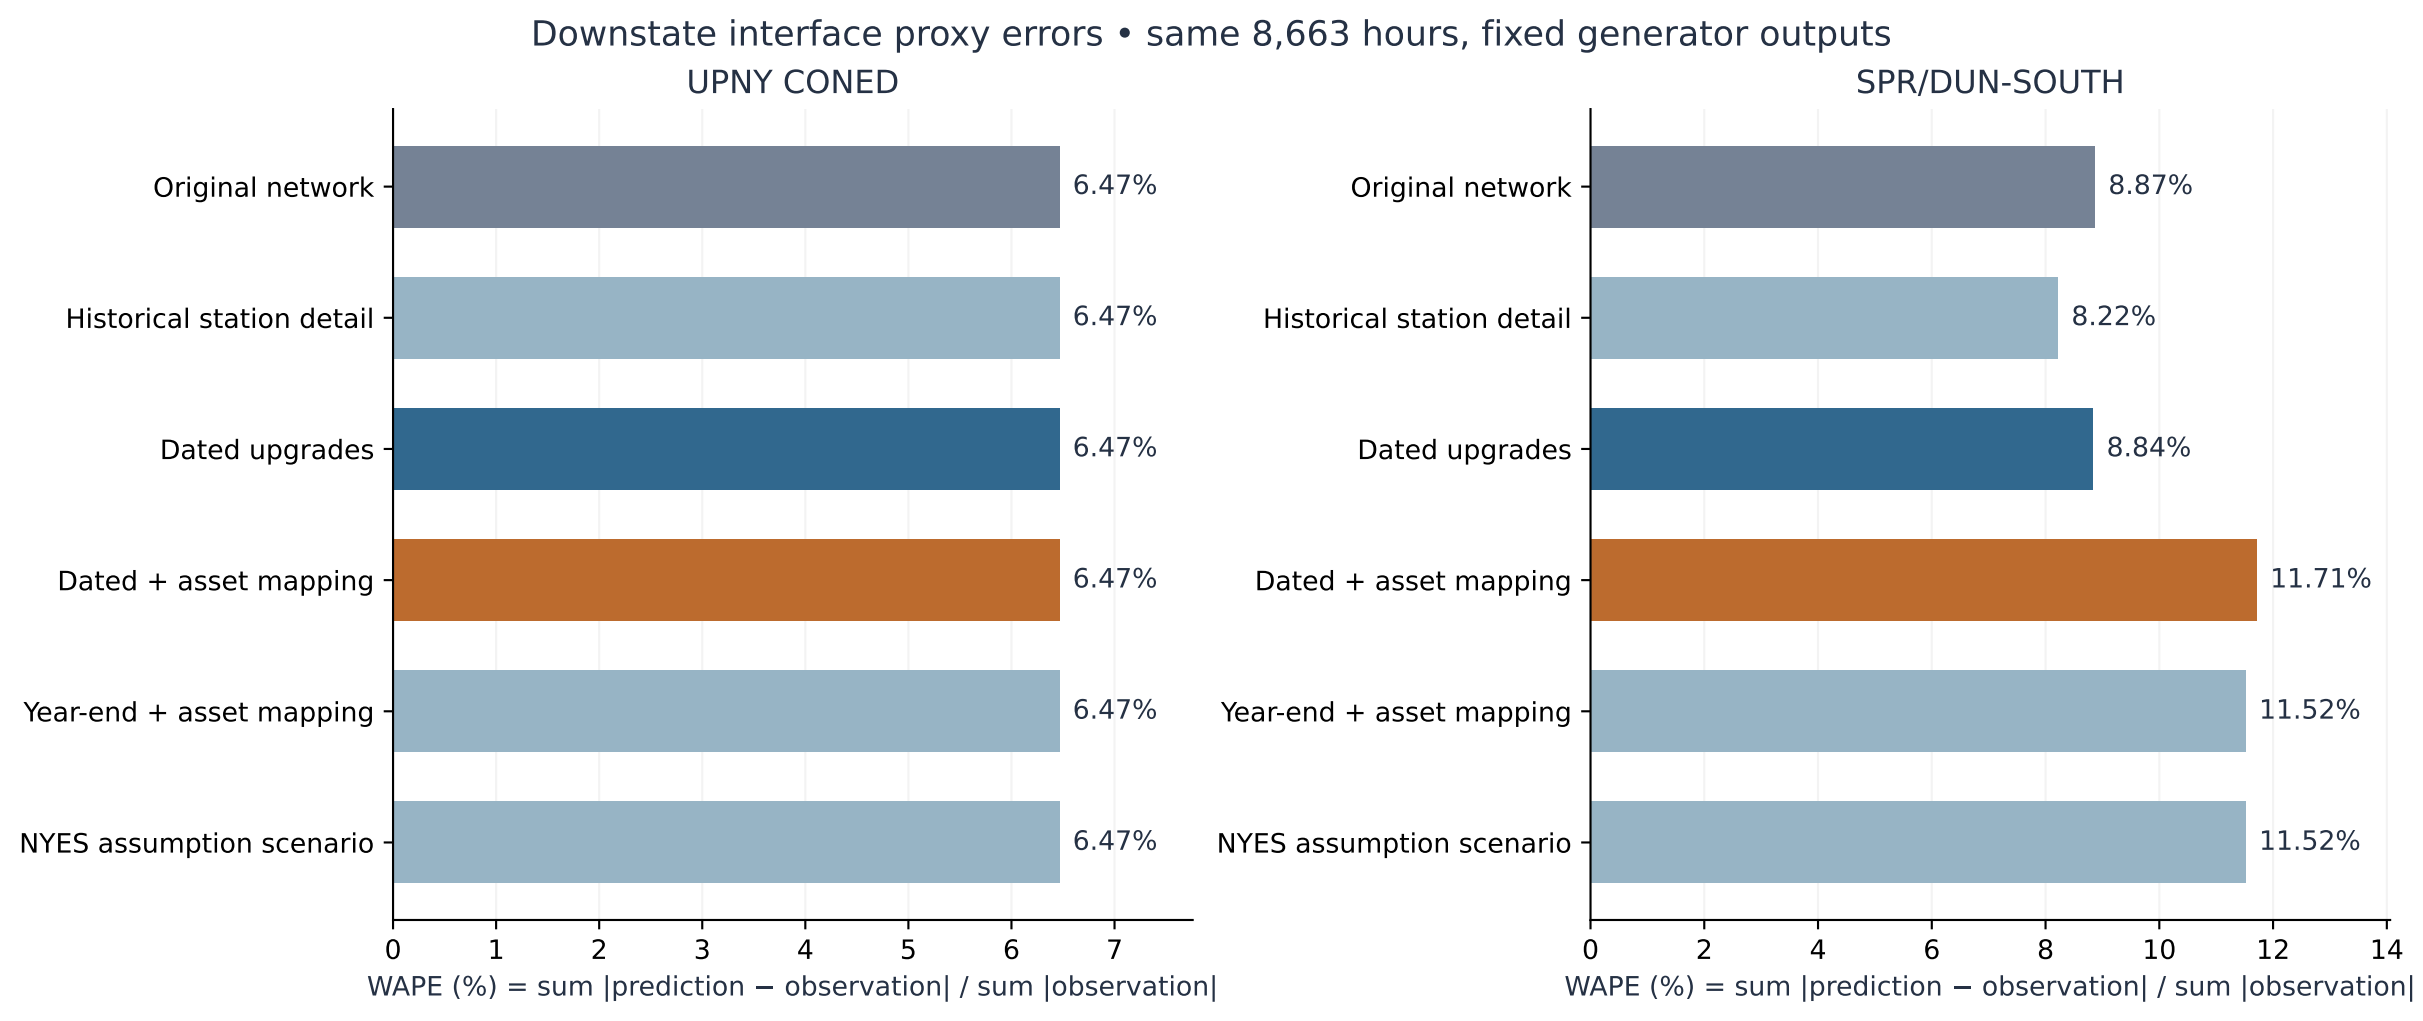
Downstate interface proxy errors • same 8,663 hours, fixed generator outputs
UPNY CONED
SPR/DUN-SOUTH
Original network
Historical station detail
Dated upgrades
Dated + asset mapping
Year-end + asset mapping
NYES assumption scenario
6.47%
6.47%
6.47%
6.47%
6.47%
6.47%
8.87%
8.22%
8.84%
11.71%
11.52%
11.52%
0
1
2
3
4
5
6
7
0
2
4
6
8
10
12
14
WAPE (%) = sum |prediction − observation| / sum |observation|
WAPE (%) = sum |prediction − observation| / sum |observation|