Downstate additions and replaced aggregate branches

51 added buses / 62 shown | year-end 2025 core; optional NYES paths excluded

Blue square boxes: ADDED buses; gray rounded boxes: ORIGINAL buses. Labels = name / model ID / nominal kV.

Blue lines: added historical source circuits | Gold dashed: added assumed connections

Red dashed: replaced original branches (inactive) | Purple: unchanged DC equivalents | Gray: retained; gray dotted: idle scaffold
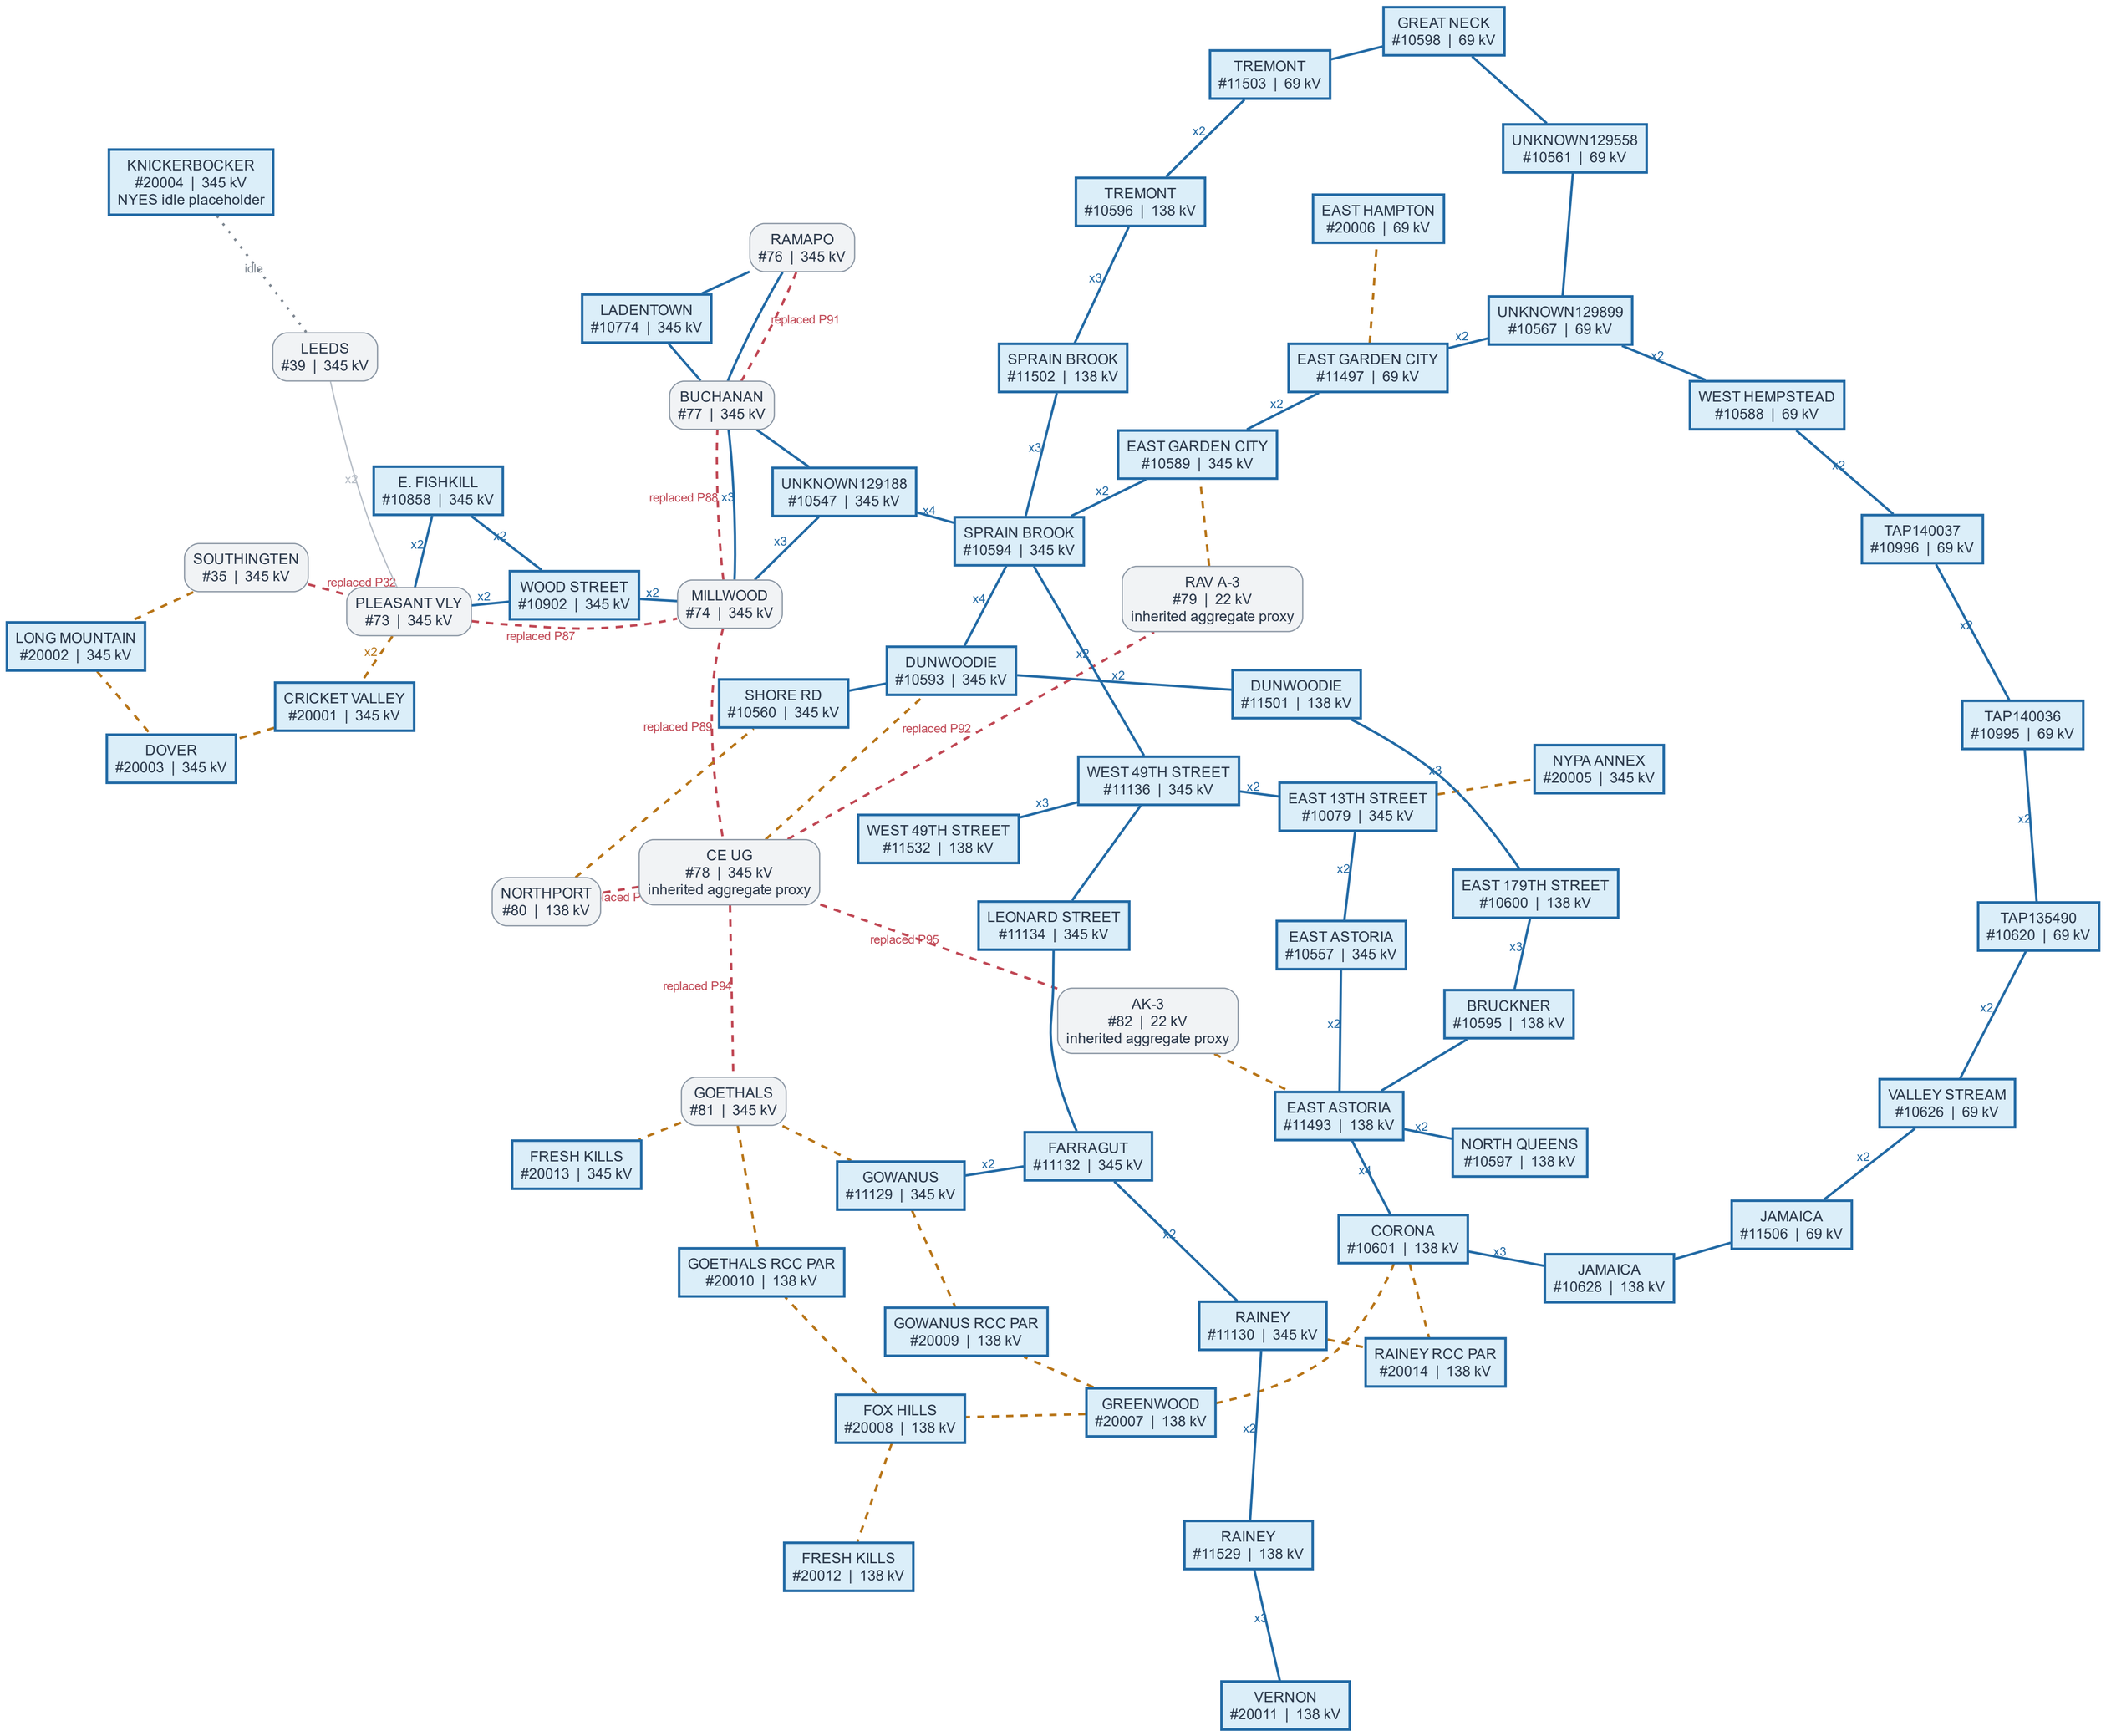
xN = parallel branch count. Schematic, not geographic. Cross-voltage proxies are not certified physical transformers.