Weekly Market Summary

November 10-16, 2025

About this Report

This report contains eleven sections. They are:

1) The ***Weekly Highlights*** section provides brief explanations of notable events that occurred during the week. The tables provided show market results for the current week, prior week, the same week a year ago, and the percentage change this week vs. the prior week and prior year. The highlights also include a detailed explanation of the Day-Ahead and Real-Time price separation for the current week, along with any Real-Time price corrections.
2) The ***Pricing*** section contains various graphs presenting information about Locational Marginal Prices (LMPs) and its components for the Hub, Load Zones, and external nodes. A table showing descriptive LMP statistics for these locations is also provided.
3) The ***Weekly Demand*** section contains a table describing total Day-Ahead and Real-Time Load Obligation (DALO & RTLO) for the current week, last week, the percentage change from last week, last year, and the percentage change from last year. In addition, there are graphs showing Day-Ahead demand bids and cleared volumes by type. Also included are tables for daily demand bid and virtual volumes and peak load by day with associated Real-Time pricing.
4) The ***Weekly Supply*** section contains tables and graphs of Day-Ahead Generation Obligation accumulated from generation, virtual supply, and imports. These exhibits also include the Day-Ahead Demand Reduction Obligation. Information on Real-Time supply including, metered generation by fuel type, self-scheduled MWh, Real-Time reliability MWh, marginal price setting, and external interface imports.
5) ***Net Commitment Period Compensation (NCPC)*** section includes information and links to the NCPC Summary report.
6) The ***Energy Market Payment*** section contains a table showing the payments associated with the Day-Ahead and Real-Time Energy Markets, a pie chart showing the component percentage of the Day-Ahead Energy Market payment, and a bar chart showing the magnitude of each component's contribution to the total Energy Market payment.
7) The ***Flexible Response Services (FRS)*** section contains tables and graphs related to the FRS clearing rate, the associated closeout charges, cleared FRS product MWh, and FRS payments.
8) The ***Energy Imbalance Reserves (EIR)*** section contains tables and graphs related to the Forecast Energy Reserve Price (FERP), EIR Obligation MWh, and EIR payments and closeout charges.
9) The ***Real-Time Reserve Market*** section contains a table showing the Real-Time Reserve payments by Reserve Zone, two tables with Real-Time Reserve Clearing Prices data, and a table with information related to Real-Time reserve bias implementation.
10) The ***Capacity Scarcity Condition (CSC)*** section contains preliminary details of any CSC activity that may have occurred during the week.

11) The last section of the report, the ***Glossary and Links*** section, contains additional information concerning the sections listed above, including links to relevant pages on the ISO New England web site.

Note: A supplemental Excel file 'Weekly Market Data 53 Weeks.XLSX', located here, contains the past 53 weeks of data of various concepts including market prices, payments, charges, and MWh values.

Click this icon in the section header to navigate to the glossary section, where definitions are described in more detail, with links to the ISO New England web site.

Weekly Highlights: November 10-16, 2025

1.1 Weekly Highlights

Notable Events

- Real-Time LMPs in excess of $235/MWh were caused by binding reserve constraints in the hour ending 6:00 p.m. on Friday, November 14.

Locational Marginal Pricing (LMPs) New England Hub; $/MWh; Average	This Week	Last Week	% Chg vs. Prior Week	Last Year	% Chg vs. Prior Year
Day-Ahead Energy Market; All Hours	$64.21	$47.82	34.3%	$37.05	73.3%
*Real-Time Energy Market; All Hours	$59.05	$45.49	29.8%	$36.84	60.3%
*This is the average of the 5-minute pricing intervals within the week.					

Weekly Demand Statistics (MWh)	This Week	Last Week	% Chg vs. Prior Week	Last Year	% Chg vs. Prior Year
Revenue Quality System Peak Load (MWh - Initial)	16,488	15,178	8.6%	15,724	4.9%
DA Load Obligation (All Zones)	-2,246,654	-2,095,914	7.2%	-2,105,057	6.7%
RT Load Obligation (All Zones)	-2,184,097	-2,054,884	6.3%	-2,062,258	5.9%
DA Cleared Exports (All Interfaces)	-201,796	-265,472	-24.0%	-207,602	-2.8%
RT Scheduled Exports (All Interfaces)	-319,254	-382,451	-16.5%	-295,768	7.9%

Weekly Supply Statistics	This Week	Last Week	% Chg vs. Prior Week	Last Year	% Chg vs. Prior Year
Input Fuel Price (Natural Gas, $/MMBtu)	$4.15	$3.32	24.9%	$1.86	122.7%
Mass Average Input Fuel Price (Natural Gas, $/MMBtu)	$4.73	$3.32	42.5%	$1.87	152.9%
Metered Generation (MWh)	2,207,589	2,193,574	0.6%	2,044,730	8.0%
Generation Obligation (MWh)	2,544,221	2,475,238	2.8%	2,399,541	6.0%
RT Demand Reduction Obligation (MWh)	26	0	N/A	28	-4.9%
Self-Scheduled Generation (MWh)	801,677	811,858	-1.3%	726,526	10.3%
DA Cleared Imports (MWh - All Interfaces)	247,338	213,197	16.0%	283,915	-12.9%
RT Scheduled Imports (MWh - All Interfaces)	336,633	281,664	19.5%	354,812	-5.1%

Market Payments	This Week	Last Week	% Chg vs. Prior Week	Last Year	% Chg vs. Prior Year
Day-Ahead and Real-Time Energy Market Payments ($)	$182,985,261	$134,549,111	36.0%	$88,671,430	106.4%
Day-Ahead Ancillary Services Market Payments ($)	$5,305,806	$4,743,641	11.9%	N/A	N/A
Real-Time Reserve Market Payments ($)	$539,571	$32,820	Large	$25,021	Large

Underlying natural gas data furnished by:

ice Global markets in clear view

Day-Ahead Price Separation

- On Tuesday, November 11, depressed pricing in the Maine (ME) Load Zone was caused by a binding constraint on the Orrington-South Interface due to patterns of load and generation.
- On Tuesday, November 11, depressed pricing in the Vermont (VT) Load Zone was caused by a binding constraint on the Sheffield Highgate Export Interface due to the planned outage of the PV20-1 (Sandbar – South Hero) line. The PV20-1 line is expected to be restored on November 21.
- On Sunday, November 16, depressed pricing in the ME Load Zone was caused by a binding constraint on the Inner Rumford Export Interface due to the planned outage of the 209 (Raymond-Kimball Road) line. The 209 line is expected to be restored on November 21.

Real-Time Price Separation

- On Monday and Tuesday, November 10 and 11, depressed pricing in the ME Load Zone was caused by a binding constraint on the Orrington-South Interface due to patterns of load and generation.

Real-Time Price Corrections

- None.

Year-to-Date Peak Load Statistics*


- FCM Peak Load (preliminary, subject to change) is 26,086 MWh and occurred in the hour ending 7:00 P.M. on Tuesday, June 24. At this hour, the Capacity Zone-level FCM peak loads were 3,357 MWh in Northern New England, 2,026 MWh in Maine, 9,920 MWh in Rest-of-Pool, and 10,783 MWh in Southeast New England.
- Revenue Quality System Peak Load (initial) is 26,586 MWh and occurred in the hour ending 6:00 P.M. on Tuesday, June 24.
- Telemetered System Peak Load is 26,024 MWh and occurred in the hour ending 7:00 P.M. on Tuesday, June 24.


*Due to the difference in calculation methodologies, these values can occur on different days and hours.

Pricing


2.1 Pricing


The two graphs below show the weekly average of LMPs, congestion, and marginal loss components at the Hub and Load Zones for both the Day-Ahead and Real-Time Energy Markets.

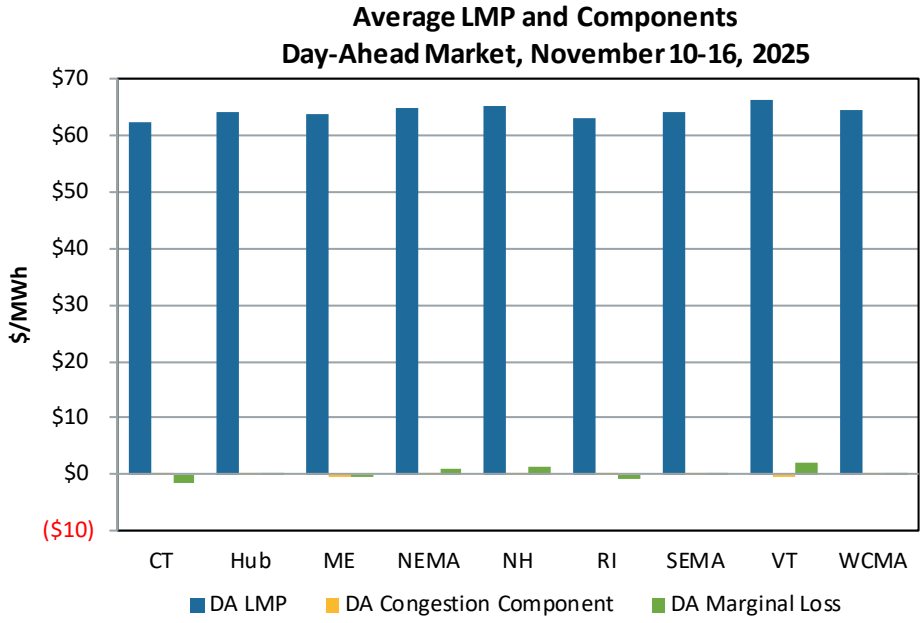

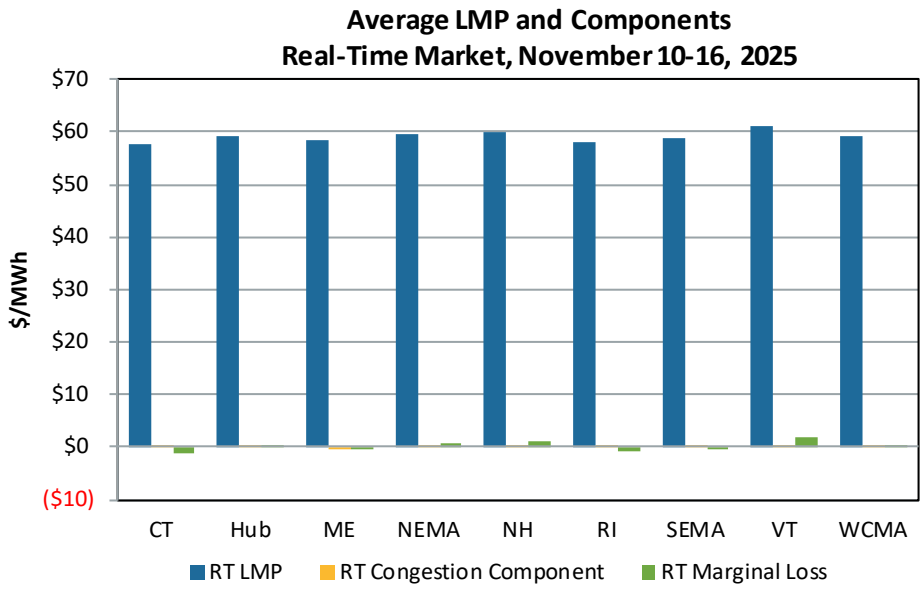



The following two graphs show hourly Day-Ahead LMPs for the Hub, the eight Load Zones, and the seven external nodes. In cases where there is little or no price separation, the lines for multiple locations may be indistinguishable from each other.

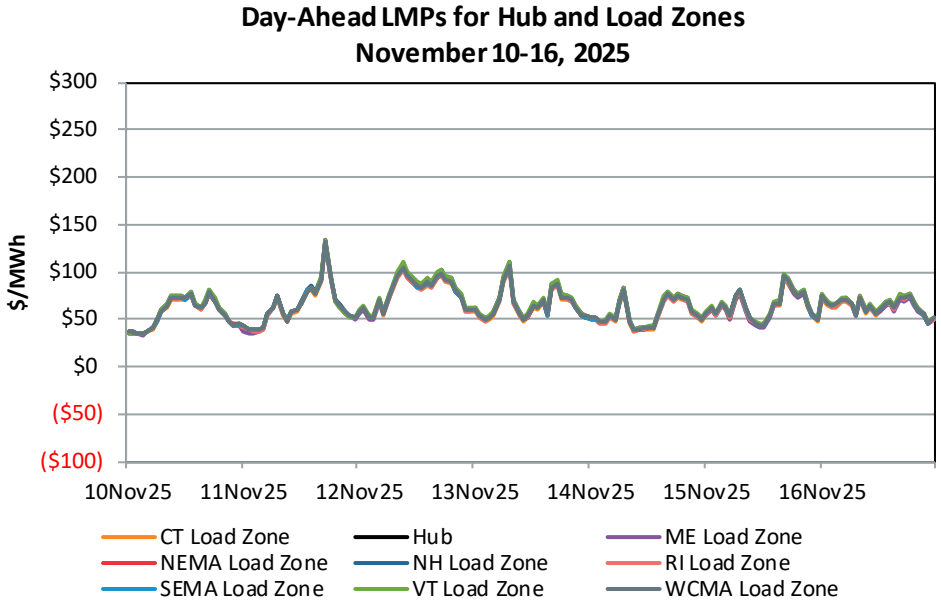

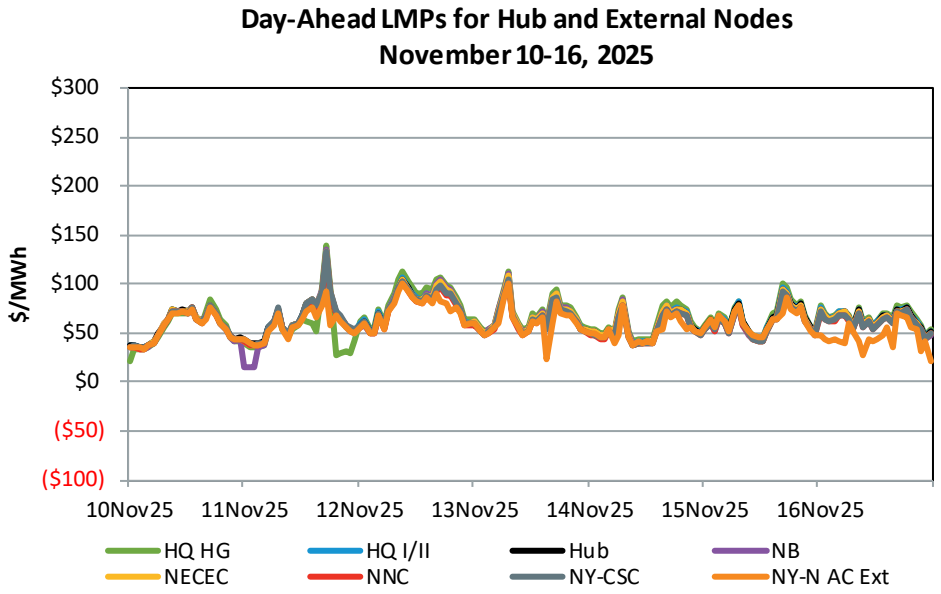

The following two graphs show hourly average Real-Time LMPs for the Hub, the eight Load Zones, and the seven external nodes. The 5-minute LMPs are averaged to create hourly values for comparison. The lines for multiple locations may be indistinguishable from each other.

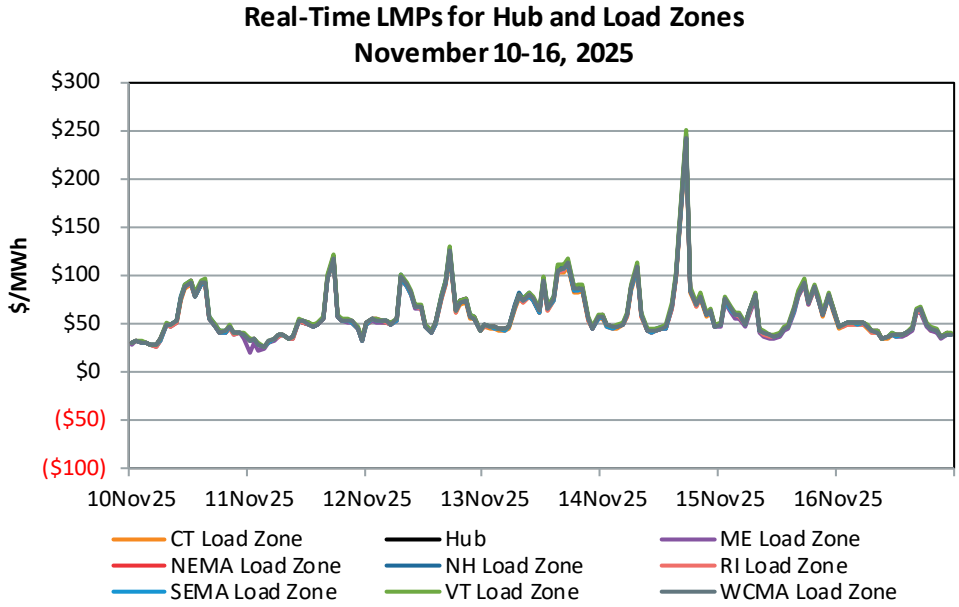

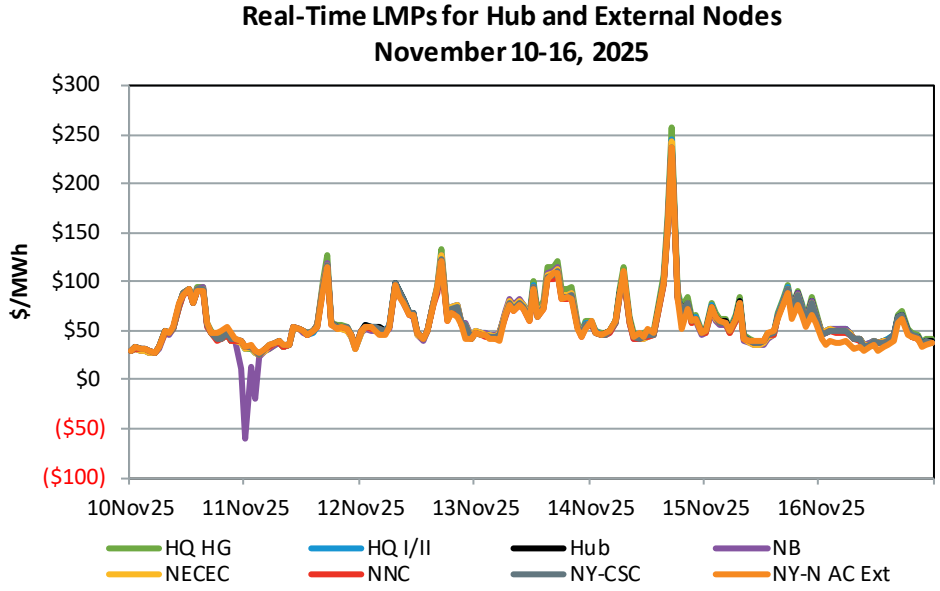

LMP Summary Statistics, November 10-16, 2025

Hub/Zone/ Ext. Node	Avg DA LMP ($/MWh)	*Avg RT LMP ($/MWh)	Min DA LMP ($/MWh)	Min RT LMP ($/MWh)	Max DA LMP ($/MWh)	Max RT LMP ($/MWh)	DA as % of Hub	*RT as % of Hub	*RT as % of DA	DA Std Dev	*RT Std Dev	*RT Std/DA Std
Hub	$64.21	$59.05	$34.75	$25.74	$131.27	$241.76	100%	100%	92%	16.41	26.04	159%
ME	$63.75	$58.29	$33.89	$19.34	$132.90	$241.69	99%	99%	91%	17.00	26.61	157%
NH	$65.41	$60.05	$34.81	$25.66	$134.23	$247.04	102%	102%	92%	17.07	26.78	157%
VT	$66.20	$60.97	$34.73	$26.00	$134.75	$251.27	103%	103%	92%	17.30	27.21	157%
CT	$62.57	$57.79	$34.10	$25.64	$129.75	$235.21	97%	98%	92%	16.10	25.31	157%
RI	$63.28	$58.20	$34.25	$25.44	$130.47	$238.74	99%	99%	92%	16.26	25.72	158%
SEMA	$64.25	$58.83	$34.62	$25.66	$132.39	$241.24	100%	100%	92%	16.52	25.99	157%
WCMA	$64.39	$59.23	$34.85	$25.89	$131.51	$242.56	100%	100%	92%	16.44	26.10	159%
NEMA	$65.04	$59.65	$34.90	$25.74	$133.82	$244.85	101%	101%	92%	16.77	26.42	158%
NB Ext	$63.42	$57.34	$15.05	$-60.31	$134.28	$242.30	99%	97%	90%	18.18	28.93	159%
NY-N AC Ext	$58.16	$57.11	$21.06	$26.45	$101.45	$237.18	91%	97%	98%	15.37	25.65	167%
HQ Ext	$64.78	$59.53	$34.53	$25.21	$131.78	$245.10	101%	101%	92%	16.68	26.50	159%
HG Ext	$65.31	$60.89	$21.63	$24.27	$138.47	$257.09	102%	103%	93%	19.37	28.24	146%
CSC Ext	$62.99	$58.86	$34.58	$26.07	$132.78	$237.55	98%	100%	93%	16.42	25.69	156%
NNC Ext	$62.11	$57.64	$34.03	$25.87	$129.46	$234.47	97%	98%	93%	16.01	25.11	157%
NECEC Ext	$64.00	$58.71	$33.94	$24.73	$132.83	$242.05	100%	99%	92%	16.90	26.36	156%

*This is the average of the 5-minute pricing intervals within the week.


5-Minute LMP Summary (RT Only)
November 10-16, 2025


Hub/Zone	Max RT LMP ($/MWh)	Min RT LMP ($/MWh)	RT Std Dev	RT as % of Hub
Hub	$344.80	$0.03	$29.42	100%
ME	$344.12	$0.03	$29.92	98%
NH	$352.19	$0.03	$30.21	102%
VT	$358.25	$0.03	$30.70	103%
CT	$335.57	$0.03	$28.61	98%
RI	$340.55	$0.03	$29.05	99%
SEMA	$343.95	$0.03	$29.36	100%
WCMA	$346.06	$0.03	$29.49	100%
NEMA	$349.14	$0.03	$29.83	101%

5-Minute Energy Component of LMP
November 10-16, 2025

Frequency Tabulation	< $0.00	$0.00 - $20.99	$21.00 - $40.99	$41.00 - $70.99	$71.00 - $100.99	$100.00 - $150.99	$150.00 - $200.99	$200.00 - $500.99	$500.00 - $1000.99	> $1000.99
5-Minute Energy	0.0%	0.3%	22.6%	52.3%	19.1%	5.0%	0.3%	0.4%	0.0%	0.0%

The next two graphs show hourly Day-Ahead and hourly Real-Time congestion components for the Hub and each of the eight Load Zones. The 5-minute values are averaged to create hourly values for comparison. The lines for multiple locations may be indistinguishable from each other.

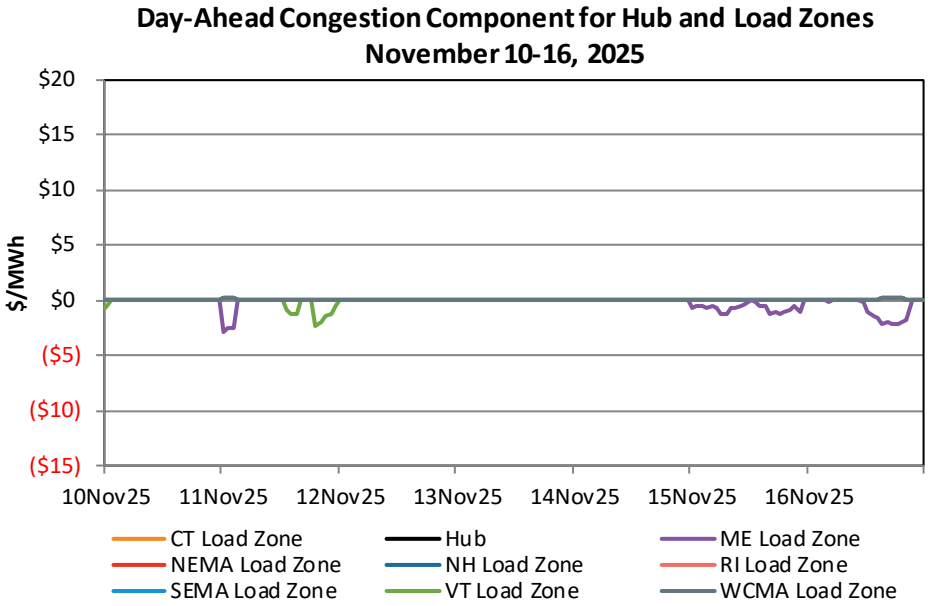

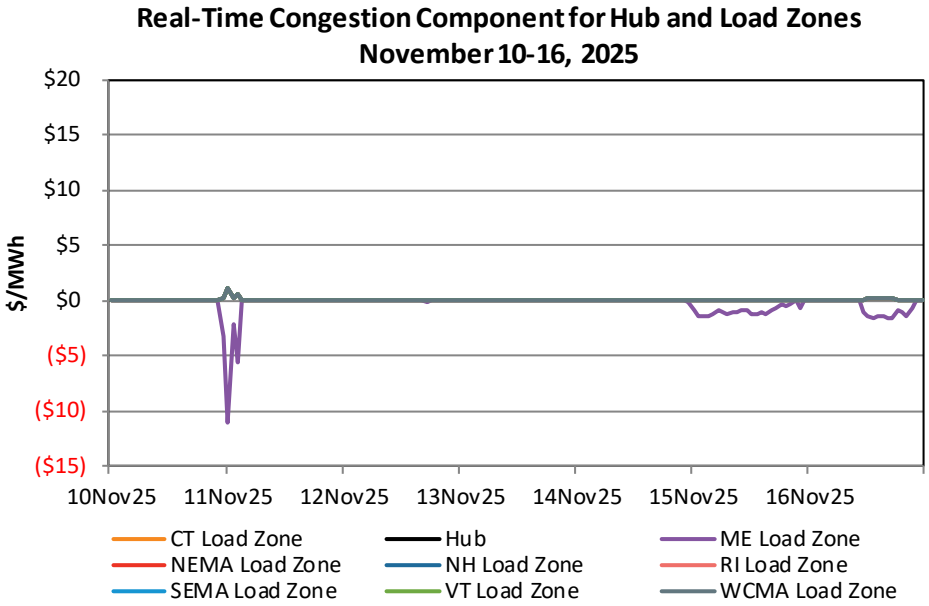


Energy Market Demand


3.1 Day-Ahead Demand

The following table displays the Day-Ahead Load Obligation at the Hub, Load Zones, and external nodes for this week, last week, the same week a year ago and the percent change for each.

Location	This Week (MWh)	Last Week (MWh)	% Chg vs. Prior Week	Last Year (MWh)	% Chg vs. Prior Year
Hub	11,941	21,678	-44.9%	7,836	52.4%
ME	205,950	198,230	3.9%	199,838	3.1%
NH	208,771	197,751	5.6%	201,437	3.6%
VT	108,311	100,974	7.3%	93,831	15.4%
CT	507,863	462,218	9.9%	464,775	9.3%
RI	136,508	126,781	7.7%	128,734	6.0%
SEMA	263,434	242,950	8.4%	263,953	-0.2%
WCMA	308,664	286,589	7.7%	280,993	9.8%
NEMA	444,647	414,693	7.2%	424,895	4.6%
NB Ext	23,440	33,006	-29.0%	73,139	-68.0%
NY-N AC Ext	82,014	102,986	-20.4%	72,672	12.9%
HQ Ext	103,015	116,352	-11.5%	48,787	111.2%
HG Ext	679	31	Large	38	Large
CSC Ext	0	23,040	-100.0%	14,672	-100.0%
NNC Ext	1,661	2,291	-27.5%	1,304	27.4%
NECEC Ext	0	0	N/A	0	N/A

Participants can bid fixed and price sensitive demand as well as submit virtual demand bids and virtual supply offers into the Day-Ahead Energy Market. The first graph below shows hourly cleared values for these four categories of bids and offers. The second graph shows average hourly values for the week.

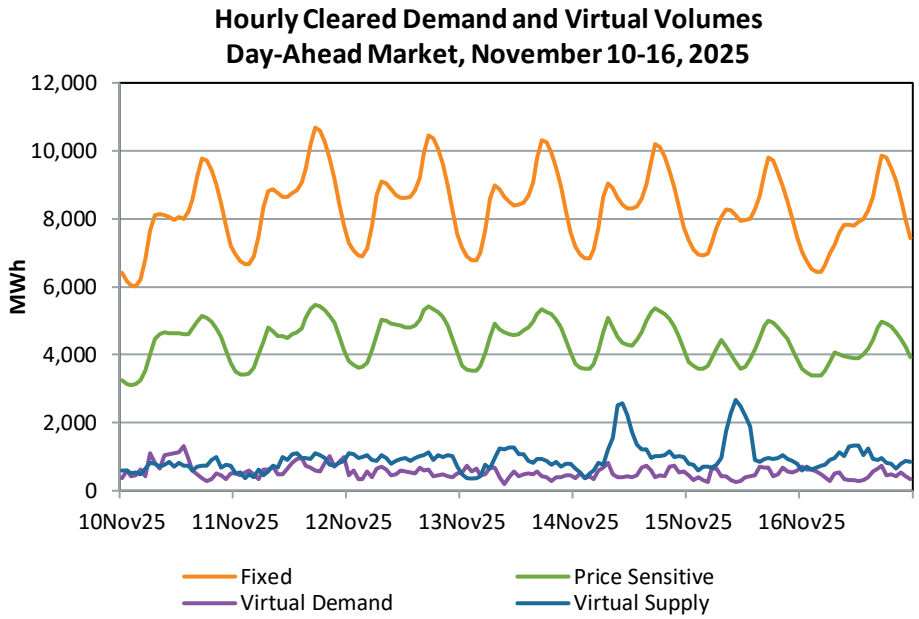

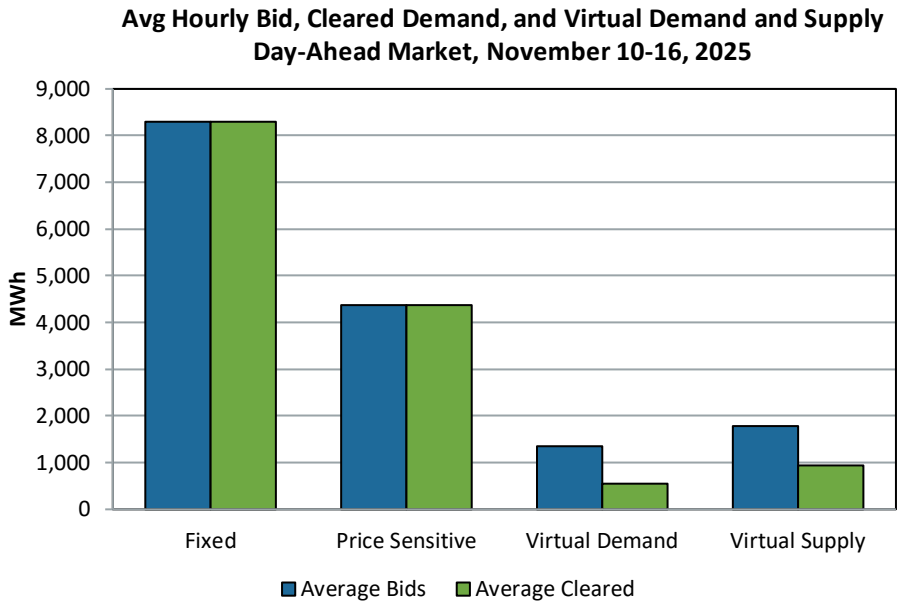

Daily Demand Bid and Virtual Volumes by Zone (MWh)

November 10-16, 2025

The following table summarizes Day-Ahead demand bid volumes submitted and cleared at the Hub and in the eight Load Zones (including nodal locations within each Load Zone) along with virtual demand (Decrement or 'Dec') bids and supply (Increment or 'Inc') offers on the same basis.

Location	Day	Fixed Demand Bids	Price Sens. Bids	Dec Bids	Inc Offers	Cleared Fixed Demand	Cleared Price Sens. Demand	Cleared Decs	Cleared Incs	Total DA Demand
Hub	10NOV25	0	0	3,934	4,116	0	0	2,121	2,733	2,121
Hub	11NOV25	0	0	4,880	9,185	0	0	2,726	3,992	2,726
Hub	12NOV25	0	0	3,655	7,813	0	0	1,284	6,842	1,284
Hub	13NOV25	0	0	2,544	10,704	0	0	1,003	5,887	1,003
Hub	14NOV25	0	0	3,658	6,495	0	0	1,436	3,997	1,436
Hub	15NOV25	0	0	3,514	6,855	0	0	1,249	5,489	1,249
Hub	16NOV25	0	0	2,668	3,272	0	0	1,362	2,824	1,362
ME	10NOV25	15,256	12,747	2,897	8,019	15,256	12,747	2,200	4,316	30,203
ME	11NOV25	16,111	12,989	2,853	9,256	16,111	12,989	1,329	5,812	30,428
ME	12NOV25	16,248	13,759	2,481	8,873	16,248	13,759	1,143	6,238	31,150
ME	13NOV25	16,177	13,532	1,838	5,168	16,177	13,532	891	2,437	30,600
ME	14NOV25	15,912	13,189	1,997	12,141	15,912	13,189	949	7,242	30,050
ME	15NOV25	15,402	12,504	1,860	10,264	15,402	12,504	777	6,592	28,682
ME	16NOV25	15,572	12,938	1,995	9,787	15,572	12,938	745	6,985	29,254
NH	10NOV25	21,481	6,954	1,987	3,165	21,481	6,954	1,426	1,197	29,860
NH	11NOV25	22,823	7,319	1,436	2,480	22,823	7,319	713	1,393	30,854
NH	12NOV25	22,836	7,573	1,877	2,224	22,836	7,573	1,133	1,089	31,542
NH	13NOV25	22,399	7,425	1,091	1,670	22,399	7,425	510	869	30,335
NH	14NOV25	22,361	7,324	1,179	4,611	22,361	7,324	375	2,735	30,060
NH	15NOV25	21,226	6,446	2,920	2,955	21,226	6,446	1,375	2,006	29,047
NH	16NOV25	20,824	6,414	1,856	2,268	20,824	6,414	304	1,671	27,543
VT	10NOV25	1,110	13,270	2,032	1,523	1,110	13,270	1,519	1,019	15,898
VT	11NOV25	1,136	13,551	2,138	1,245	1,136	13,485	1,463	792	16,083
VT	12NOV25	1,147	13,781	2,870	1,159	1,147	13,494	1,814	757	16,455
VT	13NOV25	1,144	13,557	1,993	1,355	1,144	13,557	1,254	738	15,955
VT	14NOV25	1,143	13,943	2,741	3,043	1,143	13,943	1,926	2,053	17,011
VT	15NOV25	1,182	13,047	2,284	2,666	1,182	13,047	1,180	2,212	15,408
VT	16NOV25	1,178	13,315	2,082	1,627	1,178	13,315	1,201	1,278	15,695
CT	10NOV25	41,207	25,749	6,663	980	41,207	25,749	3,571	540	70,526
CT	11NOV25	45,978	28,262	4,981	3,250	45,978	28,262	4,090	1,671	78,330
CT	12NOV25	44,905	28,692	4,709	3,451	44,905	28,692	3,074	2,702	76,670
CT	13NOV25	43,609	27,566	4,204	3,186	43,609	27,566	3,363	2,567	74,538
CT	14NOV25	44,251	27,471	3,562	4,156	44,251	27,471	2,588	2,910	74,310
CT	15NOV25	41,796	25,674	3,402	3,818	41,796	25,674	2,544	3,551	70,014
CT	16NOV25	39,822	24,625	3,633	3,244	39,822	24,625	2,690	2,404	67,136
RI	10NOV25	12,787	4,846	2,804	1,011	12,787	4,846	847	628	18,480
RI	11NOV25	13,833	5,824	2,302	1,036	13,833	5,824	957	637	20,613

Weekly Market Summary

Location	Day	Fixed Demand Bids	Price Sens. Bids	Dec Bids	Inc Offers	Cleared Fixed Demand	Cleared Price Sens. Demand	Cleared Decs	Cleared Incs	Total DA Demand
RI	12NOV25	13,657	6,042	2,512	583	13,657	6,042	829	397	20,528
RI	13NOV25	13,736	5,894	1,420	1,456	13,736	5,894	496	689	20,126
RI	14NOV25	13,394	5,884	1,957	2,144	13,394	5,884	893	1,470	20,171
RI	15NOV25	12,724	5,437	2,186	1,372	12,724	5,437	889	1,128	19,050
RI	16NOV25	12,212	5,187	2,425	1,176	12,212	5,187	653	841	18,052
SEMA	10NOV25	24,379	10,782	2,562	2,145	24,379	10,782	790	1,690	35,950
SEMA	11NOV25	26,869	11,225	2,215	2,082	26,869	11,225	542	2,068	38,636
SEMA	12NOV25	26,948	11,473	2,059	1,698	26,948	11,473	476	1,627	38,897
SEMA	13NOV25	26,815	11,001	1,860	2,234	26,815	11,001	496	1,364	38,312
SEMA	14NOV25	26,824	11,064	1,766	2,295	26,824	11,064	464	2,073	38,352
SEMA	15NOV25	27,075	9,996	1,584	2,870	27,075	9,996	280	2,710	37,351
SEMA	16NOV25	26,027	9,871	1,787	1,797	26,027	9,871	332	1,730	36,230
WCMA	10NOV25	29,808	11,322	4,347	1,590	29,808	11,322	2,139	1,336	43,269
WCMA	11NOV25	32,812	11,818	2,290	761	32,812	11,818	1,581	708	46,211
WCMA	12NOV25	32,946	12,056	2,422	2,191	32,946	12,056	1,570	1,728	46,572
WCMA	13NOV25	33,051	11,819	2,132	2,811	33,051	11,819	1,324	1,923	46,194
WCMA	14NOV25	32,456	11,549	2,278	3,792	32,456	11,549	1,358	2,374	45,363
WCMA	15NOV25	30,734	10,215	2,831	1,129	30,734	10,215	1,777	872	42,726
WCMA	16NOV25	29,976	9,877	1,414	782	29,976	9,877	763	722	40,615
NEMA	10NOV25	43,149	16,773	2,517	1,922	43,149	16,773	930	1,672	60,852
NEMA	11NOV25	46,994	17,470	2,845	1,720	46,994	17,470	1,006	1,362	65,469
NEMA	12NOV25	47,869	18,125	2,125	1,603	47,869	18,125	852	1,152	66,845
NEMA	13NOV25	46,535	17,721	2,331	2,925	46,535	17,721	1,055	1,766	65,311
NEMA	14NOV25	46,730	17,708	1,401	3,073	46,730	17,708	656	2,056	65,093
NEMA	15NOV25	44,917	16,089	1,600	1,758	44,917	16,089	555	1,754	61,561
NEMA	16NOV25	43,865	15,496	1,577	1,446	43,865	15,496	520	1,338	59,880

3.2 Real-Time Demand


The following table displays the Real-Time Load Obligation at each Load Zone and external nodes for this week, last week, the same week a year ago, and the percent change for each.

Location	This Week (MWh)	Last Week (MWh)	% Chg vs. Prior Week	Last Year (MWh)	% Chg vs. Prior Year
ME	210,931	199,112	5.9%	199,354	5.8%
NH	215,130	202,923	6.0%	201,963	6.5%
VT	101,316	90,037	12.5%	92,166	9.9%
CT	490,878	456,845	7.4%	459,644	6.8%
RI	132,435	128,051	3.4%	128,809	2.8%
SEMA	253,114	238,633	6.1%	237,161	6.7%
WCMA	298,152	282,570	5.5%	280,782	6.2%
NEMA	429,020	409,164	4.9%	409,011	4.9%
NB Ext	21,076	37,080	-43.2%	78,425	-73.1%
NY-N AC Ext	190,470	190,528	0.0%	136,222	39.8%
HQ Ext	102,488	127,032	-19.3%	49,775	105.9%
HG Ext	1,816	681	166.7%	14,865	-87.8%
CSC Ext	0	20,584	-100.0%	13,483	-100.0%
NNC Ext	3,404	6,546	-48.0%	2,999	13.5%
NECEC Ext	0	0	N/A	0	N/A

Real-Time Peak Hour System Load and Associated Average Hourly LMPs

Day	Hour	System Load (MWh)	Hub	Maine Load Zone	NH Load Zone	VT Load Zone	CT Load Zone	RI Load Zone	SEMA Load Zone	WCMA Load Zone	NEMA Load Zone
10NOV25	18	15,001	$47.52	$47.86	$48.55	$49.46	$46.76	$46.95	$47.45	$47.77	$48.03
11NOV25	18	16,488	$117.50	$117.46	$119.96	$122.41	$115.28	$116.43	$117.56	$117.73	$119.08
12NOV25	18	15,856	$124.57	$126.80	$128.38	$129.56	$121.03	$122.67	$124.10	$124.84	$126.49
13NOV25	18	15,590	$111.94	$113.64	$115.09	$117.24	$108.89	$110.32	$111.60	$112.29	$113.53
14NOV25	18	15,374	$241.76	$241.69	$247.04	$251.27	$235.21	$238.74	$241.24	$242.56	$244.85
15NOV25	18	14,615	$92.86	$91.27	$94.37	$95.73	$90.67	$92.06	$92.75	$92.85	$93.83
16NOV25	18	15,196	$65.20	$62.22	$66.02	$67.52	$64.05	$64.20	$64.89	$65.20	$65.74

The graph below compares the hourly quantities of cleared Day-Ahead demand with the forecast and actual load. Cleared demand is the total of cleared fixed demand bids, cleared price sensitive demand bids, and cleared Decrement bids.

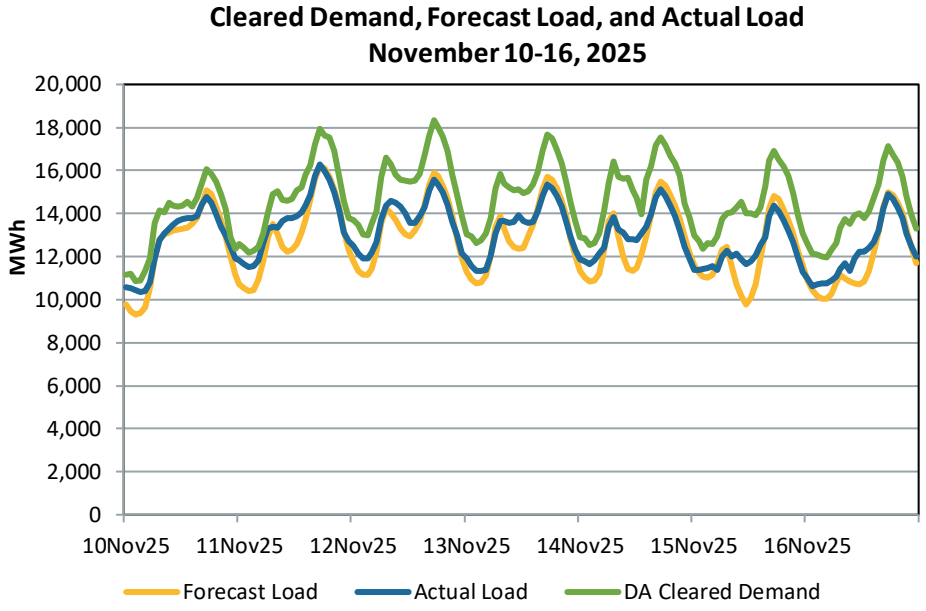


The table below compares the total quantities (MWh) of Day-Ahead Load Obligation with the Real-Time Load Obligation for each Load Zone (including nodal locations within each Load Zone) for the week. Day-Ahead Load Obligation is composed of Day-Ahead cleared demand bids and cleared Decrement bids. Real-Time Load Obligation is comprised of metered load and internal bilateral contracts for load.

Zone	DA Load Obligation (MWh)	RT Load Obligation (MWh)	DA Delta (MWh)	DA % of RT
ME	210,367	211,868	-1,501	99.3%
NH	209,241	215,436	-6,196	97.1%
VT	112,505	101,316	11,189	111.0%
CT	511,832	491,263	20,569	104.2%
RI	137,020	132,435	4,585	103.5%
SEMA	263,727	255,292	8,435	103.3%
WCMA	345,010	347,381	-2,371	99.3%
NEMA	445,011	429,105	15,906	103.7%

Energy Market Supply

4.1 Day-Ahead Supply

The following graph displays hourly Day-Ahead Generation Obligation, along with cleared Day-Ahead Increment offers (virtual supply), Day-Ahead Demand Reduction (DR) Obligation, and Day-Ahead Import volume.

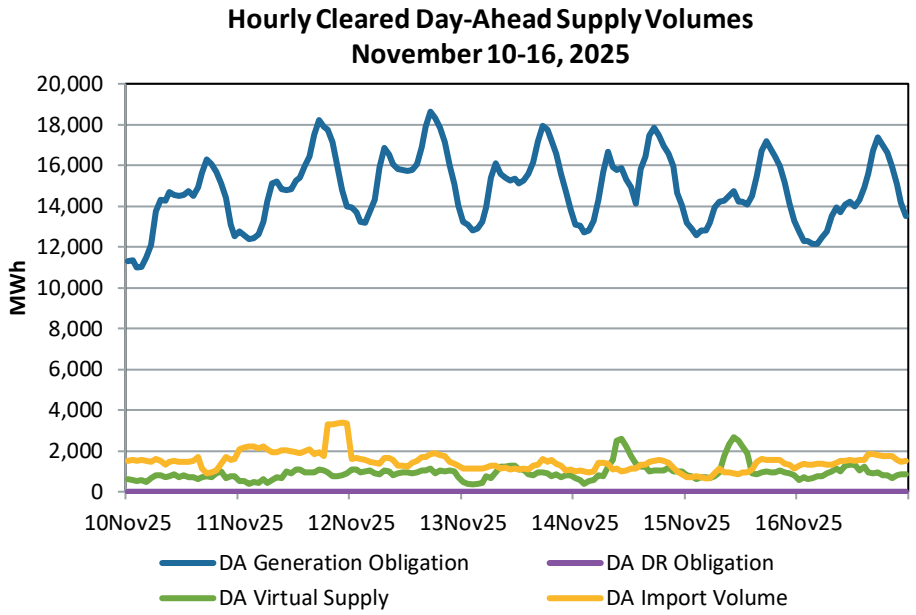

The following table displays the average hourly Day-Ahead Generation and Day-Ahead Demand Reduction Obligation, along with cleared Day-Ahead Virtual Supply and Day-Ahead Import Volume, for this week, last week, the same week a year ago, and the percent change for each.

Type	This Week (MWh)	Last Week (MWh)	% Chg vs. Prior Week	Last Year (MWh)	% Chg vs. Prior Year
DA Generation Obligation	14,835	14,314	3.6%	14,007	5.9%
DA Demand Reduction Obligation	0	0	N/A	0	N/A
DA Cleared Increments	938	978	-4.1%	964	-2.7%
DA Imports	1,472	1,269	16.0%	1,690	-12.9%

The following table provides the total Day-Ahead Imports by Interface for This Week, Last Week, the same week a year ago and the percent change for each.

Location	This Week (MWh)	Last Week (MWh)	% Chg vs. Prior Week	Last Year (MWh)	% Chg vs. Last Yr
NB Ext	10,908	3,410	219.9%	13,469	-19.0%
NY-N AC Ext	204,757	190,047	7.7%	198,934	2.9%
HQ Ext	17,952	14,469	24.1%	61,607	-70.9%
HG Ext	8,252	221	Large	2,692	206.5%
CSC Ext	0	0	N/A	1,121	N/A
NNC Ext	4,709	3,799	24.0%	5,061	-7.0%
NECEC Ext	0	0	N/A	0	N/A

4.2 Real-Time Supply


The following table provides daily and weekly totals, in megawatt-hours (MWh), of the amount of electricity produced by classified fuel type during the week. The data provided are for the full system, including "settlement only" resources that do not offer their output into the wholesale markets. The Price Responsive Demand (PRD) category below refers to Demand Reduction from Demand Response Resources (DRR). Annual files of Daily Generation by Fuel Type and further detail of the fuels composing the categories below may be found on the ISO's web site here.

	Metered Generation (Megawatt hours)							
Category	10Nov25	11Nov25	12Nov25	13Nov25	14Nov25	15Nov25	16Nov25	Total
Coal	0	7	0	32	32	35	4	110
Hydro	17,278	20,522	22,473	20,707	19,994	16,135	15,297	132,405
Landfill Gas	1,045	1,119	1,053	928	831	1,069	832	6,877
Methane	66	65	66	66	57	56	49	425
Natural Gas	165,674	149,291	196,729	203,375	191,501	171,763	159,866	1,238,200
Nuclear	80,401	80,446	80,430	80,463	80,478	80,492	80,447	563,156
Oil	60	473	4	10	446	8	1	1,002
Other	654	1,136	1,250	1,065	1,881	1,768	1,257	9,011
PRD	0	12	0	0	15	0	0	26
Refuse	7,398	7,329	7,470	6,759	7,399	7,565	7,122	51,041
Solar	1,568	6,235	5,990	4,233	10,600	13,135	6,992	48,753
Wind	17,835	22,059	16,794	10,059	16,832	13,724	22,421	119,724
Wood	5,116	5,148	5,354	5,278	4,991	5,417	5,579	36,884
Total	297,097	293,840	337,611	332,976	335,057	311,168	299,867	2,207,615


Online generators that are at their Economic Minimum output level are not eligible to set the clearing price. Real-Time Self-Scheduled Generation shown below reflects output by self-scheduled generation and by (non-dispatchable) Settlement Only Resources (SORs). Real-Time Reliability Generation represents the aggregate economic minimum output level of generation committed for reliability reasons. The following table shows the sum of generation self-scheduled (and SORs), and that of Real-Time reliability committed units, and, for reference, the total daily generation in megawatts by day for the current week.

Day	Self-Scheduled MWh	RT Reliability MWh	Total Generation MWh
10Nov25	109,693	0	297,097
11Nov25	115,744	0	293,840
12Nov25	114,870	0	337,611
13Nov25	111,956	0	332,976
14Nov25	116,400	0	335,057
15Nov25	118,071	0	311,168
16Nov25	114,943	0	299,867

The following graph shows the total economic minimum MWh of self-scheduled generation and generation committed for reliability as a percentage of total generation.

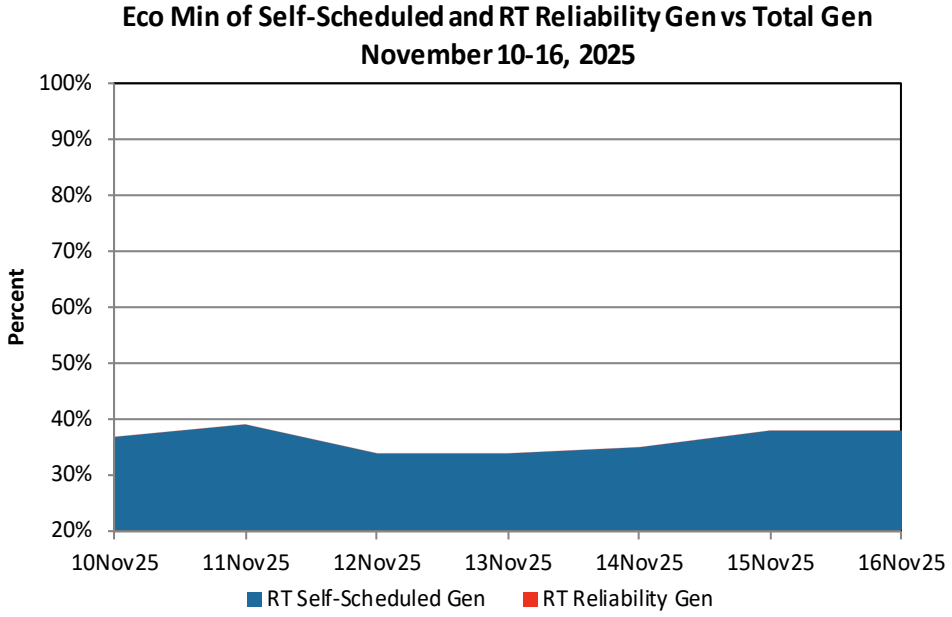


The following graph shows the average number of self-scheduled generating units and MWh for each hour of the last week.

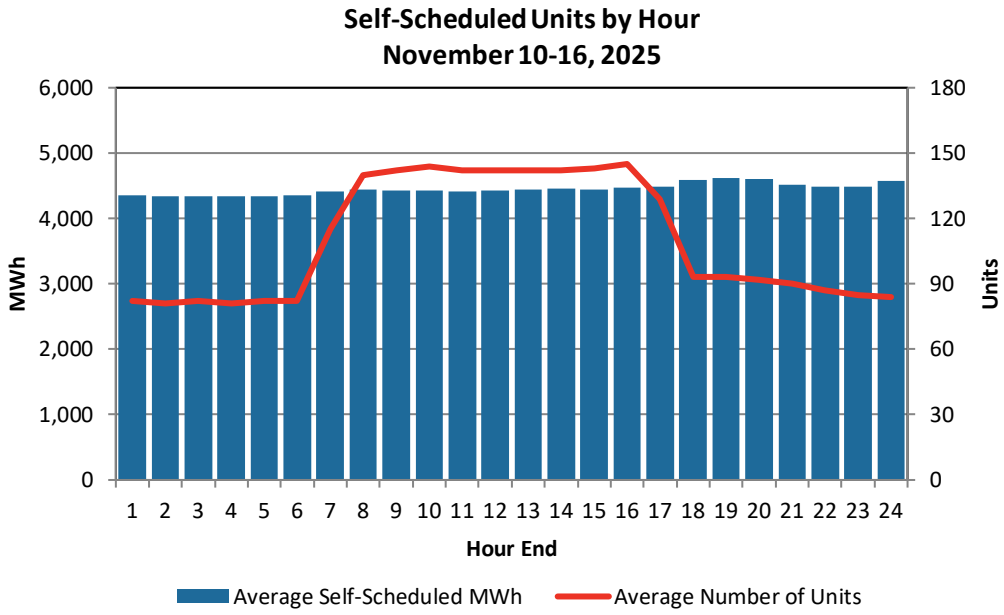


The following table provides the total Real-Time Imports by Interface for this week, last week, the same week a year ago, and the percentage change for each.

Location	This Week (MWh)	Last Week (MWh)	% Chg vs. Prior Week	Last Year (MWh)	% Chg vs. Last Yr
NB Ext	11,923	3,007	296.5%	14,069	-15.3%
NY-N AC Ext	260,979	267,635	-2.5%	255,441	2.2%
HQ Ext	40,327	3,877	Large	60,335	-33.2%
HG Ext	15,859	2,384	Large	17,372	-8.7%
CSC Ext	0	0	N/A	0	N/A
NNC Ext	7,545	4,761	58.5%	7,595	-0.7%
NECEC Ext	0	0	N/A	0	N/A

The following graph shows the percentage of time in which a particular resource-type was responsible for setting the price during each of the last 52 weeks.

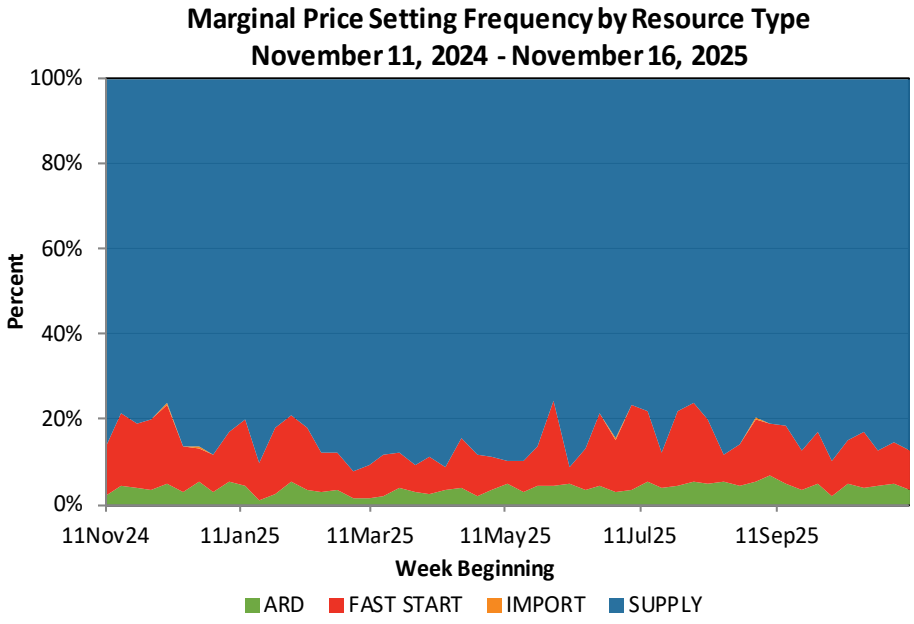

The next graph shows the percentage of time in which a registered fuel type was responsible for setting the price during each hour of the last week. The Price Responsive Demand (PRD) category below refers to Demand Reduction Obligation from Demand Response Resources (DRR). The exhibit only summarizes the intervals in which one unit was marginal, which was 46% of all intervals during the week. For a load-weighted analysis of marginality, see Section 3.2 of Quarterly Markets Report, located here.

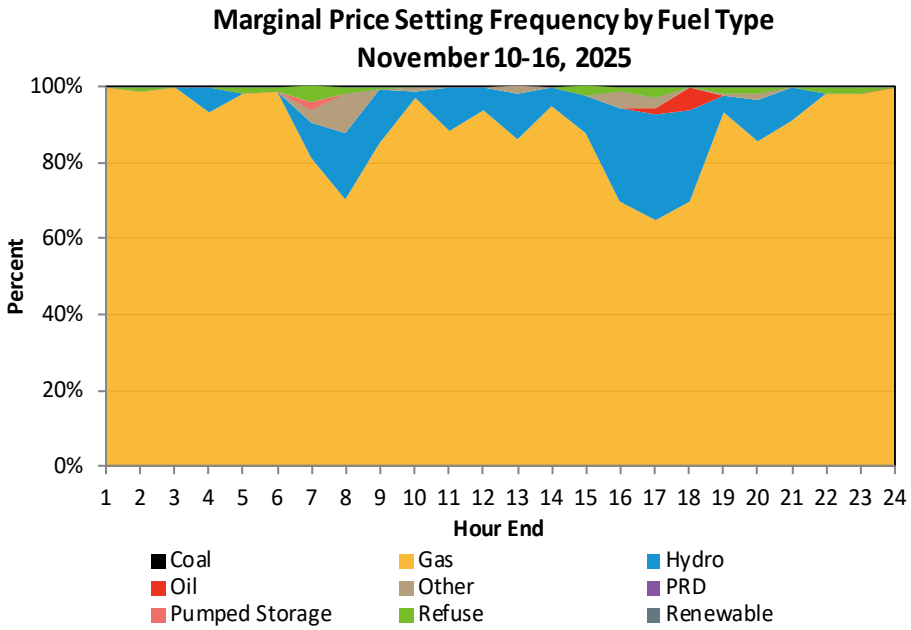

Net Commitment Period Compensation (NCPC)

5.1 Net Commitment Period Compensation

NCPC information does not appear in this report. Aggregate NCPC data continues to be provided in the supplemental Excel file on a one-week lag.

An NCPC Summary report is published to the Market Performance Reports webpage each Thursday or Friday.

The NCPC summary features daily-level summary charges and includes new detailed information concerning:

- Day-Ahead (DA) and Real-Time (RT) First Contingency payments to both internal and external payees
- DA and RT Second Contingency payments, including reliability region detail
- Voltage, Distribution, and Generator Performance Audit detail
- RT Detail for these concepts: Out of Merit, Canceled Starts, Hourly Shortfall, Posturing, Rapid Response Pricing Opportunity Cost, and Dispatch Lost Opportunity Cost

This report also includes a companion spreadsheet that contains daily, year-to-date totals for each of these concepts. The report and spreadsheet are also posted here, select 'NCPC Summary' from the document type filter on the left side of the page.

Energy Market Payments


6.1 Energy Market Payments

The table below displays the three components that make up the Energy Market payment for the prior week. These are payments made in relation to Day-Ahead LMPs, payments associated with the Day-Ahead Forecast Energy Requirement (FER), and payments related to deviations from Day-Ahead energy positions that occur in Real-Time.


Energy Market Payment Summary
November 10-16, 2025

DA LMP Payments (A)	DA FER Payments (B)	RT Dev Payments (C)	Energy Market Payment (D=A+B+C)
$160,363,284	$20,612,722	$2,009,254	$182,985,261

The following chart shows the percentage contribution of the two components of the Day-Ahead Energy Market payment.

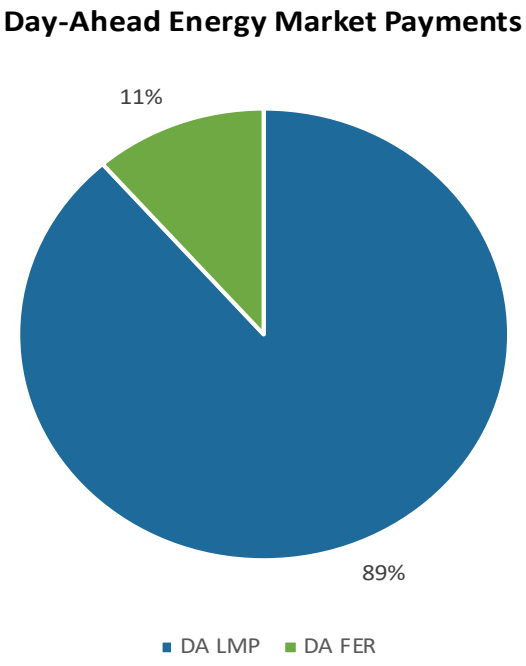


The chart below shows the magnitude of each component's contribution to the total Energy Market payment.

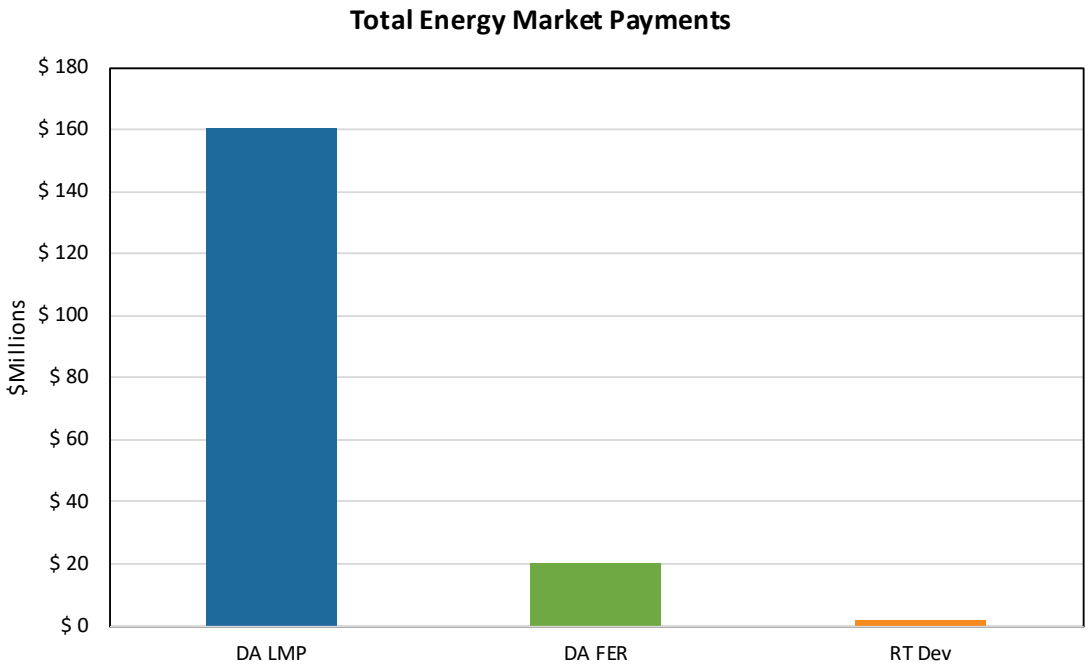


Flexible Response Services (FRS)

7.1 FRS Pricing

The following graph shows the hourly FRS Clearing Prices for the past week.

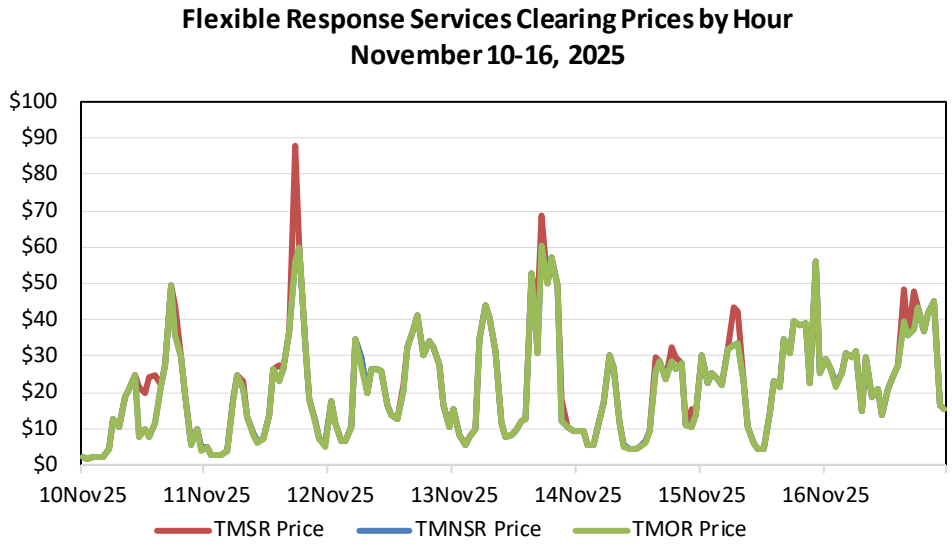

The hourly closeout charge rate is the max of the (RT Hub LMP – Strike Price) and 0. The graph below shows the hourly closeout charge rate during the week.

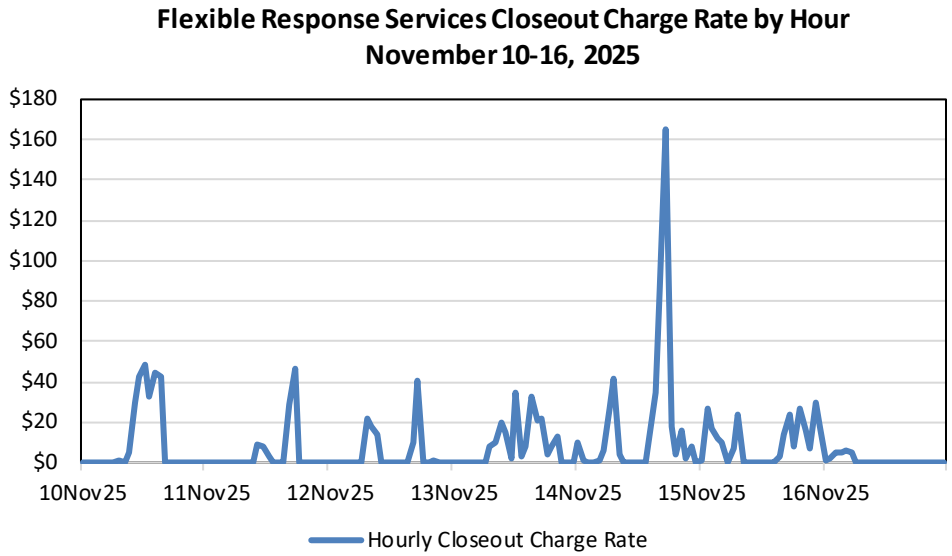


Percentage of Hours with Closeout Charge Rates
November 10-16, 2025

Frequency Tabulation	$0.00	$0.01 - $4.99	$5.00 - $9.99	$10.00 - $19.99	$20.00 - $49.99	$50.00 - $99.99	> $100.00
Hourly Closeout Charge Rate	57.2%	10.7%	7.7%	10.1%	13.1%	0.6%	0.6%

7.2 FRS Quantities

The following graph shows the Hourly Cleared MWh of each FRS product.

Cleared Flexible Response Services MW by Hour
November 10-16, 2025

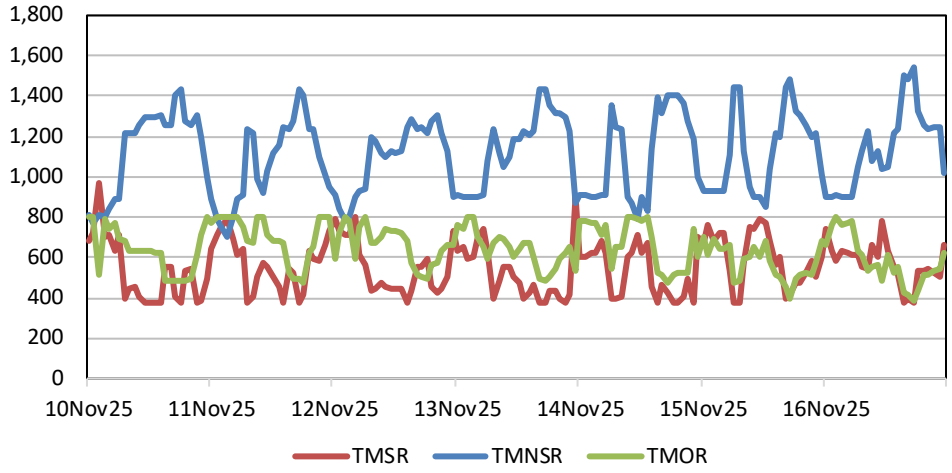


7.3 FRS Payments

FRS payments made to units during the prior week are shown in the following table. FRS procurements are made to satisfy the system level requirement for these services. The figures below are preliminary, and subject to revision during the settlement process.

Flexible Response Services Payment Summary
November 10-16, 2025

Product Type	FRS Payments (A)	FRS Closeout Charges (B)	FRS Net Payments/Charges (C=A+B)
TMSR	$1,902,494	-$622,149	$1,280,345
TMNSR	$4,253,080	-$1,709,128	$2,543,952
TMOR	$2,110,877	-$772,611	$1,338,266
Total	$8,266,451	-$3,103,888	$5,162,563


The following graph shows the daily Credit and Closeout charges by FRS product type:

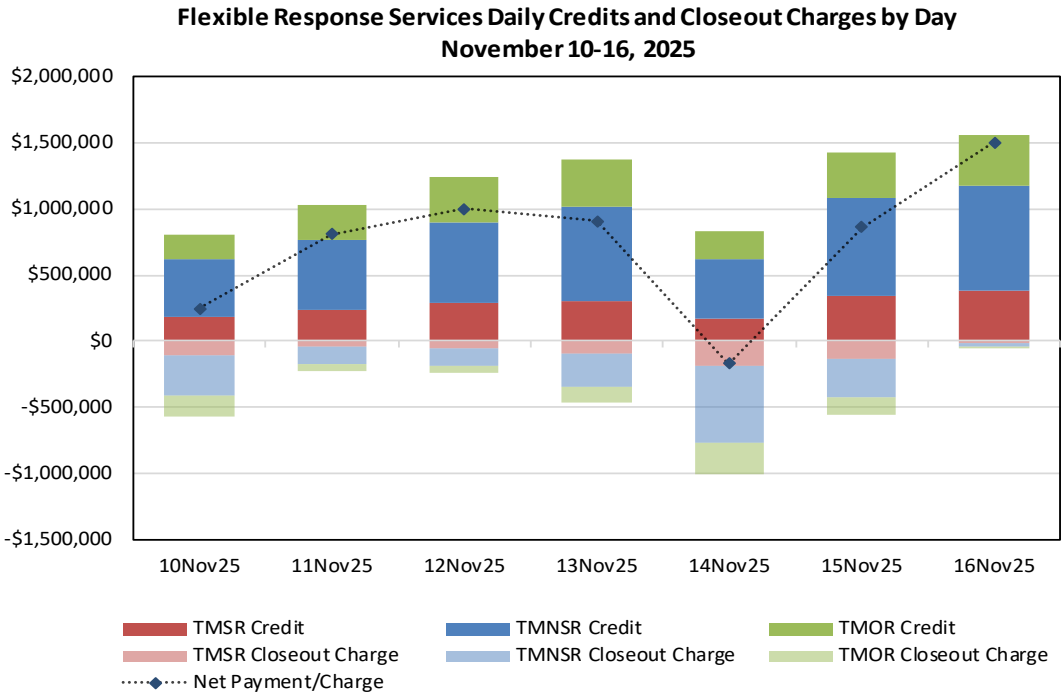

Energy Imbalance Reserves (EIR)

8.1 EIR Pricing

Units with an EIR Obligation are compensated based on the Forecast Energy Requirement Price (FERP). The graph below shows the FERP by hour.

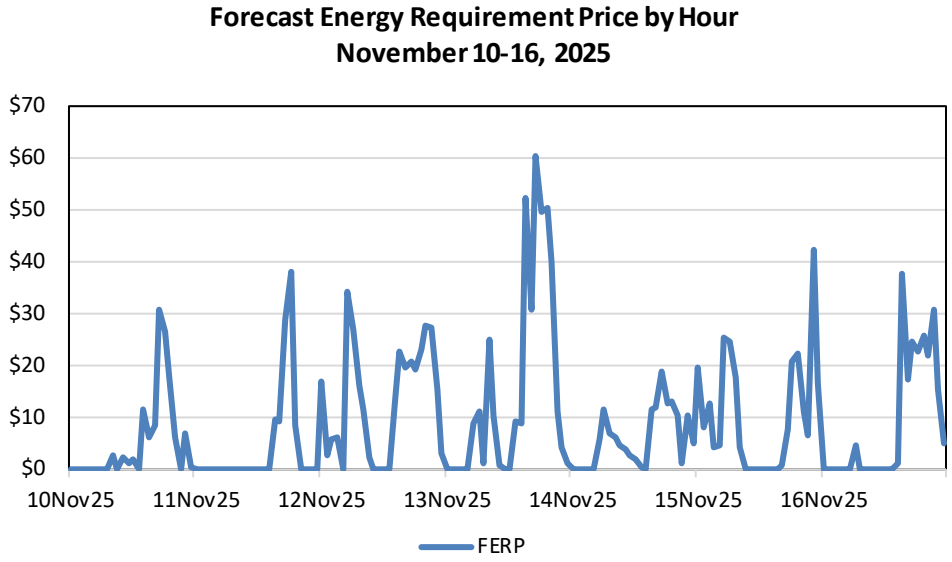

The following table shows the distribution of the hourly FERP during the reporting week.


Hourly Forecast Energy Requirement Price Distribution
November 10-16, 2025

Frequency Tabulation	$0.00	$0.01 - $4.99	$5.00 - $9.99	$10.00 - $19.99	$20.00 - $49.99	$50.00 - $99.99	> $100.00
FERP	39.2%	15.5%	11.9%	16.1%	15.5%	1.8%	0.0%

8.2 EIR Obligations

The following graph shows the hourly EIR Obligation MWh values for the week.

Hourly Energy Imbalance Reserves Obligation MWh
November 10-16, 2025

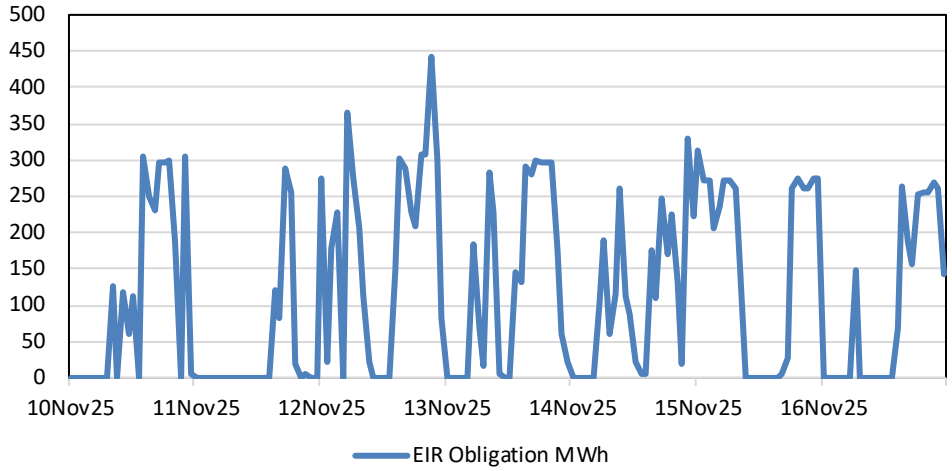

The table below shows the distribution of the hourly EIR Obligation MWh during the reporting week.

Energy Imbalance Reserves Obligation MWh Distribution
November 10-16, 2025

Frequency Tabulation	0 MWh	0.01-49.99 MWh	50.0-99.99 MWh	100.0-249.99 MWh	250.0-499.99 MWh	500.0-999.99 MWh	> 1,000 MWh
EIR Obligation MWh	39.3%	8.3%	4.8%	21.4%	26.2%	0.0%	0.0%

8.3 EIR Payments

EIR payments made to units during the reporting week are shown in the following table. These figures are preliminary, and subject to revision during the settlement process.

Energy Imbalance Reserves Payment Summary
November 10-16, 2025

EIR Payments (A)	EIR Closeout Charges (B)	EIR Net Payments/Charges (C=A+B)
$380,352	-$237,109	$143,243

Real-Time Reserve Market

9.1 Real-Time Reserve Payments

Real-Time Reserve Payment Summary by Reserve Zone
November 10-16, 2025

DAY	CT	NEMABSTN	ROS	SWCT	Total
10NOV25	$93.38	$45.43	$1,466.59	$74.53	$1,679.93
11NOV25	$15,532.35	$8,315.24	$41,560.06	$26,132.11	$91,539.76
12NOV25	$123.63	$47.60	$2,082.82	$134.92	$2,388.97
13NOV25	$1,108.53	$1,349.25	$10,732.22	$719.73	$13,909.73
14NOV25	$71,817.31	$42,468.35	$219,067.98	$89,723.44	$423,077.08
15NOV25	$588.12	$357.53	$4,873.67	$1,059.78	$6,879.10
16NOV25	$4.92	$11.06	$73.33	$7.57	$96.88
Total	$89,268.24	$52,594.46	$279,856.67	$117,852.08	$539,571.45

The following table shows Real-Time Reserve clearing prices. These figures are also preliminary and subject to revision during the settlement process.

Real-Time Reserve Clearing Price Frequency, Local Reserve Zones
November 10-16, 2025

Product	Zero-Priced 5-Minute Intervals	Non-Zero 5-Minute Intervals	Percent of Non-Zero 5-Minute Intervals During the Week						
			<=$10	$10.01-$50	$50.01-$100	$100.01-$200	$200.01-$500	$500.01-$1000	>$1,000
TMSR	93.5%	6.5%	62.9%	28.0%	0.8%	3.8%	4.5%	0.0%	0.0%
TMNSR	98.9%	1.1%	4.5%	40.9%	4.5%	22.7%	27.3%	0.0%	0.0%
TMOR	99.0%	1.0%	0.0%	40.0%	5.0%	25.0%	30.0%	0.0%	0.0%

Real-Time Reserve Clearing Price Frequency, Local Reserve Zones
November 10-16, 2025

Local Reserve Zone	Product	Zero-Priced 5-Minute Intervals	Non-Zero 5-Minute Intervals
Connecticut	TMSR	93.5%	6.5%
	TMNSR	98.9%	1.1%
	TMOR	99.0%	1.0%
NEMA/Boston	TMSR	93.5%	6.5%
	TMNSR	98.9%	1.1%
	TMOR	99.0%	1.0%
Rest Of System	TMSR	93.5%	6.5%
	TMNSR	98.9%	1.1%
	TMOR	99.0%	1.0%
Southwest Connecticut	TMSR	93.5%	6.5%
	TMNSR	98.9%	1.1%
	TMOR	99.0%	1.0%

The table below displays the time intervals, reserve types, and bias adjustment values for any reserve bias adjustments during this week.

Real-Time Reserve Bias
November 10-16, 2025

Local Day	Reserve Bias
November 10-16, 2025	None

Capacity Scarcity Conditions (CSC)

10.1 Capacity Scarcity Conditions

A Capacity Scarcity Condition (CSC) occurs when there is a deficiency in one or more of the three reserve requirements and the reserve-constraint penalty factor (RCPF) is setting the Real-Time Reserve price. More information can be found here in section III.13.7.2.1.

The preliminary balancing ratio is a value representing the initially calculated relationship between the required capacity and the total Capacity Supply Obligation during a CSC. The balancing ratio is computed using the following formula:

(Load + Reserve Requirement) / Total Capacity Supply Obligation

The OP-4 Actions are the eleven actions, outlined by Operating Procedure 4, that ISO-NE uses to restore capacity during periods of capacity deficiency. More information and descriptions of each OP-4 Action can be found here.

The tables below display the time intervals, OP-4 Actions, and preliminary balancing ratio for any Capacity Scarcity Conditions during this week.

System-wide Capacity Scarcity Condition Detail[1]
November 10-16, 2025

Day	5-Minute Interval Beginning	Location	OP-4 Actions	Preliminary Balancing Ratio
There were no System-wide Capacity Scarcity Condition events during this period.				

Local Capacity Scarcity Condition Detail
November 10-16, 2025

Day	5-Minute Interval Beginning	Location	OP-4 Actions	Preliminary Balancing Ratio
There were no Local Capacity Scarcity Condition events during this period.				

[1] The initial value may change at time of actual market settlement.

Glossary and Links

11.1 Peak Load Statistics

FCM System Load

FCM system load is the sum of active load assets that are non-dispatchable and that are included in the FCM settlement. Information is used to establish a load asset's contribution to the peak system load for purposes of the Forward Capacity Market (FCM). For more information on the FCM annual system peak day, hour, and load, see the ISO website here.

Revenue Quality System Load

The revenue quality system load is the metered settlement value of the system 'net energy' for load concept. It is defined as the sum of generation, net external interchange, and the reduction provided by dispatched Demand Response Resources (DRR), less load from pumped storage units and energy storage devices.

Telemetered System Load

The telemetered system load value represents the calculated 'real-time' demand for electricity in the New England Balancing Authority Area that represents a telemetered aggregation of generation, net interchange, DRR reconstitution and excluding pumping load.

11.2 Locational Marginal Price (LMP)

A LMP is a calculated price of wholesale electric energy at a pricing node, Load Zone, reliability region, or the Hub. LMPs are comprised of three components: energy, congestion, and marginal losses. The energy component is the same at all locations, while the congestion and marginal loss components can vary among locations. More information on LMPs can be found at the ISO web site here.

Analyze: Weekly Average Day-Ahead LMP Statistics, Hub and Load Zones (53 weeks, Excel format.)
TAB NAME: 'Avg DA and RT LMP Hub and Zones'

Analyze: Weekly Average Congestion and Loss Components, Hub and Load Zones (53 weeks, Excel format.)
TAB NAME: 'Average Congestion and Loss'

11.3 Day-Ahead and Real-Time Energy Markets

Day-Ahead and Real-Time Demand

Participants can bid fixed and price sensitive demand into the Day-Ahead Energy Market. They can also submit virtual demand bids called Decrement (Dec) bids as well as External Transaction bids. Day-Ahead Load Obligation (DALO) is the result of clearing the Day-Ahead Energy Market, and is aggregated by location. DALO is the total MWh of cleared demand bids, cleared Decs, and cleared External Transaction sales at all locations. Real-Time Load Obligation (RTLO) is the total MWh of a participant's metered load including External Transaction sales.

Analyze: Weekly Total Day-Ahead and Real-Time Load Obligation, Hub and Zones (53 weeks, Excel format)

TAB NAME: 'Total DA and RT Load Obligation'

Day-Ahead and Real-Time Supply

Participants can bid "must run" and Economic supply into the Day-Ahead Energy Market. They can also submit virtual supply offers called Increment (Inc) offers as well as External Transaction offers. Day-Ahead Generation Obligation (DAGO) is the result of clearing the Day-Ahead Energy Market, and is aggregated by Location. DAGO is the total MWh of cleared supply offers, cleared Inc offers, and cleared External Transaction purchases at all locations. Real-Time Generation Obligation (RTGO) is equal to the MWh of energy provided by Generators and External Transaction purchases at that Location. Real-Time Generation Obligation Deviation is the total MWh of a participant's metered generation less their DAGO positions.

Analyze: Weekly Total Day-Ahead Generation Obligation, Hub and Zones (53 weeks, Excel format)
TAB NAME: 'DA Supply'

Analyze: Marginal Fuel Type by Week (53 weeks, Excel format).
TAB NAME: 'Percent Marginal Fuel Type'

Analyze: Marginal Resource Type by Week (53 weeks, Excel format).
TAB NAME: 'Percent Marginal Resource Type'

System Load

System Load is 'net energy' for load on the system and is defined as the sum of generation and net external interchange, less pumping load. This total also includes the grossed up demand response value, and excludes demand from energy storage devices. Real-Time Load Obligation is the sum of all revenue quality metered load within the control area plus Real-Time External Transaction sales.

For more information on the Day-Ahead and Real-Time Energy Markets and associated charges, see the ISO web site here for Day-Ahead and here for Real-Time.

11.4 Net Commitment Period Compensation (NCPC)

NCPC is the payment to a market participant for its Generator, Asset-Related Demand (ARD), Demand Response Resource (DRR), or External Transaction that did not recover its effective offer costs from the energy market during an operating day. The NCPC payment is intended to make a resource that follows the ISO's operating instructions "no worse off" financially than the best alternative generation schedule. Typically, a resource receiving NCPC was operated out of merit to protect the overall resource adequacy and transmission security of specific locations or of the entire balancing authority area.

For more information on the Day-Ahead and Real-Time Energy Markets and associated charges, see the ISO web site here for Day-Ahead and here for Real-Time.

11.5 Energy Market Payments

The Energy Market payment is made up of three components: payments made in relation to Day-Ahead LMPs, payments associated with Day-Ahead Forecast Energy Requirement (FER), and payments related to deviations in Real-Time.

The Day-Ahead Energy Market is a financial market where market participants purchase and sell electric energy at financially binding Day-Ahead prices for the following day. This market is the financially binding schedule of commitments for the purchase and sale of energy the ISO develops each day according to the bid and offer data that market participants submit to the market. A supply offer or a demand bid will generally clear the Day-Ahead market if its associated price is less than or equal to the hourly Locational Marginal Price (LMP) at its location, as system conditions allow.

The Day-Ahead market allows buyers and sellers to hedge against price volatility in the Real-Time Energy Market by locking in energy prices before the operating day.

The FER is equal to the load forecast, and it is satisfied by a combination of the Day-Ahead Energy Imbalance Reserves (EIR) product and cleared Day-Ahead energy supplied by Generator Assets, Demand Response Resources, and net Imports. The Forecast Energy Requirement Price (FERP) is the clearing price for the FER (analogous to how the LMP is the clearing price for the energy balance constraint). A MWh of cleared Day-Ahead energy from a physical supply resource will be paid the LMP + FERP, because that MWh contributes to both the energy balance and FER constraints. A MWh of cleared EIR, in contrast, is paid only the FERP, because it contributes to the FER, but not to the energy balance constraint. EIR payments are part of the Day-Ahead Ancillary Services market, and are not included in the Day-Ahead Energy Market value.

Payments in the Real-Time Energy Market are based upon deviations in the participants' actual operation in Real-Time from their Day-Ahead energy positions. These deviations are multiplied by the Real-Time LMP at the associated location to arrive at the Real-Time Energy Market payment total.

For more information on the Energy Market Payments, see the ISO web site located here.

Analyze: Energy Market Payments, by Week (53 weeks, Excel format)
TAB NAME: 'Energy Market Payments'

11.6 Flexible Response Services (FRS) Market

The Day-Ahead Ancillary Services (DAAS) Market replaced the Forward Reserve Market as of March 1, 2025. The DAAS Market is designed to procure and transparently price the ancillary service capabilities needed for a reliable, next-day operating plan with an evolving generation fleet.

One component of the DAAS market clears Day-Ahead flexible response services to ensure that the system is prepared to recover from sudden source-loss contingencies and can respond quickly to fluctuations in net load during the operating day. These are referred to as Flexible Response Services (FRS), and are analogous to the Ten-Minute Spinning Reserves (TMSR), Ten-Minute Non-Spinning Reserves (TMNSR), and Thirty-Minute Operating Reserves (TMOR). These three products (TMSR, TMNSR, and TMOR) will also have a closeout charge based on the Hub Real-Time LMP. All three of the FRS requirements are set on a region-wide basis.

For more information on the DAAS Market, see the ISO web site located here.

Analyze: DAAS Market Results, by Week (53 weeks, Excel format)
TAB NAME: 'DAAS Market'

11.7 Energy Imbalance Reserves (EIR) Market

The second component of the DAAS Market involves clearing a new day-ahead ancillary service to cover the "gap" when the day-ahead market's physical energy supply awards are below the ISO's forecast real-time load. These are referred to as Energy Imbalance Reserves (EIR). EIR is also subject to a closeout charge based on the Hub Real-Time LMP, and the EIR requirement is set on a region-wide basis.

For more information on the DAAS Market, see the ISO web site located here.

Analyze: DAAS Market Results, by Week (53 weeks, Excel format)
TAB NAME: 'DAAS Market'

11.8 Real-Time Reserve Market

The Real-Time LMP calculation process simultaneously sets Real-Time Reserve Market Clearing Prices (RMCP) for Ten-Minute Spinning Reserve (TMSR), Ten-Minute Non-Spinning Reserve (TMNSR), and Thirty-Minute Operating Reserve (TMOR).

For more information on the Real-Time Reserve Market, see the ISO web site located here.

Analyze: Real-Time Reserve Market Results, by Week (53 weeks, Excel format)
TAB NAME: 'Real-Time Reserve Market'

Document Revision History		
Date	**Version**	**Remarks**
11/19/2025	Original	Initial posting.