



NYgrid 2019 interface-flow reproduction

8,760 naive local hourly labels · both operator definitions use exactly the same DC solutions

A Corrected operator: paper error distribution

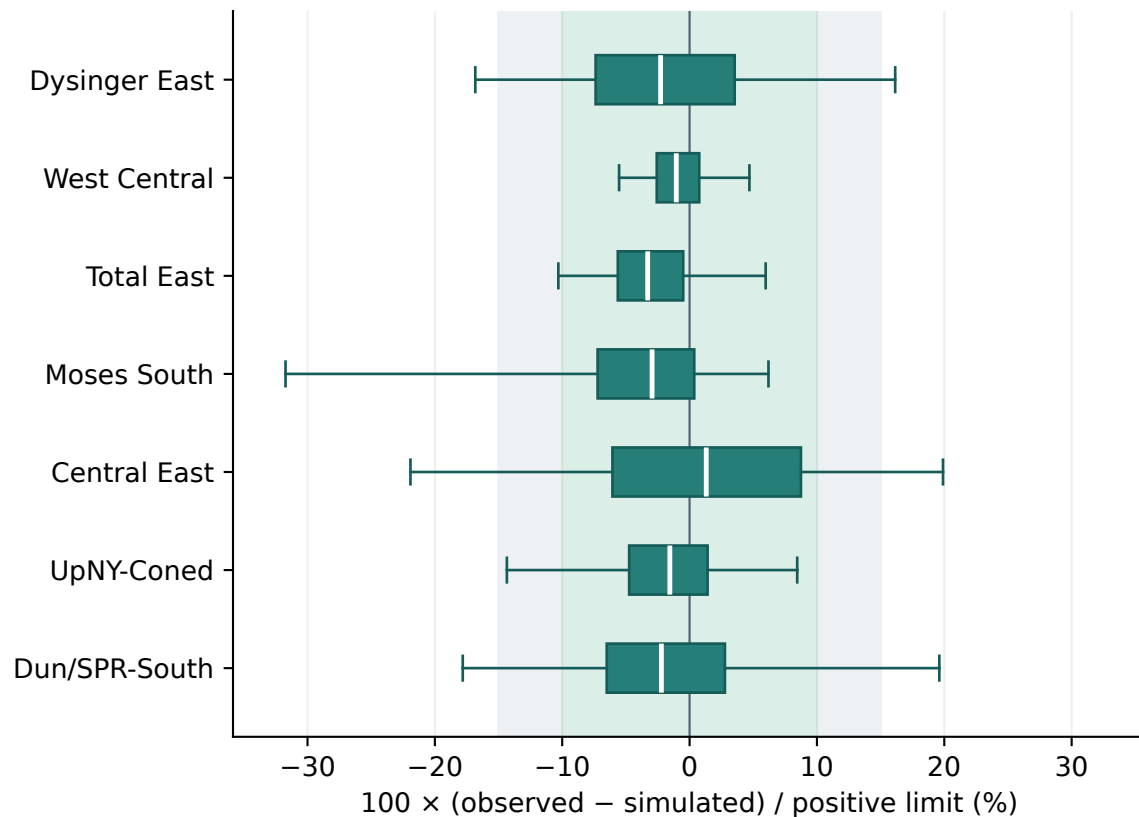

B Actual-flow relative aggregate error

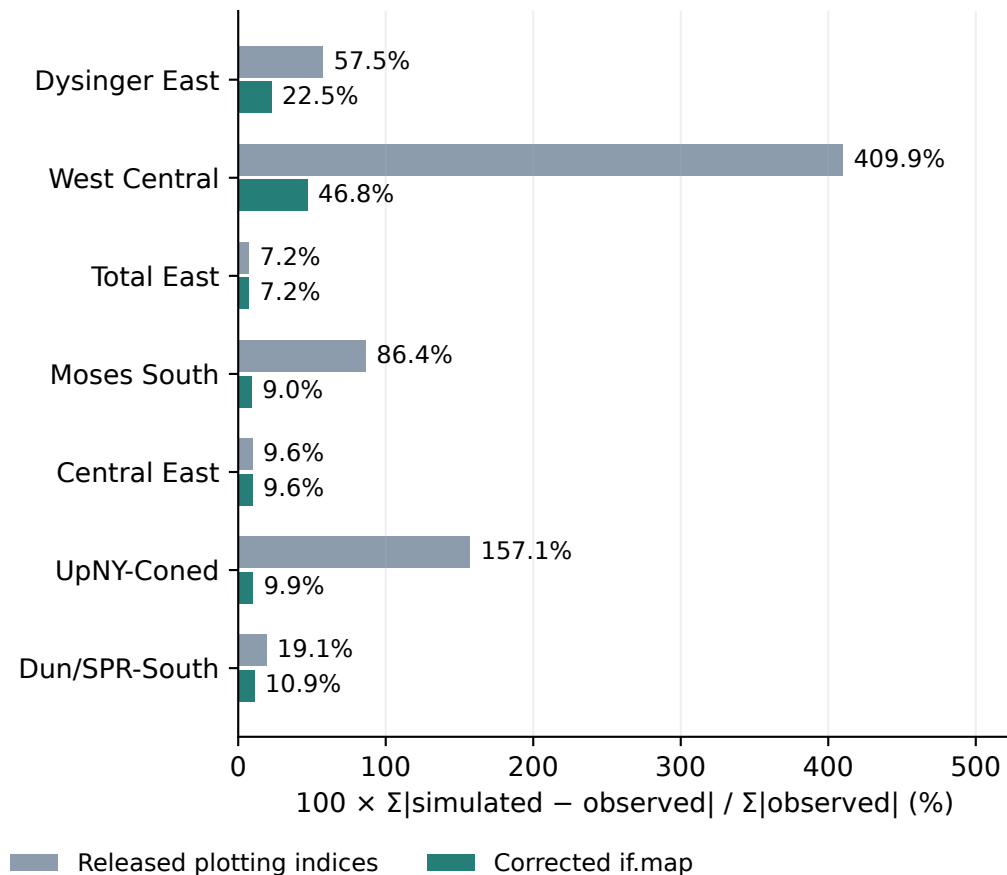

A: white line = median; boxes = 25th-75th percentiles; whiskers = 2.5th-97.5th percentiles. Tails beyond whiskers are not displayed.

Shading marks $\pm 10\%$ and $\pm 15\%$ of the positive interface limit. These are not percentages of observed flow.

Primary replication retains imputed and DST-ambiguous source hours. Operator correction uses model identities, not target fitting.

DC convergence does not establish bounded AC feasibility. Actual-flow metrics use no denominator floor.