Appendix A – SCHEDULE OF SIGNIFICANT INTERCHANGES ASSUMED FOR TRANSFER LIMITS STUDIES

SUMMARY OF NET INTERCHANGE SCHEDULES

TO / FROM	NYISO	PJM	IESO	ISONE	NB/NS	Trans Énergie	Cross-Sound	Neptune-HVdc	Linden VFT	HTP	NNC Transfer	Other Control Areas	TOTAL EXPORT+ IMPORT-
NYISO		37	0	83	0	-533	-330	-660	-315	0	-100	120	-1698
PJM	-37		0	0	0	0	0	660	315	0	0	2276	3214
IESO	0	0		0	0	-1250	0	0	0	0	0	0	-1250
ISONE	-83	0	0		0	-225	330	0	0	0	100	0	122
NB/NS	0	0	0	0		-765	0	0	0	0	0	0	-765
Trans Énergie	533	0	1250	225	765		0	0	0	0	0	45	2818

APPENDIX A *SUMMARY OF WINTER 2024-25 BASE TRANSFERS*	
NEW BRUNSWICK/NOVA SCOTIA	
New Brunswick to TransÉnergie: Madawaska and Eel River HVdc	-765
New Brunswick to New England	0
Total Export (+) / Import (-)	**-765**

NEW ENGLAND	
New England to New Brunswick	0
New England to TransÉnergie: Sandy Pond HVdc	0
New England to TransÉnergie: Vermont	-225
New England to New York	-83
New England to NY: Norwalk Harbor-Northport	100
New England to NY: Cross-Sound	330
Total Export (+) / Import (-)	**122**

NEW YORK ISO	
New York to TransÉnergie	-533
New York to New England	83
New York to New England: Norwalk Harbor-Northport	-100
New York to New England: Cross-Sound	-330
New York to PJM: NYPA to PA-RECS	75
New York to PJM: Sithe Allegheny	-38
New York to PJM: Non-Firm Energy	0
New York to PJM: Linden VFT	-315
New York to PJM: Neptune HVdc	-660
New York to PJM: HTP	0
New York to MISO: NYPA to AMP- Ohio	120
New York to IESO (Ontario)	0
Total Export (+) / Import (-)	**-1698**

APPENDIX A *SUMMARY OF WINTER 2024-25 BASE TRANSFERS*	
IESO (Ontario)	
IESO to TransÉnergie	-1250
IESO to New York	0
IESO to PJM	0
IESO to MISO	0
Total Export (+) / Import (-)	**-1250**

PJM	
PJM to New York: NYPA to PA-RECS	-75
PJM to New York: Sithe Allegheny	38
PJM to New York: Non Firm Energy	0
PJM to New York: Neptune HVdc	660
PJM to New York: Linden VFT	315
PJM to New York: HTP	0
Miscellaneous Transfers to Other Areas	2276
Total Export (+) / Import (-)	**3214**

TRANSÉNERGIE	
TransÉnergie to New Brunswick: Madawaska and Eel River HVdc	765
TransÉnergie to New England: Sandy Pond HVdc	0
TransÉnergie to New England: Vermont	225
TransÉnergie to New York	533
TransÉnergie to IESO (Ontario)	1250
TransÉnergie to Cornwall	45
Total Export (+) / Import (-)	**2818**

Appendix B – WINTER 2024-25 BASE CASE CONDITIONS

GENERATION FACILITIES (LEVEL OF GENERATION IN CASE)

The status and dispatch level of generation represented in this analysis is a reasonable expectation based on the information available at the time of the study. Those modeling assumptions incorporate known unit outage status.

TransÉnergie HVdc CONVERTER SCHEDULES

Chateauguay HVdc	332 MW	In Service
Sandy Pond HVdc	0 MW	Out-of-service
Highgate HVdc	223 MW	In Service
Madawaska HVdc	415 MW	In Service
Eel River HVdc	350 MW	In Service

AREA LOADS & LOSSES


NYISO	23,904 MW	
ISO-NE	21,528 MW	
IESO (Ontario)	23,451 MW	
PJM	45,872 MW	

PHASE ANGLE REGULATOR SCHEDULES

Inghams (CD-ED)	120 MW	
Sandbar PAR (PV-20)	100 MW	
St. Lawrence-Moses L33P	0 MW	Out-of-service
St. Lawrence-Moses L34P	0 MW	
Norwalk Harbor-Northport	100 MW	
Jamaica-Valley Stream	-100 MW	
Jamaica-Lake Success	-200 MW	
Hudson-Farragut (B3402)	0 MW	Out-of-service
Marion-Farragut (C3403)	0 MW	Out-of-service
Linden-Goethals	0 MW	
Waldwick-Hinchmans	0 MW	
Waldwick-Fairlawn	0 MW	
Waldwick-Hillsdale	0 MW	
Ramapo PAR #1 (+ to NY)	100 MW	
Ramapo PAR #2 (+ to NY)	100 MW	
East Garden City #1	345 MW	
East Garden City #2	345 MW	

Appendix C – POWER FLOW TRANSCRIPTION DIAGRAM

SYSTEM OVERVIEW

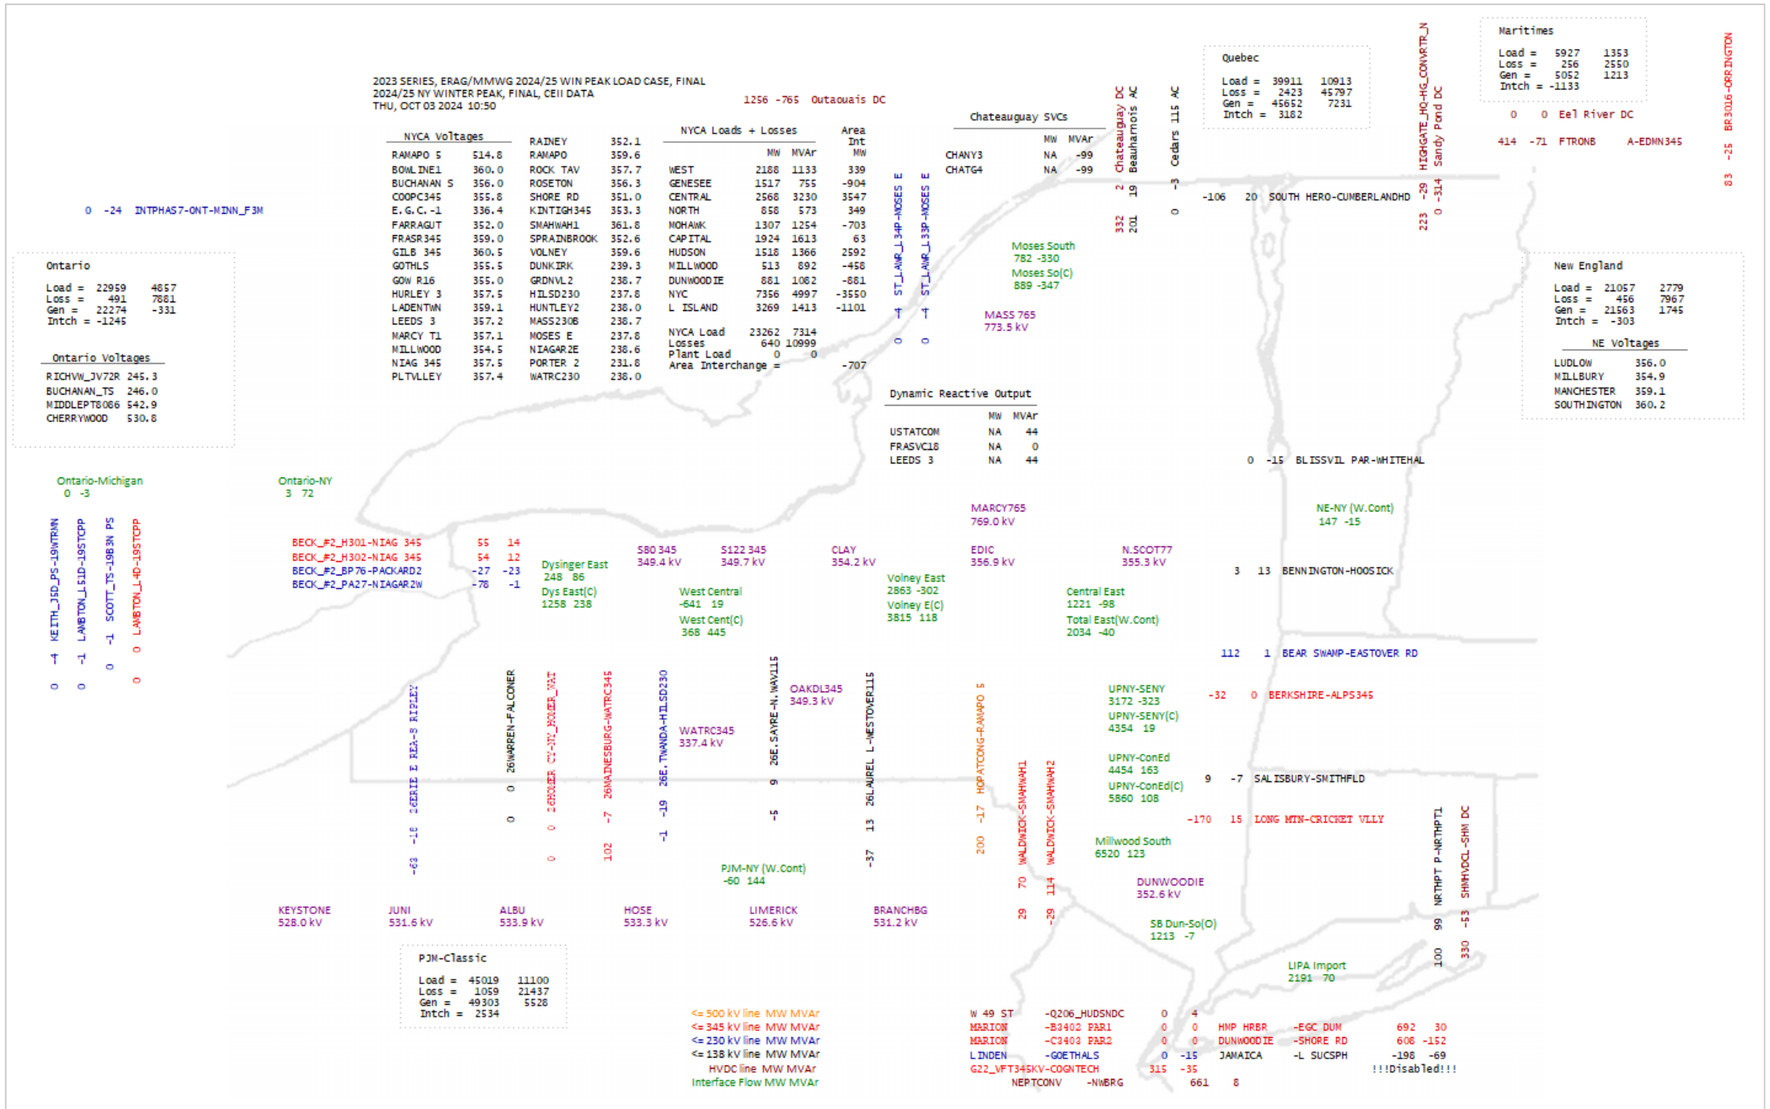

Appendix D – RATINGS OF MAJOR TRANSMISSION FACILITIES IN NEW YORK

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
ACADEMY__138A_138B_PAR1	PAR1	138	301	360	451	325751	135.96
ACADEMY__138A_138B_PAR8	PAR8	138	301	360	451	325750	136
ACADEMY__345_138_TR1	T1	345	273	332	402	325753	136
ACADEMY__345_138_TR8	T8	345	273	332	402	325752	136
ADIRNDCK_230_115_BK 1	AT1	230	132	166	172	26697	90
ADIRNDCK-CHASLAKE_230_13	13	230	478	478	634	325233	-100
ADIRNDCK-PORTER___230_12	12	230	478	478	634	25082	0
ALBANY__-GREENBSH_115_1	1	115	304	349	399	25860	18
ALBANY__-GREENBSH_115_2	2	115	304	349	399	25868	18
ALBANY__-TRINITY__115_5	5	115	214	256	317	25861	-58
ALBANY__-TRINITY__115_9	9	115	159	178	258	25872	-26
ALCOA___-BRADY____115_13	13	115	156	170	181	25230	20
ALCOA___-DENNISON_115_12	12	115	312	328	387	25227	23
ANDOVER_-PALMITER_115_157-932	157-932	115	97	117	119	25094	11
ARCADE__-MACHIAS__115_167	167	115	156	171	182	326168	-9
ASHLEYRD-MASONCR__115_909	909	115	189	207	221	25847	31
ASHLEYRD-PLATSBRG_115_700	700	115	223	237	259	25845	37
ASTANNEX_138A_138B_PAR1	PAR1	138	415	477	544	325848	100
ASTANNEX_345_138_TR1	TR1	345	320	390	468	325847	100
ASTANNEX-ASTORIAE_138_34091	34091	138	288	318	346	325849	100
ASTANNEX-E13THSTA_345_Q35L	Q35L	345	415	639	1595	25134	-347
ASTANNEX-E13THSTA_345_Q35M	Q35M	345	415	639	1595	25142	-354
ASTORIAE-CORONA___138_34181	34181	138	195	249	378	25277	118
ASTORIAE-CORONA___138_34182	34182	138	195	249	378	25278	114
ASTORIAE-CORONA___138_34183	34183	138	195	249	378	25279	118
ASTORIAE-CORONA___138_34184	34184	138	195	249	378	25280	110
ASTORIAE-CORONA___138_34185	34185	138	195	249	378	25281	105
ASTORIAE-CORONA___138_34186	34186	138	195	249	378	25282	107
ASTORIAW-QUENBRDG_138_28241	28241	138	195	249	378	25315	103
ASTORIAW-QUENBRDG_138_28242	28242	138	195	249	378	25316	-105
ASTORIAW-QUENBRDG_138_28243	28243	138	391	499	688	25317	192
ASTORIAW-QUENBRDG_138_28244	28244	138	413	557	688	25318	-222
ATHENS__-VNWAGNER_345_91	91	345	1624	1783	1946	25054	-569
BABBITSC-LIGHTHSE_115_6	6	115	141	144	165	25506	34

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
BABYLON_-BRGHTWTR_69__771	771	69	164	176	195	327240	8
BAGATLRD-PILGRIM__138_564	564	138	571	612	678	325607	33
BARRETT__138A_138B_PAR	PAR	138	193	272	327	25590	-145
BARRETT_-FREEPORT_138_459	459	138	193	272	327	26425	-145
BATAVIA_-SEBATVIA_115_117	117	115	239	239	239	26017	37
BATH____-MONTRFL__115_965	965	115	146	160	178	26163	0
BATH____-SPENCHIL_115_723	723	115	149	172	207	325797	-45
BEAR SWP-EASTOVER_230_E205W	E205W	230	536	586	634	25030	114
BECK____-NIAGARA__230_PA27	PA27	230	480	540	685	25025	78
BECK____-NIAGARA__345_PA301	PA301	345	1180	1469	1860	25040	-55
BECK____-NIAGARA__345_PA302	PA302	345	1180	1469	1860	25041	-55
BECK____-PACKARD__230_BP76	BP76	230	582	687	713	25024	28
BENNETT_-MORAINE__115_725	725	115	149	172	179	325858	2
BENNETT_-SPENCHIL_115_953	953	115	221	241	261	26164	29
BERKSHIR-ALPS_____345_393	393	345	1792	1883	1912	25034	-33
BETHLHEM-ALBANY___115_18	18	115	388	427	474	26119	49
BIGTREE_-DAVIS_RD_115_904	904	115	179	197	213	25162	-25
BIGTREE_-GARDNVLB_115_902	151	115	227	232	232	26040	14
BIGTREE_-LANGNERD_115_903	903	115	289	305	335	326050	-8
BLACKRVR-CARTHAGE_115_1	1	115	141	144	159	26067	-14
BLACKRVR-EWATRTWN_115_5	5	115	141	144	159	325771	2
BLACKRVR-FORTDRUM_115_2	2	115	141	144	159	26068	5
BLACKRVR-MIDDLERD_115_8	8	115	141	144	165	326703	-57
BLISSVIL-WHITEHAL_115_K7	K7	115	239	239	239	25028	0
BNNINGTN-HOOSICK__115_K6	K6	115	229	274	292	25029	4
BOONVLLE-BNVLMUNI_115_2	2	115	124	124	124	26073	-5
BOONVLLE-STITVILE_115_1	1	115	127	127	127	625016	25
BOONVLLE-TURIN_RD_115_3	3	115	141	144	159	26071	-35
BORDRCTY-GUARDIAN_115_969	969	115	239	239	239	325283	65
BOWLINE__345_138_BK455	BK 455	345	506	587	671	25664	113
BOWLINE_-WHAVSTRW_345_67-1	67	345	777	837	837	25567	578
BOWLINOR-CONGERS__138_561	561	138	191	230	431	26723	-85
BRANCOMB-SCHAGCKT_115_310	10	115	227	248	268	26474	20
BRENTWOD-PILGRIM__69__765	765	69	274	285	285	26536	66
BRENTWOD-PILGRIM__69__768	768	69	104	113	120	26534	52
BRISTLHL-WHITAKER_115_4	4	115	128	135	152	25512	-47
BROOKHVN-EDWARDAV_138_864	864	138	277	438	599	25553	77

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
BROOKHVN-SILLSRD__138_874	874	138	529	591	670	325617	-97
BROOKHVN-SILLSRD__138_887	887	138	529	591	670	325619	-97
BROOKHVN-WILDWOOD_138_861	861	138	555	590	671	325932	-51
BROWNFLS-TAYLORVL_115_3	3	115	130	144	159	26076	36
BROWNFLS-TAYLORVL_115_4	4	115	130	138	159	26077	36
BUCHAN_N_345_138_BK TA5	BK TA5	345	230	306	381	25425	66
BUCHAN_N-BUCHANAN_138_95891	95891	138	249	296	384	25568	-66
BUCHAN_N-EASTVIEW_345_W93	W93	345	1823	2015	2557	25133	779
BUCHAN_S-MILLWOOD_345_W97	W97	345	1840	1973	2154	25146	559
BUCHAN_S-MILLWOOD_345_W98	W98	345	1840	1973	2154	25247	559
BUCHANAN-MILLWOOD_138_96951	96951	138	291	322	408	25283	17
BUCHANAN-MILLWOOD_138_96952	96952	138	291	322	408	25284	17
BURNS___-N.HEMPST_138_531	531	138	222	274	321	25878	-17
BURNS___-OAKSTRET_138_702	702	138	226	248	258	325812	58
BURNS___-WHAVSTOR_138_541	541	138	222	274	321	25879	-59
BUTLER__-MOHICAN__115_18	18	115	141	144	165	26434	-24
C._ISLIP-RONKOKMA_138_883	883	138	435	612	678	26497	12
CANAL___-RIVRHEAD_138_910	910	138	206	281	311	325242	-67
CANAL___-RIVRHEAD_138_911	911	138	190	260	288	327371	-62
CANANDGA-STONYRDG_230_68	68	230	599	625	653	25176	130
CARMEL__-UNIONVAL_115_991	991	115	271	278	306	26155	85
CARMEL__-WOODSTNY_115_900	900	115	255	278	302	326880	-59
CARMEL__-WOODSTNY_115_992	992	115	260	286	302	325278	-57
CARR_ST_-DEWITT___115_15	15	115	227	249	268	26093	-15
CASTLEGD-FULLRHLW_115_937	937	115	298	334	357	325222	-20
CATON___-HILLSIDE_115_960	960	115	149	155	155	325290	-25
CEDAR___-BURGOYNE_115_6	6	115	141	144	165	26516	-28
CEDARS__-ROSEMNTA_115_1/11	1/11	115	156	170	181	26083	2
CEDARS__-ROSEMNTB_115_2/22	2/22	115	156	170	181	26082	2
CEDRHRST-HEWLETT__69__263	263	69	143	157	168	326318	32
CHADWICK-E.WALDEN_115_DW	DW	115	220	234	256	26218	-77
CHADWICK-WBALMVLE_115_DW	DW	115	220	234	256	26217	44
CHASLAKE-PORTER___230_11	11	230	511	564	586	25051	-216
CHAT_TAP-LYON_MTN_115_1(911)	1(911)	115	173	191	205	325704	-12
CHATGUAY-MASSENA__765_7040	7040	765	5300	6254	6625	25301	533
CHEMUNG_-NWAVERLY_115_962	962	115	133	149	162	325289	-24
CHESTROR-SUGRLOAF_138_271	271	138	282	309	321	325424	37

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
CHRCHTWN-BLUESTOR_115_4	4	115	270	297	324	327496	32
CHRCHTWN-CRARYVIL_115_984	984	115	298	334	368	26500	-8
CHRCHTWN-CRARYVIL_115_984	984	115	298	334	368	26500	-8
CHRCHTWN-HUDSON___115_12	12	115	8888	8888	8888	327503	38
CHRCHTWN-LAFARGE__115_8	8	115	141	144	165	327497	29
CHRCHTWN-NCATSKLL_115_5	5	115	169	213	239	327495	-27
CLAY_____345_115_BK 1	BK 1	345	560	718	796	25387	244
CLAY_____345_115_BK 2	BK 2	345	590	764	796	25421	244
CLAY____-BARTELRD_115_10	10	115	285	286	318	25520	-105
CLAY____-BARTELRD_115_3	3	115	268	293	317	25519	-81
CLAY____-COLAMCRS_115_5	5	115	267	293	317	25522	-49
CLAY____-DEWITT___345_13	13	345	1431	1605	1721	25168	460
CLAY____-EDIC_____345_1-16	1-16	345	1591	1745	1904	25200	481
CLAY____-EDIC_____345_2-15	2-15	345	1591	1745	1904	25169	482
CLAY____-EUCLID___115_11	11	115	268	293	317	25516	110
CLAY____-EUCLID___115_17	17	115	268	293	317	25515	81
CLAY____-INDPDNCE_345_26	26	345	1918	2115	2390	25858	-1002
CLAY____-WETZEL___115_14	14	115	268	293	317	25517	-24
CLINTON_-IMC_TAP__115_15	15	115	141	144	165	26128	-9
CLOSTER_-SPARKL___69__751	751	69	141	154	160	26504	3
CLRKSCRN_345_115_BK1	BK 1	345	280	313	336	325724	-87
CLRKSCRN_345_115_BK2	BK 2	345	280	313	336	325725	-87
CLRKSCRN-OAKDALE__345_36	36	345	1279	1410	1781	325726	-537
CODINGTN-E.ITHACA_115_981	981	115	278	314	346	25730	7
CODINGTN-ETNA_____115_998	998	115	258	258	258	25734	-29
COFFEEN_-EWATRTWN_115_5	5	115	152	152	152	325769	-21
COFFEEN_-GLENPARK_115_3	3	115	119	119	119	26069	-54
COLDENHM-ROCKTVRN_115_J	J	115	256	282	349	26420	-59
COLDSPRG-CARRSCRN_115_905	905	115	133	149	162	26440	-8
COLLIERS-RICHFELD_115_929	929	115	206	226	251	26169	1
COLTON__-FLATROCK_115_2	2	115	139	146	155	26088	31
COLTON__-HIGLEY___115_1	1	115	156	156	156	26087	31
COLTON__-LITTLRIV_115_7	7	115	93	101	106	26086	10
COLTON__-TOWNLINE_115_9	9	115	109	109	109	325641	-10
CONGERS_-SNKEHLRD_138_563	563	138	378	414	431	25887	64
COOPERNY-FERNDALE_115_950	950	115	149	149	149	26171	45
COOPERNY-ROCKHILL_115_957	957	115	119	119	119	325614	31

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
COOPERS__345_115_BK 2	BK 2	345	239	239	239	25433	55
COOPERS__345_115_BK 3	BK 3	345	239	239	239	25434	56
COOPERS_-DOLSONAV_345_CCDA42	CCDA42	345	1793	1793	1793	25111	236
COOPERS_-MIDDLETP_345_CCRT34	CCRT34	345	1786	1792	1792	25110	501
CORONA__-JAMAICA__138_18001	18001	138	168	225	368	25285	65
CORONA__-JAMAICA__138_18002	18002	138	168	225	368	25286	65
CORONA__-RAINEY___138_36187	36187	138	327	417	537	326894	65
CORONA__-RAINEY___138_36188	36188	138	312	401	534	625053	0
CORPDRIV-HARNGCRN_138_703	703	138	161	186	224	25881	33
CORTLAND-LABDELFE_115_3	3	115	207	207	207	325248	8
CORTLAND-TULLYCTR_115_18	18	115	224	239	239	26089	-40
CRICKVLY-PLSNTVLY_345_F83	F83	345	1414	1549	1796	326887	-392
CRICKVLY-PLSNTVLY_345_F84	F84	345	1533	2045	2242	326888	-509
CURRY_RD-LINE8TAP_115_8	8	115	141	144	165	26254	22
DANSKAMR-CHADWICK_115_DW	DW	115	265	290	315	26219	32
DANSKAMR-MARLBORO_115_DB	DB	115	227	249	269	26221	1
DANSKAMR-NCHELSEA_115_AC	AC	115	216	231	334	25829	25
DANSKAMR-NCHELSEA_115_DC	DC	115	200	217	334	25830	26
DANSKAMR-RYNDS_HL_115_DR	DR	115	237	282	315	25831	19
DAVIS_RD-STOLLERD_115_927	927	115	239	239	239	26172	42
DELHI___-DELHI_TP_115_951	951	115	255	255	255	26174	-75
DELHI_TP-COLLIERS_115_951	951	115	243	262	262	26203	-39
DENNISON-LAWRNCAV_115_5	5	115	268	293	317	25226	11
DENNISON-NORFOLK__115_4	4	115	268	293	317	25225	-12
DEPOSIT_-INDIANHD_69__675	675	69	132	146	156	325971	33
DEWITT___345_115_BK 1	BK 1	345	318	318	318	325221	236
DEWITT___345_115_BK 2	BK 2	345	318	318	318	25418	236
DEWITT__-BUTERNUT_115_4	4	115	245	260	282	26094	28
DOLSONAV-ROCKTVRN_345_DART44	DART44	345	1918	2115	2390	326310	-942
DULEY___-PATNODE__230_PND-1	PND-1	230	506	564	589	325856	-64
DULEY___-PLATSBRG_230_DP-1	DP-1	230	295	324	361	25272	0
DUNKIRK__230_115_BK 31	BK 31	230	173	234	250	25386	48
DUNKIRK__230_115_BK 41	BK 41	230	166	226	250	25430	48
DUNKIRK_-BERRY_RD_115_160	160	115	239	239	239	26025	-47
DUNKIRK_-BRIGHAM__115_161	161	115	211	217	225	26021	-29
DUNKIRK_-BRIGHAM__115_162	162	115	211	217	225	26027	23
DUNWODIE_138__138__BK N1	BK N1	138	376	428	500	25624	115

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
DUNWODIE_138__138__BK N2	BK N2	138	223	312	400	25623	105
DUNWODIE-DUNWOODN_345_W74	W74	345	490	575	667	326212	250
DUNWODIE-DUNWOODS_345_W73	W73	345	386	454	511	326211	239
DUNWODIE-E179THST_138_99153	99153	138	269	370	651	25287	190
DUNWODIE-MOTTHAVN_345_71	71	345	741	858	1309	25151	476
DUNWODIE-MOTTHAVN_345_72	72	345	741	858	1309	25191	465
DUNWODIE-SHERMCRK_138_99031	99031	138	154	196	308	25193	115
DUNWODIE-SHERMCRK_138_99032	99032	138	219	307	421	25239	105
DUNWODIE-SHORE_RD_345_Y50	Y50	345	741	977	1667	25091	608
DUNWOODN_345_138_BK N1	BK N1	345	490	575	667	25209	0
DUNWOODS_138_138_PAR S1	BK S1	138	399	526	540	25626	190
DUNWOODS_345_138_BK S1	BK S1	345	386	454	511	25208	0
DUNWOODS-DUNWOODN_138_99997	99997 TIE	138	245	293	342	25532	-8
DYSINGER_345A_345B_1T3521_PAR	PAR	345	700	874	874	327480	-399
DYSINGER-ESTOLERD_345_DES1	DES1	345	700	874	874	327465	400
DYSINGER-KINTIGH__345_38	38	345	1918	2115	2312	25074	-92
DYSINGER-KINTIGH__345_39	39	345	1195	1195	1195	327246	-96
DYSINGER-STA_255__345_DH1	DH1	345	1591	1745	1904	327457	8
DYSINGER-STA_255__345_DH2	DH2	345	1591	1745	1904	327458	8
E.ITHACA-ETNA_____115_732	732	115	133	149	162	25733	-29
E.SAYRE_-NWAVERLY_115_956	956	115	127	127	127	25013	5
E.TWANDA-HILLSIDE_230_70	70	230	539	594	670	25014	2
E.WALDEN-COLDENHM_115_CW	CW	115	256	282	349	26225	34
E.WALDEN-MODENA___115_EM	EM	115	285	310	349	25832	0
E.WALDEN-ROCKTVRN_115_D	D	115	256	282	350	26226	-77
E13THSA_E13THSA_138_37371	37371	138	356	514	860	325707	56
E13THSTA_138_69__TR 9	BK9	138	176	223	235	26488	0
E13THSTA_345_138_BK 10	BK 10	345	284	297	315	25467	-73
E13THSTA_345_138_BK 11	BK 11	345	284	297	315	25468	-79
E13THSTA_345_138_BK 12	BK 12	345	322	363	410	25463	69
E13THSTA_345_138_BK 13	BK 13	345	307	373	447	25464	-79
E13THSTA_345_138_BK 14	BK 14	345	295	326	369	25465	0
E13THSTA_345_138_BK 15	BK 15	345	311	372	436	25466	-66
E13THSTA_345_138_BK 16	BK 16	345	318	372	495	25469	71
E13THSTA_345_69__BK 17	BK 17	345	271	336	452	25459	32
E13THSTA-FARRAGUT_345_45	45	345	773	944	1347	25190	77
E13THSTA-FARRAGUT_345_46	46	345	786	955	1353	25251	22

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
E13THSTA-FARRAGUT_345_48	48	345	692	832	1288	25252	203
E13THSTA-FARRAGUT_345_B47	B47	345	537	731	1157	25177	244
E179THST-HELLGATE_138_15055	15055	138	242	321	400	25288	-179
E179THST-HELLGT_E_138_15053	15053	138	187	244	374	25289	132
E179THST-HELLGT_E_138_15054	15054	138	187	244	374	25290	-131
E179THST-PARKCHTR_138_38X01	38X01	138	191	305	512	25327	-32
E179THST-PARKCHTR_138_38X02	38X02	138	191	305	512	25328	32
E179THST-PARKCHTR_138_38X03	38X03	138	191	305	512	25329	19
E179THST-PARKCHTR_138_38X04	38X04	138	191	305	512	25330	-19
EASTOVER_230_115_BK1	BK 1	230	466	579	666	326097	90
EASTOVER_230_115_BK2	BK 2	230	466	579	666	326403	96
EASTRIVR_138_69__BK 111	BK111	138	91	121	142	25526	0
EASTRIVR_138_69__BK 112	BK112	138	91	121	142	25527	0
EASTRIVR_138_69__BK 113	BK113	138	91	121	142	25528	10
EASTRIVR_138_69__BK 114	BK114	138	91	121	142	25529	10
EASTVIEW_345_138_BK 1N	BK 1N	345	509	579	664	25472	107
EASTVIEW_345_138_BK 1S	BK 1S	345	486	571	671	25373	104
EASTVIEW_345_138_BK 2N	BK 2N	345	508	572	664	25471	94
EASTVIEW_345_138_BK 2S	BK 2S	345	509	579	664	25470	106
EASTVIEW-SPRNBRK__345_W64	W64	345	2430	2823	3357	25143	683
EASTVIEW-SPRNBRK__345_W65	W65	345	1976	2387	2897	25144	791
EASTVIEW-SPRNBRK__345_W78	W78	345	2430	2823	3357	25346	745
EASTVIEW-SPRNBRK__345_W79	W79	345	1976	2387	2897	25153	746
EBATAVIA-NO.LEROY_115_119	119	115	169	185	196	26012	28
EDIC_____345_115_BK4	BK 4	345	603	721	796	25454	157
EDIC_____345_230_BK2	BK 2	345	551	626	758	25422	56
EDIC____-FRASER___345_EF24-40	EF24-40	345	1793	1793	1793	25112	-473
EDIC____-GORDONRD_345_14	14	345	1624	1783	1946	327482	486
EDIC____-PRINCTWN_345_351	351	345	2204	2204	2204	625077	535
EDIC____-PRINCTWN_345_352	352	345	2204	2204	2204	625078	535
EDIC_PTR_230_115_BK 1P	BK 1	230	320	365	398	25389	136
EDIC_PTR_230_115_BK 2P	BK 2	230	320	365	398	25423	136
EDIC_PTR_345_115_BK 3E	BK 3	345	524	602	760	25424	0
EDWARDAV-RIVRHEAD_138_893	893	138	277	348	379	325654	64
EELPOTRD-MEYER____115_724	724	115	143	157	167	325288	-26
EFISHKIL_345_115_BK 1	BK 1	345	505	531	531	25724	-178
EFISHKIL_345_115_BK 2	BK 2	345	560	560	560	325845	178

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
EFISHKIL-WOOD_ST__345_F38	F38	345	2408	2668	3065	25367	888
EFISHKIL-WOOD_ST__345_F39	F39	345	2408	2668	3065	25368	951
EGRDNCTY_345_138_AT1	AT1	345	428	556	641	25551	345
EGRDNCTY_345_138_AT2	AT2	345	428	556	641	25552	345
EGRDNCTY_345C_345A_PAR1	PAR1	345	428	812	855	25678	-345
EGRDNCTY_345C_345B_PAR2	PAR2	345	428	812	855	25679	-345
EGRDNCTY-CARLPLCE_138_361	361	138	310	340	371	25533	-15
EGRDNCTY-CNTYLPRS_69_361	361	69	141	141	141	325824	-25
EGRDNCTY-NEWBRDGE_138_462	462	138	190	279	460	25303	99
EGRDNCTY-NEWBRDGE_138_463	463	138	206	296	419	25304	99
EGRDNCTY-NEWBRDGE_138_465	465	138	214	303	423	25535	104
EGRDNCTY-ROSLYN___138_362	362	138	304	334	364	25534	-6
EKINGSTN-RHINEBCK_115_ER	ER	115	220	234	256	26222	33
ELBRIDGE_345_115_BK 1	BK 1	345	542	621	796	25448	364
ELBRIDGE-GRS_LOCK_115_19	19	115	141	144	165	26097	18
ELBRIDGE-GRS_LOCK_115_3	3	115	176	176	176	26098	26
ELBRIDGE-LAKELAND_115_4	4	115	190	208	221	325316	-20
ELBRIDGE-MILTON_C_115_18	18	115	156	159	159	26095	32
ELBRIDGE-STATE_ST_115_5-972	5-972	115	231	259	285	25107	-91
ELBRIDGE-STATE_ST_115_6-710	6-710	115	297	305	336	326377	-68
ELM_ST__-SENECA___230_71	71	230	223	254	262	26426	-12
ELM_ST__-SENECA___230_72	72	230	223	254	262	26427	-13
ELWOOD__-PULASKLI_69__670	670	69	132	146	156	26610	57
ENDICOTT-RANGEHL__115_920	920	115	238	239	239	26158	29
ENDICOTT-ROBBLEAV_115_948	948	115	263	263	263	26159	-29
ENORWICH-CTYLINE__115_918	918	115	149	172	179	325280	-39
ENORWICH-CTYLINE__115_918	918	115	149	172	179	325280	-39
ENORWICH-CTYLINE__115_918	918	115	149	172	179	325280	-39
ENORWICH-JENNISON_115_946	946	115	117	136	153	25729	0
ERIE E__-S.RIPLEY_230_69	69	230	587	637	637	25016	64
ERIE_ST_-PAVMNTRD_115_926	926	115	252	268	268	26175	-51
ESTOLERD-STOLLERD_345_28	28	345	800	800	800	327463	-216
ETNA____-CLRKSCRN_115_715	715	115	282	290	320	325728	-96
ETNA____-CLRKSCRN_115_947	947	115	222	229	242	325727	-48
ETNA____-WILLET___115_945	945	115	155	171	181	25731	60
FAIRFIEL-INGHAM_C_115_3	3	115	128	135	152	26106	-63
FALCONER-SOUTHDOW_115_153	153	115	156	171	182	26033	-21

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
FALCONER-SOUTHDOW_115_154	154	115	156	171	182	26032	-15
FALLSPRK-VALKIN___115_19-730	19-730	115	227	248	268	326940	-66
FARRAGUT_345B_345A_TR11	TR11	345	543	737	930	25044	0
FARRAGUT_345C_345A_TR12	TR12	345	549	748	930	25043	0
FARRAGUT-GOWANUS__345_41	41	345	724	899	1356	25141	-84
FARRAGUT-GOWANUS__345_42	42	345	615	805	1284	25140	-84
FARRAGUT-HUDS_AVE_138_32077	32077	138	121	146	156	25291	140
FARRAGUT-HUDS_AVE_138_32711	32711	138	129	154	167	25293	138
FARRAGUT-PLYMTHST_138_32078	32078	138	129	154	168	25292	136
FARRCKWY-CEDRHRST_69__256	256	69	143	157	168	26566	-26
FARRCKWY-WOODMERE_69__259	259	69	120	136	143	26597	-33
FERNDALE-WWDBURNY_115_959	959	115	77	77	77	26180	-20
FEURABSH-GREENBSH_115_17	17	115	222	234	278	25862	-102
FEURABSH-NCATSKLL_115_2	2	115	141	144	165	25067	-73
FISHKPLN-EFISHKIL_115_HF	HF	115	311	342	375	26227	91
FISHKPLN-SYLVANLK_115_FP/990	FP/990	115	256	282	346	25066	84
FITZPTRK-EDIC_____345_FE-1	FE-1	345	1434	1434	1661	25077	-789
FIVEMILE_345_115_BK1	BK 1	345	597	597	597	326175	150
FIVEMILE-ESTOLERD_345_29	29	345	1195	1195	1195	327464	182
FLATSTR_-EELPOTRD_115_722	722	115	143	157	167	325287	11
FORGEBRK-MERTPARK_115_WF	WF	115	225	251	282	26229	9
FORTORNG-SCHODACK_115_14	14	115	227	248	268	326937	-21
FOXHILLS-WILLWBRK_138_29211	29211	138	207	275	450	25771	-100
FOXHILLS-WILLWBRK_138_29212	29212	138	207	275	450	25772	-84
FRASER___345_115_BK 2	BK 2	345	364	420	420	25391	115
FRASER__-COOPERS__345_33	33	345	1793	1793	1793	25236	-418
FRASER__-GILBOA___345_GF5-35	GF5-35	345	1746	1896	1971	25060	75
FRASERNY-DELHI_TP_115_951	951	115	255	255	255	26202	-114
FREEPORT-NEWBRDGE_138_461	461	138	216	281	402	25155	-193
FRESHKLS_138C_138A_R1 _ 21191	PSR 1	138	371	429	483	25639	-194
FRESHKLS_138C_138B_R2 _ 21192	PSR 2	138	348	438	499	25640	-195
FRESHKLS_345_138_TA 1	TA 1	345	371	429	483	25457	195
FRESHKLS_345_138_TB 1	TB 1	345	379	437	499	25458	195
FRONT_ST-ROSA_RD__115_11	11	115	239	239	239	26274	81
FROST_RD-MEYER____230_87	87	230	521	573	621	625082	98
FTZPK_NM-LIGHTHSE_115_3	3	115	119	119	159	25502	40
FULLRHWL-MORGANRD_115_937	937	115	239	239	239	325223	-10

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
GALEVILE-KERHONKS_115_GK	GK	115	218	218	218	326089	16
GARDNVLA_230_1___BK6P	BK 6	230	366	420	420	25405	22
GARDNVLA_230_1___BK7P	BK 7	230	245	296	300	25435	20
GARDNVLA-GIRDLERD_115_705	705	115	239	239	239	25116	-55
GARDNVLA-LANGNERD_115_903	903	115	255	255	255	325284	19
GARDNVLA-STOLLERD_230_66	66	230	673	764	764	25180	-123
GARDNVLB_230_115_TR 2	BK 2	230	422	518	666	25385	32
GARDNVLB_230_115_TR 3	BK 3	230	382	462	462	25416	22
GARDNVLB_230_115_TR 4	BK 4	230	382	462	462	25417	32
GARDNVLB-BETHWEST_115_149	149	115	245	257	294	325317	-9
GARDNVLB-BETHWEST_115_150	150	115	245	257	294	325318	0
GARDNVLB-COBBLENM_115_152	152	115	227	232	232	26023	19
GARDNVLB-DUNKIRK__230_74	74	230	633	633	633	25197	-69
GARDNVLB-GARDNVLA_115_T1012	T10	115	308	308	308	25085	0
GARDNVLB-GARDNVLA_115_T1112	T11	115	308	308	308	326149	39
GARDNVLB-GARDNVLA_230_T8-12	T8-12	230	796	917	920	25089	0
GARDNVLB-METALICO_115_141	141	115	232	232	232	26038	-31
GARDNVLB-METALICO_115_142	142	115	237	237	237	26037	-32
GARDNVLB-STEBBINS_230_73	73	230	637	637	637	25166	0
GARDNVLB-WALDENNG_115_54-921	54-921	115	227	249	268	26035	13
GE_R_D__-GROOMS___115_20_15	20	115	245	257	294	26266	-32
GE_R_D__-GROOMS___115_20_15	20	115	245	257	294	26266	-32
GILBOA__-LEEDS____345_GL3	GL3	345	1762	1896	2241	25219	-504
GILBOA__-N.SCTLND_345_GNS-1	GNS-1	345	1746	1896	2103	25052	-100
GINNA___-PANNELRG_115_912	912	115	289	305	312	25260	77
GINNA___-S124_____115_913	913	115	272	280	306	26281	97
GINNA___-STA_135__115_909	909	115	282	298	313	325837	90
GINNA___-STA_135__115_937	937	115	297	325	358	325838	90
GINNA___-STA_204__115_908	908	115	322	360	415	26282	114
GINNA___-STA_204__115_911	911	115	320	358	414	26283	112
GIRDLERD-STOLLERD_115_706	706	115	238	239	239	325161	78
GLDNBRGD-CROTONFL_115_991	991	115	260	286	310	326416	-4
GLENWDGT-ROSLYN___138_364	364	138	363	384	425	25556	29
GLENWOOD-CARLPLCE_138_363	363	138	312	373	410	25554	-26
GLENWOOD-GLENWDGT_138_366	366	138	363	384	425	25555	-29
GOETHALS_345_1___BK1P	BK 1	345	902	1119	1150	325129	0
GOETHALS_345A_345B_BK 1N	BK 1N	345	591	787	978	25641	0

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
GOETHALS-FRESHKLS_345_21	21	345	1016	1096	1362	25138	-195
GOETHALS-FRESHKLS_345_22	22	345	1285	1618	1817	25137	-195
GOETHALS-LINDN_CG_345_G23L	G23L	345	672	893	1630	26000	307
GOETHALS-LINDN_CG_345_G23M	G23M	345	672	893	1630	325203	307
GOLAH___-MORTIMER_115_110	110	115	141	144	159	26034	-64
GORDONRD_345_230_TR-G1	TR-G1	345	760	760	760	327483	255
GORDONRD_345_230_TR-G3	TR-G3	345	783	885	1195	327484	255
GORDONRD-PRINCTWN_345_371	371	345	2216	2216	2216	625030	-24
GORDONRD-ROTTRDAM_230_30	30	230	597	688	753	327485	-258
GORDONRD-ROTTRDAM_230_31	31	230	597	688	753	327486	-256
GOUDEY__-ROBBLEAV_115_940	940	115	262	262	262	325166	39
GOWANUS__138A_138B_PAR R14	PAR R14	138	273	338	407	25794	-194
GOWANUS__138A_138B_PAR R2	PAR R2	138	413	516	600	25793	-195
GOWANUS__345_138_BK T14	BK T14	345	309	407	421	25475	195
GOWANUS__345_138_BK T2	BK T2	345	413	516	600	25476	195
GOWANUS__345KV_REA_R41_REACTR	R41 S.REACT	345	687	896	1315	26001	84
GOWANUS__345KV_REA_R42_REACTR	R42 S.REACT	345	687	896	1315	26003	84
GOWANUS_-GOETHALS_345_25	25	345	561	748	1241	25139	112
GOWANUS_-GOETHALS_345_26	26	345	561	748	1241	25571	112
GOWANUS_-GREENWD__138_42231	42231	138	273	387	516	25214	195
GOWANUS_-GREENWD__138_42232	42232	138	273	338	407	25215	194
GOWANUSA-GREENWD__138_42G24	42G24	138	270	307	322	26007	0
GOWANUSC-GREENWD__138_42G13	42G13	138	259	307	322	26006	0
GREENBSH-STEPHTWN_115_993	993	115	121	135	159	26447	0
GREENDGE-FLATSTR__115_968	968	115	133	149	162	26185	-5
GREENDGE-MONTRFL__115_967	967	115	133	149	162	26184	-17
GREENDGE-MONTRFL__115_967	967	115	133	149	162	26184	-17
GREENDGE-MONTRFL__115_970	970	115	145	160	178	26183	-21
GREENLWN-ELWOOD___138_673	673	138	379	585	663	25546	-5
GREENLWN-SYOSSET__138_676	676	138	263	364	657	25548	75
GREENWD_-FOXHILLS_138_29231	29231	138	195	249	378	25321	31
GREENWD_-FOXHILLS_138_29232	29232	138	195	249	378	25322	50
GROOMS__-JOHNSON__115_13-14	14	115	268	293	317	26267	-46
GROOMS__-JOHNSON__115_13-14	14	115	268	293	317	26267	-46
GRS_LOCK-GELCKHM__115_8	8	115	190	208	221	26103	0
GRS_LOCK-HARRISRD_115_16	16	115	141	144	165	26102	27
GUARDIAN-HALEYRD__115_969	969	115	270	270	270	26167	-60

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
HALEYRD_-GREENDGE_115_969	969	115	240	270	297	325294	32
HANCOCK_-HAZEL____115_955	955	115	90	90	90	26187	0
HARNGCRN-W.NYACK__69__701	701	69	141	154	160	26259	10
HARSNRAD-ROBNSNRD_115_907	907	115	260	278	286	26162	9
HAUPPAUG-C._ISLIP_138_889	889	138	251	387	427	25681	115
HAZEL___-FERNDALE_115_955	955	115	133	149	162	26181	-9
HELLGATE-ASTORIAW_138_24051	24051	138	188	264	447	25210	-25
HELLGATE-ASTORIAW_138_24052	24052	138	188	264	447	25211	28
HELLGATE-HELLGATE_138_15055L	15055L	138	242	321	400	25573	179
HELLGATE-HELLGATE_138_15055M	15055M	138	242	321	400	26729	179
HELLGT_E-ASTORIAE_138_34051	34051	138	195	249	378	25323	-131
HELLGT_E-ASTORIAE_138_34052	34052	138	195	249	378	25324	-131
HELLGT_W-ASTORIAW_138_24053	24053	138	171	207	207	25212	116
HELLGT_W-ASTORIAW_138_24054	24054	138	171	207	207	25213	0
HELLGT_W-ASTORIAW_138_24056	24056	138	183	270	284	26461	25
HEMPSTED-EGRDNCTY_69_358	358	69	141	141	141	326813	25
HEWLETT_-VALLYSTR_69__260	260	69	128	157	168	325286	-51
HICKLING-CATON____115_958	958	115	149	172	205	26189	9
HICKLING-YAWGERRD_115_964	964	115	127	147	167	26188	-7
HILLBURN-RAMAPOOR_138_52	52	138	210	270	287	25882	-38
HILLBURN-S.MAHWAH_69__65	65	69	165	181	188	26263	15
HILLSIDE_230_1_BK3P	BK 3	230	299	336	336	325759	78
HILLSIDE_230_1_BK4P	BK 4	230	462	543	560	325760	62
HILLSIDE-CHEMUNG__115_962	962	115	155	155	155	25726	26
HILLSIDE-WATRCURE_230_69	69	230	645	663	711	25181	92
HINMAN__-HARSNRAD_115_908	908	115	286	286	286	26161	-170
HISHELDN-STONCREK_230_81	81	230	521	573	621	325622	15
HOLBROOK-NSHORBCH_138_884	884	138	408	449	497	25341	0
HOLBROOK-SILLSRD__138_872	872	138	561	596	678	25340	-4
HOLBROOK-WEST BUS_138_888	888	138	577	618	685	25542	-215
HOMER_HL-DUGAN_RD_115_157	157	115	107	117	123	26041	-15
HOMER_HL-FIVE_MIL_115_169	169	115	270	297	324	26452	-64
HOMER_HL-FIVE_MIL_115_170	170	115	270	297	324	26022	-64
HOMR_NYW-PIERC_NY_345_48	48	345	1508	1713	1789	326214	98
HOMRC_NY-MAINS_NY_345_47	47	345	1482	1631	1900	326121	141
HONK_FLS-ELLENVTP_69__WH	WH2	69	95	96	96	26234	25
HOOK_TAP-FARMGTN__115_7-983	7-983	115	176	181	199	26100	-22

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
HOPATCON-RAMAPO___500_5018	5018	500	1156	1450	1915	25019	-200
HUDS_AVE-JAMAICA__138_701	701	138	161	246	409	25294	-98
HUDS_AVE-JAMAICA__138_702	702	138	161	246	409	25295	98
HUDSON__-FALLSPRK_115_20-731	20-731	115	227	248	268	326939	65
HUDSONP_-FARRAGUT_345_B3402	B3402	345	543	737	930	25020	0
HUDSONTP-W49TH_ST_345_Y56	Y56	345	9999	9999	9999	325893	0
HUNTLEY_-ELM_ST___230_70	70	230	432	477	491	25855	-34
HUNTLEY_-PEROXYCM_115_39	39	115	211	217	242	26044	-42
HUNTLEY_-SAWYER___230_79	79	230	691	760	848	25127	-109
HUNTLEY_-SAWYER___230_80	80	230	691	760	848	25128	-149
HUNTLEY_-SWETH224_115_37	37	115	190	190	190	26045	-3
HUNTLEY_-TWOMLCRK_115_38	38	115	176	181	209	26047	42
HUNTLEY_-YOUNG214_115_36	36	115	210	210	210	26046	-4
HURLYAVE_345/115_BK 1	BK 1	345	486	560	560	25419	203
HURLYAVE-LINCNPRK_115_HP	HP	115	243	267	293	25833	71
HURLYAVE-ROSETON__345_303	303	345	1713	1885	1912	25218	269
HURLYAVE-STURGNPL_115_HS	HS	115	211	224	241	25834	80
HYATT___-BORDRCTY_115_10-979	10-979	115	155	170	179	25106	-26
IMC_TAP_-MECO_____115_15-IM	15	115	152	166	175	26132	-22
INDK-OSW-EPULASKI_115_2	2	115	141	144	165	25503	49
INDPDNCE-SCRIBA___345_25	25	345	1918	2115	2390	25859	-154
INGHAM_C_115_115_PAR 2	PAR 2	115	197	234	239	25242	120
INGHAM_C-INGHAM_E_115_R81	R81	115	222	234	239	25243	0
INGHAM_E-ESPRGFLD_115_7-942	7-942	115	124	124	124	25061	-26
INGHAM_E-FAGEDARY_115_9	9	115	128	135	152	25863	32
INGHAM_E-STJHNVLE_115_6	6	115	104	107	122	26133	29
JAMAICA_-LAKSUCSS_138_903	903	138	271	350	428	25090	-199
JAMAICA_-VALLYSTR_138_901 L_M	901 L&M	138	307	368	441	25048	100
JENNISON-AFTON____115_954	954	115	173	191	200	26186	8
JENNISON-KATTLVLE_115_943	943	115	146	160	178	25898	-60
JENNISON-SIDNEYRR_115_949	949	115	116	136	153	26173	-5
JOHNSON_-MAPLEWOD_115_12	12	115	239	239	239	26268	-63
KATONAH_-AMAWALK__115_995	995	115	291	311	311	325279	-34
KATONAH_-GLDNBRGD_115_991	991	115	260	286	310	26157	32
KENTAVE_-GREENWD__138_31232	31232	138	195	249	310	25299	-133
KINGS___-WEST BUS_138_881	881	138	571	612	678	326911	60
KNAPPCRN-SANDDOCK_115_KB_KC	KC	115	243	267	293	26240	-6

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
KNAPPCRN-SANDDOCK_115_KB_KC	KC	115	243	267	293	26240	-6
KNAPPCRN-SPACKILL_115_SK	SK	115	243	267	293	325777	-24
KNICRBKR-ALPS_____345_6	6	345	1456	1601	1780	625040	342
KNICRBKR-PLSNTVLY_345_Y57	Y57	345	2454	2454	2454	625041	-645
KNTFSRNC-SCOTAFLT_115_913	913	115	119	119	119	26207	-6
LADENTWN-BOWLINE__345_68	68	345	777	837	837	25249	463
LADENTWN-LOVETT___345_Y66	Y66	345	1823	2015	2557	625085	1106
LADENTWN-WHAVSTRW_345_67	67	345	1976	2387	2895	25248	-427
LAFARGE_-LN6_TP_1_115_6	6	115	141	144	159	25864	0
LAFAYTTE-CLRKSCRN_345_4-46	4-46	345	1279	1410	1793	25049	-714
LAFAYTTE-DEWITT___345_22	22	345	1643	1643	1643	25174	223
LAKSUCSS_138A_138B_PAR	PAR	138	271	350	427	25593	200
LANGDON_-NORTHSDE_115_936	936	115	231	250	282	26160	-32
LAONA___-MOONROAD_115_172	172	115	107	117	123	326591	-16
LAONA___-MOONROAD_115_173	173	115	107	117	123	326592	-16
LASHERRD-TAPBLSTN_115_43	43	115	478	478	478	327083	16
LAUREL L-GOUDEY___115_952	952	115	133	149	162	25012	38
LEEDS___-ATHENS___345_95	95	345	1624	1783	1946	25789	575
LEEDS___-HURLYAVE_345_301	301	345	1713	1885	1912	25055	472
LEEDS___-VNWAGNER_345_92	92	345	1624	1783	1912	25056	-577
LIGHTHSE-MALLORY__115_7	7	115	141	144	165	25521	-15
LINCNPRK-EKINGSTN_115_LR	LR	115	243	260	282	26223	-44
LINDEN__-GOETHALS_230_A2253	A2253	230	760	847	956	25017	0
LINDN_CG-LNDVFT___345_V-3022	V-3022	345	325	415	436	325657	-315
LITTLRIV-COLTON___115_8	8	115	93	101	106	25514	7
LOCKPORT-HINMAN___115_100	100	115	268	293	317	25087	153
LOCKPORT-OAKFIELD_115_112	112	115	166	175	187	25300	44
LOCKPORT-SHELBY76_115_113	113	115	174	191	199	25263	38
LOCKPORT-TELGRAPH_115_107	107	115	268	293	317	25265	59
LOCKPORT-TELGRAPH_115_111	111	115	199	199	199	25262	34
LOCKPORT-TELGRAPH_115_114	114	115	174	191	199	25264	45
LOCUSTGR-NEWBRDGE_138_558	558	138	354	584	664	25158	-298
LONG_MTN-CRICKVLY_345_398	398	345	1533	1935	2242	25033	-170
LOVETT___345_138_BK_192	BK 192	345	240	320	400	625086	13
LOVETT__-BOWLINOR_138_56	56	138	191	230	321	25877	-28
LOVETT__-BUCHAN_S_345_Y88	Y88	345	1823	2015	2557	25185	0
LOVETT__-STONYPNT_138_54	54	138	187	228	308	25885	2

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
LUTHERFT-MALTA____115_44	44	115	213	292	318	325890	3
LUTHERFT-MULBRYNM_115_308	308	115	311	318	318	325742	-42
LYON_MTN-KNTFSRNC_115_1(911)	1(911)	115	149	172	204	26205	0
MAINESBG-WATRCURE_345_30	30	345	1278	1410	1434	25018	-102
MALONE__-WILLIS___115_1-910	1-910	115	168	173	173	25586	-91
MANCHSTR-SPACKILL_115_MC	MC	115	243	267	293	325776	49
MAPLEWOD-WTRVLARS_115_19	19	115	239	239	239	25870	32
MAPLEWOD-WTRVLARS_115_31	31	115	168	188	239	25844	62
MARCY____765_345_AT1	AT1	765	1756	1756	1756	25455	387
MARCY____765_345_AT2	AT2	765	1938	2393	2407	25456	340
MARCY___-EDIC_____345_UE1-7	UE1-7	345	2187	2390	2390	25229	-524
MARCY___-FRASANNX_345_UCC2-41	UCC2-41	345	1793	1793	1793	25113	437
MARCY___-N.SCTLND_345_18	18	345	1793	2034	2241	25276	-536
MARION__-FARRAGUT_345_C3403	C3403	345	454	645	841	25038	0
MARSHVLE-CLINTON__115_12	12	115	152	158	158	325267	0
MASSENA__765_230_AT1	AT1	765	1286	1376	1664	25665	-98
MASSENA__765_230_AT2	AT2	765	1286	1376	1664	25666	-98
MASSENA_-MARCY____765_MSU1	MSU1	765	5300	5300	5300	25224	-727
MCADOO__-DEKALB___115_4	4	115	93	101	106	26064	10
MCINTYRE-CORNING__115_6	6	115	156	158	159	26108	-1
MCKNOWNV-NEWKRMKL_115_8	8	115	337	373	414	26499	-54
MECO____-CENTERST_115_22	10	115	152	153	153	327075	-2
MENANDS_-REYNOLDS_115_2	2	115	255	282	316	26135	-127
MENANDS_-RIVERSDE_115_3	3	115	298	344	414	26134	45
MERTPARK-WICCOPEE_115_WP	WP	115	246	260	282	325772	-31
MEYER____230_1___BK4P	BK 4	230	223	268	268	325765	0
MEYER___-CANANDGA_230_60	60	230	591	649	715	325604	-23
MEYER___-MORAINE__115_966	966	115	149	172	207	26166	14
MIDDLEOR-SHOEMAKR_138_29	29	138	506	587	671	26468	-182
MIDDLETP_345_138_BK 114	BK 114	345	506	587	671	26465	183
MIDDLETP-ROCKTVRN_345_CCRT34	CCRT34	345	1918	2115	2390	26464	-316
MILAN___-BLUESTOR_115_T7	T7	115	220	234	256	327498	-22
MILAN___-PLSTVYCH_115_10	10	115	169	199	233	26433	22
MILAN___-RHINEBCK_115_MR	MR	115	219	232	239	26242	-9
MILLERPL-HOLBROOK_138_885	885	138	529	591	670	26691	7
MILLIKEN-ETNA_____115_974	974	115	231	260	286	26177	-18
MILLIKEN-ETNA_____115_975	975	115	219	219	219	26178	-20

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
MILLWOOD_345_138_TA 1	TA 1	345	248	333	359	25530	0
MILLWOOD_345_138_TA 2	TA 2	345	234	305	321	25531	44
MILLWOOD-EASTVIEW_345_W82	W82	345	2430	2823	3357	25147	-897
MILLWOOD-EASTVIEW_345_W85	W85	345	2430	2823	3357	25258	-851
MILLWOOD-EASTVIEW_345_W99	W99	345	2430	2823	3357	25255	-850
MNTNDALE-WWDBURNY_115_957	957	115	133	138	138	325616	-22
MODENA__-GALEVILE_115_MG	MG	115	248	268	297	26236	0
MODENA__-OHIOVLLE_115_PX	PX	115	285	310	349	25835	10
MOHICAN_-DARBY____115_309	3	115	227	248	268	26687	-17
MOHICAN_-IRVINGTS_115_15	15	115	270	297	324	26122	0
MONSEY__-BURNS____138_601	601	138	456	478	500	325608	-49
MONTRFL_-CODINGTN_115_982	982	115	133	149	162	25728	-22
MONTRFL_-RIDGE_RD_115_963	963	115	133	149	162	26196	3
MONTRFL_-RIDGE_RD_115_978	978	115	131	131	131	26197	5
MOONROAD-FALCONER_115_175	175	115	107	117	123	26030	-27
MOONROAD-FALCONER_115_176	176	115	107	117	123	26031	-26
MORGANRD-LANGDON__115_936	936	115	238	239	239	325224	-4
MORTIMER-FAIRPORT_115_1	1	115	168	181	188	25163	-40
MORTIMER-FAIRPORT_115_2	2	115	166	175	187	25240	41
MORTIMER-STA_56___115_24	24	115	156	171	182	25096	-48
MORTIMER-STA_89___115_25	25	115	139	146	162	25095	-61
MOSES____230_115_AT1	AT1	230	526	589	719	25411	47
MOSES____230_115_AT2	AT2	230	479	589	722	25451	45
MOSES____230_115_AT3	AT3	230	220	276	288	25452	0
MOSES____230_115_AT4	AT4	230	551	598	719	25453	47
MOSES___-ADIRNDCK_230_MA1	MA1	230	447	473	517	25269	-5
MOSES___-ADIRNDCK_230_MA2	MA2	230	447	473	517	25270	-5
MOSES___-ALCOA_PA_115_MAL6	MAL6	115	257	281	284	25581	-103
MOSES___-GRASRIVR_115_MAL4	MAL4	115	291	319	350	25582	107
MOSES___-GRASRIVR_115_MAL5	MAL5	115	265	265	265	25583	107
MOSES___-MASSENA__230_MMS1	MMS1	230	1279	1376	1593	25274	98
MOSES___-MASSENA__230_MMS2	MMS2	230	1279	1376	1593	25275	98
MOSES___-WILLIS___230_MW1	MW1	230	447	473	517	25188	0
MOSES___-WILLIS___230_MW2	MW2	230	447	473	517	25271	-33
MOTTHAVN-RAINEY___345_Q11	Q11	345	741	858	1309	325430	363
MOTTHAVN-RAINEY___345_Q12	Q12	345	741	858	1309	325431	339
N.AKRON_-BATAVIA__115_108	108	115	152	159	159	25125	-28

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
N.CARTHG-TAYLORVL_115_8	8	115	119	119	119	26431	-18
N.END___-ASHLEYRD_115_702	702	115	350	386	434	25846	-68
N.END___-PLATSBRG_115_701	701	115	239	239	239	25848	135
N.HEMPST-WHAVSTOR_138_530	530	138	282	309	321	26506	54
N.SCTLND_345_115_BK 1	BK 1	345	529	642	796	25445	109
N.SCTLND_345_115_BK 2	BK 2	345	629	796	796	25460	103
N.SCTLND-AIRPRDCT_115_8	8	115	340	373	414	25496	97
N.SCTLND-ALTAMONT_115_20	20	115	141	144	165	25492	-45
N.SCTLND-BETHLHEM_115_4	4	115	311	313	313	25497	-98
N.SCTLND-FEURABSH_115_3	3	115	311	341	375	25495	92
N.SCTLND-KNICRBKR_345_2	2	345	2041	2242	2390	25217	316
N.SCTLND-LEEDS____345_93	93	345	1534	1692	1912	25171	-566
N.SCTLND-LEEDS____345_94	94	345	1534	1692	1912	25203	-563
N.SCTLND-OWENSCRN_115_7	7	115	141	144	165	25491	45
N.SCTLND-OWENSCRN_115_9	9	115	141	144	165	25490	-17
N.TROY__-EASTOVER_115_306	306	115	227	248	268	326095	-38
N.TROY__-EASTOVER_115_307	307	115	227	248	268	326096	-34
N.TROY__-HOOSICK__115_5	5	115	268	293	317	26131	-11
N.TROY__-SYCAWAY__115_14-988	14-988	115	227	248	268	26137	-2
N.TROY__-SYCAWAY__115_16	16	115	227	248	268	26139	-15
NANOTECH-MCKNOWNV_115_2	2	115	337	373	414	326637	34
NCHELSEA-FISHKPLN_115_NF	NF	115	255	290	315	26228	7
NCHELSEA-FORGEBRK_115_FO	FO	115	225	251	282	26230	-22
NEPTUNE_-DUFFYAVE_345_NEPTUNE	NEPTUNE	345	660	785	785	325304	660
NESCNSET-HOLBROOK_69__673	673	69	132	146	156	326339	-19
NEVRSNK_-NVRSK_TP_69__WH	WH	69	101	114	121	26244	-2
NEWBRDGE_345_138_BK_1	BK 1	345	417	525	597	325301	331
NEWBRDGE_345_138_BK_2	BK 2	345	450	469	562	325302	331
NEWBRDGE-BAGATLRD_138_563	563	138	406	584	664	25536	52
NEWBRDGE-DUFFYAVE_345_501	501	345	660	785	785	325303	661
NEWBRDGE-EGRDNCTY_138_467	467	138	267	398	668	325378	80
NEWBRDGE-RULAND___138_561	561	138	299	327	350	25305	101
NEWBRDGE-RULAND___138_562	562	138	295	323	346	25306	101
NEWBRDGE-RULAND___138_567	567	138	256	398	641	325379	101
NEWKRMKL-ALBANY___115_7	7	115	340	371	413	325257	-68
NIAGARA__230_115_AT1	AT1	230	240	345	479	25409	13
NIAGARA__230_115_AT2	AT2	230	276	350	449	25410	63

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
NIAGARA__345_230_AT3	AT3	345	383	567	767	25408	-127
NIAGARA__345_230_AT4	AT4	345	882	1027	1150	25449	-239
NIAGARA__345_230_AT5	AT5	345	441	552	575	25450	-131
NIAGARA_-DYSINGER_345_ND1	ND1	345	1591	1745	1793	327443	304
NIAGARA_-DYSINGER_345_ND2	ND2	345	1591	1745	1904	327456	302
NIAGARA_-LNGRD209_115_180	180	115	243	249	297	25104	-71
NIAGARA_-MOUNTAIN_115_120	120	115	224	250	291	25135	-63
NIAGARA_-PACKARD__115_191	191	115	449	567	597	25075	-120
NIAGARA_-PACKARD__115_192	192	115	449	567	597	25099	-139
NIAGARA_-PACKARD__115_193	193	115	449	567	597	25100	-123
NIAGARA_-PACKARD__115_194	194	115	449	567	597	25101	-123
NIAGARA_-PACKARD__115_195	195	115	449	567	597	25102	-143
NIAGARA_-PACKARD__230_61	61	230	767	844	949	25186	-201
NIAGARA_-PACKARD__230_62	62	230	717	717	949	25220	-197
NIAGARA_-ROBNSNRD_230_64	64	230	638	678	764	25088	-125
NIAGARA_-SANBORN__115_102	102	115	349	369	411	25103	-64
NINEMILE-CLAY_____345_8	8	345	1278	1410	1624	25167	-790
NINEMILE-FTZPK_NM_115_4	4	115	119	119	159	25500	-40
NINEMILE-SCRIBA___345_9	9	345	1278	1410	1792	25359	175
NOGDNBRG-MCINTYRE_115_9	9	115	159	159	159	26080	13
NRTH1385-NOR HBR__138_601	601	138	147	200	409	325597	34
NRTH1385-NOR HBR__138_602	602	138	147	200	409	325598	33
NRTH1385-NOR HBR__138_603	603	138	147	200	409	325599	33
NRTH1385-NRTHPORT_138_NNC	NNC	138	441	569	569	25035	100
NRTHPORT_138_138_PS2	PS2	138	470	485	582	25599	-182
NRTHPORT_138N_138E_PAR 1	PAR 1	138	491	569	569	25598	100
NRTHPORT-ELWOOD___138_678	678	138	355	580	656	25543	-8
NRTHPORT-ELWOOD___138_681	681	138	358	612	678	25544	-9
NRTHPORT-PILGRIM__138_672	672	138	174	286	414	25307	96
NRTHPORT-PILGRIM__138_677	677	138	351	573	664	25308	193
NRTHPORT-PILGRIM__138_679	679	138	356	576	664	25309	193
OAKDALE__230_115_BK 1	BK 1	230	318	398	398	25400	42
OAKDALE__345_1___BK3P	BK 3	345	520	600	600	25399	151
OAKDALE__345_115_BK 2	BK 2	345	542	557	597	25401	181
OAKDALE_-DELHI____115_919	919	115	171	179	179	25897	-20
OAKDALE_-ENDICOTT_115_938	938	115	175	175	175	26198	-41
OAKDALE_-FRASER___345_32	32	345	1314	1314	1314	25235	-139

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
OAKDALE_-GOUDEY___115_939	939	115	292	321	352	26182	-163
OAKDALE_-KATTLVLE_115_943	943	115	171	188	200	26201	-80
OAKDALE_-NORTHSDE_115_944	944	115	231	239	239	26199	69
OAKSTRET-CORPDRIV_138_704	704	138	235	309	431	326882	-58
OAKWOOD_-ELWOOD___138_674	674	138	379	585	663	25545	-40
OAKWOOD_-SYOSSET__138_675	675	138	263	364	657	25547	77
OHIOVLLE-HIGHLAND_115_OR	OR	115	223	234	278	26247	-39
ONEIDA__-GRNEMPFM_115_2	2	115	141	144	159	25895	0
ONEIDA__-SHERILPL_115_6	6	115	141	144	159	26113	36
ONEIDA__-WALESVIL_115_7	7	115	141	144	159	26115	-30
OSWEGO___345_115_BK 7	BK 7	345	576	657	774	25372	374
OSWEGO__-ELBRIDGE_345_17	17	345	1278	1410	1792	25234	-864
OSWEGO__-S.OSWEGO_115_3	3	115	209	250	250	25507	153
OSWEGO__-S.OSWEGO_115_5	5	115	209	250	250	25508	153
OSWEGO__-S.OSWEGO_115_8	8	115	318	318	318	25509	53
OSWEGO__-VOLNEY___345_11	11	345	1278	1410	1792	25199	193
OSWEGO__-VOLNEY___345_12	12	345	1278	1410	1792	25201	193
PACKARD__230_115_BK 3	BK 3	230	233	250	250	25414	-28
PACKARD__230_115_BK 4	BK 4	230	235	250	250	25415	23
PACKARD_-LNGRD209_115_182	182	115	243	249	297	26056	-75
PACKARD_-MILTR210_115_129	129	115	239	318	318	25906	-106
PACKARD_-MILTR210_115_130	130	115	239	317	317	26059	-96
PACKARD_-NIAGB130_115_181-922	181-922	115	194	199	233	26055	-60
PACKARD_-SAWYER___230_77	77	230	680	747	836	25164	-187
PACKARD_-SAWYER___230_78	78	230	680	747	836	25195	-187
PALMITER-BENNETT__115_932	932	115	143	157	167	26165	19
PANNELL__345_115_4T	BK 4T	345	582	598	598	326315	63
PANNELL__345_115_5T	BK 5T	345	582	598	598	326316	63
PANNELL__345_115_6T	BK 6T	345	582	598	598	326317	66
PANNELL_-CLAY_____345_1	1	345	1195	1315	1673	25058	395
PANNELL_-CLAY_____345_2	2	345	1195	1315	1673	25050	396
PANNELRG-FARMGTN__115_4-977	4-977	115	266	292	313	25080	-108
PARISHVL-COLTON___115_3	3	115	156	170	181	25241	-1
PATROON_-NANOTECH_115_6	6	115	340	373	414	25866	-12
PAVMNTRD-STOLLERD_115_926	926	115	299	335	358	325220	-61
PAWLING_-TILYFSTR_115_994	994	115	291	311	311	25902	19
PEARLRVR-HARNGCRN_34__45	45	35	25	29	32	26278	2

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
PIERCBRK-FIVEMILE_345_37	37	345	1195	1195	1195	326225	31
PILGRIM__138B_138A_PAR	PAR	138	351	375	427	25604	140
PILGRIM_-HAUPPAUG_138_871	871	138	351	375	427	25550	-140
PILGRIM_-KINGS____138_880	880	138	571	612	678	25537	-79
PLATSBRG_230_1___AT1	AT1	230	280	349	415	325794	0
PLATSBRG_230_1___AT4	AT4	230	295	324	361	325801	23
PLATSBRG-KNTFSRNC_115_PS1	PS1	115	149	172	204	25078	0
PLSNTVLE_345_13__BK 1	BK 1	345	64	70	70	25477	22
PLSNTVLE_345_13__BK 2	BK 2	345	64	70	70	25478	21
PLSNTVLE-DUNWODIE_345_W89	W89	345	2213	2402	2675	25182	-829
PLSNTVLE-DUNWODIE_345_W90	W90	345	1976	2282	2542	25250	-859
PLSNTVLY_345_115_BK S1	BK S1	345	478	478	478	25382	-186
PLSNTVLY-EFISHKIL_345_F36	F36	345	1976	2387	2895	25256	-411
PLSNTVLY-EFISHKIL_345_F37	F37	345	1976	2387	2895	25257	-411
PLSNTVLY-WOOD_ST__345_F30	F30	345	1975	2386	2895	25237	841
PLSNTVLY-WOOD_ST__345_F31	F31	345	1975	2386	2895	25238	841
PLSTVYCH-INWOOD___115_X	X	115	219	232	255	26209	-48
PLSTVYCH-MANCHSTR_115_M	M	115	243	267	293	26208	-68
PLSTVYCH-TODDHILL_115_C	C	115	255	302	334	325156	55
PORTER__-VALLEY___115_4	4	115	141	144	165	25231	72
PORTER__-WATKINRD_115_5	5	115	141	144	165	25232	82
PORTJEFF-HOLBROOK_138_862	862	138	337	373	410	25539	4
PORTJEFF-HOLBROOK_138_886	886	138	366	388	429	25540	4
PRINCTWN-N.SCTLND_345_361	361	345	2216	2216	2216	625031	-347
PRINCTWN-N.SCTLND_345_362	362	345	2216	2216	2216	625032	-347
PRINCTWN-N.SCTLND_345_55	55	345	1624	1781	1928	327492	-335
QUAKERRD-MACEDON__115_930	930	115	68	85	112	25093	-28
QUAKERRD-PANNELRG_115_914	914	115	265	295	312	25261	-1
QUAKERRD-PANNELRG_115_925	925	115	350	370	412	25682	0
QUAKERRD-SLEIGHT__115_13-980	13-980	115	146	146	146	25079	-51
QUENBRDG-VERNON___138_31281	31281	138	413	550	602	25159	213
QUENBRDG-VERNON___138_31282	31282	138	413	550	602	25160	158
QUENSBRY-CEDAR____115_10	10	115	156	170	181	26140	-43
RAINEY___345_1___8EP	BK 8E	345	311	361	424	325107	109
RAINEY___345_1___8WP	BK 8W	345	327	392	455	325110	56
RAINEY___345_138_5E	BK 5E	345	8888	8888	8888	326892	65
RAINEY___345_138_5W	BK 5W	345	370	458	540	625051	0

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
RAINEY__-E75THSTA_138_38M35	38M35	138	184	258	262	327306	101
RAINEY__-FARRAGUT_345_61	61	345	608	801	1286	25152	177
RAINEY__-FARRAGUT_345_62	62	345	739	854	1293	25253	156
RAINEY__-FARRAGUT_345_63	63	345	608	801	1286	25254	-169
RAINEY__-VERNON___138_36311	36311	138	280	325	382	25296	-109
RAINEY__-VERNON___138_36312	36312	138	295	353	409	25297	-57
RAINEY_138A_138B_PAR_5	PAR5	138	327	417	537	326893	-65
RAINEY_138A_138B_PAR_5W	PAR5W	138	379	463	540	625052	0
RAMAPO___345_138_BK 1300	BK 1300	345	592	677	743	25441	76
RAMAPO___345_138_BK 2300	BK 2300	345	592	677	743	25442	76
RAMAPO___345_345_PAR3500	PAR3500	345	740	901	1150	25370	100
RAMAPO___345_345_PAR4500	PAR4500	345	728	931	1093	25371	100
RAMAPO___500_345_BK 1500	BK 1500	500	1160	1419	1923	25656	200
RAMAPO__-BUCHAN_N_345_Y94	Y94	345	1823	2015	2542	25184	-845
RAMAPO__-LADENTWN_345_W72	W72	345	1823	2015	2557	25233	-219
RAMAPO__-SUGARLOF_345_76	76	345	2271	2271	2271	326219	-515
RAMAPOOR-STRLFRST_138_26	26	138	282	309	321	326302	-36
RAMAPOOR-TALLMAN__138_60	60	138	456	478	500	25880	93
RANGEHL_-CASTLEGD_115_937	937	115	239	239	239	325225	-28
REVERCOP-ROME_____115_4	4	115	141	144	165	26072	10
REYNOLDS_345_115_BK 2	BK 2	345	550	598	699	25403	281
REYNOLDS-ALPS_____345_1	1	345	1912	1912	1912	25587	-375
REYNOLDS-REGENRON_115_9	9	115	426	470	537	26129	-52
RIDGE_RD-HILLSIDE_115_963	963	115	133	149	162	26190	16
RIDGE_RD-HILLSIDE_115_978	978	115	133	149	155	26191	18
RIVERSDE-RVSD_TAP_115_4	4	115	239	239	239	26144	-71
RIVERSDE-TRINITY__115_18	18	115	159	178	258	26491	-23
RIVERSDE-TRINITY__115_19	19	115	214	256	311	26492	-28
RIVRHEAD-WILDWOOD_138_912	912	138	336	440	487	327372	84
ROBNSNRD_230_1___BK1P	BK 1	230	380	420	420	25395	21
ROBNSNRD-STOLLERD_230_65	65	230	673	717	717	25065	103
ROCHESTR_345_115_BK 1	BK 1T	345	582	629	630	25412	89
ROCHESTR_345_115_BK 2	BK 2T	345	389	476	478	25432	98
ROCHESTR_345_115_BK 3	BK 3T	345	582	629	630	25446	88
ROCHESTR_345_115_BK 5	BK 5T	345	546	630	630	325381	172
ROCHESTR-PANNELL__345_RP1	RP1	345	1589	1744	1904	25192	-294
ROCHESTR-PANNELL__345_RP2	RP2	345	1589	1744	1904	25172	-295

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
ROCKHILL-MNTNDALE_115_957	957	115	184	192	200	325615	-26
ROCKTVRN_345_115_BK TR1	BK TR1	345	485	530	530	25406	121
ROCKTVRN_345_115_BK TR3	BK TR3	345	485	533	560	26168	123
ROCKTVRN-RAMAPO___345_77	77	345	2271	2271	2271	25183	592
ROCKTVRN-SUGARLOF_345_76	76	345	2271	2271	2271	326218	619
ROCKTVRN-SUGRL_CH_115_SL	SL	115	372	410	473	625048	16
ROME____-TURNSTON_115_1	1	115	239	239	239	26112	0
RONKOKMA-HOLBROOK_138_875	875	138	542	581	643	25541	18
ROSA_RD_-GE_R_D___115_14	14	115	245	257	294	26145	-51
ROSETON_-EFISHKIL_345_RFK305	RFK305	345	2528	2772	3133	25108	1200
ROSETON_-ROCKTVRN_345_311	311	345	1713	1885	2102	25069	-197
ROTTRDAM_230_115_BK 6	BK 6	230	406	462	478	25407	-159
ROTTRDAM_230_115_BK 7	BK 7	230	346	396	448	25392	-153
ROTTRDAM_230_115_BK 8	BK 8	230	377	427	474	25413	-123
ROTTRDAM-BURDECK__115_17	17	115	141	144	165	25129	14
ROTTRDAM-BURDECK__115_19	19	115	141	144	165	26146	21
ROTTRDAM-CURRY_RD_115_11	11	115	268	293	317	25869	-47
ROTTRDAM-EASTOVER_230_38	38	230	511	564	637	326094	-73
ROTTRDAM-FRONT_ST_115_16	16	115	268	293	317	26147	-105
ROTTRDAM-PINEBUSH_115_35	35	115	141	144	165	25865	-39
RULAND__-HOLBROOK_138_882	882	138	529	591	670	25538	25
RULAND__-PILGRIM__138_661	661	138	514	574	587	25310	30
RULAND__-PILGRIM__138_662	662	138	559	581	581	25311	30
RYAN____-PLATSBRG_230_RYP-2	RYP-2	230	295	324	361	25273	23
RYNDS_HL-HIGHLAND_115_HR	HR	115	220	234	256	325825	23
RYNDS_HL-INWOOD___115_IR	IR	115	219	232	255	26248	27
S.MAHWAH-RAMAPOOR_138_51	51	138	282	309	321	25888	57
S.OSWEGO-CLEARWTR_115_9	9	115	199	199	199	25510	-91
S.OSWEGO-CURTIS___115_10	10	115	199	199	199	25511	-74
S.OSWEGO-HAMRHILL_115_6	6	115	141	144	165	25513	-50
S.OSWEGO-NINEMILE_115_1	1	115	141	144	165	25501	-46
S.OWEGO_-GOUDEY___115_961	961	115	143	157	167	25725	-28
S.OWEGO_-NWAVERLY_115_962	962	115	143	157	167	25727	18
S.OWEGO_-NWAVERLY_115_962	962	115	143	157	167	25727	18
S.PERRY_-FROST_RD_230_86	86	230	521	573	621	326586	98
S.PERRY_-MEYER____115_934	934	115	106	116	120	26194	15
S.RIPLEY-DUNKIRK__230_68	68	230	597	607	607	25045	64

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
S124_____115A_115B_PS1	PS1	115	176	242	414	325930	85
S124_____115A_115B_PS2	PS2	115	176	242	414	325931	85
S42_____-S124_____115_932	932	115	213	233	237	325827	-85
S42_____-S124_____115_938	938	115	213	230	230	325972	-85
SANBORN_-LOCKPORT_115_101	101	115	285	300	318	25267	-60
SAND_BAR-PLATSBRG_115_PV20	PV20	115	236	307	320	25027	-106
SANDDOCK-NCHELSEA_115_SC	SC	115	255	282	315	26249	-13
SCHODACK-GREENBSH_115_13	13	115	227	248	268	325804	28
SCHUYLER-PORTER___115_13	13	115	224	239	239	326142	42
SCOTAFLT-MASONCR__115_909	909	115	189	207	221	325702	-8
SCRIBA__-FITZPTRK_345_FS-10	FS-10	345	1434	1434	1662	25076	-48
SCRIBA__-VOLNEY___345_20	20	345	1474	1626	1881	25204	569
SCRIBA__-VOLNEY___345_21	21	345	1912	1912	1912	25314	746
SHAWNERD-LOCKPORT_115_104	104	115	199	199	199	26050	0
SHENDOAH-EFISHKIL_115_EF	EF	115	299	342	375	26251	87
SHERMAN_-SPIERFLS_115_17	17	115	141	144	159	26148	-34
SHERMCRK-ACADEMY__138_331	331	138	345	431	546	325755	-135
SHERMCRK-ACADEMY__138_332	332	138	345	431	546	325754	-134
SHERMCRK-E179THST_138_15031	15031	138	184	235	371	25156	-161
SHERMCRK-E179THST_138_15032	15032	138	184	235	371	25157	-159
SHOEMAKR-CHESTROR_138_27	27	138	282	309	321	26466	-52
SHOR_NPX-SHOREHAM_138_CSC	CSC	138	353	353	353	325153	329
SHORE_RD_345_138_BK 1	BK 1	345	513	534	641	25439	314
SHORE_RD_345_138_BK 2	BK 2	345	513	534	641	25440	292
SHORE_RD-GLENWOOD_138_365	365	138	370	392	434	25205	-105
SHORE_RD-GLENWOOD_138_366	366	138	589	636	732	25154	-105
SHORE_RD-LAKSUCSS_138_367	367	138	249	365	623	25145	-197
SHORE_RD-LAKSUCSS_138_368	368	138	252	369	630	25150	-197
SHOREHAM-MILLERPL_138_879	879	138	529	591	670	25117	-19
SHOREHAM-WILDWOOD_138_863	863	138	567	602	685	25115	149
SHOREHAM-WILDWOOD_138_867	867	138	529	591	670	25114	146
SIDNEYRR-DELHI____115_949	949	115	116	127	127	326184	24
SLEIGHT_-CLYDE____115_3-971	3-971	115	155	155	155	26686	11
SMAHWAH__345_138_BK 258	BK 258	345	441	516	569	25393	86
SMAHWAH_-RAMAPO___345_69	69	345	1601	2015	2268	25021	57
SMAHWAH_-RAMAPO___345_70	70	345	1822	2015	2433	25259	29
SMITHFLD-SALISBRY_69__690/FV	690/FV	69	60	60	60	25619	9

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
SPENCPRT-STA_113__115_947	947	115	143	151	161	326080	-50
SPIERFLS-BUTLER___115_4	4	115	128	135	152	26136	-35
SPIERFLS-CURTPALM_115_9	9	115	128	135	152	326145	7
SPIERFLS-MOHICAN__115_7	7	115	141	144	165	26435	-30
SPIERFLS-QUENSBRY_115_5	5	115	141	144	165	26141	-44
SPIERFLS-TAPBROOK_115_2	2	115	282	288	318	25874	-7
SPIERFLS-TAPBROOK_115_302	302	115	222	234	278	25873	-2
SPRNBRK__345_138_BK N7	BK N7	345	382	451	472	25628	161
SPRNBRK__345_138_BK S6	BK S6	345	382	451	472	25625	163
SPRNBRK__345KV_REA_R49	R49	345	755	978	1423	26725	696
SPRNBRK_-ACADEMY__345_M29	M29	345	536	775	1369	325756	273
SPRNBRK_-DUNWODIE_138_99942	99942	138	409	438	464	25246	-161
SPRNBRK_-DUNWODIE_345_W75	W75	345	2849	3170	3640	25071	-349
SPRNBRK_-DUNWOODN_138_99941	99941	138	414	465	465	25245	-163
SPRNBRK_-EGRDNCTR_345_Y49	Y49	345	693	940	1360	25105	696
SPRNBRK_-TREMONT__345_X28	X28	345	542	725	1220	25175	333
SPRNBRK_-W49TH_ST_345_M51	M51	345	799	956	1543	25053	-491
SPRNBRK_-W49TH_ST_345_M52	M52	345	832	979	1542	25223	-491
STA_128_-STA_82___115_906	906	115	129	129	129	26303	-25
STA_133_-STA_1185_115_933	933	115	117	129	149	326161	27
STA_135_-STA_230__115_929	929	115	281	298	313	325839	100
STA_158_-STA_128__115_924	924	115	155	171	179	26654	22
STA_162_-S.PERRY__115_906- 7X	906- 7X	115	143	157	167	25062	0
STA_162_-STA_1185_115_907	907	115	142	150	166	325254	-12
STA_162_-STA_158__115_924	924	115	155	171	179	26653	1
STA_204_-S124_____115_911	911	115	272	280	306	26307	84
STA_23__-S42_____115_920	920	115	230	230	230	70027	0
STA_23__-STA_255R_115_941	941	115	299	398	398	327242	-73
STA_23__-STA_262__115_944	944	115	400	538	640	70028	20
STA_230_-QUAKERRD_115_929	929	115	297	325	358	325840	-93
STA_251_-MORTIMER_115_901	901	115	243	256	278	25097	65
STA_251_-STA_33___115_942	942	115	245	261	283	326100	39
STA_251_-STA_33___115_943	943	115	245	261	283	326101	-79
STA_255__345_115_1TRANS	BK 1T	345	583	672	672	327207	78
STA_255__345_115_2TRANS	BK 2T	345	583	672	672	327208	78
STA_255_-ROCHESTR_345_40	40	345	1595	1751	1912	327209	62
STA_255_-ROCHESTR_345_HR1	HR1	345	1591	1745	1904	327243	39

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
STA_255_-ROCHESTR_345_HR2	HR2	345	1591	1745	1904	327244	39
STA_255R-STA_418__115_940	940	115	300	604	717	327241	-83
STA_262_-STA_33___115_943	943	115	400	640	640	326414	33
STA_37__-STA_48___115_926	926	115	351	373	414	26314	62
STA_37__-STA_67___115_926	926	115	250	280	300	26313	-91
STA_418_-STA_113__115_947	947	115	153	167	178	326069	-59
STA_56__-STA_82___115_23	23	115	176	181	209	26287	-38
STA_67__-ROCHESRG_115_922	922	115	343	390	398	26321	98
STA_67__-STA_418__115_910	910	115	286	303	332	326048	4
STA_67__-STA_82___115_903	903	115	343	416	433	26322	-27
STA_69__-STA_71___115_945	945	115	129	145	161	326238	0
STA_69__-STA_93___115_917	917	115	151	167	175	326237	-8
STA_7___-STA_48___115_919	919	115	272	280	306	26302	36
STA_7___-STA_48___115_927	927	115	263	294	348	326039	-40
STA_7___-STA_93___115_917	917	115	143	149	159	26301	-15
STA_70__-SPENCPRT_115_947	947	115	143	151	161	326343	34
STA_71__-STA_70___115_946	946	115	143	151	161	326342	17
STA_82__-MORTIMER_115_7X8272	7X8272	115	291	320	356	25098	-94
STA_82__-ROCHESRG_115_904	904	115	596	651	717	25081	-153
STA_82__-ROCHESRG_115_905	905	115	608	669	697	26305	142
STA_82__-STA_251__115_902	902	115	224	250	278	70058	-39
STA_82__-STA_48___115_916	916	115	458	542	564	326055	62
STATE_CA-PATRTAP__115_15	15	115	170	188	239	26494	0
STATE_ST-WRGHTAVE_115_976	976	115	231	239	239	26200	94
STEBBINS-DUNKIRK__230_84	84	230	637	637	637	625020	91
STERLING-RULAND___138_663	663	138	229	284	315	26498	114
STJHNVLE-MARSHVLE_115_11	11	115	159	159	159	26127	0
STLAWRNC-MOSES____230_L33P	L33P	230	376	454	519	25026	0
STLAWRNC-MOSES____230_L34P	L34P	230	420	490	519	25037	0
STOLLERD_345_115_BK 3	BK 3	345	249	299	350	25461	108
STOLLERD_345_115_BK 4	BK 4	345	249	299	349	25462	108
STOLLERD-HISHELDN_230_67	67	230	521	573	621	25064	-20
STONBROK-PORTJEFF_69__877	877	69	132	146	156	326336	27
STONCREK-WETHSRFD_230_83	83	230	521	573	621	325973	-43
STONER__-VAILMILL_115_12	12	115	121	121	121	25680	5
STONYRDG_230_115_BK1	BK 1	230	258	258	258	325811	80
STONYRDG-HILLSIDE_230_72	72	230	607	665	734	325810	-50

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
STURGNPL-OHIOVLLE_115_OR	OR	115	223	234	242	326294	-47
SUGARLOF_345_138_BK1112	BK 1112	345	456	478	500	326220	102
SUGRL_CH_138_115_T1	T-1	138	420	420	420	625050	0
SUGRL_CH-SUGRLOAF_138_30	30	138	484	533	556	625049	0
SUGRLOAF-STRLFRST_138_261	261	138	282	309	321	25326	75
SULLVNPK-STONYRDG_115_712	712	115	297	305	336	325809	79
SWAGRTWN-ROTTRDAM_115_1	1	115	478	478	478	26429	111
SWANROAD-LOCKPORT_115_103	103	115	199	199	199	26051	-47
SYLVANLK-PAWLING__115_990	990	115	255	278	306	26156	-69
SYOSSET_-LOCUSTGR_138_559	559	138	519	580	656	25904	256
TALLMAN_-MONSEY___138_602	602	138	456	478	500	325609	-70
TAYLORVL-BREMEN___115_6	6	115	130	144	161	26070	-27
TAYLORVL-WATERSRD_115_5	5	115	130	144	154	26107	0
TEALLAVE-BRIDGPRT_115_5	5	115	141	144	165	325164	-76
TEALLAVE-CROUSEHD_115_13	13	115	239	239	239	326066	12
TEALLAVE-SALCARBM_115_6	6	115	227	239	239	26154	76
TEMPLE__-PEAT ST__115_10	10	115	145	176	179	26715	53
TERMINAL-PORTER___115_6	6	115	243	250	298	326140	-44
TERMINAL-SCHUYLER_115_7	7	115	141	144	165	326141	-16
TILDEN__-SOUTHWOD_115_19	19	115	222	234	239	26092	89
TILYFSTR-CROTONFL_115_994	994	115	175	178	179	326413	6
TODDHILL-FISHKPLN_115_A	A	115	285	301	319	325157	-28
TREMONT__138A_138B_BK 11	BK 11	138	271	329	377	25649	165
TREMONT__138C_138D_BK 12	BK 12	138	271	329	377	25650	167
TREMONT__345_138_BK 11	BK11	345	299	350	407	25473	165
TREMONT__345_138_BK 12	BK12	345	299	350	407	25474	167
TREMONT_-PARKCHTR_138_38X01	38X01	138	251	363	550	25120	83
TREMONT_-PARKCHTR_138_38X02	38X02	138	251	363	550	25121	83
TREMONT_-PARKCHTR_138_38X03	38X03	138	270	397	550	25122	83
TREMONT_-PARKCHTR_138_38X04	38X04	138	270	397	550	25123	84
TULLERHL-CLRKSCRN_115_1-716	1-716	115	156	170	181	26192	29
UNIONVAL-CROTONFL_115_991	991	115	291	312	326	326417	-67
VALLEY__-FAIRFIEL_115_12	12	115	141	144	165	325743	-47
VALLYSTR_138A_138B_PAR	PAR	138	313	368	441	25607	100
VALLYSTR-BARRETT__138_291	291	138	207	293	406	25312	103
VALLYSTR-BARRETT__138_292	292	138	200	286	402	25313	116
VALLYSTR-EGRDNCTY_138_261	261	138	283	385	677	327260	-55

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
VALLYSTR-EGRDNCTY_138_262	262	138	190	279	419	25244	-91
VALLYSTR-FARRCKWY_69__270	270	69	126	146	156	326311	30
VALLYSTR-LAKEVIEW_69_264	264	69	60	68	71	325818	1
VALLYSTR-MALVERNE_69_267	267	69	96	106	111	325820	11
VERNON___138A_138B_PAR R1	PAR R1	138	370	431	510	325712	0
VERNON__-GREENWD__138_31231	31231	138	195	249	310	25337	186
VERNON__-KENTAVE__138_31232	31232	138	195	249	310	26123	-133
VERNON__-W49TH_ST_138_38M72	38M72	138	178	252	252	325122	0
VINEGRHL_138_27__TR1	TR1	138	116	146	158	327488	0
VINEGRHL_138_27__TR2	TR2	138	116	146	158	625027	0
VNWAGNER-PLSNTVLY_345_Y58	Y58	345	2445	2719	2770	625044	-572
VNWAGNER-PLSNTVLY_345_Y59	Y59	345	2445	2719	2770	625045	-572
VOLNEY__-CLAY_____345_6	6	345	1474	1626	1881	25198	-911
VOLNEY__-MARCY____345_19	19	345	1918	2115	2390	25345	780
W.NYACK_-SNKEHLRD_138_562	562	138	212	281	312	325906	-46
W_ERIAVE-HICKLING_115_935	935	115	169	190	208	325568	-18
W_ERIAVE-SULLVNPK_115_711	711	115	271	278	306	325808	59
W_YAPHNK-HOLTS_8G_69__853	853	69	88	100	106	26547	0
W49TH_ST_345_138_TR1	TR1	345	462	532	651	325061	141
W49TH_ST-E13THSTA_345_M54	M54	345	772	1009	1575	25228	-143
W49TH_ST-E13THSTA_345_M55	M55	345	772	1009	1575	25222	-170
WADNGRIV-NSHORBCH_138_878	878	138	447	596	678	325642	-15
WADNGRIV-SHOREHAM_138_891	891	138	524	585	663	25342	15
WALCK_RD-BUFALO78_115_133	133	115	239	317	317	26153	-79
WALDWICK-SMAHWAH__345_J3410	J3410	345	895	1214	2043	25032	-29
WALDWICK-SMAHWAH__345_K3411	K3411	345	908	1222	2049	25039	29
WARNSBRG-SCOFLDRD_115_10	10	115	119	119	119	326148	32
WARREN__-FALCONER_115_171	171	115	116	116	120	25015	0
WATERSRD-BNVL_TAP_115_8	8	115	141	144	165	327519	21
WATERSRD-LOWVILLE_115_7	7	115	128	135	152	327520	28
WATKINRD-INGHAM_C_115_2	2	115	128	135	152	25805	-58
WATRCURE_345_230_BK 1	BK 1	345	516	600	600	25402	70
WATRCURE_345_230_BK 2	BK 2	345	519	599	599	327087	71
WATRCURE-OAKDALE__230_71	71	230	322	450	685	25179	-42
WATRCURE-OAKDALE__345_31	31	345	717	717	717	25178	39
WBALMVLE-MARLBORO_115_MW	MW	115	243	267	293	326090	-16
WEST BUS-SILLSRD__138_873	873	138	571	612	678	325618	4

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
WETHSRFD-S.PERRY__230_85	85	230	521	573	621	325623	80
WHAVSTOR_345_138_BK 194	BK 194	345	451	546	619	25447	150
WHAVSTOR-LOVETT___138_53	53	138	187	228	308	25884	4
WHAVSTOR-STONYPNT_138_542	542	138	282	309	321	326049	-10
WHAVSTRW-WHAVSTOR_345_671	671	345	451	546	619	326216	150
WHEMPSTD-CNTYLPRS_69_357-355	357-355	69	141	141	141	325822	22
WHEMPSTD-HEMPSTED_69_356	356	69	128	141	141	325823	20
WHEMPSTD-LAKEVIEW_69_352	352	69	60	68	71	325819	0
WHEMPSTD-MALVERNE_69_353	353	69	60	68	71	325821	20
WHITEHAL-COMSTKNM_115_13	13	115	141	144	159	25903	21
WHITEHAL-TICONDRG_115_3	3	115	141	144	159	26471	-28
WHITMAN_-ONEIDA___115_8	8	115	159	159	159	25894	3
WICCOPEE-SHENDOAH_115_FS	FS	115	243	260	282	325773	32
WILDWOOD-RIVRHEAD_138_890	890	138	374	396	438	25905	86
WILLET__-ENORWICH_115_709	709	115	155	171	181	25732	-36
WILLIS___230_115_AT1	AT1	230	172	201	225	25388	38
WILLIS___230_115_AT2	AT2	230	172	201	225	25390	38
WILLIS__-CHAT_TAP_115_1(911)	1(911)	115	173	191	205	26204	-7
WILLIS__-PATNODE__230_WPN-1	WPN-1	230	530	582	612	325565	0
WILLIS__-RYAN_____230_WRY-2	WRY-2	230	478	478	591	325566	-109
WILLWBRK-FRESHKLS_138_29211	29211	138	207	275	450	25319	100
WILLWBRK-FRESHKLS_138_29212	29212	138	207	275	450	25320	116
WOLF_RD_-EVERETRD_115_10	10	115	270	297	324	26255	25
WOOD_ST__345_115_BK 1	BK 1	345	350	400	420	25437	94
WOOD_ST__345_115_BK 2	BK 2	345	358	412	420	25438	72
WOOD_ST__345_115_BK_3	BK 3	345	350	400	420	625083	72
WOOD_ST_-MILLWOOD_345_W80	W80	345	1975	2386	2895	25148	-765
WOOD_ST_-MILLWOOD_345_W81	W81	345	1975	2386	2895	25525	-765
WOOD_ST_-PLSNTVLE_345_Y86	Y86	345	2408	2668	3065	25358	-884
WOOD_ST_-PLSNTVLE_345_Y87	Y87	345	2102	2282	2541	25132	-853
WOODLAWN-RUTHROAD_115_12	12	115	222	234	268	26490	-8
WOODMERE-VALLYSTR_69__261	261	69	120	136	143	325285	52
WOODSTNY-AMAWALK__115_996	996	115	260	286	310	25574	70
WOODSTNY-KATONAH__115_901	901	115	260	286	303	326481	-52
WRGHTAVE-MILLIKEN_115_973	973	115	231	253	253	26195	-53
WWDBURNE-STHLOWTP_69__WH1	WH1	69	56	61	64	326487	26
WWDBURNY_115_69__BK 1	BK 1	115	50	50	50	25404	27

Name	ID	Voltage	NORM	LTE	STE	PTID	Flow
WYNTKLNM-REYNOLDS_115_13-988	13-988	115	227	248	268	26143	-26
YAHNUNDA-DEBALSO__115_3	3	115	152	166	175	26515	53
YAWGERRD-RIDGE_RD_115_963	963	115	188	206	219	326312	19

Appendix E – INTERFACE DEFINITIONS

NYISO OPERATING INTERFACES & OASIS TRANSMISSION PATHS

DYSINGER EAST		
West (Zone A) – Genesee (Zone B)		
Name	**Line ID**	**Voltage (kV)**
*Dysinger-Station 255 (Henrietta)	DH1	345
*Dysinger-Station 255 (Henrietta)	DH2	345
*Lockport-N. Akron	108	115
*Lockport-Oakfield	112	115
*Lockport- Telegraph	111	115
*Lockport-Shelby	113	115
*Lockport-Telegraph	107	115
*Lockport-Telegraph	114	115
West (Zone A) – Central (Zone C)		
*Stolle Road-High Sheldon	67	230
*Andover-Palmiter	157-932	115

SPRAIN BROOK-DUNWOODIE SOUTH		
Dunwoodie (Zone I) – NYC (Zone J)		
Name	**Line ID**	**Voltage (kV)**
*Dunwoodie-Mott Haven	71	345
*Dunwoodie-Mott Haven	72	345
Sprain Brook-Tremont*	X28	345
*Sprain Brook-West 49th Street	M51	345
*Sprain Brook-West 49th Street	M52	345
*Sprain Brook-Academy	M29	345
*Dunwoodie-Sherman Creek	99031	138
*Dunwoodie-Sherman Creek	99032	138
*Dunwoodie-East 179th Street	99153	138
Long Island (Zone K) – NYC (Zone J)		
*Lake Success-Jamaica	903	138
*Valley Stream-Jamaica	901L_M	138

* indicates the metered end of the circuit

MOSES SOUTH		
North (Zone D) – Mohawk Valley (Zone E)		
Name	**Line ID**	**Voltage (kV)**
*Massena-Marcy	MSU1	765
*Moses-Adirondack	MA1	230
*Moses-Adirondack	MA2	230
*Dennison-Norfolk	4	115
*Dennison-Sandstone	5	115
*Alcoa-N. Ogdensburg	13	115
Parishville-Colton*	3	115

UPNY-CONED		
Hudson Valley (Zone G) – Millwood (Zone H)		
Name	**Line ID**	**Voltage (kV)**
*Lovett-Buchanan	Y88	345
*Pleasant Valley-Wood St.	F30	345
*Pleasant Valley-Wood St.	F31	345
*Pleasant Valley-East Fishkill	F36	345
*Pleasant Valley-East Fishkill	F37	345
*Ramapo-Buchanan	Y94	345
Roseton-East Fishkill*	RFK305	345
*Fishkill Plains–Sylvan Lake	FP/990	115
East Fishkill 345/115*	BK1	115/345
East Fishkill 345/115*	BK2	115/345

UPNY-SENY		
Mohawk Valley (Zone E) – Hudson Valley (Zone G)		
Name	**Line ID**	**Voltage (kV)**
Middletown-Rock Tavern*	CCRT34	345
Coopers Corners-Dolson Ave.*	CCDA42	345
Middletown 345*/138	BK114	345/138
West Woodbourne 115/69*	BK1	115/69
Capital (Zone F) – Hudson Valley (Zone G)		
*Athens-Van Wagner	91	345
*Leeds-Van Wagner	92	345
*Leeds-Hurley Ave.	301	345
Churchtown-North Catskill*	5	115
Blue Stores-Milan*	T7	115
Knickerbocker-Pleasant Valley*	Y57	115
*Feura Bush-North Catskill	2	115

* indicates the metered end of the circuit

TOTAL EAST		
Mohawk Valley (Zone E) – Capital (Zone F)		
Name	**Line ID**	**Voltage (kV)**
Edic-Gordon Rd*	14	345
Marcy-New Scotland*	18	345
*Fraser-Gilboa	GF5-35	345
*Edic-Princetown	351	345
*Edic-Princetown	352	345
East Springfield-Inghams*	7-942	115
*Inghams PAR	PAR	115
*Inghams Bus Tie	R81	115
Mohawk Valley (Zone E) – Hudson Valley (Zone G)		
Middletown-Rock Tavern*	CCRT34	345
Coopers Corners-Dolson Ave.*	CCDA42	345
Middletown 345*/138	BK114	345/138
West Woodbourne 115/69*	BK1	115/69
North (Zone D) – ISONE (Zone N)		
*Plattsburgh-Sand Bar	PV20	115
PJM East (Zone P) – Hudson Valley (Zone G)		
Hopatcong-Ramapo*	5018	500
*Waldwick-S. Mahwah	J3410	345
*Waldwick-S. Mahwah	K3411	345
PJM East (Zone P) – NYC (Zone J)		
Marion-Farragut*	C3403	345
Hudson-Farragut*	B3402	345
Linden-Goethals*	A2253	230
PJM (Rockland Electric) – Hudson Valley (Zone G)		
*Closter-Sparkill	751	69
*Harings Corners-W. Nyack	701	69
*Harings Corners-Corporate Drive	703	138
*Montvale-Bluehill	44	69
*Montvale-Bluehill	43	69
*Montvale-Pearl River	491	69
*Harings Corners-Pearl River	45	34
*S. Mahwah-Ramapo	51	138
*S. Mahwah-Hillburn	65	69
S. Mahwah 138*/345	BK258	138/345

* indicates the metered end of the circuit

CENTRAL EAST		
Mohawk Valley (Zone E) – Capital (Zone F)		
Name	**Line ID**	**Voltage (kV)**
Edic-Gordon Rd*	14	345
Marcy-New Scotland*	18	345
*Edic-Princetown	351	345
*Edic-Princetown	352	345
East Springfield-Inghams*	7-942	115
Inghams PAR*	PAR 2	115
Inghams Bus Tie*	R81	115
North (Zone D) – ISONE (Zone N)		
*Plattsburgh-Sand Bar	PV20	115

CONED – LIPA		
Dunwoodie (Zone I) – Long Island (Zone K)		
Name	**Line ID**	**Voltage (kV)**
*Dunwoodie-Shore Road	Y50	345
*Sprain Brook-East Garden City	Y49	345
NYC (Zone J) – Long Island (Zone K)		
Jamaica-Valley Stream*	901_L&M	138
Jamaica-Lake Success*	903	138

NYISO-ISONE		
North (Zone D) – ISONE (Zone N)		
Name	**Line ID**	**Voltage (kV)**
*Plattsburgh-Sand Bar	PV20	115
Capital (Zone F) – ISONE (Zone N)		
*Alps-Berkshire	393	345
Eastover-Bear Swamp*	E205W	230
*Hoosick –Bennington	K6	115
*Whitehall-Blissville	K7	115
Hudson Valley (Zone G) – ISONE (Zone N)		
Name	**Line ID**	**Voltage (kV)**
*Cricket Valley-Long Mountain	398	345
Smithfield-Salisbury*	690/FV	69

* indicates the metered end of the circuit

PJM-NYISO			
PJM East (Zone P) – NYC (Zone J)			
	Name	**Line ID**	**Voltage (kV)**
	Marion-Farragut*	C3403	345
	Hudson-Farragut*	B3402	345
	W49St*-Hudson TP	Y56	345
PJM West – Central (Zone C)			
	*Mainesburg-Watercure	30	345
	*Mainesburg-Homer City	47	345
	*Homer City-Mainesburg	47	345
	E. Towanda-Hillside*	70	230
	Laurel Lake-Goudey*	952	115
	*E. Sayre-N. Waverly	956	115
PJM West – West (Zone A)			
	*Pierce Brook-Five Mile Road	37	345
	*Pierce Brook-Homer City	48	345
	*Homer City-Pierce Brook	48	345
	Erie East-South Ripley*	69	230
	*Warren-Falconer	171	115
PJM East (Zone P) – Hudson Valley (Zone G)			
	Hopatcong-Ramapo*	5018	500
	*Waldwick-S. Mahwah	J3410	345
	*Waldwick-S. Mahwah	K3411	345
PJM (Rockland Electric) – Hudson Valley (Zone G)			
	*Closter-Sparkill	751	69
	*Harings Corners- W. Nyack	701	69
	*Harings Corners-Corporate Drive	703	138
	*Montvale-Bluehill	44	69
	*Montvale-Bluehill	43	69
	*Montvale-Pearl River	491	69
	*Harings Corners- Pearl River	45	34
	*S. Mahwah-Ramapo	51	138
	*S. Mahwah-Hillburn	65	69
	S. Mahwah 138*/345	BK258	138/345

* indicates the metered end of the circuit

WESTERN EXPORT		
West (Zone A) – Ontario South (Zone O)		
Name	**Line ID**	**Voltage (kV)**
*Niagara-Beck	PA301	345
*Niagara-Beck	PA302	345
*Niagara-Beck	PA27	230
Packard-Beck*	BP76	230
West (Zone A) – PJM West		
*Pierce Brook-Five Mile Road	37	345
*Pierce Brook-Homer City	48	345
*Homer City-Pierce Brook	48	345
Erie East-South Ripley*	69	230
*Warren-Falconer	171	115
West (Zone A) – Genesee (Zone B)		
*Dysinger-Station 255 (Henrietta)	DH1	345
*Dysinger-Station 255 (Henrietta)	DH2	345
*Lockport-N. Akron	108	115
*Lockport-Oakfield	112	115
*Lockport-Telegraph	111	115
*Lockport-Shelby	113	115
*Lockport-Telegraph	107	115
*Lockport-Telegraph	114	115
West (Zone A) – Central (Zone C)		
*Stolle Road-High Sheldon	67	230
*Andover-Palmiter	157-932	115

OSWEGO EXPORT	
Oswego Complex Generation Export Limit	
Name	**Gen ID**
Sithe Unit G1	Stihe-G1
Sithe Unit G2	Sithe-G2
Sithe Unit G3	Sithe-G3
Sithe Unit G4	Sithe-G4
Sithe Unit G5	Sithe-G5
Sithe Unit G6	Sithe-G6
Fitzpatrick Generator	Fitz
Nine Mile Point 1 Generator	9 mile #1
Nine Mile Point 2 Generator	9 mile #2
Oswego 5 Generator	Oswego 5
Oswego 6 Generator	Oswego 6

* indicates the metered end of the circuit

West Central		
Genesee (Zone B) – Central (Zone C)		
Name	**Line ID**	**Voltage (kV)**
Pannell Rd-Clay*	PC1	345
Pannell Rd-Clay*	PC2	345
*Quaker-Macedon	930	115
*Mortimer-Fairport	1	115
*Mortimer-Fairport	2	115
*Pannell-Farmington	4-977	115
*Quaker Rd-Sleight Rd	13-980	115
*Quaker Rd-Macedon	930	115
*St. 162 - S. Perry	906	115
Hook Rd 34/115	BK1	34.5/115
Hook Rd 34/115	BK2	34.5/115
Clyde 34/115	TR1	34.5/115
Farmington 34.5/115kV	#7	34.5/115
Farmington 12/115 kV	#4	34.5/115
West (Zone A) – Central (Zone C)		
*Stolle Road-High Sheldon	67	230
*Andover-Palmiter	157-932	115

* indicates the metered end of the circuit

IESO (Ontario)-NYISO		
Ontario East (Zone O) – North (Zone D)		
Name	**Line ID**	**Voltage (kV)**
St. Lawrence-Moses*	L33P	230
St. Lawrence-Moses*	L34P	230
Ontario South (Zone O) – West (Zone A)		
Beck-Niagara*	PA301	345
Beck-Niagara*	PA302	345
Beck-Niagara*	PA27	230
*Beck-Packard	BP76	230

Appendix F – ANNOTATED TARA OUTPUT

This Section Is Available Electronically If Requested

Appendix G – COMPARISON OF TRANSFER LIMITS WINTER 2024-25 VS. 2023-24

		WINTER 2024-25		WINTER 2023-24		
Interface		**Limit (MW)**	**Contingency**	**Limit (MW)**	**Contingency**	**Delta**
Dysinger East	Normal	2100	(1)	2225	(1)	-125
	Emergency	2175	(2)	2300	(2)	-125
West Central Reverse	Normal	1850	(3)	1800	(3)	50
	Emergency	2525	(4)	2475	(4)	50
UPNY - ConEd	Normal	7275	(5)	6250	(6)	1025
	Emergency	8575	(7)	8175	(8)	400
UPNY - SENY	Normal	4750	(5)	4200	(9)	550
	Emergency	5950	(7)	5675	(8)	275
Sprain Brook Dunwoodie-South	Normal	3975	(10)	3850	(10)	125
	Emergency	4125	(11)	4175	(11)	-50
Con Ed - LIPA	Normal	1000	(12)	1025	(12)	-25
	Emergency	1425	(13)	1425	(14)	0
Central East	**MSC-7040 FLOW**	**HQ -> NY**	**600 MW**	**HQ -> NY**	**600 MW**	
	Normal	4200	(15)	4175	(17)	25
	Emergency	4700	(16)	4775	(16)	-75
	MSC-7040 FLOW	**No Flow**	**0 MW**	**No Flow**	**0 MW**	
	Normal	4200	(15)	4175	(17)	25
	Emergency	4700	(16)	4750	(16)	-50
	MSC-7040 FLOW	**NY -> HQ**	**600 MW**	**NY -> HQ**	**600 MW**	
	Normal	4175	(15)	4625	(17)	-450
	Emergency	4700	(16)	4775	(16)	-75
Total East [1]	**MSC-7040 FLOW**	**HQ -> NY**	**600 MW**	**HQ -> NY**	**600 MW**	
	Normal	5350	(18)	5425	(18)	-75
	Emergency	6100	(7)	5900	(8)	200
	MSC-7040 FLOW	**No Flow**	**0 MW**	**No Flow**	**0 MW**	
	Normal	5325	(18)	5400	(18)	-75
	Emergency	6075	(7)	5875	(8)	200
	MSC-7040 FLOW	**NY -> HQ**	**600 MW**	**NY -> HQ**	**600 MW**	
	Normal	5325	(18)	4850	(18)	475
	Emergency	6000	(7)	5375	(8)	625

[1] Limits in this report do not include Neptune in the Total East Interface.

		WINTER 2024-25		WINTER 2023-24		
Interface		**Limit (MW)**	**Contingency**	**Limit (MW)**	**Contingency**	**Delta**
Moses - South	**MSC-7040 FLOW**	**HQ -> NY**	**600 MW**	**HQ -> NY**	**600 MW**	
	Normal	1450	(19)	1000	(20)	450
	Emergency	2375	(21)	1050	(22)	1325
	MSC-7040 FLOW	**No Flow**	**0 MW**	**No Flow**	**0 MW**	
	Normal	1025	(20)	950	(20)	75
	Emergency	1325	(23)	1000	(22)	325
	MSC-7040 FLOW	**NY -> HQ**	**600 MW**	**NY -> HQ**	**600 MW**	
	Normal	525	(20)	425	(20)	100
	Emergency	825	(23)	550	(24)	275

NYISO WINTER 2023-25 CROSS-STATE THERMAL LIMIT CONTINGENCY LIST

ID	Limiting Element	Rating		Contingency	
(1)	Niagara – Dysinger (ND1) 345 kV	@LTE3,4	1745 MW	L/O	Niagara – Dysinger (ND2) 345 kV
(2)	Niagara – Dysinger (ND1) 345 kV	@STE	1793 MW	L/O	Niagara – Dysinger (ND2) 345 kV
(3)	Clay – Pannell (1) 345 kV	@LTE	1315 MW	L/O	Clay – Pannell (2) 345 kV Clay – Edic (2-15) 345 kV
(4)	Clay – Pannell (2) 345 kV	@STE	1673 MW	L/O	Pannell – Clay (1)
(5)	Lovett – Buchanan (Y88) 345 kV	@LTE	2015 MW	L/O	Buchanan – Ramapo (Y94) 345kV
(6)	Ladentown – Buchanan (Y88) 345 kV	@LTE	2015 MW	L/O	Buchanan – Ramapo (Y94) 345kV
(7)	Coopers Corners – Middletown TAP (CCRT34) 345 kV	@STE	1792 MW	L/O	Dolson Ave – Rock Tavern (DART-44) 345 kV
(8)	Coopers Corner – Middletown Tap (CCRT34) 345 kV	@STE	1801 MW	L/O	Dolson – Rock Tavern (DART44) 345 kV
(9)	Pleasant Valley – Wood Street (F30) 345 kV	@LTE	2384 MW	L/O	East Fishkill – Wood Street (F38 & F39) 345kV
(10)	Dunwoodie – Mott Haven (71) 345kV	@MTE	1083 MW	L/O	Dunwoodie – Mott Haven (72) 345kV
(11)	Dunwoodie – Mott Haven (71) 345kV	@NORM	741 MW		Pre – Contingency Loading
(12)	Dunwoodie – Shore Rd. (Y50) 345kV	@LTE	977 MW	L/O	Sprainbrook – East Garden City (Y49) 345kV Sprainbrook – Academy (M29) 345 kV
(13)	Newbridge – Locust Grove (558) 138 kV	@NORM	354 MW		Pre-Contingency Loading
(14)	Newbridge – Locust Grove (558) 138 kV	@NORM	664 MW		Pre-Contingency Loading
(15)	New Scotland – Leeds (93) 345kV	@LTE	1692 MW	L/O	New Scotland – Leeds (94) 345kV
(16)	New Scotland – Leeds (93) 345kV	@STE	1912 MW	L/O	New Scotland – Leeds (94) 345kV

(17)	Gordon Road – Rotterdam (30) 230 kV	@LTE	688 MW	L/O	Gordon Road – Princetown 345 kV (371) Gordon Road (31) 345/230 kV Transformer
(18)	Roseton – East Fishkill (RFK305)	@LTE	2772 MW	L/O	Lovett – Buchanan (Y88) 345 kV Ramapo – Buchanan (Y94) 345 kV Buchanan (BKTA5) 345/138 kV Transformer
(19)	Chases Lake – Porter (11) 230 kV	@LTE	564 MW	L/O	Chateauguay – Massena (7040) 765 kV Massena – Marcy (MSU1) 765 kV and TransÉnergie delivery
(20)	Chases Lake – Porter (11) 230 kV	@LTE	564 MW	L/O	Moses – Massena (MMS1 & MMS2) 345 kV
(21)	Willis – Malone (1-910) 115 kV	@STE	173 MW	L/O	Alcoa PA – Alcoa (R8105) 115 kV
(22)	Chases Lake – Porter (11) 230 kV	@STE	586 MW	L/O	Marcy – Massena (MSU1)765 kV
(23)	Willis – Malone (1-910) 115 kV	@STE	173 MW	L/O	Sandbar – Plattsburgh (PV-20) 115 kV
(24)	Chases Lake – Porter (11) 230 kV	@STE	586 MW	L/O	Marcy – Massena (MSU1) 765 MW Massena – Chateaguay (7040) 765 MW

Table-1 DISTRIBUTION FACTORS FOR DYSINGER EAST CIRCUITS

Monitored Element		Base Flow	TRANSFER	DYSINGER-STA255	STOLLE-HIGHSHELDON	LOCKPT-SHEL	LOCKPT-SOUR
DYSINGER	345 STATION 255 345 1	8.05	32.40%	TRIP	18.08%	19.14%	21.09%
STOLE230	230 SHLDN230 230 1	8.05	32.40%	67.38%	18.08%	19.14%	21.09%
PALMT115	115 ANDOVER1 115 1	-20.39	9.99%	3.63%	TRIP	4.84%	5.33%
LOCKPORT	115 SHEL-113 115 1	-11.28	1.59%	0.93%	10.46%	0.80%	0.88%
LOCKPORT	115 NAKR-108 115 1	38.17	2.39%	2.43%	3.06%	TRIP	14.47%
LOCKPORT	115 OAKFLDTP 115 1	42.31	0.88%	0.89%	1.13%	3.40%	3.68%
LOCKPORT	115 SOUR-111 115 1	44.47	0.99%	1.00%	1.26%	3.81%	4.12%
LOCKPORT	115 TELRD114 115 1	34.35	2.43%	2.47%	3.10%	13.35%	TRIP
LOCKPORT	115 TELRD107 115 1	59.25	1.13%	1.15%	1.44%	6.00%	5.88%
DYSINGER	345 STATION 255 345 2	45.41	2.39%	2.43%	3.05%	18.14%	10.92%
SUB-TOTALS			86.58%	82.30%	59.65%	88.61%	87.46%
L33P-L34P		-0.35	4.35%	6.52%	9.34%	4.08%	4.49%
PJM-NYISO		582.94	2.86%	8.44%	29.91%	5.49%	8.01%
TOTALS			93.79%	97.26%	98.90%	98.18%	99.96%

Table-2 DISTRIBUTION FACTORS FOR WEST CENTRAL CIRCUITS

Monitored Element			Base Flow	TRANSFER	PANNEL-CLAY (1)	PANNEL-CLAY (2)	STOLLE-SHLDN	PANNEL-FARM	S121-SLEGH
PANNELL3	345 CLAY	345 1	395.16	31.28%	**TRIP**	-55.09%	10.69%	19.44%	18.74%
PANNELL3	345 CLAY	345 2	396.44	31.38%	-55.17%	**TRIP**	10.73%	19.51%	18.80%
STOLE230	230 SHLDN230	230 1	20.39	9.99%	-3.07%	-3.07%	**TRIP**	7.55%	2.50%
PANNELLI	115 FRMGTN-4	115 1	-109.26	3.53%	-6.09%	-6.10%	8.26%	**TRIP**	17.15%
S121 B#2	115 SLEIG115	115 1	-51.12	2.75%	-3.75%	-3.75%	1.74%	10.94%	**TRIP**
ANDOVER1	115 PALMT115	115 1	11.28	1.59%	-0.50%	-0.50%	10.46%	2.47%	0.59%
MORTIMER	115 LAWLER-1	115 1	-39.95	2.55%	-2.58%	-2.59%	1.26%	10.28%	4.62%
MORTIMER	115 LAWLER-2	115 1	-40.63	2.58%	-2.61%	-2.62%	1.28%	10.40%	4.67%
QUAKER	115 MACDN115	115 1	-28.33	0.34%	-0.48%	-0.48%	0.37%	3.21%	19.25%
STA 162	115 S.PER115	115 1	-11.08	0.61%	-1.81%	-1.81%	14.88%	4.35%	1.87%
	SUB-TOTALS			**86.58%**	**-76.06%**	**-76.01%**	**59.65%**	**88.15%**	**88.18%**
L33P-L34P			0.50	0.00%	-9.23%	-9.24%	9.34%	2.87%	3.96%
PJM-NYISO			0.00	13.73%	-14.64%	-14.66%	30.95%	8.97%	7.82%
	TOTALS			**100.31%**	**99.92%**	**99.92%**	**99.94%**	**99.99%**	**99.97%**

Table-3 DISTRIBUTION FACTORS FOR TOTAL EAST CIRCUITS

Monitored Element				Base Flow	TRANSFER	EDIC34-GORDON	FRASER-GILBA	MARCY3-NSCOT	WALD-SMAWA	HOPATCONG-RAMPO	LINDEN-GOETH
EDIC	345	GORDONRD	345 1	434.08	12.43%	TRIP	11.39%	18.61%	0.19%	2.24%	2.05%
FRASR345	345	GILB 345	345 1	85.33	14.07%	11.50%	TRIP	15.07%	0.26%	3.11%	3.86%
MARCY T1	345	N.SCOT99	345 1	466.49	14.68%	17.46%	14.01%	TRIP	0.23%	2.67%	2.44%
WALDWICK	345	SMAHWAH1	345 1	-29.11	0.13%	1.29%	1.70%	1.64%	TRIP	28.50%	20.51%
COOPC345	345	DOLSON_AVE	345 2	200.29	14.28%	3.73%	16.24%	4.83%	0.40%	4.20%	0.88%
E.SPR115	115	INGHAM-E	115 1	-23.34	0.98%	0.24%	2.49%	-0.06%	0.02%	0.18%	0.18%
W.WDB115	115	W.WDBR69	69.0 1	25.95	0.49%	0.29%	1.09%	0.36%	0.00%	0.05%	0.18%
NE_PV20_NY	115	CUMBERLAND	115 1	106.24	0.00%	1.59%	1.16%	1.87%	0.06%	0.65%	0.60%
Edic	345	Princetown	345 1	474.44	14.09%	25.66%	13.24%	21.50%	0.22%	2.55%	2.33%
Edic	345	Princetown	345 2	474.14	14.08%	25.64%	13.23%	21.49%	0.22%	2.55%	2.32%
INGMS-CD	115	INGHAM-E	115 1	119.93	0.00%	3.31%	0.52%	2.84%	0.03%	0.38%	0.34%
MDTN TAP	345	ROCK TAV	345 1	285.55	12.75%	3.51%	15.12%	4.54%	0.47%	3.60%	1.11%
MDTN TAP	345	SHOEMTAP	138 1	176.99	2.14%	0.32%	1.58%	0.41%	-0.10%	0.83%	-0.32%
WALDWICK	345	SMAHWAH2	345 1	29.09	-0.13%	1.34%	1.69%	1.71%	91.00%	29.06%	21.48%
HCOR138	138	CORPORATE DR	138 1	-33.12	0.01%	0.00%	0.00%	0.00%	0.05%	0.01%	0.01%
SMAHWAH1	345	SMAH138	138 1	-86.91	0.39%	-0.07%	0.03%	-0.09%	-3.47%	-0.69%	-1.32%
SMAH138	138	RAMP138	138 1	-55.81	-0.26%	0.04%	-0.02%	0.05%	2.78%	0.68%	0.86%
CLOSTER	69.0	SPARKILL	69.0 1	-3.35	0.05%	0.01%	0.03%	0.01%	0.04%	-0.01%	0.07%
HCOR69	69.0	WNYA69	69.0 1	-10.63	0.10%	0.02%	0.06%	0.02%	0.08%	-0.02%	0.14%
MONTVALE	69.0	L491T	69.0 1	-20.70	0.07%	0.01%	0.04%	0.02%	0.12%	0.01%	0.11%
SMAH69	69.0	HILB69	69.0 1	-14.15	-0.35%	-0.02%	-0.14%	-0.02%	0.42%	0.00%	0.13%
HCOR34	34.5	PEARL34	34.5 1	-1.53	-0.01%	0.00%	0.00%	0.00%	0.00%	0.00%	-0.01%
MONTVALE	69.0	BLUHILL	69.0 1	1.14	0.00	0.00	0.00	0.00	0.00	0.00	0.00
MONTVALE	69.0	BLUHILL	69.0 2	1.14	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SUB-TOTALS					100.35%	95.90%	93.60%	94.81%	92.57%	80.58%	57.82%
RAMAPO 5	500	HOPATCONG	500 1	200.03	0.00%	2.32%	3.19%	2.94%	4.39%	TRIP	23.28%
NEPTCONV	345	NWBRG	345 1	660.00	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
COGNTECH	345	G22_VFT345KV	345 1	314.50	0.00%	0.39%	0.72%	0.49%	0.58%	4.25%	18.64%
B3402 PAR1	345	MARION	345 1	0.00	0.00%	O/S	O/S	O/S	O/S	O/S	O/S
C3403 PAR2	345	MARION	345 1	0.00	0.00%	O/S	O/S	O/S	O/S	O/S	O/S
GOETHALS	230	LINDEN	230 1	0.21	0.00%	1.37%	2.55%	1.73%	2.03%	15.00%	TRIP
TOTALS					100.35%	99.96%	100.06%	99.96%	99.57%	99.82%	99.73%

Table-4 DISTRIBUTION FACTORS FOR UPNY-CONED CIRCUITS

Monitored Element			Base Flow	TRANSFER	LADNTW-BUCHS	RAMAPO-BUCHN	PLVLLY-E.FISHK	ROSETN-E.FISHK	LINDEN-GOETH
LOVETT	345 BUCHANAN S	345 1	1118.67	15.19%	TRIP	58.36%	-3.76%	27.55%	32.27%
RAMAPO	345 BUCHANAN N	345 1	847.31	14.26%	-43.18%	TRIP	-0.23%	14.90%	21.62%
PLTVLLEY	345 E FISHKILL	345 2	412.53	10.97%	7.36%	-0.60%	TRIP	32.72%	1.49%
ROSETON	345 E FISHKILL	345 1	1196.85	13.01%	-27.67%	20.22%	16.80%	TRIP	12.95%
FISHKILL	115 SYLVN115	115 1	84.40	0.84%	-0.95%	0.48%	-0.16%	0.25%	0.35%
PLTVLLEY	345 E FISHKILL	345 1	412.53	10.97%	7.36%	-0.60%	64.81%	32.72%	1.49%
PLTVLLEY	345 WOOD C	345 1	841.72	16.93%	-14.79%	4.40%	8.89%	-8.70%	3.99%
PLTVLLEY	345 WOOD B	345 1	841.66	16.93%	-14.79%	4.40%	8.89%	-8.70%	3.99%
E FISH	115 E FISHKILL	345 1	-178.57	0.89%	-1.00%	0.93%	2.71%	5.59%	0.65%
	SUB_TOTALS			99.11%	-86.66%	86.66%	95.25%	90.74%	78.17%
B3402 PAR1	345 MARION	345 1	0.00	0.00%	O/S	O/S	O/S	O/S	O/S
C3403 PAR2	345 MARION	345 1	0.00	0.00%	O/S	O/S	O/S	O/S	O/S
GOETHALS	230 LINDEN	230 1	0.07	0.00%	-8.55%	7.74%	0.20%	3.42%	TRIP
COGNTECH	345 G22_VFT345KV	345 1	314.50	0.00%	-2.43%	2.20%	0.06%	0.97%	18.64%
NRTHPT P	138 NRTHPT1	138 1	100.00	0.00%	-1.37%	2.48%	1.79%	-0.71%	2.53%
	TOTALS			99.11%	-99.00%	99.07%	97.29%	94.41%	99.34%

Table-5 DISTRIBUTION FACTORS FOR SPRAINBROOK DUNWOODIE SOUTH CIRCUITS

Monitored Element			Base Flow	TRANSFER	DUNWDE-RAINY	SPRAIN-TRMNT	SPRAIN-W49TH	VSTR-KMAICA	LKSUC-JMAICA
REAC71	345 MOTT HAVEN	345 3	475.35	29.45%	TRIP	7.34%	24.73%	-13.27%	13.76%
REAC72	345 MOTT HAVEN	345 4	464.17	28.76%	57.08%	7.16%	24.12%	-12.95%	13.42%
SPRAINBROOK	345 TREMONT	345 1	332.58	0.00%	0.42%	TRIP	0.61%	-3.47%	3.38%
SPRAINBROOK	345 ACADEMY	345 1	272.65	0.00%	0.33%	17.87%	0.50%	-2.80%	2.73%
REACM51	345 W 49 ST	345 1	490.85	20.89%	19.03%	8.34%	TRIP	-11.21%	10.53%
REACM52	345 W 49 ST	345 2	490.85	20.89%	19.03%	8.34%	45.56%	-11.21%	10.53%
DUN NO1R	138 S CREEK W	138 1	114.66	0.00%	0.24%	9.80%	0.21%	-1.55%	1.53%
DUN NO2R	138 S CREEK E	138 1	104.89	0.00%	0.32%	12.98%	0.27%	-2.05%	2.03%
DUN SO1R	138 E179 ST W	138 1	189.76	0.00%	0.48%	19.82%	0.42%	-3.13%	3.10%
V STRM P	138 JAMAICA	138 1	199.55	0.00%	0.79%	3.43%	0.79%	-36.72%	TRIP
L SUCSPH	138 JAMAICA	138 1	99.89	0.00%	-0.79%	-3.63%	-0.87%	TRIP	37.85%
SUB-TOTALS				100.00%	96.93%	91.45%	96.33%	-98.37%	98.87%
B3402 PAR1	345 MARION	345 1	0.00	0.00%	O/S	O/S	O/S	O/S	O/S
C3403 PAR2	345 MARION	345 1	0.00	0.00%	O/S	O/S	O/S	O/S	O/S
GOETHALS	230 LINDEN	230 1	0.07	0.00%	1.16%	1.00%	1.51%	-1.27%	0.88%
COGNTECH	345 G22_VFT345KV	345 1	296.35	0.00%	0.33%	0.28%	0.43%	-0.36%	0.25%
TOTALS				100.00%	98.42%	92.74%	98.27%	-100.00%	100.00%

Table-6 DISTRIBUTION FACTORS FOR MOSES SOUTH CIRCUITS

Monitored Element		Base Flow	TRANSFER	MASSEN-MARCY	MOSES-ADRONB1	MOSES-ADRONB2
MASS 765	765 MARCY765 765 1	789.97	77.18%	**TRIP**	29.65%	29.70%
MOSES W	230 ADRON B1 230 1	8.82	7.91%	15.57%	**TRIP**	56.12%
MOSES W	230 ADRON B2 230 1	8.82	7.93%	15.62%	56.19%	**TRIP**
ALCOA-NM	115 BRADY 115 1	20.48	1.14%	2.24%	0.54%	0.55%
ALLENS F	115 COLTON 115 1	-0.39	1.46%	0.90%	0.31%	0.31%
DENNISON	115 ANDRWS-4 115 1	12.15	2.19%	4.33%	1.05%	1.05%
DENNISON	115 LWRNCE-B 115 1	11.80	2.19%	4.33%	1.05%	1.05%
	SUB_TOTALS		**100.00%**	**42.98%**	**88.80%**	**88.78%**
MOSES E	230 ST_LAWR_L33P 230 1	1.10	0.00%	22.85%	4.50%	4.51%
MOSES E	230 ST_LAWR_L34P 230 1	0.00	0.00%	22.68%	4.47%	4.47%
CUMBERLAND	115 NE_PV20_NY 115 1	106.40	0.00%	11.49%	2.24%	2.24%
	TOTALS		**100.00%**	**100.00%**	**100.00%**	**100.00%**

Table-7 DISTRIBUTION FACTORS FOR NEISO NYISO CIRCUITS

Monitored Element				Base Flow	TRANSFER	ALPS34-BERK	CRICKET VLLY - LONG MTN	EASTOVER-BEARSWAMP
NE_393_NY	345 ALPS345	345 1		56.55	33.35%	TRIP	-39.09%	38.85%
NE_398_NY	345 CKTVLLEY	345 1		44.14	53.81%	-50.33%	TRIP	26.26%
NE_E205W_NY	230 EASTOVER RD	230 1		-30.58	8.89%	-16.46%	-8.64%	TRIP
NE_PV20_NY	115 CUMBERLAND	115 1		106.20	0.00%	-6.14%	-4.29%	3.14%
NE_K7_NY	115 WHITEHAL	115 1		0.00	0.00%	-8.52%	-4.56%	7.59%
NE_K6_NY	115 HOOSICK	115 1		5.55	2.96%	-7.70%	-2.93%	18.21%
NE_690_NY	69.0 SMITHFLD	69.0 1		1.71	0.99%	-0.98%	-2.80%	0.54%
NE_601_NY	138 NRTHPT P	138 1		34.30	0.00%	-3.18%	-12.50%	1.73%
NE_602_NY	138 NRTHPT P	138 2		34.30	0.00%	-3.17%	-12.46%	1.73%
NE_603_NY	138 NRTHPT P	138 3		34.30	0.00%	-3.15%	-12.38%	1.72%
TOTALS					100.00%	99.62%	99.64%	99.77%

Table-8 DISTRIBUTION FACTORS FOR ONTARIO NYISO CIRCUITS

Monitored Element	Base Flow	TRANSFER	BECK-NIAG301	BECK-NIAG302	PA27-NIAGAR	BP76-PACKD2	MOSE-STLAWL33
BECK_#2_H301 345 NIAG 345 345 1	16.93	33.39%	TRIP	55.84%	34.13%	32.01%	21.55%
BECK_#2_H302 345 NIAG 345 345 1	16.92	33.39%	55.84%	TRIP	34.13%	32.01%	21.55%
BECK_#2_PA27 230 NIAGAR2W 230 1	11.50	15.83%	20.68%	20.68%	TRIP	29.73%	10.82%
BECK_#2_BP76 230 PACKARD2 230 1	-51.22	17.39%	16.87%	16.87%	25.86%	TRIP	9.72%
ST_LAWR_L33P 230 MOSES E 230 1	-0.19	0.00%	2.46%	2.46%	2.04%	2.11%	TRIP
ST_LAWR_L34P 230 MOSES E 230 1	0.00	0.00%	O/S	O/S	O/S	O/S	O/S
SUB-TOTALS		100.00%	96.04%	96.04%	96.32%	96.03%	88.20%
ON-MICH	-0.63	0.00%	3.87%	3.87%	3.59%	3.87%	33.40%
TOTALS		100.00%	99.73%	99.73%	99.75%	99.73%	99.02%

Table-9 DISTRIBUTION FACTORS FOR PJM-NYISO CIRCUITS

Monitored Element				Base Flow	TRANSFER	HOPATCONG-RAMPO	LINDEN-GOETH	WALDWK-SMAWA	PIERCE-5MILE	MAIN-WATER	E.TOWD-HILLS	Erie-Ripley
HOPATCONG	500	RAMAPO 5	500 1	279.93	0.00%	TRIP	23.28%	4.39%	10.18%	10.27%	9.15%	8.14%
LINDEN	230	GOETHALS	230 1	104.89	0.00%	15.00%	TRIP	2.03%	4.73%	4.75%	3.53%	3.83%
WALDWICK	345	SMAHWAH2	345 1	133.60	0.03%	28.50%	20.51%	TRIP	5.88%	6.03%	4.53%	4.77%
26PIERCEBRK	345	5MILE345	345 1	230.13	26.62%	3.82%	2.75%	0.34%	TRIP	16.93%	5.96%	31.94%
26MAINESBURG	345	WATRC345	345 1	78.97	28.61%	4.06%	2.91%	0.37%	17.83%	TRIP	27.14%	8.15%
26E.TWANDA	230	HILSD230	230 1	142.20	19.56%	3.76%	2.26%	0.29%	6.53%	28.24%	TRIP	5.01%
26ERIE E REA	230	S RIPLEY	230 1	152.44	11.42%	1.19%	0.87%	0.11%	12.44%	3.02%	1.78%	TRIP
WALDWICK	345	SMAHWAH1	345 1	91.46	-0.03%	29.06%	21.48%	91.00%	6.26%	6.43%	4.84%	5.08%
26HOMER CY	345	NY_HOMER_WAT	345 Z1	140.80	0.00%	3.24%	2.42%	0.30%	13.24%	-61.70%	9.77%	7.48%
26HOMER CY	345	NY_HOMER_STO	345 Z1	97.90	0.00%	2.41%	1.76%	0.22%	-55.36%	11.64%	1.01%	11.40%
26MAINESBURG	345	NY_MAINESBUR	345 Z1	139.60	0.00%	-3.24%	-2.42%	-0.30%	-13.24%	61.70%	-9.77%	-7.48%
26PIERCEBRK	345	NY_PIERCEBRK	345 Z1	97.50	0.00%	-2.41%	-1.76%	-0.22%	55.36%	-11.64%	-1.01%	-11.40%
NEPTCONV	345	NWBRG	345 1	314.00	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
G22_VFT345KV	345	COGNTECH	345 1	314.50	0.00%	4.25%	18.64%	0.58%	1.33%	1.34%	1.00%	1.08%
SMAHWAH1	345	SMAH138	138 1	63.79	0.09%	-0.69%	-1.32%	-3.47%	-0.53%	-0.55%	-0.43%	-0.43%
HCOR138	138	CORPORATE DR	138 1	32.61	0.00%	0.01%	0.01%	0.05%	0.00%	0.00%	0.00%	0.00%
SMAH138	138	RAMP138	138 1	61.25	-0.06%	0.68%	0.86%	2.78%	0.34%	0.36%	0.28%	0.28%
26E.SAYRE	115	N.WAV115	115 1	52.00	7.20%	1.34%	0.82%	0.10%	2.65%	8.26%	25.30%	1.68%
26LAUREL L	115	WESTOVER115	115 1	76.43	6.59%	1.30%	0.78%	0.10%	1.31%	3.25%	9.87%	0.89%
26WARREN	115	FALCONER	115 1	0.00	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
CLOSTER	69.0	SPARKILL	69.0 1	3.18	0.01%	-0.01%	0.07%	0.04%	0.01%	0.01%	0.01%	0.01%
HCOR69	69.0	WNYA69	69.0 1	10.30	0.02%	-0.02%	0.14%	0.08%	0.01%	0.01%	0.01%	0.01%
MONTVALE	69.0	BLUHILL	69.0 1	-1.14	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
MONTVALE	69.0	BLUHILL	69.0 2	-1.14	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
MONTVALE	69.0	L491T	69.0 1	19.78	0.02%	0.01%	0.11%	0.12%	0.01%	0.01%	0.01%	0.01%
SMAH69	69.0	HILB69	69.0 1	33.78	-0.09%	0.00%	0.13%	0.42%	0.15%	0.17%	0.13%	0.12%
HCOR34	34.5	PEARL34	34.5 1	1.54	0.00%	0.00%	-0.01%	0.00%	0.00%	0.00%	0.00%	0.00%
MARION	345	B3402 PAR1	345 1	0.00	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
MARION	345	C3403 PAR2	345 1	0.00	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
SUB-TOTALS					100.00%	92.28%	94.30%	99.30%	69.14%	88.52%	93.10%	70.54%
ON-MICH				-0.63	0.00%	6.97%	5.13%	0.63%	28.55%	10.50%	6.34%	27.31%
TOTALS					100.00%	99.25%	99.43%	99.94%	97.69%	99.02%	99.44%	97.85%