Moses South investigation: confirmed repair and diagnostic scenarios

2025 dated topology · the same 8,663 qualified hours · lower error is better

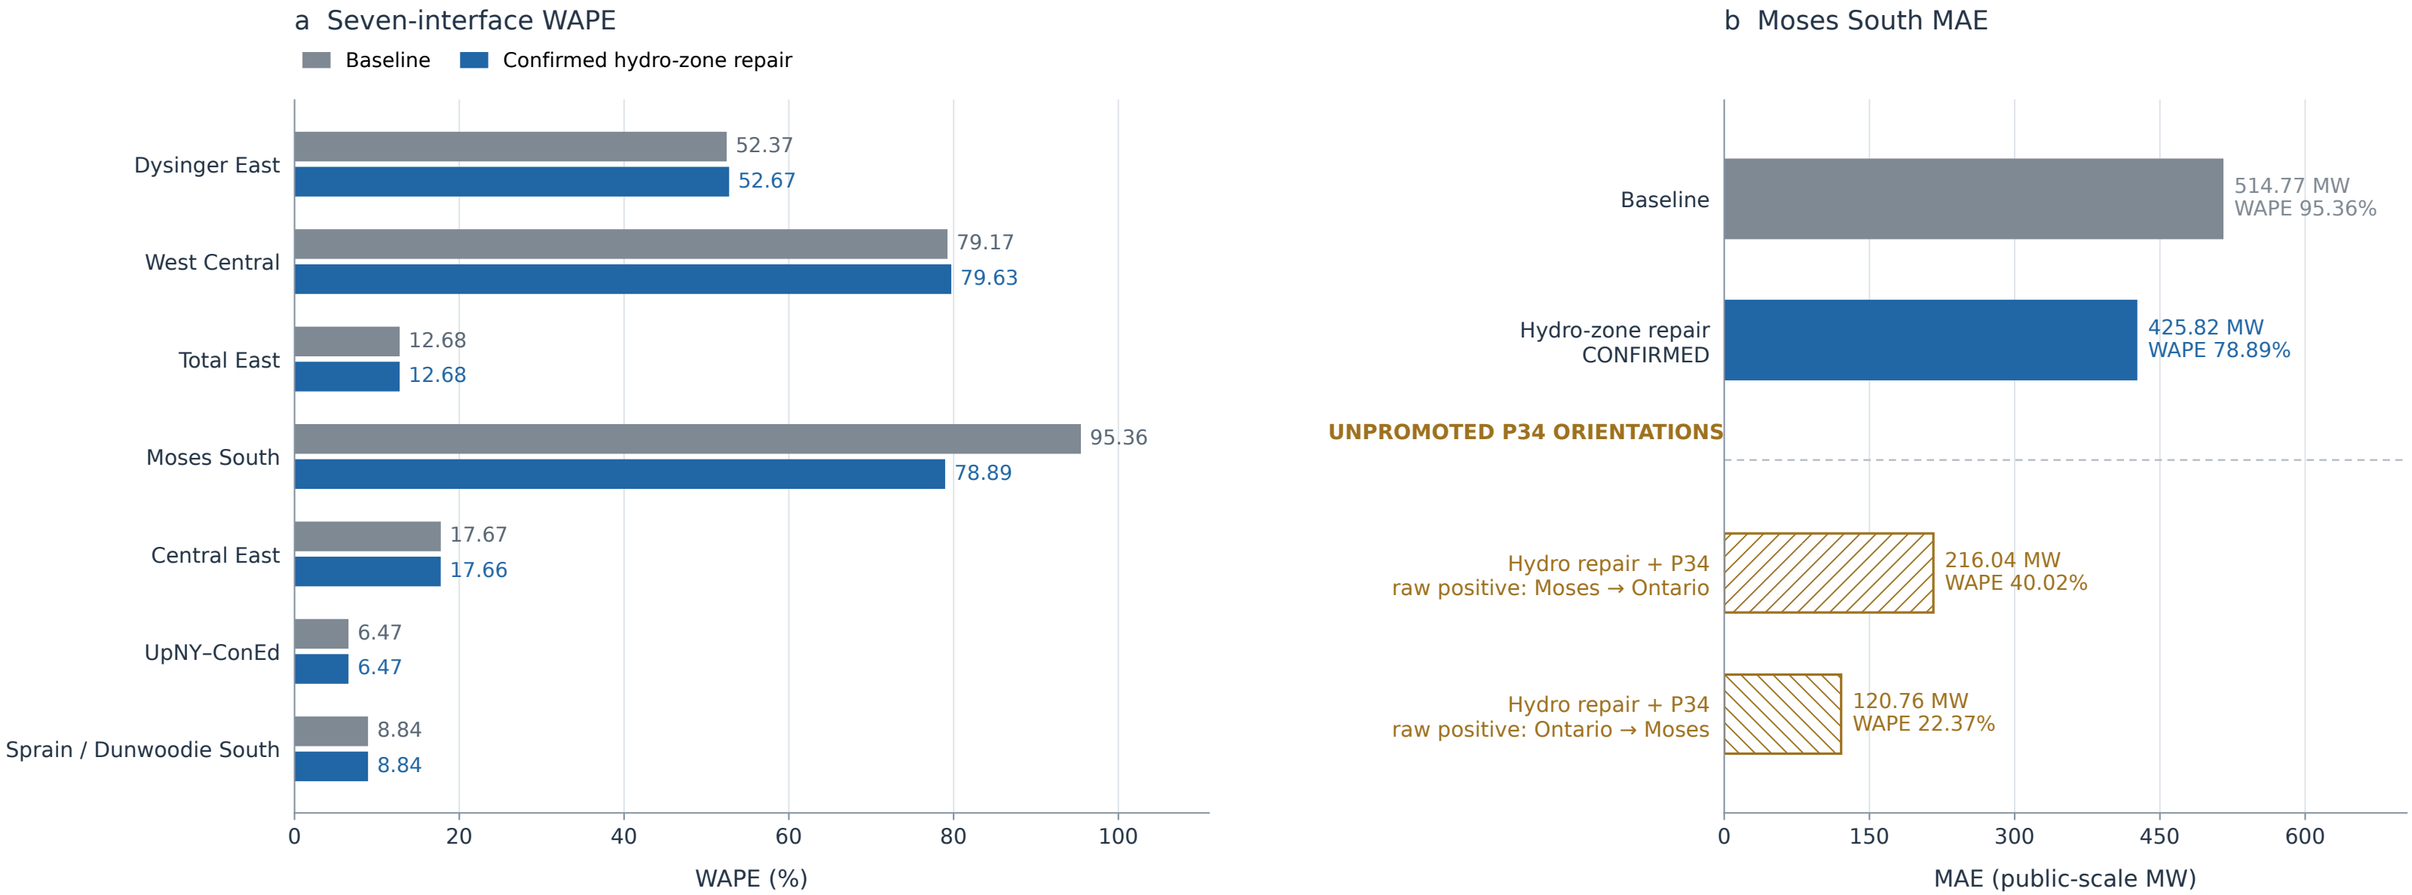

WAPE = 100 × Σ|modeled − observed| / Σ|observed|. MAE = mean |modeled − observed|. Model MW are divided by the fixed γ for public-scale comparison.

The hydro-zone assignment repair is source-confirmed. P34 direction remains unresolved; neither diagnostic orientation is selected or promoted.

Derived DC phase controls are not qualified physical PAR tap settings. The two hatched bars are alternative scenarios, not uncertainty bounds.

Source: comparison/interface_summary.csv · annual rows, common_PAR_qualified cohort · full-precision inputs and SHA-256 provenance accompany this figure.