2025 interface comparison after the Moses generation and boundary repair

Same 8,651 paired hours; unchanged source mask, public observations, gamma and primary terminal convention.

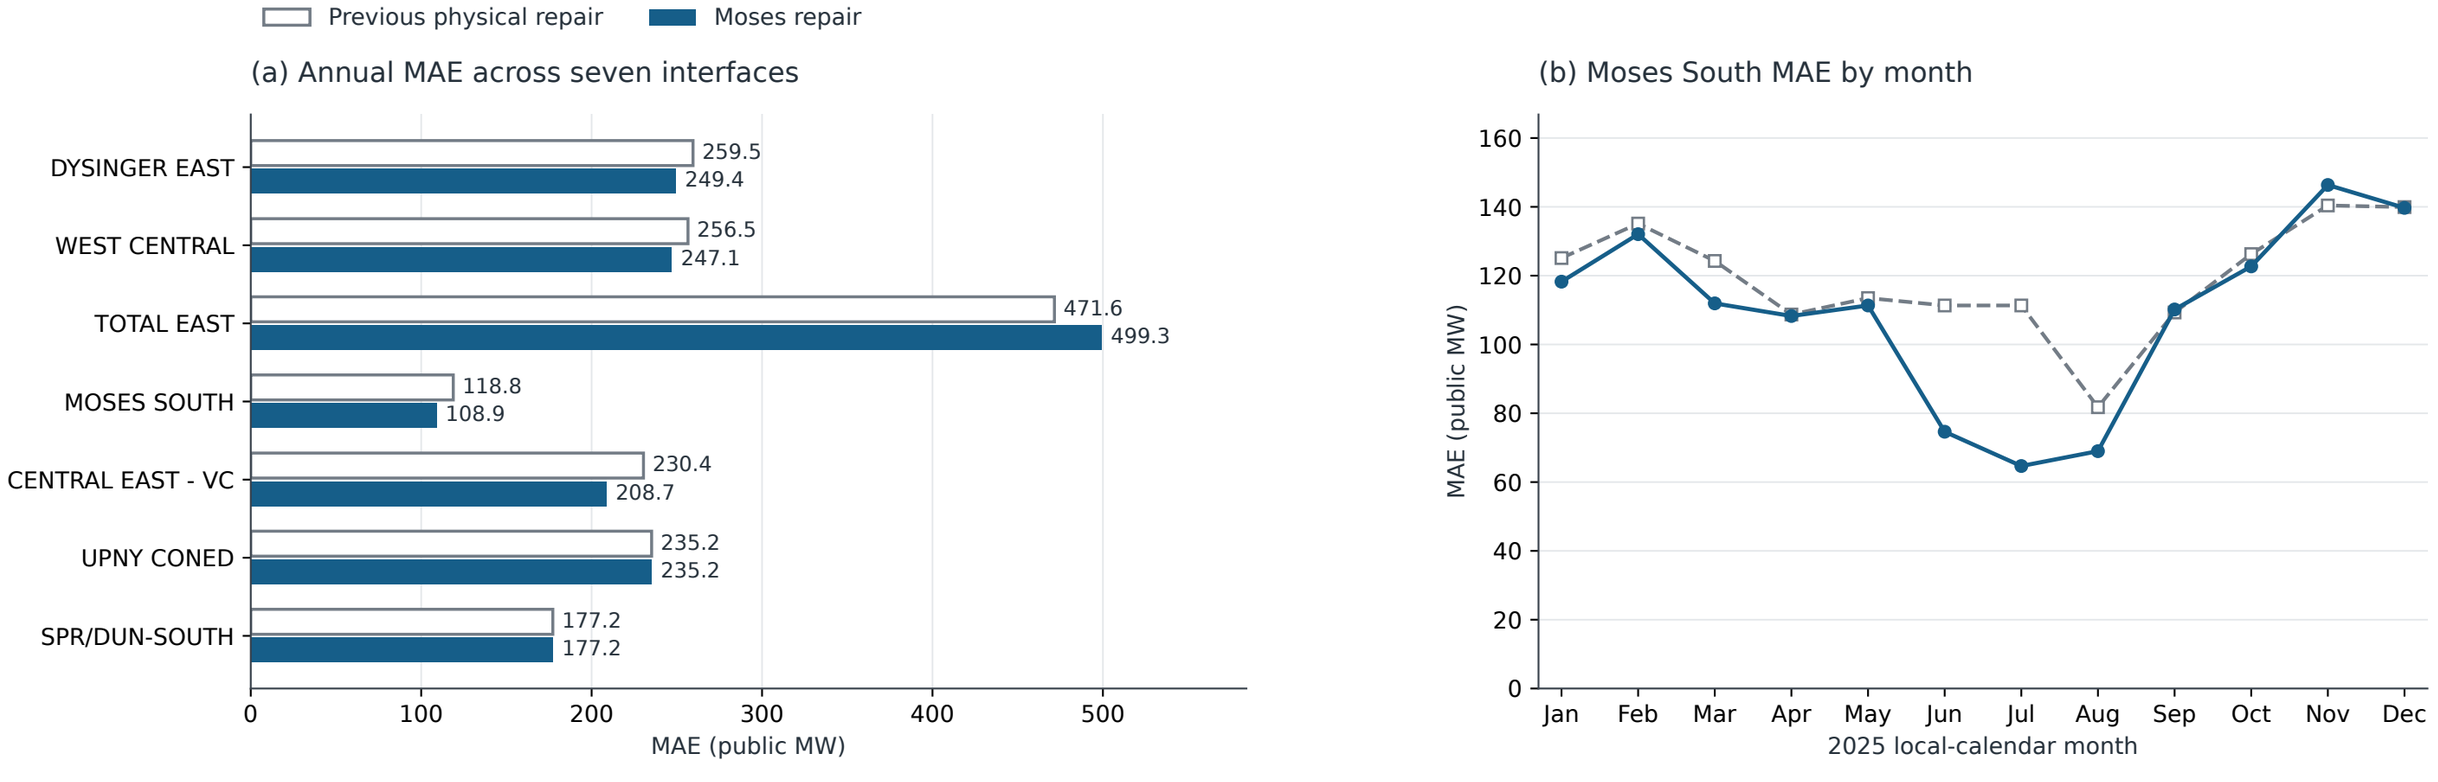

Moses South annual MAE: 118.821 → 108.945 MW. Total East: 471.551 → 499.304 MW.

Equation-qualified predictions; 0 hours pass every operating limit. Physical P32 meter equivalence remains unverified.