



Calibration des Probabilités — MLP (Test Set)

64 biomarqueurs | 159 échantillons test | ECE = 0.0036

a

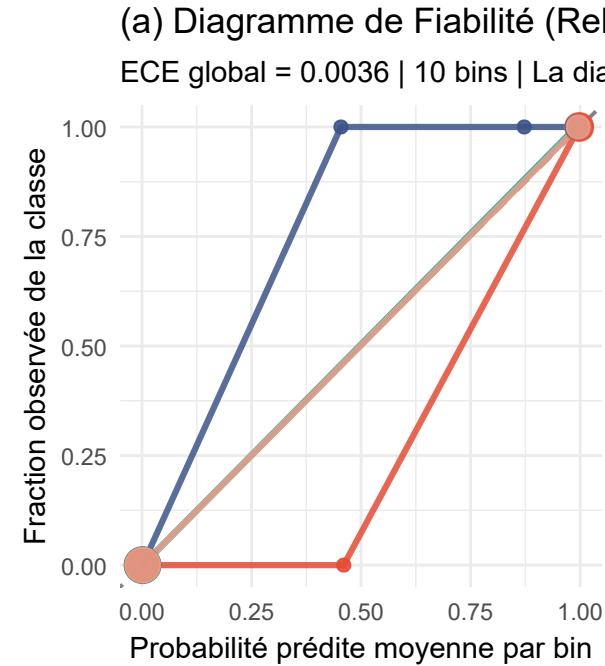

b

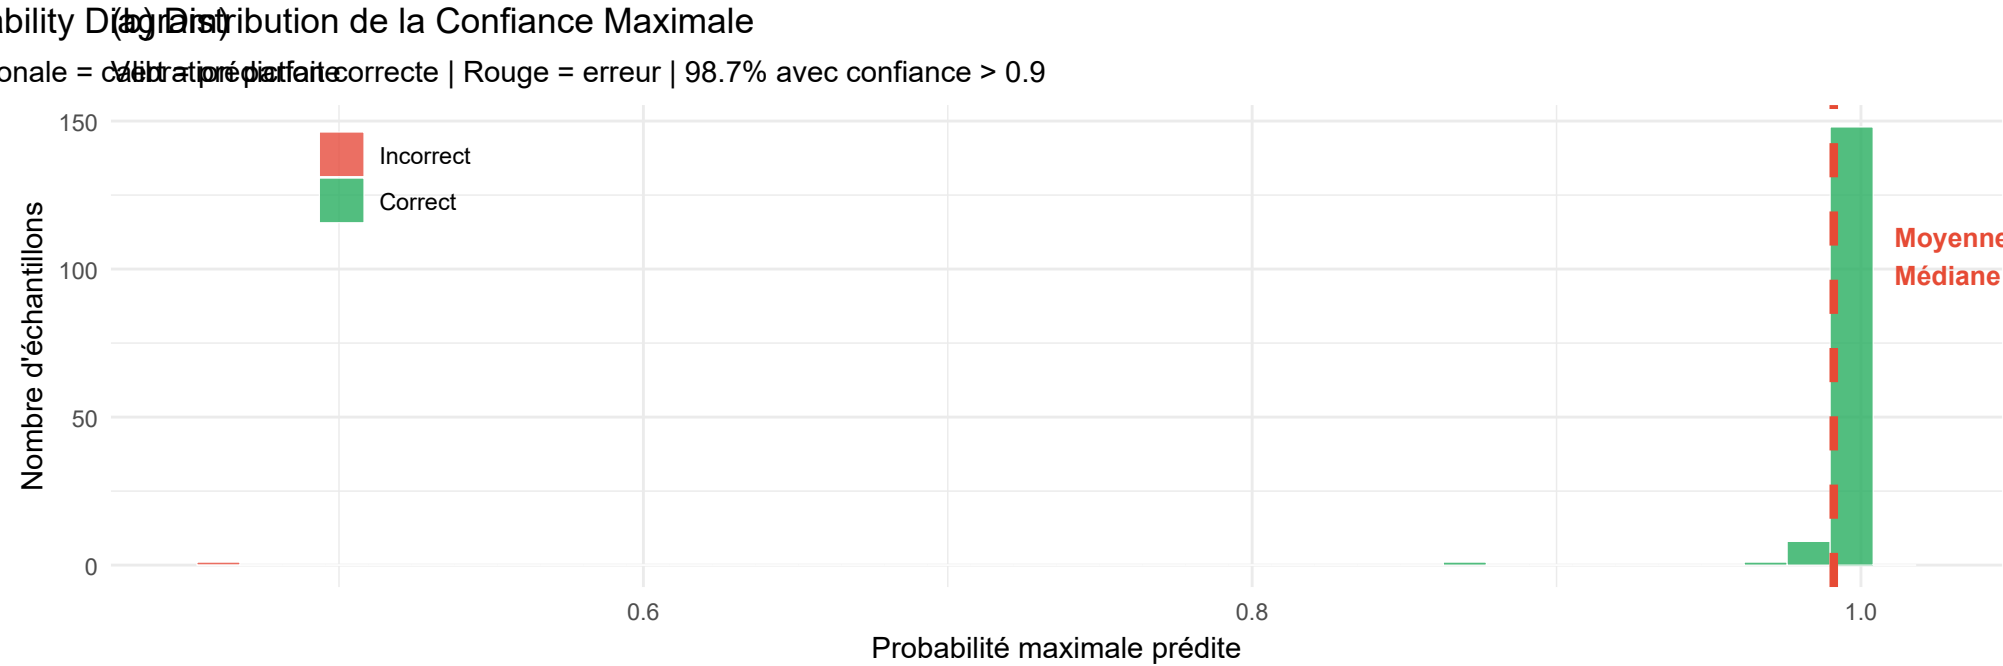

N échantillons ● 50 ● 100

E=0.005) COAD (ECE=0.002) KIRC (ECE=0.002) LUAD (ECE=0.006) PRAD (ECE=0.002)