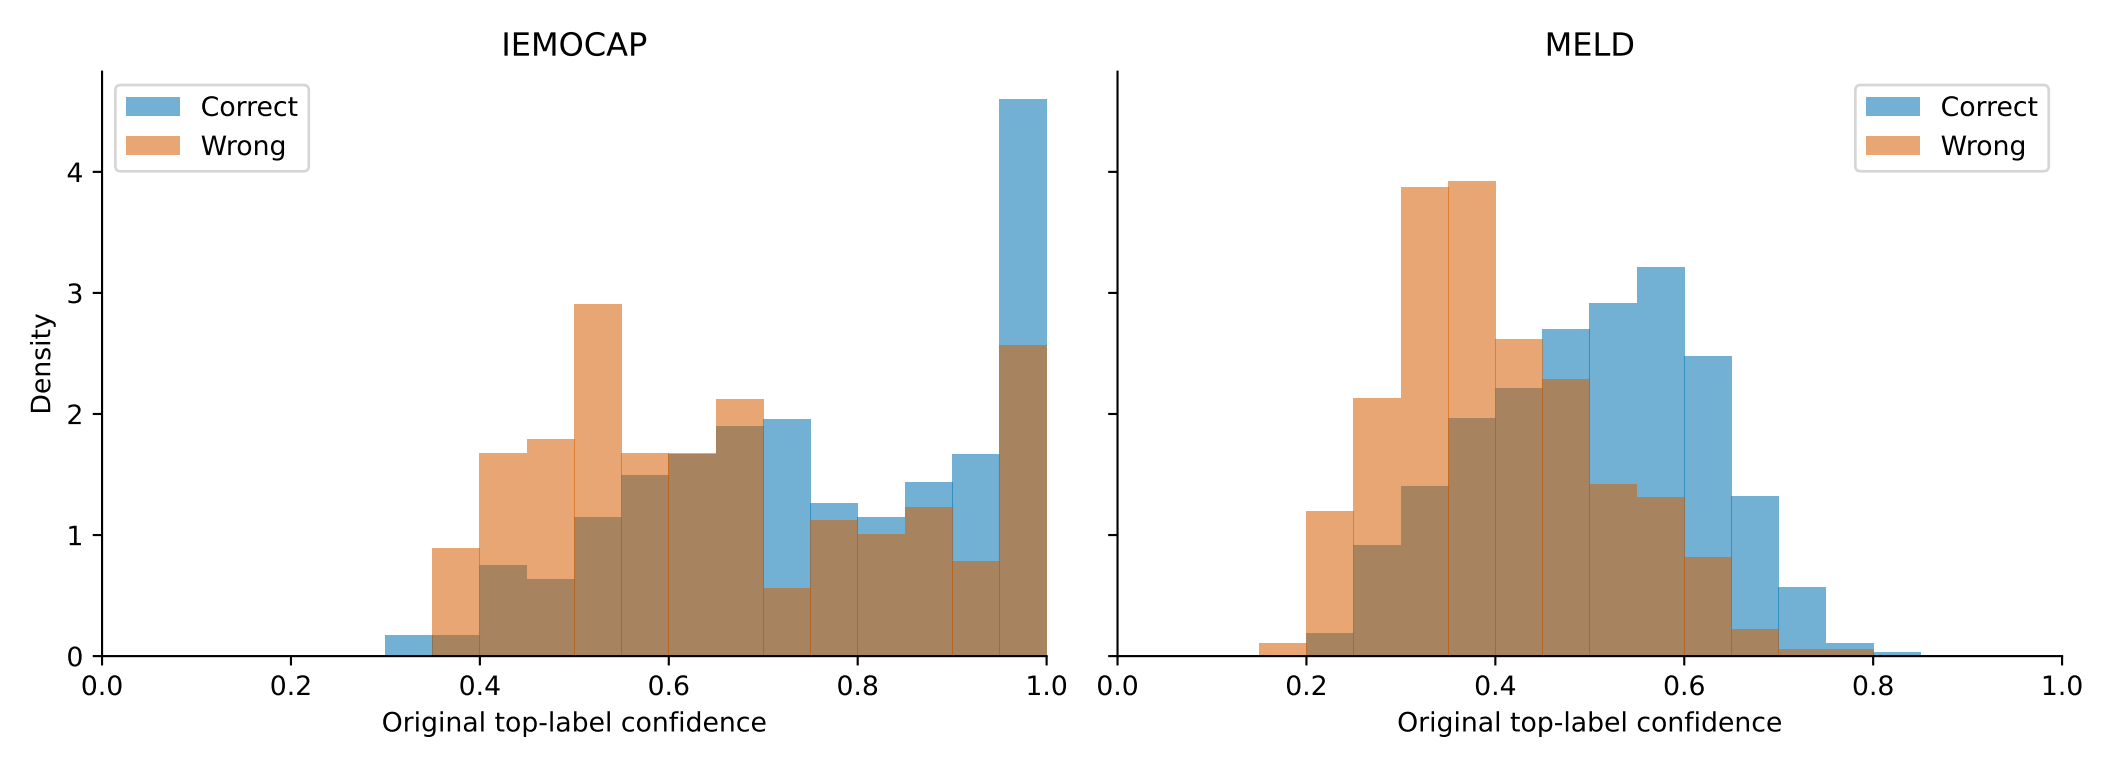
IEMOCAP
MELD
Correct
Wrong
Density
0
1
2
3
4
0.0
0.2
0.4
0.6
0.8
1.0
Original top-label confidence