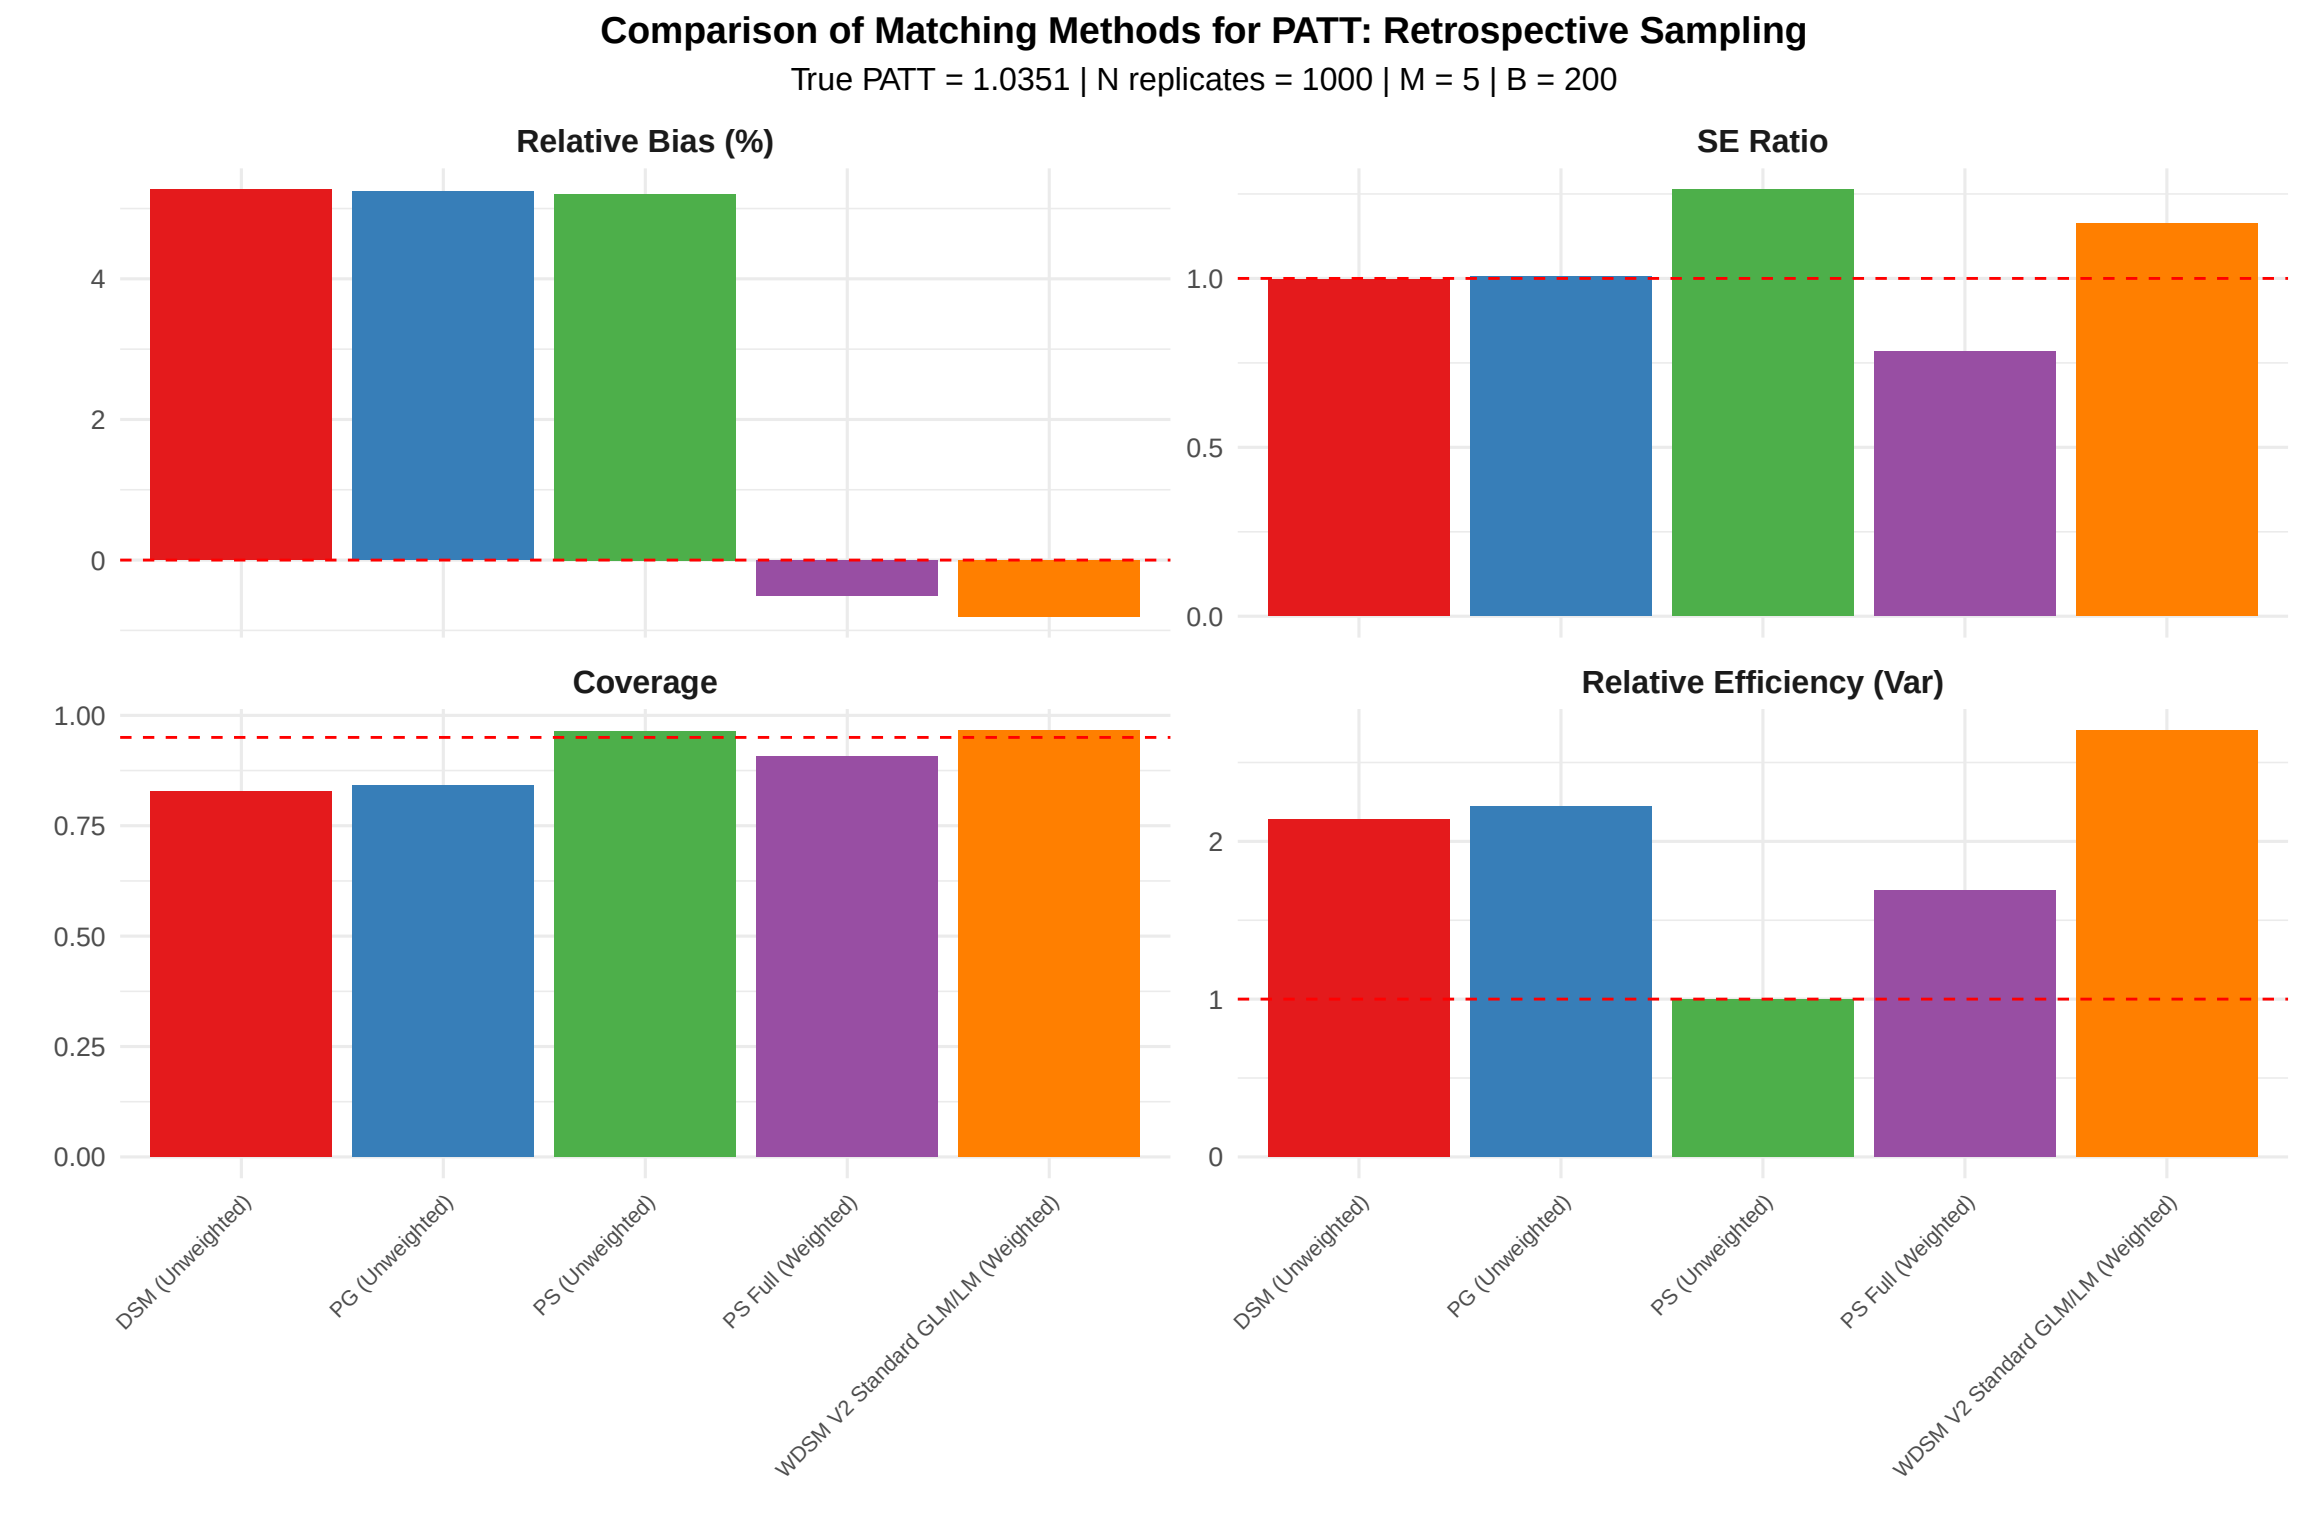
Comparison of Matching Methods for PATT: Retrospective Sampling
True PATT = 1.0351 | N replicates = 1000 | M = 5 | B = 200
Relative Bias (%)
4
2
0
SE Ratio
1.0
0.5
0.0
Coverage
1.00
0.75
0.50
0.25
0.00
Relative Efficiency (Var)
2
1
0
DSM (Unweighted)
PG (Unweighted)
PS (Unweighted)
PS Full (Weighted)
WDSM V2 Standard GLM/LM (Weighted)