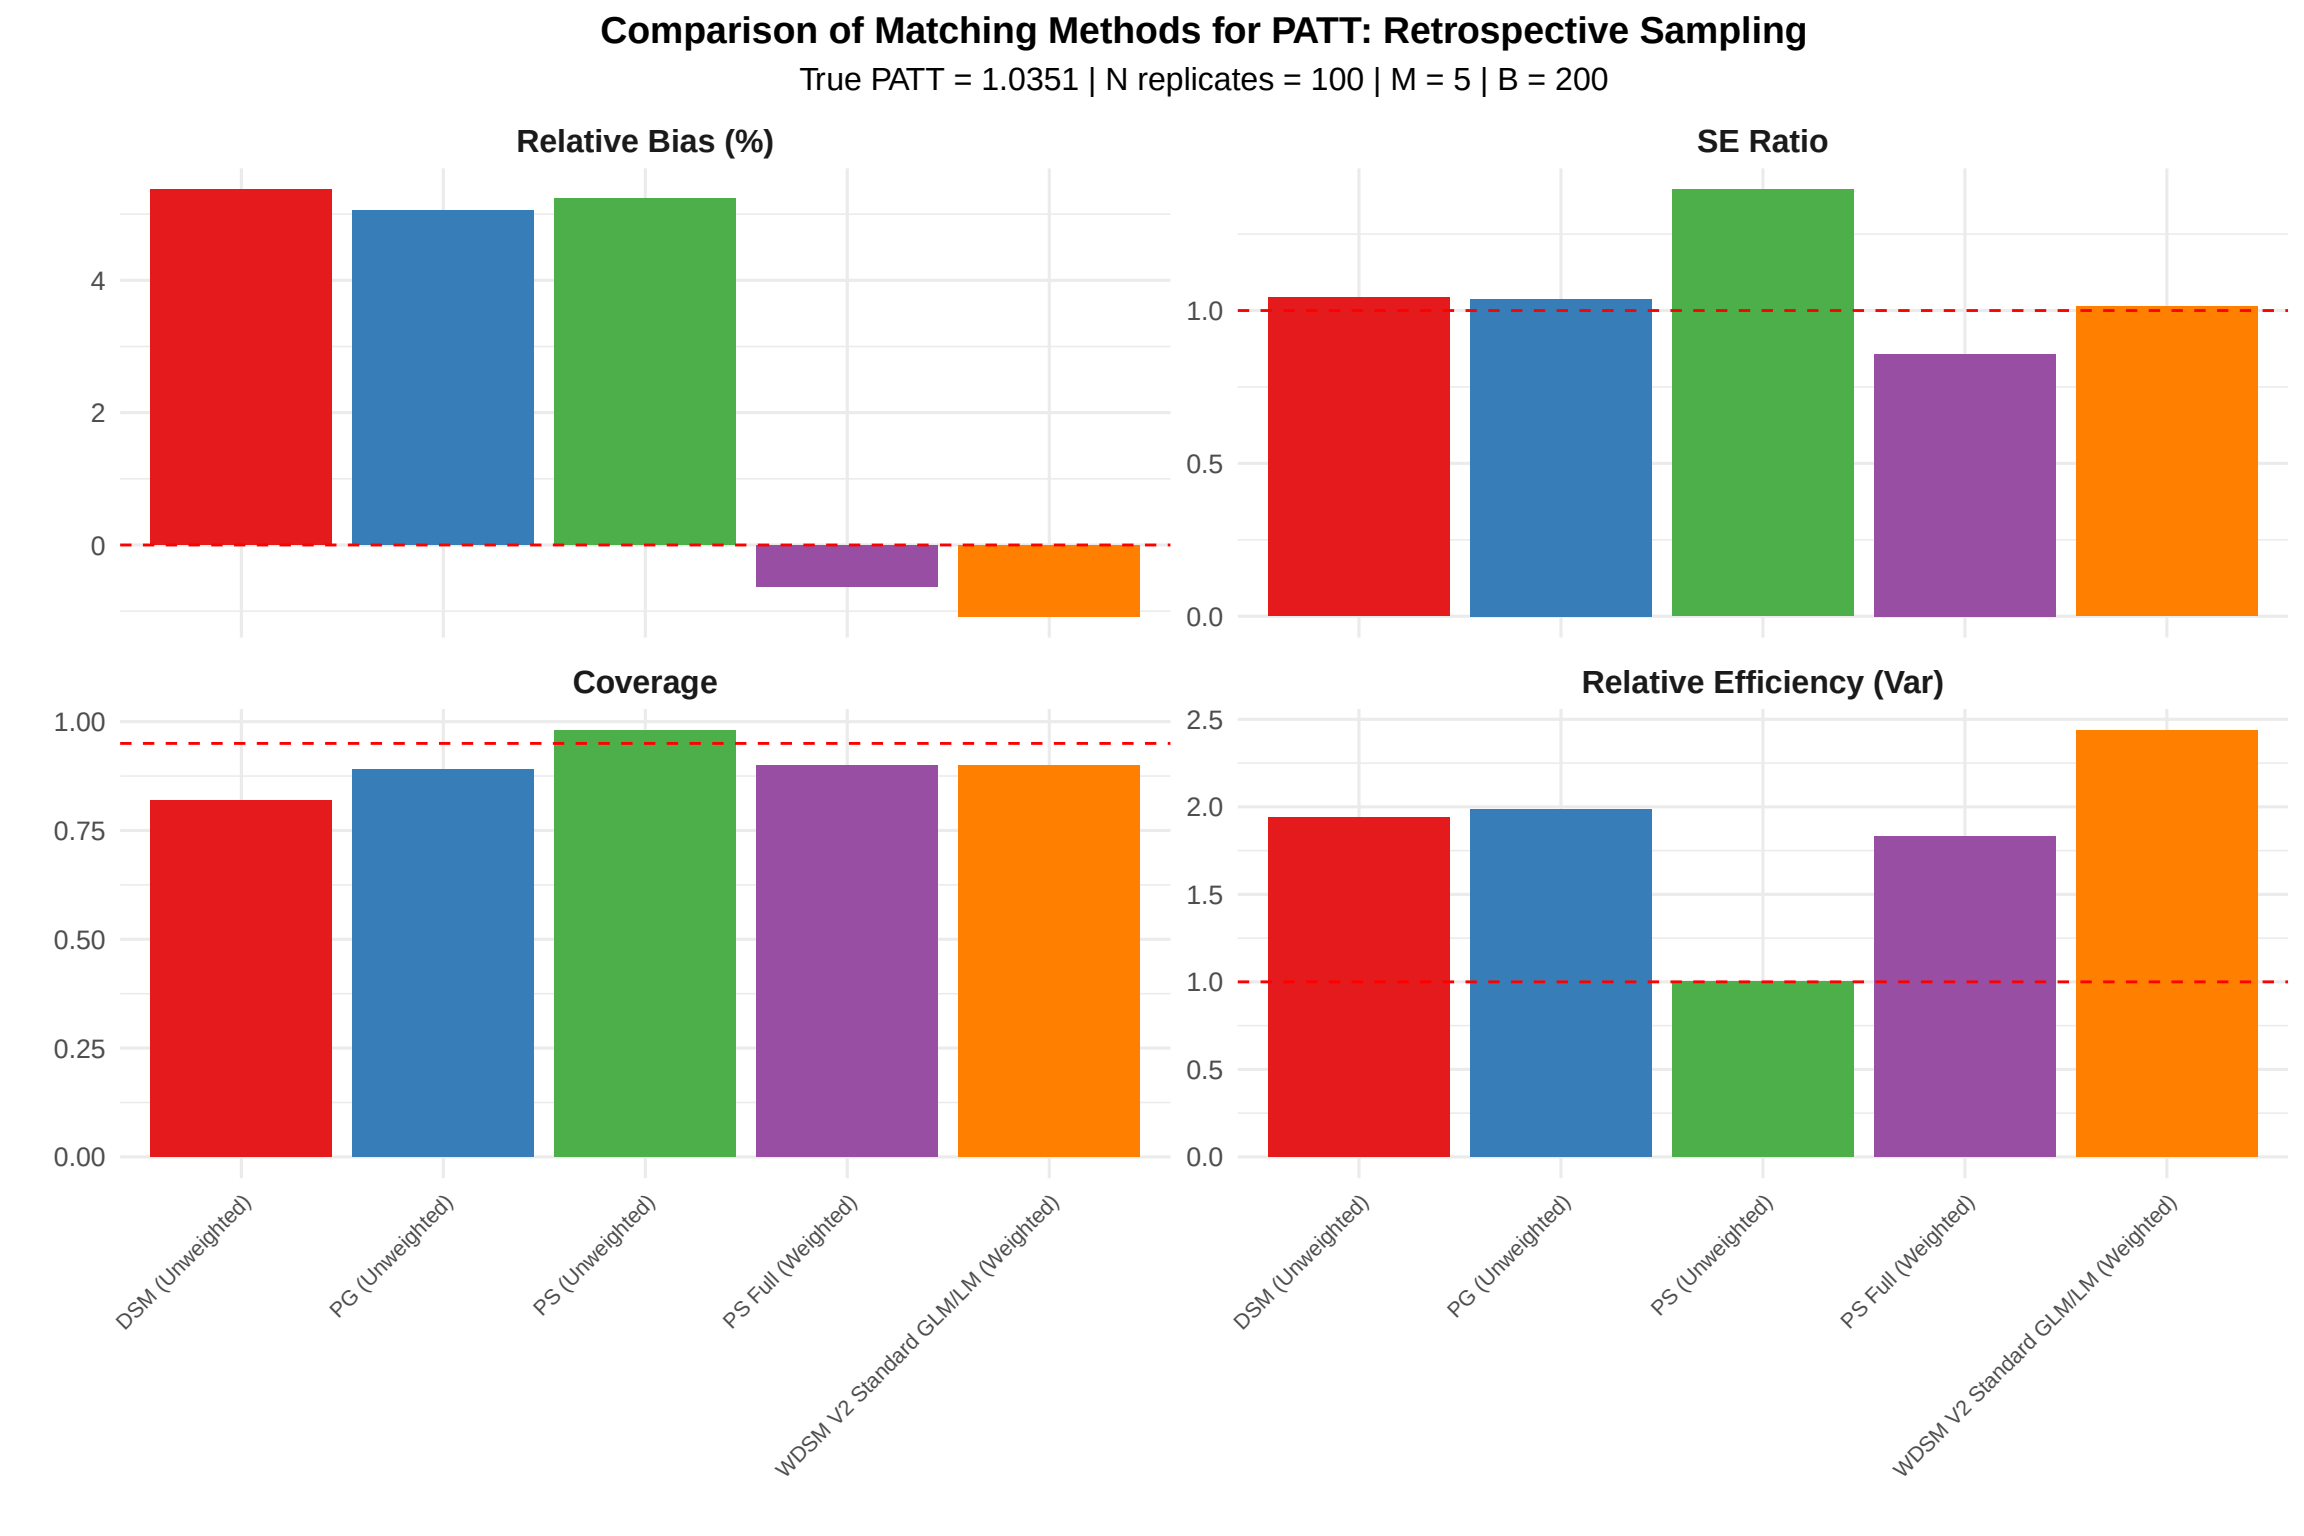
Comparison of Matching Methods for PATT: Retrospective Sampling
True PATT = 1.0351 | N replicates = 100 | M = 5 | B = 200
Relative Bias (%)
4
2
0
SE Ratio
1.0
0.5
0.0
Coverage
1.00
0.75
0.50
0.25
0.00
Relative Efficiency (Var)
2.5
2.0
1.5
1.0
0.5
0.0
DSM (Unweighted)
PG (Unweighted)
PS (Unweighted)
PS Full (Weighted)
WDSM V2 Standard GLM/LM (Weighted)