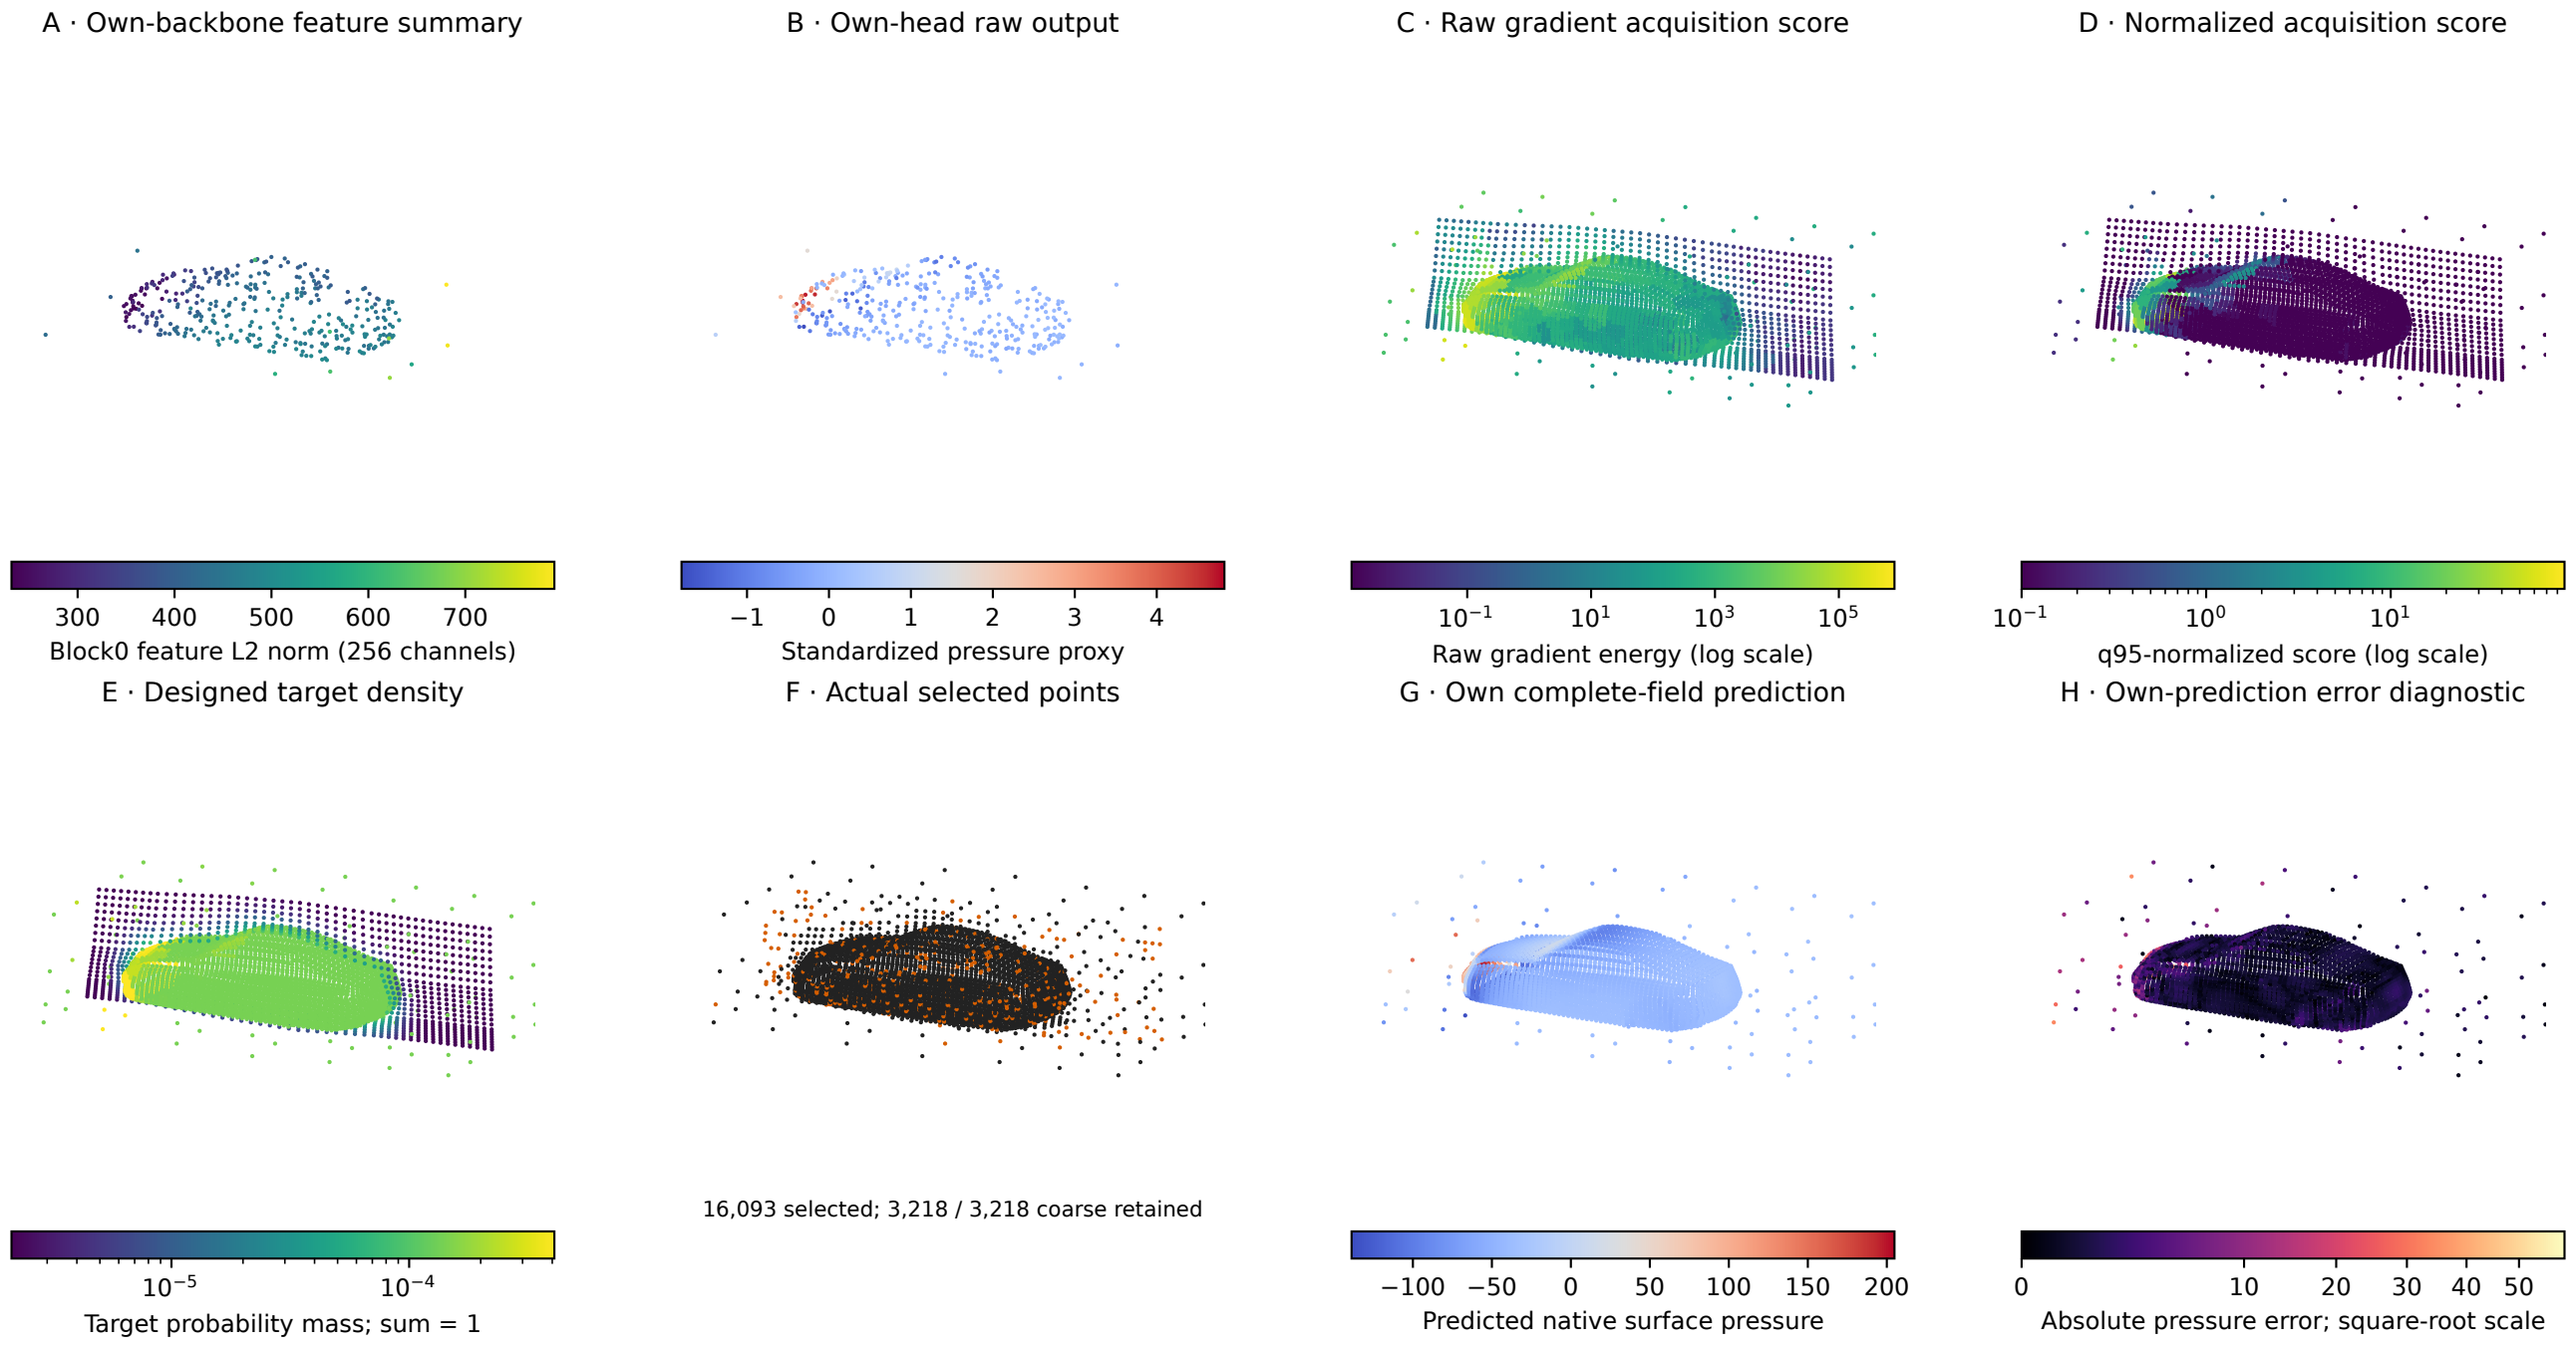

A · Own-backbone feature summary
B · Own-head raw output
C · Raw gradient acquisition score
D · Normalized acquisition score
300 400 500 600 700
Block0 feature L2 norm (256 channels)
−1 0 1 2 3 4
Standardized pressure proxy
10^{-1} 10^{1} 10^{3} 10^{5}
Raw gradient energy (log scale)
10^{-1} 10^{0} 10^{1}
q95-normalized score (log scale)
E · Designed target density
F · Actual selected points
G · Own complete-field prediction
H · Own-prediction error diagnostic
16,093 selected; 3,218 / 3,218 coarse retained
10^{-5} 10^{-4}
Target probability mass; sum = 1
−100 −50 0 50 100 150 200
Predicted native surface pressure
0 10 20 30 40 50
Absolute pressure error; square-root scale