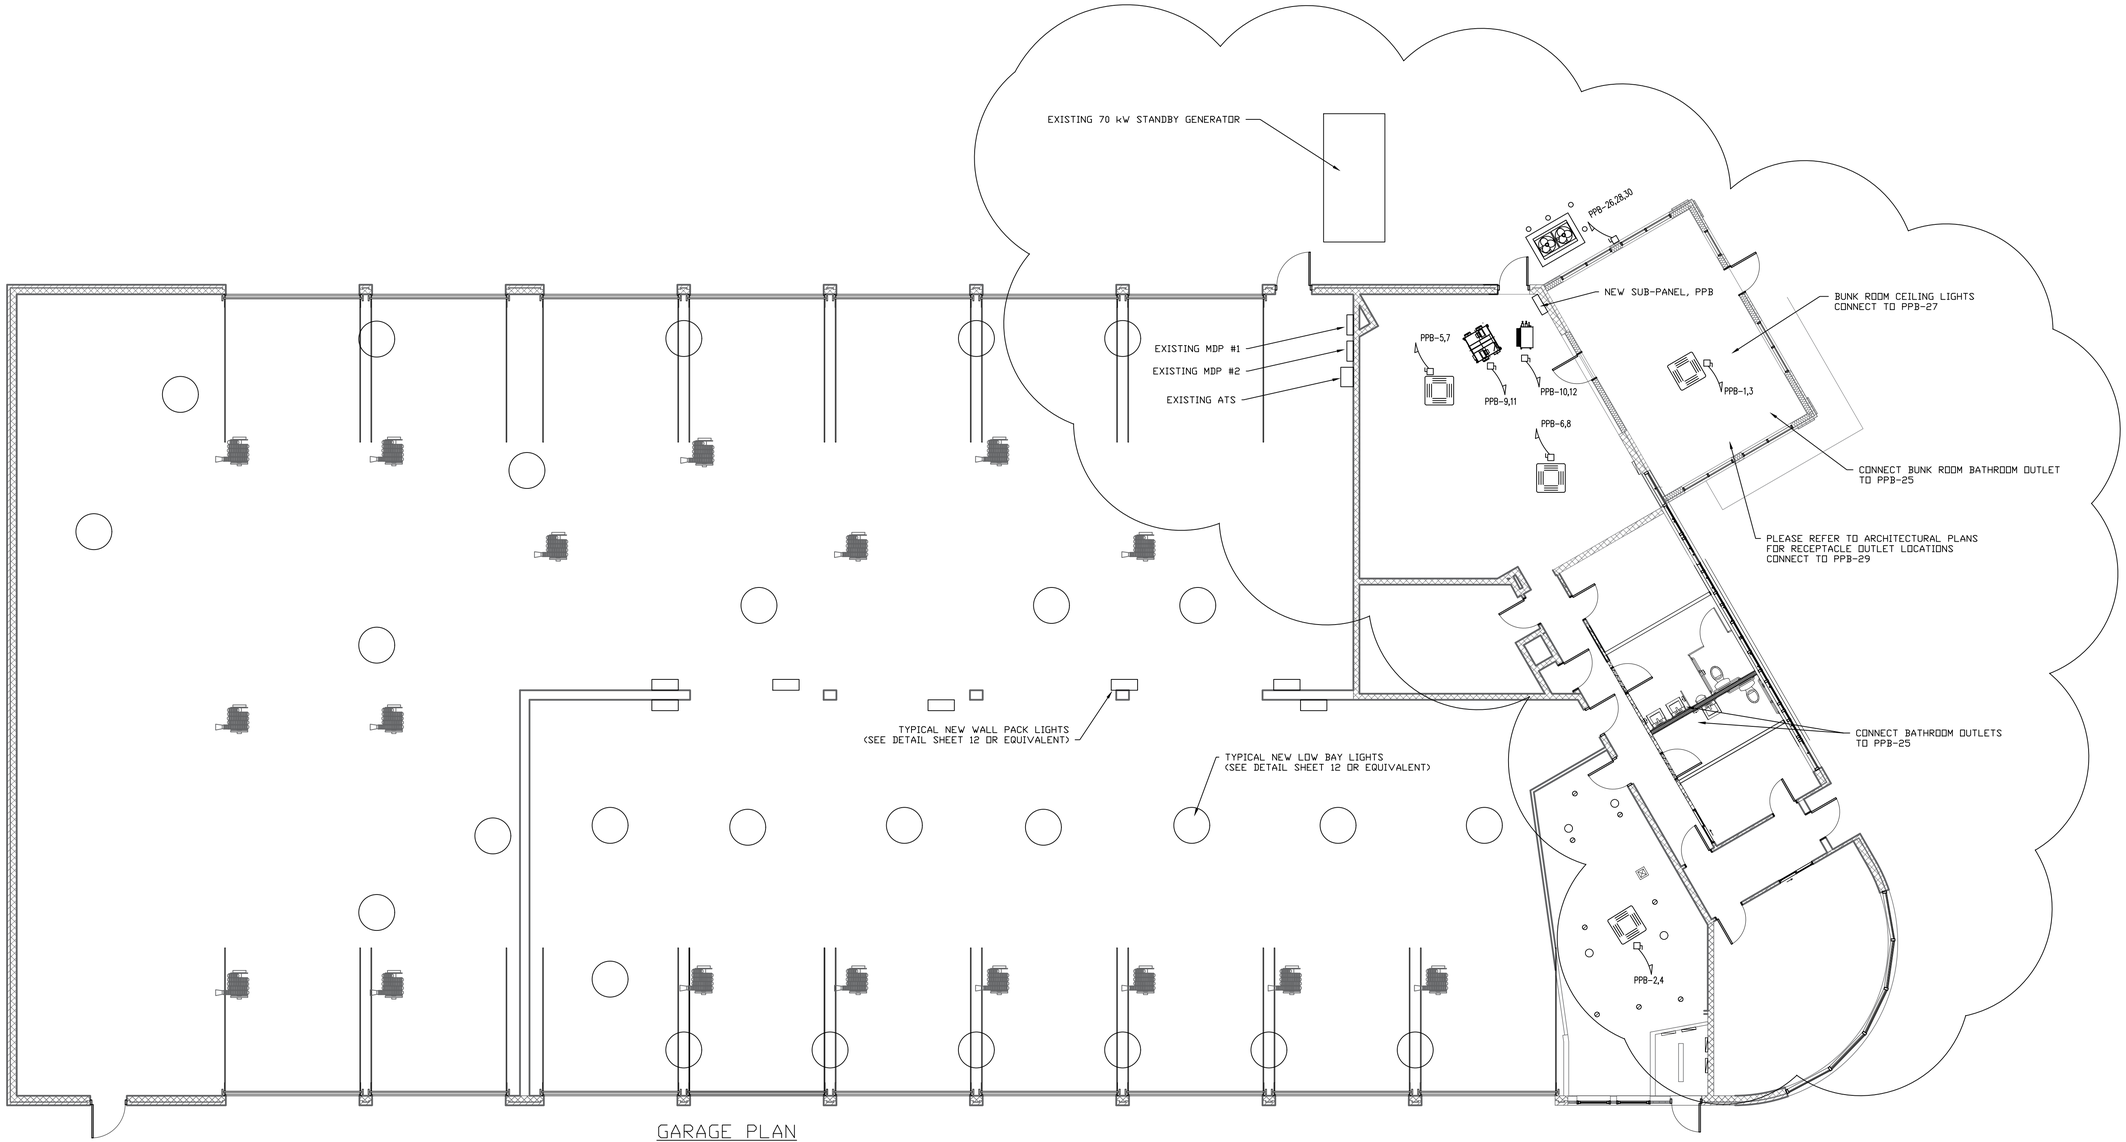

GARAGE PLAN

NOTES:
1. CONNECT NEW SUB-PANEL, PPB TO EXISTING MDP #2 WITH 150A BREAKER. USE SLOTS 3,5,7
2. USE (4) #4 WITH #6 GND FROM 80A BREAKER IN PPB TO OUTSIDE CONDENSER
3. USE (2) #10 WITH #10 GND FOR ALL OTHER CIRCUITS

WARNING - IT IS A VIOLATION OF STATE EDUCATION LAW FOR ANY REASON, UNLESS HE IS ACTING UNDER THE DIRECTION OF LICENSED PROFESSIONAL ENGINEER, TO ALTER ANY ITEM IN ANY WAY ON THESE PLANS.

REVISIONS

NO.	ISSUED FOR	DATE
1	FOR CONCEPTUAL REVIEW	06/27/2022
2	FOR BIDDING	04/15/2024

DESCRIPTION:
INSTALL NEW HVAC EQUIPMENT IN CONJUNCTION WITH NEW ADDITION AND REMODEL OF SUPERINTENDENT'S OFFICE. REPLACE NEW LIGHTING IN EXISTING GARAGE SPACE.
NO CHANGE IN MEANS OF EGRESS, USE GROUP, OR OCCUPANCY.

PROJECT LOCATION:
YORKTOWN HIGHWAY GARAGE
281 UNDERHILL AVE
YORKTOWN HEIGHTS, NY 10598

OWNER:
TOWN OF YORKTOWN
363 UNDERHILL AVE
YORKTOWN HEIGHTS, NY 10598

REVANS DESIGN, PE PC
60 SOMERSTON RD
YORKTOWN, NY 10598
914-222-0397

STATE OF NEW YORK • PAUL REVANS • 091827 • LICENSED PROFESSIONAL ENGINEER

DATE :	06-12-2024
PROJECT REF#	RD 21032HVAC
DRAWN BY:	P.R.
CHECKED BY:	PR

E - 001.01

ELECT PLAN

SHEET 7 OF 12

APPROVAL STAMPS