


How the 150 kW load splits across the ASHRAE 90.1 economizer envelope

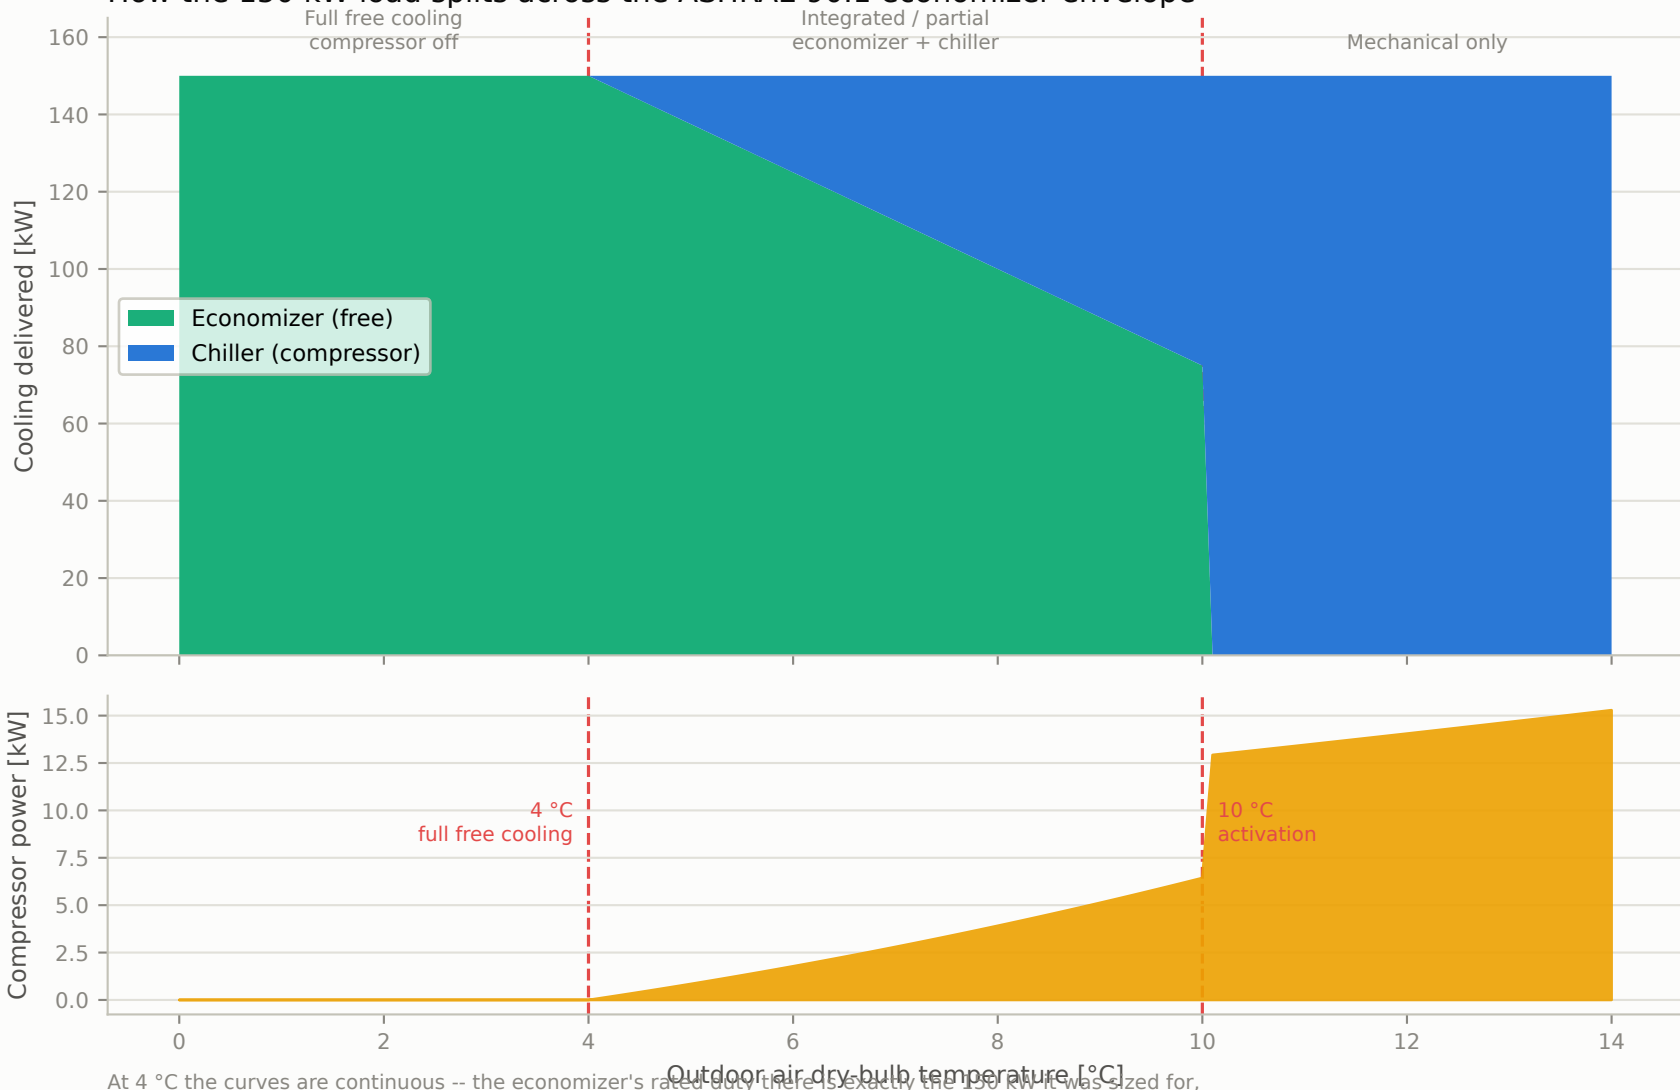

At 4 °C the curves are continuous -- the economizer's rated duty there is exactly the 150 kW it was sized for, so the partial band joins full free cooling with no step. At 10 °C there IS a step: the economizer is still delivering 75 kW (half the load) when the fixed 90.1 changeover switches it off, so compressor power jumps 6.4 -> 13.0 kW. That step is left money on the table, not physics -- see the floating-changeover item in Suggestions for Improvement.