


Design-day facility power: 42.7 kW against a 150 kW IT load $\Rightarrow$ PUE = 1.285

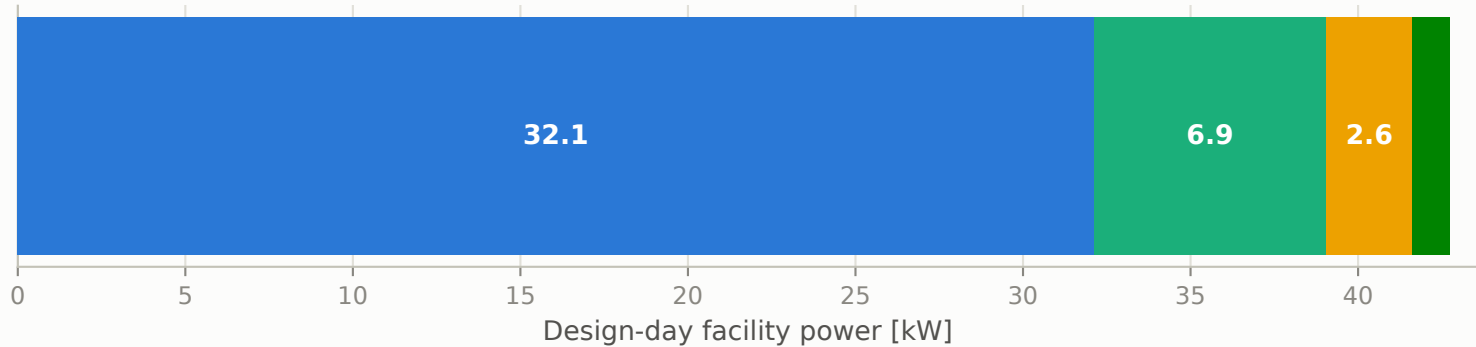

■ Compressor bank 32.12 kW (75%) ■ Dry cooler fans 6.93 kW (16%) ■ Glycol loop pump 2.57 kW (6%) ■ CHW/CRAH pump 1.11 kW (3%)