
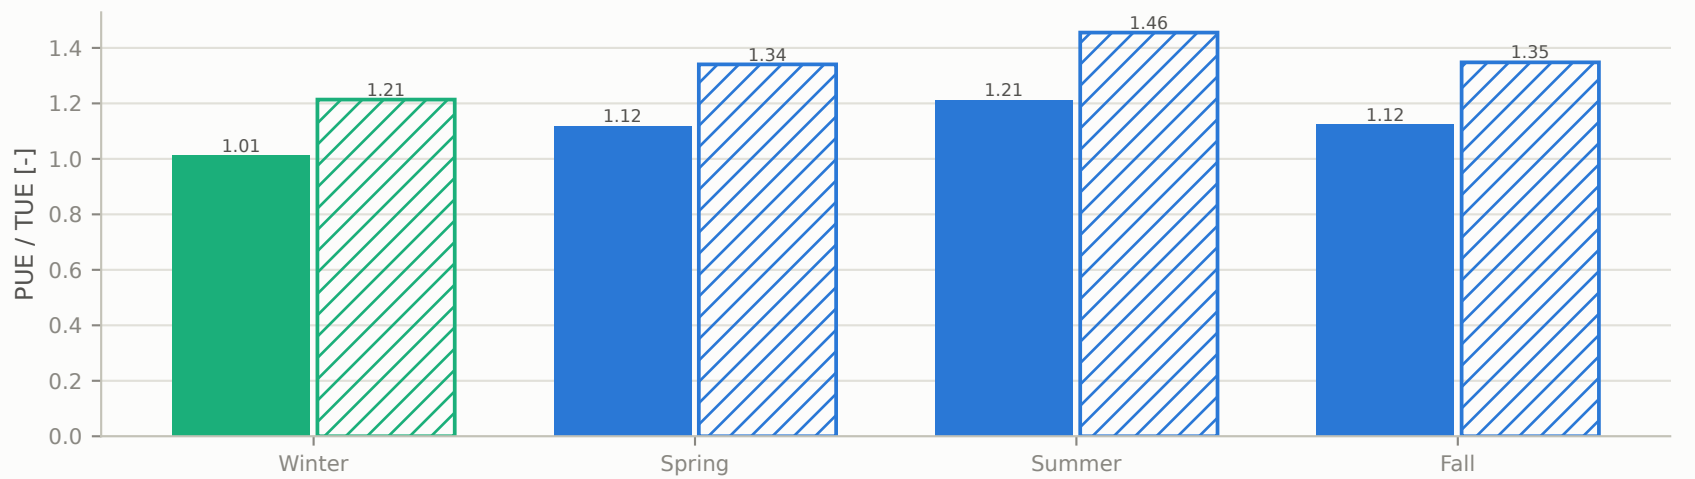


Seasonal-average total system COP, PUE and TUE (Champaign, IL TMY3)

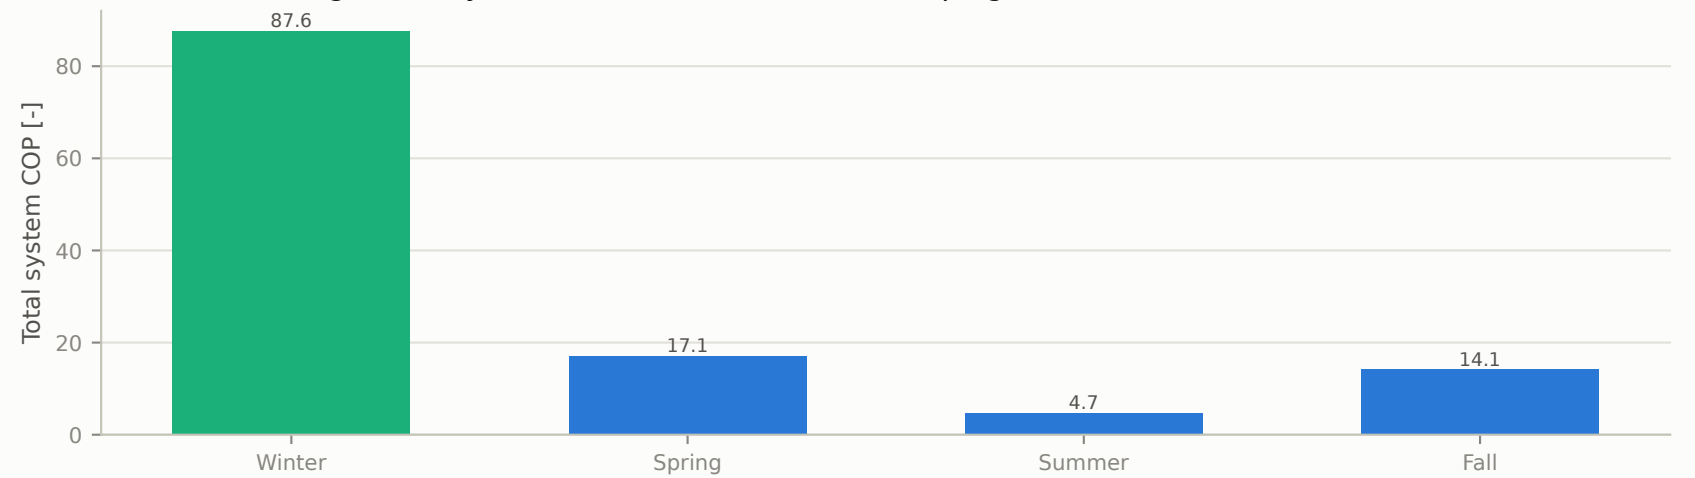

Aqua = full free cooling (compressor off)   Yellow = integrated/partial free cooling   Blue = mechanical   Solid = PUE   Hatched = TUE  
TUE = ITUE x PUE with ITUE = 1.20 ASSUMED (no server power model in this project); band 1.10-1.30.