



PROJECT Two-Vehicle Open Carport — 24'-0" × 25'-0"	LOCATION 18398 131st Trail N, Jupiter Farms, FL	CLIENT Raul	SCALE N.T.S.
--	---	----------------	-----------------


A-1 · FOUNDATION & ROOF FRAMING PLAN

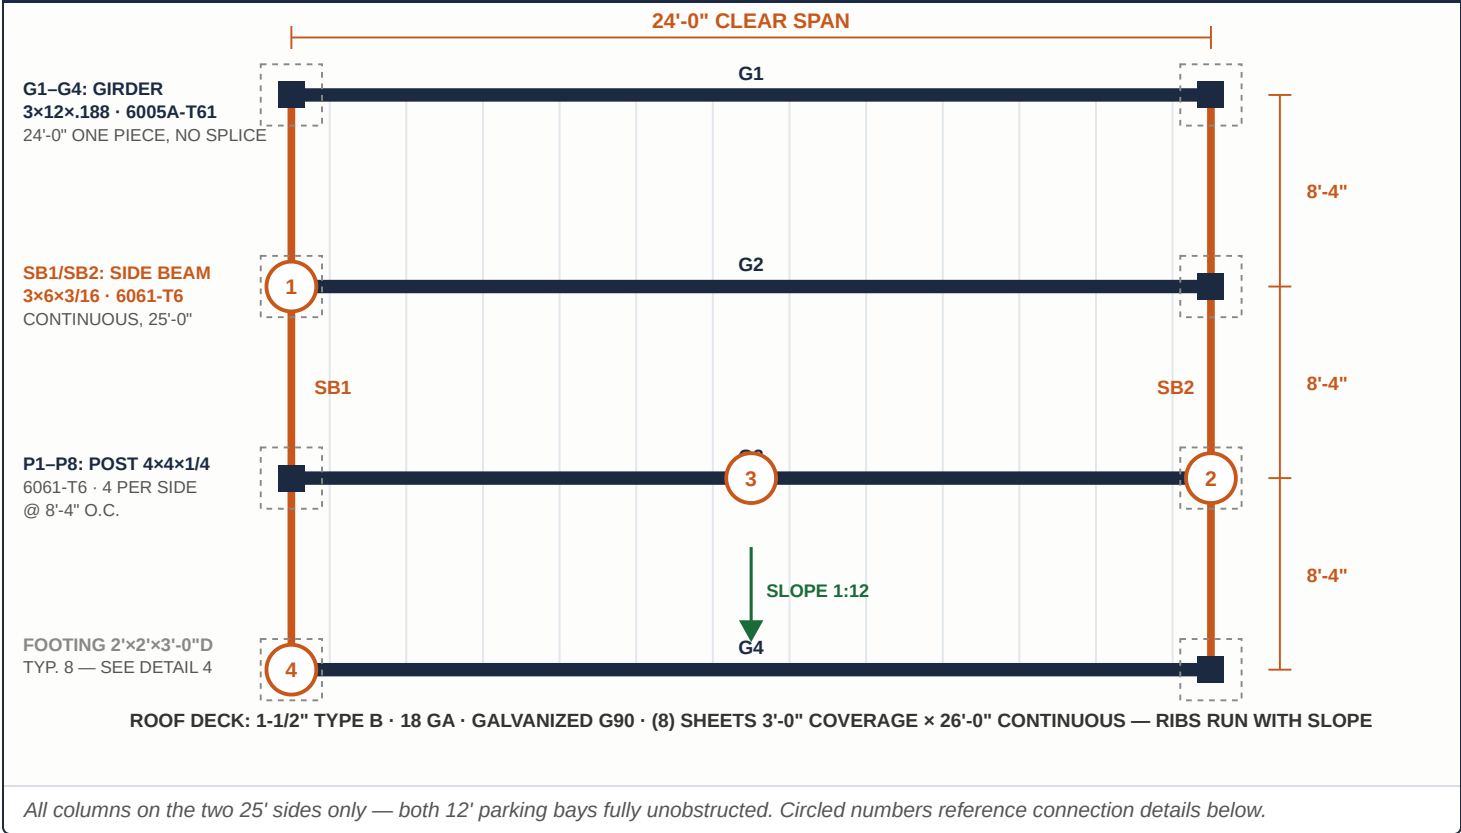

A-2 · SIDE ELEVATION

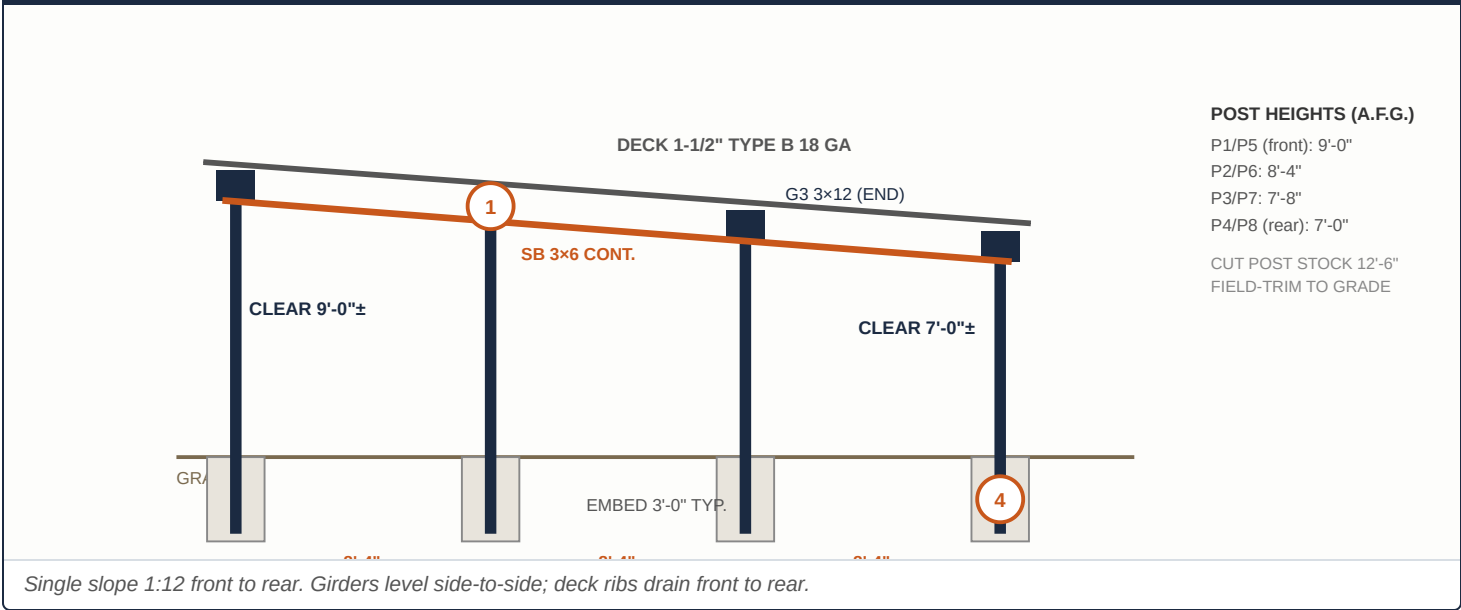


DETAIL 1 · GIRDER-TO-POST CONNECTION

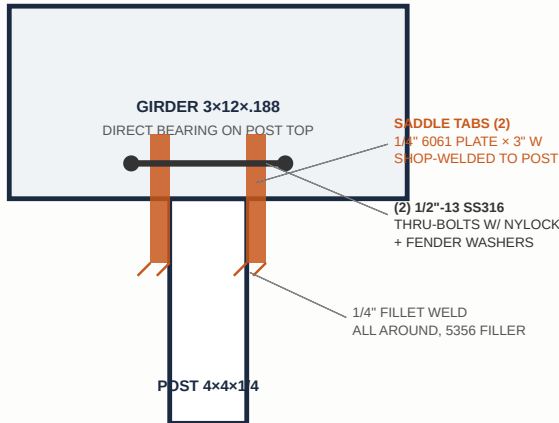

Girder bears on post top (gravity); saddle tabs + thru-bolts resist wind uplift. Typ. 8 locations.


DETAIL 2 · SIDE BEAM AT POST (PLAN SECTION)

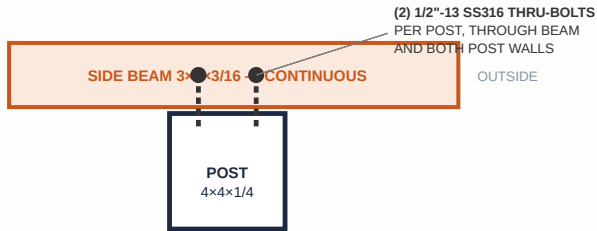

SIDE BEAM RUNS ON OUTSIDE FACE OF ALL 4 POSTS,
TOP FLUSH WITH GIRDER BEARING — TIES COLUMN LINE,
25'-0" ONE PIECE (SPLICE OVER POST PERMITTED,
INTERNAL SLEEVE 12" + (4) 3/8" SS BOLTS)

Typ. 8 locations (4 per side). All bolt holes drilled 1/16" oversize, deburred.


DETAIL 3 · DECK FASTENING (SECTION AT GIRDER)

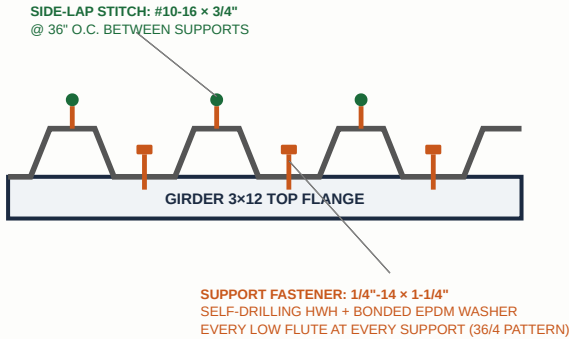

DECK: 1-1/2" TYPE B · 18 GA · G90 GALVANIZED · SHEETS CONTINUOUS OVER 3 SPANS

Perimeter zone: fastener in EVERY flute. Field: every flute at supports per HVHZ practice.

DETAIL 4 · FOOTING & COLUMN EMBEDMENT

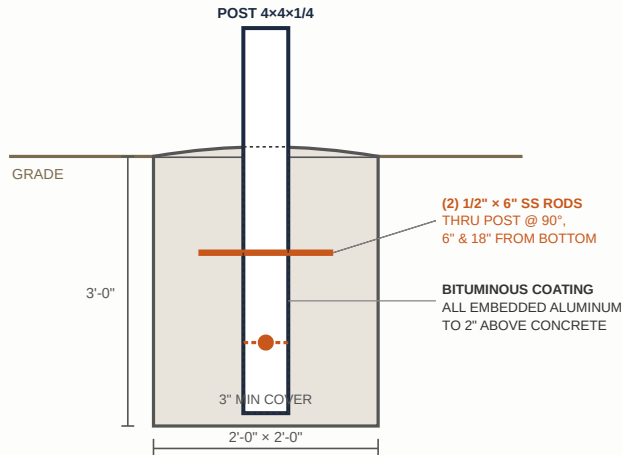

3,000 psi concrete, top crowned to shed water. Post set plumb & braced before pour. Typ. 8.

BILL OF MATERIALS — CARPORT A

Mark	Member	Section	Alloy	Length	Qty
P1–P8	Column	4" × 4" × 1/4" sq. tube	6061-T6	12'-6" (field-trim)	8
G1–G4	Roof girder (clear span)	3" × 12" × 0.188" rect. tube	6005A-T61	24'-0"	4
SB1–SB2	Side beam (continuous)	3" × 6" × 3/16" rect. tube	6061-T6	25'-0"	2
—	Saddle tabs (Detail 1)	1/4" plate, 3" × 6"	6061-T6	—	16
—	Roof deck	1-1/2" Type B, 18 ga, G90 galv.	Steel	26'-0" (3'-0" cov.)	8
—	Footing concrete, 3,000 psi	2'-0" × 2'-0" × 3'-0"	—	0.45 CY each	8

FASTENER SCHEDULE — CARPORT A

Location	Fastener	Qty / Spacing
----------	----------	---------------

Girder to post (Detail 1)	1/2"-13 × 5-1/2" SS316 hex bolt, nylock nut, fender washers	2 per post · 16 total
Side beam to post (Detail 2)	1/2"-13 SS316 thru-bolt, nylock nut, fender washers	2 per post · 16 total
Deck to girders (Detail 3)	1/4"-14 × 1-1/4" self-drilling HWH, bonded EPDM washer	Every low flute at every support
Deck side laps	#10-16 × 3/4" stitch screw	36" o.c. between supports
Footing anchors (Detail 4)	1/2" × 6" SS rod thru post, 2 per post @ 90°	16 rods total

GENERAL NOTES

- All aluminum welding with 5356 filler by certified aluminum welder; 1/4" fillet welds unless noted.
- All bolts, nuts, washers and anchor rods stainless steel Type 316. Bolt holes 1/16" oversize, deburred.
- Galvanized deck bearing directly on aluminum is a compatible (zinc) contact; all deck cut edges touched up with cold-galvanizing compound.
- Embedded aluminum protected with bituminous coating per FBC — no aluminum in direct contact with concrete or soil.
- Layout, post locations and final grades field-verified with owner before excavation. Deck sheet lengths confirmed against as-built frame before ordering.
- Structure designed as open (no walls). Do not enclose sides without review — wind loads change.