



PROJECT Tractor Shelter — 16'-0" x 20'-0"	LOCATION 18398 131st Trail N, Jupiter Farms, FL	CLIENT Raul	SCALE N.T.S.
---	---	-----------------------	------------------------

B-1 · FOUNDATION & ROOF FRAMING PLAN

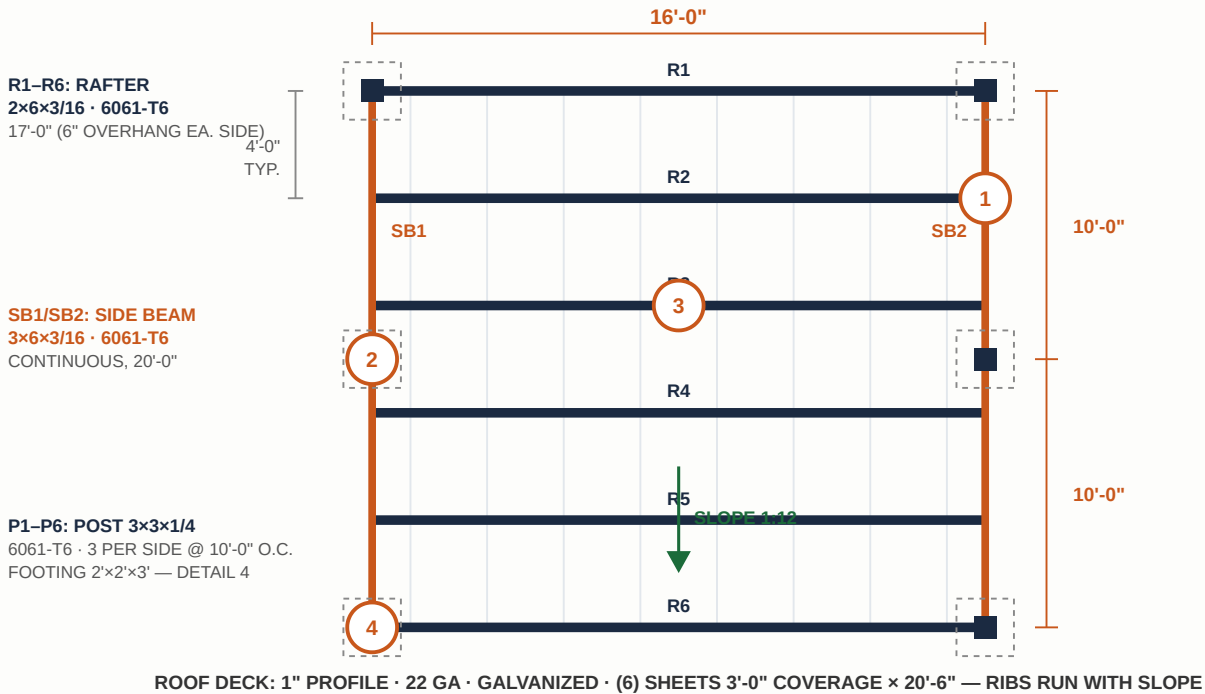


B-2 · SIDE ELEVATION

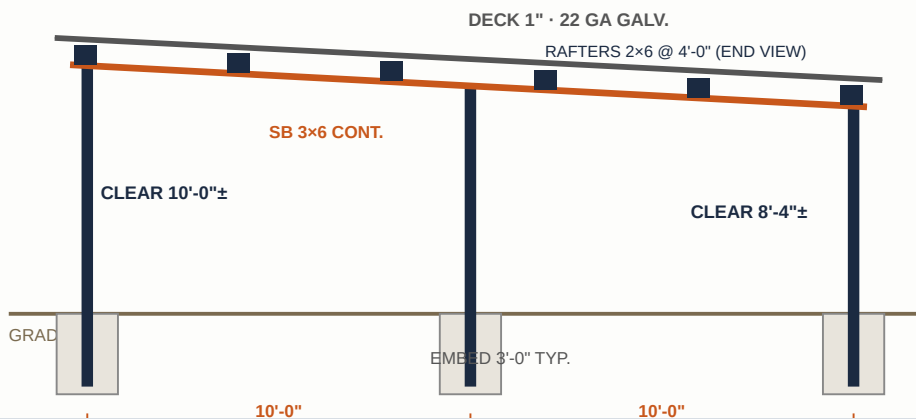

Single slope 1:12 front to rear. Post heights above grade: front 10'-0", middle 9'-2", rear 8'-4" (cut from 13'-6" stock, field-trim).


DETAIL 1 · RAFTER-TO-SIDE BEAM CONNECTION

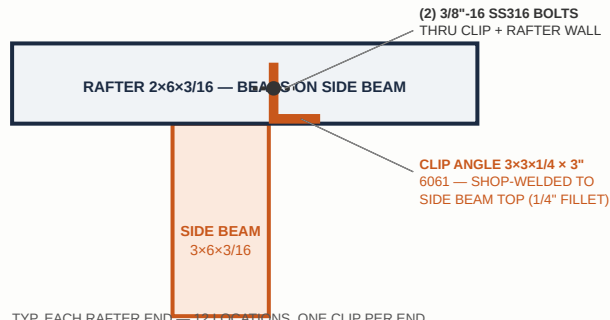

TYP. EACH RAFTER END — 12 LOCATIONS. ONE CLIP PER END, INSTALLED ON UPHILL FACE. RAFTER OVERHANG 6" BEYOND BEAM.

Gravity by direct bearing; clip + bolts resist wind uplift and alignment.


DETAIL 2 · SIDE BEAM AT POST (PLAN SECTION)

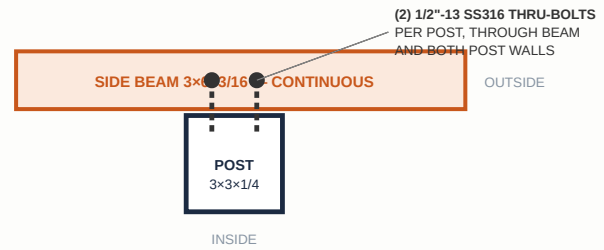

SIDE BEAM ON OUTSIDE FACE OF POSTS, TOP OF BEAM = TOP OF POST. 20'-0" ONE PIECE PER SIDE — NO SPLICES.

Typ. 6 locations. Bolt holes 1/16" oversize, deburred.


DETAIL 3 · DECK FASTENING (SECTION AT RAFTER)

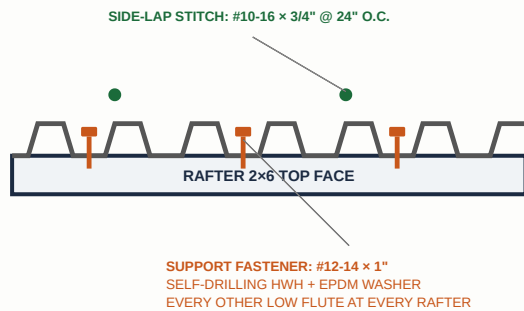

DECK: 1" PROFILE · 22 GA · GALVANIZED · 20'-6" FULL-LENGTH SHEETS (5 SPANS)

Perimeter/edge zone: every low flute. Cut edges cold-galv touch-up.

DETAIL 4 · FOOTING & COLUMN EMBEDMENT

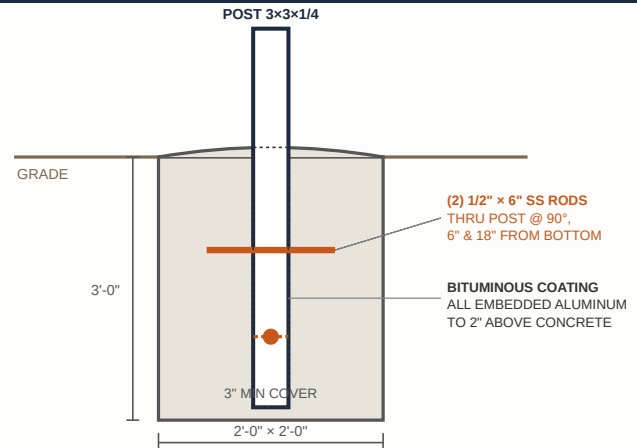

3,000 psi concrete, crowned top. Post set plumb & braced before pour.
Typ. 6.

BILL OF MATERIALS — CARPORT B

Mark	Member	Section	Alloy	Length	Qty
P1–P6	Column	3" × 3" × 1/4" sq. tube	6061-T6	13'-6" (field-trim)	6
R1–R6	Rafter	2" × 6" × 3/16" rect. tube	6061-T6	17'-0"	6
SB1–SB2	Side beam (continuous)	3" × 6" × 3/16" rect. tube	6061-T6	20'-0"	2
—	Clip angles (Detail 1)	3" × 3" × 1/4" angle × 3" long	6061-T6	—	12
—	Roof deck	1" profile, 22 ga, galvanized	Steel	20'-6" (3'-0" cov.)	6
—	Footing concrete, 3,000 psi	2'-0" × 2'-0" × 3'-0"	—	0.45 CY each	6

FASTENER SCHEDULE — CARPORT B

Location	Fastener	Qty / Spacing
----------	----------	---------------

Rafter to side beam (Detail 1)	3/8"-16 SS316 bolt, nylock nut, washers, thru clip angle	2 per rafter end · 24 total
Side beam to post (Detail 2)	1/2"-13 SS316 thru-bolt, nylock nut, fender washers	2 per post · 12 total
Deck to rafters (Detail 3)	#12-14 × 1" self-drilling HWH, bonded EPDM washer	Every other low flute at every rafter; every flute at edges
Deck side laps	#10-16 × 3/4" stitch screw	24" o.c. between rafters
Footing anchors (Detail 4)	1/2" × 6" SS rod thru post, 2 per post @ 90°	12 rods total

GENERAL NOTES

- All aluminum welding with 5356 filler by certified aluminum welder; 1/4" fillet welds unless noted.
- All bolts, nuts, washers and anchor rods stainless steel Type 316. Bolt holes 1/16" oversize, deburred.
- Galvanized deck on aluminum is a compatible (zinc) contact; deck cut edges touched up with cold-galvanizing compound.
- Embedded aluminum protected with bituminous coating per FBC — no aluminum in direct contact with concrete or soil.
- 10'-0" clear entry height verified against owner's tractor (ROPS raised) before fabrication.
- Layout and final grades field-verified with owner before excavation. Structure designed as open (no walls) — do not enclose without review.