



وزارة الاتصالات
وتكنولوجيا المعلومات



SUNNOVA

SOLAR POWER GENERATION FORECASTING

Machine Learning and Deep Learning for 15-Minute and 24-Hour-Ahead Photovoltaic Forecasting

Presented by:

Mohamed Abdelhaliem | Mostafa Mahmoud | Ahmed Hassan Omran |
Mostafa Khalifa Mohamed | Youssef Mahmoud Ali AboEl-Magd

Supervised by:

Maj. Gen. (R.) Prof. Dr. Gouda Ismail Salama

Military Technical College

Track Head:

Dr. Aya Hossam

(August 2026)

AGENDA

01

02

03

INTRODUCTION

MOTIVATION

CHALLENGES

04

05

06

RELATED WORK

PROJECT OBJECTIVE

PROPOSED SOLUTION

07

08

09

EXPERIMENTAL RESULTS

CONCLUSION

FUTURE WORK

INTRODUCTION

Solar Power Forecasting: Context and Need

RENEWABLE ENERGY ENABLES A SUSTAINABLE POWER FUTURE

- Renewable energy comes from naturally replenished sources such as solar, wind, and hydropower.
- Solar power is one of the fastest-growing renewable sources because it is clean, scalable, and suitable for utility-scale generation.
- However, its variability creates a strong need for accurate power forecasting.

Forecasting makes renewable power
more predictable and easier to integrate into the grid.



SOLAR PV CONVERTS SUNLIGHT INTO ELECTRICITY

- Solar photovoltaic systems convert sunlight directly into electrical power.
- Their output depends mainly on solar irradiance, temperature, system characteristics, and local weather conditions.
- PV systems are used in residential, commercial, industrial, and utility-scale applications.



Solar energy
is abundant, but its power output is highly variable and weather-dependent.

FORECASTING MAKES SOLAR POWER GRID-READY

- Solar power forecasting estimates future photovoltaic generation using historical power, weather, and solar-position information.
- Accurate forecasts help grid operators balance supply and demand, schedule energy resources, reduce curtailment, and integrate renewable generation more reliably.



**Better forecasts
lead to better energy planning and more reliable renewable integration.**

AGENDA

01

INTRODUCTION

02

MOTIVATION

03

CHALLENGES

04

RELATED WORK

05

PROJECT OBJECTIVE

06

PROPOSED SOLUTION

07

EXPERIMENTAL RESULTS

08

CONCLUSION

09

FUTURE WORK



MOTIVATION

Why Solar Forecasting Matters

WEATHER VARIABILITY MAKES SOLAR FORECASTING DIFFICULT

Cloud Cover

Causes sudden irradiance drops and rapid power fluctuations.

Temperature

High temperature can reduce PV conversion efficiency.

Humidity & Solar Irradiance

Affects atmospheric light transmission and irradiance quality.

Grid Stability & Efficiency

Forecast accuracy supports balancing, scheduling, and reliable renewable integration.

“ The forecasting model must combine weather dynamics with historical power behavior ”

WHY MACHINE LEARNING FOR SOLAR FORECASTING?

Learning nonlinear relationships between weather conditions and photovoltaic power generation

Nonlinear Modeling

Captures complex relationships between weather, solar position, and PV output.

Multi-Source Features

Combines weather data, historical power, solar geometry, and plant metadata.

Multi-Horizon Forecasting

Supports 15-minute-ahead and 24-hour-ahead solar power prediction.

Operational Value

Supports energy scheduling, grid integration, and performance monitoring.

Machine learning transforms heterogeneous solar data into actionable power forecasts.

AGENDA

01

INTRODUCTION

02

MOTIVATION

03

CHALLENGES

04

RELATED WORK

05

PROJECT OBJECTIVE

06

PROPOSED SOLUTION

07

EXPERIMENTAL RESULTS

08


CONCLUSION

09

FUTURE WORK

CHALLENGES

Technical Obstacles in Solar Power Forecasting



PROBLEM STATEMENT: SOLAR OUTPUT IS HARD TO PREDICT



- Solar generation changes across time and seasons.
- Sudden weather changes create rapid power fluctuations.
- Historical power alone is insufficient under changing weather.
- Forecast accuracy decreases without weather-feature integration.

“Reliable forecasting requires both temporal history and weather information.”

WEATHER VARIABILITY IS A MAJOR SOURCE OF FORECAST UNCERTAINTY

Cloud Cover

- Blocks or scatters solar radiation and can cause rapid drops in PV output.

Temperature & Humidity

- Affect panel efficiency and the transmission of sunlight through the atmosphere.

Solar Irradiance

- Varies with time, season, location, and atmospheric conditions; it is the primary driver of PV generation.

“ The model must integrate weather features with historical power to capture these variations. ”

SOLAR GENERATION HAS COMPLEX TEMPORAL PATTERNS

Power output depends on both recent history and long-term cycles.

Daily Cycles

Generation rises during daylight and falls to zero at night.

Seasonal Patterns

Irradiance and production vary across seasons.

Rapid Changes

Cloud shadows can create sudden intra-hour power drops.

Long-Term Effects

Panel degradation and changing operating conditions affect generation over time.

The model must capture patterns across multiple time scales.

FORECAST ERRORS CREATE OPERATIONAL AND ECONOMIC RISK



- **Grid Imbalance** — Inaccurate forecasts complicate supply–demand balancing.
- **Poor Scheduling** — Operators cannot plan dispatch and storage efficiently.
- **Higher Costs** — Forecast errors may increase reserve requirements and energy waste.

“ The operational value of a forecasting model is measured by how well it supports real grid decisions. ”

AI MODELS LEARN COMPLEX WEATHER-POWER PATTERNS

Nonlinear Relationships

**Captures interactions between
weather and PV output**

Feature Integration

**Combines weather, historical
power, and solar-position
features**

Operational Support

**Produces forecasts for scheduling
and grid balancing**

These capabilities motivate the use of Random Forest and LSTM in the proposed solution.

AGENDA

01

INTRODUCTION

02

MOTIVATION

03

CHALLENGES

04

RELATED WORK

05

PROJECT OBJECTIVE

06

PROPOSED SOLUTION

07

EXPERIMENTAL RESULTS

08

CONCLUSION

09

FUTURE WORK



RELATED WORK

Previous Research in Solar Power Forecasting

SELECTED STUDIES IN SOLAR POWER FORECASTING

Study	Dataset / Horizon	Model	Reported Result	Main Limitation
Konstantinou et al. (2021)	Cyprus PV plant; 1.5-hour ahead	Stacked LSTM	RMSE = 0.11368	Single plant and limited horizon
Jesus (2025)	BR-PVGen; 51 plants	MLP + TL / RF	SMAPE = 43.92% NRMSE = 14.07% / 13.82%	Static models limited temporal learning
Radzi et al. (2026)	Malaysian PV plant; 38 months	Hybrid GRU–LSTM	$R^2 = 0.9961$ RMSE = 18.55 W MAE = 19.43 W	Higher complexity and deployment cost

Results are not directly comparable because datasets, forecast horizons, units, and evaluation protocols differ.

These differences motivate a consistent multi-plant, multi-horizon evaluation.

BR-PVGEN: A MULTI-PLANT FORECASTING BENCHMARK

- **Dataset:** 51 PV plants with meteorological and power-generation data.
- **Reference Horizon:** 15-minute-ahead forecasting.
- **Reported Results:** MLP + Transfer Learning:
SMAPE = 43.92%
NRMSE = 14.07%
RF: NRMSE = 13.82%.
- **Limitation:** The reference models use engineered/static representations and do not explicitly learn hidden temporal states.



“ Our work extends the evaluation to a 24-hour horizon and compares an interpretable RF baseline with sequential LSTM modeling. “

RESEARCH GAP

A consistent multi-plant, multi-horizon evaluation is still needed.

Limited Generalization

Many studies focus on a single PV plant or a limited operating condition.

Horizon Dependency

A model that performs well at 15 minutes may not perform equally well at 24 hours.

Model Trade-Offs

Random Forest is interpretable and robust, while LSTM models temporal dependencies but requires longer sequences.

Fair Evaluation

A consistent dataset, plant-level split, feature pipeline, and evaluation metrics are needed for meaningful comparison.

This project evaluates Random Forest and LSTM across 51 PV plants and two forecasting horizons.

AGENDA

01

INTRODUCTION

02

MOTIVATION

03

CHALLENGES

04

RELATED WORK

05

PROJECT OBJECTIVE

06

PROPOSED SOLUTION

07

EXPERIMENTAL RESULTS

08

CONCLUSION

09

FUTURE WORK

PROJECT GOAL

RELIABLE MULTI-HORIZON FORECASTING

- **Enable smarter energy trading decisions by providing accurate day-ahead solar power forecasts that allow plant operators and grid managers to reduce reserve costs and maximise revenue from electricity market participation**
- **Design a generalised forecasting framework that adapts to new unseen plants using plant metadata (capacity, efficiency, tracker type, location) without requiring retraining from scratch**
- **Implement Transfer Learning to improve prediction accuracy for plants with limited historical data by leveraging knowledge from data-rich plants**
- **Deploy the trained models through a web application that allows users to input plant specifications and weather forecasts and receive predicted power output curves for any plant — known or new**

AGENDA

01

INTRODUCTION

02

MOTIVATION

03

CHALLENGES

04

RELATED WORK

05

PROJECT OBJECTIVE

06

PROPOSED SOLUTION

07

EXPERIMENTAL RESULTS

08

CONCLUSION

09

FUTURE WORK

PROPOSED SOLUTION

END-TO-END FORECASTING PIPELINE

1. **Data Preparation** — Clean, synchronize, and resample power and weather data.
2. **Feature Engineering** — Generate solar geometry, lag, rolling, temporal, and metadata features.
3. **Model Training** — Train per-plant Random Forest and LSTM models.
4. **Forecast Generation** — Produce 15-minute-ahead and 24-hour-ahead predictions.
5. **Evaluation & Comparison** — Compare models using R^2 , MAE, RMSE, NRMSE, and SMAPE.

RANDOM FOREST: AN INTERPRETABLE BASELINE

Random Forest combines multiple decision trees and averages their predictions to produce a stable regression output.

HOW RANDOM FOREST PRODUCES A FORECAST:

- 1. Sample — Train each tree on a different randomized subset of the data.**
- 2. Predict — Each tree produces an individual power forecast.**
- 3. Aggregate — Average the tree predictions to obtain the final output.**

KEY STRENGTHS:


It captures nonlinear relationships and provides feature importance for interpretation.

WHY RANDOM FOREST FOR SOLAR FORECASTING?

- **Nonlinear Relationships** — Models complex interactions between weather and PV output.
- **Mixed Feature Types** — Uses weather, historical power, solar geometry, and plant metadata.
- **Interpretability** — Provides feature importance to explain forecast drivers.
- **Strong Baseline** — Offers a stable reference before evaluating sequential LSTM models.

SOLAR POWER FORECASTING SYSTEM (15-MINUTE AHEAD)

RF- Architecture:

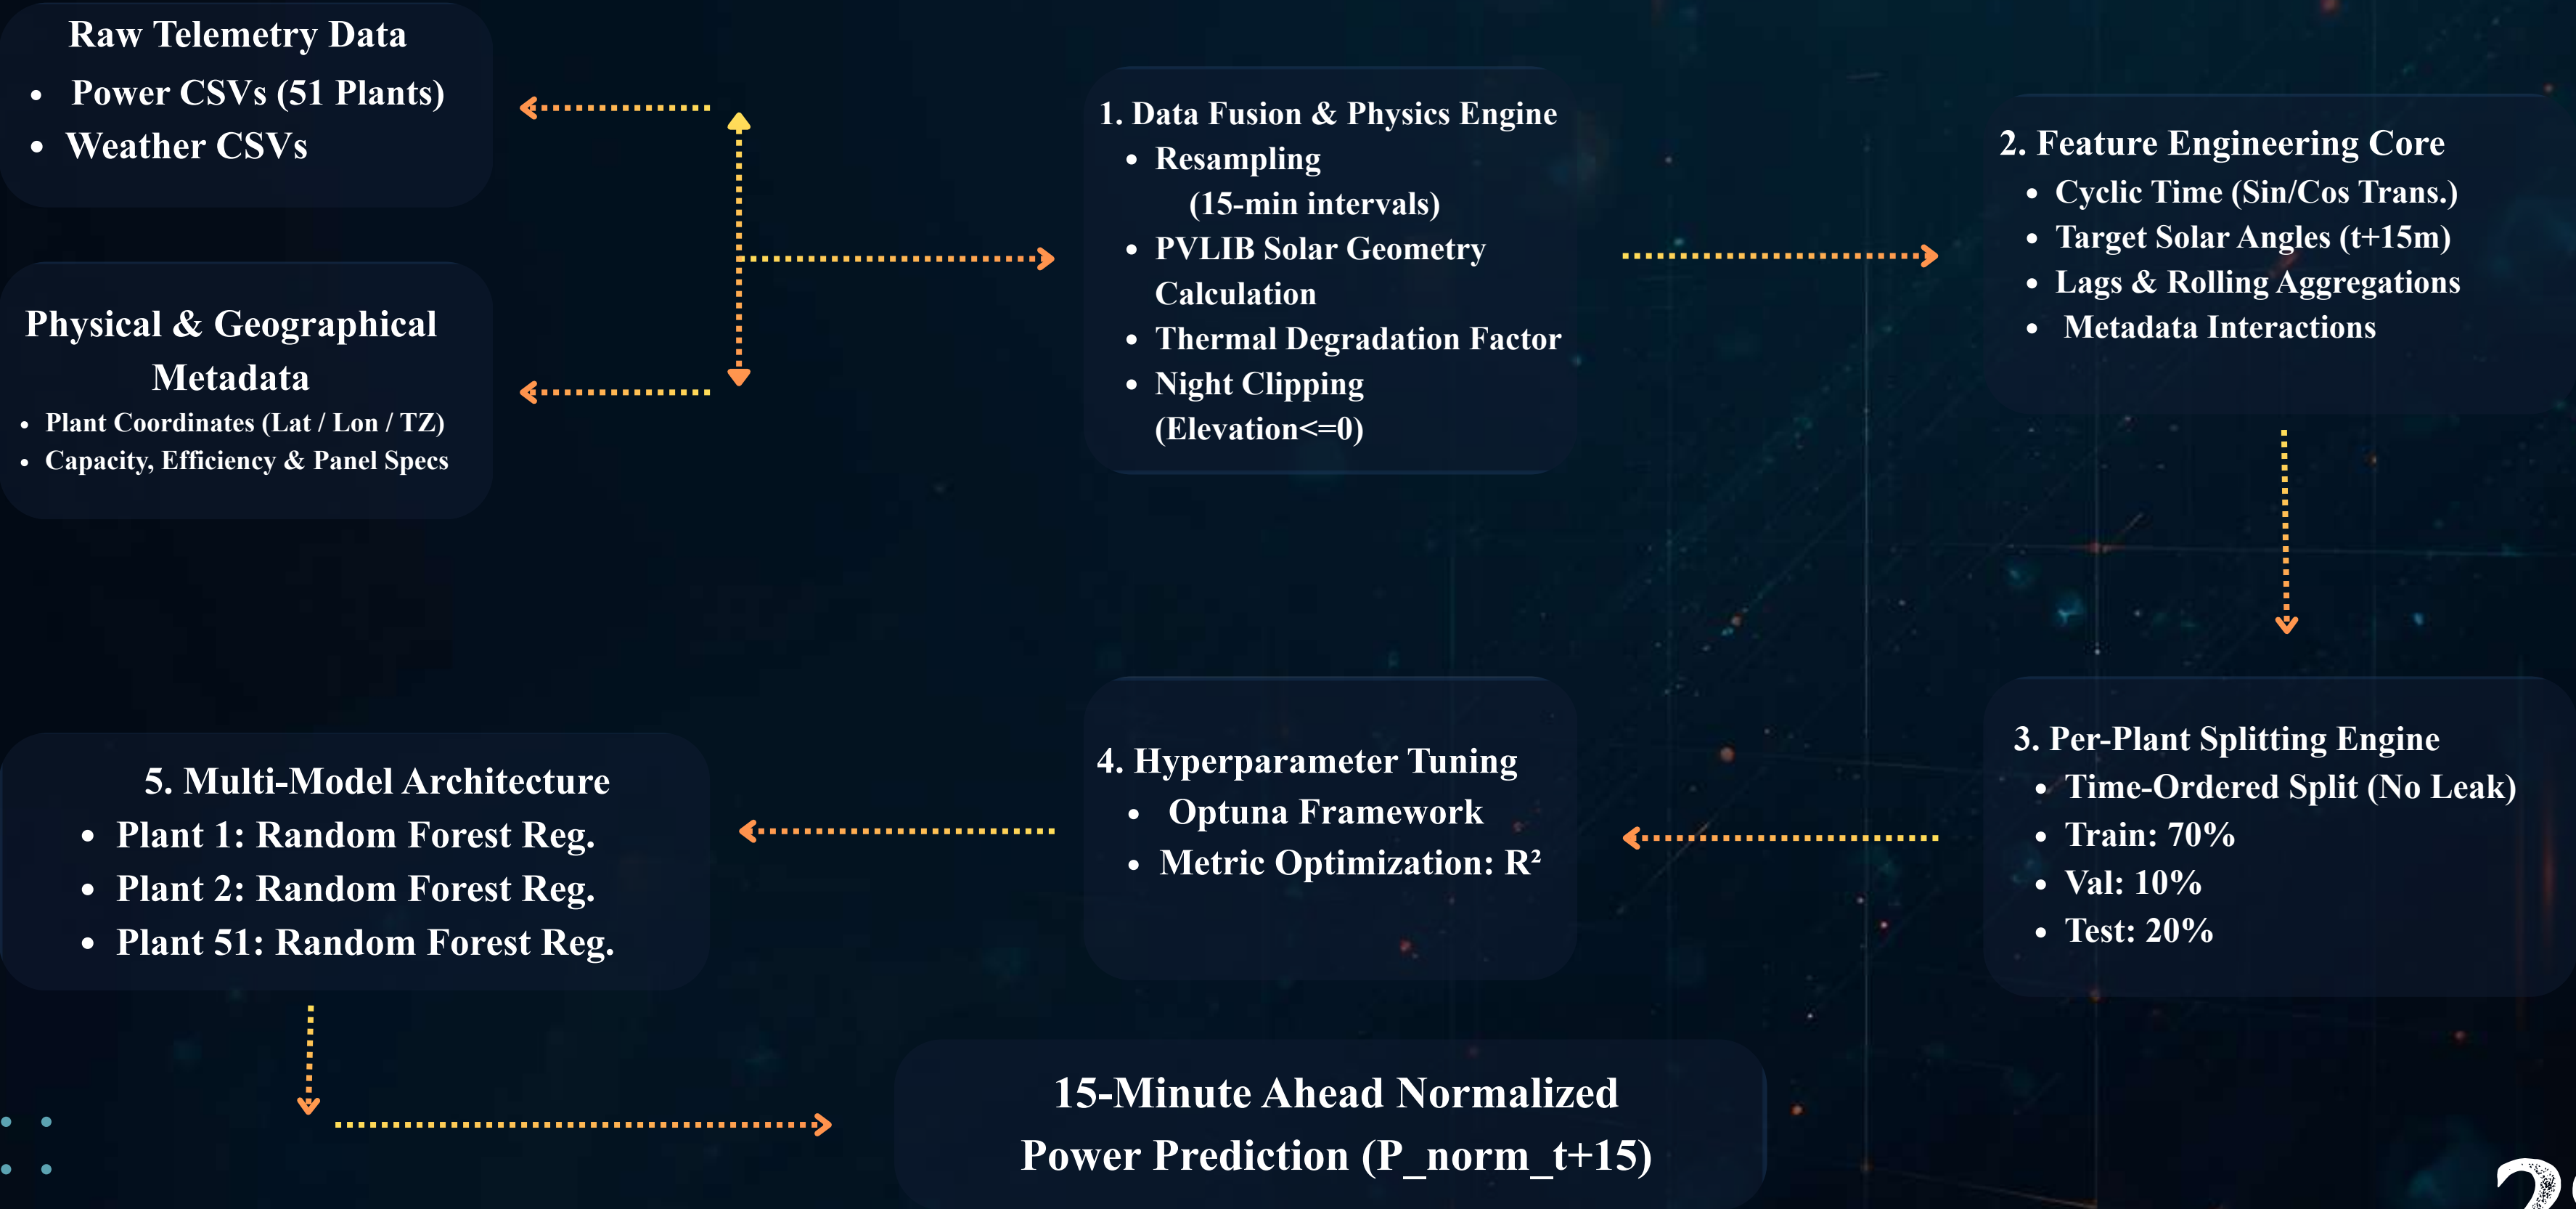

SOLAR POWER FORECASTING SYSTEM (24-HOURE AHEAD)

RF- Architecture:

Raw Telemetry Data

- Power CSVs (51 Plants)
- Weather CSVs

Physical & Geographical Metadata

- Plant Coordinates (Lat / Lon / TZ)
- Capacity, Efficiency & Panel Specs

1. Paring & integrity

- ID- based power - weather pairing
- 51 matched plant profiles
- Meta data and folder validation

2. Physics - Informed Fusion

- Timezone normaliztion and UTC alignment
- Power/Weather inner merge
- 15 min resampling and interpolation
- Pvlb solar elevation / azimuth
- Night Clipping: Elevation ≤ 0

3. Feature Engineering Core

- 49 features per plant
- Cyclical time + t+24h solar geometry
- Power/Weather lags: 1h-7d
- Rolling statistics and interactions
- Target = Power shifted - 96 steps.

5. Evaluation & Diagnostics

- R2 , MAE, RMSE , NRMSE , SMAPE
- Pooled Vs per- plant metrics.
- Outlier detection
- Feature importance and error profiles
- Maintenance dispatch report.

5. Inference & Post-Processing

- Per-plant prediction +surrogate fallback
- Inverse scaling to watts
- Non-negative clipping
- Target-Time night mask

4- Chronological split & RF

- Per - plant 80% train / 20% test
- RFRegressor per plat
- full/ light parameter tier.
- 51 dedicated model piplines

24 - Houre Ahead Power Forecast
Per Plant + Fleet

FEATURE ENGINEERING

Feature groups used to represent solar, weather, and temporal behavior

Physics-Informed Features

- Solar position (azimuth, zenith)
- Clear-sky index (pvlib)
- Solar geometry interactions

Lag Features

- Previous PV generation values
- Lagged meteorological variables
- Short-term temporal patterns

Plant Metadata

- Structure type (Tracker / Fixed)
- Bifaciality coefficient
- Installed capacity

Temporal & Weather

- Hour, day, and seasonal indicators
- Irradiance (POA / GHI)
- Temperature & related variables

RANDOM FOREST PIPELINE

CORE APPROACH

Model: Per-Plant Random Forest

Horizon: 15Min | 24H ahead

Dataset: BR-PVGen (51 plants)

Scope: Individual model per plant +
shared feature schema

Key Design Choices

- Physics-informed features (pvlib solar geometry)
- Clear-sky index + interaction terms
- Plant metadata (tracker / bifacial / capacity)
- Night-time hard masking (physics constraint)
- Hermetic packaging for production deployment

PIPELINE STEPS

- 1 Data Sync**
Power + Weather pairing per plant
- 2 Feature Eng.**
Solar position, clear-sky, lags, metadata
- 3 Train RF**
Independent Random Forest per plant
- 4 Night Mask**
Force zero output outside solar hours
- 5 Package**
Serialize model + schema + scales

TRAINING STRATEGY

Per-Plant Modeling

- **One model per plant — Captures site-specific generation behavior.**
- **Shared feature schema — Keeps inputs consistent across all plants.**
- **Chronological evaluation — Preserves temporal order and avoids data leakage.**
- **Operational benefit — Supports plant-level forecasting and diagnostics.**

RANDOM FOREST KEY HYPERPARAMETERS

Configuration used for the 15-minute-ahead RF experiment

422

n_estimators

Number of trees in the forest.
Higher value improves stability and
reduces variance.

18

max_depth

Maximum depth of each tree.
Limits complexity to control overfitting.

4

min_samples_split

Minimum samples required to split
an internal node. Prevents overly
specific splits.

11

min_samples_leaf

Minimum samples required at a leaf
node. Improves generalization
on noisy data.

0.3

max_features

Number of features considered at each
split. Reduces correlation
between trees.

RANDOM FOREST KEY HYPERPARAMETERS

Configuration used for the 24-hour-ahead RF experiment

150

n_estimators

Number of trees in the forest.
Higher value improves stability and
reduces variance.

10

max_depth

Maximum depth of each tree.
Limits complexity to control overfitting.

30

min_samples_split

Minimum samples required to split
an internal node. Prevents overly
specific splits.

12

min_samples_leaf

Minimum samples required at a leaf
node. Improves generalization
on noisy data.

sqrt

max_features

Number of features considered at each
split. Reduces correlation
between trees.

LSTM: MODELING TEMPORAL DEPENDENCIES

Definition:

LSTM is a recurrent neural network designed to learn patterns across ordered time-series observations.

Key Characteristics:

- Learns long-term temporal dependencies.
- Uses historical weather and power sequences.
- Models nonlinear temporal relationships.

Unlike a static model, LSTM uses the order and history of observations.

LONG SHORT-TERM MEMORY (LSTM)

15MIN/24 MIN AHEAD

Architecture:

Layer (type)	Output Shape	Param #	Connected to
seq_input (InputLayer)	(None, 96, 18)	0	-
meta_input (InputLayer)	(None, 7)	0	-
lstm_1 (LSTM)	(None, 96, 128)	75,264	seq_input[0][0]
meta_dense_1 (Dense)	(None, 32)	256	meta_input[0][0]
layer_normalization (LayerNormalization)	(None, 96, 128)	256	lstm_1[0][0]
batch_normalization (BatchNormalization)	(None, 32)	128	meta_dense_1[0][0]
lstm_2 (LSTM)	(None, 64)	49,408	layer_normalization[0][0]
dropout (Dropout)	(None, 32)	0	batch_normalization[0][0]
layer_normalization_1 (LayerNormalization)	(None, 64)	128	lstm_2[0][0]
meta_dense_2 (Dense)	(None, 16)	528	dropout[0][0]
merge (Concatenate)	(None, 80)	0	layer_normalization_1[0][...] meta_dense_2[0][0]
fc_1 (Dense)	(None, 128)	10,368	merge[0][0]
dropout_1 (Dropout)	(None, 128)	0	fc_1[0][0]
fc_2 (Dense)	(None, 64)	8,256	dropout_1[0][0]
dropout_2 (Dropout)	(None, 64)	0	fc_2[0][0]
output (Dense)	(None, 1)	65	dropout_2[0][0]
relu_clamp (ReLU)	(None, 1)	0	output[0][0]

LONG SHORT-TERM MEMORY (LSTM)

Why LSTM ?

Challenges with Random Forest:

- Processes each sample independently
- Cannot capture temporal dependencies
- Performance decreases under rapidly changing weather conditions

Advantages of LSTM

- Learns sequential weather patterns
- Retains long-term historical information
- Better models nonlinear temporal relationships

Evaluate whether explicit temporal learning improves forecasting across the two horizons.

AGENDA

01

INTRODUCTION

02

MOTIVATION

03

CHALLENGES

04

RELATED WORK

05

PROJECT OBJECTIVE

06

PROPOSED SOLUTION

07


EXPERIMENTAL RESULTS

08

CONCLUSION

09

FUTURE WORK

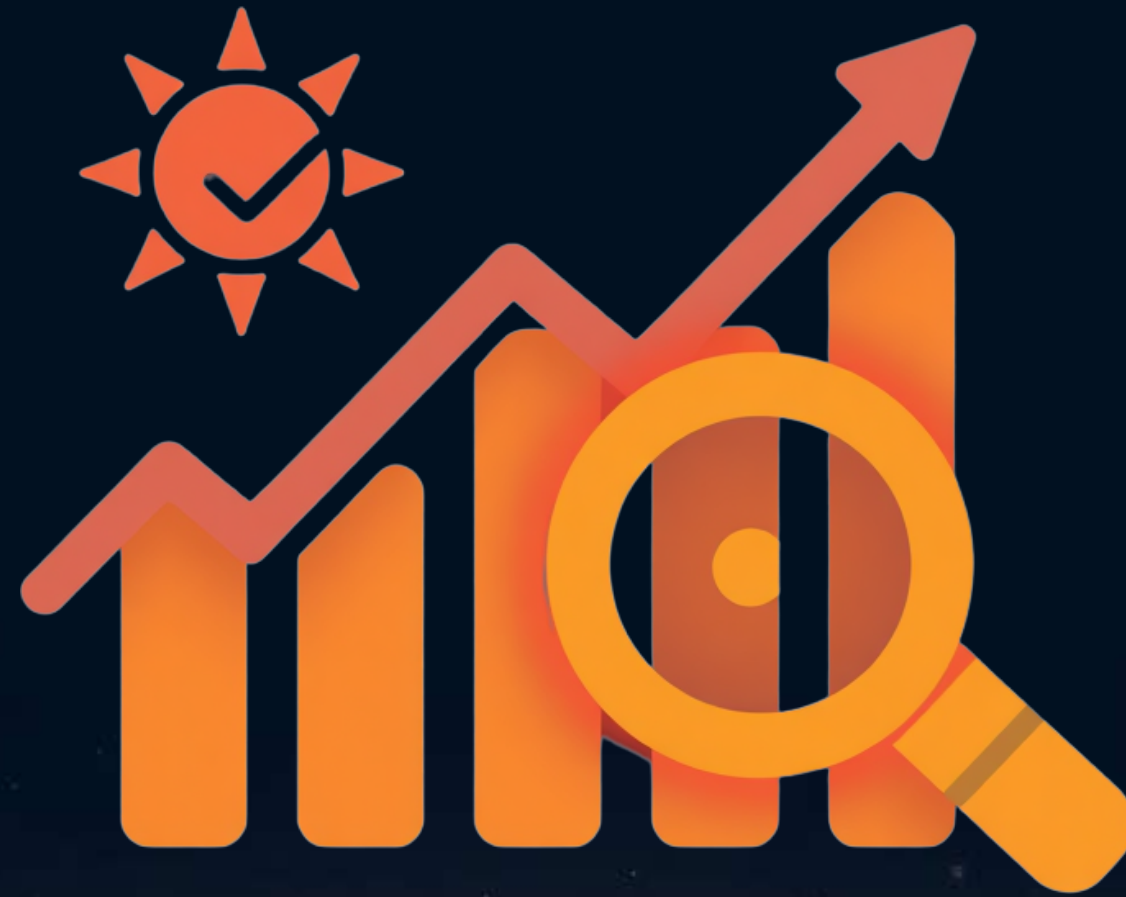

EXPERIMENTAL RESULTS

Comparing Random Forest and LSTM
Across Two Forecast Horizons

RANDOM FOREST — 15-MINUTE-AHEAD RESULTS

0.8883

Mean R^2

50 plants evaluated

17.81

SMAPE (%)

Mean SMAPE
across 50 plants

10.52%

NRMSE (%)

Mean NRMSE
across all plants

KEY INSIGHTS



- 50 Plants evaluated (Plant 15 excluded)
- Best Validation $R^2 = 0.896$
- Most plants achieved $R^2 > 0.80$
- Errors increased during late afternoon

LIMITATIONS & NEXT STEP

- No temporal memory
- Peak power saturation

Next:
evaluate LSTM for temporal awareness.

RANDOM FOREST PREDICTION ANALYSIS

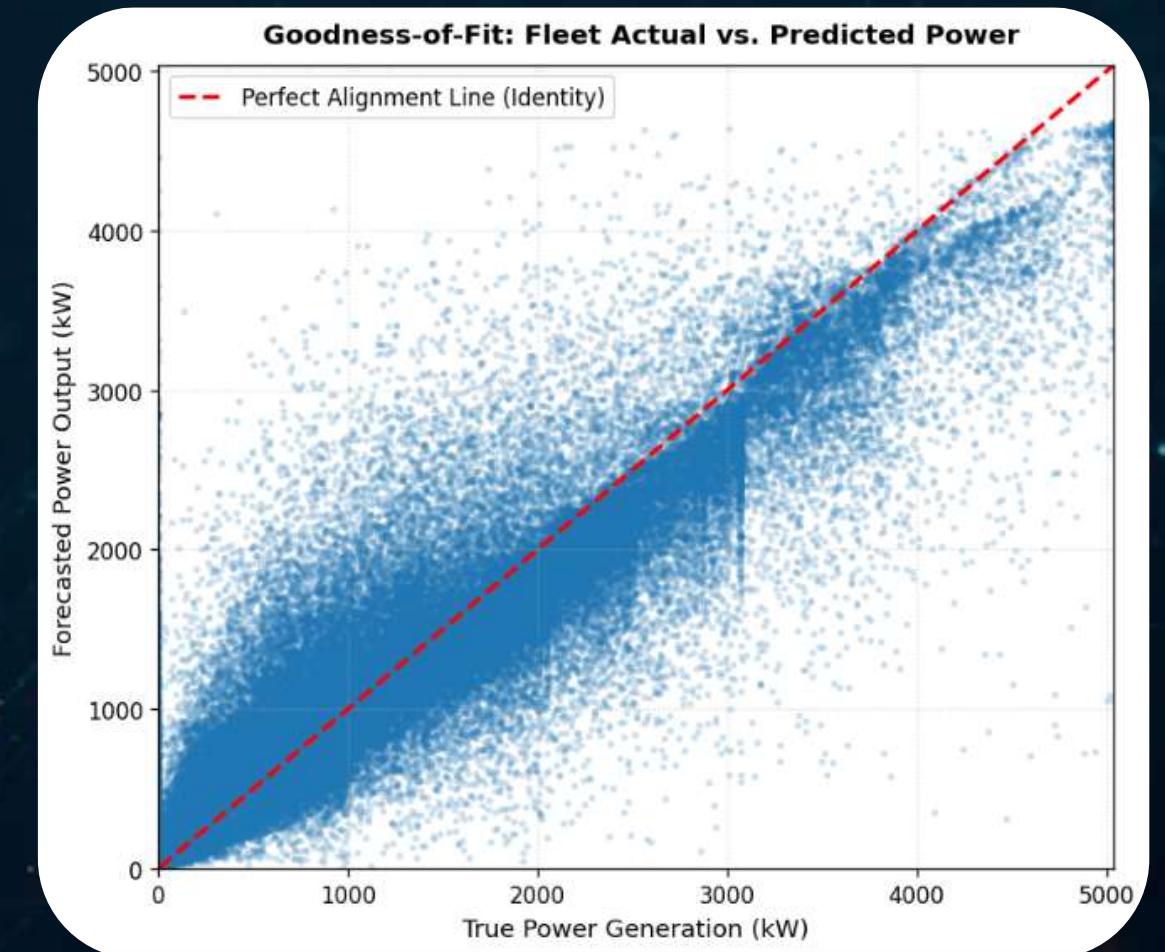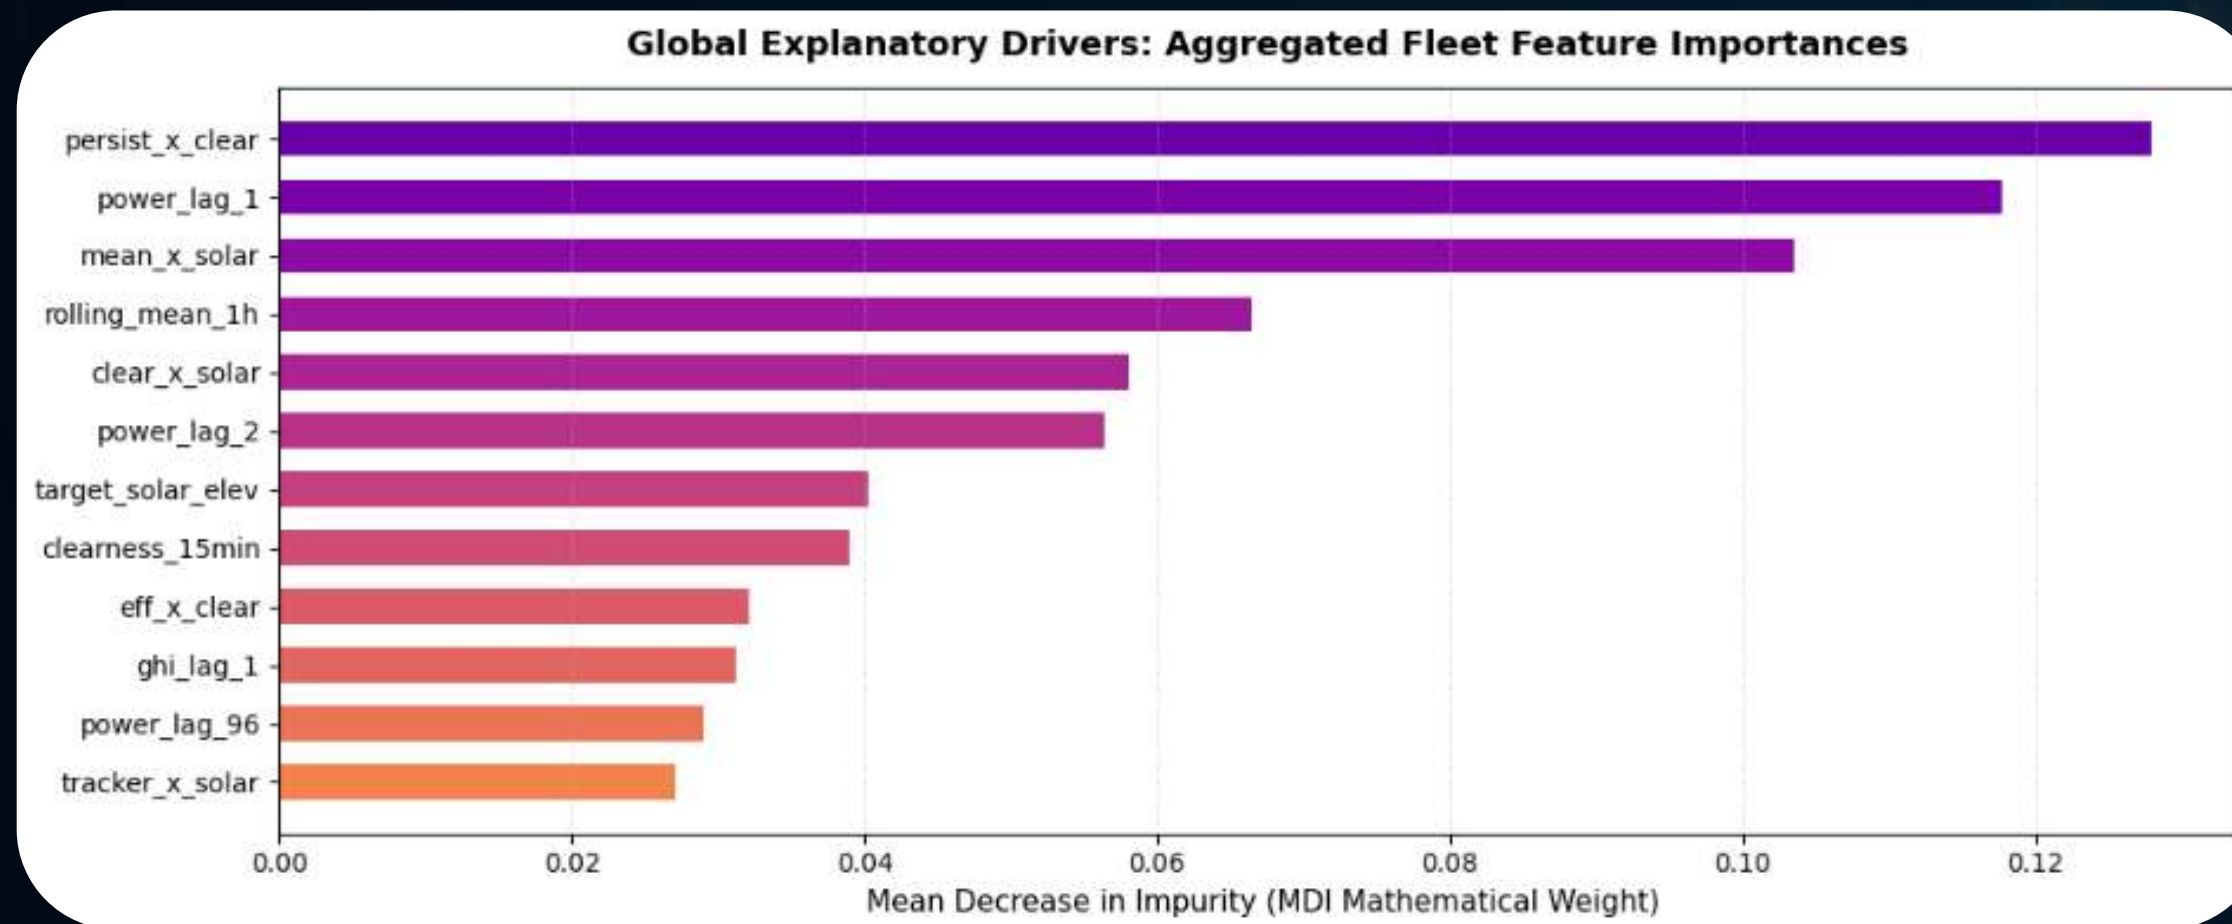

- Predictions closely follow actual power.
- Weather + historical power are the most influential features.
- Performance decreases during rapid weather changes.

RANDOM FOREST

EXPERIMENT (2) - 24.H AHEAD RESULTS

0.782

Mean R^2

50 plants evaluated

22.5 %

SMAPE (%)

Mean SMAPE
across 50 plants

15.29 %

NRMSE (%)

Mean NRMSE
across 50 plants

KEY INSIGHTS

- 50 Plants evaluated after excluding plant 15
- SMAPE was lower than all six qualitative reference models.
- Pooled $R^2 = 0.81$; Per-plant $R^2 = 0.782$
- Several plants exceeded $R^2 > 0.85$

LIMITATIONS & NEXT STEP



- 24-Hour Forecasting is harder than the 15-min experiment.
- Plant level Performance is heterogeneous ; plant 15 was a sever outlier
- Current RF has no explicit temporal dynamics

Next:

Compare LSTM / GRU for Temporal dynamics

RANDOM FOREST PREDICTION ANALYSIS EXPERIMENT 2 - 24.H

Explainability and Goodness-Of-Fit Across the Healthy Fleet

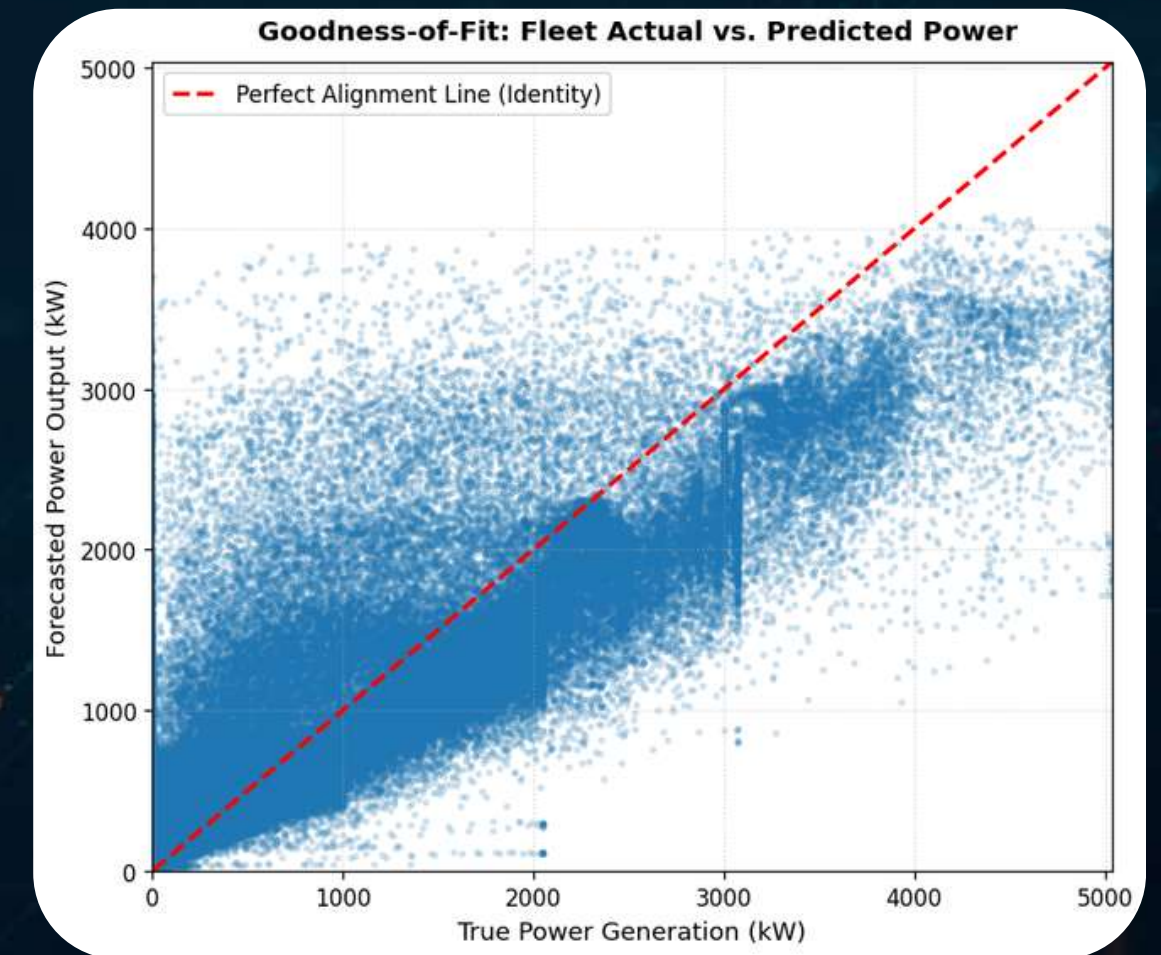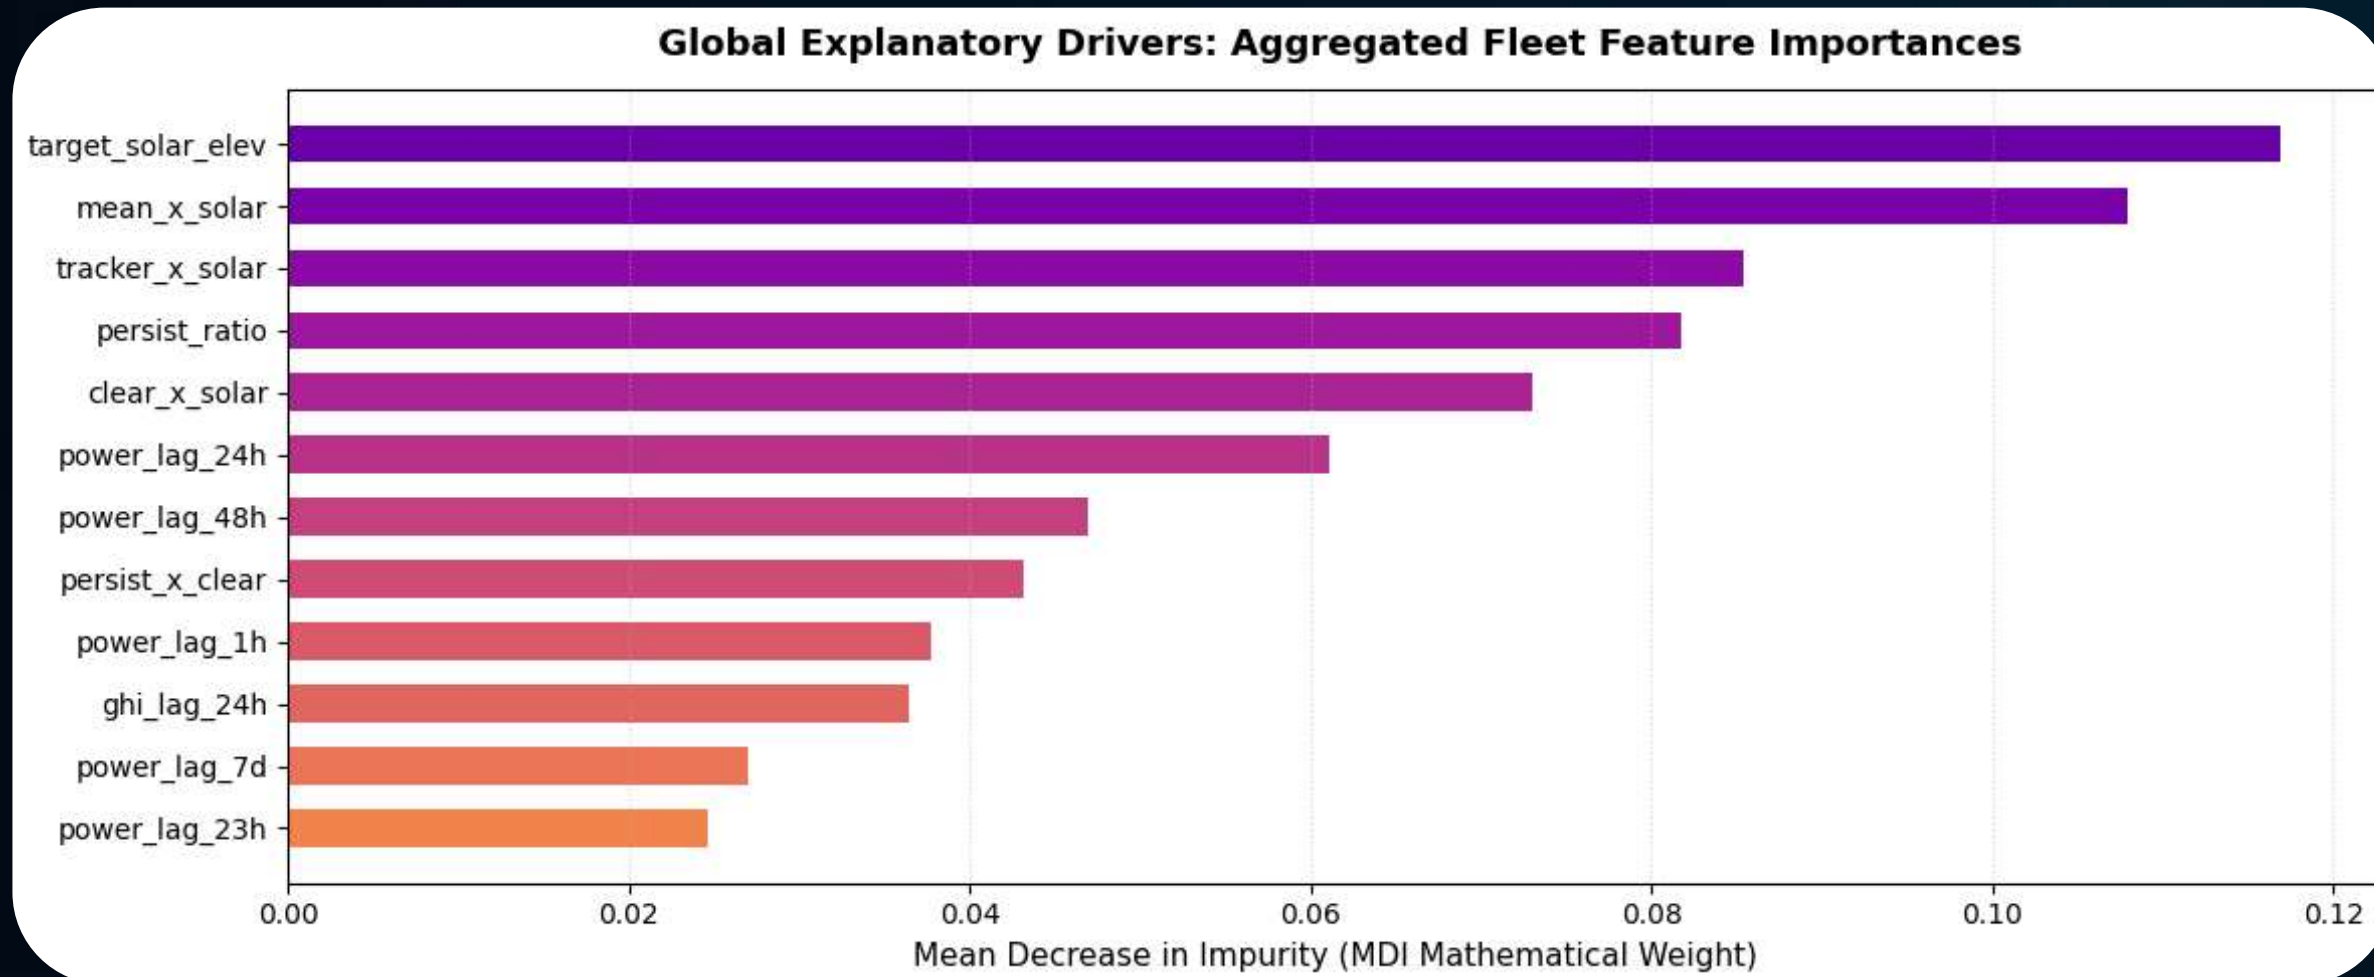

- Solar elevation is the dominant fleet-wide explanatory feature.
- 24h/48h persistence and engineered interactions reinforce the forecast.
- Extreme peaks are capped above approximately 3,500 kW, while cloud attenuation increases variance.

BASELINE COMPARISON: RESEARCH PAPER VS OUR RANDOM FOREST

Model	SMAPE (%)	NRMSE (%)
ARIMA	47.05	14.23
Gradient Boosting	46.94	13.99
Random Forest	47.33	13.82
XGBoost	46.48	13.92
MLP	46.40	14.49
MLP + Transfer Learning	43.92	14.07
Our Random Forest 15 Min / 24H	17.81/22.5	10.52/15.29

Key Findings

Our RF achieves lower SMAPE and NRMSE than the listed 15-minute reference models, while the 24-hour result demonstrates performance under a more difficult horizon.

LSTM — 15-MINUTE-AHEAD RESULTS

0.905

Mean R^2

50 plants (excl. p15)

36.88%

SMAPE (%)

Mean SMAPE
across all plants

15.82%

NRMSE (%)

Mean NRMSE
across all plants

KEY INSIGHTS



- 50 Plants evaluated (Plant 15 excluded)
- Mean Validation $R^2 = 0.905$
- Most plants achieved $R^2 > 0.80$
- LSTM explicitly models temporal dependencies.

LIMITATIONS

- Performance may decrease under highly variable weather.
- Results depend on sequence length.




LSTM — 15-MINUTE-AHEAD PREDICTION ANALYSIS

LSTM Solar Forecast | 51 Plants | $R^2=0.905$ | SMAPE=23.4% | NRMSE(range)=7.7% | EXCELLENT

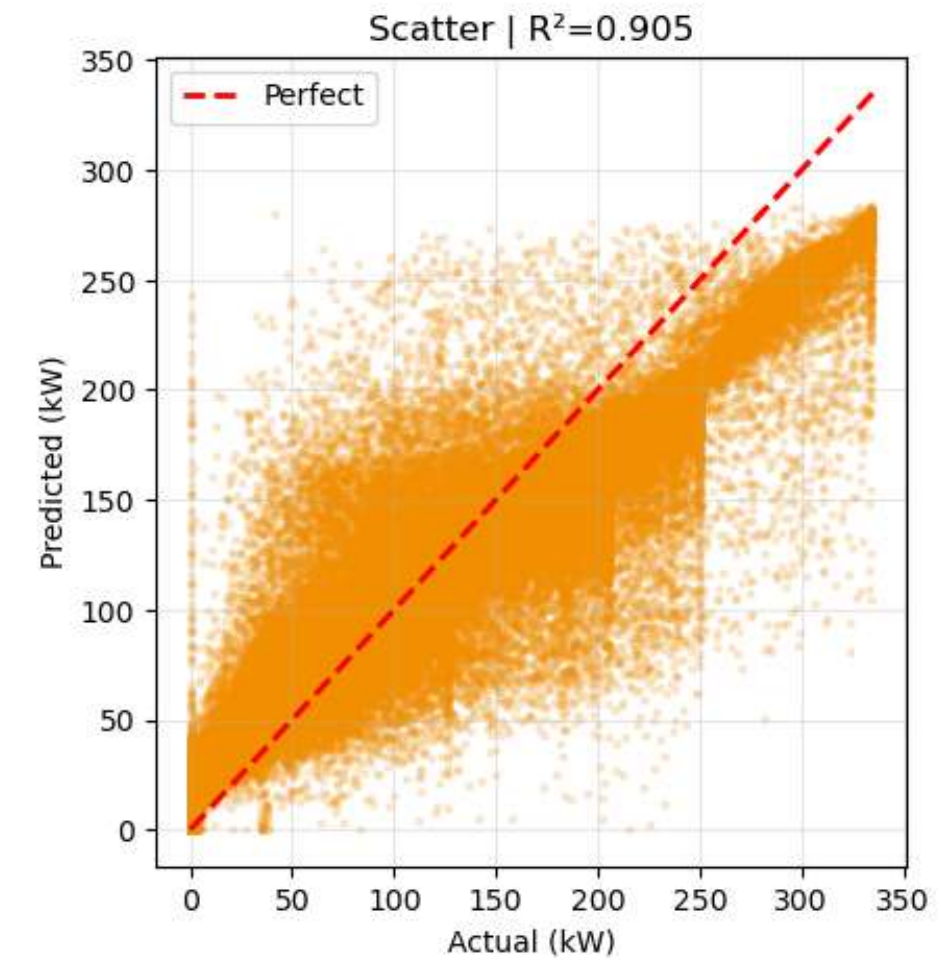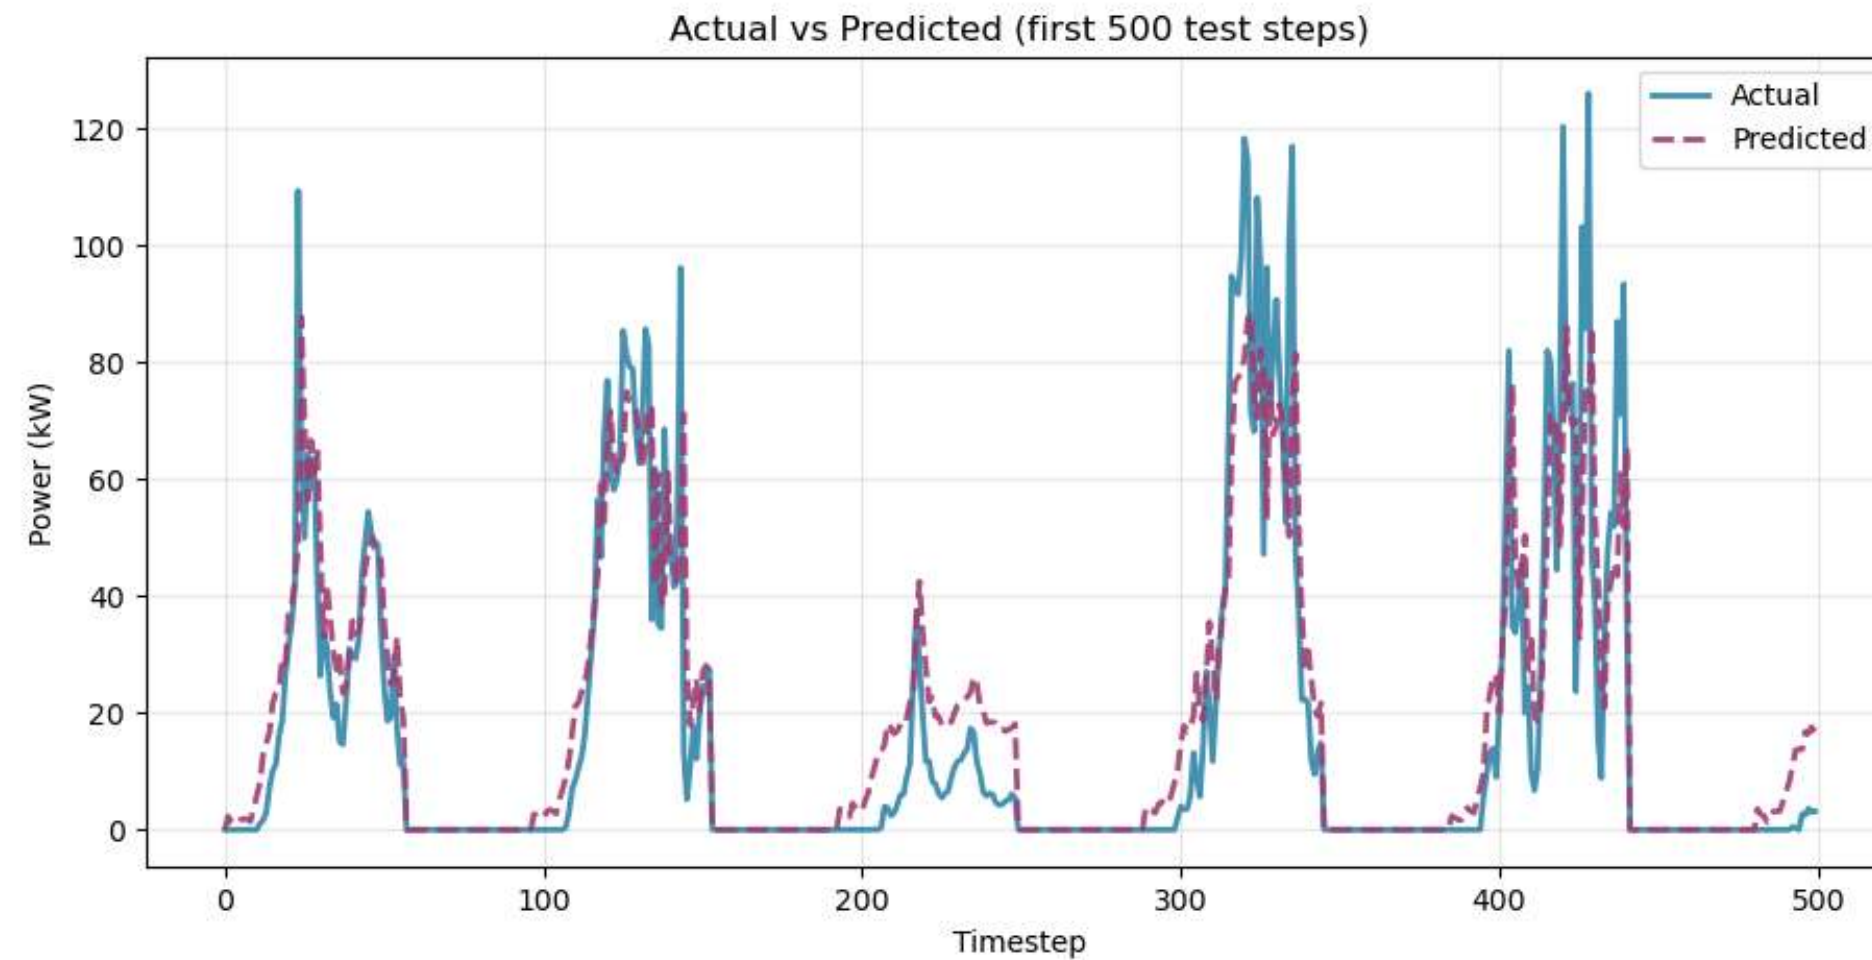

- **Trend Capture** — Predicted power follows the main daily generation pattern.
- **Forecast Agreement** — Predicted values show close agreement with actual power across the test sequence.
- **Weather Sensitivity** — Deviations increase during rapid weather changes.

LSTM 15 MIN- PREDICTION ANALYSIS

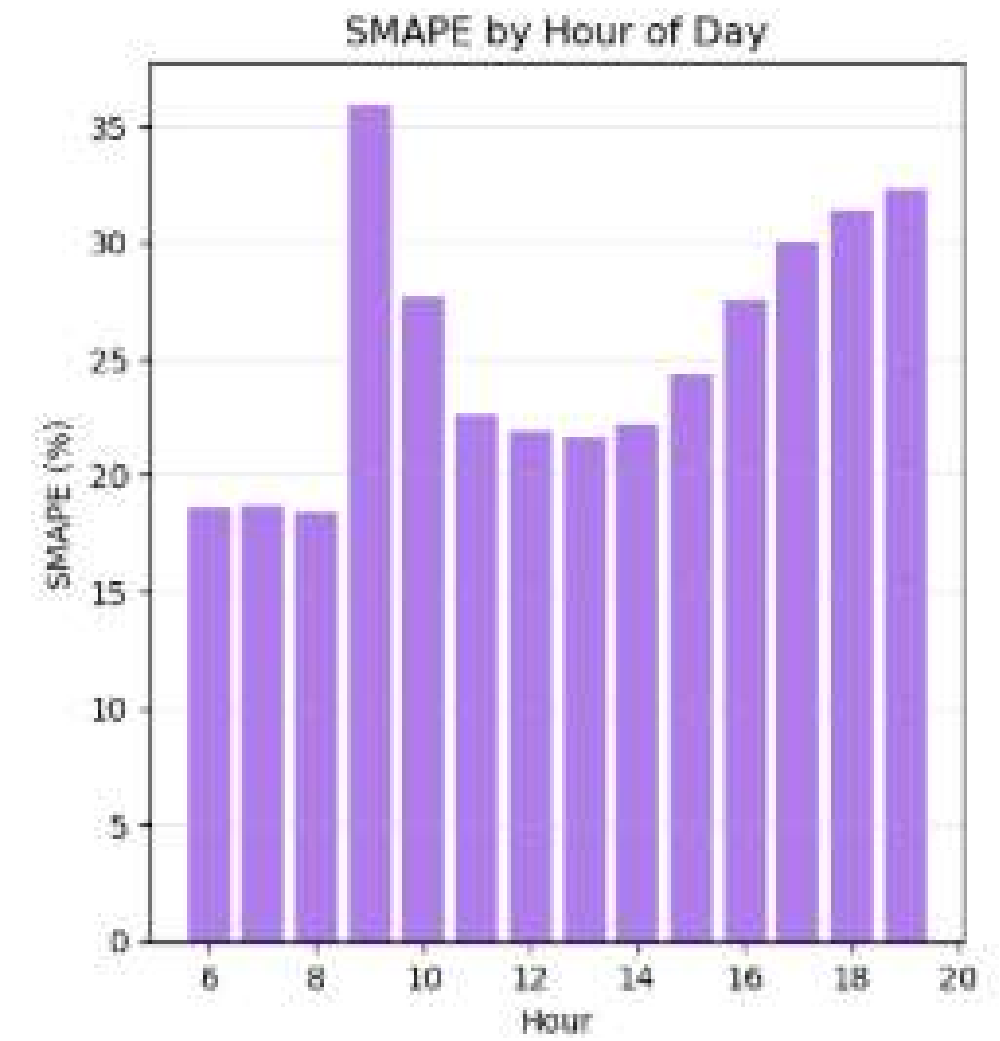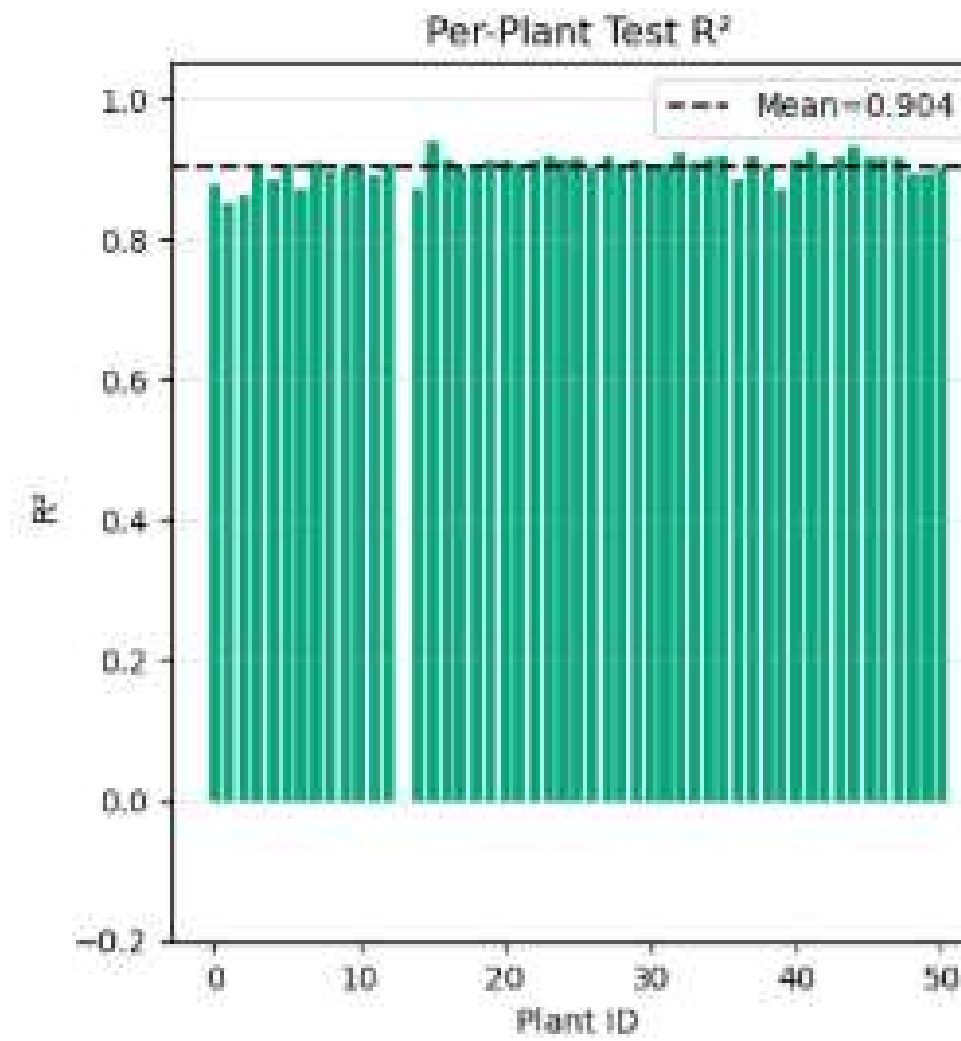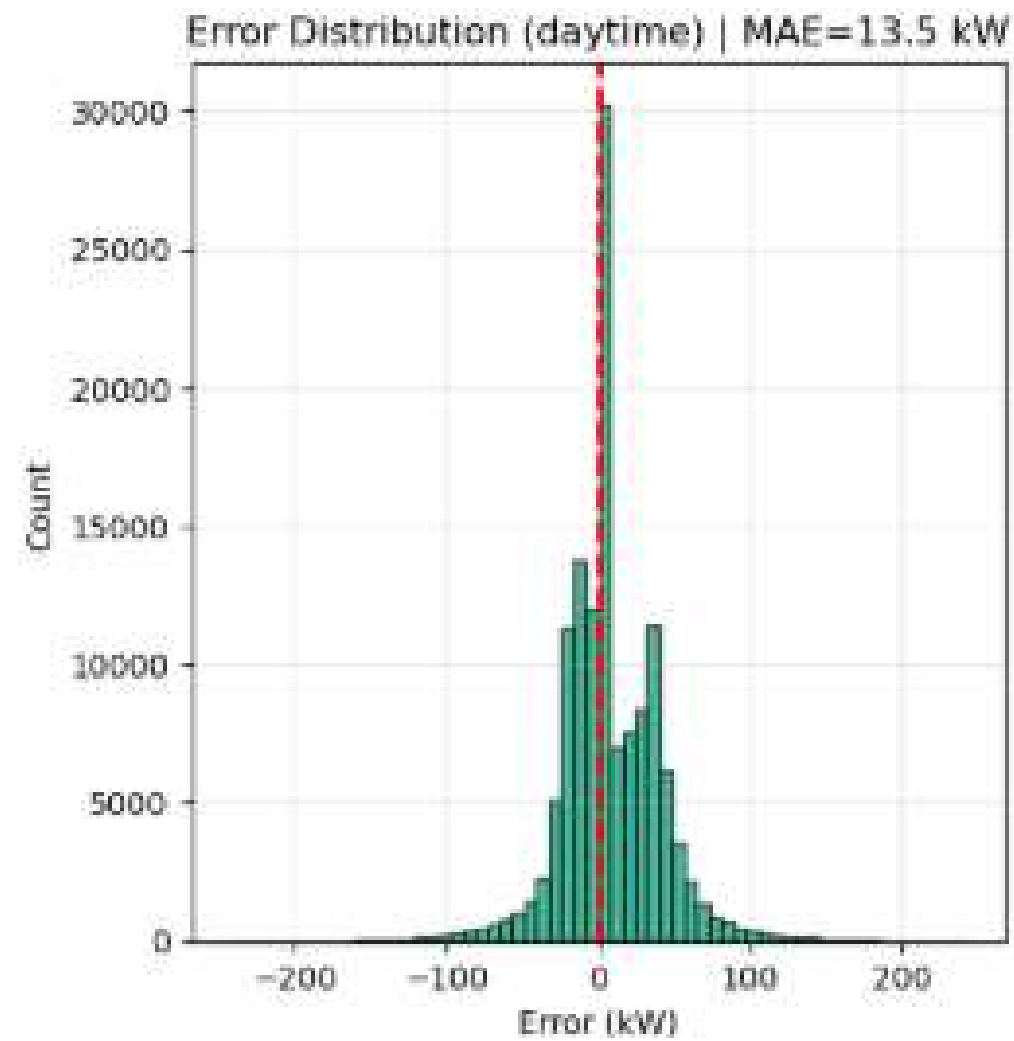

- Daytime errors are centered near zero.
- Performance is consistent across the evaluated plants.
- SMAPE increases during afternoon irradiance variability.

LSTM — 24-HOUR-AHEAD RESULTS

0.7919

Mean R^2

50 plants evaluated

33.30%

SMAPE (%)

Mean SMAPE
across 50 plants

29.64%

NRMSE (%)

Mean NRMSE
across 50 plants



KEY INSIGHTS

- 50 Plants evaluated (Plant 15 excluded)
- Mean Test $R^2 = 0.7919$
- Improved overall accuracy compared with
Random Forest

LIMITATIONS

- Higher SMAPE at sunrise and sunset.
- The model cannot react immediately to
sudden weather shifts.
- Prediction requires 192 historical timesteps.

LSTM — 24-HOUR-AHEAD PREDICTION ANALYSIS

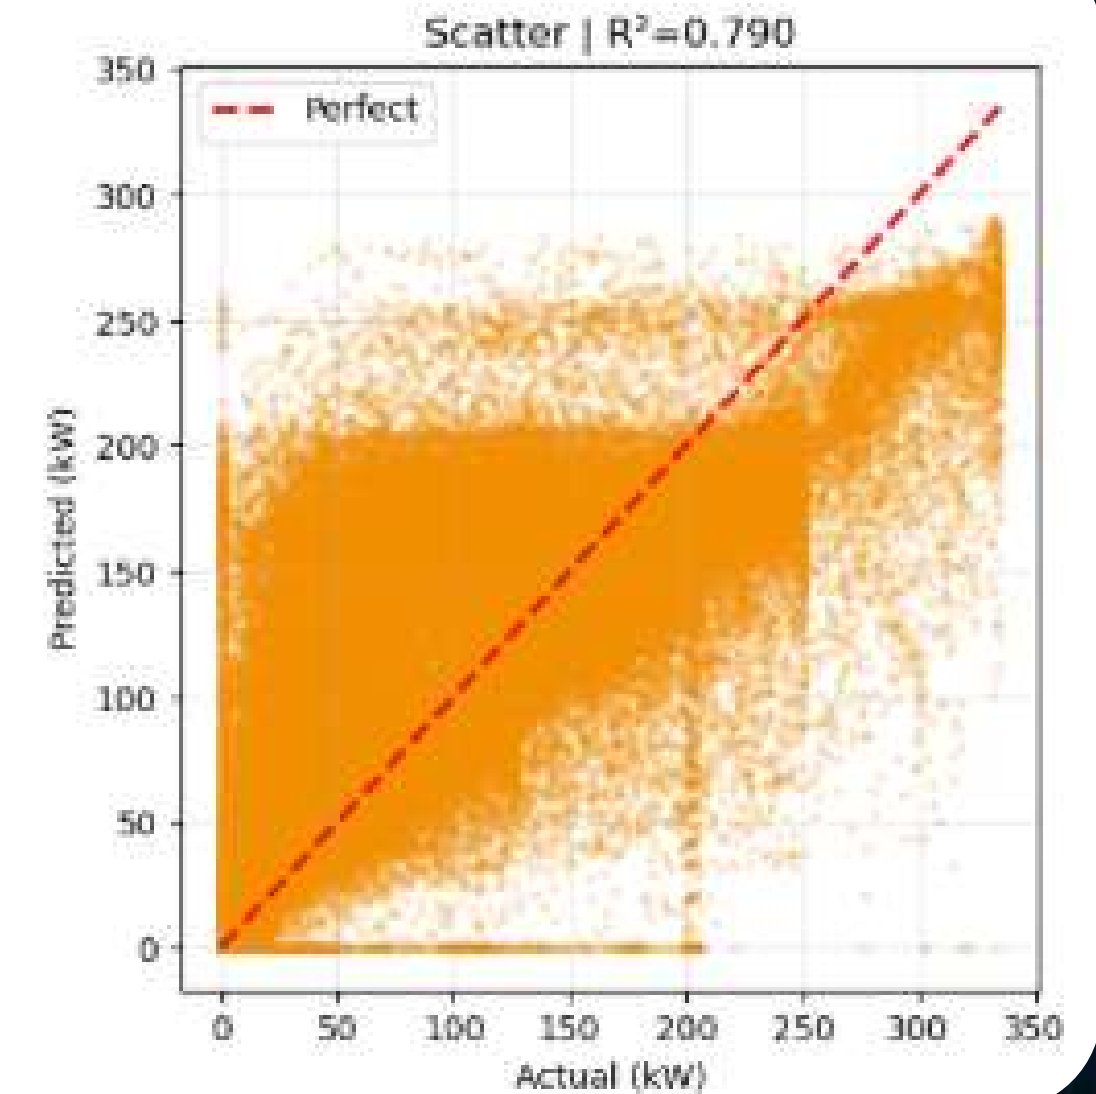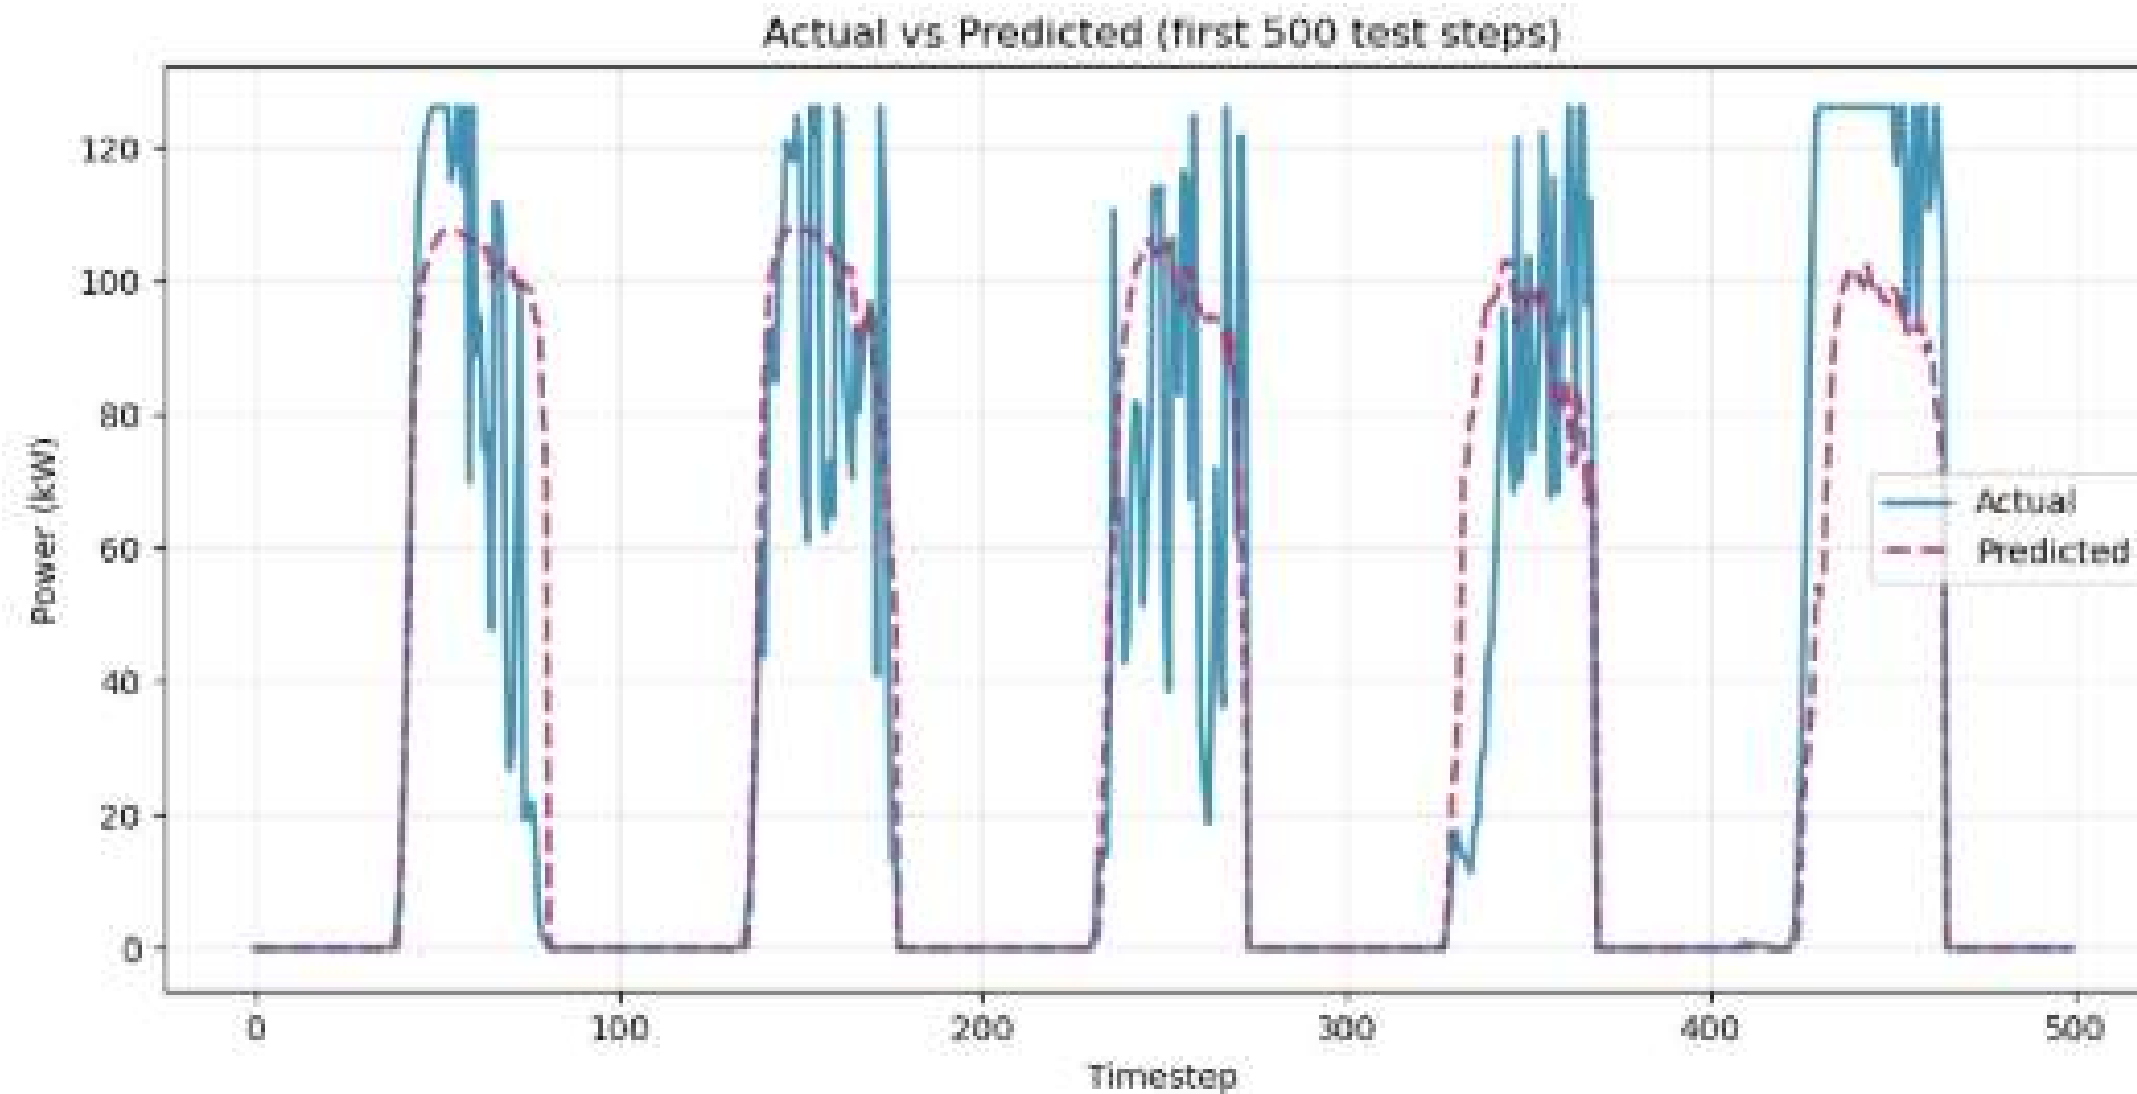

- **Pattern:** Captures the overall solar-generation pattern.
- **Peak Behavior:** Smooths sharp peaks and underestimates some rapid changes.
- **Performance:** Achieves a mean R^2 of approximately 0.79.

“LSTM captures the broad daily pattern,
but sharp peaks remain difficult to forecast 24 hours ahead.”

BASELINE COMPARISON: RESEARCH PAPER VS PROPOSED LSTM

Model	SMAPE (%)	NRMSE (%)
ARIMA	47.05	14.23
Gradient Boosting	46.94	13.99
Random Forest	47.33	13.82
XGBoost	46.48	13.92
MLP	46.40	14.49
MLP + Transfer Learning	43.92	14.07
Our LSTM 15 Min/24 H	36.88/33.30	15.82/29.64

Key Findings

- Mean per-plant $R^2 = 0.904$
- Better SMAPE than all reference models
- Same evaluation protocol as the reference paper
- 50 PV plants evaluated (Plant 15 excluded)

AGENDA

01

INTRODUCTION

02

MOTIVATION

03

CHALLENGES

04

RELATED WORK

05

PROJECT OBJECTIVE

06

PROPOSED SOLUTION

07

EXPERIMENTAL RESULTS

08

CONCLUSION

09

FUTURE WORK

CONCLUSION

- Developed an end-to-end solar power forecasting system using weather and historical power data.
- Built and compared per-plant Random Forest and LSTM models for 15-minute and 24-hour-ahead forecasting.
- Random Forest provided an interpretable and strong baseline, while LSTM added explicit temporal modeling.
- Model performance depends on the forecast horizon and evaluation metric.

“ The results show that model selection should match the operational horizon and the target performance metric. ”



AGENDA

01

INTRODUCTION

02

MOTIVATION

03

CHALLENGES

04

RELATED WORK

05

PROJECT OBJECTIVE

06

PROPOSED SOLUTION

07

EXPERIMENTAL RESULTS

08

CONCLUSION

09

FUTURE WORK

FUTURE WORK

- Hybrid RF + LSTM Models — Combine RF interpretability with LSTM temporal learning.
- Real-Time Forecasting — Deploy the pipeline for continuous operational predictions.
- Richer Data — Add weather features and evaluate larger datasets.
- Scalable Deployment — Extend Sunova toward cloud, smart-grid, and IoT integration.

“The next step is to turn the forecasting pipeline into a real-time operational tool.”





Thank You!

Questions & Discussion

