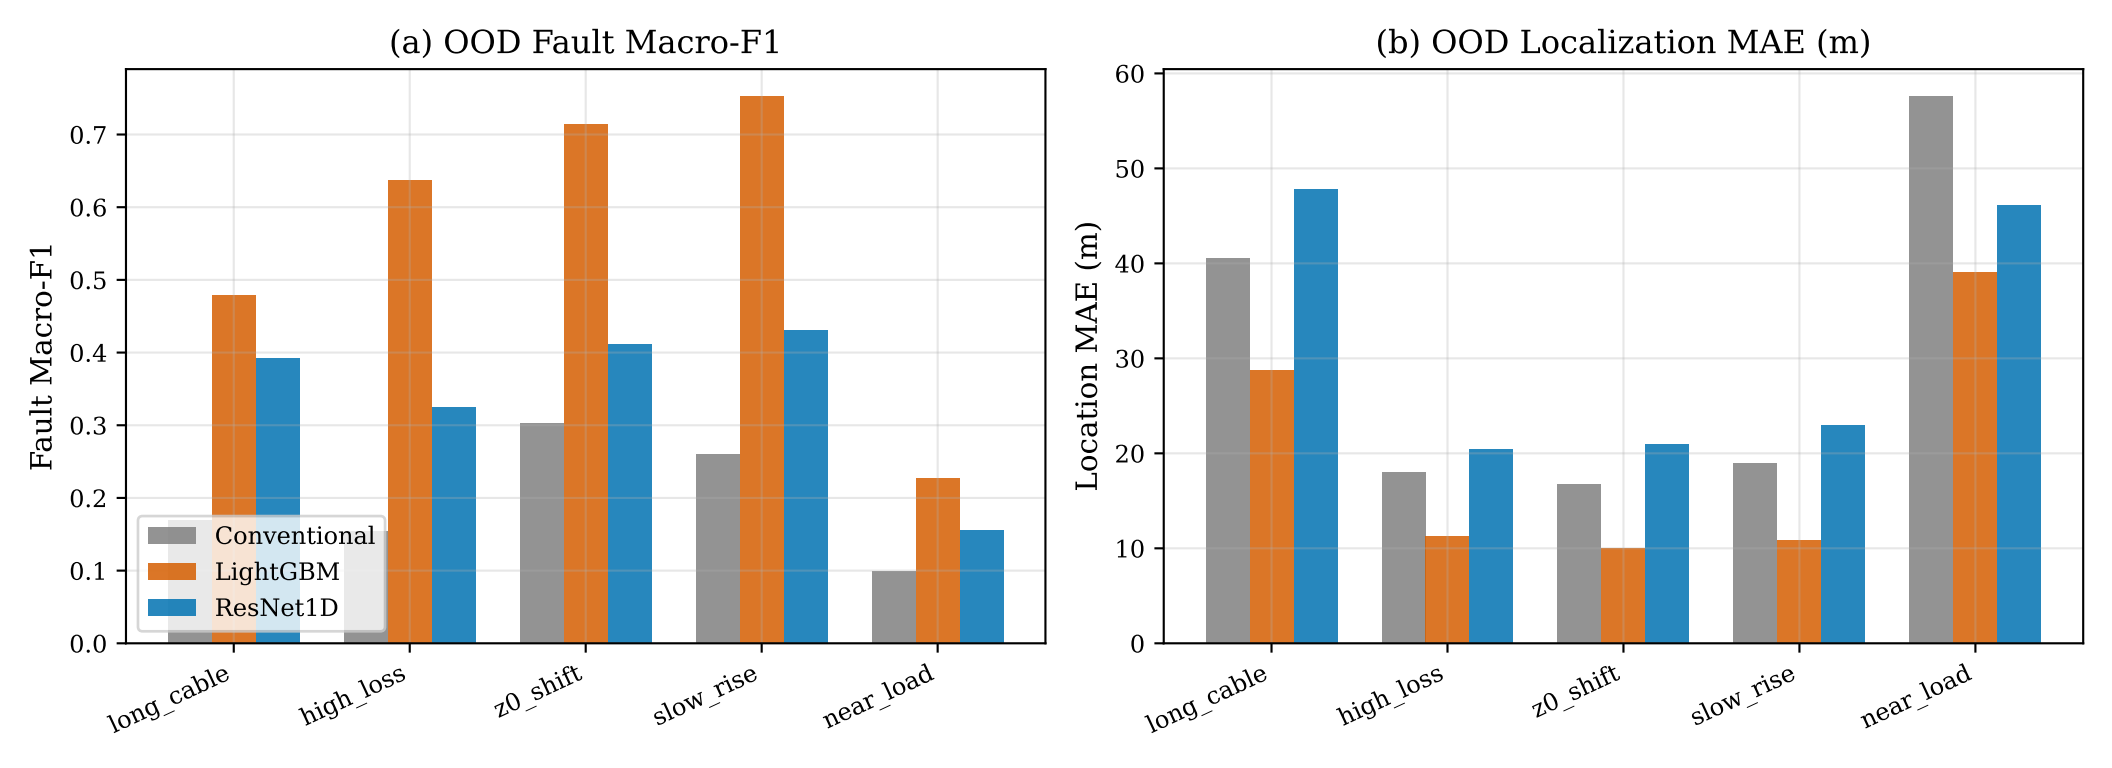
(a) OOD Fault Macro-F1
Fault Macro-F1
0.0
0.1
0.2
0.3
0.4
0.5
0.6
0.7
Conventional
LightGBM
ResNet1D
long_cable
high_loss
z0_shift
slow_rise
near_load
(b) OOD Localization MAE (m)
Location MAE (m)
0
10
20
30
40
50
60
long_cable
high_loss
z0_shift
slow_rise
near_load