

Load Steps Island Mode 16V4000L64 MN90

Emission level
Generator
B_f for G3


NOx 500mg/Nm³ @ 5% O₂
LSA 53.1M80
till 1000 kW

Norm
Inertia
Note

ISO 8528-5

85 kgm²

For 100% electrical power also regard derating for methan number,
inlet air temperature and altitude on site.

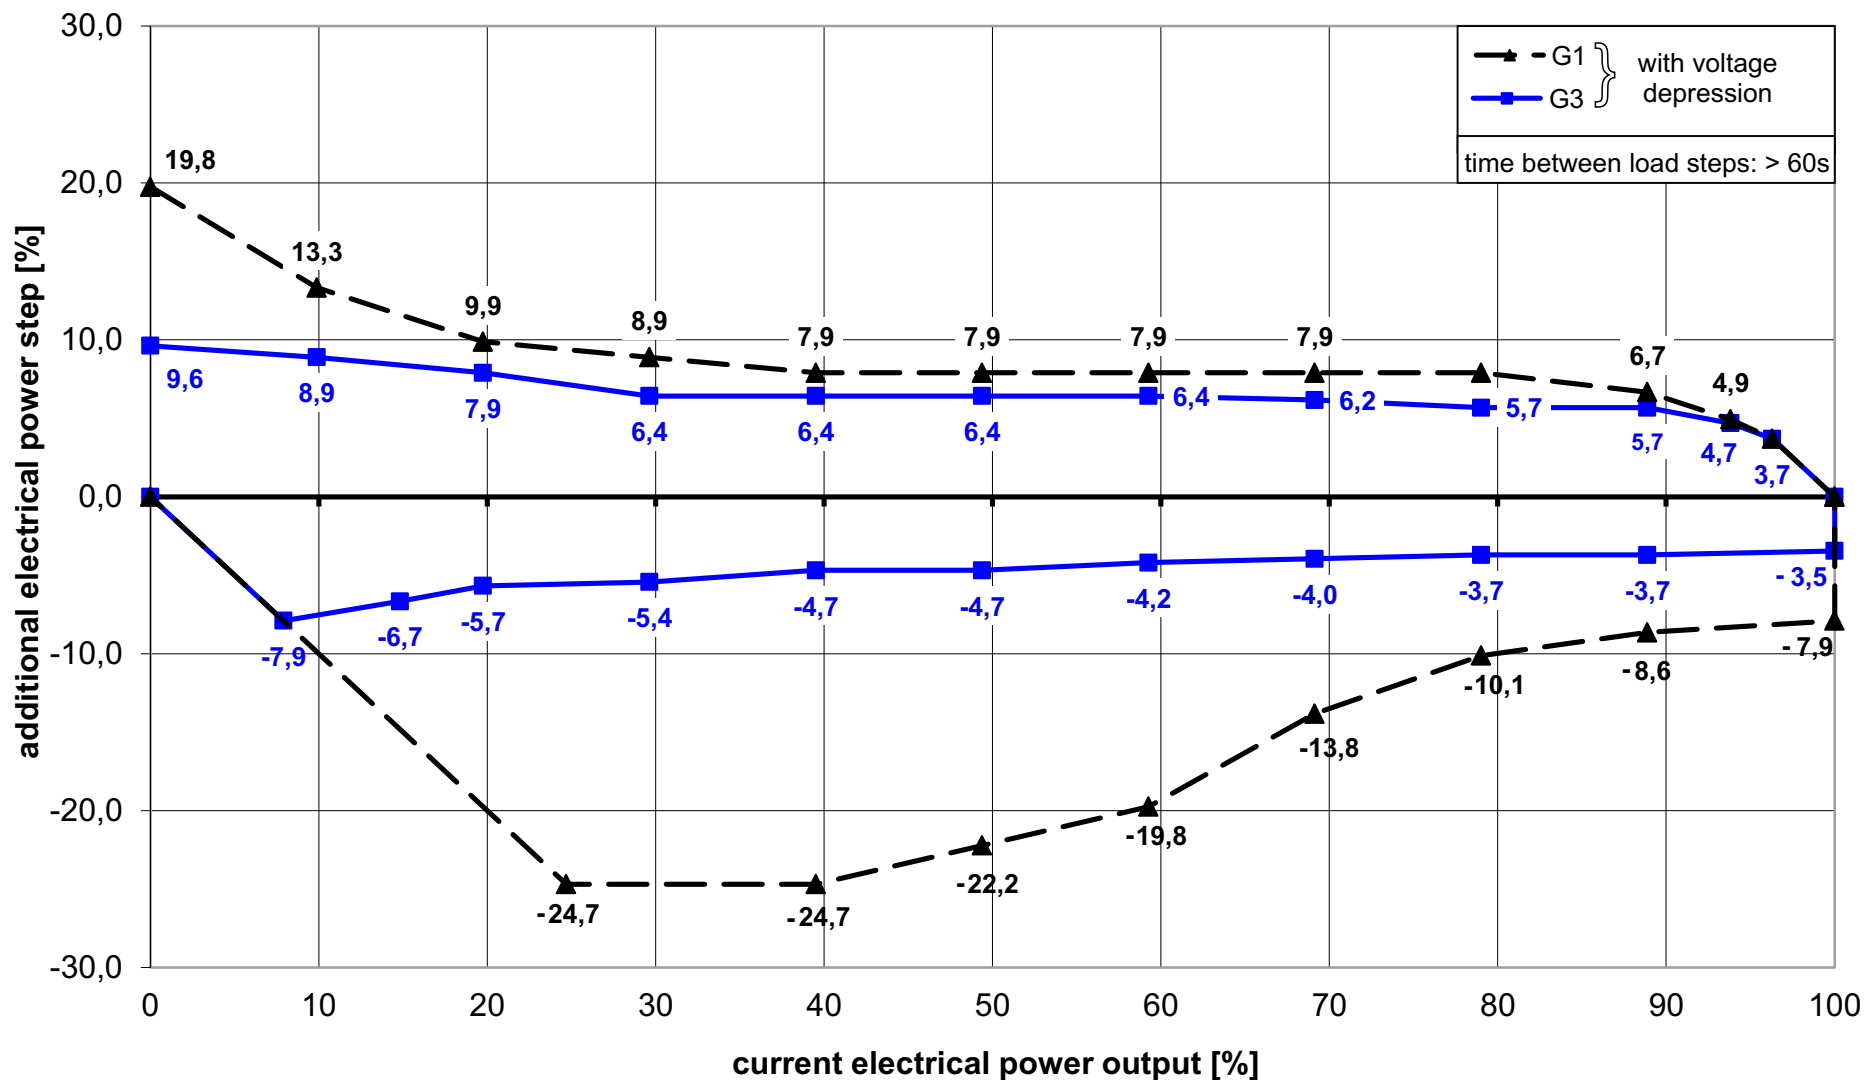

Load Steps Island Mode 16V4000L64 MN80


Emission level
Generator
 B_f for G3

NOx 500mg/Nm³ @ 5% O₂
LSA 53.1M80
till 1000 kW

Norm
Inertia
Note

ISO 8528-5
85 kgm²

For 100% electrical power also regard derating for methan number,
inlet air temperature and altitude on site.

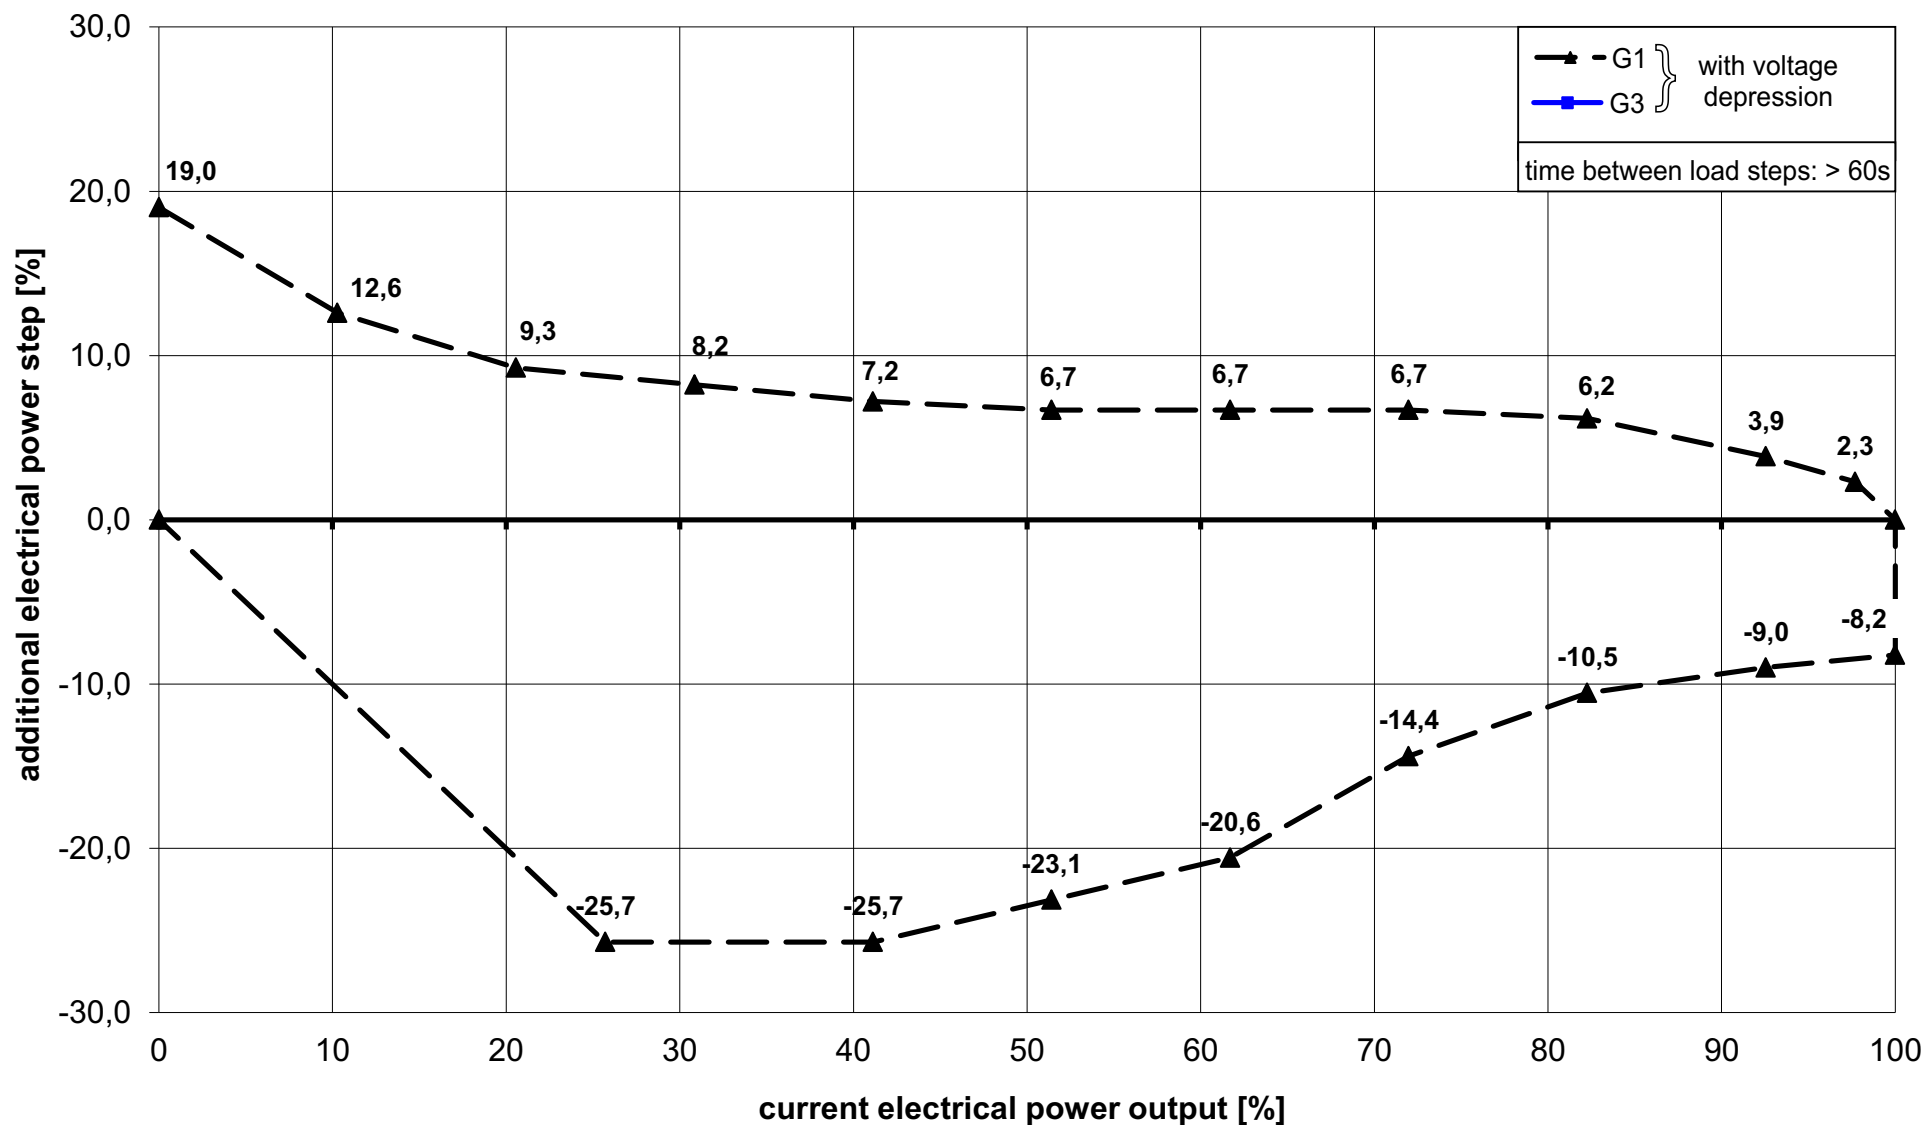

Load Steps Island Mode 16V4000L64 MN70

Emission level
Generator
B_f for G3

NO_x 500mg/Nm³ @ 5% O₂
LSA 53.1M80
till 1000 kW

Norm
Inertia
Note

ISO 8528-5
85 kgm²

For 100% electrical power also regard derating for methan number,
inlet air temperature and altitude on site.

