

BEIT HAYOT

Fire Sprinkler Reports

for

BEIT HAYOT ARIEL UNIVERSITY

Ramat HaGolan St 65,
Ari'el

Prepared By:

RONEN ALON EICHENBAUM

11/03/26



General Project Data Report

General Data

Project Title:	BEIT HAYOT	Project File Name:	BEIT HAYOT ARIEL 1950..fi7
Designed By:	RONEN ALON EICHENBAUM	Date:	11/03/26
Code Reference:		Approving Agency:	
Client Name:	BEIT HAYOT ARIEL UNIVERSITY	Phone:	
Address:	Ramat HaGolan St 65,	City, State Zip Code:	Ari'el
Company Name:		Representative:	
Company Address:		City And State:	
Phone:			
Building Name:		Building Owner:	
Contact at Building:		Phone at Building:	
Address Of Building:		City, State Zip Code:	

Project Data

Description Of Hazard:	Ordinary 1	Sprinkler System Type:	
Design Area Of Water Application:	1950 ft ²	Maximum Area Per Sprinkler:	130 ft ²
Default Sprinkler K-Factor:	5.60 K	Default Pipe Material:	SCHD 10 STEEL, DRY
Inside Hose Stream Allowance:	0.00 gpm	Outside Hose Stream Allowance:	0.00 gpm
In Rack Sprinkler Allowance:	0.00 gpm		
Sprinkler Specifications			
Make:		Model:	
Size:		Temperature Rating:	0 F

Water Supply Test Data

Source Of Information:		Date Of Test:	
Test Hydrant ID:			
Hydrant Elevation:	0 ft	Static Pressure:	0.00 psi
Test Flow Rate:	0.00 gpm	Test Residual Pressure:	0.00 psi
Calculated System Flow Rate:	410.96 gpm	Calculated Inflow Residual Pressure:	36.17 psi

Calculation Project Data

Calculation Mode:	Demand		
HMD Minimum Residual Pressure:	7.00 psi	Minimum Desired Flow Density:	0.15 gpm/ft ²
Number Of Active Nodes:	33		
Number Of Active Pipes:	32	Number Of Inactive Pipes:	0
Number Of Active Sprinklers:	20	Number Of Inactive Sprinklers:	0



Fire Sprinkler Input Data

Node Input Data

Node No.	Node Description Branch Description	Area Group Branch Dia. (in)	Sprinkler KFactor (K) Branch Len. (ft)	Pressure Estimate (psi) Branch Std Fittings	Node Elev (ft) Branch Non- Std Fittings (ft)	Non-Sprinkler Flow (gpm) Branch Sprk KFactor (K)
1	Sprinkler ----	---- 0.000	5.60 0.0	12.42 ----	10.50 0.0	0.00 0.00
2	Sprinkler ----	---- 0.000	5.60 0.0	12.66 ----	10.50 0.0	0.00 0.00
3	Sprinkler ----	---- 0.000	5.60 0.0	13.51 ----	10.50 0.0	0.00 0.00
4	Sprinkler ----	---- 0.000	5.60 0.0	14.08 ----	10.50 0.0	0.00 0.00
5	Sprinkler ----	---- 0.000	5.60 0.0	12.21 ----	10.50 0.0	0.00 0.00
6	Sprinkler ----	---- 0.000	5.60 0.0	12.12 ----	10.50 0.0	0.00 0.00
7	Sprinkler ----	---- 0.000	5.60 0.0	12.62 ----	10.50 0.0	0.00 0.00
8	Sprinkler ----	---- 0.000	5.60 0.0	13.02 ----	10.50 0.0	0.00 0.00
9	Sprinkler ----	---- 0.000	5.60 0.0	13.33 ----	10.50 0.0	0.00 0.00
10	Sprinkler ----	---- 0.000	5.60 0.0	14.79 ----	10.50 0.0	0.00 0.00
11	Sprinkler ----	---- 0.000	5.60 0.0	15.23 ----	10.50 0.0	0.00 0.00
12	Sprinkler ----	---- 0.000	5.60 0.0	13.10 ----	10.50 0.0	0.00 0.00
13	Sprinkler ----	---- 0.000	5.60 0.0	13.43 ----	10.50 0.0	0.00 0.00
14	Sprinkler ----	---- 0.000	5.60 0.0	13.52 ----	10.50 0.0	0.00 0.00
15	Sprinkler ----	---- 0.000	5.60 0.0	14.26 ----	10.50 0.0	0.00 0.00
16	Sprinkler ----	---- 0.000	5.60 0.0	14.17 ----	13.00 0.0	0.00 0.00
17	Sprinkler ----	---- 0.000	5.60 0.0	12.96 ----	10.50 0.0	0.00 0.00
18	Sprinkler ----	---- 0.000	5.60 0.0	13.26 ----	10.50 0.0	0.00 0.00



Fire Sprinkler Input Data

Node Input Data (cont'd)

Node No.	Node Description Branch Description	Area Group Branch Dia. (in)	Sprinkler KFactor (K) Branch Len. (ft)	Pressure Estimate (psi) Branch Std Fittings	Node Elev (ft) Branch Non- Std Fittings (ft)	Non-Sprinkler Flow (gpm) Branch Sprk KFactor (K)
19	Sprinkler ----	---- 0.000	5.60 0.0	14.14 ----	10.50 0.0	0.00 0.00
20	Sprinkler ----	---- 0.000	5.60 0.0	14.72 ----	10.50 0.0	0.00 0.00
30	No Discharge ----	---- 0.000	N/A 0.0	12.31 ----	10.50 0.0	0.00 0.00
31	No Discharge ----	---- 0.000	N/A 0.0	13.23 ----	10.50 0.0	0.00 0.00
32	No Discharge ----	---- 0.000	N/A 0.0	13.74 ----	10.50 0.0	0.00 0.00
40	No Discharge ----	---- 0.000	N/A 0.0	14.16 ----	10.50 0.0	0.00 0.00
41	No Discharge ----	---- 0.000	N/A 0.0	14.87 ----	10.50 0.0	0.00 0.00
42	No Discharge ----	---- 0.000	N/A 0.0	15.31 ----	10.50 0.0	0.00 0.00
43	No Discharge ----	---- 0.000	N/A 0.0	16.07 ----	10.50 0.0	0.00 0.00
44	No Discharge ----	---- 0.000	N/A 0.0	15.77 ----	10.50 0.0	0.00 0.00
45	No Discharge ----	---- 0.000	N/A 0.0	15.07 ----	10.50 0.0	0.00 0.00
50	No Discharge ----	---- 0.000	N/A 0.0	26.88 ----	7.00 0.0	0.00 0.00
60	No Discharge ----	---- 0.000	N/A 0.0	29.62 ----	4.00 0.0	0.00 0.00
70	No Discharge ----	---- 0.000	N/A 0.0	36.17 ----	0.00 0.0	0.00 0.00
100	No Discharge ----	---- 0.000	N/A 0.0	36.17 ----	0.00 0.0	0.00 0.00



Fire Sprinkler Input Data

Pipe Input Data

Beg. Node	End. Node	Pipe Description	Nominal Diameter (inch)	Type Group	Fitting Data	Nominal Length (feet)	Fitting Length (feet)	Total Length (feet)	CFactor (gpm/inch-psi)
1	2	SCHD 10 STEEL, DRY	1.500	0		13.10	0.00	13.10	100
2	3	SCHD 10 STEEL, DRY	1.500	0		13.10	0.00	13.10	100
3	40	SCHD 10 STEEL, DRY	2.000	0	E	12.00	3.50	15.50	100
4	40	SCHD 10 STEEL, DRY	1.500	0	E	1.10	2.80	3.90	100
5	30	SCHD 10 STEEL, DRY	1.500	0	E	2.40	2.80	5.20	100
6	30	SCHD 10 STEEL, DRY	1.500	0	E	8.00	2.80	10.80	100
7	30	SCHD 10 STEEL, DRY	1.500	0		5.00	0.00	5.00	100
7	31	SCHD 10 STEEL, DRY	2.000	0	E	11.50	3.50	15.00	100
8	31	SCHD 10 STEEL, DRY	1.500	0	E	8.00	2.80	10.80	100
9	41	SCHD 10 STEEL, DRY	2.000	0	E	11.00	3.50	14.50	100
9	31	SCHD 10 STEEL, DRY	2.000	0		1.50	0.00	1.50	100
10	41	SCHD 10 STEEL, DRY	1.500	0	E	1.20	2.80	4.00	100
11	42	SCHD 10 STEEL, DRY	1.500	0	E	1.10	2.80	3.90	100
12	13	SCHD 10 STEEL, DRY	1.500	0	2E	12.50	5.60	18.10	100
13	32	SCHD 10 STEEL, DRY	1.500	0	E	1.60	2.80	4.40	100
14	32	SCHD 10 STEEL, DRY	1.500	0	E	8.20	2.80	11.00	100
15	16	SCHD 10 STEEL, DRY	2.000	0		13.10	0.00	13.10	100
15	32	SCHD 10 STEEL, DRY	2.000	0		12.20	0.00	12.20	100
16	44	SCHD 10 STEEL, DRY	2.000	0	E	1.10	3.50	4.60	100
17	18	SCHD 10 STEEL, DRY	1.500	0	E	13.10	2.80	15.90	100
18	19	SCHD 10 STEEL, DRY	1.500	0		13.10	0.00	13.10	100
19	20	SCHD 10 STEEL, DRY	2.000	0		13.10	0.00	13.10	100
20	45	SCHD 10 STEEL, DRY	2.000	0	E	1.10	3.50	4.60	100
40	41	SCHD 10 STEEL, DRY	2.000	0		9.80	0.00	9.80	100
41	42	SCHD 10 STEEL, DRY	3.000	0		8.40	0.00	8.40	100
42	43	SCHD 10 STEEL, DRY	3.000	0	E	7.00	4.90	11.90	100
43	44	SCHD 10 STEEL, DRY	3.000	0	E	1.70	4.90	6.60	100
43	50	SCHD 10 STEEL, DRY	4.000	0	6E	132.00	42.60	174.60	100



Fire Sprinkler Input Data

Pipe Input Data (cont'd)

Beg. Node	End. Node	Pipe Description	Nominal Diameter (inch)	Type Group	Fitting Data	Nominal Length (feet)	Fitting Length (feet)	Total Length (feet)	CFactor (gpm/inch-psi)
44	45	SCHD 10 STEEL, DRY	2.000	0		9.30	0.00	9.30	100
50	60	SCHD 10 STEEL, DRY	4.000	0	BC	3.00	24.10	27.10	100
60	70	SCHED 10 WET STEEL	4.000	0	4E	75.00	52.00	127.00	120
70	100	Fire Pump, Boost Ignored		Pump					



Fire Sprinkler Output Data

Group Peak Node Groupings Output Data

Pipe Segment Beg. Node	End. Node	Pipe Type Group	Pipe Flow Rate (gpm)	Sprinkler Flow At Beg. Node (gpm)	Non-Sprinkler Flow Out (+) (gpm)	In (-) (gpm)	Beg. Node Residual Pressure (psi)	Imbalance Flow At Beg. Node (gpm)
1	2	0	-19.74	19.74	0.00	0.00	12.42	
2	1	0	19.74	19.92	0.00	0.00	12.66	0.00000
2	3	0	-39.66					
3	2	0	39.66	20.58	0.00	0.00	13.51	0.00000
3	40	0	-60.24					
4	40	0	-21.01	21.01	0.00	0.00	14.08	0.00000
5	30	0	-19.57	19.57	0.00	0.00	12.21	0.00000
6	30	0	-19.49	19.49	0.00	0.00	12.12	0.00000
7	30	0	39.06	19.89	0.00	0.00	12.62	0.00000
7	31	0	-58.96					
8	31	0	-20.21	20.21	0.00	0.00	13.02	0.00000
9	41	0	-99.62	20.45	0.00	0.00	13.33	0.00000
9	31	0	79.17					
10	41	0	-21.53	21.53	0.00	0.00	14.79	0.00000
11	42	0	-21.85	21.85	0.00	0.00	15.23	0.00000
12	13	0	-20.26	20.26	0.00	0.00	13.10	0.00000
13	12	0	20.26	20.53	0.00	0.00	13.43	0.00000
13	32	0	-40.79					
14	32	0	-20.59	20.59	0.00	0.00	13.52	0.00000
15	16	0	-82.53	21.15	0.00	0.00	14.26	0.00000
15	32	0	61.38					
16	15	0	82.53	21.08	0.00	0.00	14.17	0.00000
16	44	0	-103.61					
17	18	0	-20.16	20.16	0.00	0.00	12.96	0.00000
18	17	0	20.16	20.39	0.00	0.00	13.26	0.00000
18	19	0	-40.55					
19	18	0	40.55	21.06	0.00	0.00	14.14	0.00000
19	20	0	-61.61					
20	19	0	61.61	21.48	0.00	0.00	14.72	0.00000
20	45	0	-83.10					
30	5	0	19.57	0.00	0.00	0.00	12.31	0.00000
30	6	0	19.49					
30	7	0	-39.06					
31	7	0	58.96	0.00	0.00	0.00	13.23	0.00000
31	8	0	20.21					



Fire Sprinkler Output Data

Group Peak Node Groupings Output Data

Pipe Segment Beg. Node	End. Node	Pipe Type Group	Pipe Flow Rate (gpm)	Sprinkler Flow At Beg. Node (gpm)	Non-Sprinkler Flow Out (+) (gpm)	In (-) (gpm)	Beg. Node Residual Pressure (psi)	Imbalance Flow At Beg. Node (gpm)
31	9	0	-79.17					
32	13	0	40.79	0.00	0.00	0.00	13.74	0.00000
32	14	0	20.59					
32	15	0	-61.38					
40	3	0	60.24	0.00	0.00	0.00	14.16	0.00000
40	4	0	21.01					
40	41	0	-81.25					
41	9	0	99.62	0.00	0.00	0.00	14.87	0.00000
41	10	0	21.53					
41	40	0	81.25					
41	42	0	-202.40					
42	11	0	21.85	0.00	0.00	0.00	15.31	0.00000
42	41	0	202.40					
42	43	0	-224.26					
43	42	0	224.26	0.00	0.00	0.00	16.07	0.00000
43	44	0	186.71					
43	50	0	-410.96					
44	16	0	103.61	0.00	0.00	0.00	15.77	0.00000
44	43	0	-186.71					
44	45	0	83.10					
45	20	0	83.10	0.00	0.00	0.00	15.07	0.00000
45	44	0	-83.10					
50	43	0	410.96	0.00	0.00	0.00	26.88	0.00000
50	60	0	-410.96					
60	50	0	410.96	0.00	0.00	0.00	29.62	0.00000
60	70	0	-410.96					
70	60	0	410.96	0.00	0.00	0.00	36.17	0.00566
70	100	0	-410.97					
100	70	0	410.97	0.00	0.00	-410.97	36.17	



Fire Sprinkler Output Data

Group Peak Pipe Output Data

Beg. End. Node	Nodal KFactor (K)	Elevation (feet)	Spk/Hose Discharge (gpm)	Residual Pressure (psi)	Nom. Dia. Inside Dia. C-Value	q (gpm) Q (gpm) Velocity (fps)	F. L./ft (psi/ft) Fittings Type-Grp	Pipe-Len. Fit-Len. Tot-Len. (ft)	PF-(psi) PE-(psi) PT-(psi)
1	5.60	10.50	19.74	12.42	1.50	19.74	0.01786	13.10	0.234
2	5.60	10.50	19.92	12.66	1.682	19.74	----	0.00	0.000
	SCHD 10 STEEL, DRY				100	2.85	0	13.10	0.234
2	5.60	10.50	19.92	12.66	1.50	19.92	0.06494	13.10	0.851
3	5.60	10.50	20.58	13.51	1.682	39.66	----	0.00	0.000
	SCHD 10 STEEL, DRY				100	5.73	0	13.10	0.851
7	5.60	10.50	19.89	12.62	1.50	0.00	0.06315	5.00	0.316
30	0.00	10.50	0.00	12.31	1.682	39.06	----	0.00	0.000
	SCHD 10 STEEL, DRY				100	5.64	0	5.00	0.316
9	5.60	10.50	20.45	13.33	2.00	0.00	0.06948	1.50	0.104
31	0.00	10.50	0.00	13.23	2.157	79.17	----	0.00	0.000
	SCHD 10 STEEL, DRY				100	6.95	0	1.50	0.104
12	5.60	10.50	20.26	13.10	1.50	20.26	0.01875	12.50	0.339
13	5.60	10.50	20.53	13.43	1.682	20.26	2E	5.60	0.000
	SCHD 10 STEEL, DRY				100	2.93	0	18.10	0.339
15	5.60	10.50	21.15	14.26	2.00	0.00	0.04339	12.20	0.529
32	0.00	10.50	0.00	13.74	2.157	61.38	----	0.00	0.000
	SCHD 10 STEEL, DRY				100	5.39	0	12.20	0.529
15	5.60	10.50	21.15	14.26	2.00	21.15	0.07505	13.10	0.983
16	5.60	13.00	21.08	14.17	2.157	82.53	----	0.00	-1.083
	SCHD 10 STEEL, DRY				100	7.25	0	13.10	-0.099
17	5.60	10.50	20.16	12.96	1.50	20.16	0.01858	13.10	0.295
18	5.60	10.50	20.39	13.26	1.682	20.16	E	2.80	0.000
	SCHD 10 STEEL, DRY				100	2.91	0	15.90	0.295
18	5.60	10.50	20.39	13.26	1.50	20.39	0.06768	13.10	0.887
19	5.60	10.50	21.06	14.14	1.682	40.55	----	0.00	0.000
	SCHD 10 STEEL, DRY				100	5.86	0	13.10	0.887
19	5.60	10.50	21.06	14.14	2.00	21.06	0.04370	13.10	0.572
20	5.60	10.50	21.48	14.72	2.157	61.61	----	0.00	0.000
	SCHD 10 STEEL, DRY				100	5.41	0	13.10	0.572
5	5.60	10.50	19.57	12.21	1.50	19.57	0.01758	2.40	0.091
30	0.00	10.50	0.00	12.31	1.682	19.57	E	2.80	0.000
	SCHD 10 STEEL, DRY				100	2.83	0	5.20	0.091
6	5.60	10.50	19.49	12.12	1.50	19.49	0.01745	8.00	0.188
30	0.00	10.50	0.00	12.31	1.682	19.49	E	2.80	0.000
	SCHD 10 STEEL, DRY				100	2.81	0	10.80	0.188
7	5.60	10.50	19.89	12.62	2.00	19.89	0.04028	11.50	0.604
31	0.00	10.50	0.00	13.23	2.157	58.96	E	3.50	0.000
	SCHD 10 STEEL, DRY				100	5.18	0	15.00	0.604



Fire Sprinkler Output Data

Group Peak Pipe Output Data

Beg. End. Node	Nodal KFactor (K)	Elevation (feet)	Spk/Hose Discharge (gpm)	Residual Pressure (psi)	Nom. Dia. Inside Dia. C-Value	q (gpm) Q (gpm) Velocity (fps)	F. L./ft (psi/ft) Fittings Type-Grp	Pipe-Len. Fit-Len. Tot-Len. (ft)	PF-(psi) PE-(psi) PT-(psi)
8	5.60	10.50	20.21	13.02	1.50	20.21	0.01866	8.00	0.201
31	0.00	10.50	0.00	13.23	1.682	20.21	E	2.80	0.000
	SCHD 10 STEEL, DRY				100	2.92	0	10.80	0.201
13	5.60	10.50	20.53	13.43	1.50	20.53	0.06841	1.60	0.301
32	0.00	10.50	0.00	13.74	1.682	40.79	E	2.80	0.000
	SCHD 10 STEEL, DRY				100	5.89	0	4.40	0.301
14	5.60	10.50	20.59	13.52	1.50	20.59	0.01932	8.20	0.212
32	0.00	10.50	0.00	13.74	1.682	20.59	E	2.80	0.000
	SCHD 10 STEEL, DRY				100	2.97	0	11.00	0.212
3	5.60	10.50	20.58	13.51	2.00	20.58	0.04191	12.00	0.650
40	0.00	10.50	0.00	14.16	2.157	60.24	E	3.50	0.000
	SCHD 10 STEEL, DRY				100	5.29	0	15.50	0.650
4	5.60	10.50	21.01	14.08	1.50	21.01	0.02005	1.10	0.078
40	0.00	10.50	0.00	14.16	1.682	21.01	E	2.80	0.000
	SCHD 10 STEEL, DRY				100	3.03	0	3.90	0.078
9	5.60	10.50	20.45	13.33	2.00	20.45	0.10628	11.00	1.541
41	0.00	10.50	0.00	14.87	2.157	99.62	E	3.50	0.000
	SCHD 10 STEEL, DRY				100	8.75	0	14.50	1.541
10	5.60	10.50	21.53	14.79	1.50	21.53	0.02098	1.20	0.084
41	0.00	10.50	0.00	14.87	1.682	21.53	E	2.80	0.000
	SCHD 10 STEEL, DRY				100	3.11	0	4.00	0.084
40	0.00	10.50	0.00	14.16	2.00	0.00	0.07290	9.80	0.714
41	0.00	10.50	0.00	14.87	2.157	81.25	----	0.00	0.000
	SCHD 10 STEEL, DRY				100	7.13	0	9.80	0.714
11	5.60	10.50	21.85	15.23	1.50	21.85	0.02156	1.10	0.084
42	0.00	10.50	0.00	15.31	1.682	21.85	E	2.80	0.000
	SCHD 10 STEEL, DRY				100	3.16	0	3.90	0.084
41	0.00	10.50	0.00	14.87	3.00	0.00	0.05279	8.40	0.443
42	0.00	10.50	0.00	15.31	3.260	202.40	----	0.00	0.000
	SCHD 10 STEEL, DRY				100	7.78	0	8.40	0.443
42	0.00	10.50	0.00	15.31	3.00	0.00	0.06382	7.00	0.759
43	0.00	10.50	0.00	16.07	3.260	224.26	E	4.90	0.000
	SCHD 10 STEEL, DRY				100	8.62	0	11.90	0.759
43	0.00	10.50	0.00	16.07	3.00	0.00	0.04547	1.70	0.300
44	0.00	10.50	0.00	15.77	3.260	186.71	E	4.90	0.000
	SCHD 10 STEEL, DRY				100	7.18	0	6.60	0.300
16	5.60	13.00	21.08	14.17	2.00	21.08	0.11431	1.10	0.526
44	0.00	10.50	0.00	15.77	2.157	103.61	E	3.50	1.083
	SCHD 10 STEEL, DRY				100	9.10	0	4.60	1.608



Fire Sprinkler Output Data

Group Peak Pipe Output Data

Beg. End. Node	Nodal KFactor (K)	Elevation (feet)	Spk/Hose Discharge (gpm)	Residual Pressure (psi)	Nom. Dia. Inside Dia. C-Value	q (gpm) Q (gpm) Velocity (fps)	F. L./ft (psi/ft) Fittings Type-Grp	Pipe-Len. Fit-Len. Tot-Len. (ft)	PF-(psi) PE-(psi) PT-(psi)
44	0.00	10.50	0.00	15.77	2.00	0.00	0.07600	9.30	0.707
45	0.00	10.50	0.00	15.07	2.157	83.10	-----	0.00	0.000
SCHD 10 STEEL, DRY					100	7.30	0	9.30	0.707
20	5.60	10.50	21.48	14.72	2.00	21.48	0.07600	1.10	0.350
45	0.00	10.50	0.00	15.07	2.157	83.10	E	3.50	0.000
SCHD 10 STEEL, DRY					100	7.30	0	4.60	0.350
43	0.00	10.50	0.00	16.07	4.00	0.00	0.05319	132.00	9.287
50	0.00	7.00	0.00	26.88	4.260	410.96	6E	42.60	1.516
SCHD 10 STEEL, DRY					100	9.25	0	174.60	10.802
50	0.00	7.00	0.00	26.88	4.00	0.00	0.05319	3.00	1.441
60	0.00	4.00	0.00	29.62	4.260	410.96	BC	24.10	1.299
SCHD 10 STEEL, DRY					100	9.25	0	27.10	2.740
60	0.00	4.00	0.00	29.62	4.00	0.00	0.03796	75.00	4.821
70	0.00	0.00	0.00	36.17	4.260	410.96	4E	52.00	1.732
SCHED 10 WET STEEL					120	9.25	0	127.00	6.553
70	Fire Pump, Boost Ignored	0.00		36.17		410.96			
100		0.00		36.17					



Fire Sprinkler Output Data

Group Peak Sprinkler Output Data

Flowing Sprinkler Node No.	Area Group Code	Sprinkler KFactor (K)	Sprinkler Elevation (feet)	Residual Pressure (psi)	Flowing Area (ft²)	Flowing Density (gpm/ft²)	Sprinkler Discharge (gpm)
1		5.60	10.50	12.42	130.00	0.152	19.74
Sub Totals For Non-Group					130.00	0.152	19.74
2		5.60	10.50	12.66	130.00	0.153	19.92
Sub Totals For Non-Group					130.00	0.153	19.92
3		5.60	10.50	13.51	130.00	0.158	20.58
Sub Totals For Non-Group					130.00	0.158	20.58
4		5.60	10.50	14.08	130.00	0.162	21.01
Sub Totals For Non-Group					130.00	0.162	21.01
5		5.60	10.50	12.21	130.00	0.151	19.57
Sub Totals For Non-Group					130.00	0.151	19.57
6		5.60	10.50	12.12	130.00	0.150	19.49
Sub Totals For Non-Group					130.00	0.150	19.49
7		5.60	10.50	12.62	130.00	0.153	19.89
Sub Totals For Non-Group					130.00	0.153	19.89
8		5.60	10.50	13.02	130.00	0.155	20.21
Sub Totals For Non-Group					130.00	0.155	20.21
9		5.60	10.50	13.33	130.00	0.157	20.45
Sub Totals For Non-Group					130.00	0.157	20.45
10		5.60	10.50	14.79	130.00	0.166	21.53
Sub Totals For Non-Group					130.00	0.166	21.53
11		5.60	10.50	15.23	120.00	0.182	21.85
Sub Totals For Non-Group					120.00	0.182	21.85
12		5.60	10.50	13.10	130.00	0.156	20.26
Sub Totals For Non-Group					130.00	0.156	20.26
13		5.60	10.50	13.43	130.00	0.158	20.53
Sub Totals For Non-Group					130.00	0.158	20.53
14		5.60	10.50	13.52	130.00	0.158	20.59
Sub Totals For Non-Group					130.00	0.158	20.59
15		5.60	10.50	14.26	130.00	0.163	21.15
Sub Totals For Non-Group					130.00	0.163	21.15
16		5.60	13.00	14.17	95.00	0.222	21.08
Sub Totals For Non-Group					95.00	0.222	21.08
17		5.60	10.50	12.96	130.00	0.155	20.16
Sub Totals For Non-Group					130.00	0.155	20.16
18		5.60	10.50	13.26	130.00	0.157	20.39
Sub Totals For Non-Group					130.00	0.157	20.39
19		5.60	10.50	14.14	130.00	0.162	21.06
Sub Totals For Non-Group					130.00	0.162	21.06

Fire Sprinkler Output Data

Group Peak Sprinkler Output Data

Flowing Sprinkler Node No.	Area Group Code	Sprinkler KFactor (K)	Sprinkler Elevation (feet)	Residual Pressure (psi)	Flowing Area (ft²)	Flowing Density (gpm/ft²)	Sprinkler Discharge (gpm)
20		5.60	10.50	14.72	130.00	0.165	21.48
Sub Totals For Non-Group					130.00	0.165	21.48
Totals For All Groups					2555.00	0.161	410.96



Fire Sprinkler Output Summary

Hydraulically Most Demanding Sprinkler Node

HMD Sprinkler Node Number:	6
HMD Actual Residual Pressure:	12.12 psi
HMD Actual Flow:	19.49 gpm

Sprinkler Summary

Sprinkler System Type:	
Specified Area Of Application:	1950.00 ft ²
Minimum Desired Density:	0.150 gpm/ft ²
Application Average Density:	0.211 gpm/ft ²
Application Average Area Per Sprinkler:	97.50 ft ²
Sprinkler Flow:	410.96 gpm
Average Sprinkler Flow:	20.55 gpm

Flow Velocity And Imbalance Summary


Maximum Flow Velocity (In Pipe 50 - 60)	9.25 ft/sec
Maximum Velocity Pressure (In Pipe 50 - 60)	0.58 psi
Allowable Maximum Nodal Pressure Imbalance:	0.0100 psi
Actual Maximum Nodal Pressure Imbalance:	0.0000 psi
Actual Average Nodal Pressure Imbalance:	0.0000 psi
Actual Maximum Nodal Flow Imbalance:	0.0057 gpm
Actual Average Nodal Flow Imbalance:	0.0002 gpm

Overall Network Summary

Number Of Unique Pipe Sections:	32
Number Of Flowing Sprinklers:	20
Pipe System Water Volume:	192.79 gal
Sprinkler Flow:	410.96 gpm
Non-Sprinkler Flow:	0.00 gpm
Minimum Required Residual Pressure At System Inflow Node:	36.17 psi
Demand Flow At System Inflow Node:	410.96 gpm

Fire Sprinkler Output Data

Hydraulic Supply/Demand Graph

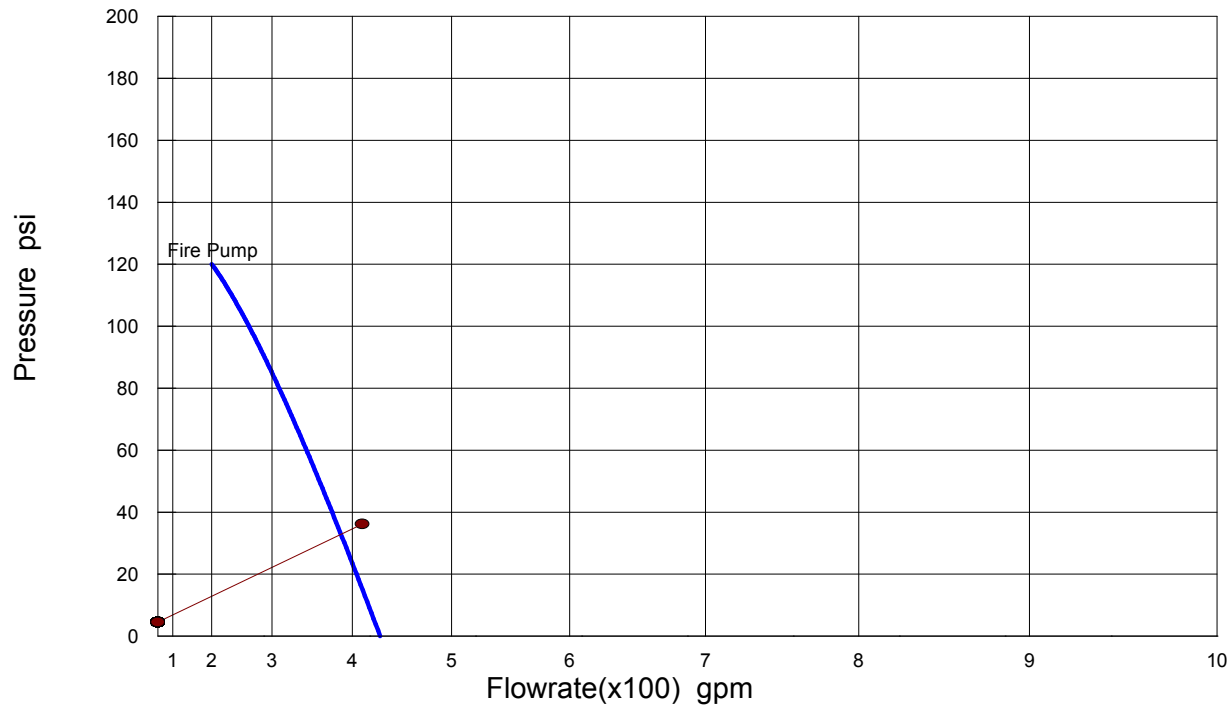

Pump Curve Data (BEIT HAYOT)

Flow (gpm) 1:	430.00	Pressure (psi) 1:	0.00
Flow (gpm) 2:	310.00	Pressure (psi) 2:	80.00
Flow (gpm) 3:	200.00	Pressure (psi) 3:	120.00
Flow (gpm) 4:	0.00	Pressure (psi) 4:	0.00
Flow (gpm) 5:	0.00	Pressure (psi) 5:	0.00

Demand Curve Data

Calculated Residual Pressure: 36.17 psi
Calculated Flow Rate: 410.96 gpm
Pressure Required For First Sprinkler Downstream From Inflow Node To Flow: 4.55 psi