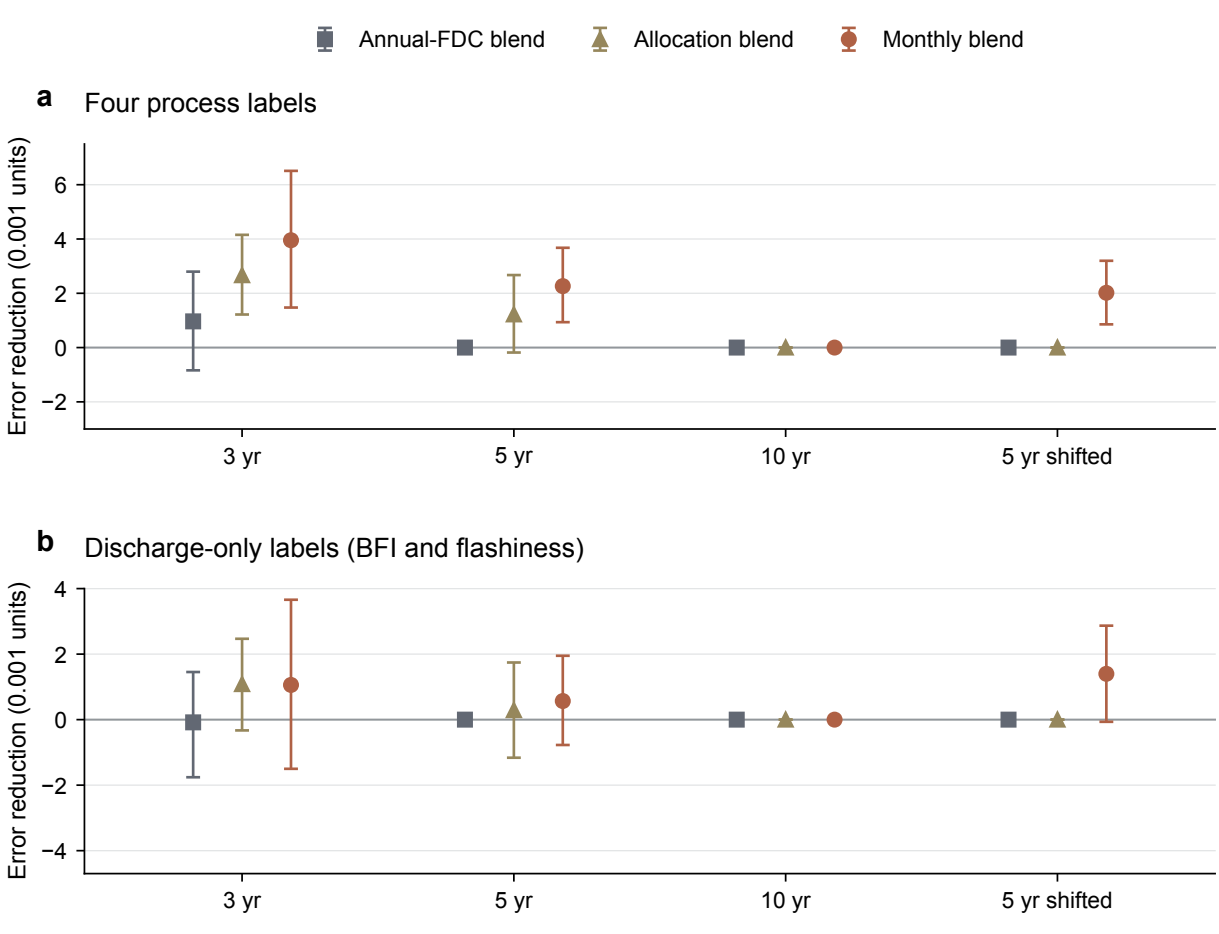
Annual-FDC blend
Allocation blend
Monthly blend
a
Four process labels
Error reduction (0.001 units)
6
4
2
0
−2
3 yr
5 yr
10 yr
5 yr shifted
b
Discharge-only labels (BFI and flashiness)
Error reduction (0.001 units)
4
2
0
−2
−4
3 yr
5 yr
10 yr
5 yr shifted