


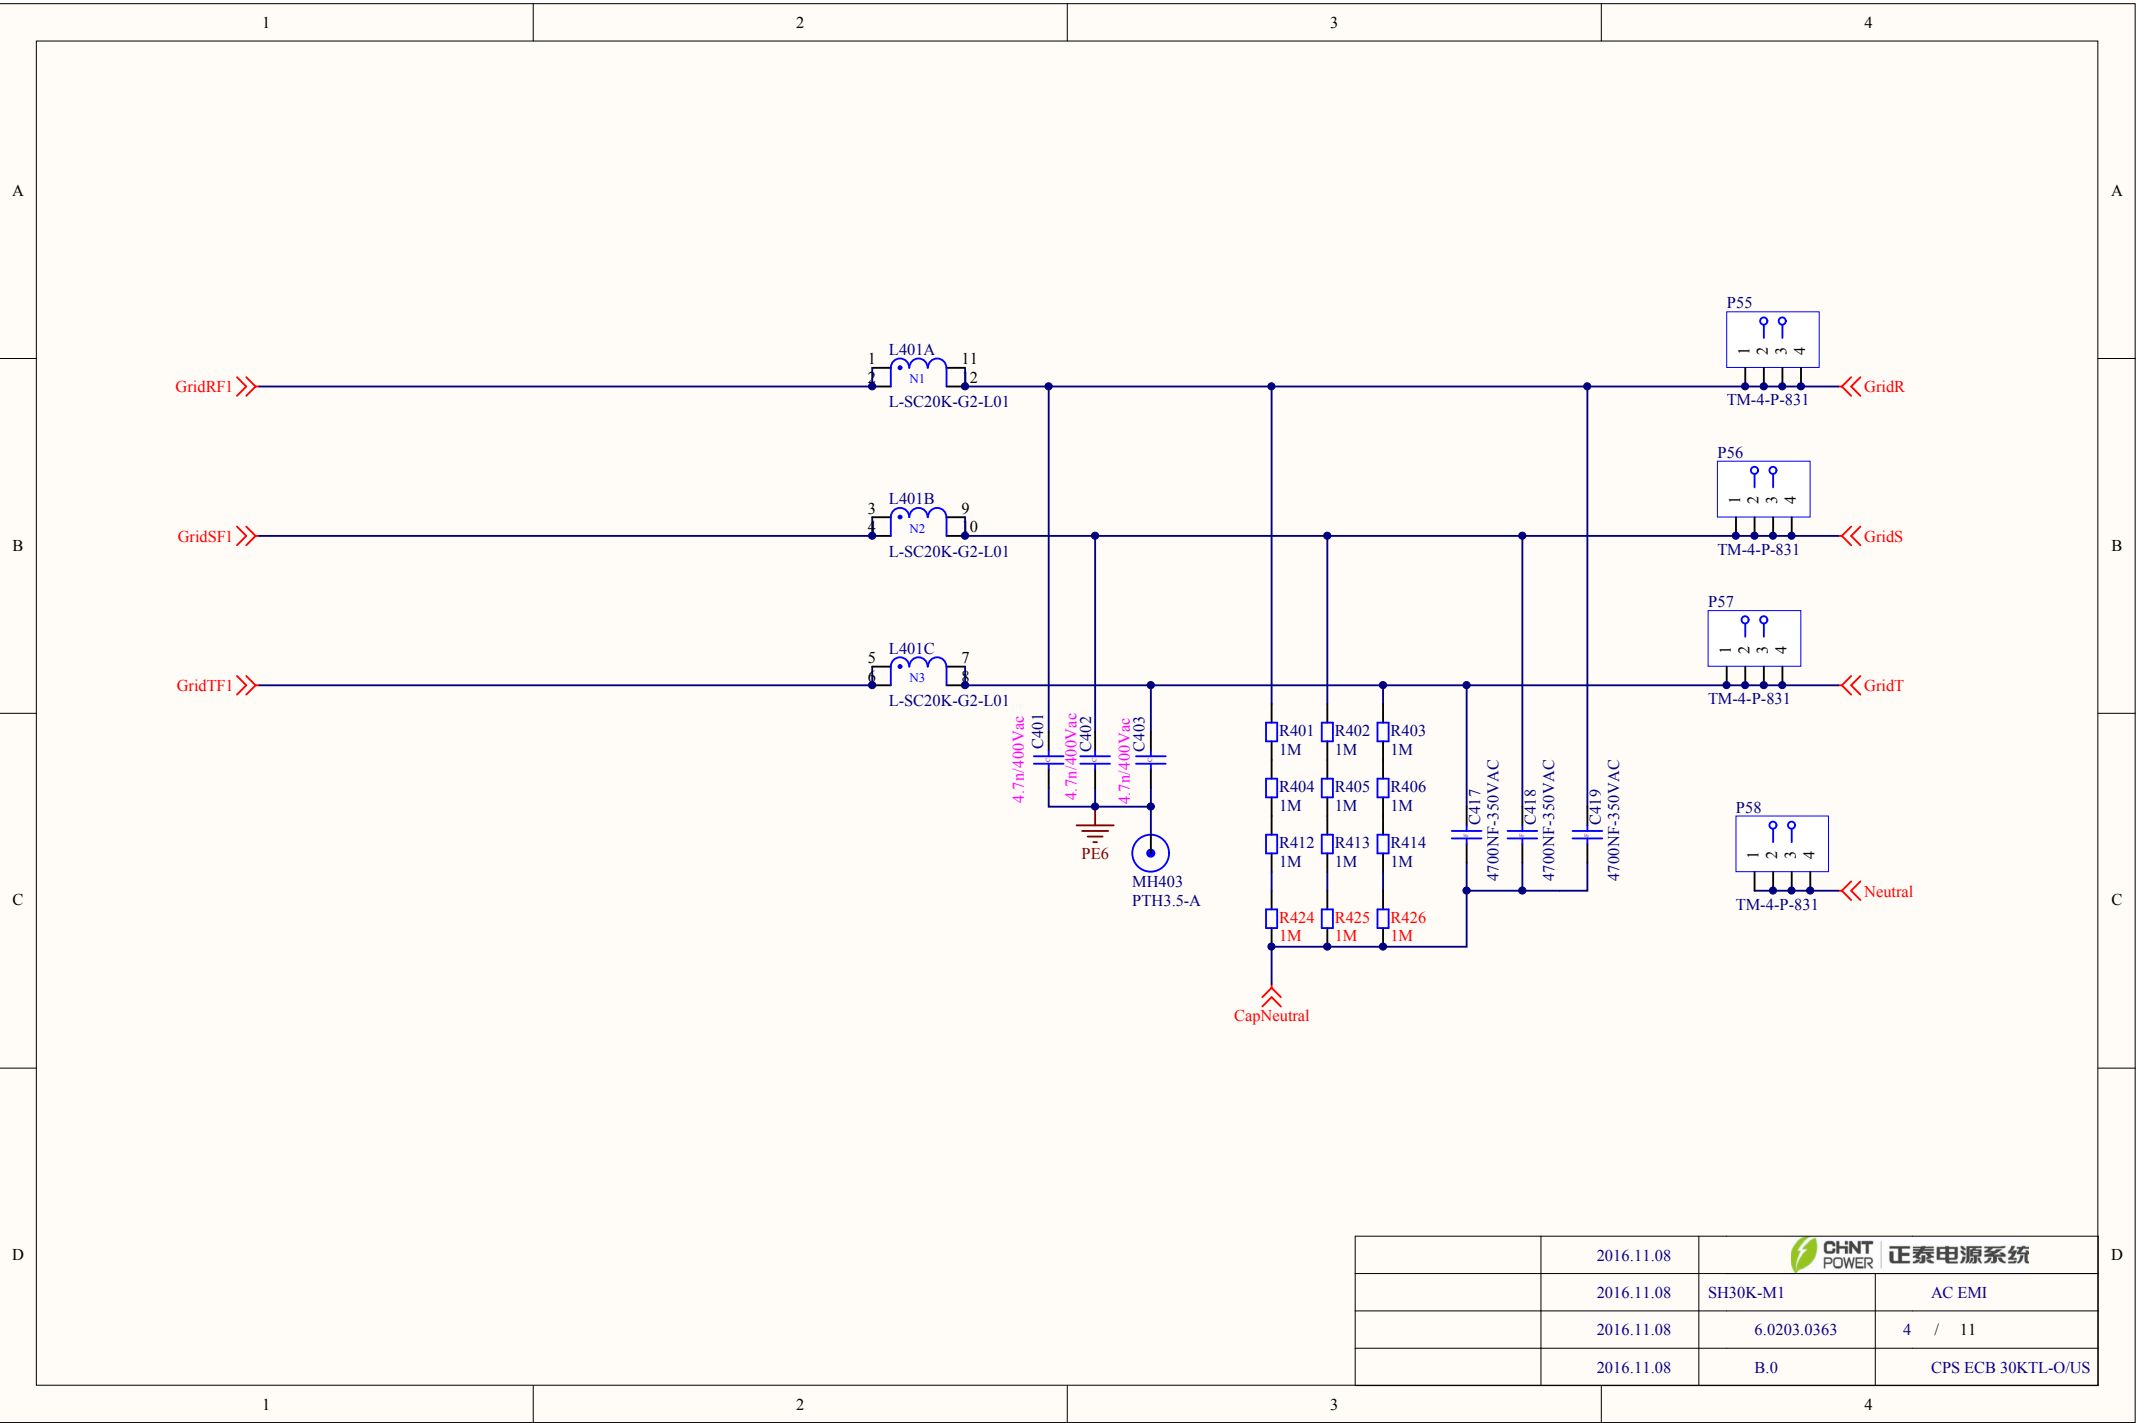
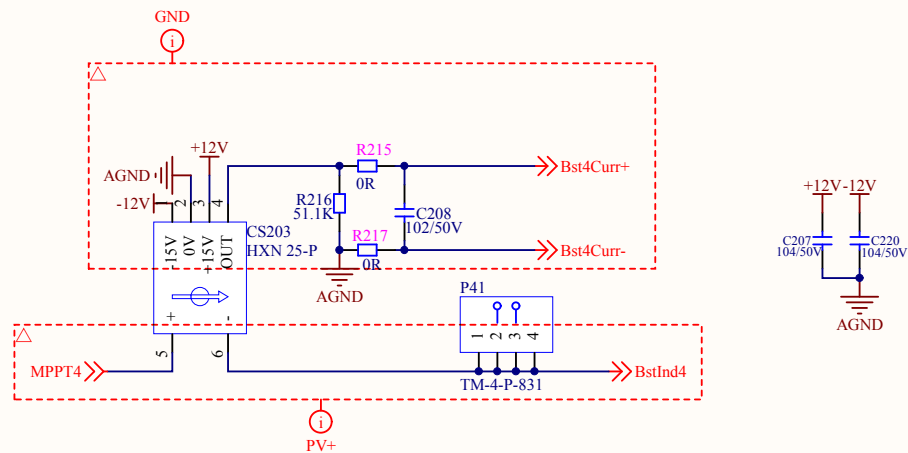
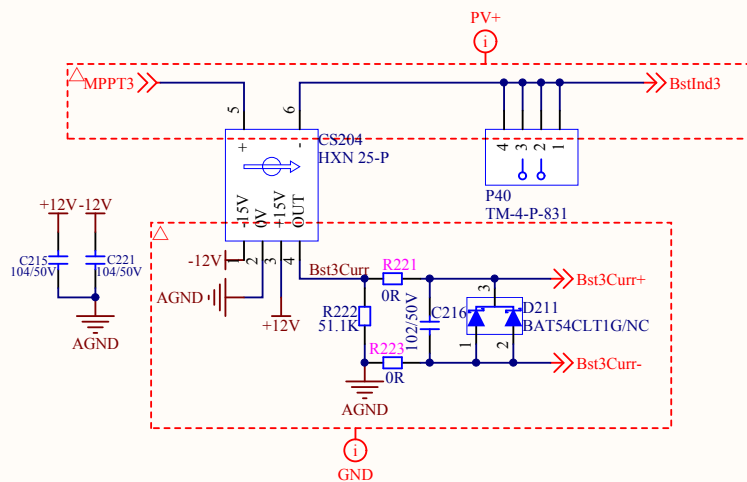
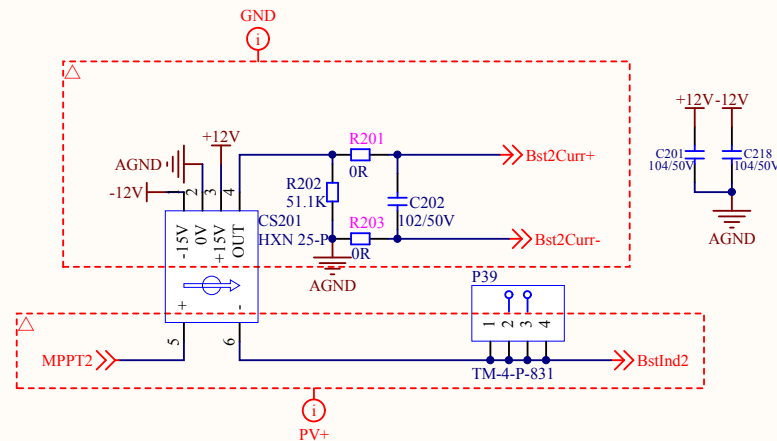


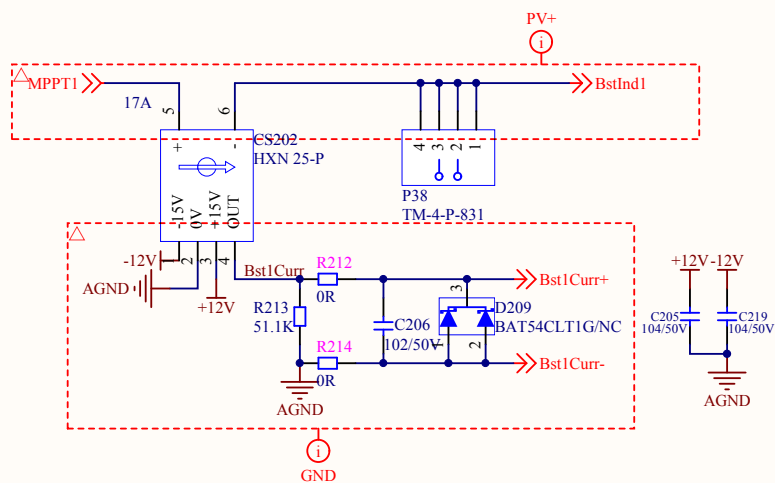





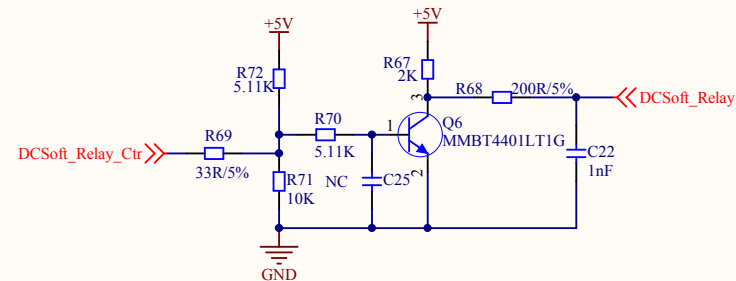


	2016.11.08	CHNT POWER 正泰电源系统	
	2016.11.08	SH30K-M1	Bypass Realy
	2016.11.08	6.0203.0363	2 / 11
	2016.11.08	B.0	CPS ECB 30KTL-O/US

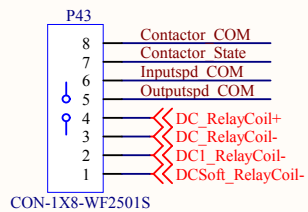


	2016.11.08	 正泰电源系统
	2016.11.08	SH30K-M1 Connect Port
	2016.11.08	6.0203.0363 11 / 11
	2016.11.08	B.0 CPS ECB 30KTL-O/US

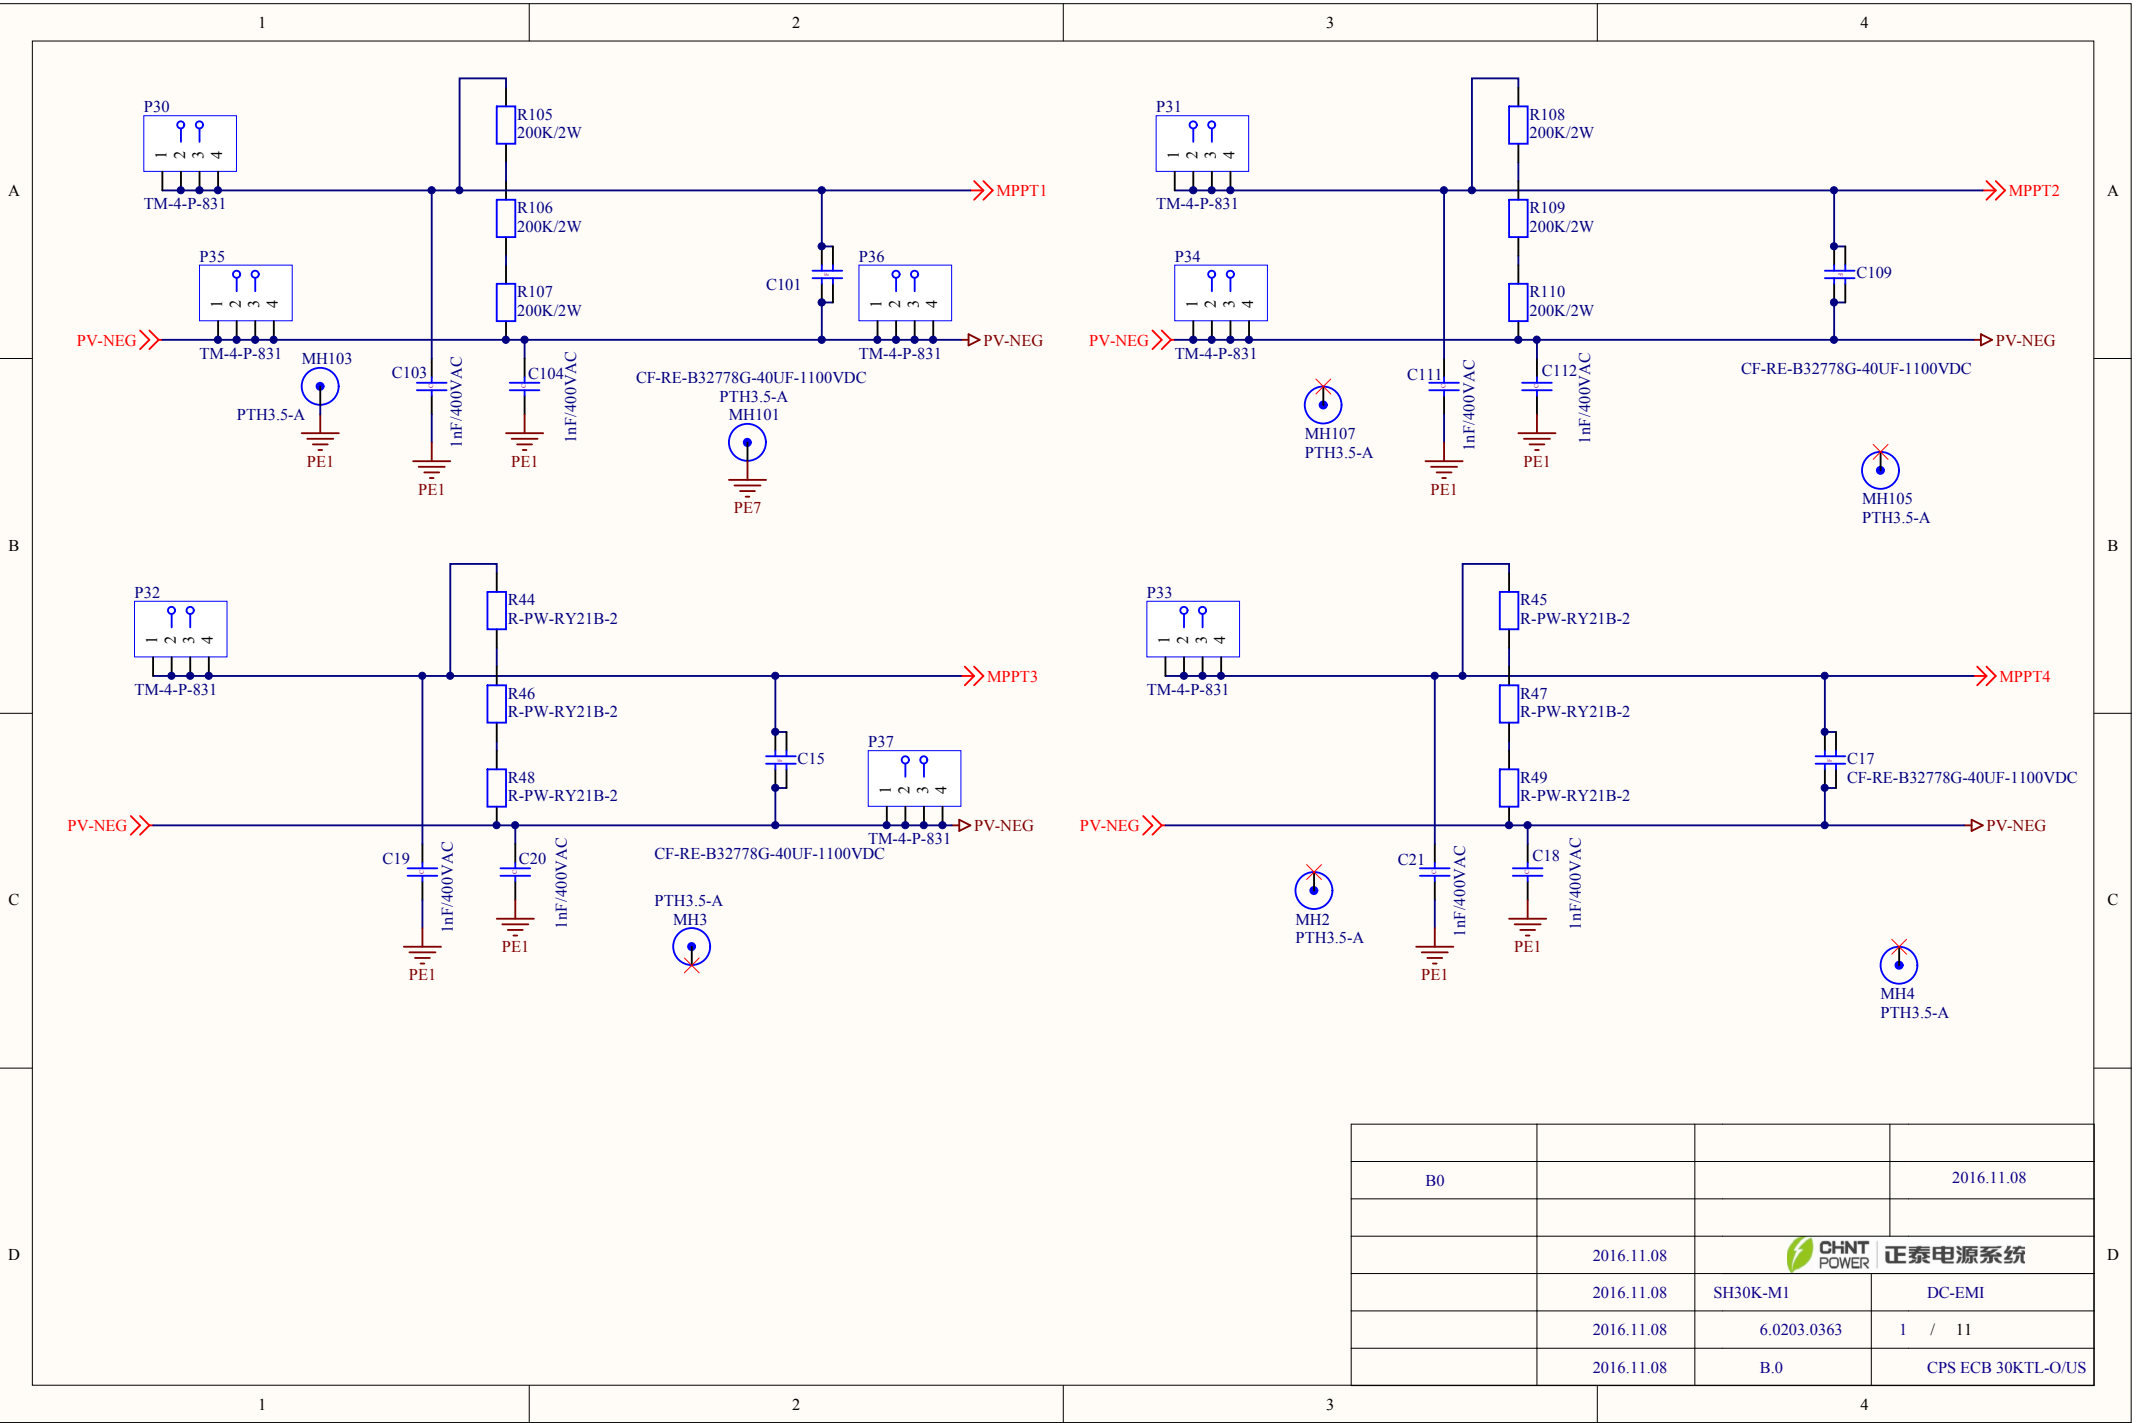

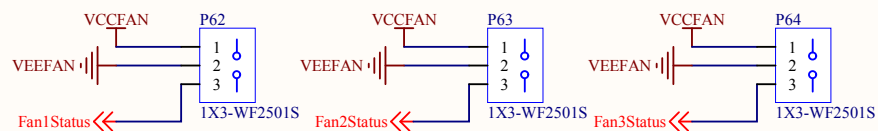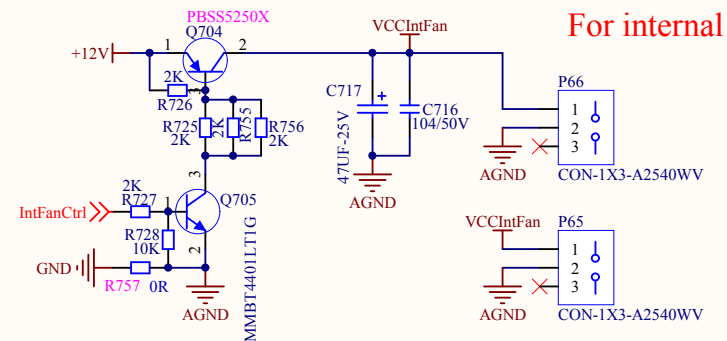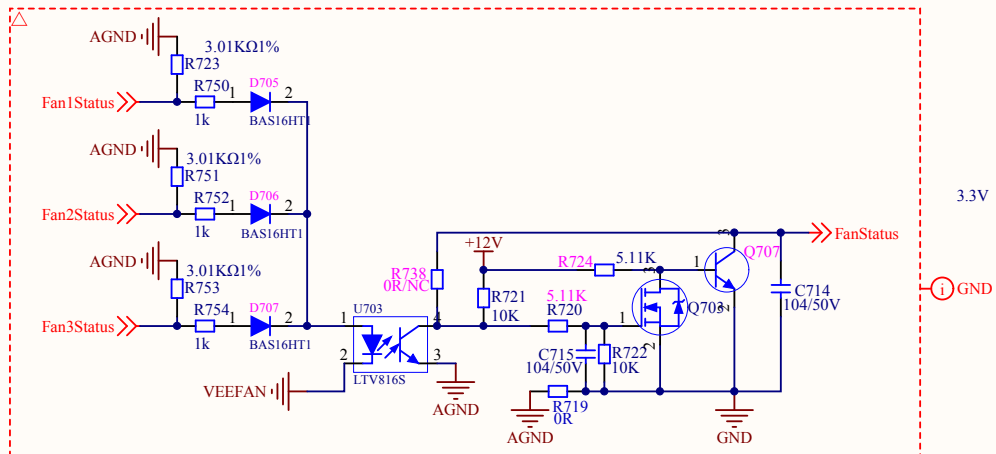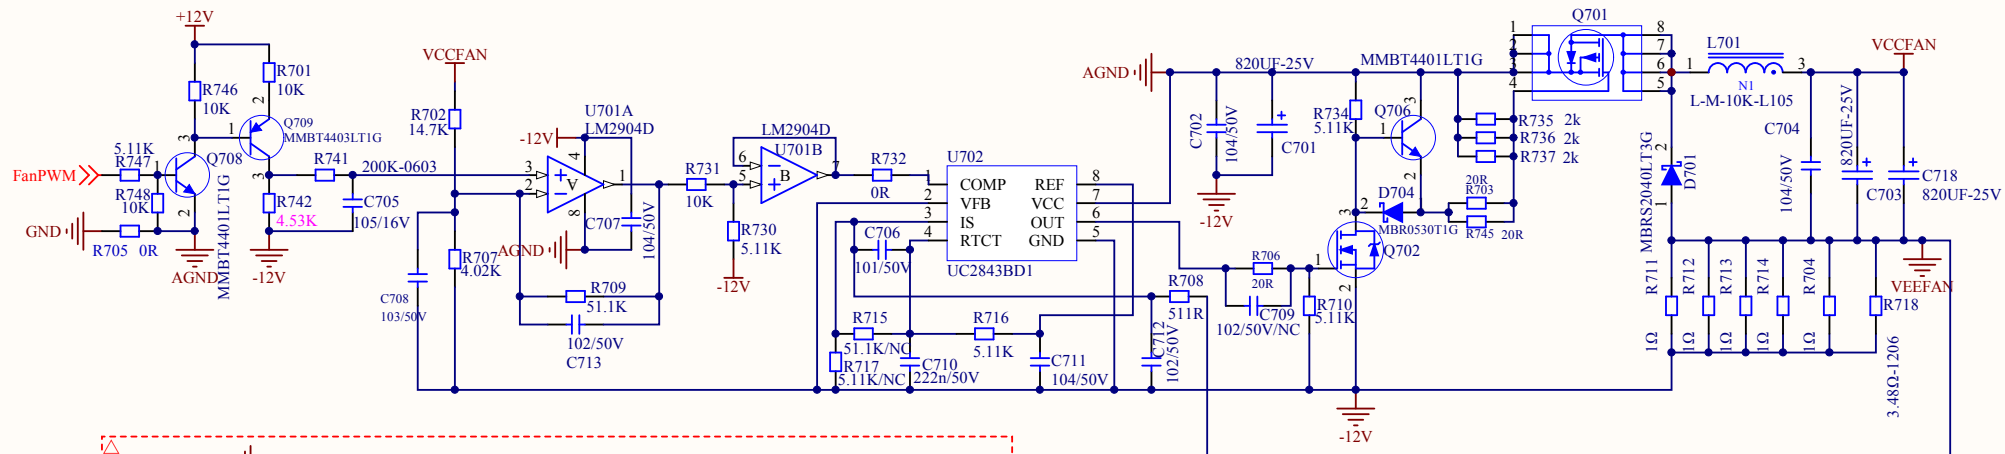

	2016.11.08	CHNT POWER 正泰电源系统	
	2016.11.08	SH30K-M1	Fan control
	2016.11.08	6.0203.0363	7 / 11
	2016.11.08	B.0	CPS ECB 30KTL-O/US

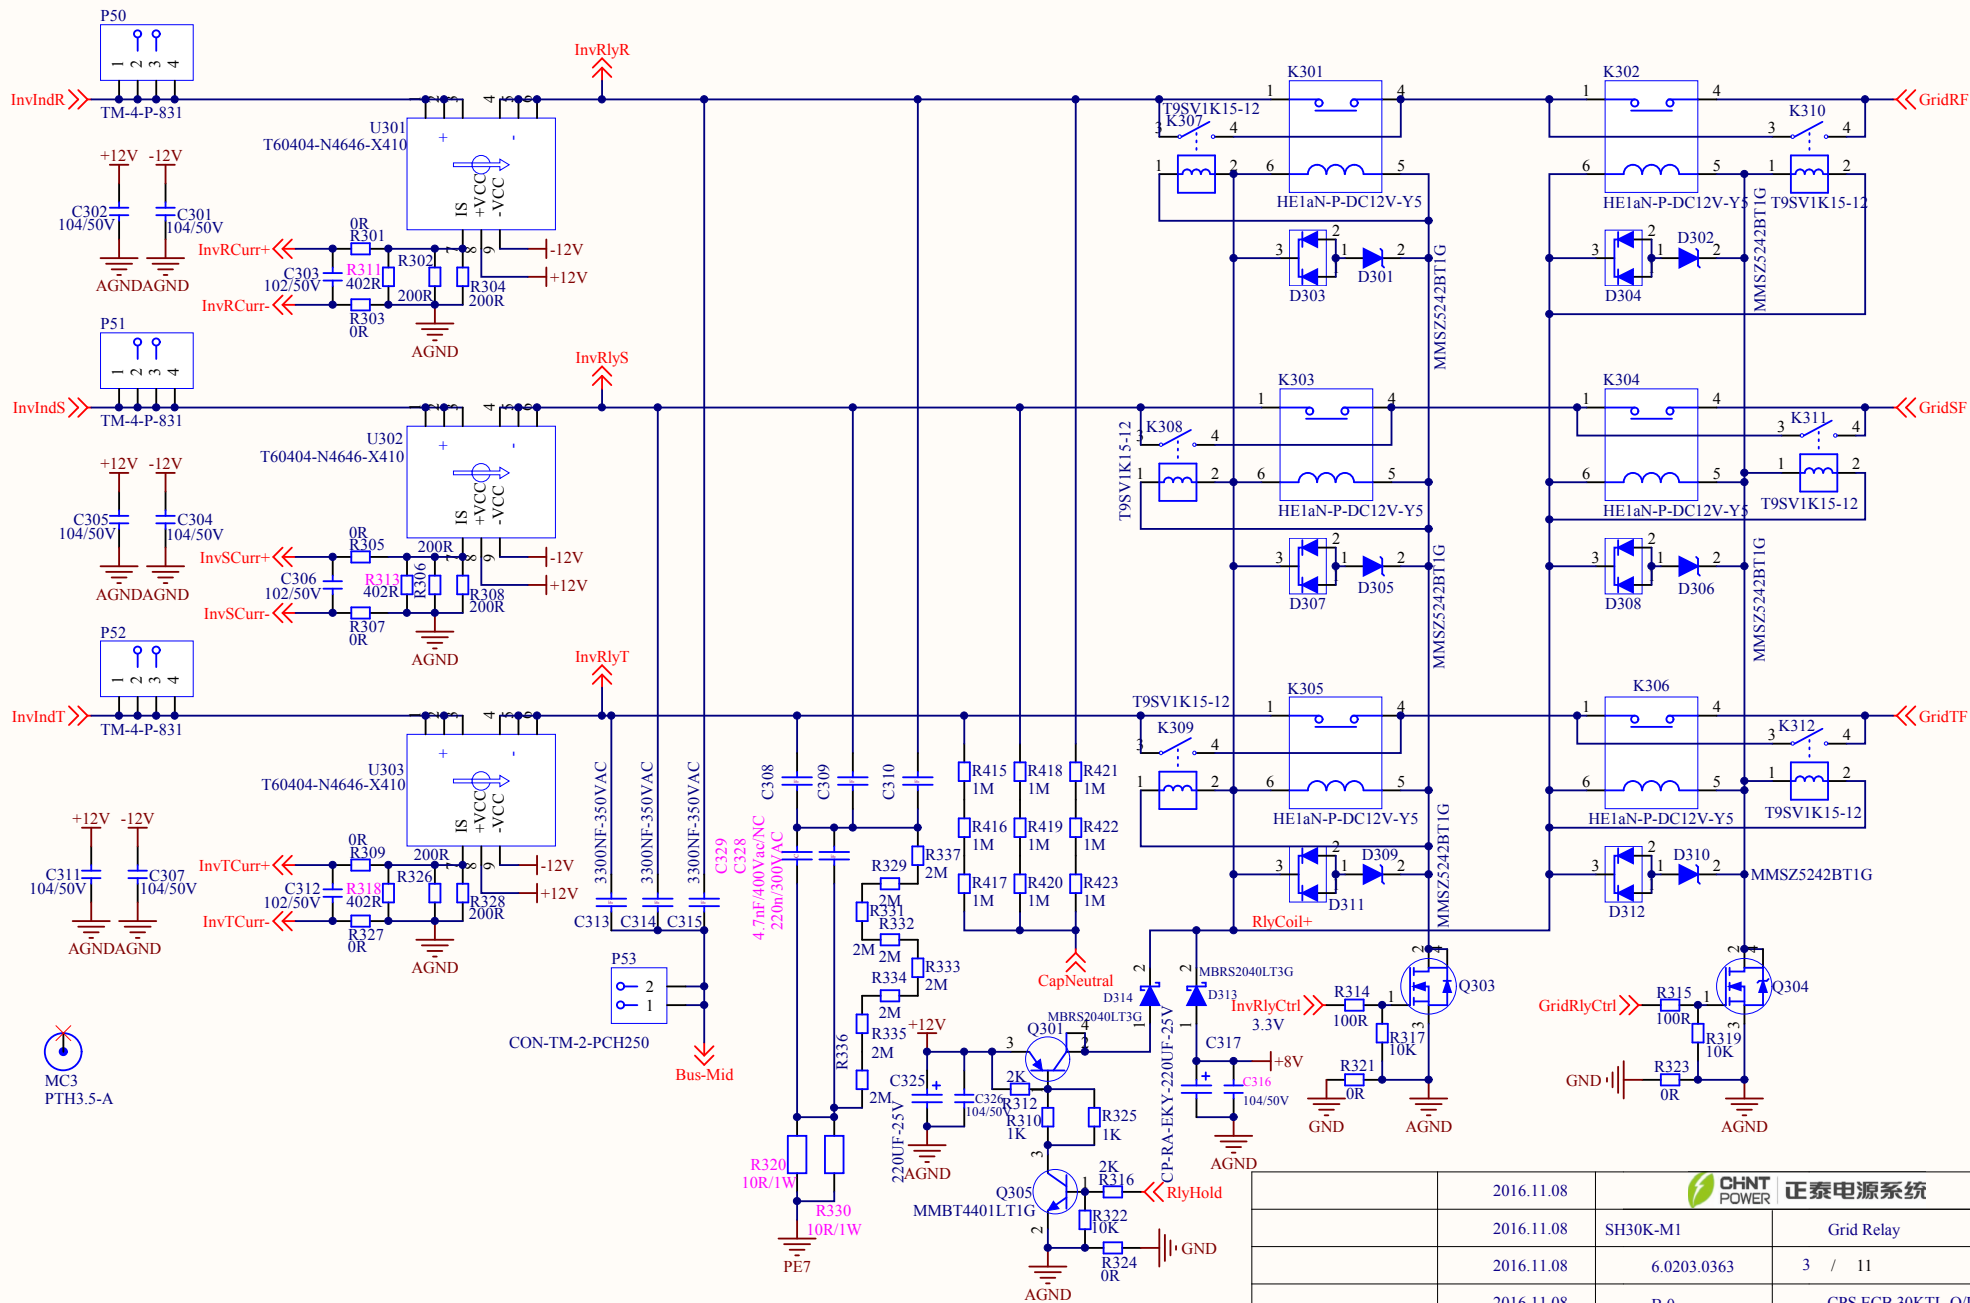


A

B

C

D

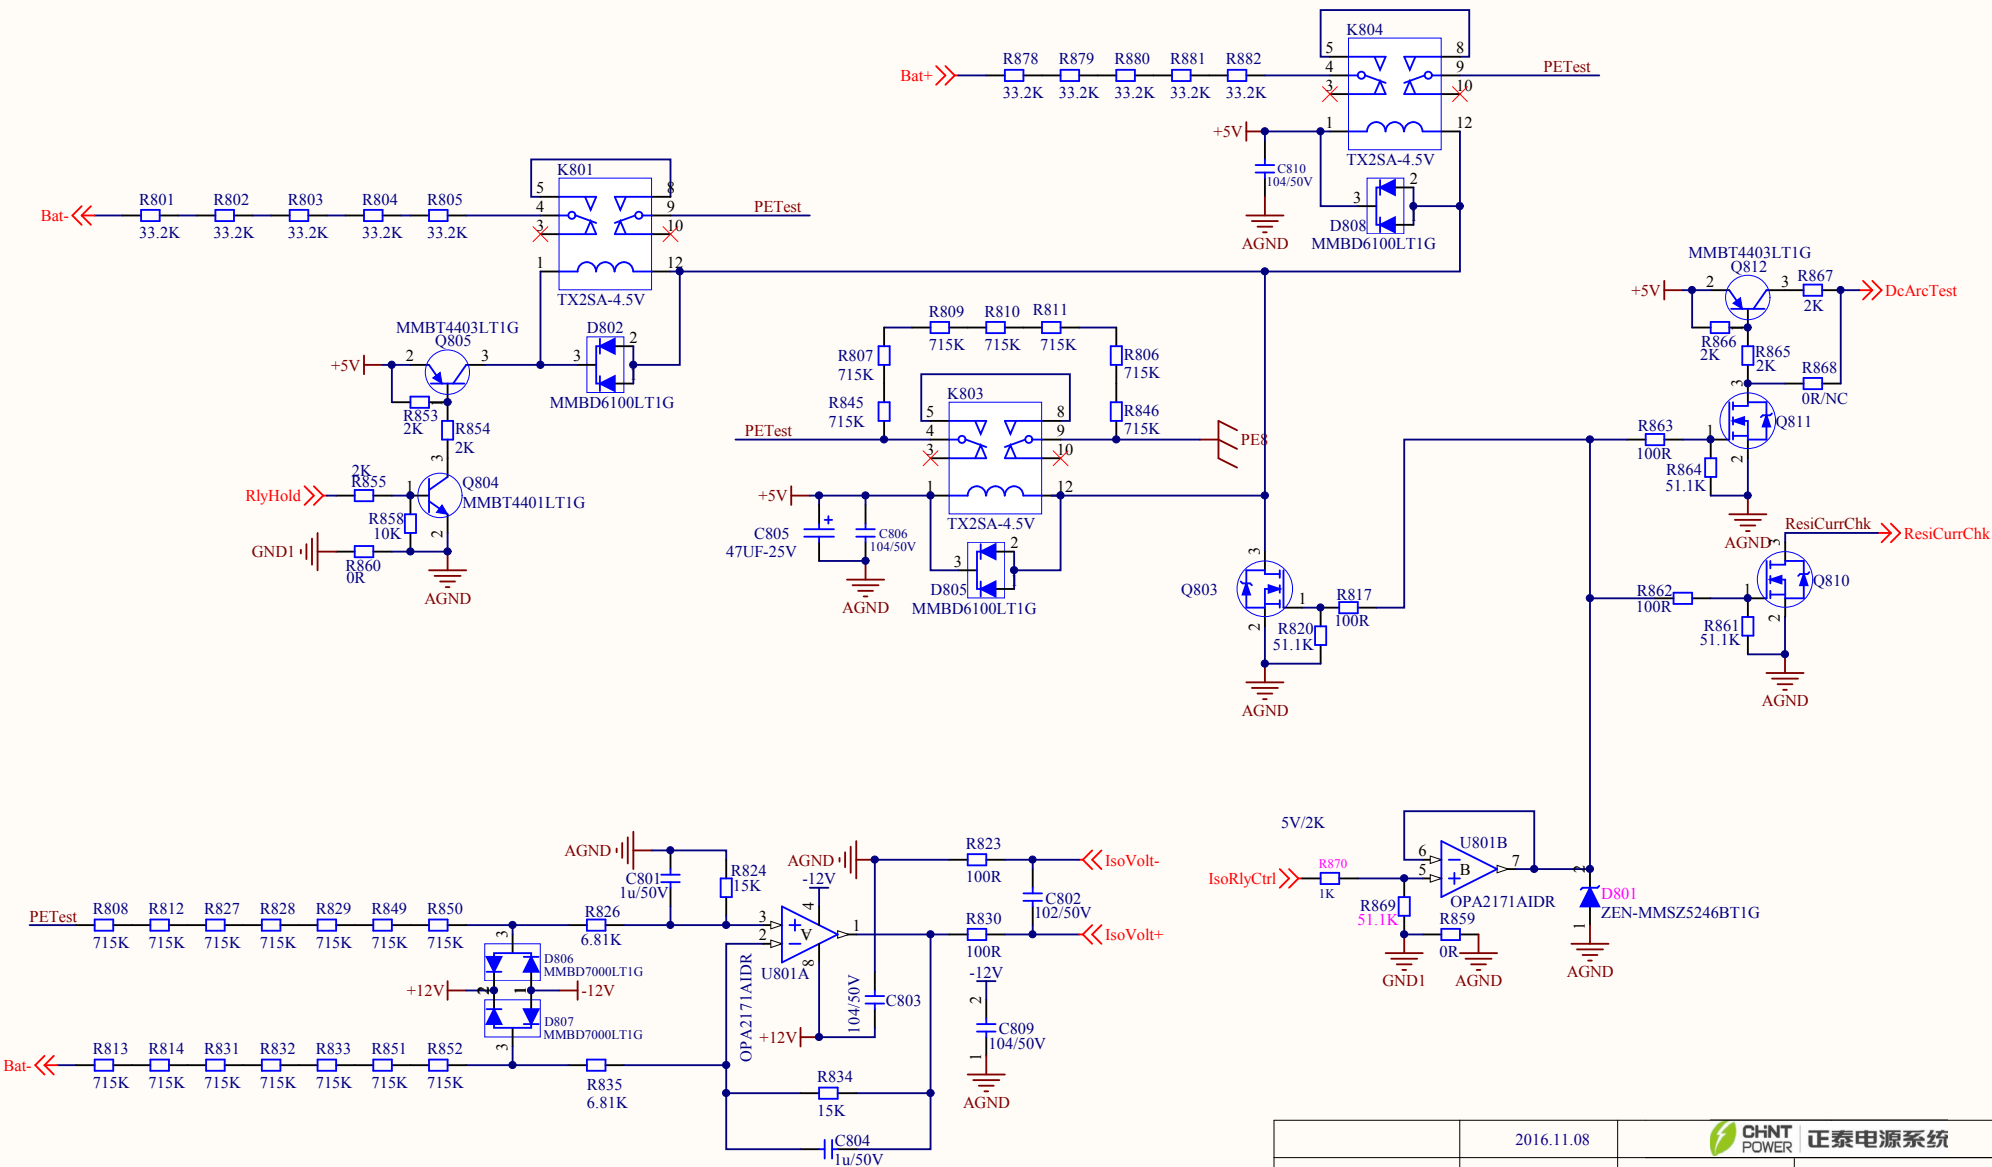


	2016.11.08	 正泰电源系统	
	2016.11.08	SH30K-M1	ISO Check
	2016.11.08	6.0203.0363	8 / 11
	2016.11.08	B.0	CPS ECB 30KTL-O/US


A

B

C

D

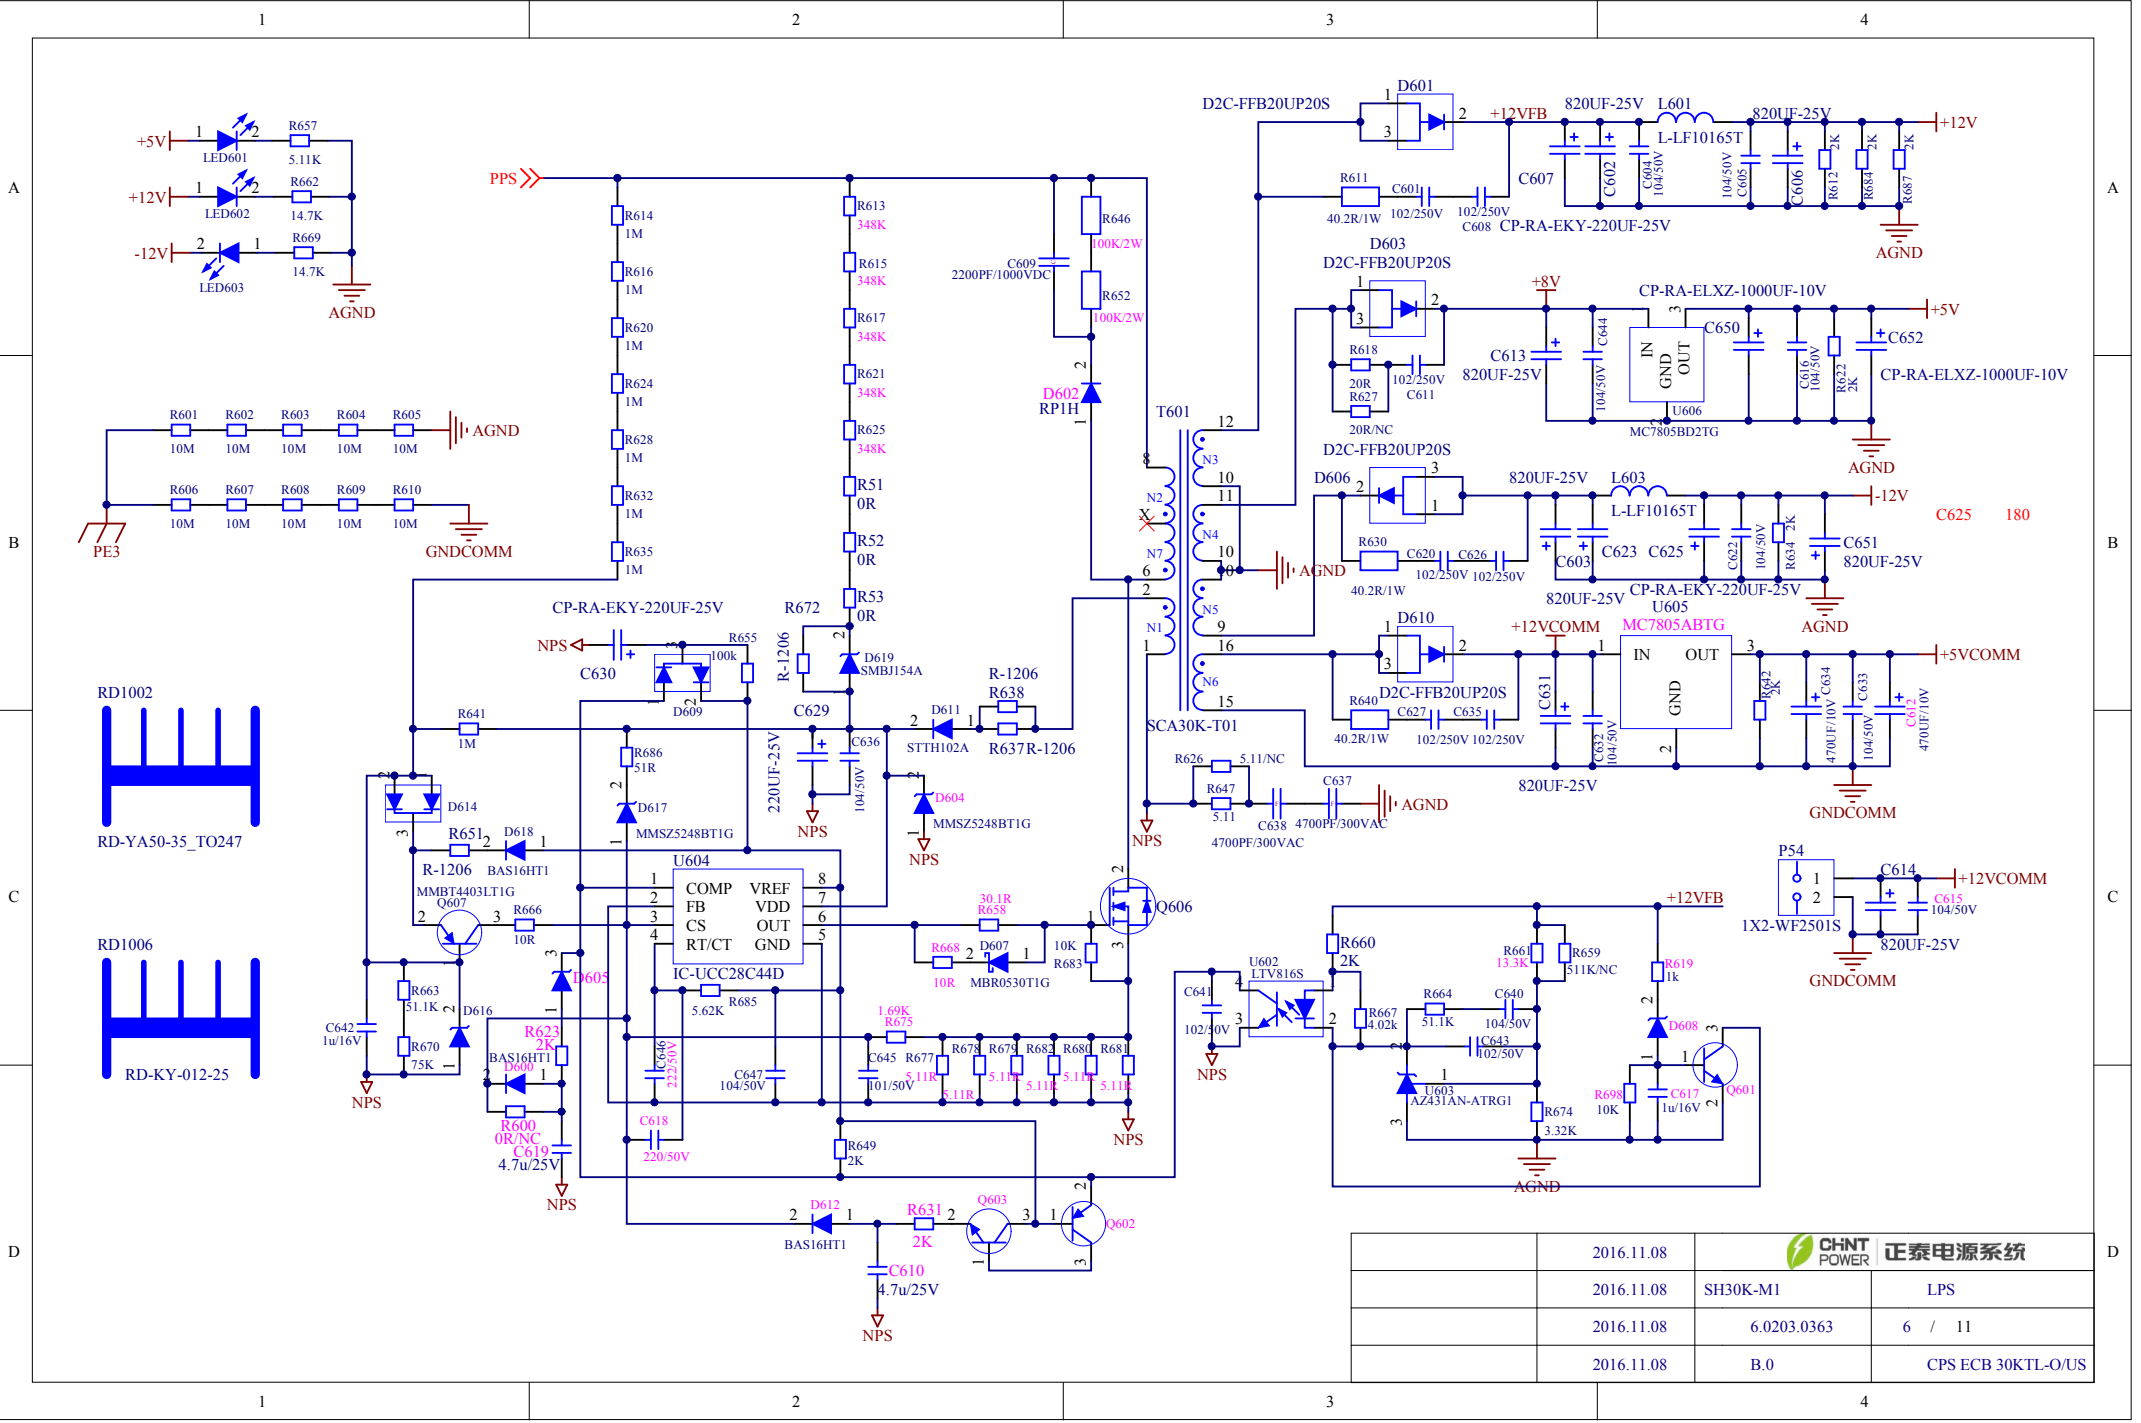

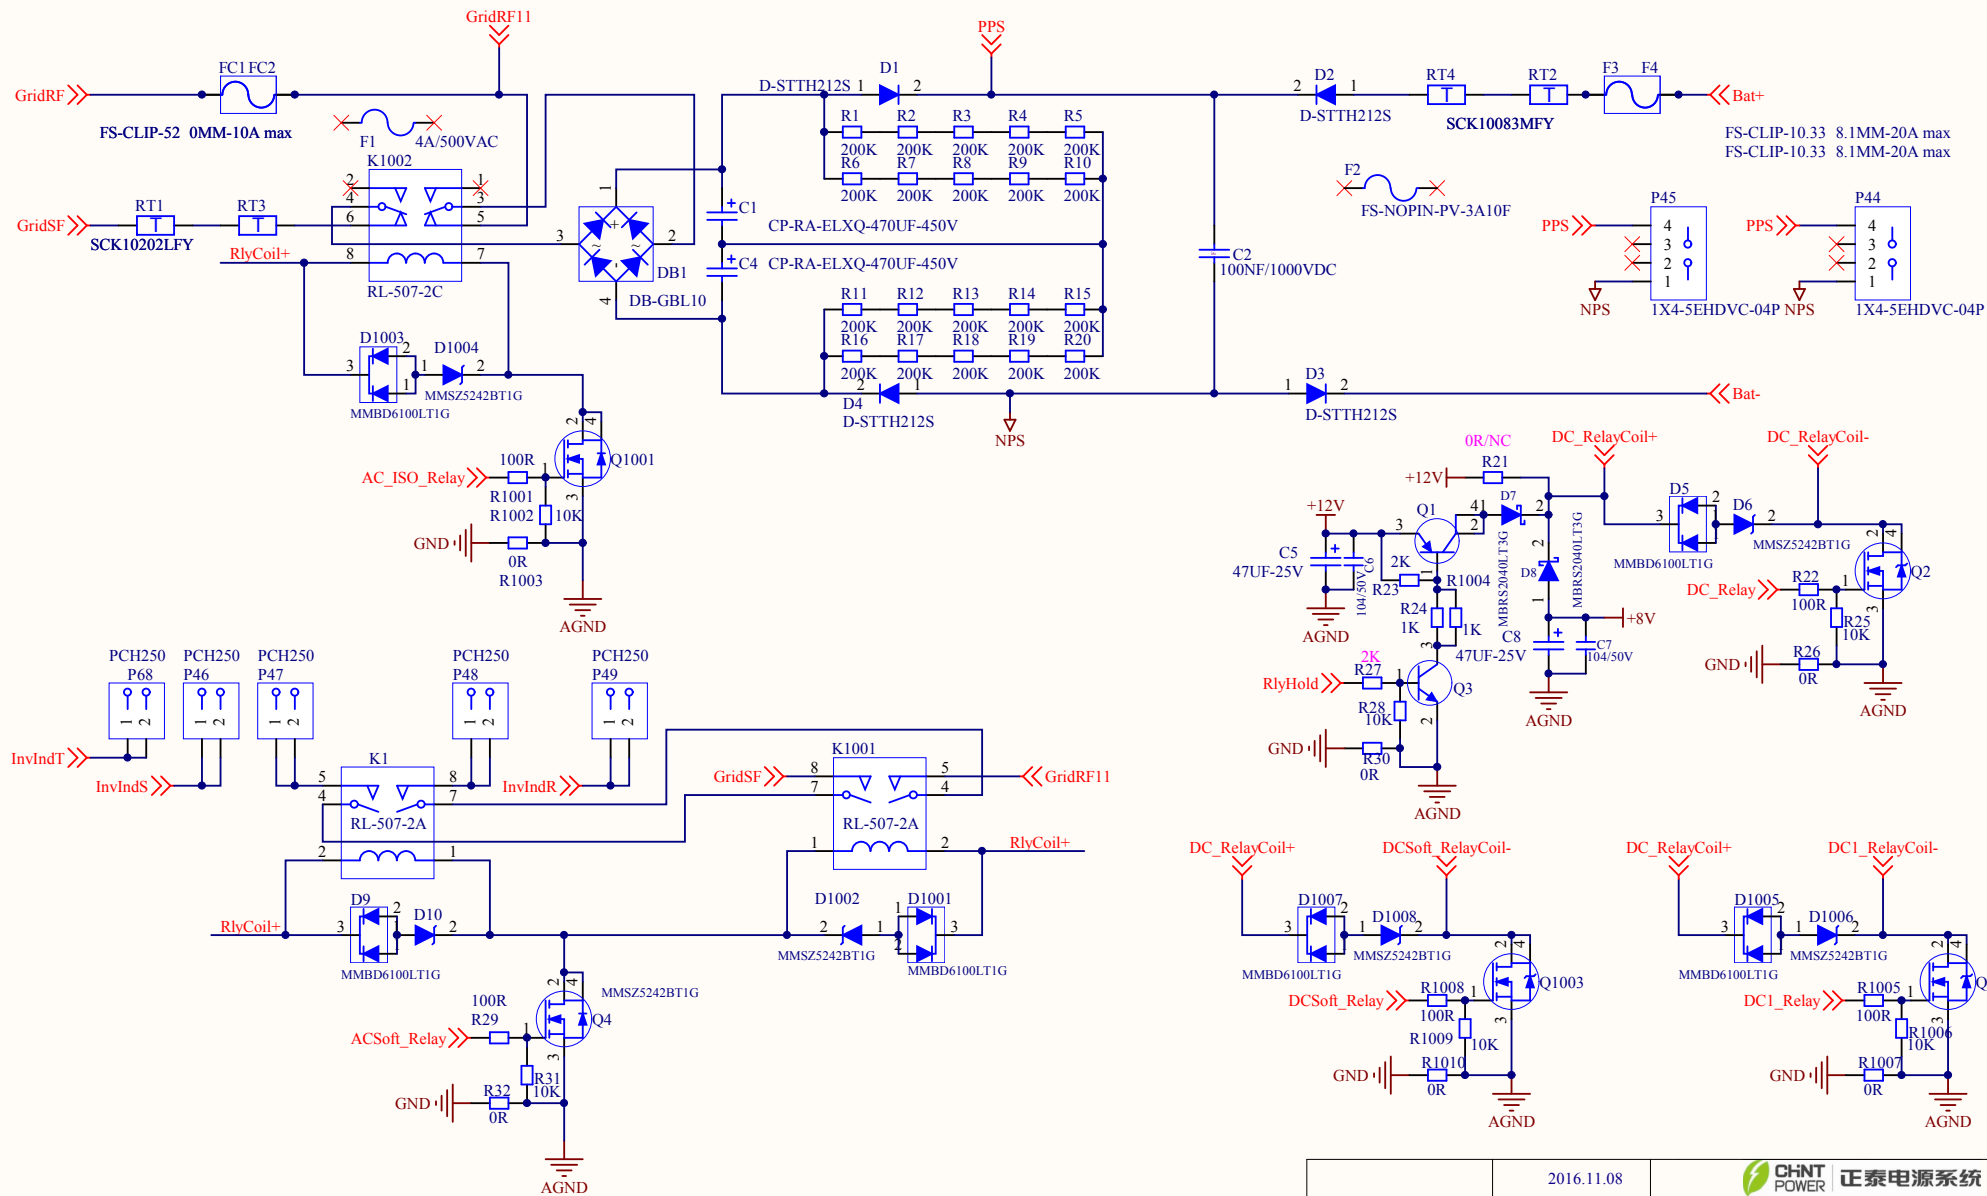

	2016.11.08	CHNT POWER	正泰电源系统
	2016.11.08		
	2016.11.08	SH30K-M1	Others
	2016.11.08	6.0203.0363	10 / 11
	2016.11.08	B.0	CPS ECB 30KTL-O/US

