

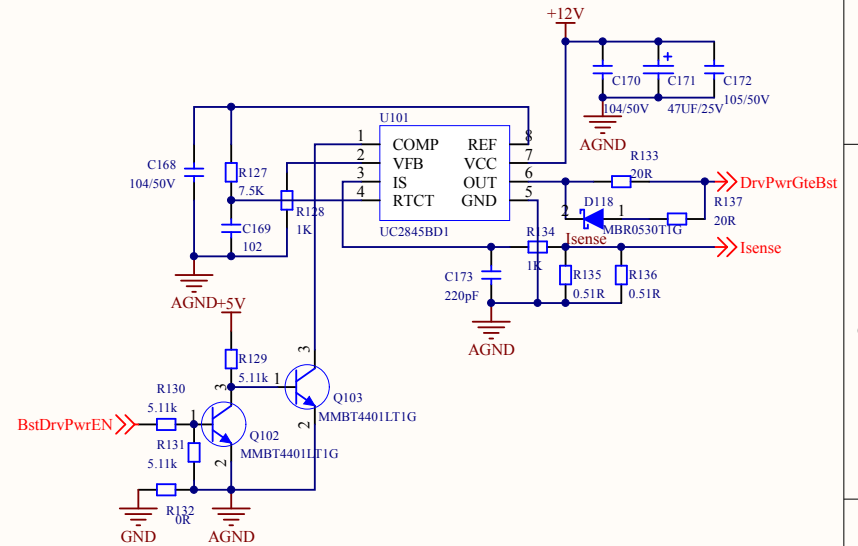
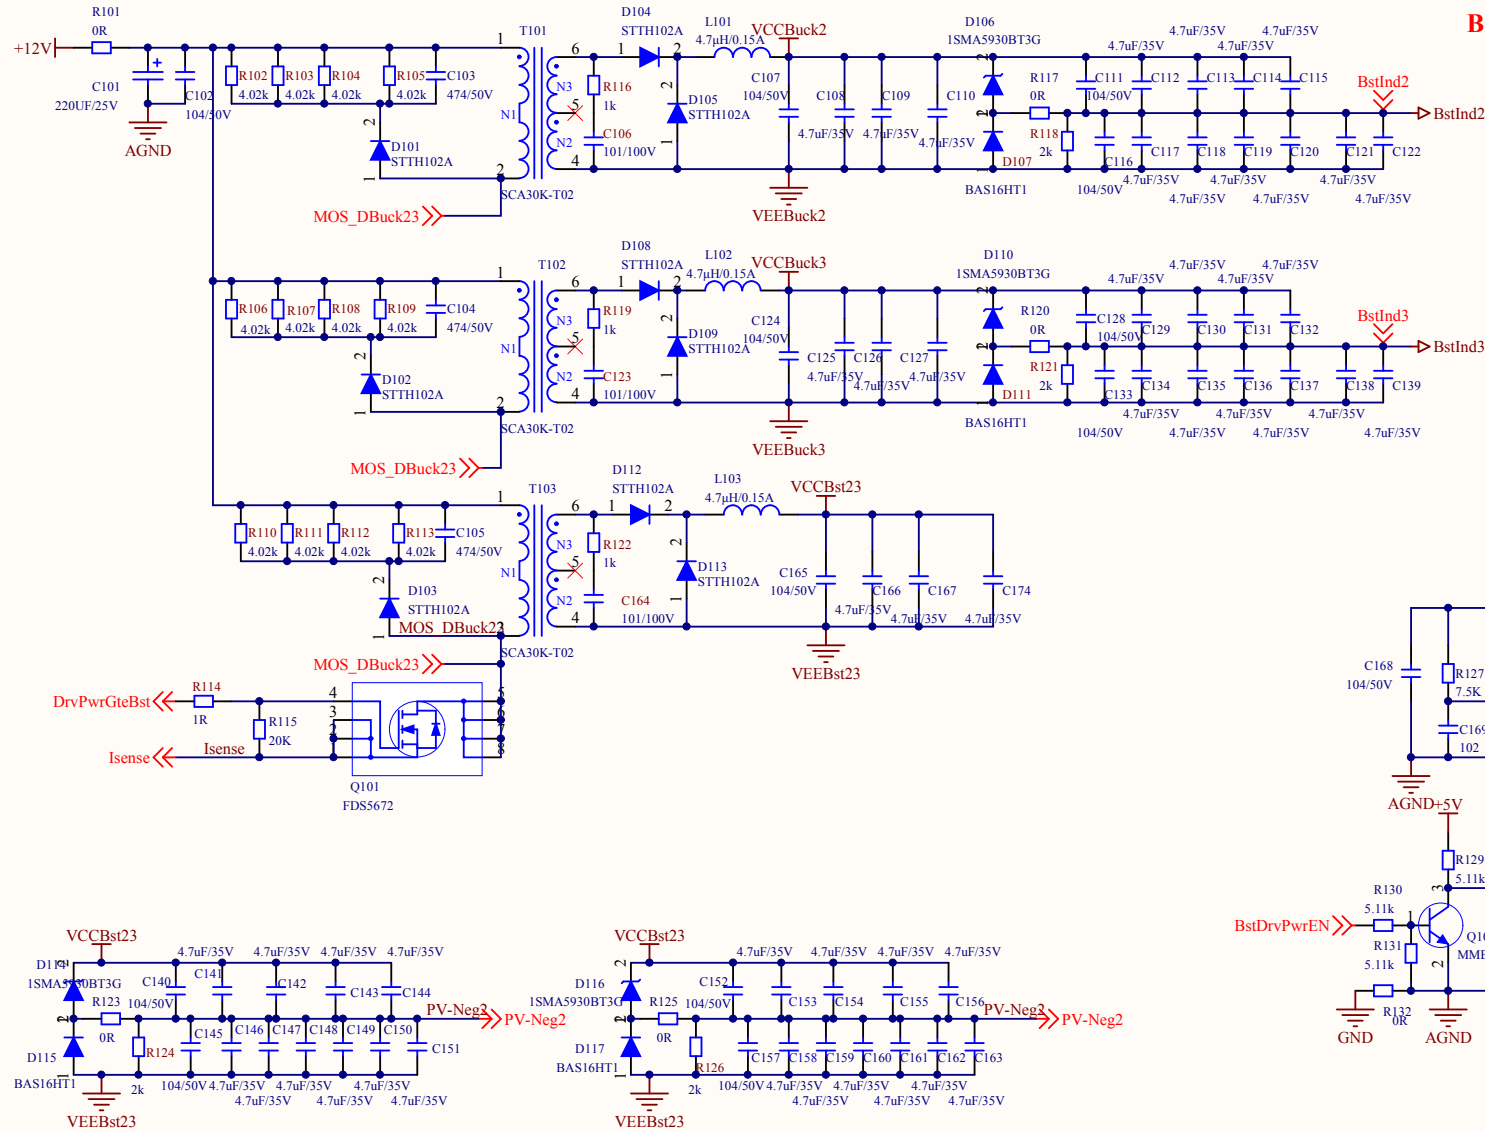
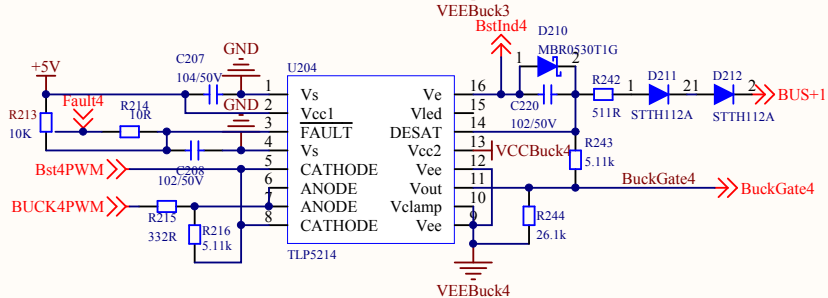
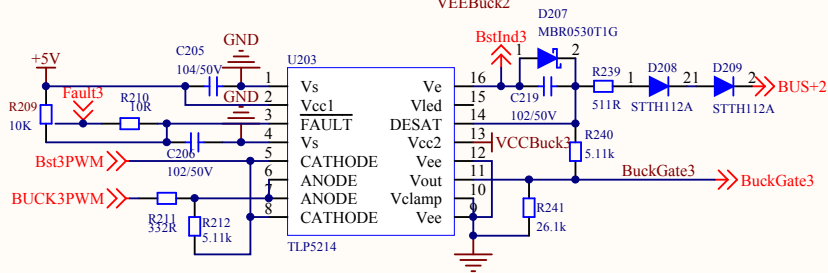





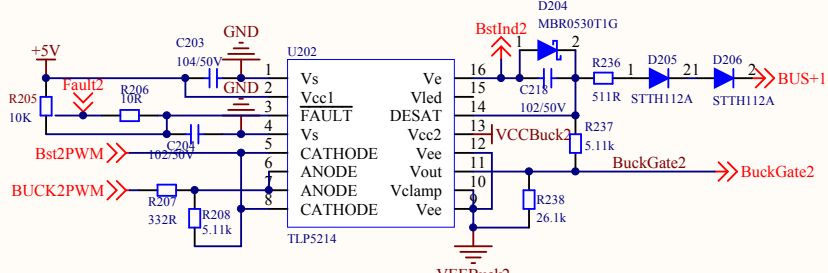


2016.11.01	CHNT POWER 正泰电源系统		
2016.11.01	SCA30KTL-P1	BuckBoostDrvPwr23	
2016.11.01	6.0203.0366	2 / 5	
2016.11.01	A.0	CPS ECB 30KTL-O/US	

Buck1~4

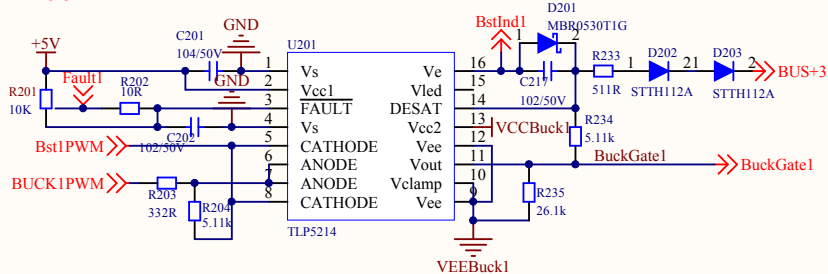


Boost1~4

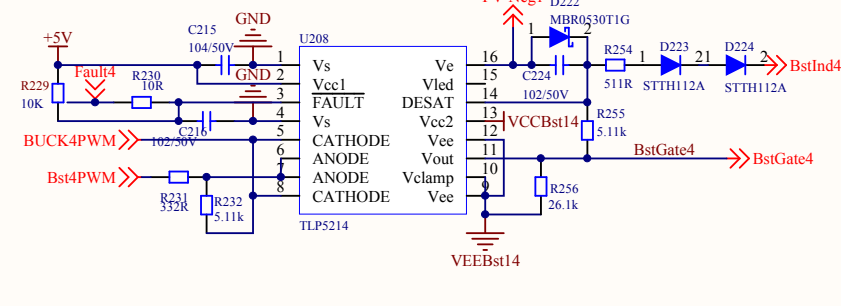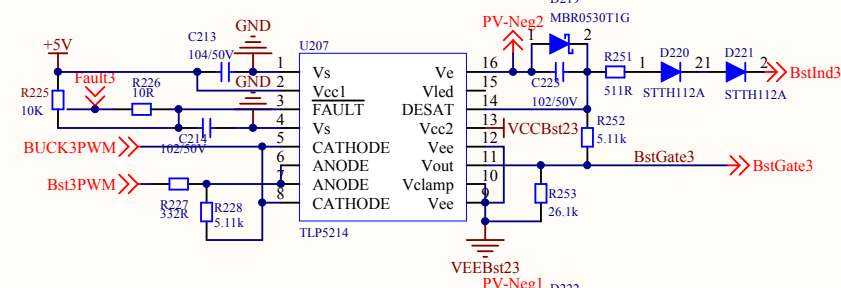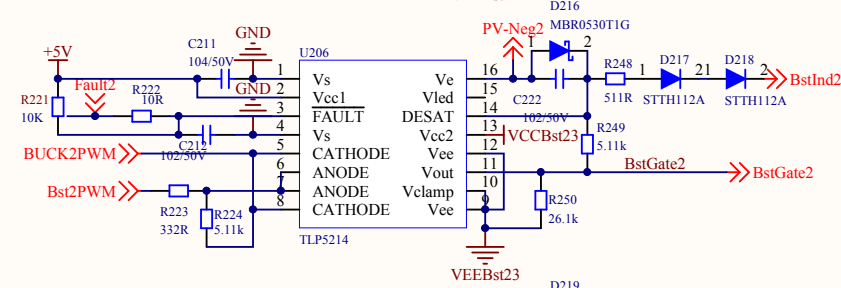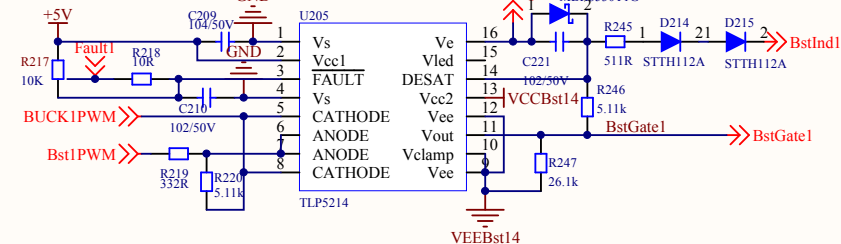


2016.11.01	CHNT POWER 正泰电源系统	
2016.11.01	SCA30KTL-P1	BuckBstDrv
2016.11.01	6.0203.0366	3 / 5
2016.11.01	A.0	CPS ECB 30KTL-O/US


Boost Buck 1

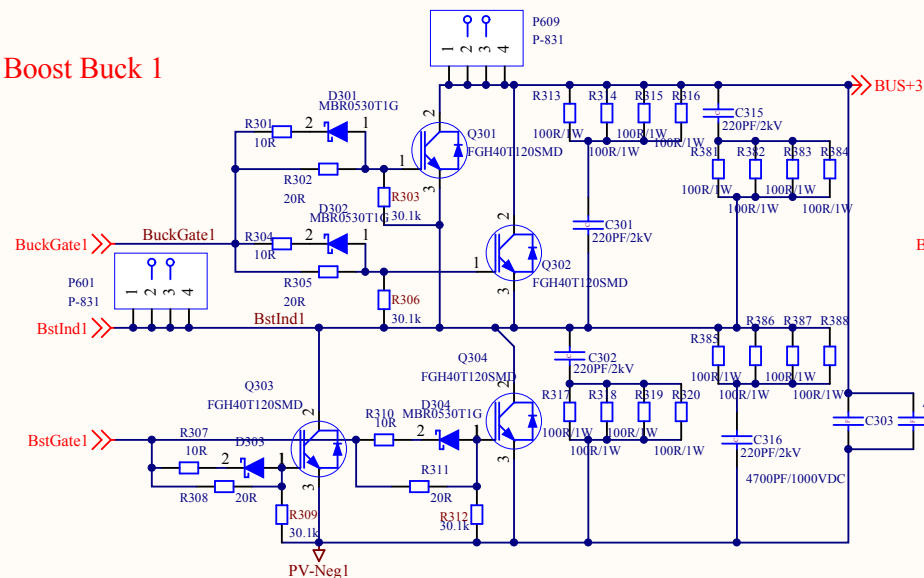


Boost Buck 2

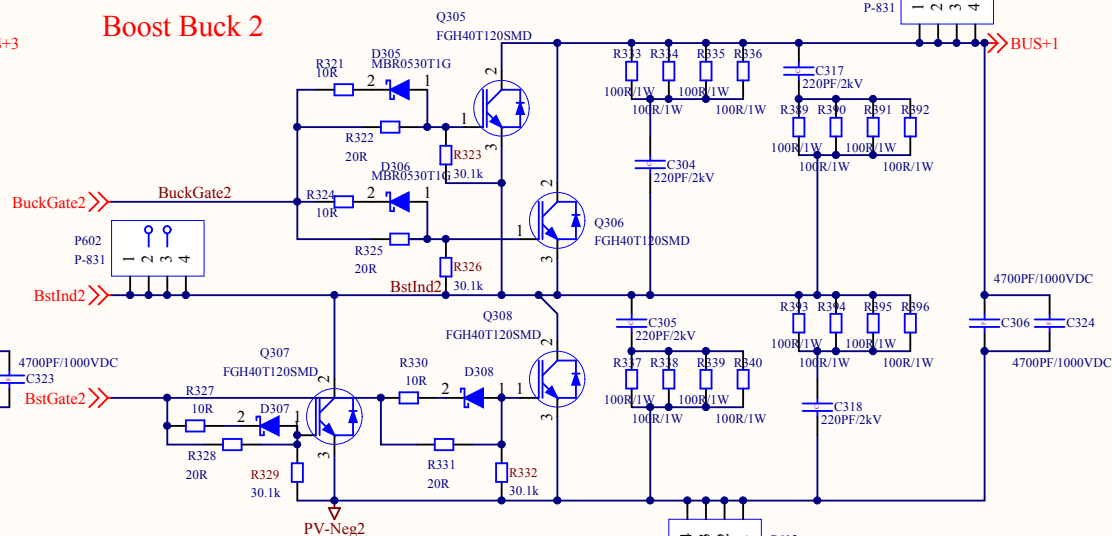

Boost Buck 3

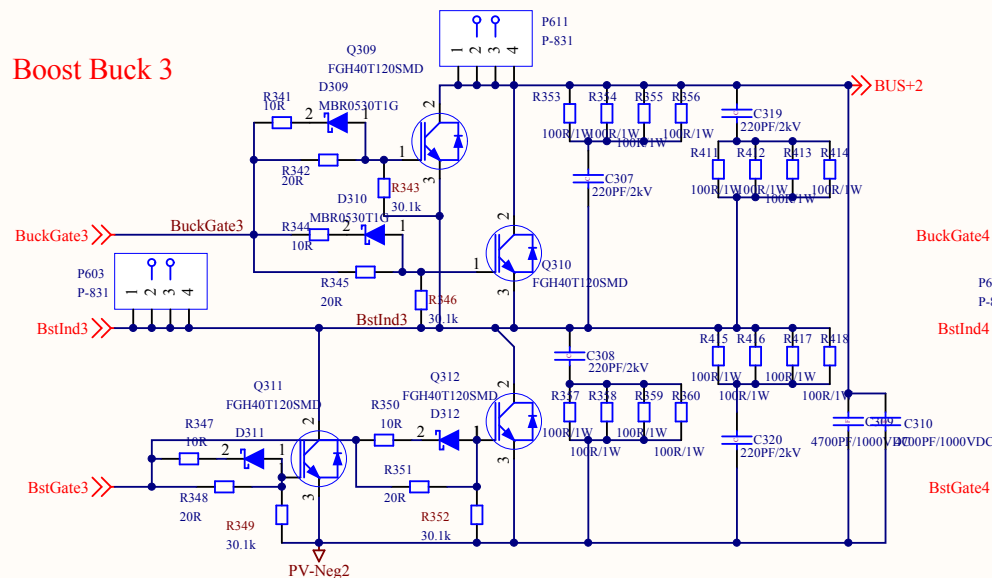

Boost Buck 4

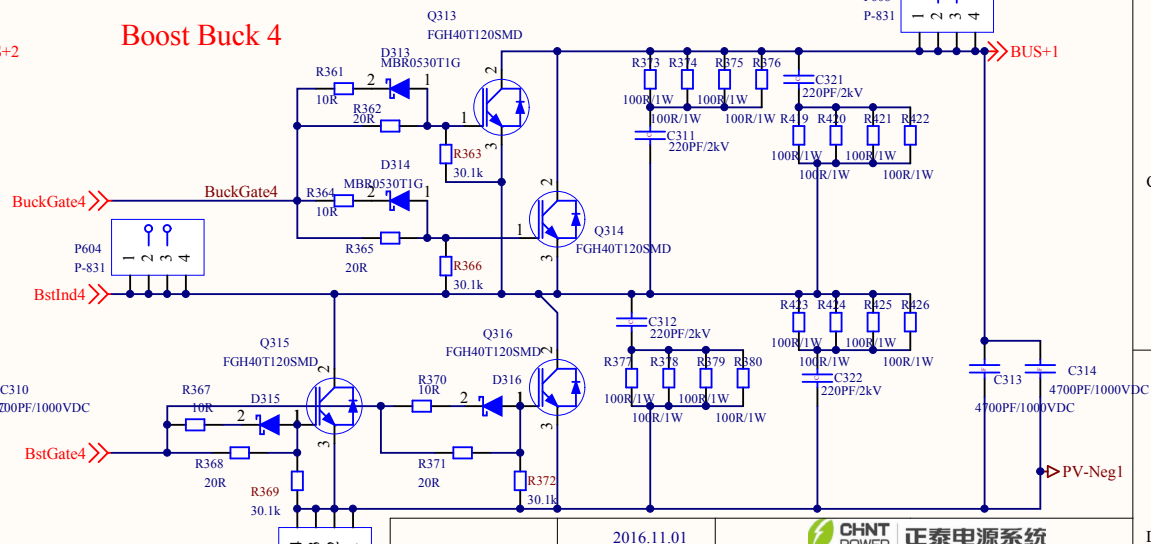

2016.11.01	CHNT POWER 正泰电源系统	
2016.11.01	SCA30KTL-P1	BuckBstPWR
2016.11.01	6.0203.0366	4 / 5
2016.11.01	A.0	CPS ECB 30KTL-O/US

