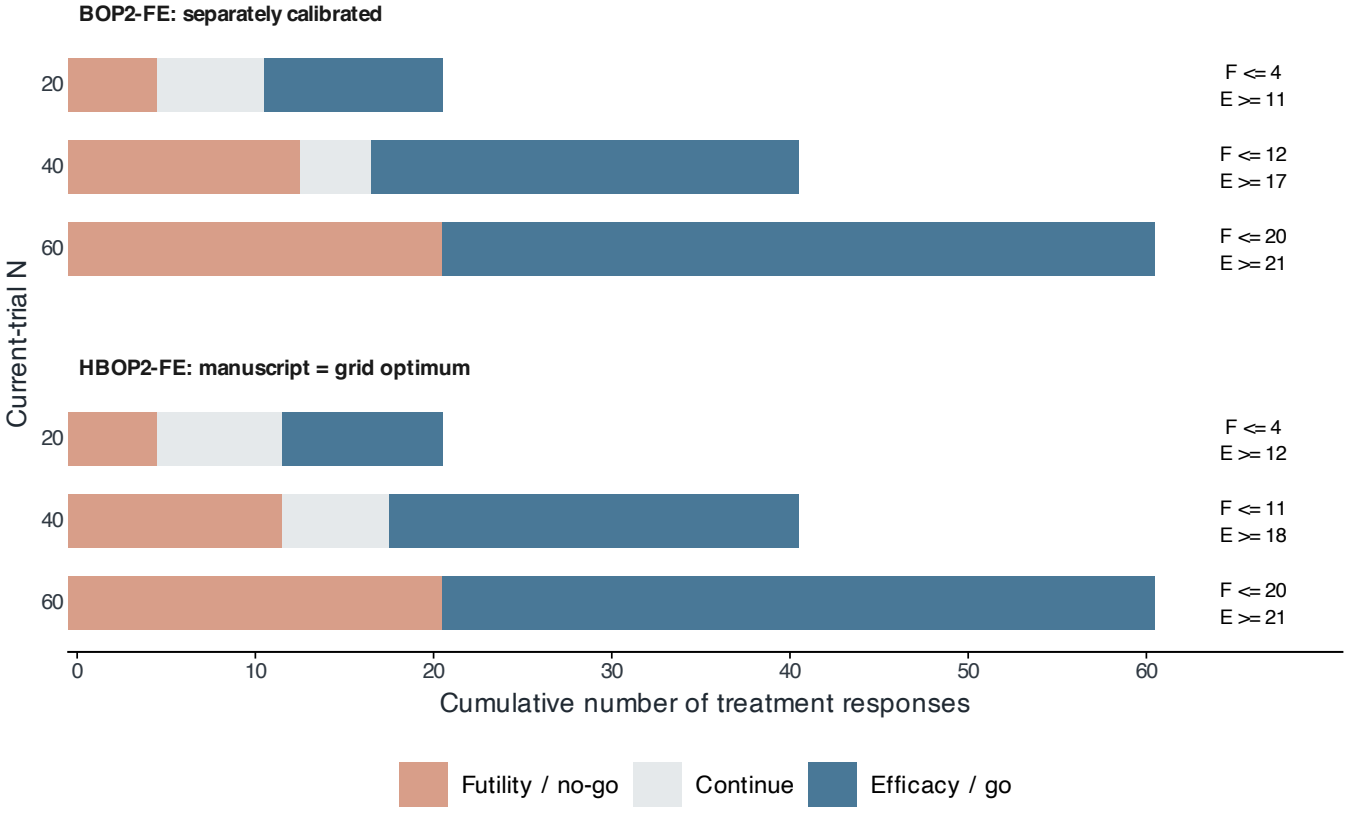
BOP2-FE: separately calibrated
20
40
60
F <= 4
E >= 11
F <= 12
E >= 17
F <= 20
E >= 21
HBOP2-FE: manuscript = grid optimum
20
40
60
F <= 4
E >= 12
F <= 11
E >= 18
F <= 20
E >= 21
Current-trial N
0
10
20
30
40
50
60
Cumulative number of treatment responses
Futility / no-go
Continue
Efficacy / go