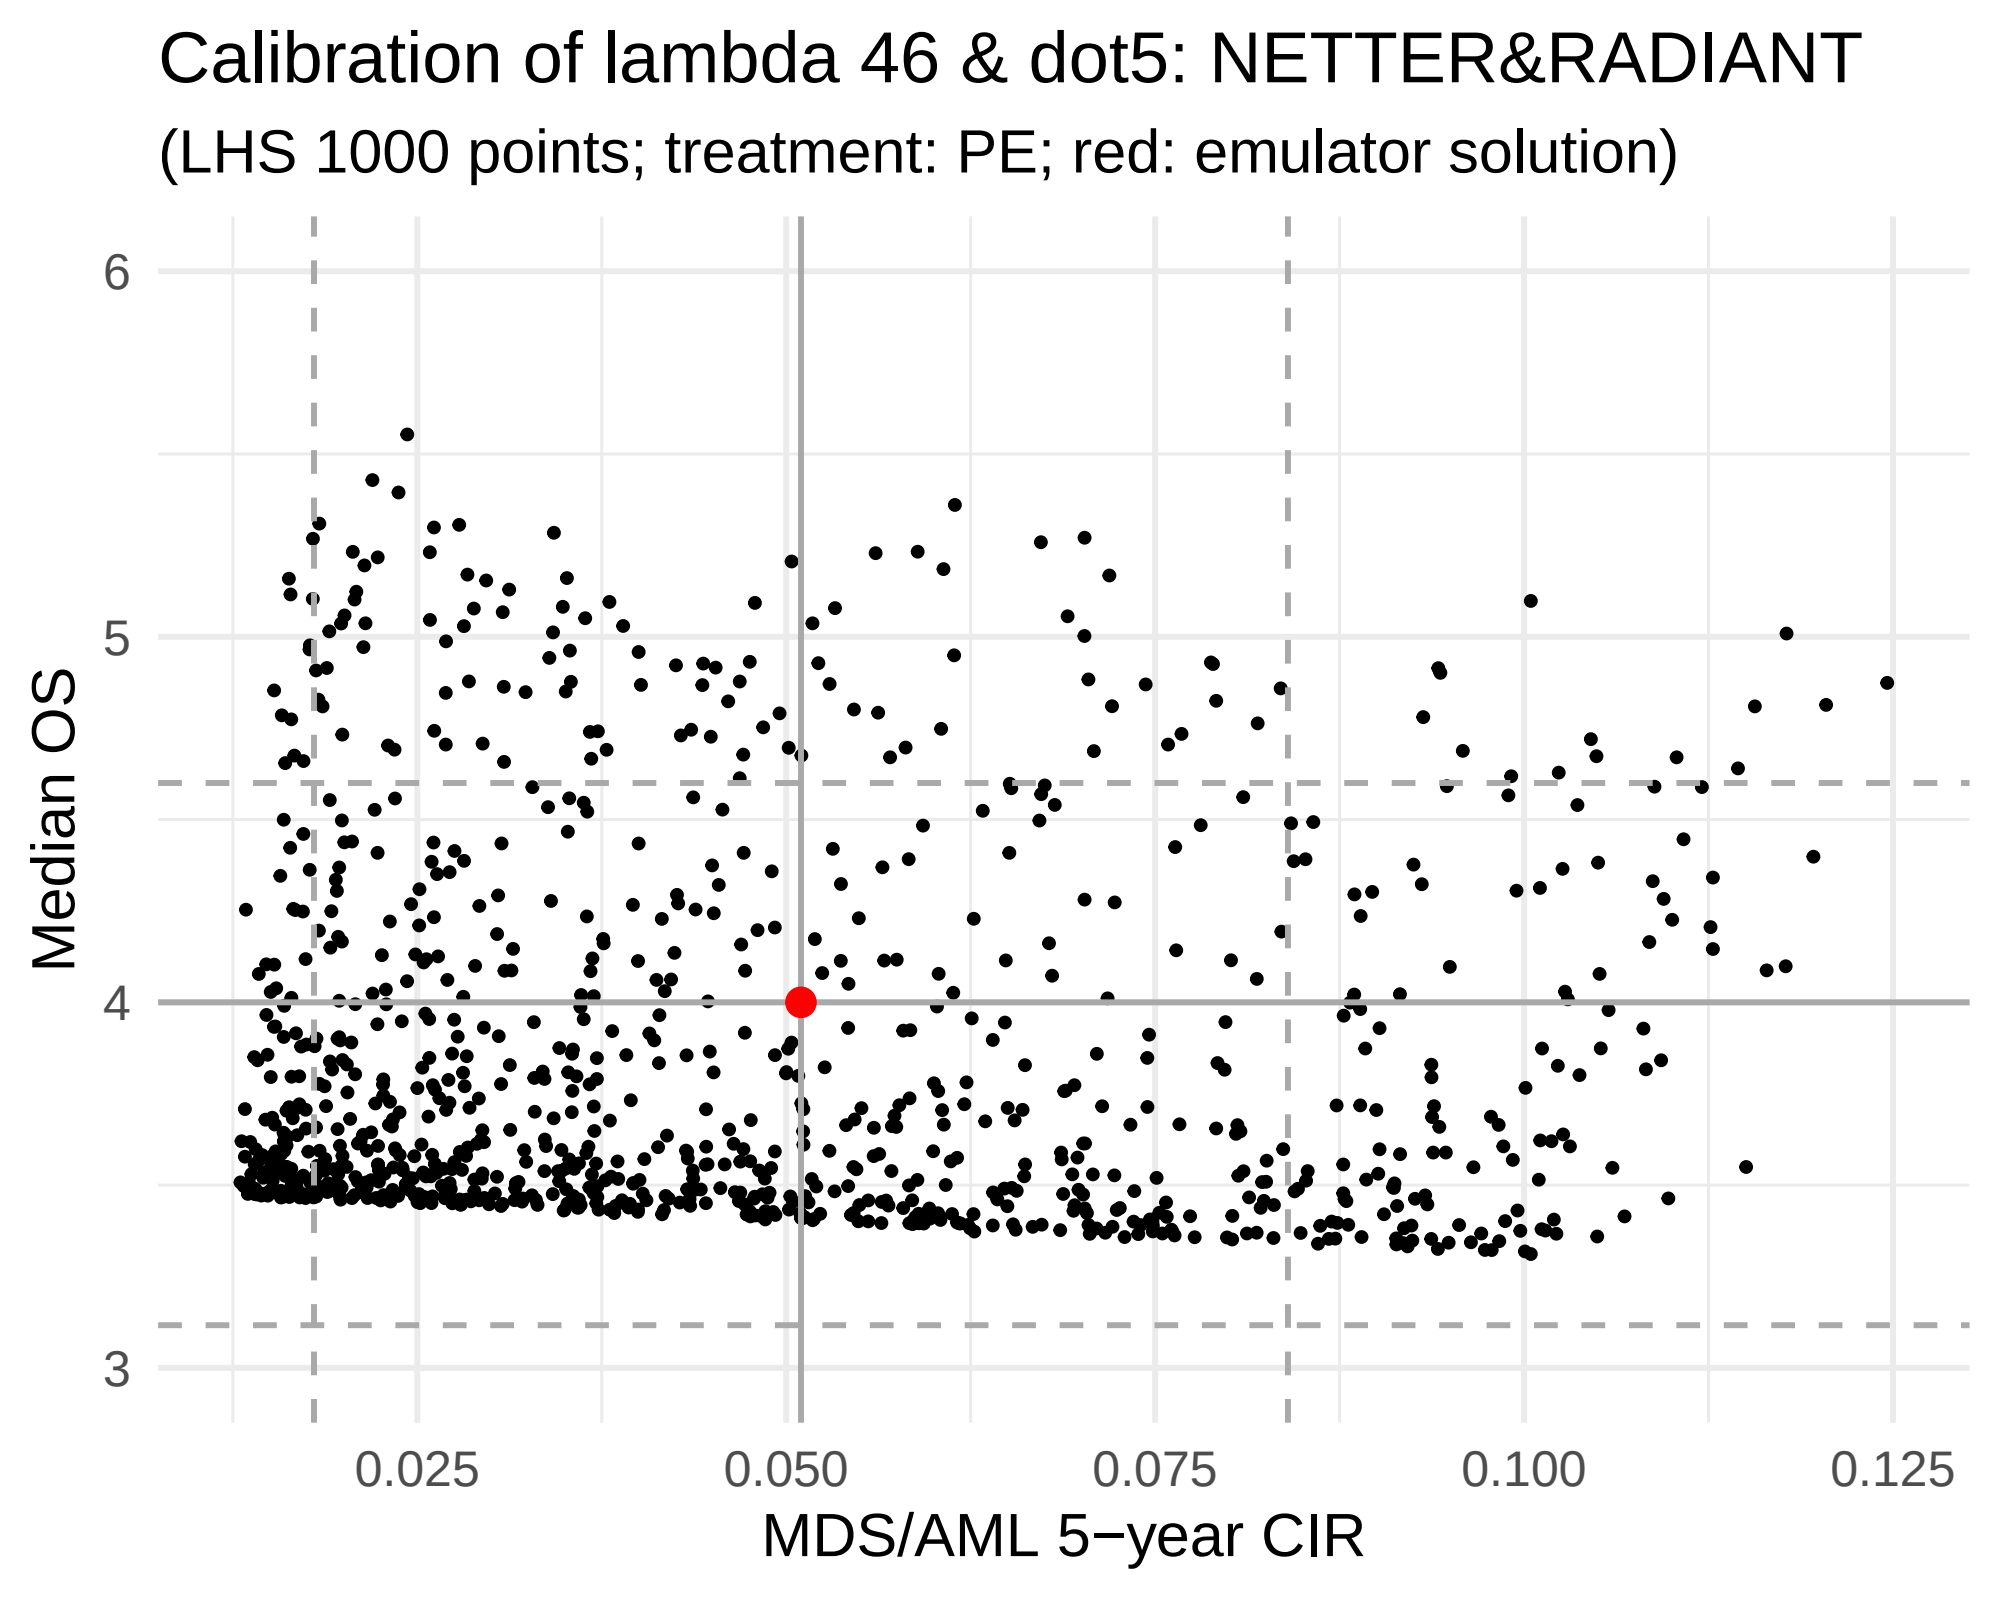

Calibration of lambda 46 & dot5: NETTER&RADIANT
(LHS 1000 points; treatment: PE; red: emulator solution)
Median OS
6
5
4
3
0.025
0.050
0.075
0.100
0.125
MDS/AML 5−year CIR