
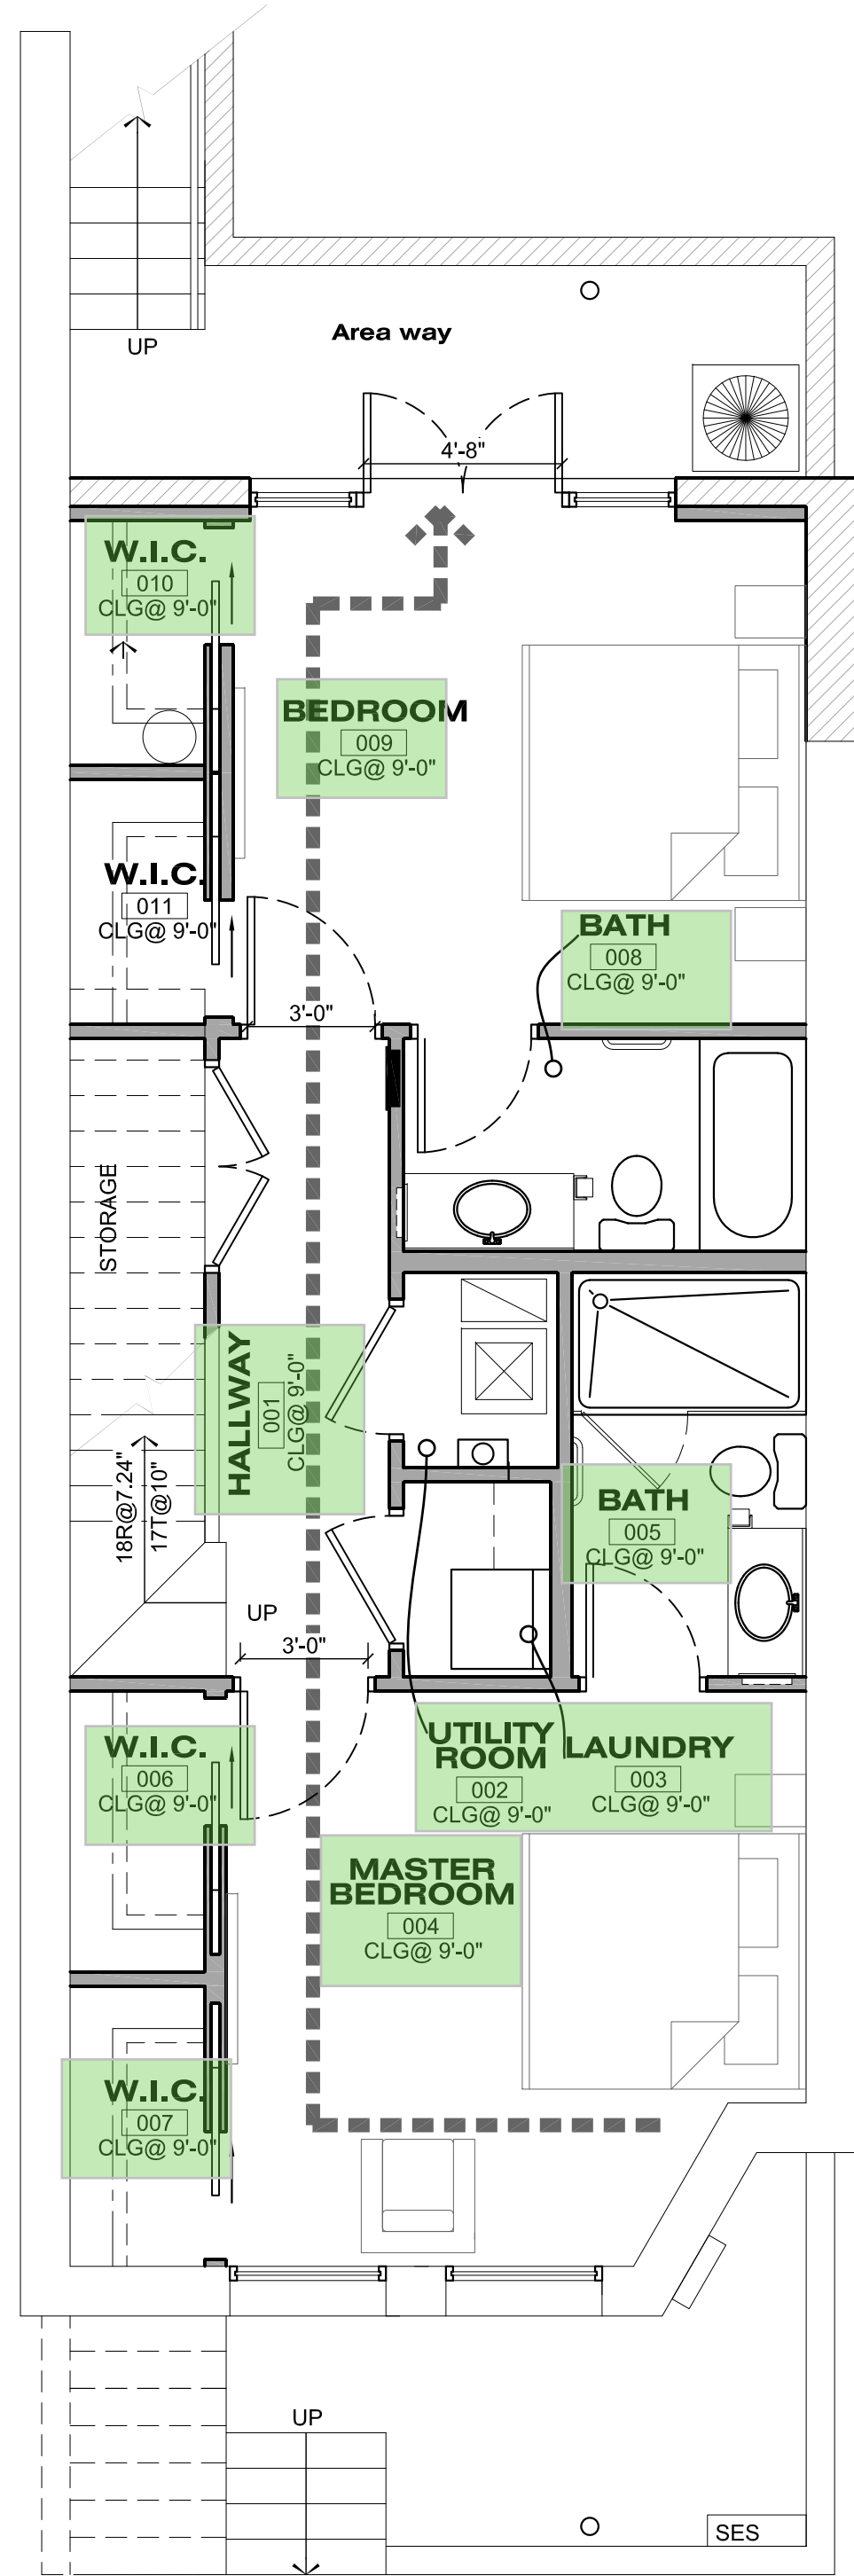
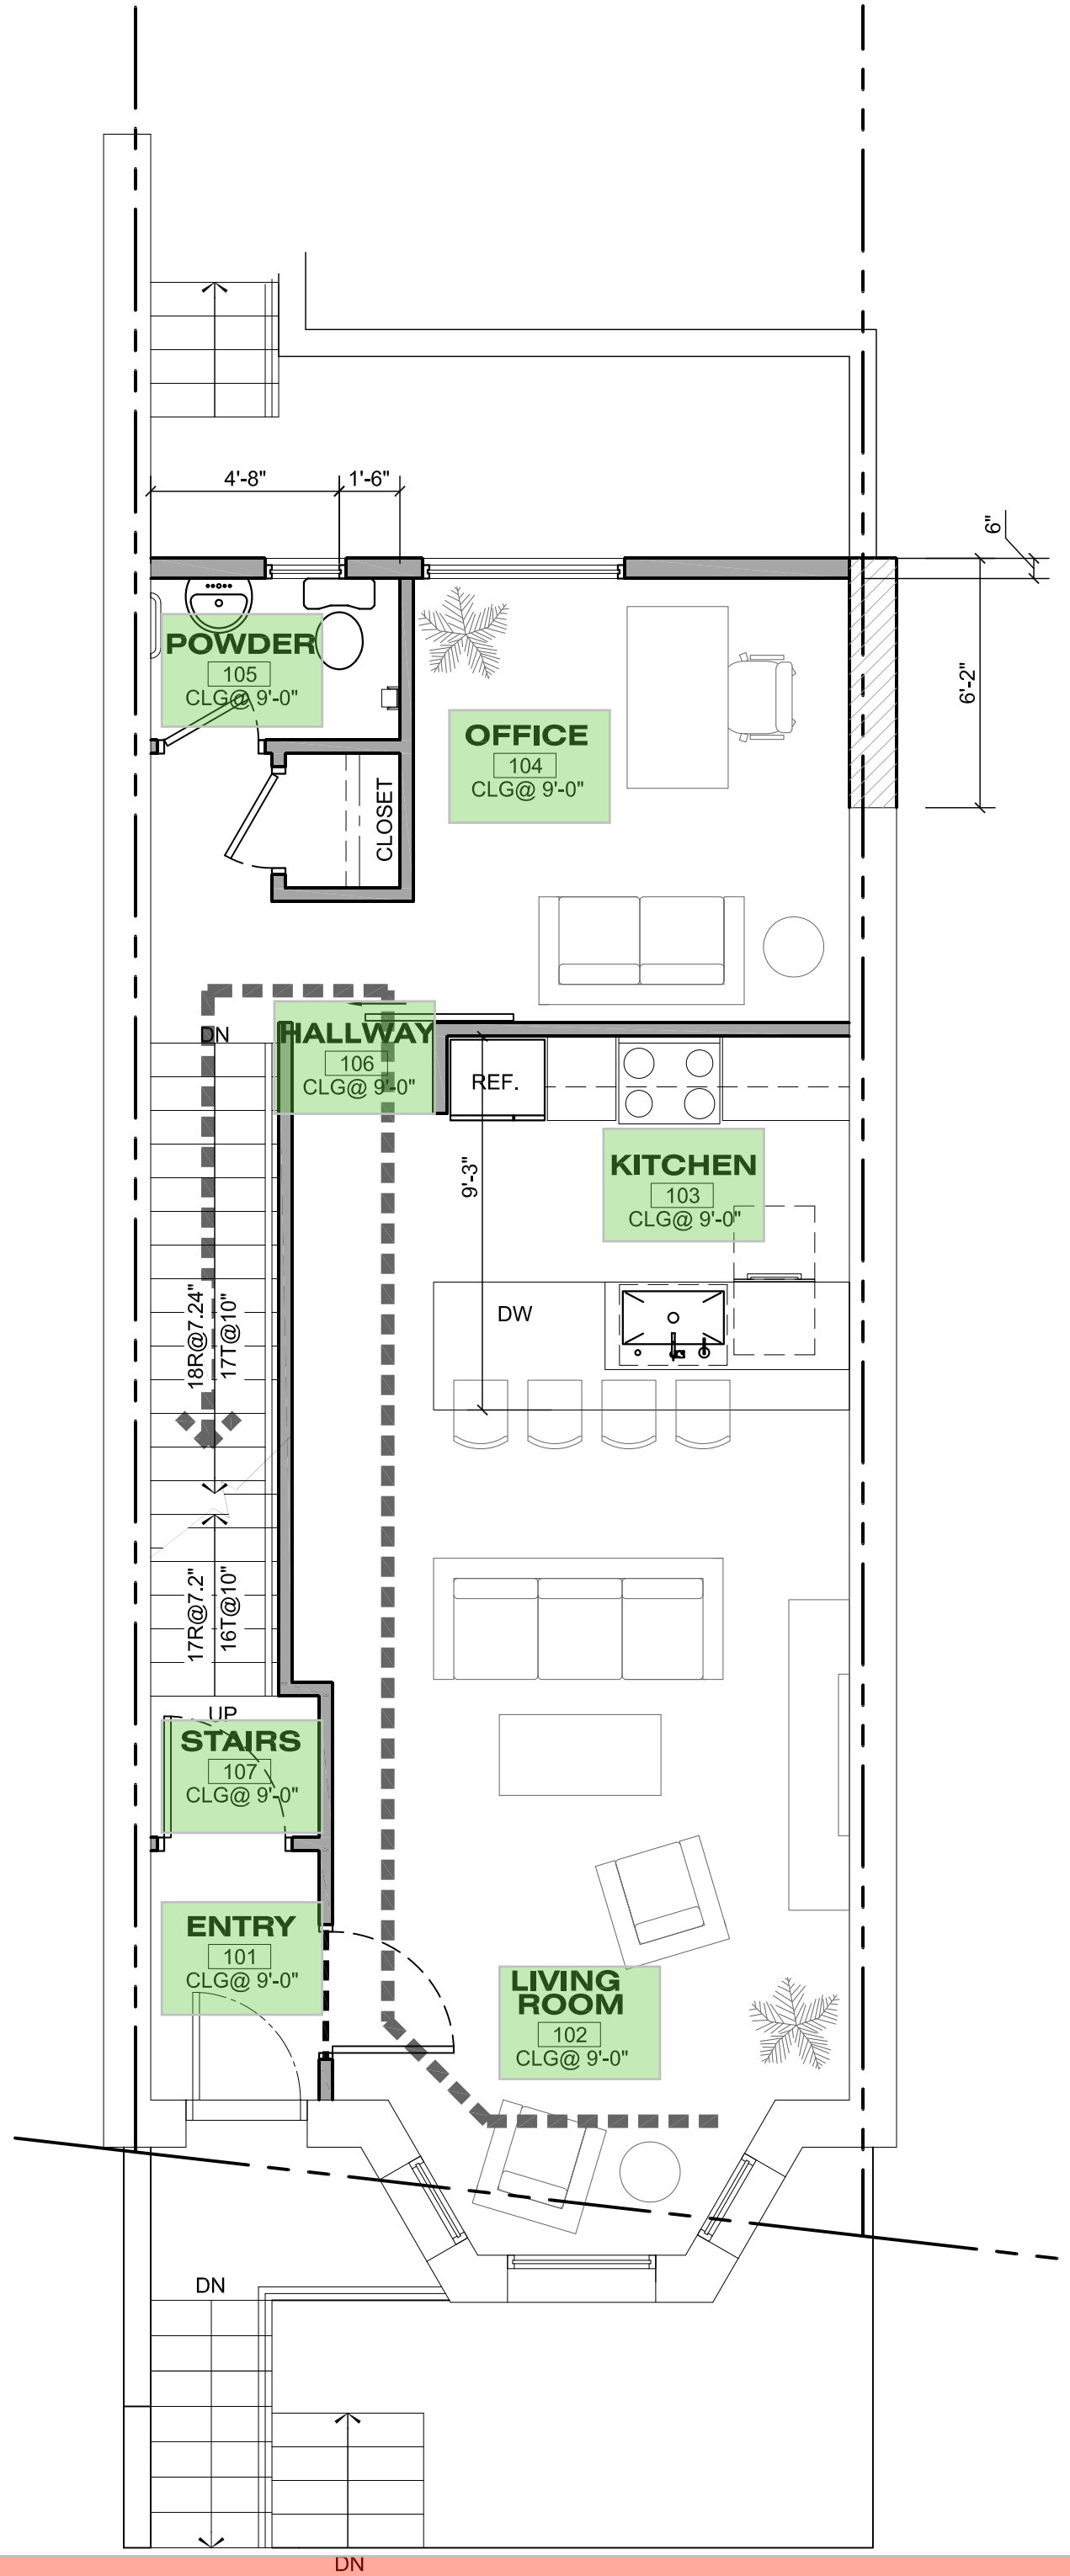
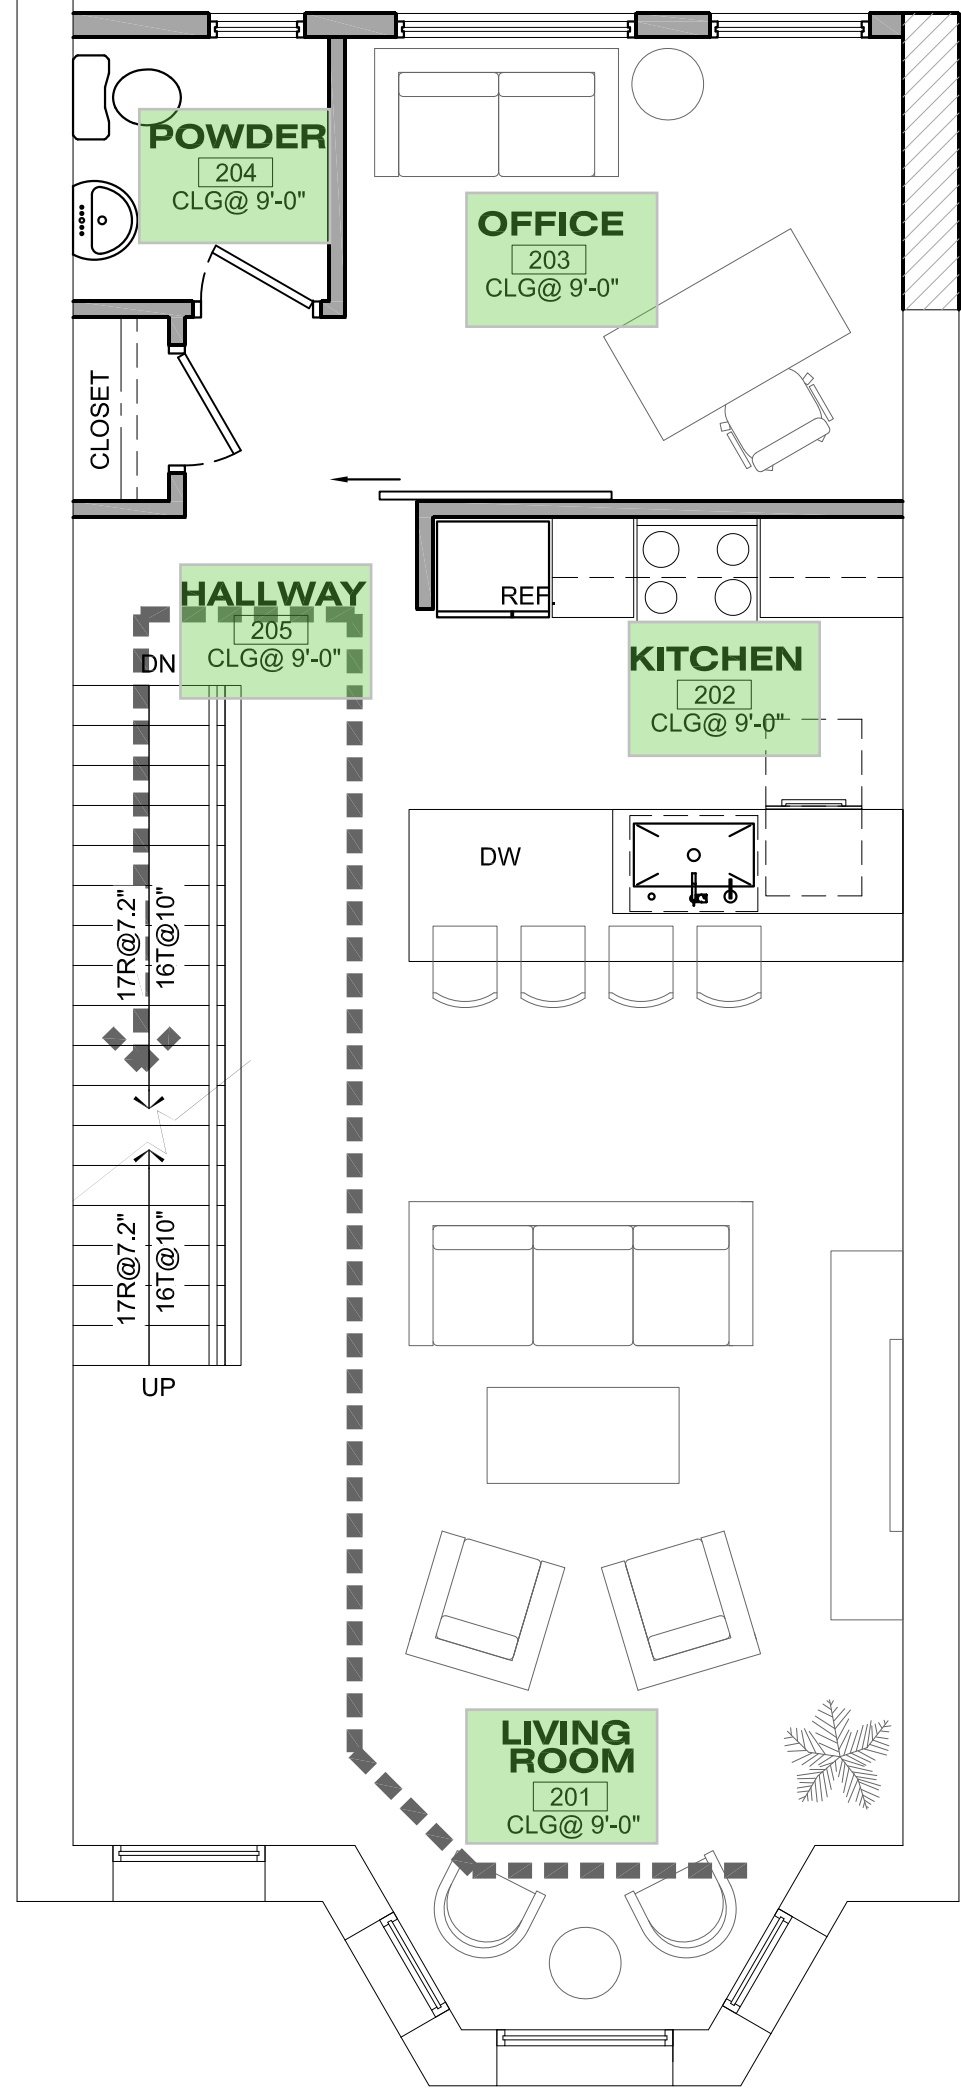


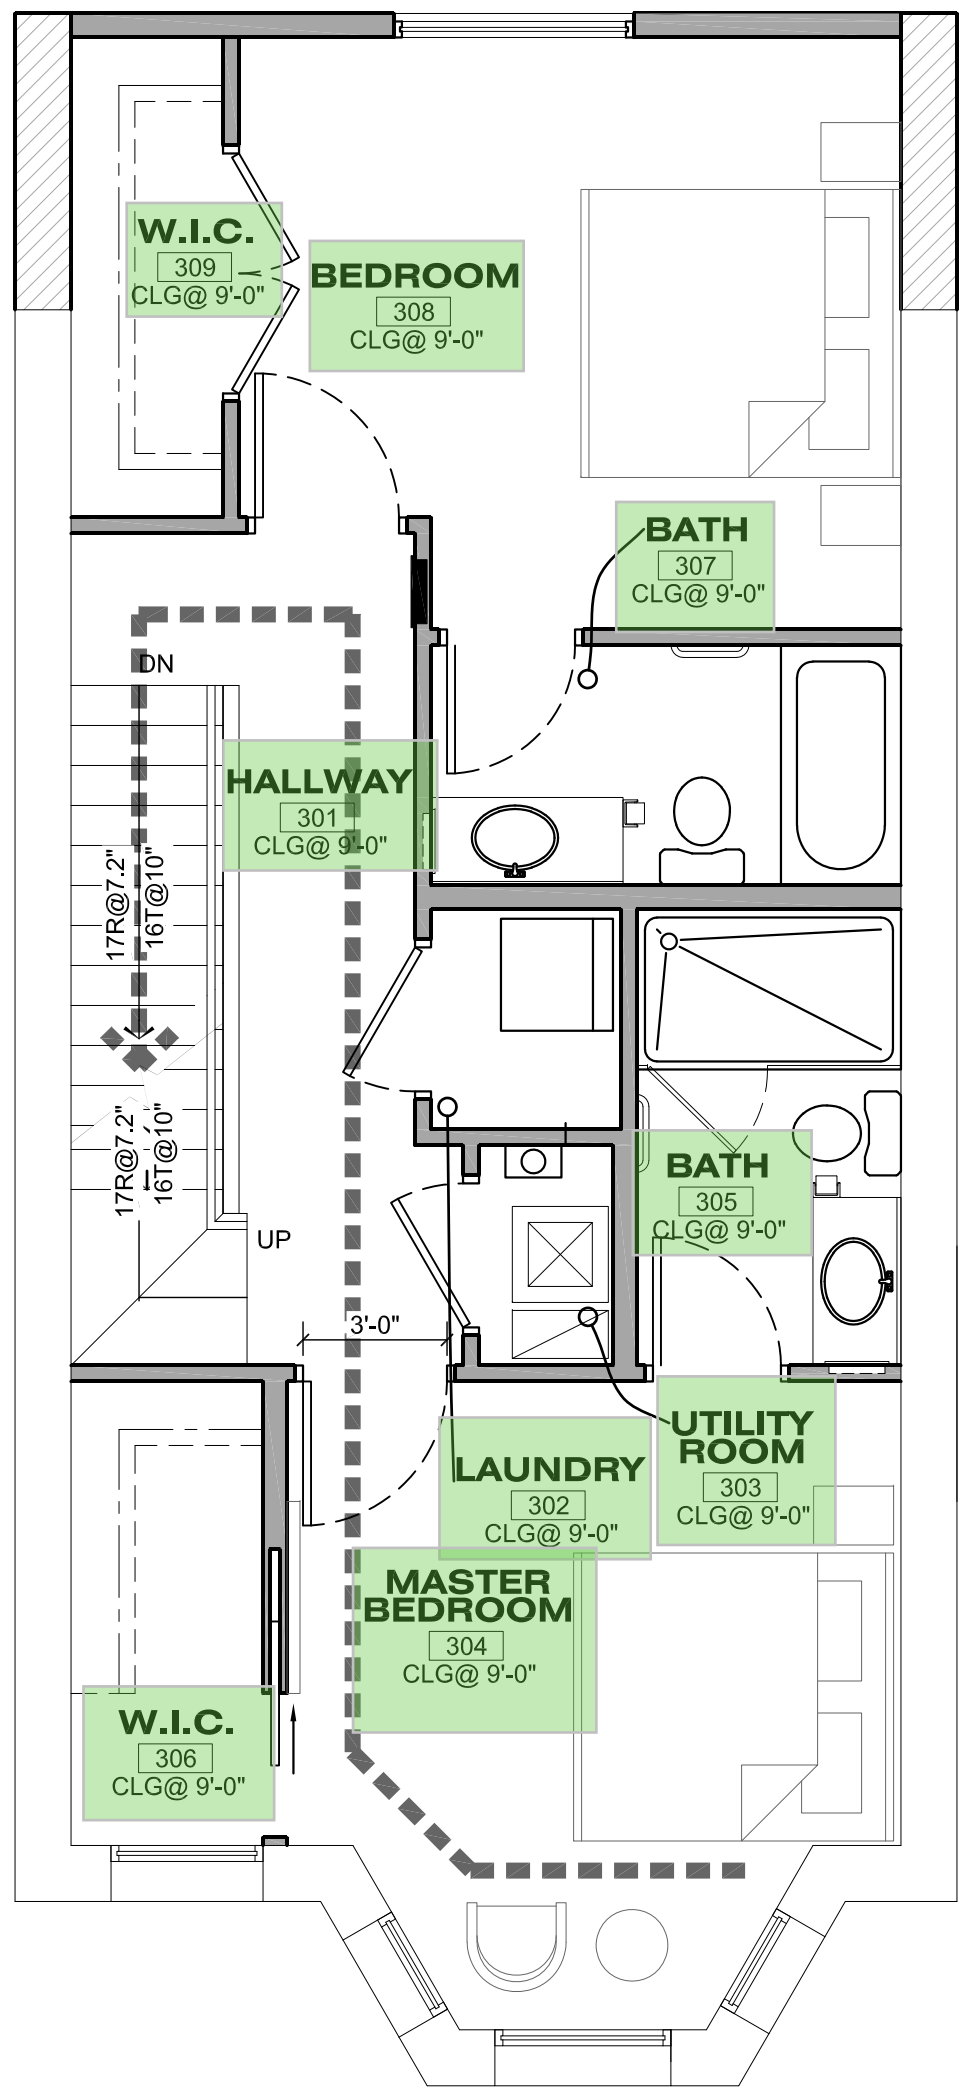

THIRD FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit B

SECOND FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit B

FIRST FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit A

BASEMENT PLAN
SCALE: 1/4" = 1'-0"
unit A

EGRESS NOTES

USE GROUP: R3
BUILDING SHALL BE FULLY SPRINKLERED

MIN. NUMBER OF EXITS OR EXIT ACCESS DOORWAYS
RESIDENTIAL (R-2) 1 REQ'D [IRC R311.2]

EGRESS COMPONENTS		
DOOR CLEARANCE	32" MIN.	[IRC R311.2]
STAIR WIDTH	36"	[IRC R311.7.1]
HALLWAYS WIDTH	36"	[IRC R311.6]
STAIR HEADROOM	80"	[IRC R311.7.1]
STAIR TREAD / RISER	-7.75" MAX./ 10" MIN.	[IRC R311.7.4]
STAIR LANDING		[IRC R311.7.5]
INTERMEDIATE LANDING	12' MAX	[IRC R311.7.5]

LEGEND

- 1 HR RATED PARTITION, REFER TO DETAILS ON SHEET A500
- PATH FROM FUTUREST OCCUPABLE POINT FROM EXIT

Project:

**WASHINGTON DC
TOWNHOUSE**

Seal:

Revision:

No. Date Description

Issue:

Date Description


Project Number:

Title:

EXIT PLANS


Sheet:

A101

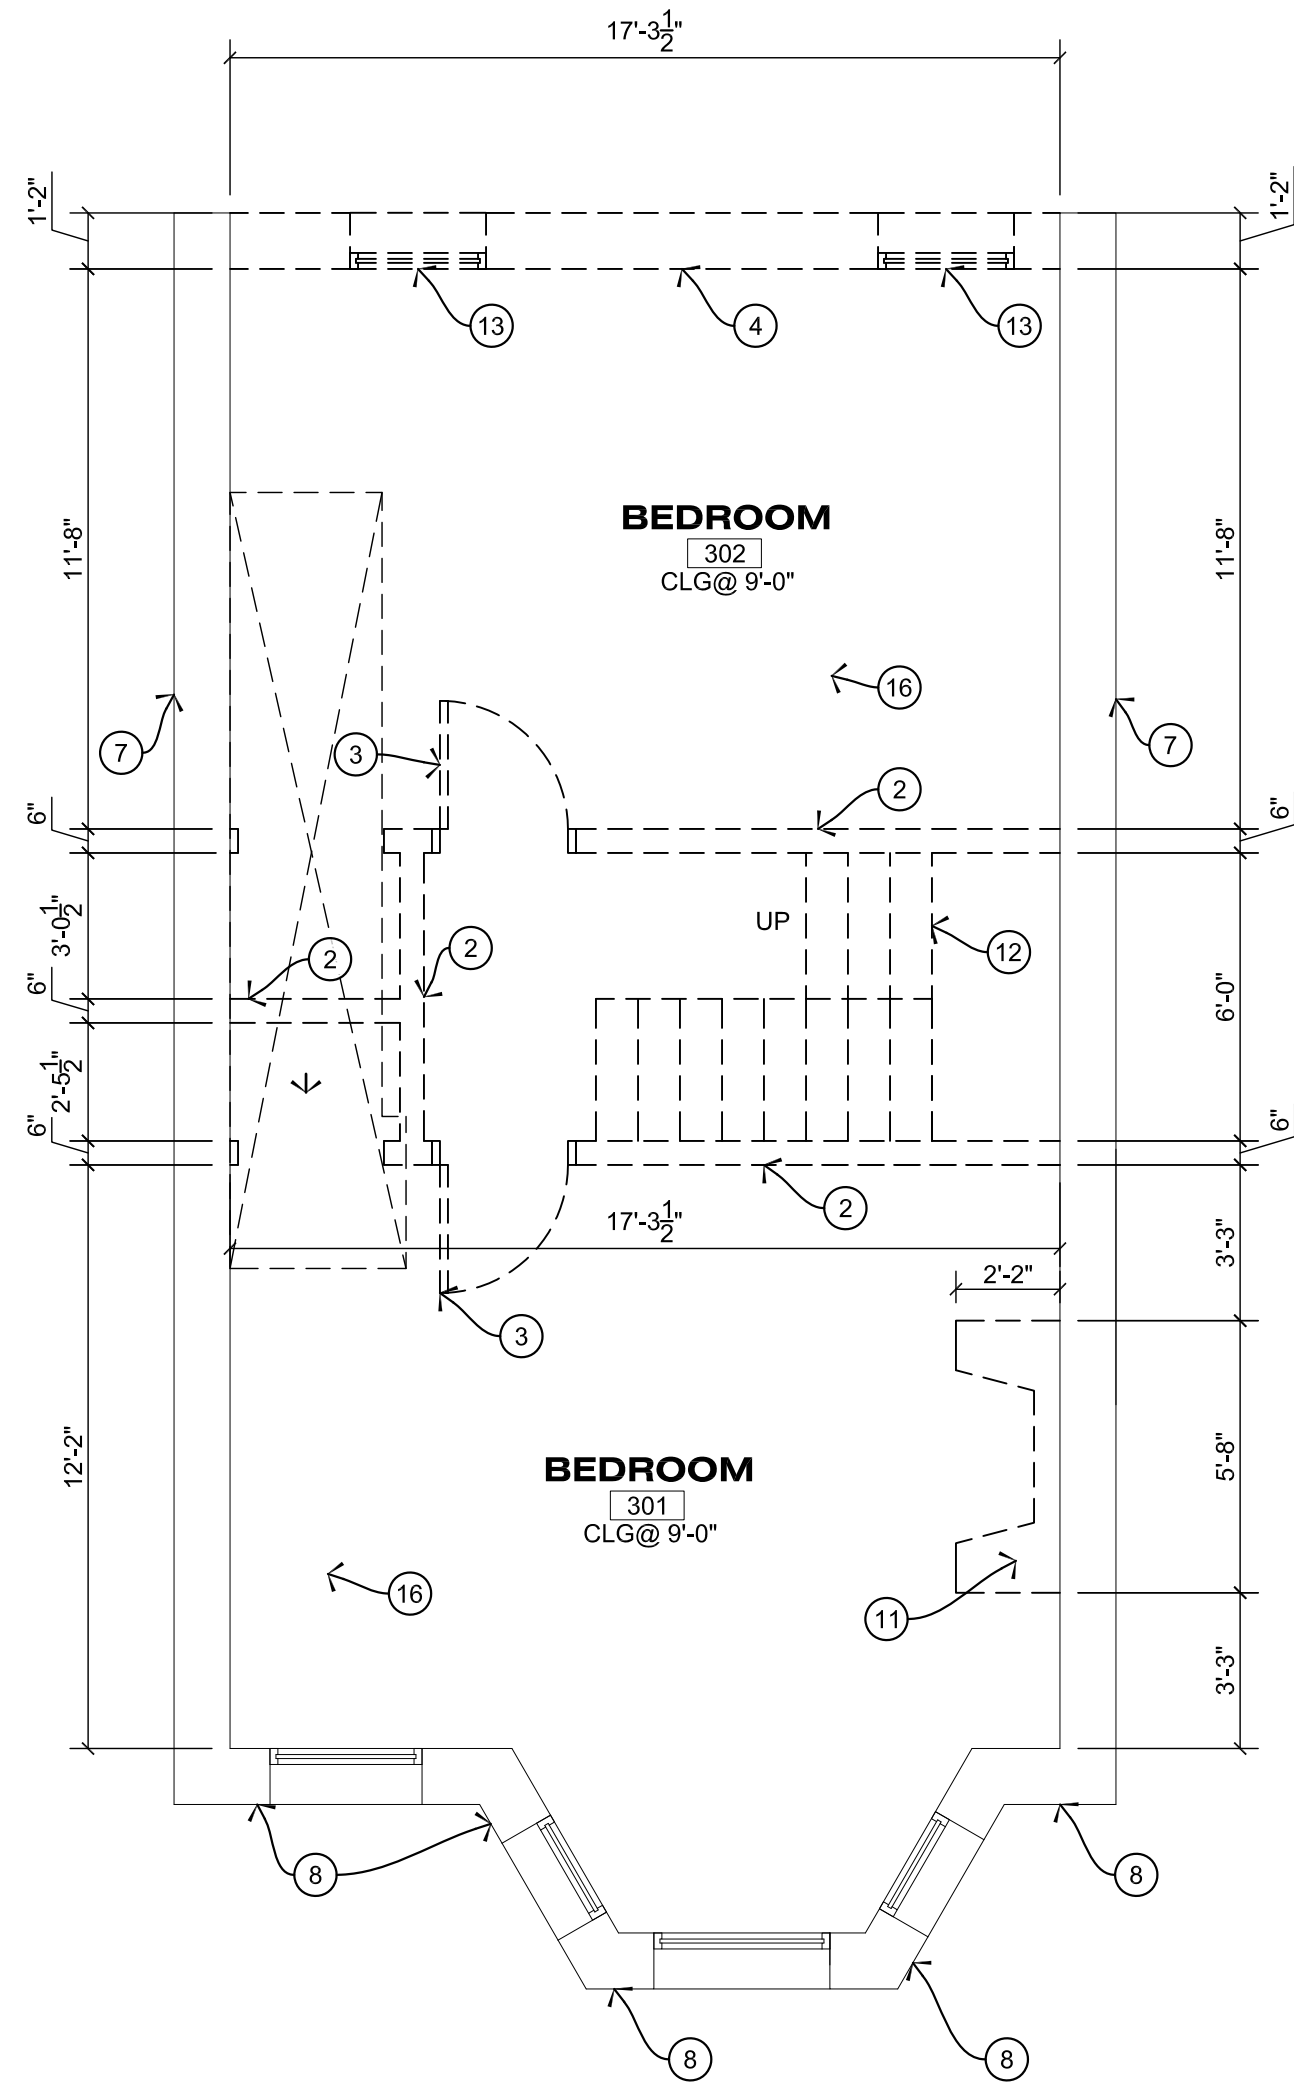


THIRD FLOOR PLAN

SCALE: 1/4" = 1'-0"

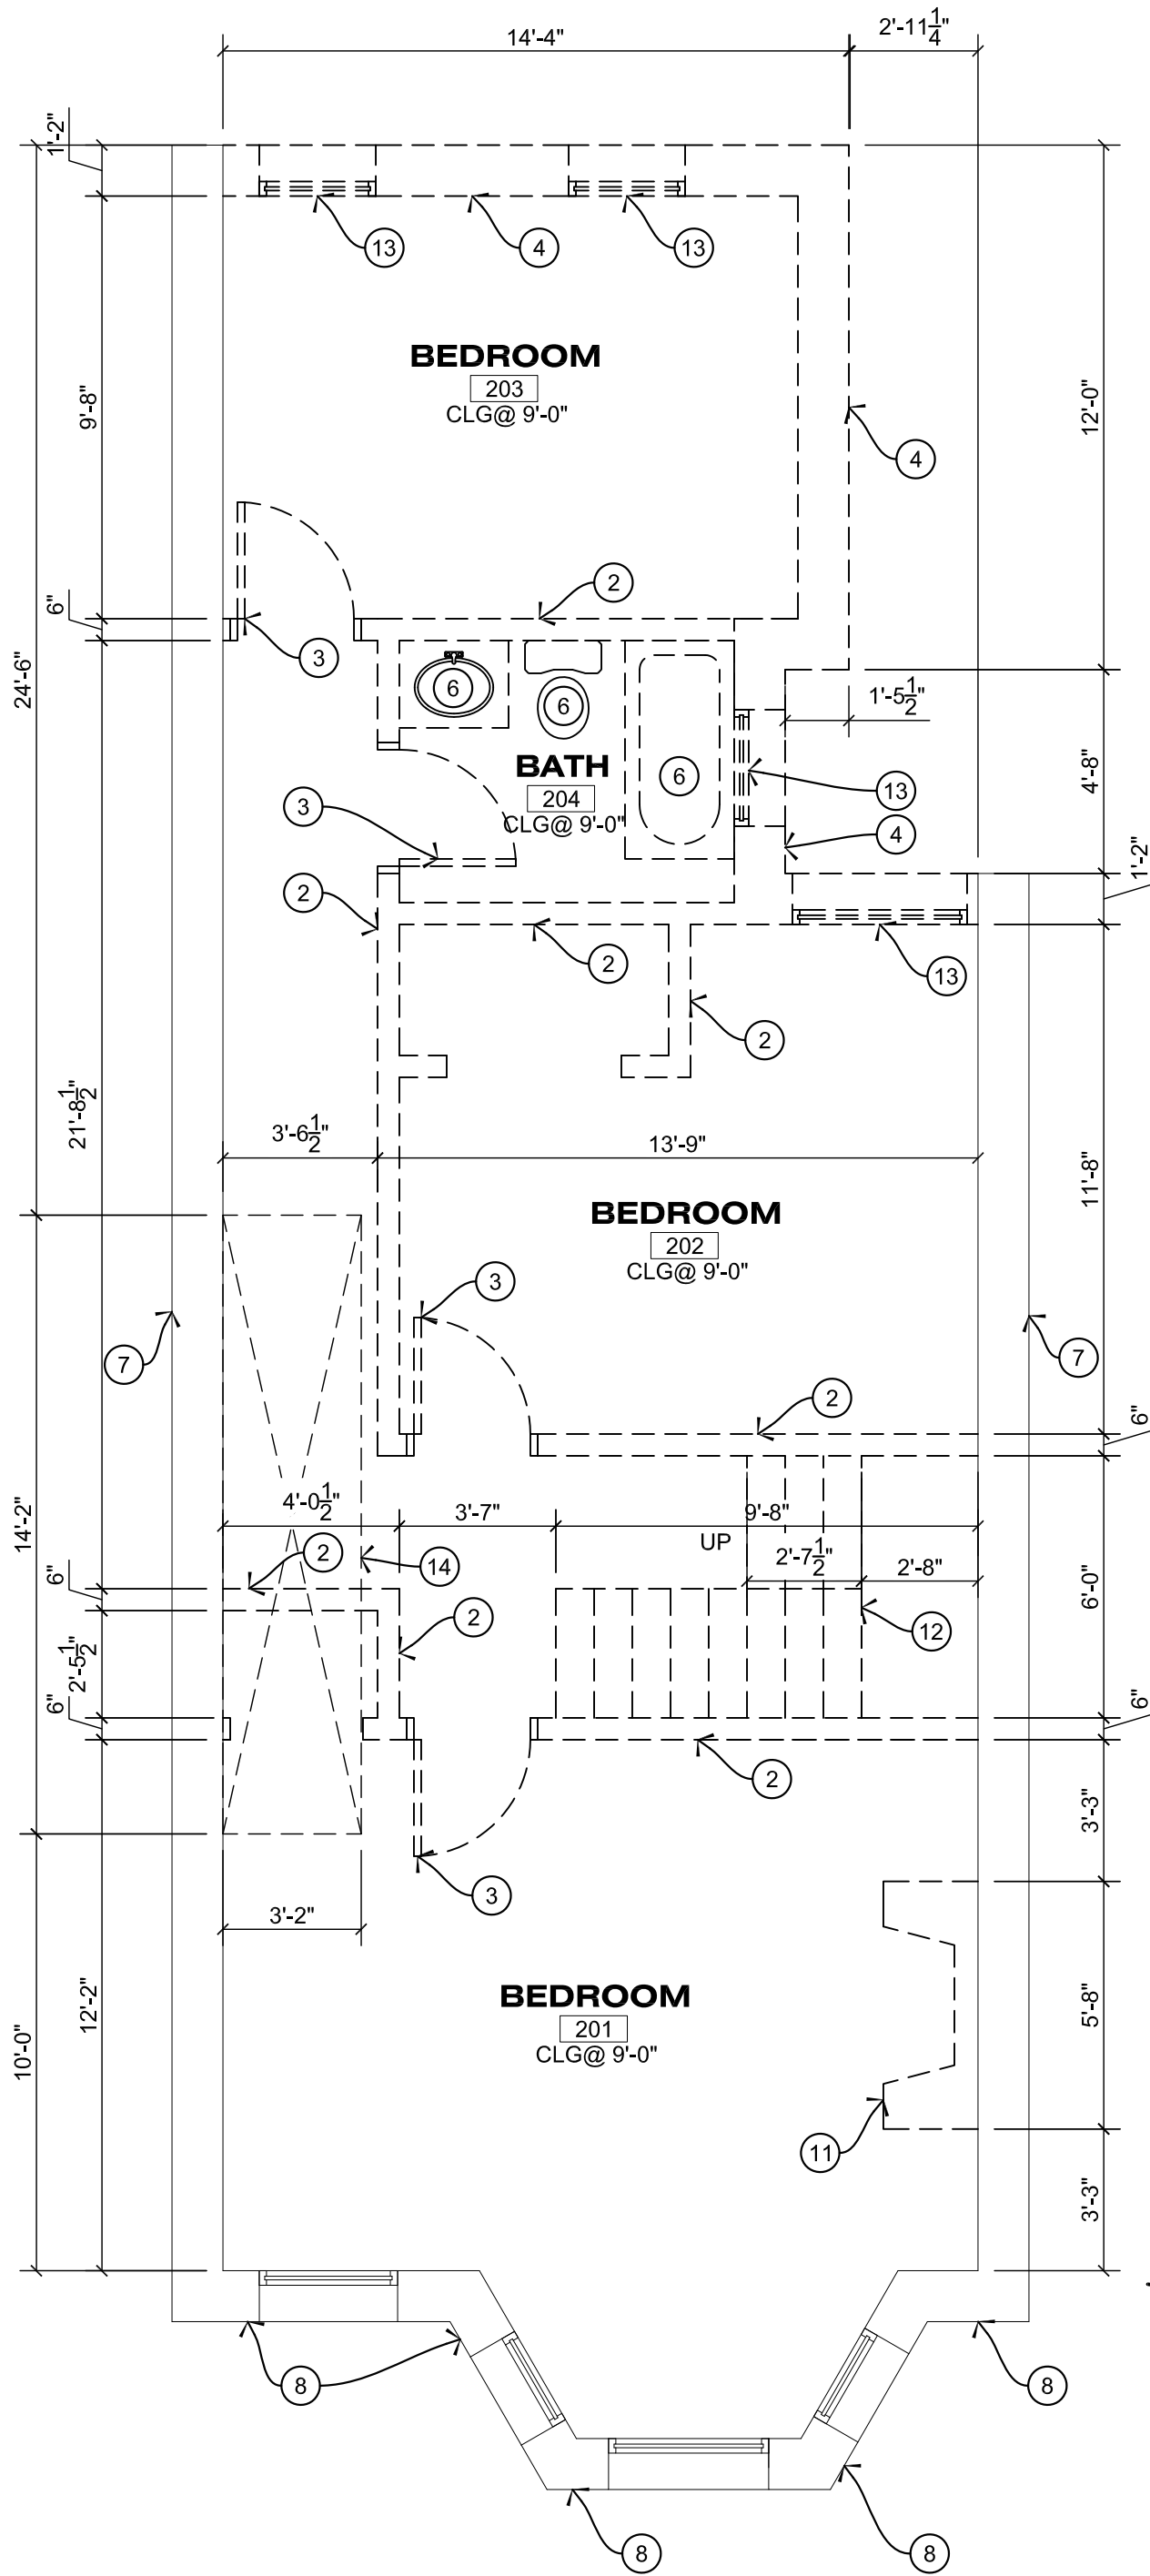


SECOND FLOOR PLAN

SCALE: 1/4" = 1'-0"

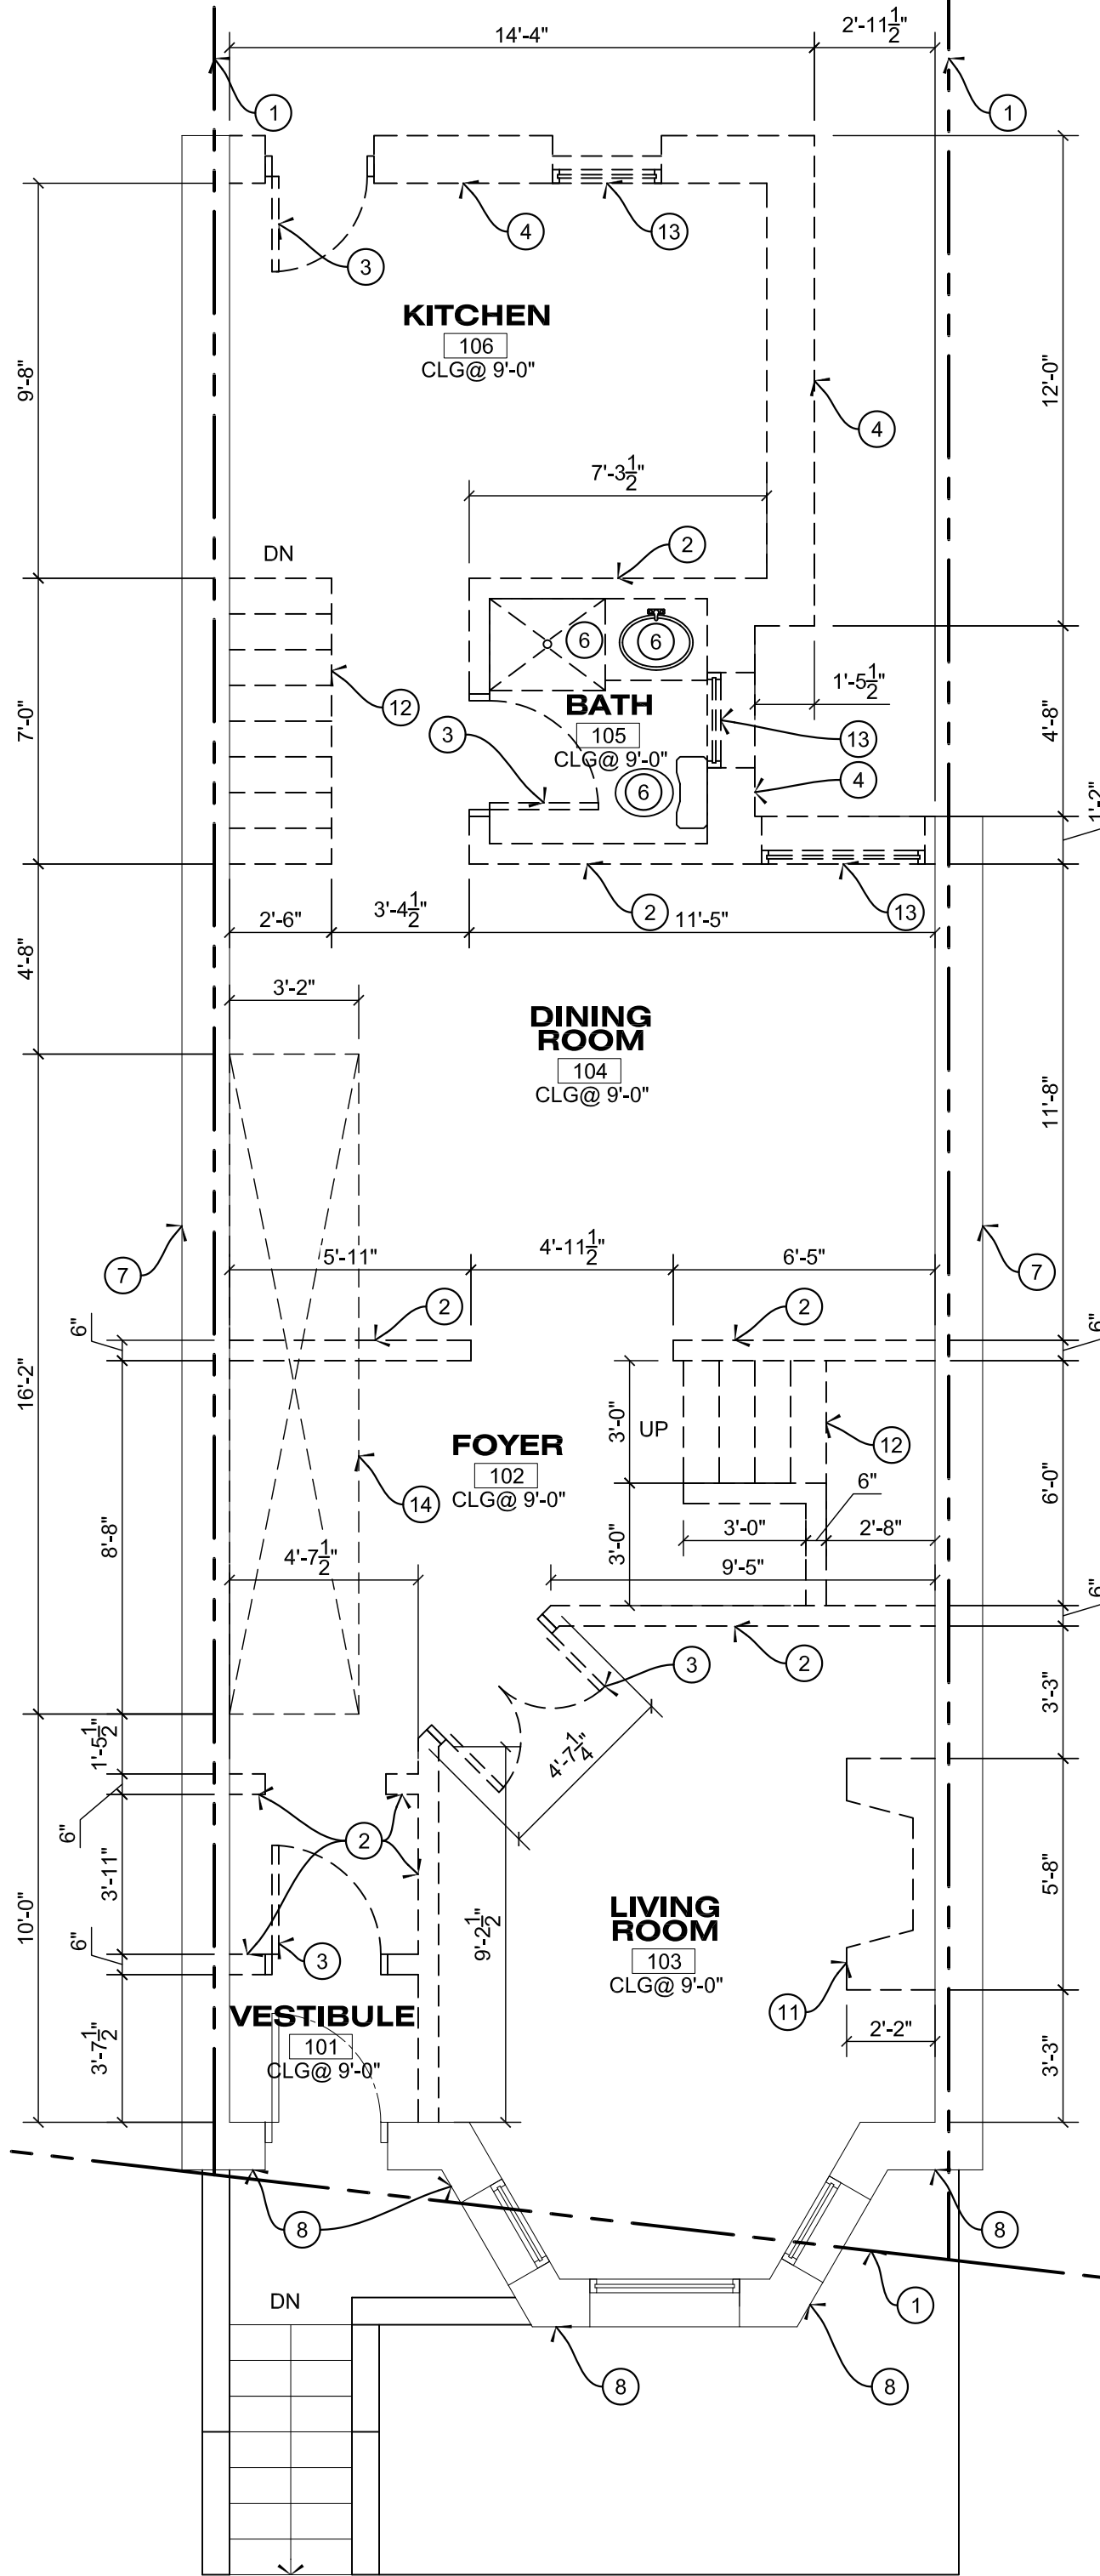

FIRST FLOOR PLAN

SCALE: 1/4" = 1'-0"

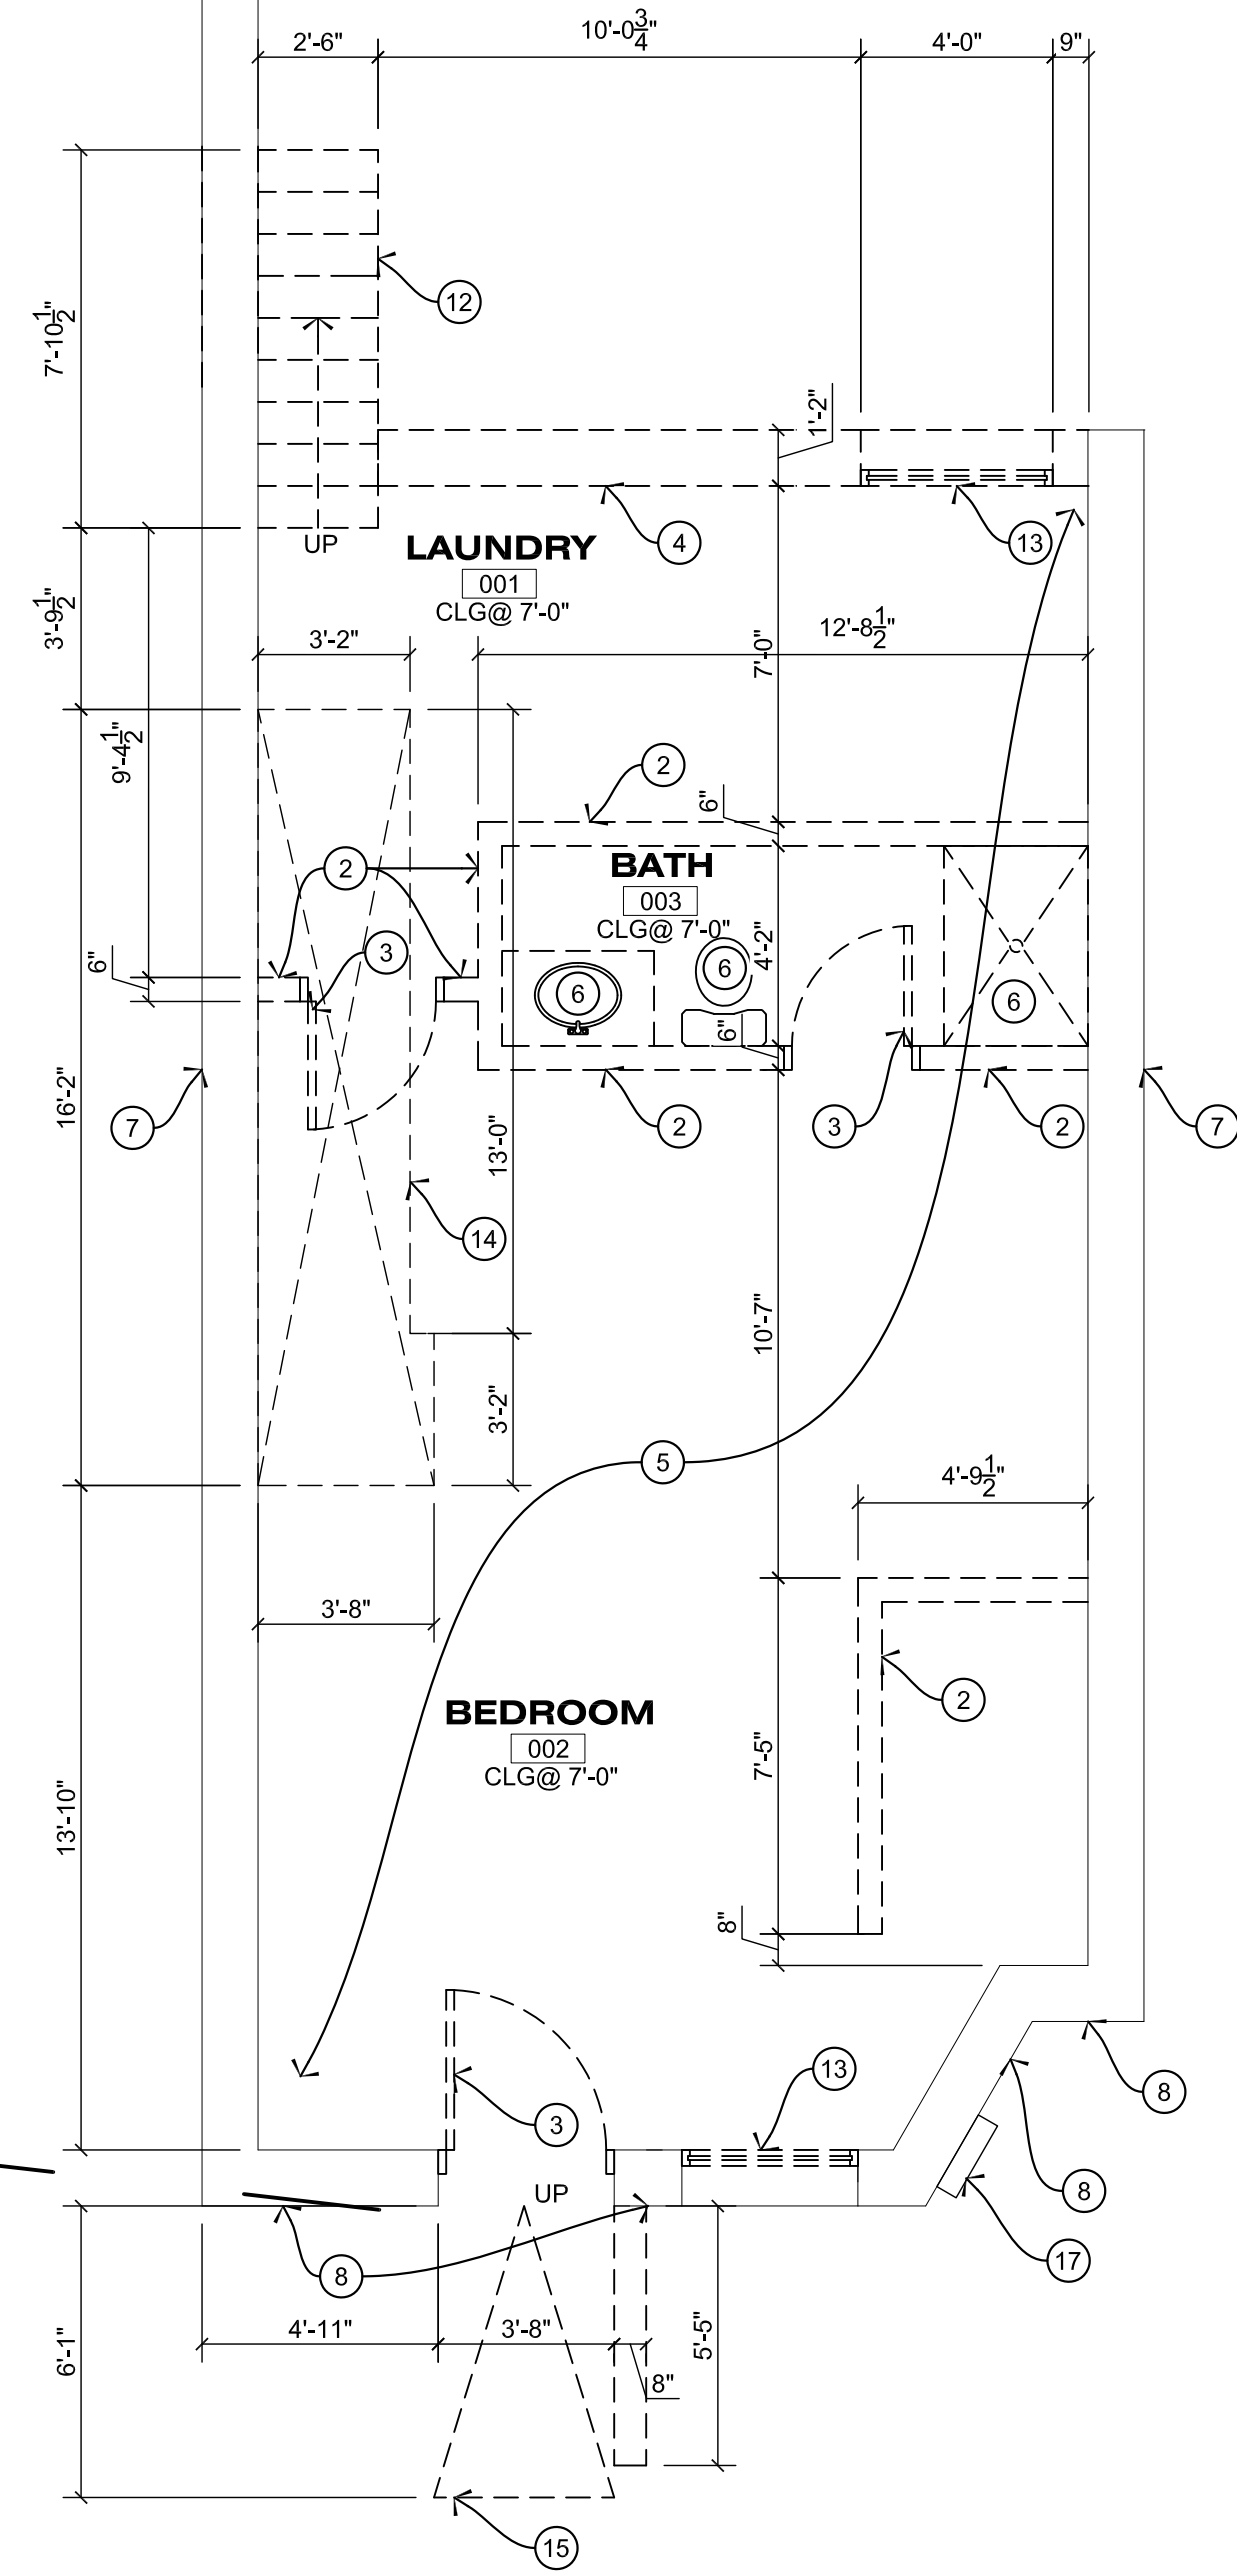

BASEMENT PLAN

SCALE: 1/4" = 1'-0"

GENERAL DEMOLITION NOTES

- A. THE WORK MAY INCLUDE DEMOLITION OF EXISTING CONSTRUCTION; REMOVAL OF VARIOUS ITEMS OF EQUIPMENT AND CONSTRUCTION, AND THE CUTTING OR ALTERATION OF EXISTING CONSTRUCTION AS SHOWN, NOTED OR IMPLIED ON THE DRAWINGS. CONTRACTOR SHALL DETERMINE AND INVENTORY ALL NECESSARY DEMOLITION AND ALTERATION OF ITEMS TO PROVIDE FOR A COMPLETE INSTALLATION OF NEW WORK. ALL COSTS OF REMOVAL, REPAIR OR REPLACEMENT SHALL BE INCLUDED IN THE BID. ADDITIONAL COSTS FOR DEMOLITION OF ITEMS HIDDEN OR INACCESSIBLE DURING THE BIDDING PHASE, SHALL BE SUBMITTED FOR APPROVAL PRIOR TO BEGINNING THE WORK.
- B. AT ALTERED CONSTRUCTION, REPAIR CUT EDGES, REPLACE CONSTRUCTION, AND FIT NEW TO EXISTING WORK. MAKE JOINTS OF NEW AND EXISTING PATCHES VERY SMOOTH, EVEN AND PRACTICALLY INVISIBLE. COORDINATE ALL REPLACEMENT AND REPAIR REQUIREMENTS WITH OWNER.
- C. SAW-CUT CONCRETE WITH DIAMOND SAW; JACK HAMMERING WILL NOT BE PERMITTED EXCEPT WITH THE EXPRESSED WRITTEN APPROVAL OF THE OWNER. CUT IN ACCURATELY LOCATED, STRAIGHT LINES, AND BREAK OUT SECTIONS. FLOOR MAY BE CORE DRILLED WHERE APPROPRIATE FOR INSTALLATION OF PIPES AND SIMILAR ITEMS. COORDINATE ALL CORE LOCATIONS AND SLAB MODIFICATIONS WITH ARCHITECT'S STRUCTURAL ENGINEER. WHERE EXISTING PIPING AND OTHER SIMILAR ITEMS ARE UNDER EXISTING SLABS, EXERCISE CARE TO PROTECT FROM DAMAGE. EXERCISE CARE WHEN CUTTING ADJACENT TO EXISTING WALLS TO AVOID DAMAGE TO WALLS. IF DAMAGED, REPAIR AS REQUIRED TO ORIGINAL CONDITION. PROVIDE SLAB X-RAY SERVICES AS REQUIRED.
- D. DOORS & FRAMES: IF DOORS AND FRAMES ARE TO BE REUSED ON THE WORK, CAREFULLY REMOVE DOOR FROM FRAMES AND REMOVE FRAMES FROM OPENING, TAKING CARE TO AVOID DAMAGE. REMOVE HARDWARE, CLEAN, REFURBISH, AND STORE FOR REINSTALLATION WITH OWNER.

- WHERE INDICATED. FOR DOORS AND FRAMES TO BE SALVAGED, CAREFULLY REMOVE FROM OPENING AND DELIVER FOR STORAGE WHERE INDICATED.
- E. PREVENT MOVEMENT OR SETTLEMENT OF STRUCTURE. PROVIDE AND PLACE BRACING AND SHORING AND BE RESPONSIBLE FOR SAFETY AND SUPPORT OF STRUCTURE, AS DETERMINED BY G.C. ENLISTED STRUCTURAL ENGINEER. ASSUME LIABILITY FOR SUCH MOVEMENT, SETTLEMENT DAMAGE OR INJURY.
- F. ARRANGE AND PAY FOR DISCONNECTING, REMOVING AND CAPPING UTILITY SERVICES WITHIN AREAS AFFECTED BY DEMOLITION. COORDINATE REQUIRED MODIFICATION WITH OWNER.
- G. CAREFULLY REMOVE MATERIALS AND EQUIPMENT WHICH ARE INTENDED TO BE REUSED. STORE IN A SECURE LOCATION. REMOVE DEBRIS, REFUSE AND MATERIALS BEING DEMOLISHED IMMEDIATELY FROM THE SITE.
- H. ERECT AND MAINTAIN WEATHERPROOF AND DUST PROOF CLOSURES AND PARTITIONS TO

- PREVENT WEATHER DAMAGE OR SPREAD OF DUST, FUMES AND SMOKE TO OTHER PARTS OF THE BUILDING, IN ACCORDANCE WITH OWNER GUIDELINES AND STIPULATIONS.
- I. PERFORM DEMOLITION IN ACCORDANCE WITH APPLICABLE AUTHORITIES HAVING JURISDICTION.
- J. REPAIR ALL DEMOLITION IN EXCESS OF THAT REQUIRED AT NO COST TO THE OWNER.
- K. REMOVE FROM SITE CONTAMINATED, VERMIN INFESTED OR DANGEROUS MATERIALS ENCOUNTERED; DISPOSE OF BY SAFE MEANS TO PROTECT HEALTH OF WORKERS AND PUBLIC.

LEGEND

	DEMOLISH EXISTING WALL		REMOVE EXISTING WINDOW
	EXISTING WALL TO REMAIN		DEMOLISH EXISTING ROOF / DECK
	EXISTING WINDOW TO REMAIN		
	EXISTING DOOR TO REMAIN		
	REMOVE EXISTING DOOR		

KEYNOTES

- PROPERTY LINE
- DEMOLISH INTERIOR WALL
- REMOVE EXISTING DOOR AND FRAME
- DEMOLISH EXISTING EXTERIOR BRICK WALL
- DEMOLISH EXISTING SLAB ON GRADE
- REMOVE EXISTING PLUMBING FIXTURES
- EXISTING BRICK PARTY WALL TO REMAIN
- EXISTING DOOR TO REMAIN
- NOT USED.
- DEMOLISH EXISTING FIREPLACE
- DEMOLISH EXISTING STAIRS
- REMOVE EXISTING WINDOW
- REMOVE EXISTING ROOF OR DECK
- DEMOLISH EXISTING RAMP
- COMPLETELY DEMOLISH EXISTING ROOF STRUCTURE
- EXISTING ELECTRICAL METER

NOTE: FLOOR JOIST AND SUB-FLOOR SYSTEM TO REMAIN. REPAIR AND REPLACE ANY DAMAGED COMPONENTS AS NECESSARY

Project:

**WASHINGTON DC
TOWNHOUSE**

Seal:

Revision:

No.	Date	Description
-----	------	-------------

Issue:

Date	Description
------	-------------


Project Number:

Title:


**EXISTING - DEMOLITION
BASEMENT FLOOR PLAN
1ST FLOOR PLAN
2ND FLOOR PLAN
3RD FLOOR PLAN**

Sheet:


A200

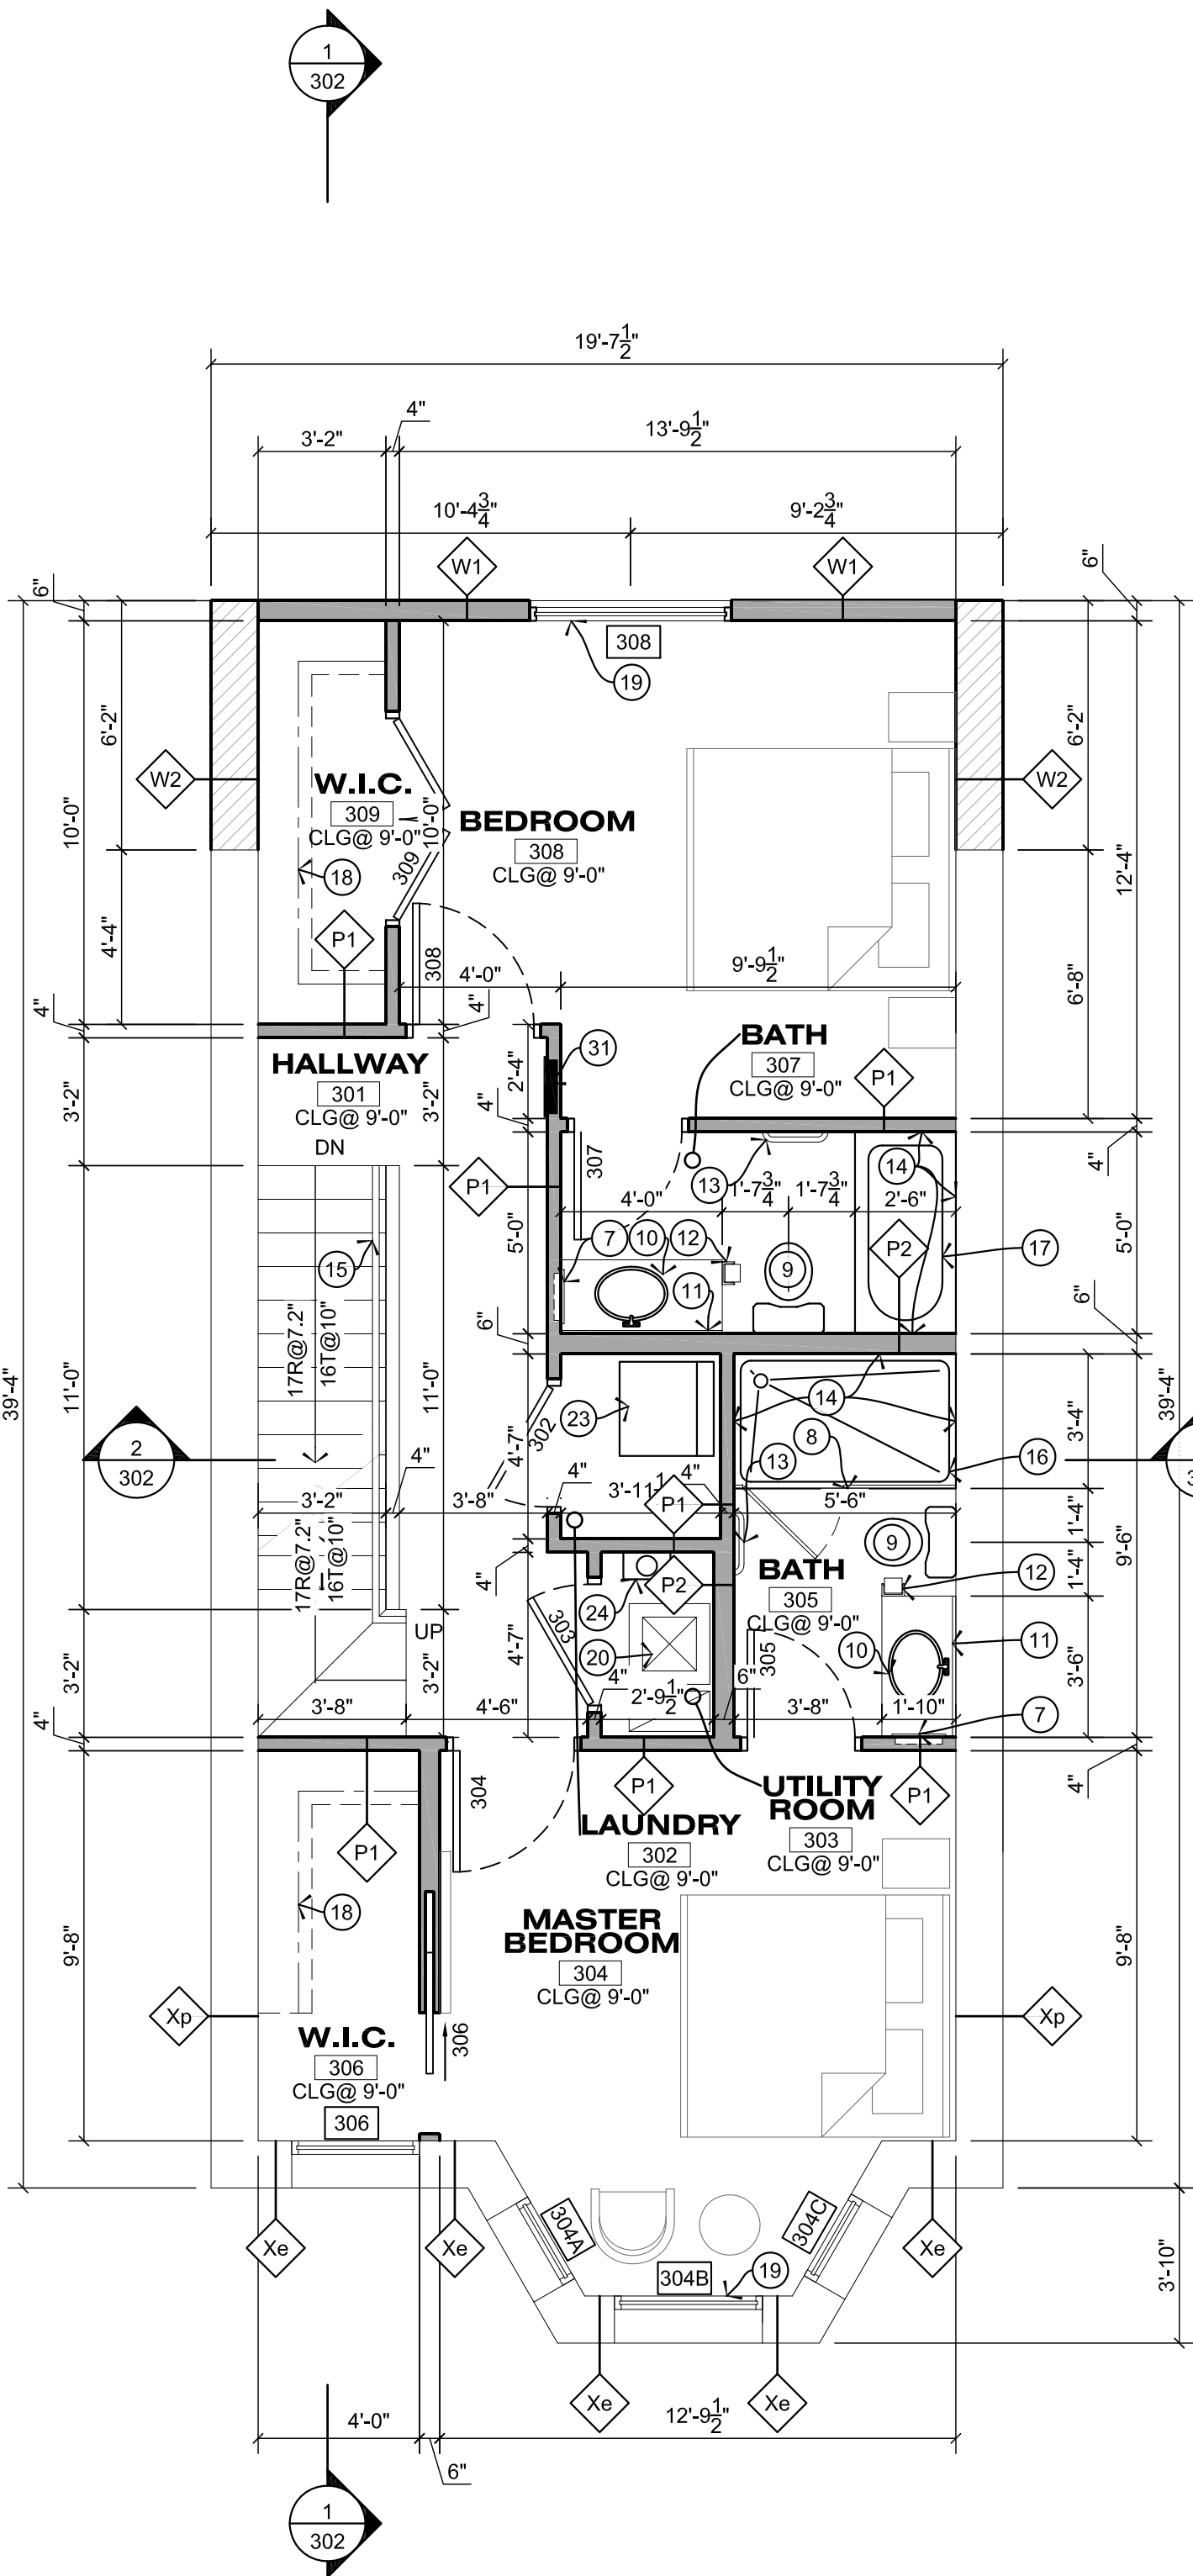


THIRD FLOOR PLAN
unit B

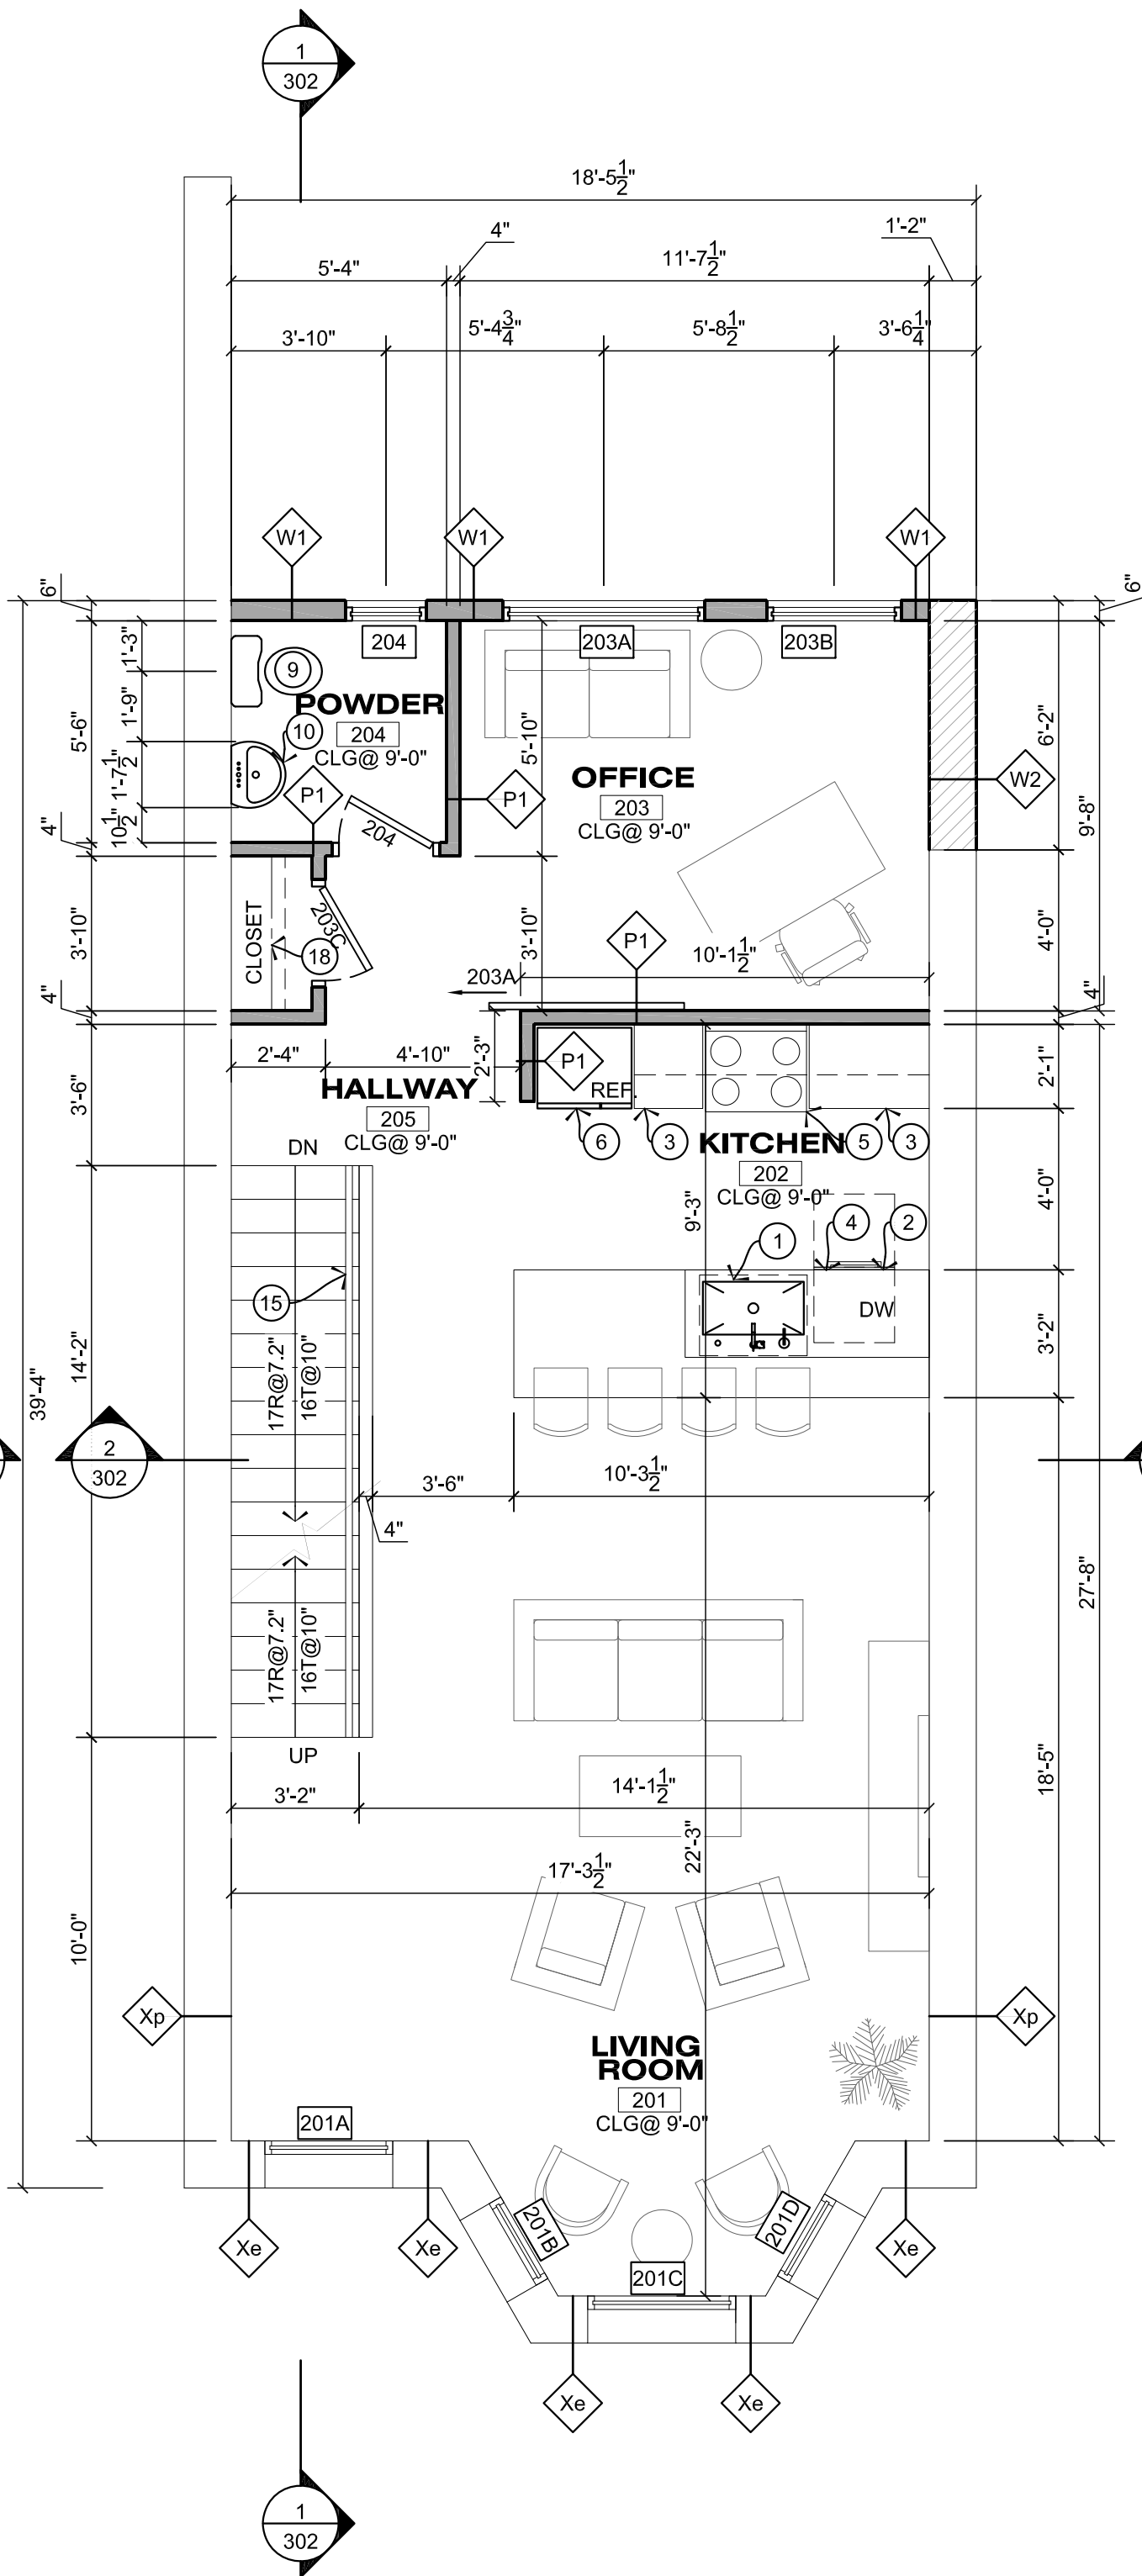

SECOND FLOOR PLAN
unit B

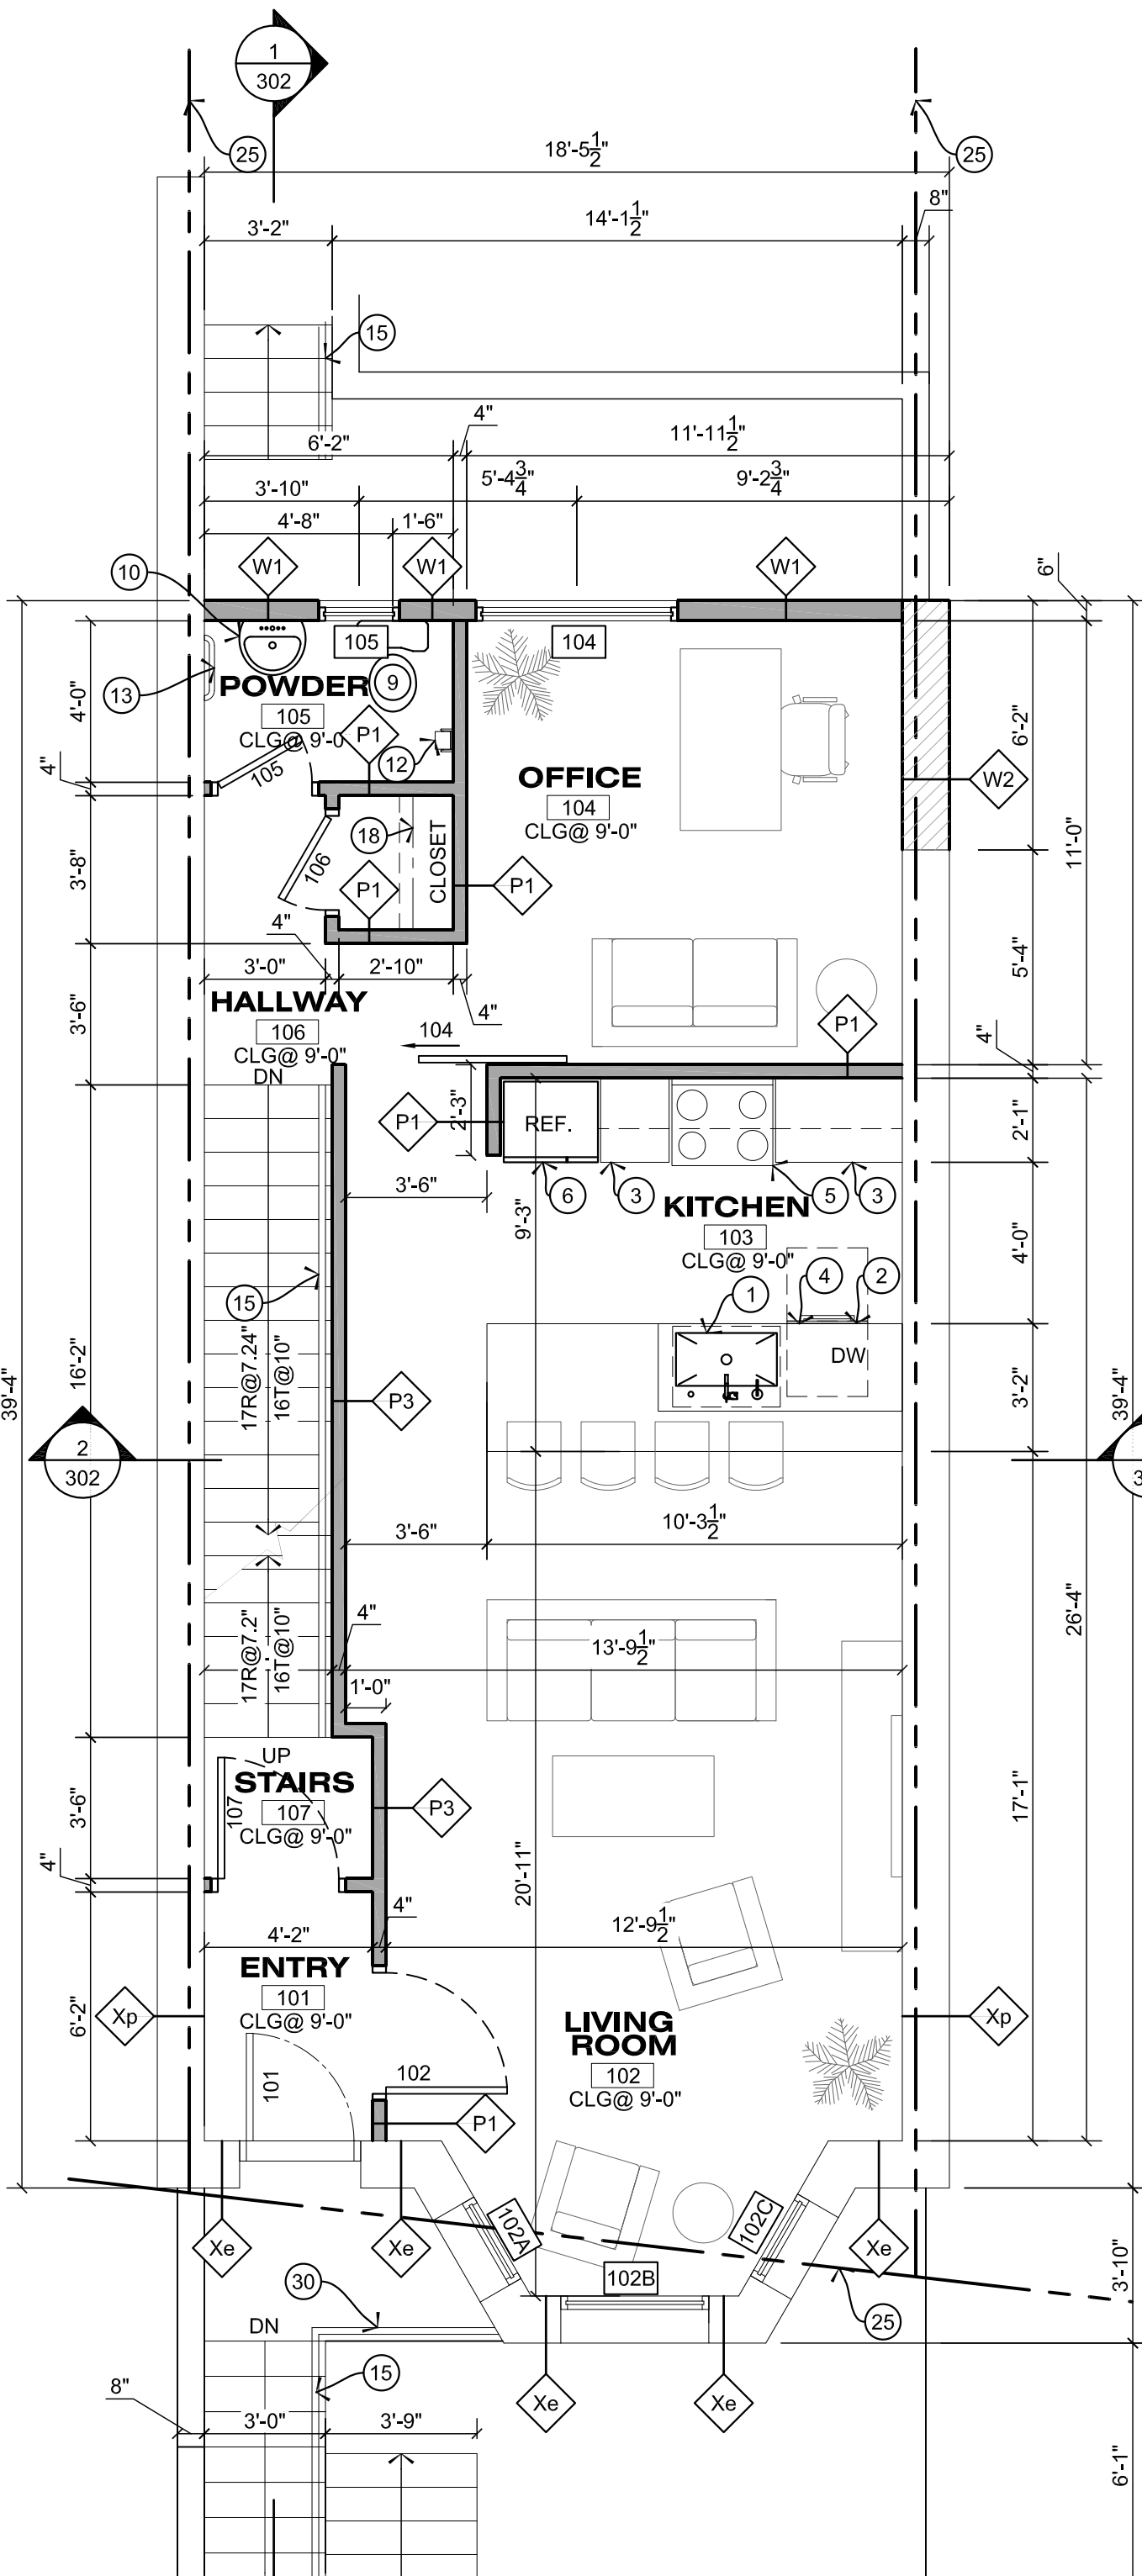

FIRST FLOOR PLAN
unit A

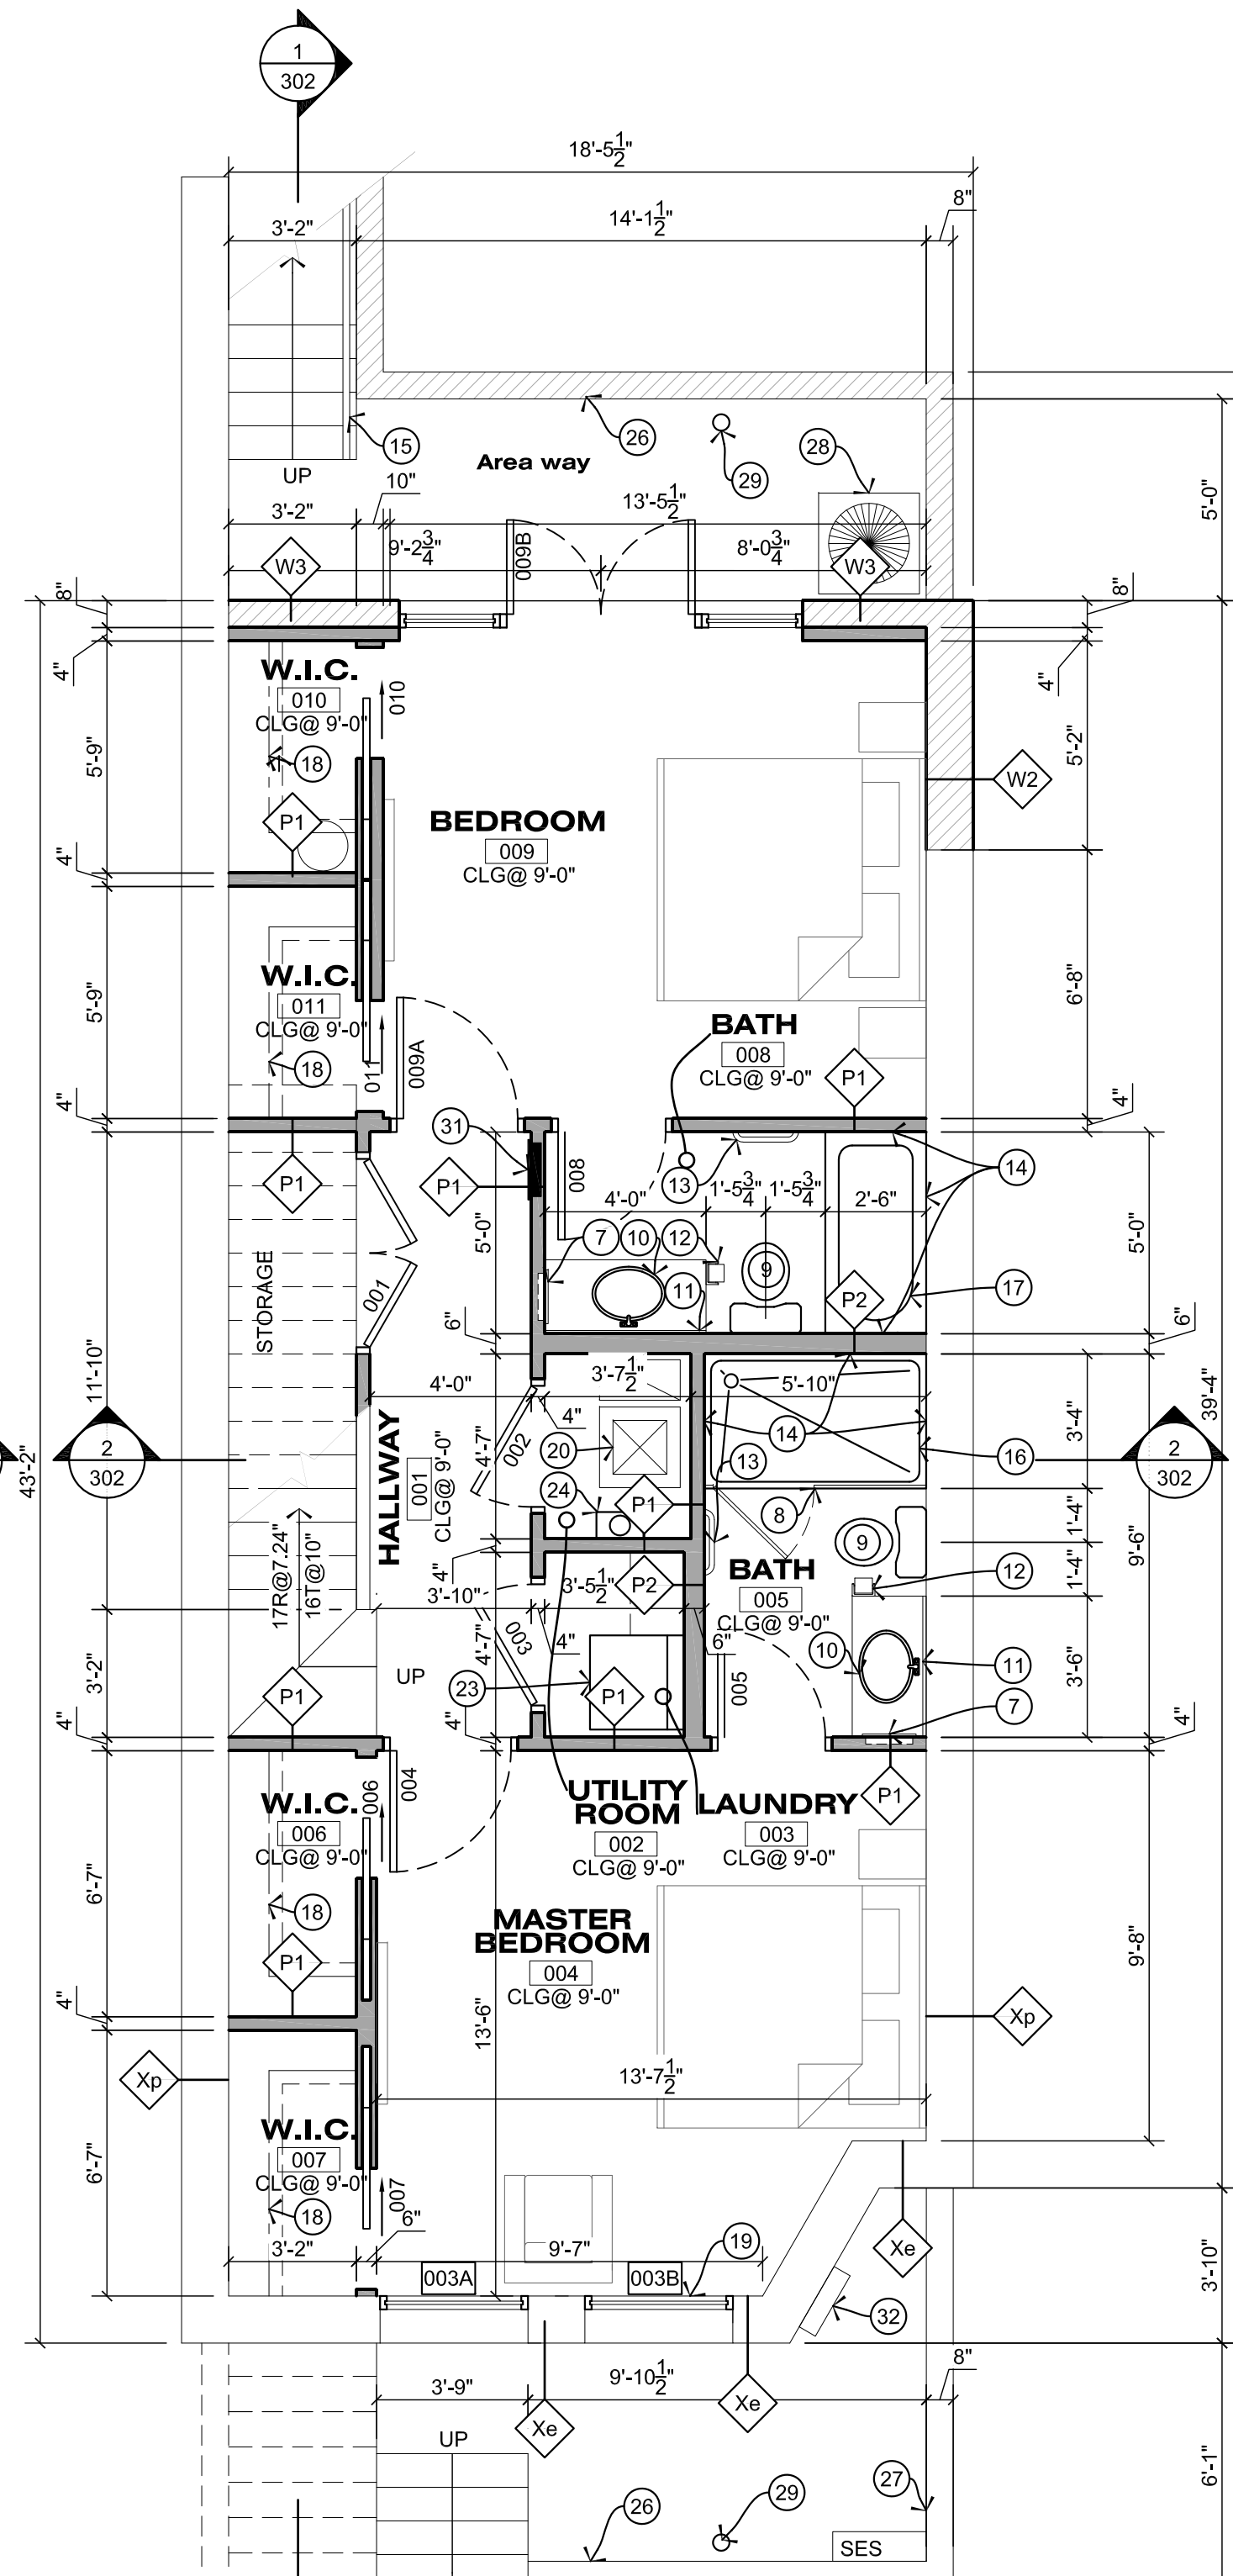

BASEMENT PLAN
unit A

Project:

**WASHINGTON DC
TOWNHOUSE**

Scale:

Revision:

No. Date Description

Issue:

Date Description

Project Number:

Title:

**NEW BASEMENT
FLOOR PLAN
NEW 1ST FLOOR PLAN
NEW 2ND FLOOR PLAN
NEW 3RD FLOOR PLAN**

Sheet:

A201

**ENERGY CONSERVATION
NOTES**

CONSTRUCTION DRAWINGS AND DOCUMENTATION
DEMONSTRATE ENERGY CODE COMPLIANCE FOR THE
BUILDING ENVELOPE.

SYSTEMS SERVING MULTIPLE DWELLING UNITS MUST
DEMONSTRATE COMPLIANCE WITH THE IECC COMMERCIAL
PROVISIONS

FENESTRATION
A. U-FACTORS OF FENESTRATION PRODUCTS ARE
DETERMINED IN ACCORDANCE WITH THE NFRC TEST
PROCEDURE OR TAKEN FROM THE DEFAULT TABLE

INSULATION
A. SLAB EDGE INSULATION INSTALLED PER
MANUFACTURER'S INSTRUCTIONS
B. ALL INSTALLED INSULATION IS LABELED OR THE
INSTALLED R-VALUES PROVIDED
C. WALL INSULATION IS INSTALLED PER MANUFACTURER'S
INSTRUCTIONS
D. CEILING INSULATION INSTALLED PER MANUFACTURER'S
INSTRUCTIONS. BLOWN INSULATION EVERY 300 SQ.FT.

AREA CALCULATIONS

UNIT A LIVABLE AREA: 1,412.1 SF
UNIT B LIVABLE AREA: 1,548.6 SF
TOTAL LIVABLE AREA: 2,960.7 SF
ENTRY: 30.6 SF
TOTAL: 2,991.3 SF

CONSTRUCTION SYSTEMS

FOR CONSTRUCTION SYSTEMS DETAILS
REFER TO SHEET A500

EXISTING EXTERIOR WALL TO REMAIN.

EXISTING PARTY WALL TO REMAIN

EXISTING ROOF TO REMAIN.

EXISTING 2X JOISTS AT 16" O.C. W/ NEW 3/4"
THICK PLYWOOD SHEATHING, REPAIR OR
REPLACE AS NEEDED

NEW EXTERIOR WALLS, W/STUCCO FINISH TO
MATCH EXISTING.
2 X 6 STUDS @ 16" O.C. AND 1/2" THICK GYPSUM
BOARD ON INTERIOR SIDE. 6" THICK R-19
FIBERGLASS BATT INSULATION.

NEW TRIPLE BRICK WALL, W/STUCCO FINISH TO
MATCH EXISTING.

8" THICK MASONRY WALL W/STUCCO FINISH.
5/8" THICK GYPSUM BOARD AND 2x FLAT
FURRING ON INTERIOR SIDE

NEW INTERIOR WALLS
2 X 4 STUDS @ 24" O.C. WITH GYPSUM BOARD
AND CERAMIC TILE AT 6'-0" A.F.F. MIN. AS
OCCURS. 3" THICK BATT FIBERGLAS
INSULATION IN PLUMBING WALLS.

NEW 1HR RATED INTERIOR WALLS
2 X 4 STUDS @ 24" O.C. WITH 5/8" SHEETROCK
BRAND FIRECODE CORE GYP. PANE, EACH SIDE.
REFER TO DETAIL.

NEW 4" THICK CONCRETE SLAB ON 4" A.B.C.

NEW STAIRS
2X JOISTS AT 16" O.C., TO MATCH EXISTING W/
3/4" THICK PLYWOOD SHEATHING AND 1/2"
GYPSUM BOARD CEILING

11-7/8" TJI JOISTS AT 16" O.C. W/ 3/4" PLYWOOD
SHEATHING AND 1/2" THICK GYPSUM BOARD
CEILING

1HR RATED DECK: 2X JOISTS AT 16" O.C. W/ 1"
NOMINAL WOOD SUB FLOOR AND 1" WOOD FINISH
FLOOR AND 1/2" OR 5/8" SHEETROCK BRAND
GYPSUM PANEL, FIRECODE C CORE

11-7/8" TJI JOISTS AT 16" O.C. W/ 1/2"
PLYWOOD SHEATHING AND 1/2" THICK
GYPSUM BOARD CEILING

LEGEND

XXX DOOR NUMBERS TAG
SEE DOOR SCHEDULE
REFER TO SHEET A400

WINDOW NUMBERS TAG, SEE
WINDOW SCHEDULE
REFER TO SCHEDULE A400

ROOM NAME

ROOM TAG


CONSTRUCTION SYSTEM TYPES TAG
REFER TO SHEET A300

KEYNOTES

SLOPE

KEYNOTES

- DOUBLE SINK WITH GARBAGE DISPOSAL,
REFER TO PLUMBING.
- 200 Amps ELECTRICAL PANEL, REFER TO
ELECTRICAL
- KITCHEN ISLAND CABINET
- 30" WIDE FREESTANDING RANGE/OVEN
WHODD VENT TO O.S.A. COORD. W/
MANUFACTURER'S REQUIREMENTS.
- REFRIGERATOR SPACE, PROVIDE 1/4" C.W.
LINE FOR ICE MAKER, SEE GEN. PLUMBING
NOTES
- RECESSED MEDICINE CABINET.
- 60"x30" ENAMEL FINISH STEEL TUB W/TEMP.
GLASS ENCLOSURE OR SHOWER CURTAIN
ROD.
- WATER CLOSET, REFER TO PLUMBING.
- LAVATORY, REFER TO PLUMBING.
- MIRROR.
- TOILET PAPER HOLDER
- TOWEL ROD
- FULL HEIGHT 1/2" THICK FIBERCEMENT
GLASSMATT BOARD AND CERAMIC TILE AT 6'-0"
A.F.F. MIN
- STAIR HANDRAIL AT 34" OVER TREAD NOSING
- SHOWER - PROVIDE SHOWER ENCLOSURE
- TUB
- ROD & SHELF
- EMERGENCY ESCAPE OPENABLE WINDOW,
- MIN. (W)20" X (H)48"
- AIR HANDLER UNIT
- 200 Amps ELECTRICAL PANEL, REFER TO
ELECTRICAL
- A/C UNIT COMPRESSOR
- STACKED WASHER & DRYER SPACE. WASHER -
PROVIDE WASHER BOX WITH WASTE DRAIN,
HOT & COLD WATER, REFER TO PLUMBING.
DRYER - PROVIDE G.I. VENTING FROM DRYER
(MIN. 4" DIA.) TO OUTSIDE WITH TOTAL LENGTH
LIMITED TO 14'-0" MAX. COMBINED HORIZ. &
VERT. (6" DIA TO 28'-0").
- WATER HEATER
- PROPERTY LINE
- EXISTING RETAINING WALL
- NEW RETAINING WALL
- AIR CONDENSER UNIT
- FLOOR DRAIN
- RAILING AT 36" A.F.F.
- 200 AMPS ELECTRICAL PANEL
- ELECTRICAL METER

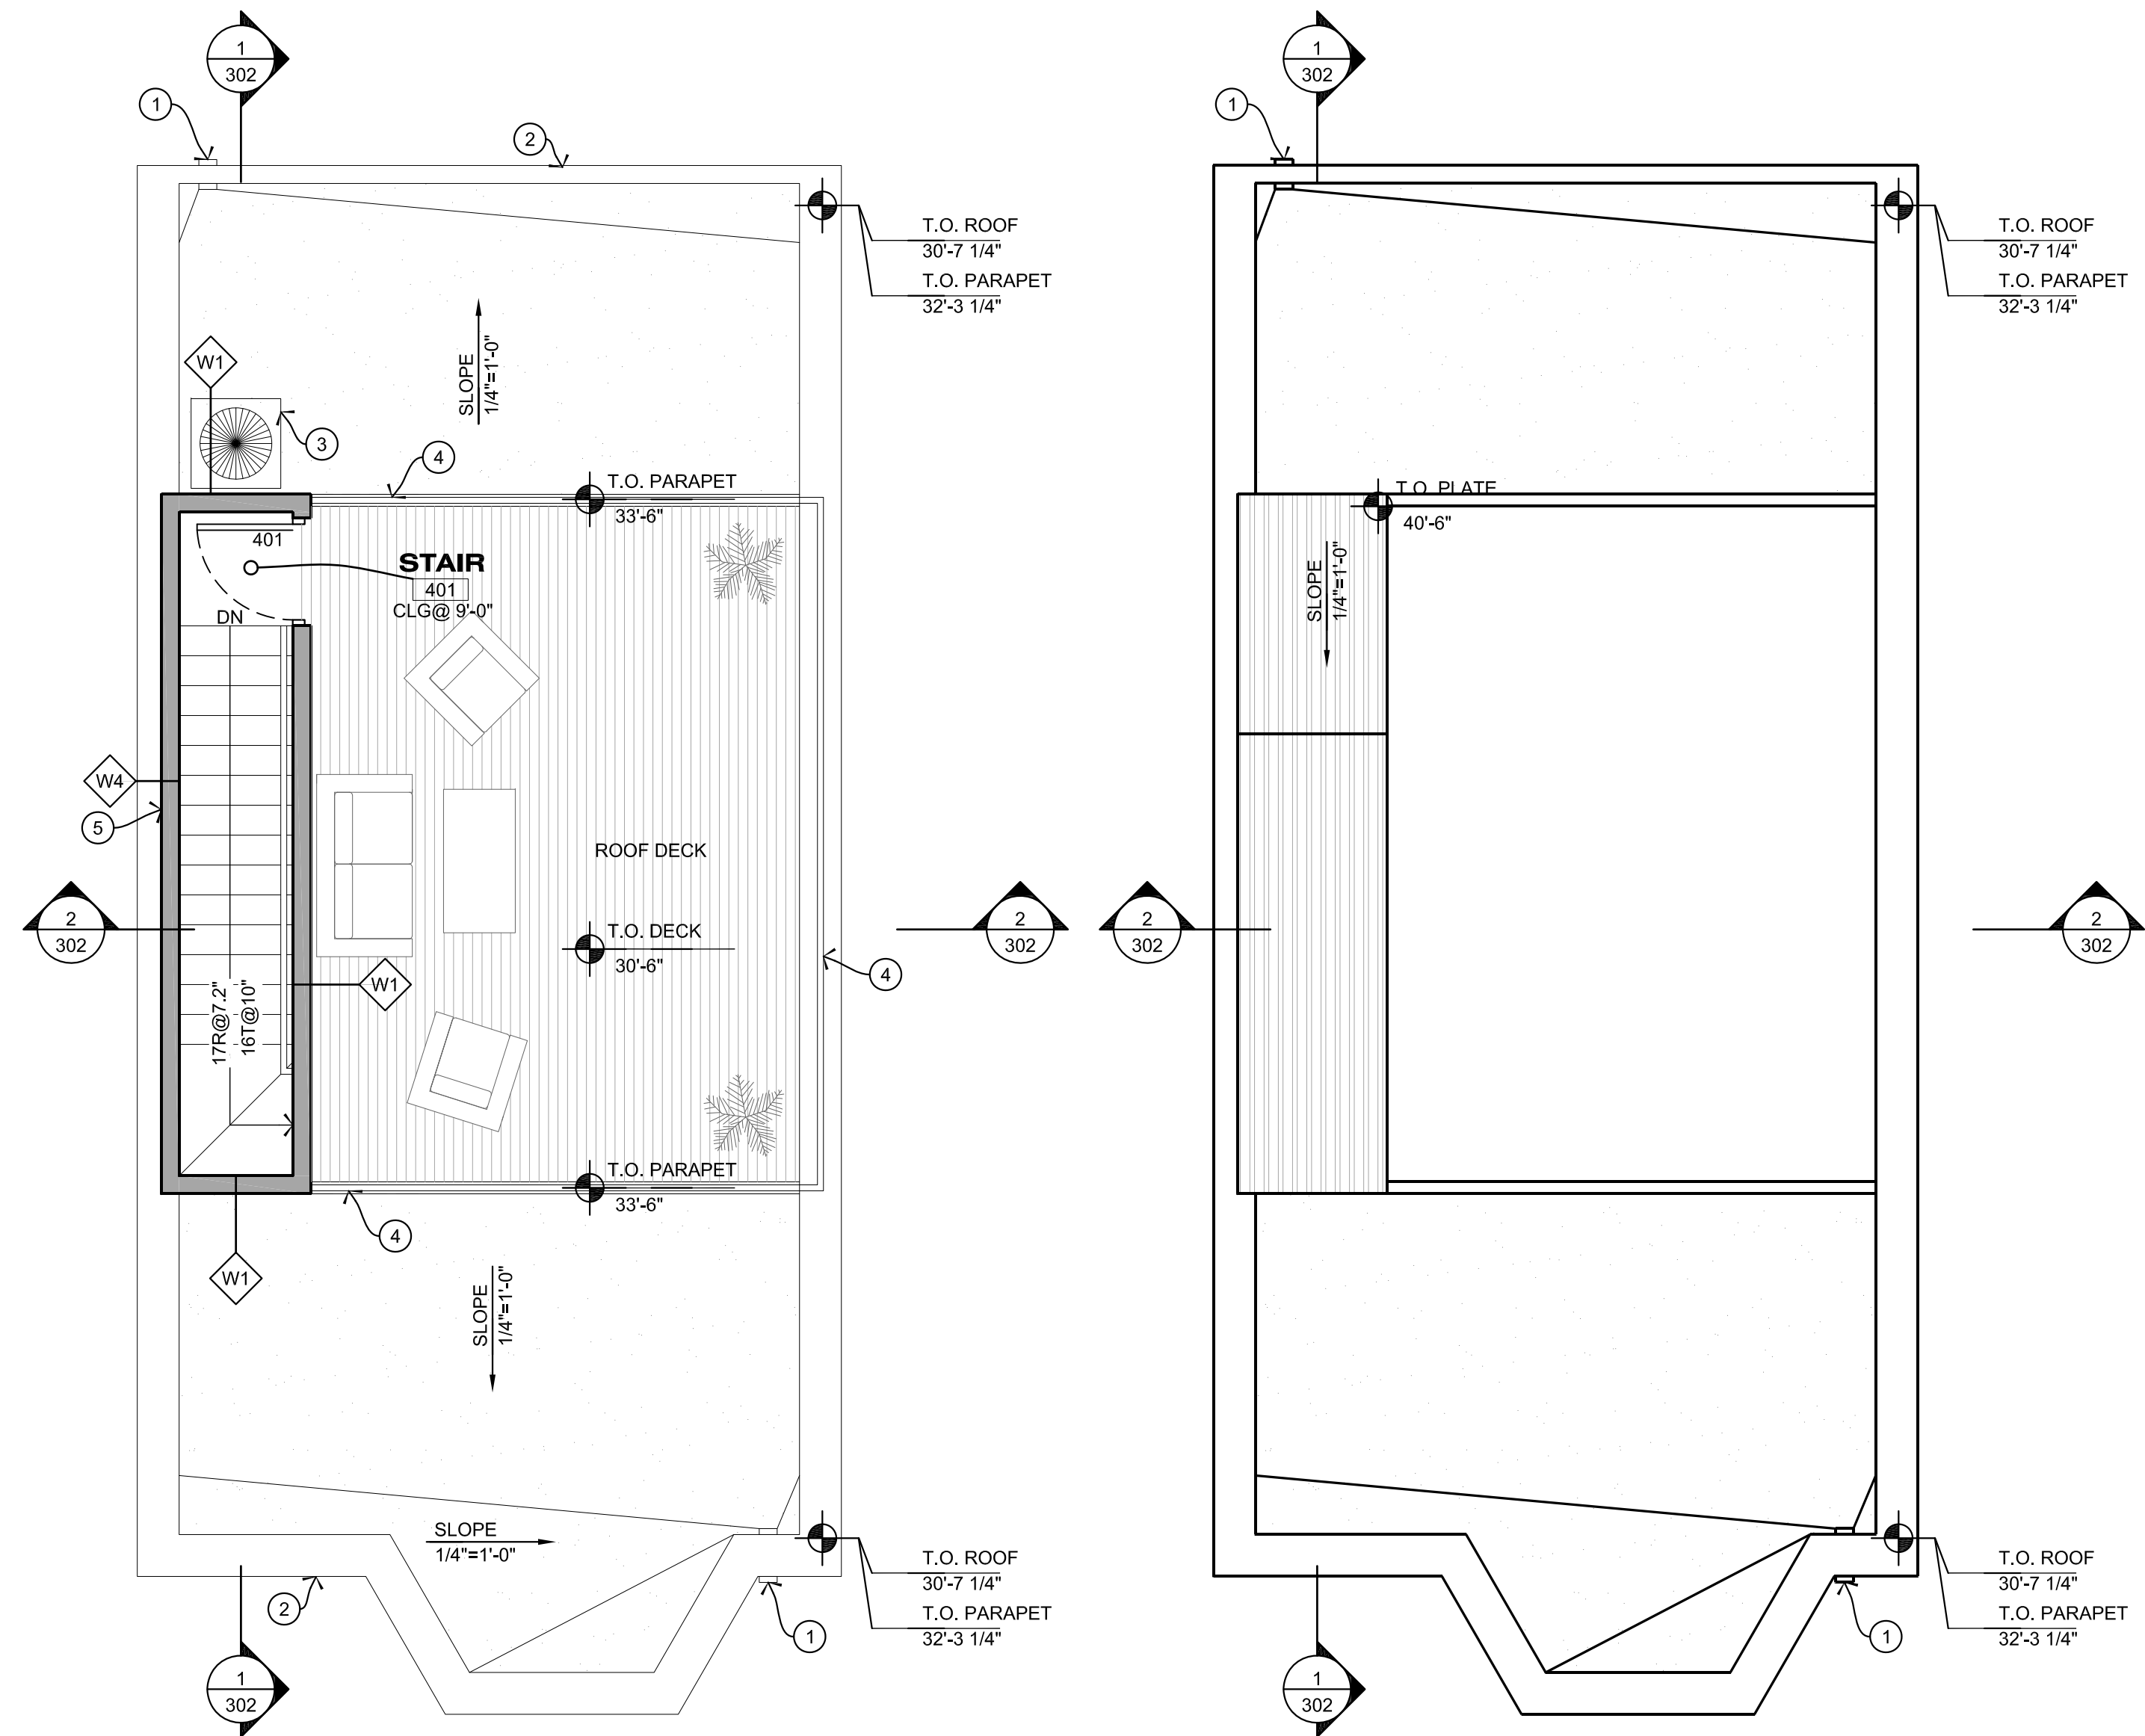

ROOF DECK PLAN
SCALE : 1/4" = 1'-0"
unit B

ROOF FLOOR PLAN
SCALE : 1/4" = 1'-0"
unit B

LEGEND		KEYNOTES
XXX	DOOR NUMBERS TAG SEE DOOR SCHEDULE REFER TO SHEETA400	1. SCUPPER 2. 2HR RATED PARAPET WALL 3. AIR CONDITION UNIT 4. METAL RAILING, PAINTED, AT 36" A.F.F. 5. 2H RATED WALL
XXX	WINDOW NUMBERS TAG, SEE WINDOW SCHEDULE REFER TO SCHEDULE A400	
ROOM NAME XXX	ROOM TAG	
X	CONSTRUCTION SYSTEM TYPES TAG REFER TO SHEET A300	
X	KEYNOTES	
SLOPE X	SLOPE	

Project:
**WASHINGTON DC
TOWNHOUSE**


Seal:

Revision:		
No.	Date	Description
Issue:		
Date	Description	

Project Number:


Title:
NEW ROOF PLAN

Sheet:

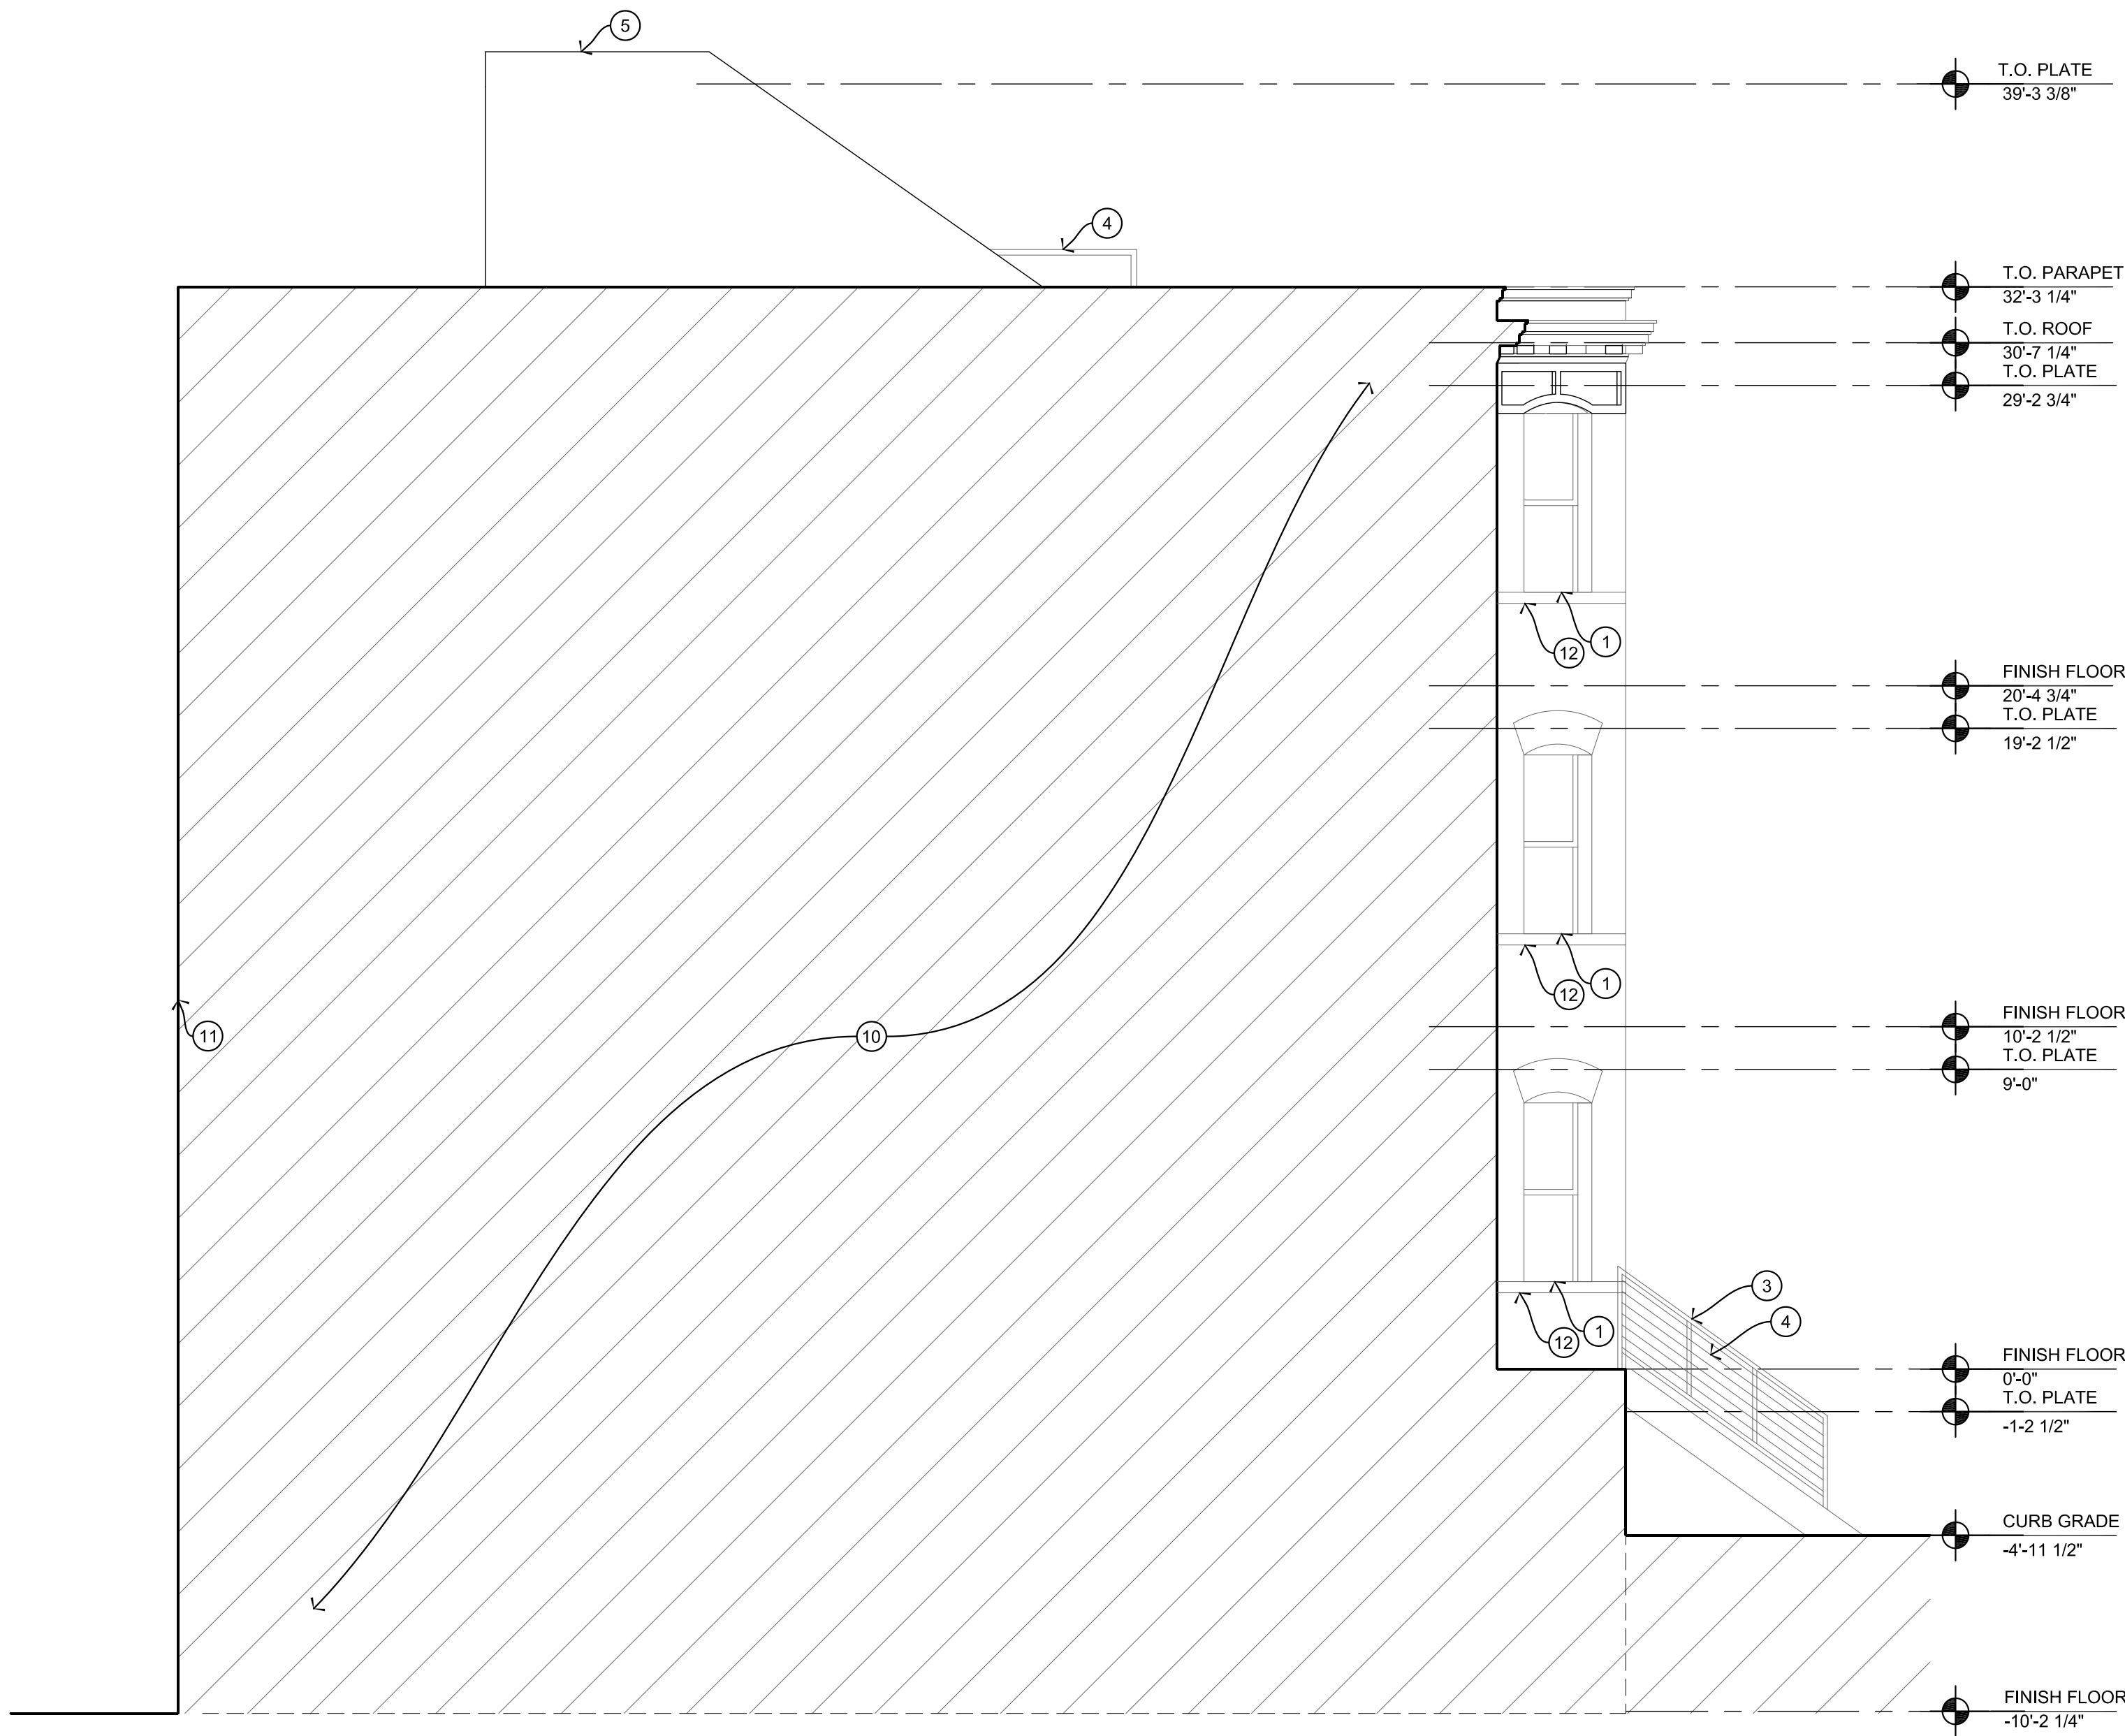

LEFT ELEVATION

SCALE: 1/4" = 1'-0"

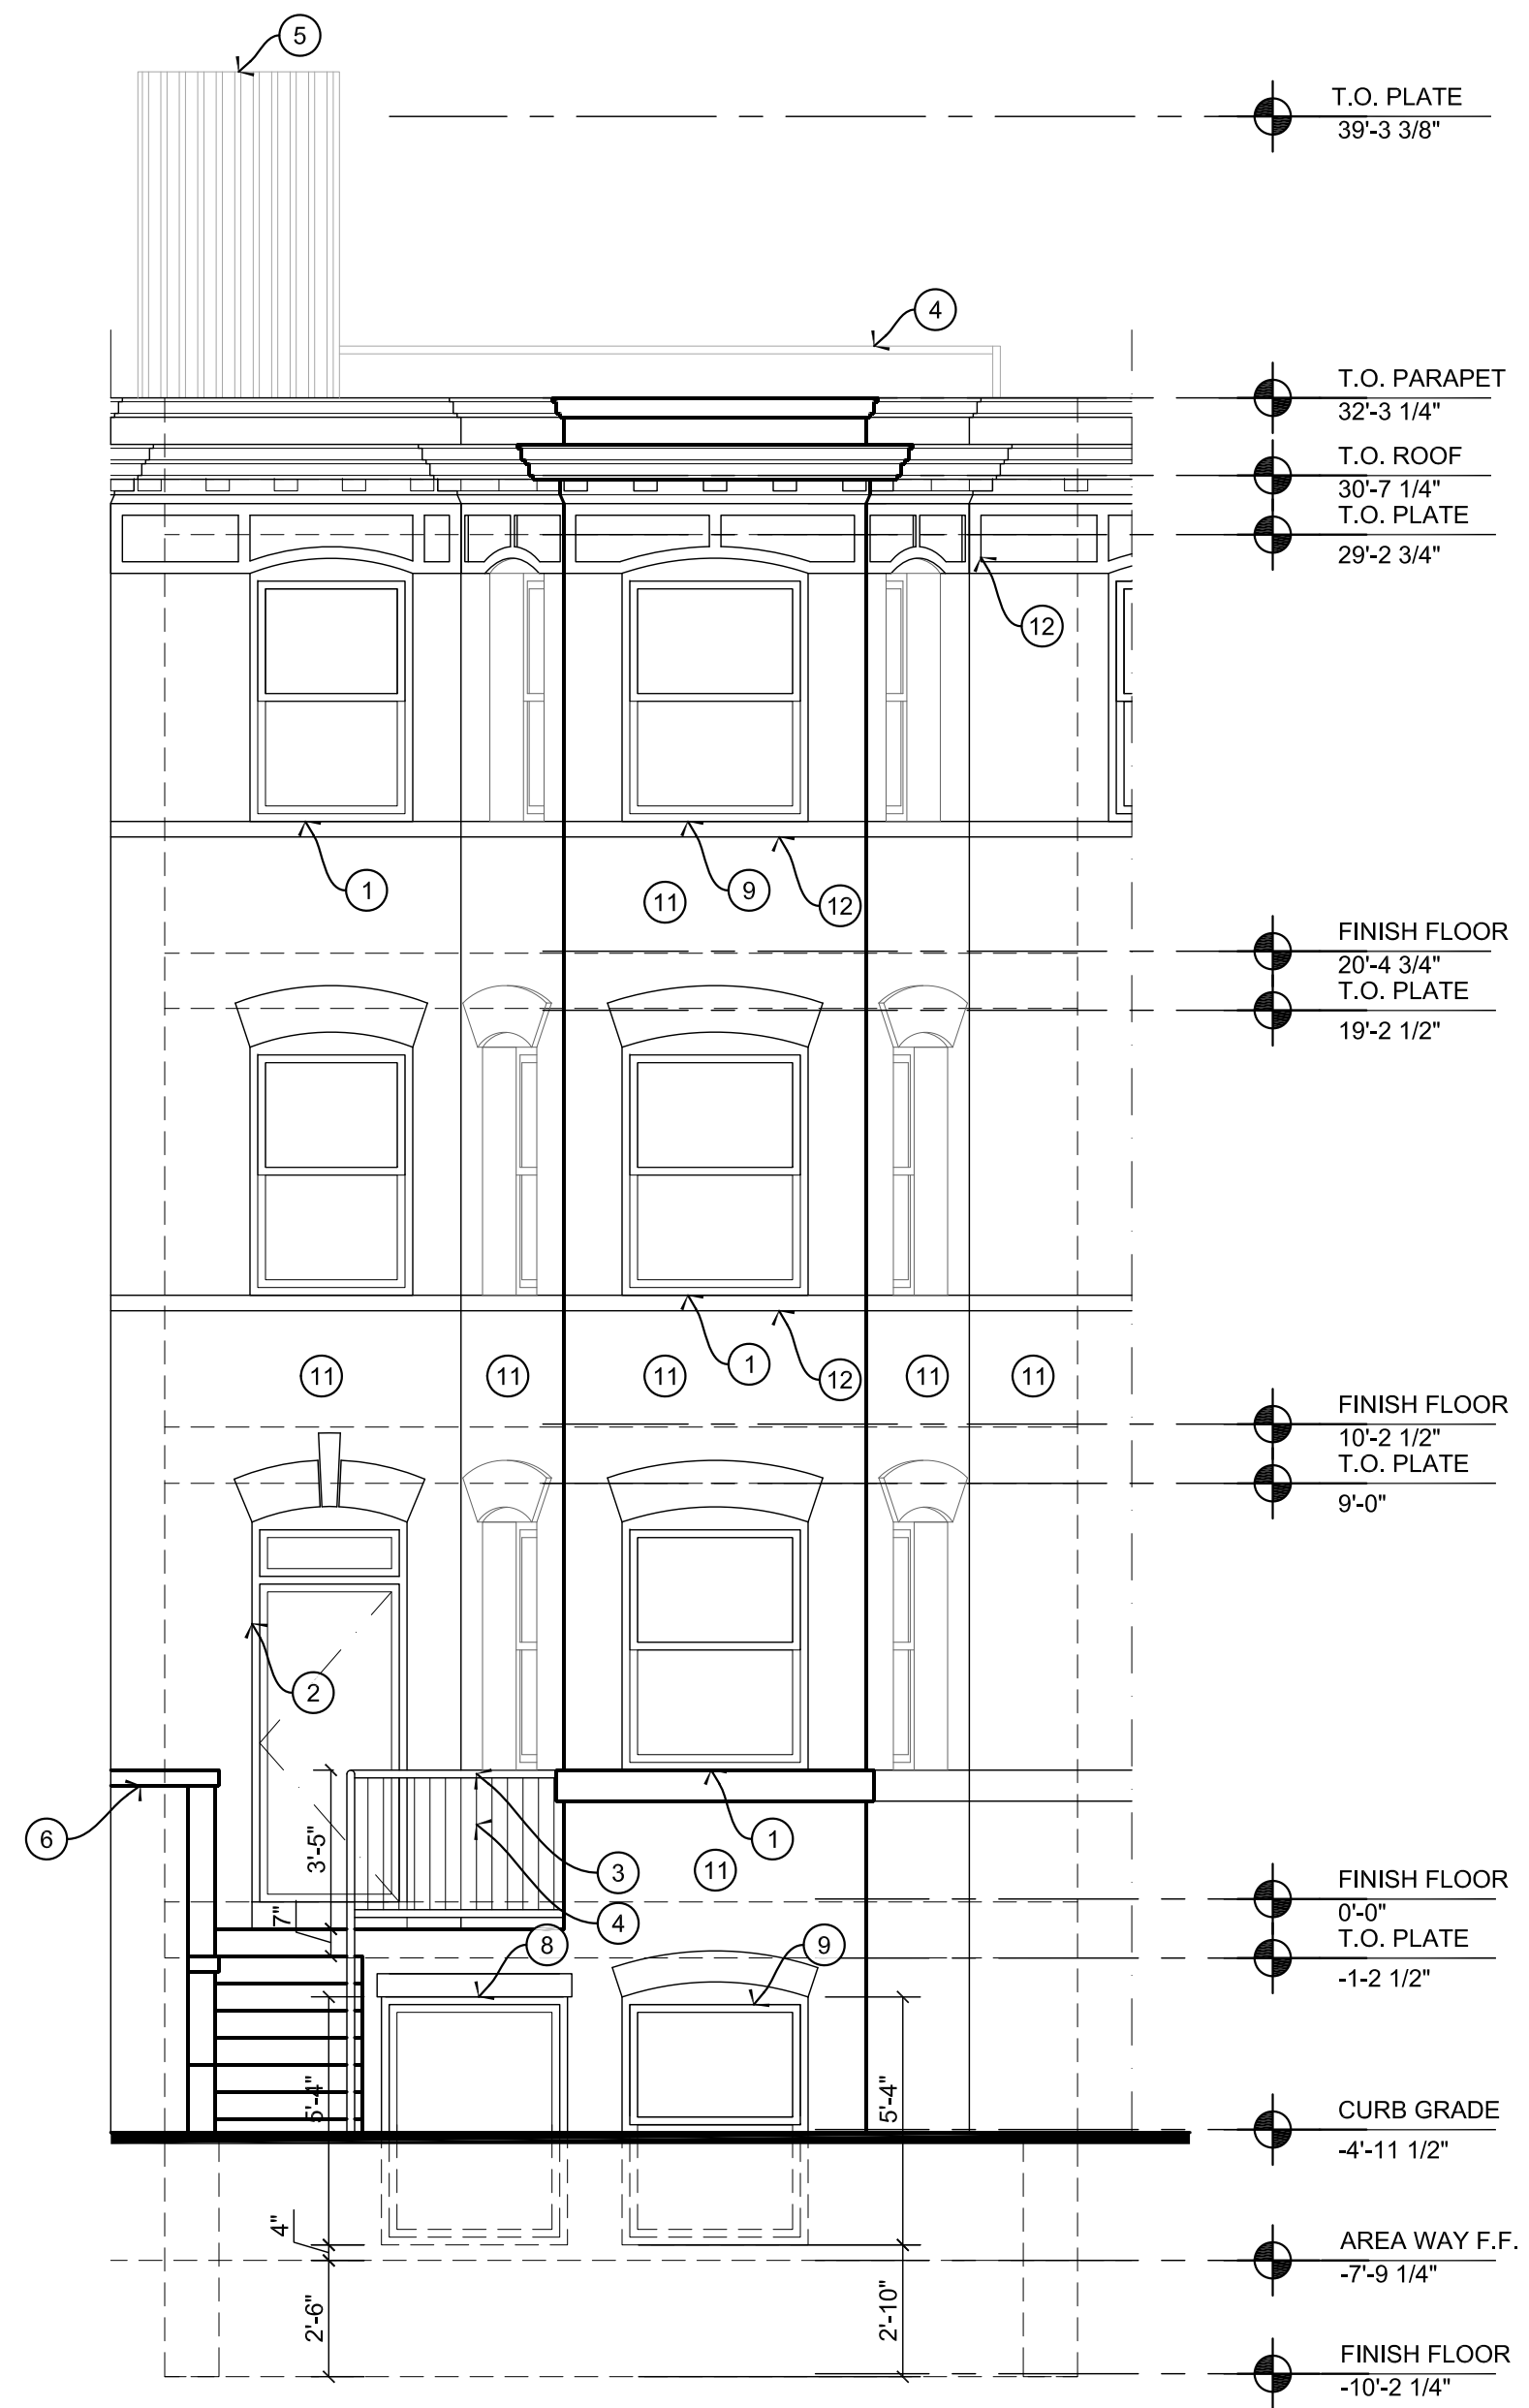

11TH ST. ELEVATION

SCALE: 1/4" = 1'-0"

KEYNOTES

- EXISTING WINDOW TO REMAIN
- EXISTING DOOR TO REMAIN
- NEW STAIR HANDRAIL AT 34" OVER TREAD NOSING
- NEW METAL RAILING, PAINTED, AT 36" A.F.F.
- STANDING SEAM METAL ROOFING
- EXISTING TO REMAIN 8" CMU WALL
- RETAINING WALL, 8" CMU, FULLY GROUTED
- NEW WINDOW
- NEW EGRESS WINDOW
- PARTY WALL
- EXISTING EXTERIOR WALL TO REMAIN
- EXISTING FACADE DECORATION TO REMAIN
- NEW DOOR
- NEW EXTERIOR WALLS, W/STUCCO FINISH TO MATCH EXISTING

Project:

**WASHINGTON DC
TOWNHOUSE**

Seal:

Revision:

No.	Date	Description
-----	------	-------------

Issue:

Date	Description
------	-------------



Project Number:

Title:

ELEVATIONS

Sheet:

A300

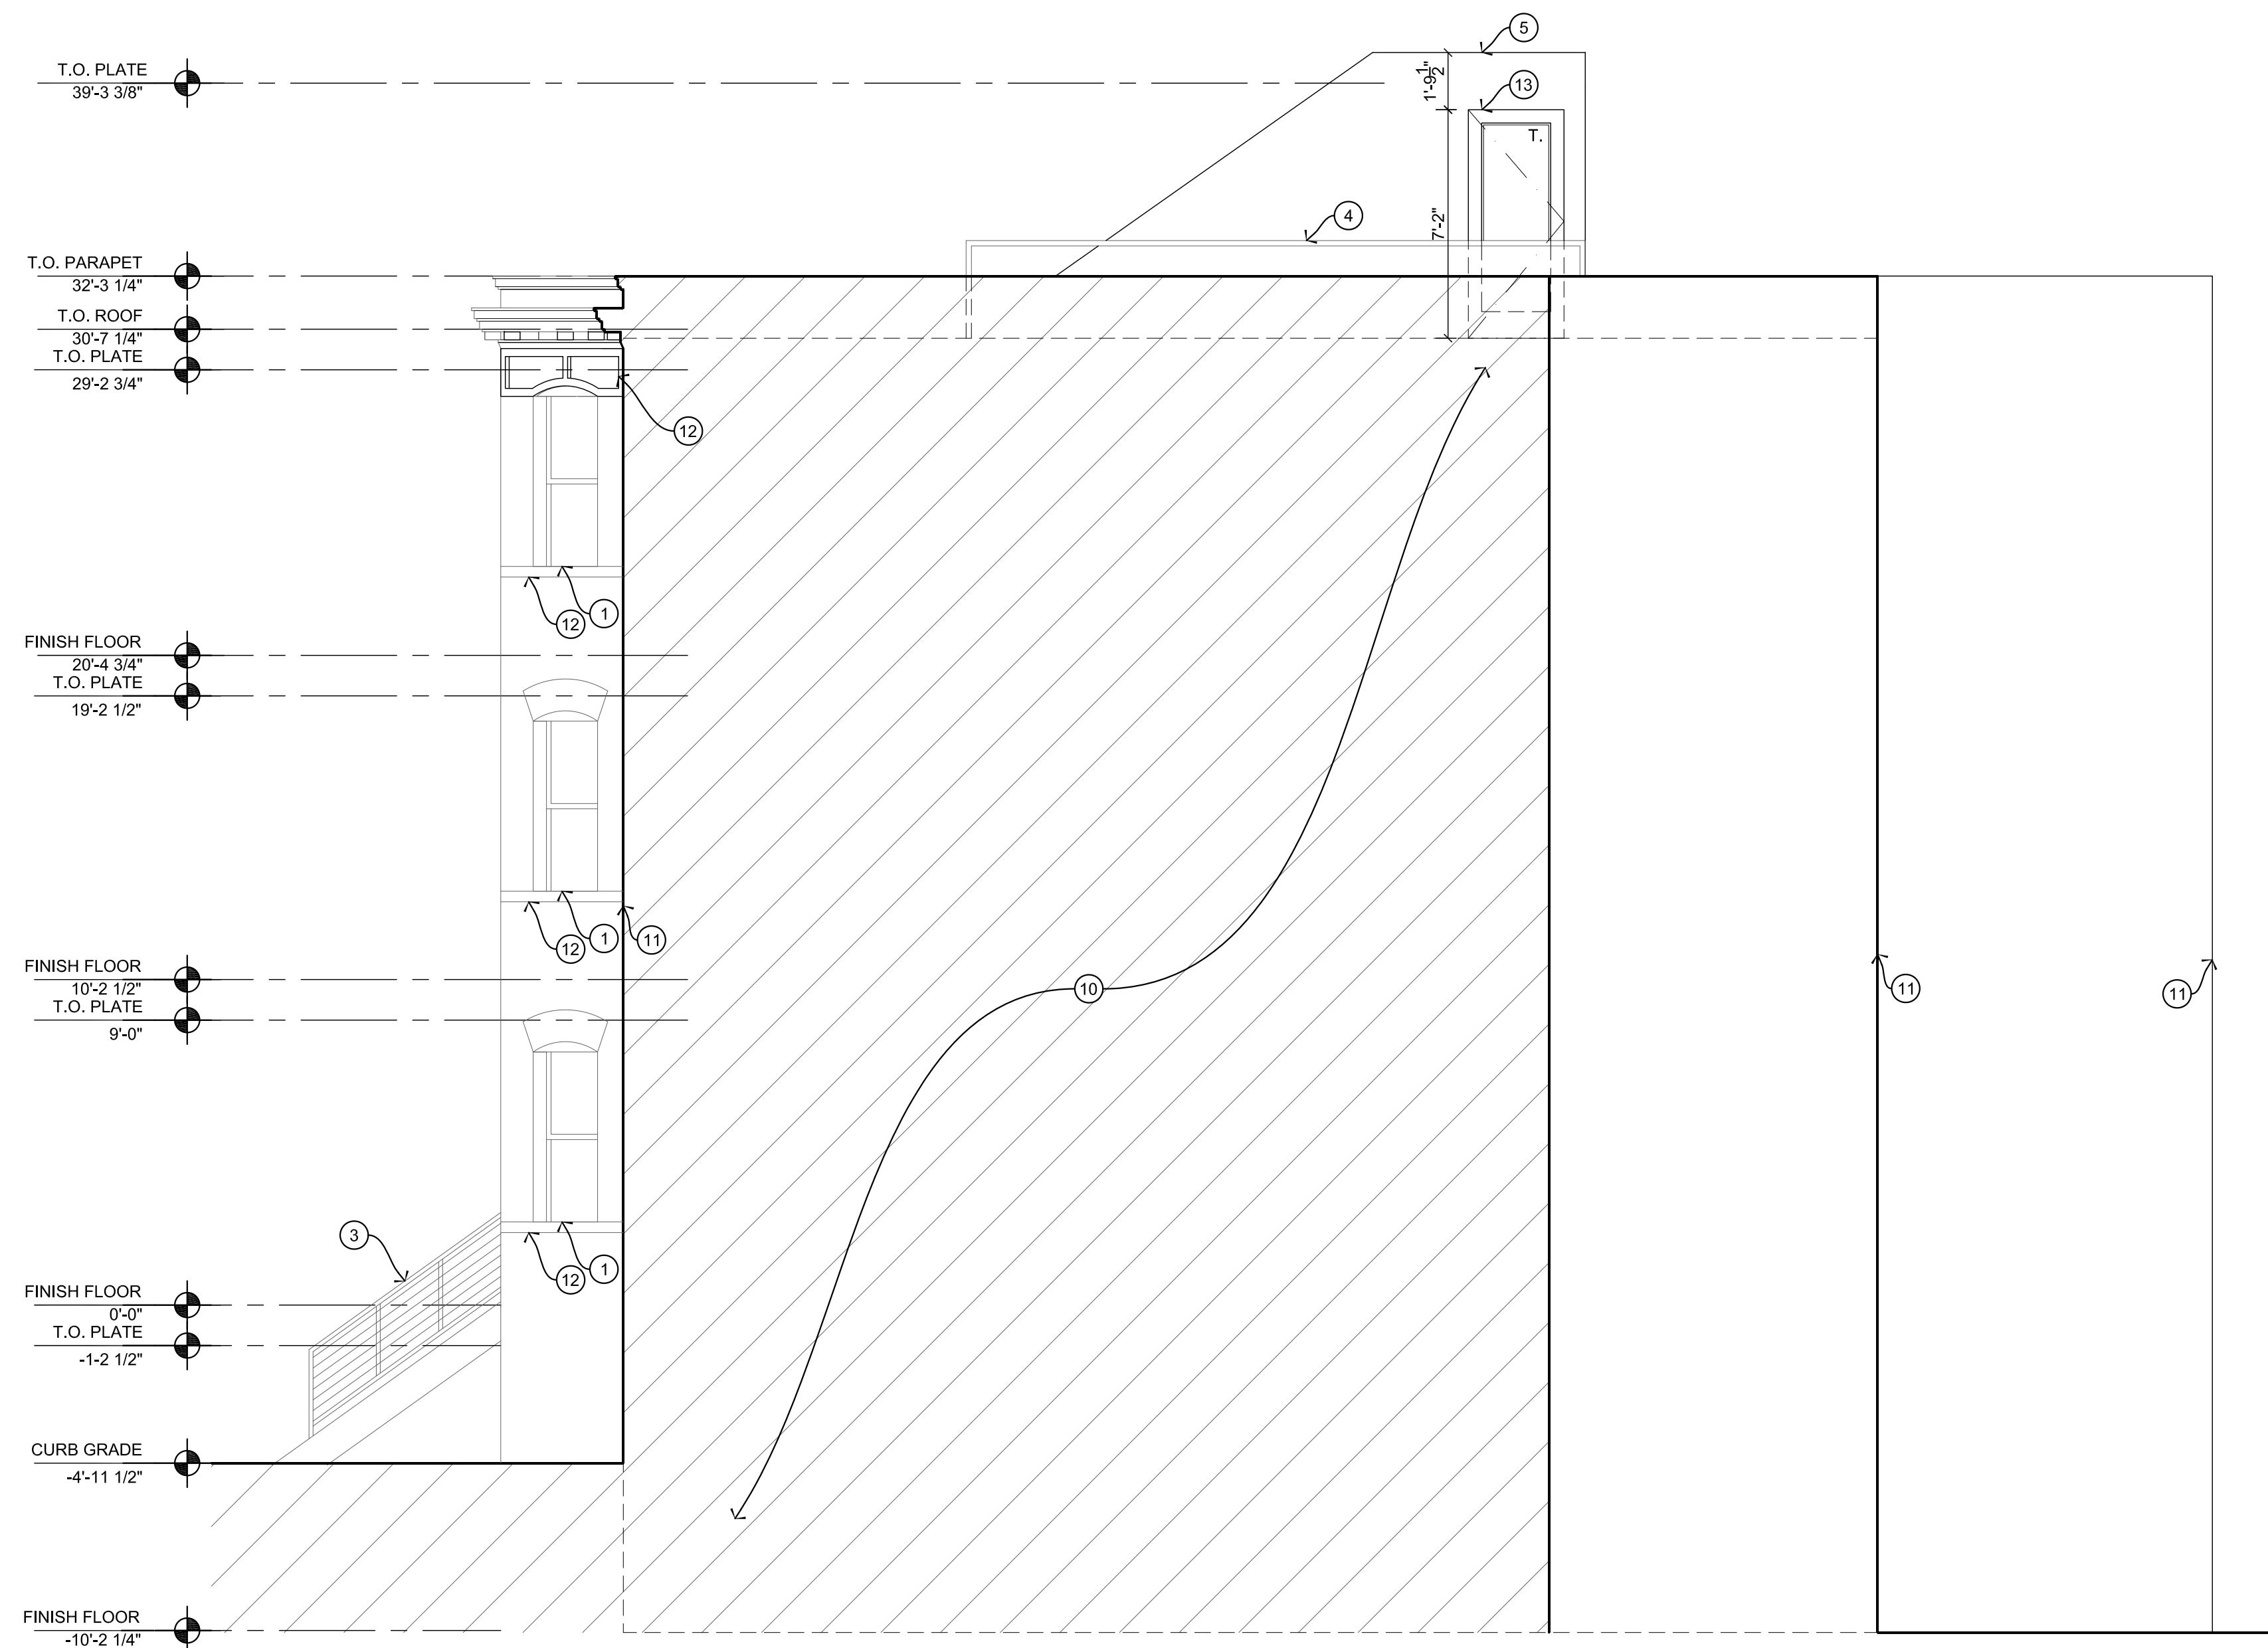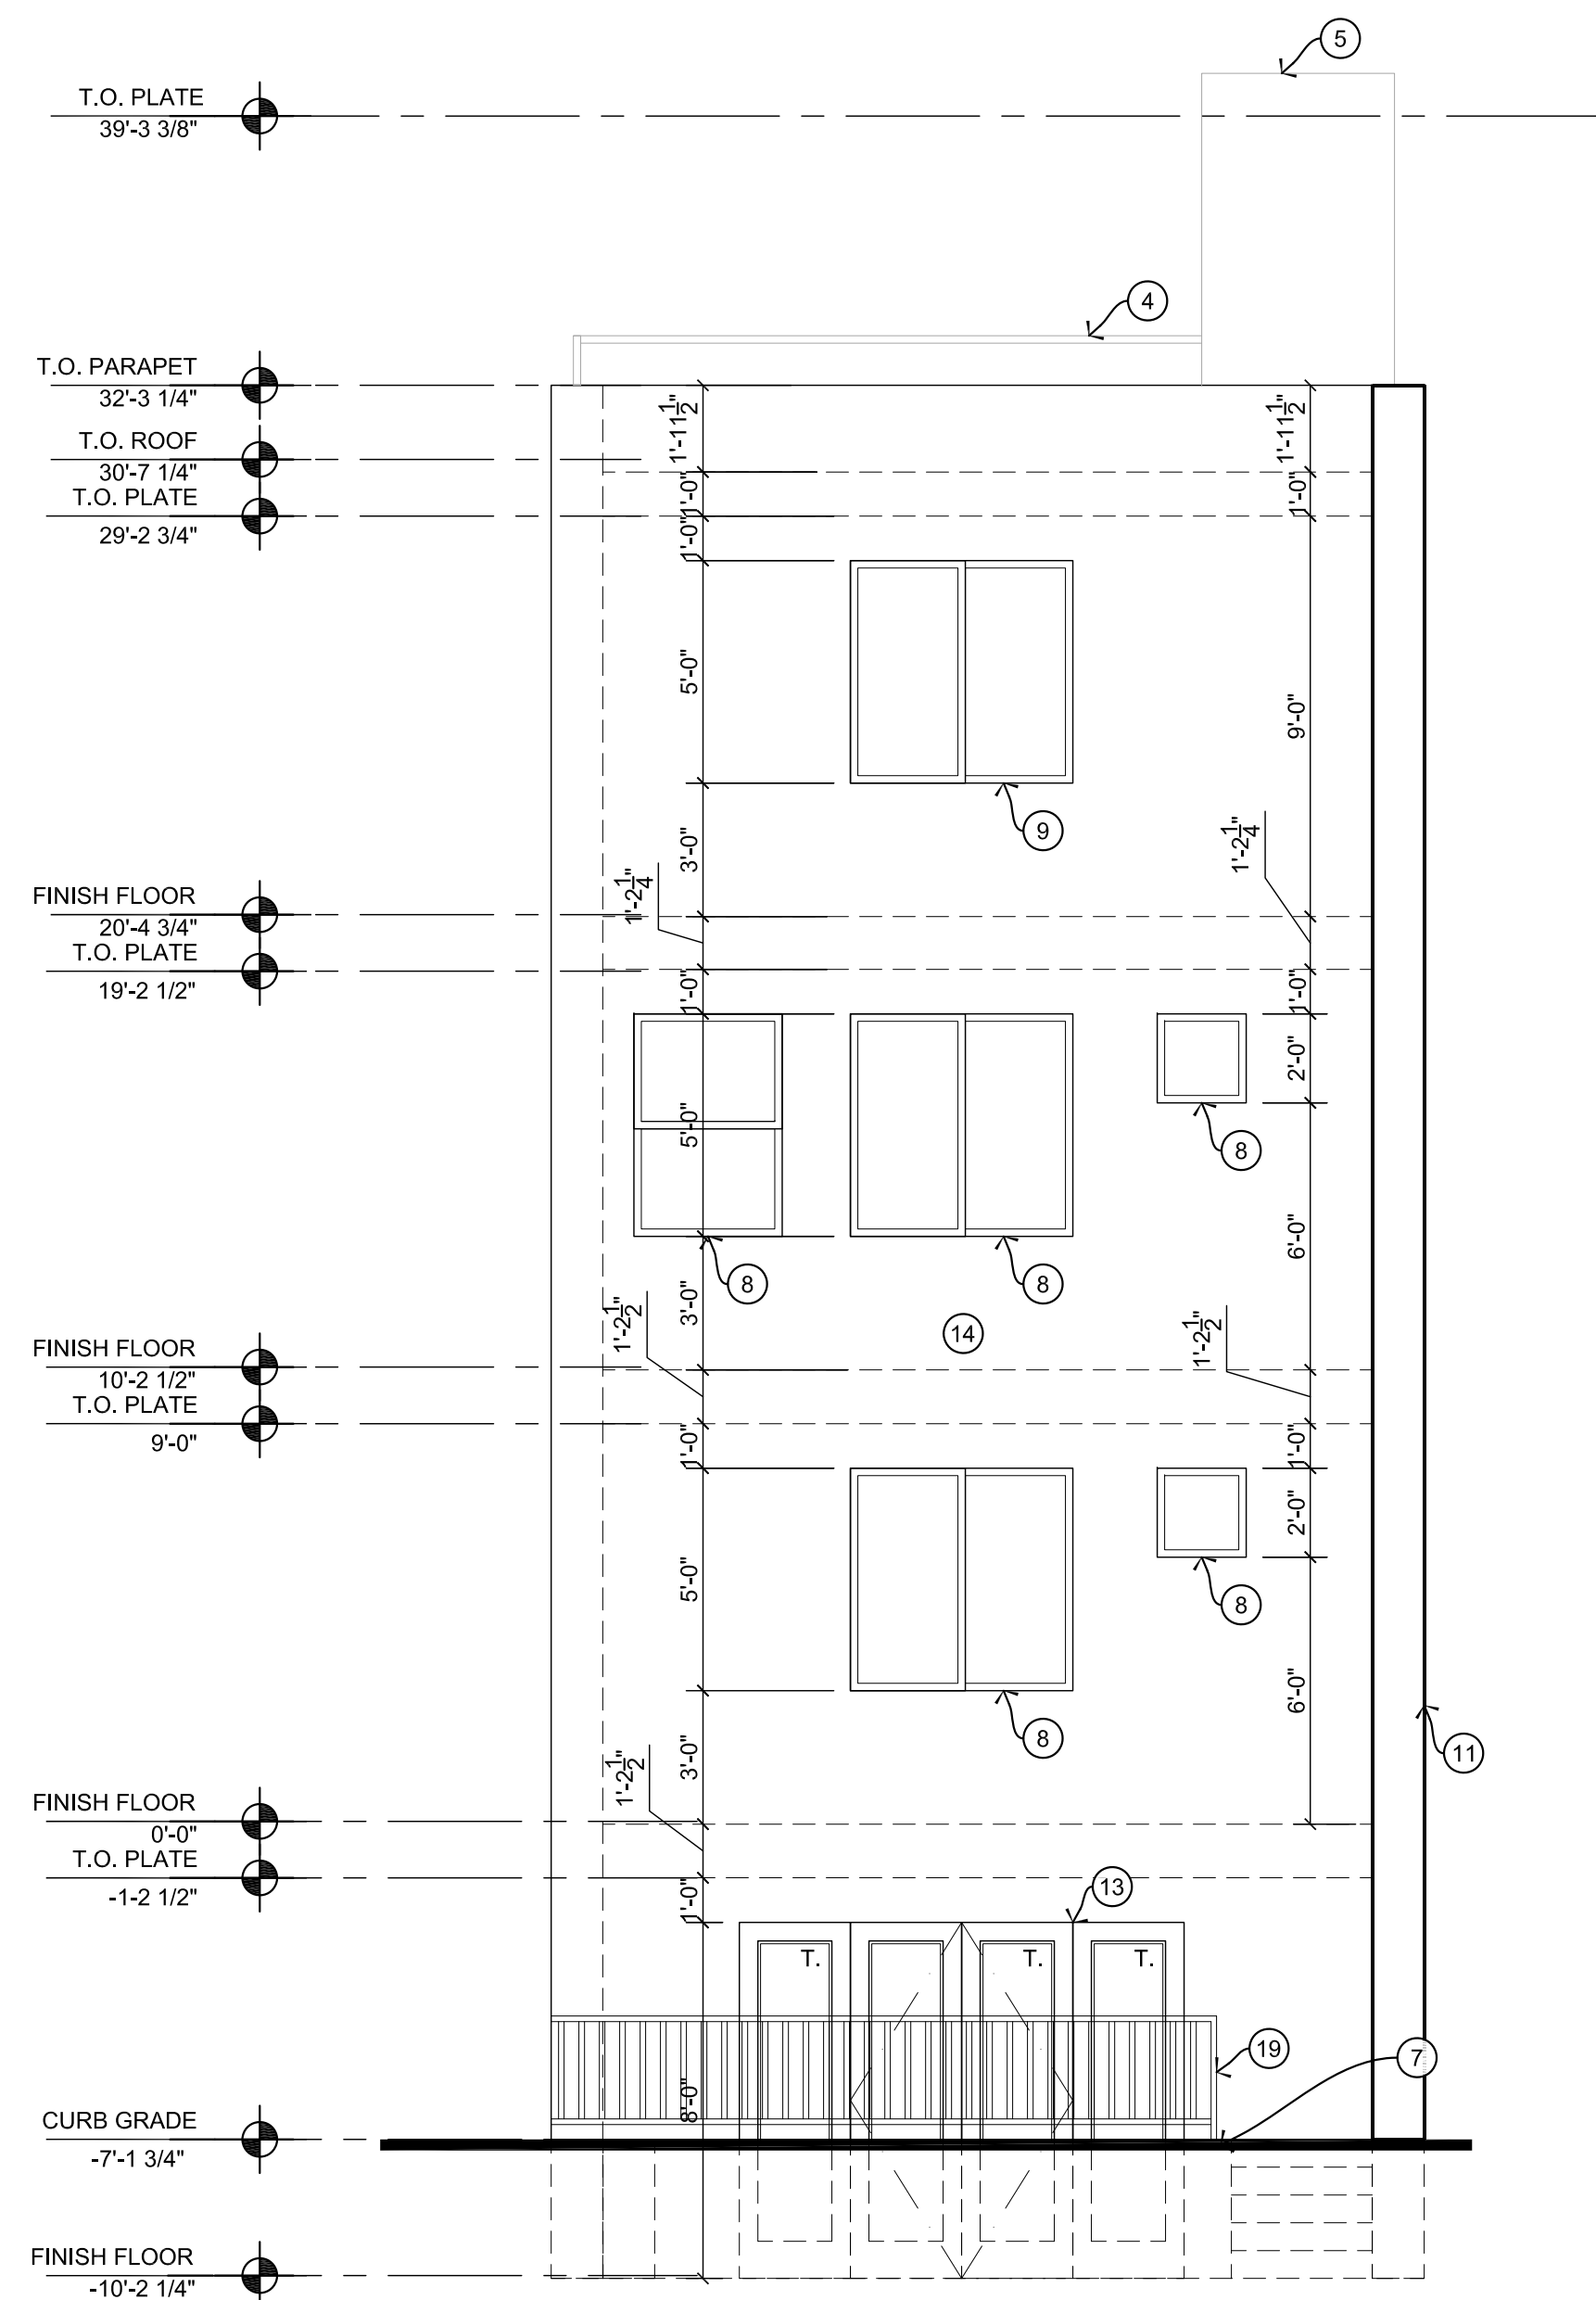

REAR ELEVATION

SCALE : 1/4" = 1'-0"

RIGHT ELEVATION

SCALE : 1/4" = 1'-0"

KEYNOTES

1. EXISTING WINDOW TO REMAIN
2. EXISTING DOOR TO REMAIN
3. NEW STAIR HANDRAIL AT 34" OVER TREAD NOSING
4. NEW METAL RAILING, PAINTED, AT 36" A.F.F.
5. STANDING SEAM METAL ROOFING
6. EXISTING TO REMAIN 8" CMU WALL
7. RETAINING WALL, 8" CMU, FULLY GROUTED
8. NEW WINDOW
9. NEW EGRESS WINDOW
10. PARTY WALL
11. EXISTING EXTERIOR WALL TO REMAIN
12. EXISTING FACADE DECORATION TO REMAIN
13. NEW DOUBLE HINGED GLAZED EXTERIOR DOOR
14. NEW EXTERIOR WALLS, W/STUCCO FINISH TO MATCH EXISTING
15. METAL RAILING, PAINTED, AT 36" A.F.F.

Project:

**WASHINGTON DC
TOWNHOUSE**

Seal: _____

Revision:

No.	Date	Description
-----	------	-------------

Issue:

Date	Description
------	-------------


Project Number: _____

Title:


ELEVATIONS

Sheet:

A301

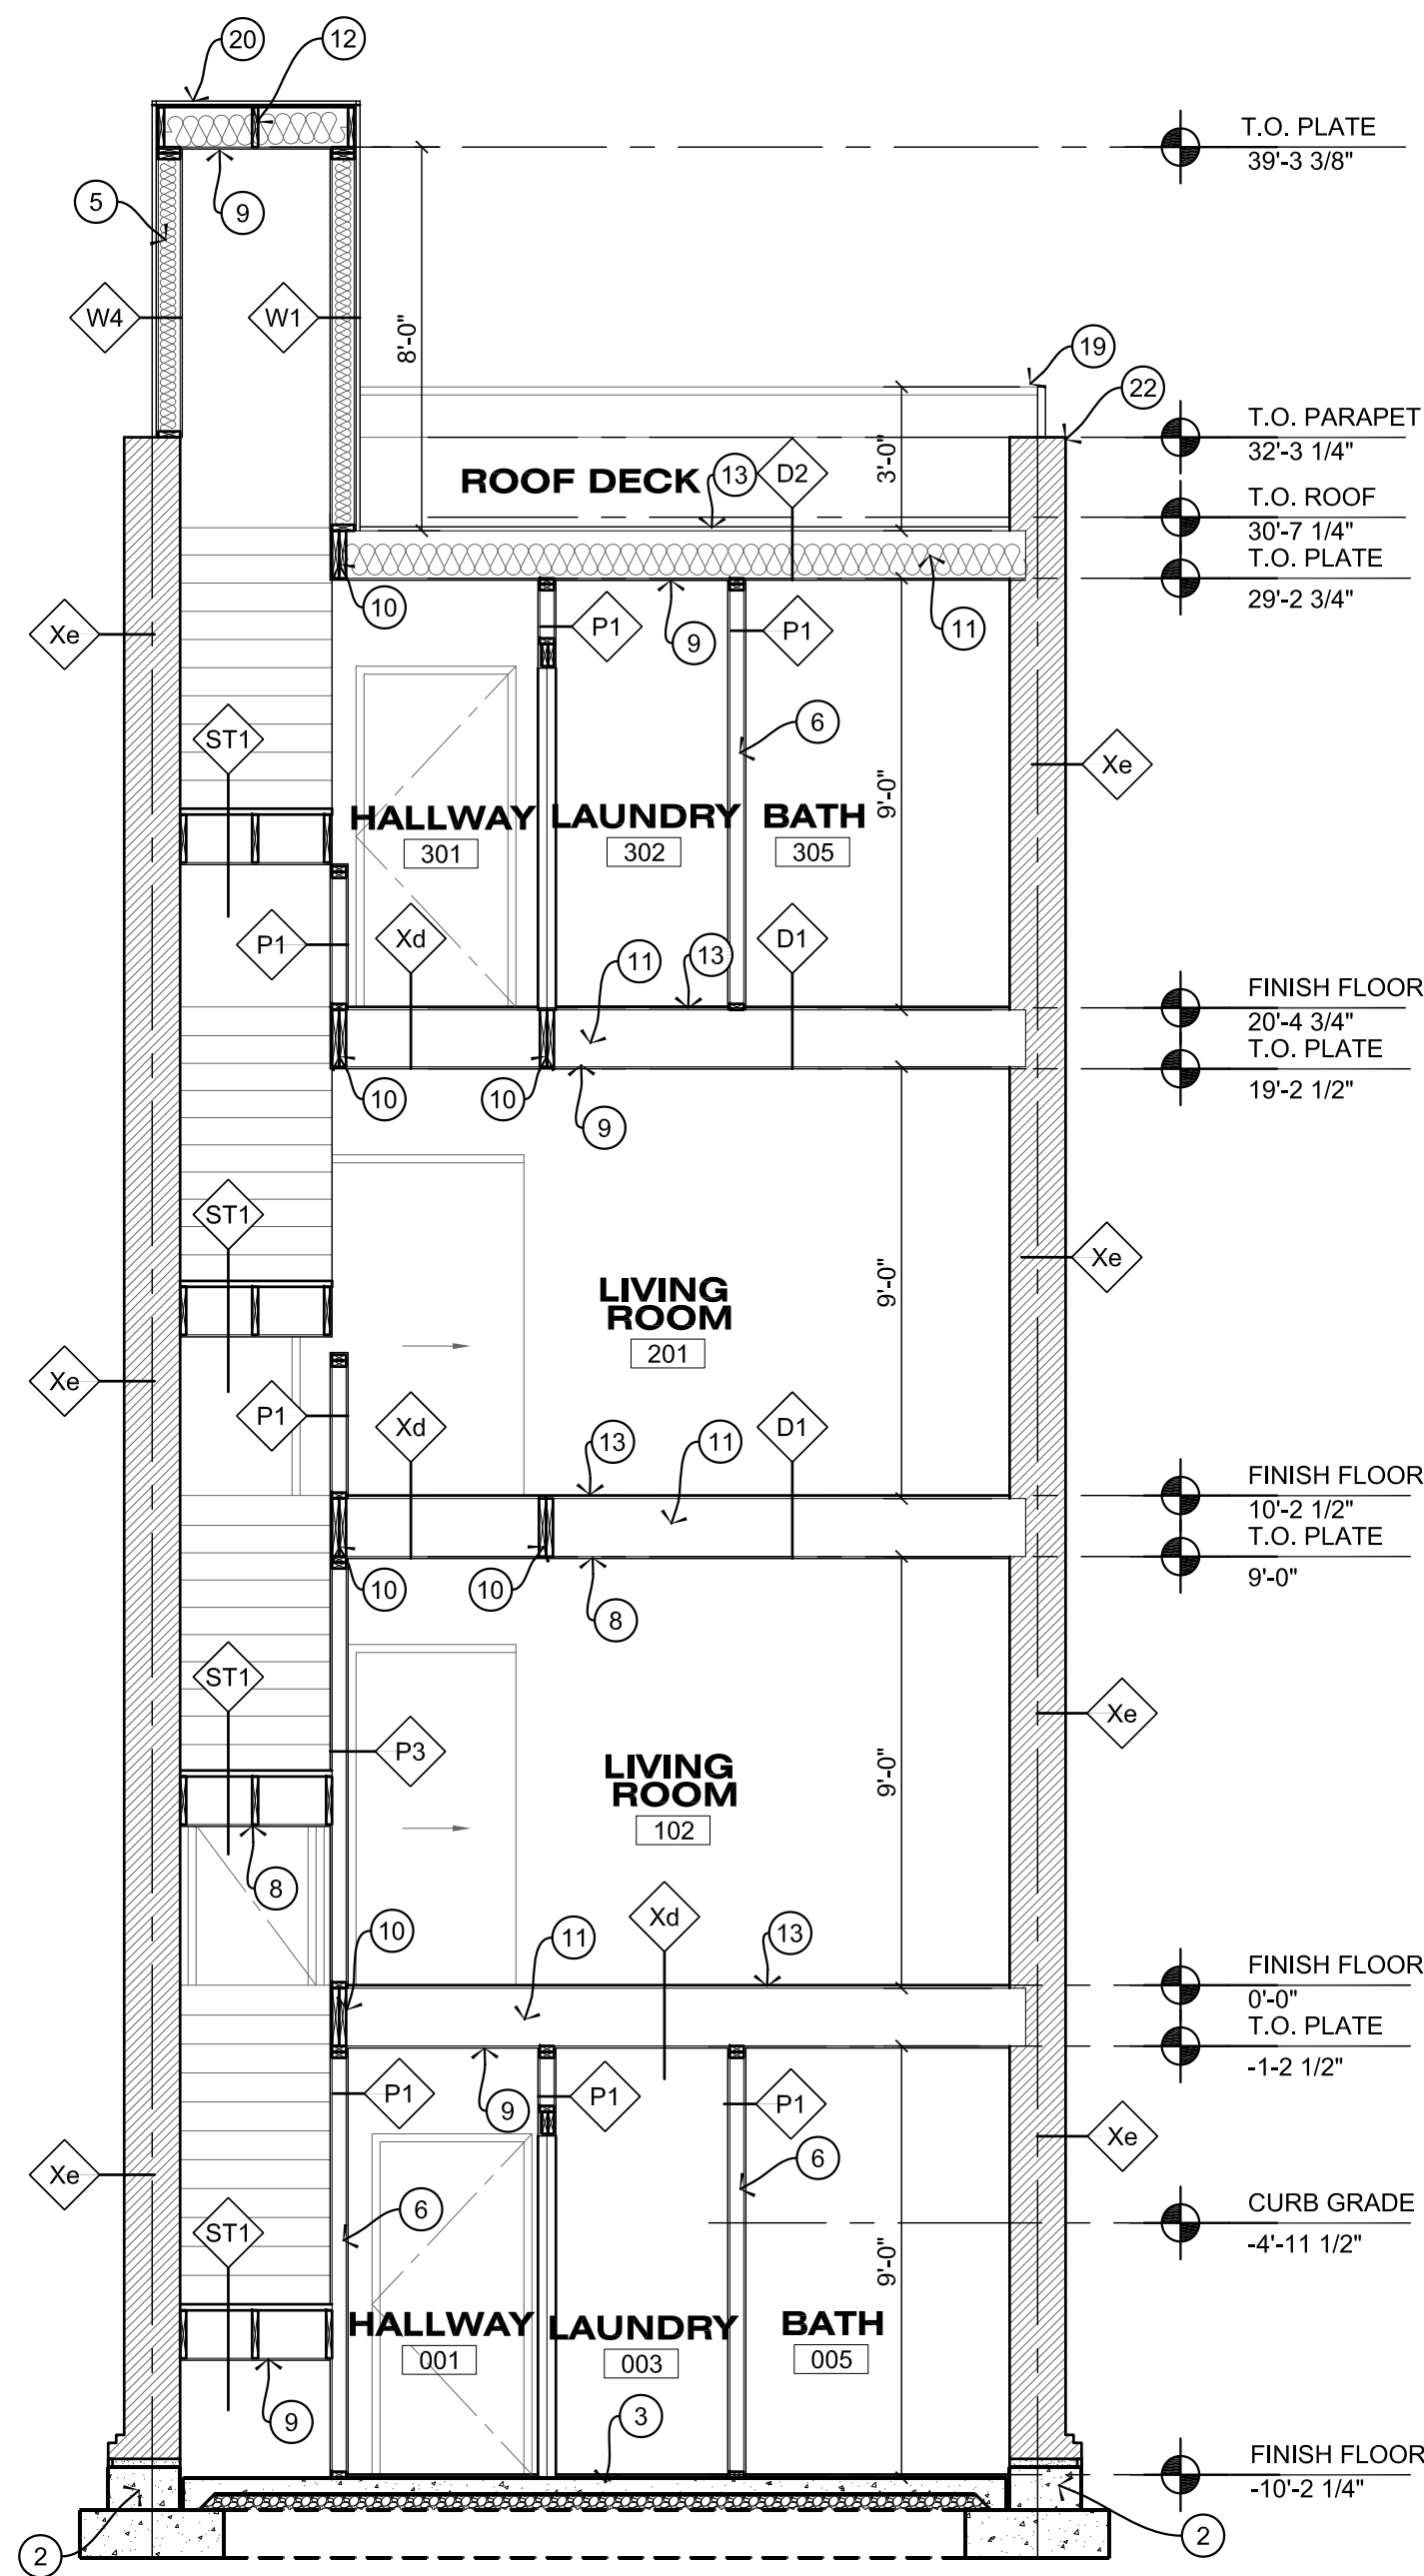

2 SECTION
SCALE: 1/4" = 1'-0"

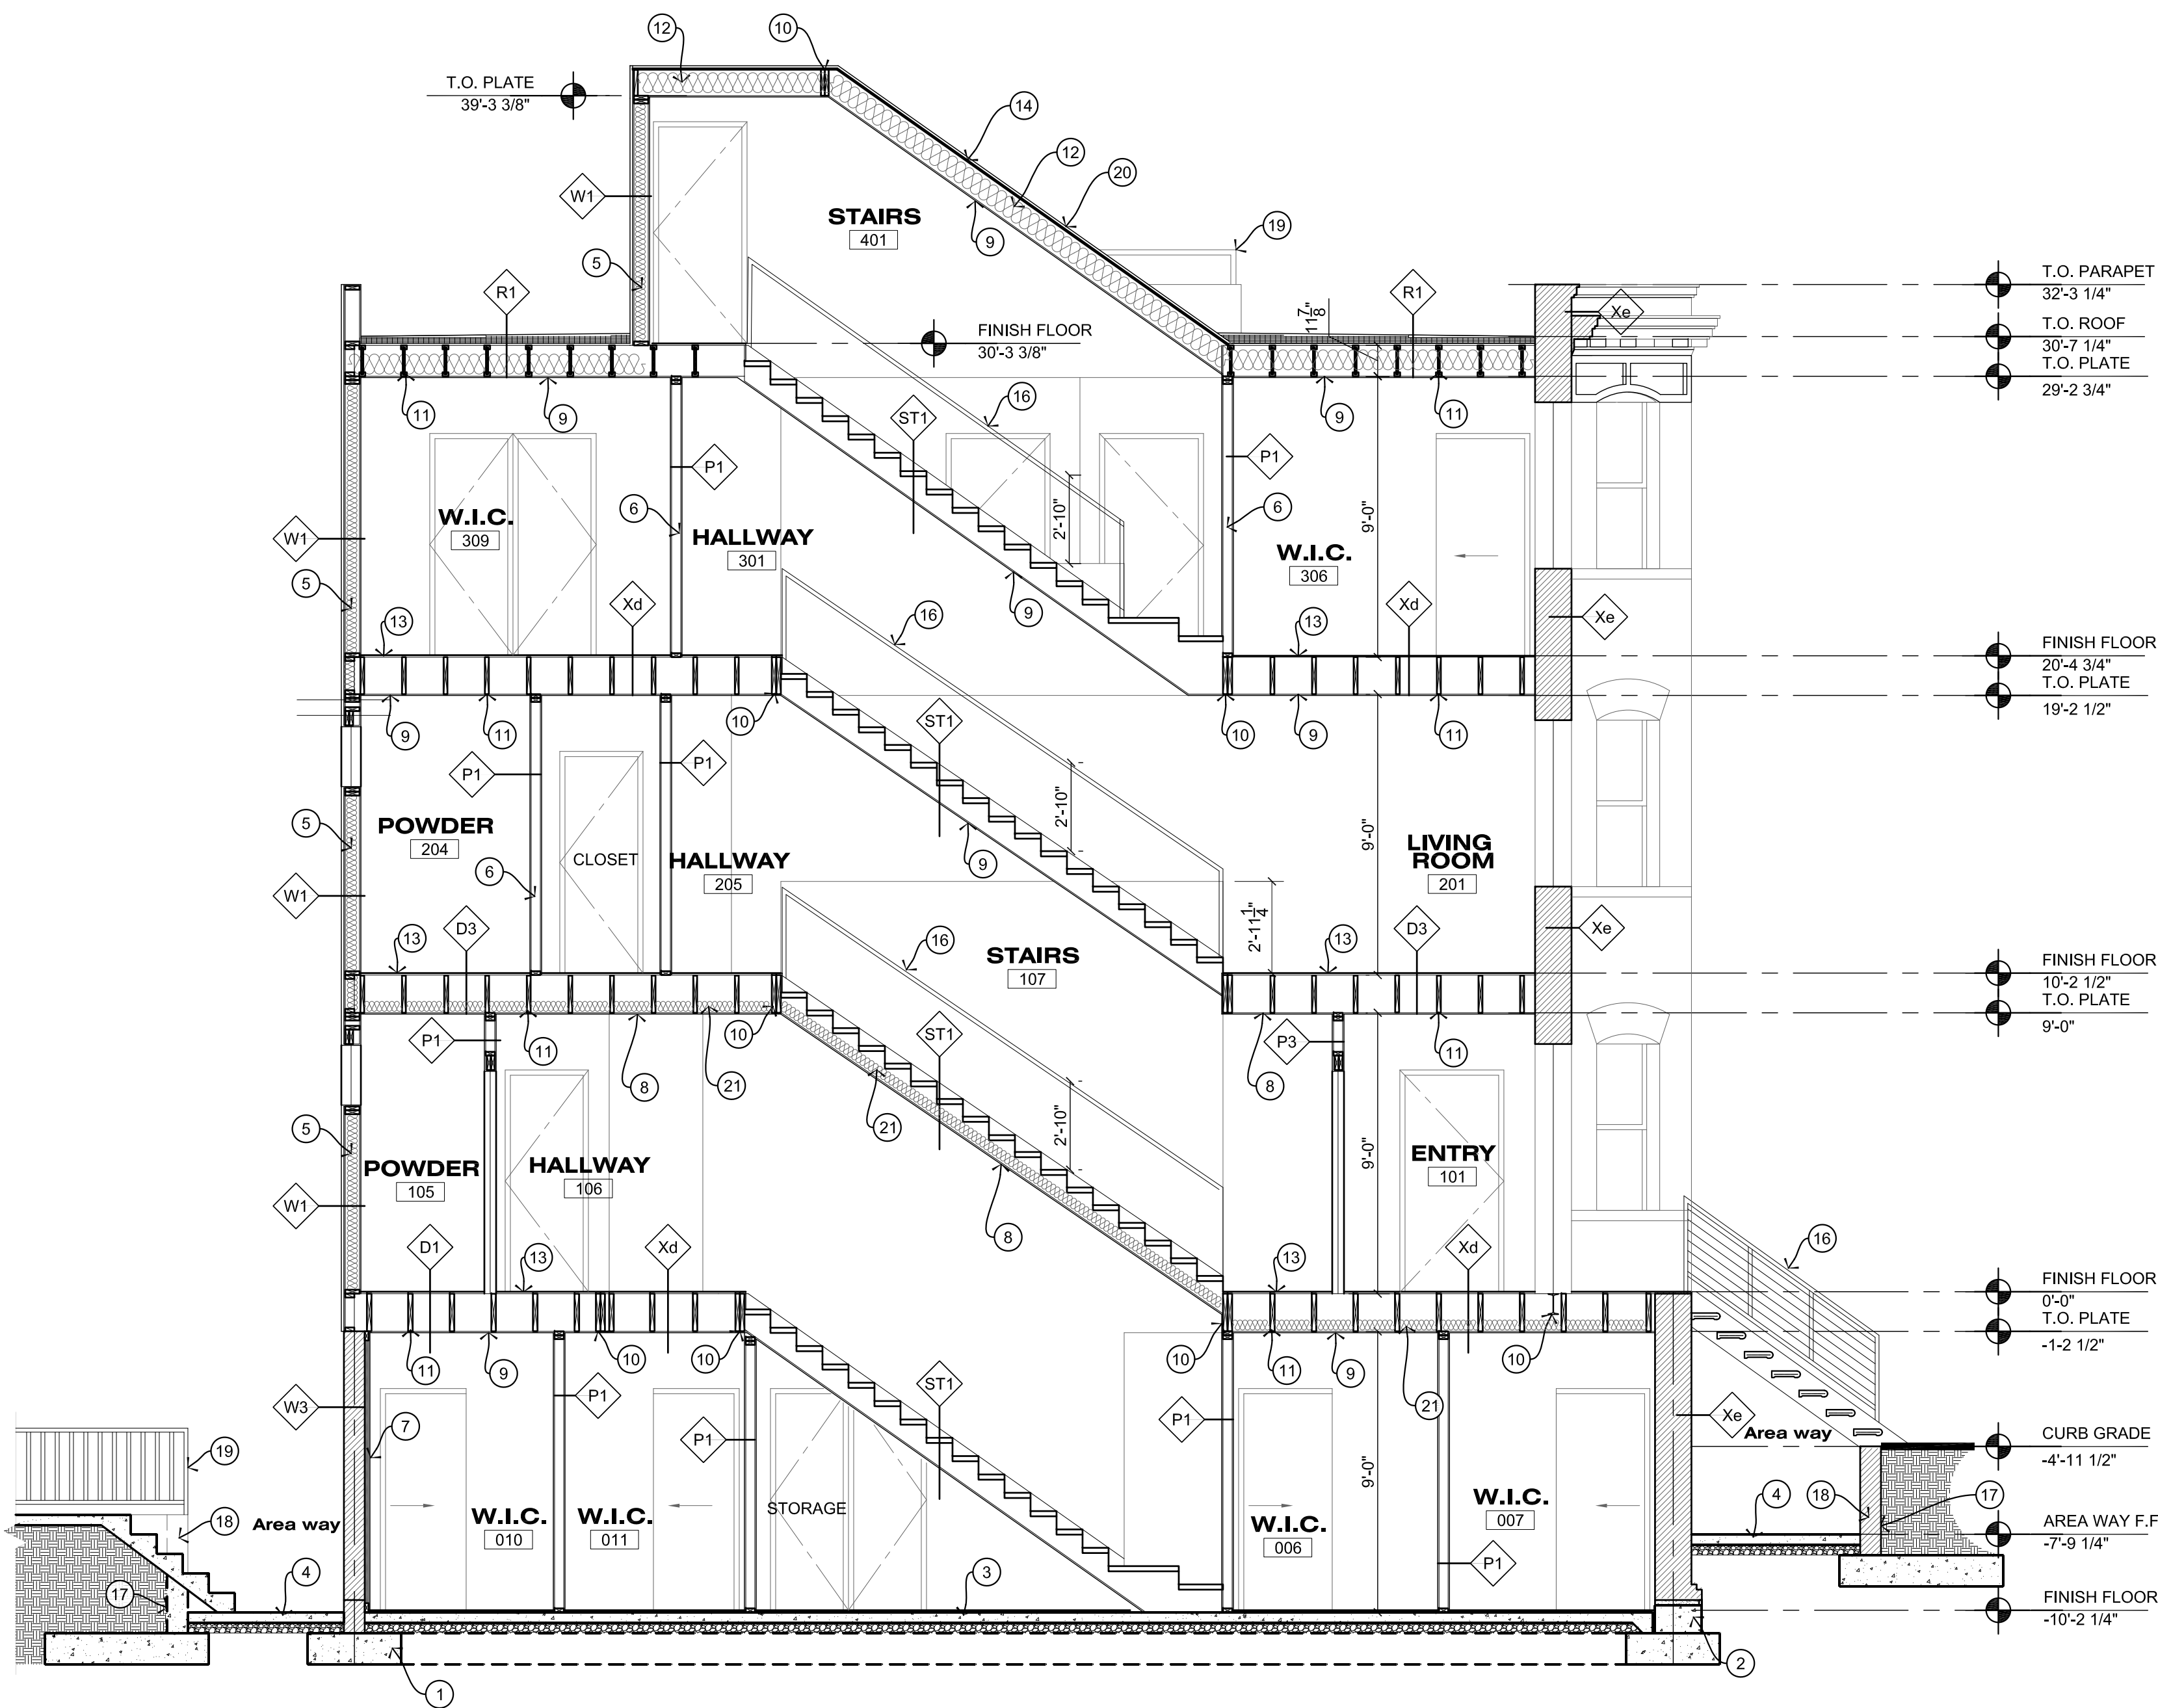

1 SECTION
SCALE: 1/4" = 1'-0"

CONSTRUCTION SYSTEMS	KEYNOTES
FOR CONSTRUCTION SYSTEMS DETAILS REFER TO SHEET A500 Xe EXISTING EXTERIOR WALL TO REMAIN. Xp EXISTING PARTY WALL TO REMAIN Xr EXISTING ROOF TO REMAIN. Xd EXISTING 2X JOISTS AT 16" O.C. W/ NEW 3/4" THICK PLYWOOD SHEATHING, REPAIR OR REPLACE AS NEEDED W1 NEW EXTERIOR WALLS, W/STUCCO FINISH TO MATCH EXISTING. 2 X 6 STUDS @ 16" O.C. AND 1/2" THICK GYPSUM BOARD ON INTERIOR SIDE. 6" THICK R-19 FIBERGLASS BATT INSULATION. W2 NEW TRIPLE BRICK WALL, W/STUCCO FINISH TO MATCH EXISTING. W3 8" THICK MASONRY WALL W/STUCCO FINISH. 5/8" THICK GYPSUM BOARD AND 2x FLAT FURRING ON INTERIOR SIDE P1 NEW INTERIOR WALLS 2 X 4 STUDS @ 24" O.C. WITH GYPSUM BOARD EACH SIDE, U.N.O. OPTIONAL ACOUSTICAL INSULATION. P2 NEW INTERIOR WALLS 2 X 6 STUDS @ 24" O.C. WITH FULL HEIGHT 1/2" THICK FIBER CEMENT GLASS MATT BOARD AND CERAMIC TILE AT 6'-0" A.F.F. MIN. AS OCCURS. 3" THICK BATT FIBERGLAS INSULATION IN PLUMBING WALLS. P3 NEW 1HR RATED INTERIOR WALLS 2 X 4 STUDS @ 24" O.C. WITH 5/8" SHEETROCK BRAND FIRECODE CORE GYP. PANE, EACH SIDE. REFER TO DETAIL. S1 NEW 4" THICK CONCRETE SLAB ON 4" A.B.C. ST1 NEW STAIRS D1 2X JOISTS AT 16" O.C., TO MATCH EXISTING W/ 3/4" THICK PLYWOOD SHEATHING AND 1/2" GYPSUM BOARD CEILING D2 11-7/8" TJI JOISTS AT 16" O.C. W/ 3/4" PLYWOOD SHEATHING AND 1/2" THICK GYPSUM BOARD CEILING D3 1HR RATED DECK: 2X JOISTS AT 16" O.C. W/ 1" NOMINAL WOOD SUB FLOOR AND 1" WOOD FINISH FLOOR AND 1/2" OR 5/8" SHEETROCK BRAND GYPSUM PANEL, FIRECODE C CORE R1 11-7/8" TJI JOISTS AT 16" O.C. W/ 1/2" PLYWOOD SHEATHING AND 1/2" THICK GYPSUM BOARD CEILING	1. CONCRETE FOOTING - SEE FOUNDATION PLAN 2. UNDERPINNING - SEE FOUNDATION PLAN 3. 4" CONCRETE SLAB OVER 4" ABC - SEE FOUNDATION PLAN. 4. 4" CONCRETE SLAB OVER 4" ABC. SLOPE MIN. 1/8" PER FOOT. 5. 2 X 6 WOOD STUDS AT 16" O.C. WITH 1/2" GYP. BD. ON INTERIOR AND STUCCO SYSTEM ON EXTERIOR - TYP. EXT. STUD WALL 6. 2 X 4 WOOD STUDS AT 16" O.C. WITH 1/2" GYP.BD. EACH SIDE - TYP. INTERIOR STUD WALL. 7. 2X FLAT FURRING. 8. 2X 5/8" THICK GYP. BOARD TYPE "X". 9. 1/2" THICK GYP. BOARD. 10. BEAM, REFER TO FRAMING PLANS 11. JOISTS @ 16" O.C. SEE STRUCTURAL DRAWINGS. 12. 2X10 FRAMING AT 24" O.C. 13. 3/4" T+G PLYWOOD SHEATHING. 14. 1/2" CDX ROOF SHEATHING. 15. BATT INSULATION - CONT. MIN. R-49 AT CEILINGS, OR R-19 AT 2x6 WALLS @16" O.C. 16. STAIR HANDRAIL AT 34" OVER TREAD NOSING. 17. WATERPROOFING MEMBRANE. 18. RETAINING WALL, 8" CMU, FULLY GROUTED 19. METAL RAILING, PAINTED, AT 36" A.F.F. 20. STANDING SEAM METAL ROOFING 21. BATT SOUND INSULATION 22. 2HR RATED PARAPET WALL

Project:
**WASHINGTON DC
TOWNHOUSE**

Seal:

Revision:
No. Date Description

Issue:
Date Description


Project Number:

Title:

SECTIONS

Sheet:

A302

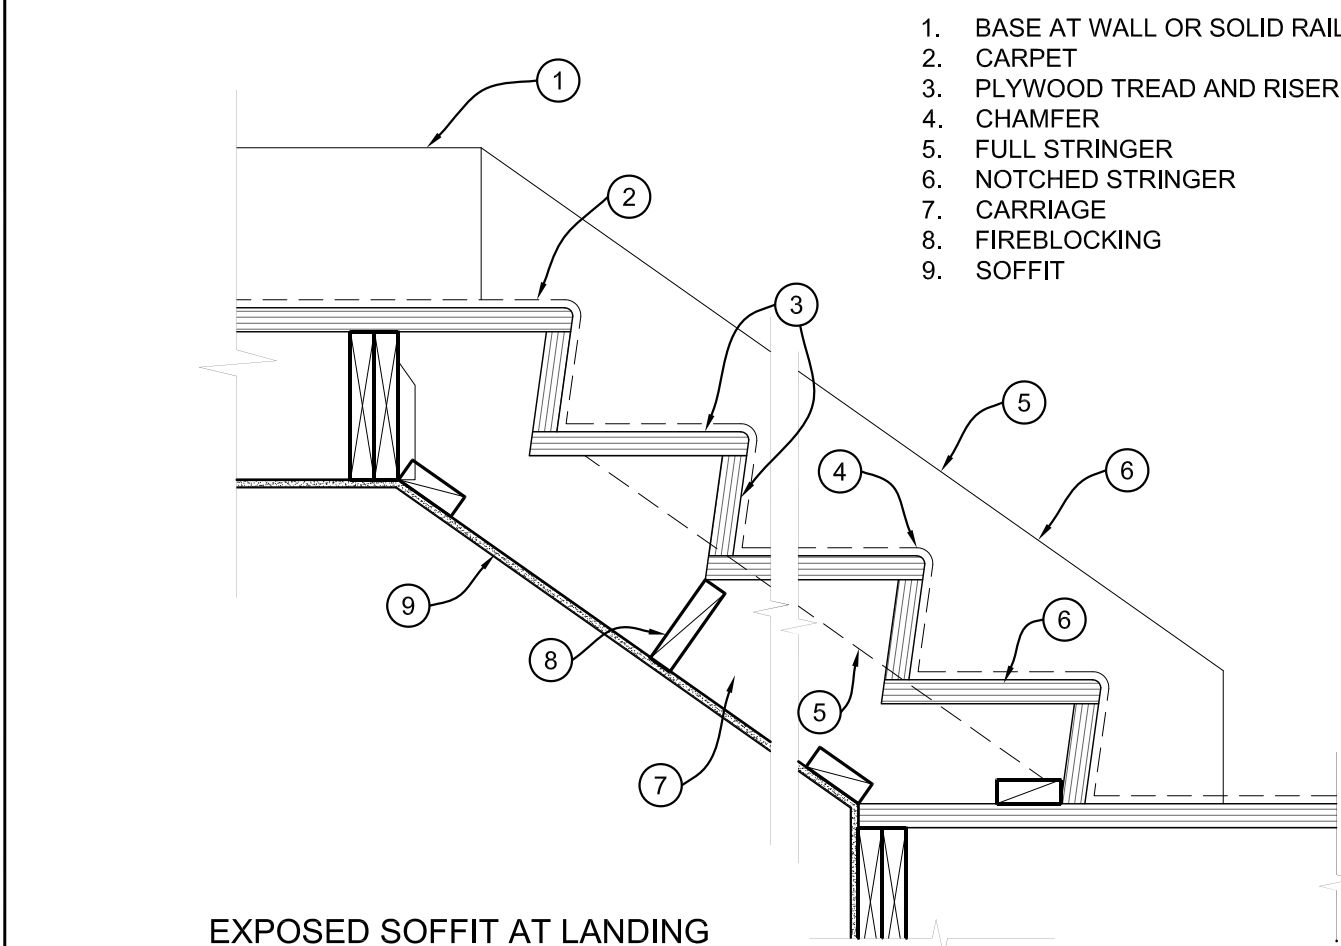

4 STAIR DETAIL



SCALE: 1"=1'-0"

STR-005

A SECTION A

SCALE: 1"=1'-0"

1. BASE AT WALL OR SOLID RAIL
2. CARPET
3. PLYWOOD TREAD AND RISER
4. CHAMFER
5. FULL STRINGER
6. NOTCHED STRINGER
7. CARRIAGE
8. FIREBLOCKING
9. SOFFIT

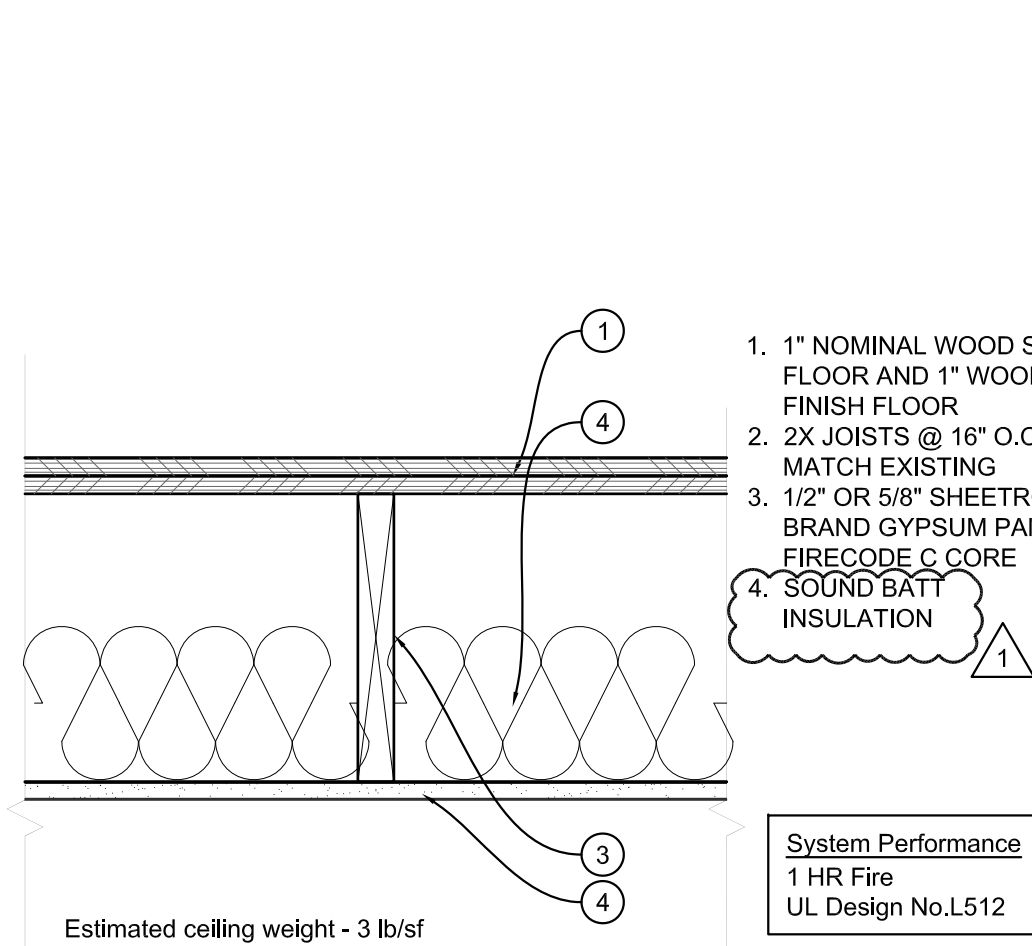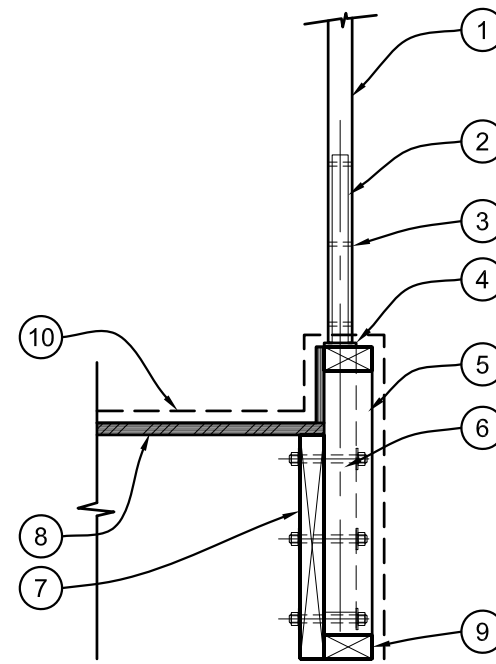

D3 DECK TYPE 1 HR RATED

SCALE: 1 1/2" = 1'-0"

STR-002


P2 PARTITION TYPE "P2"

SCALE: 3" = 1'-0"

W1 WALL-TYPE W1

P1010-701

W1010-500

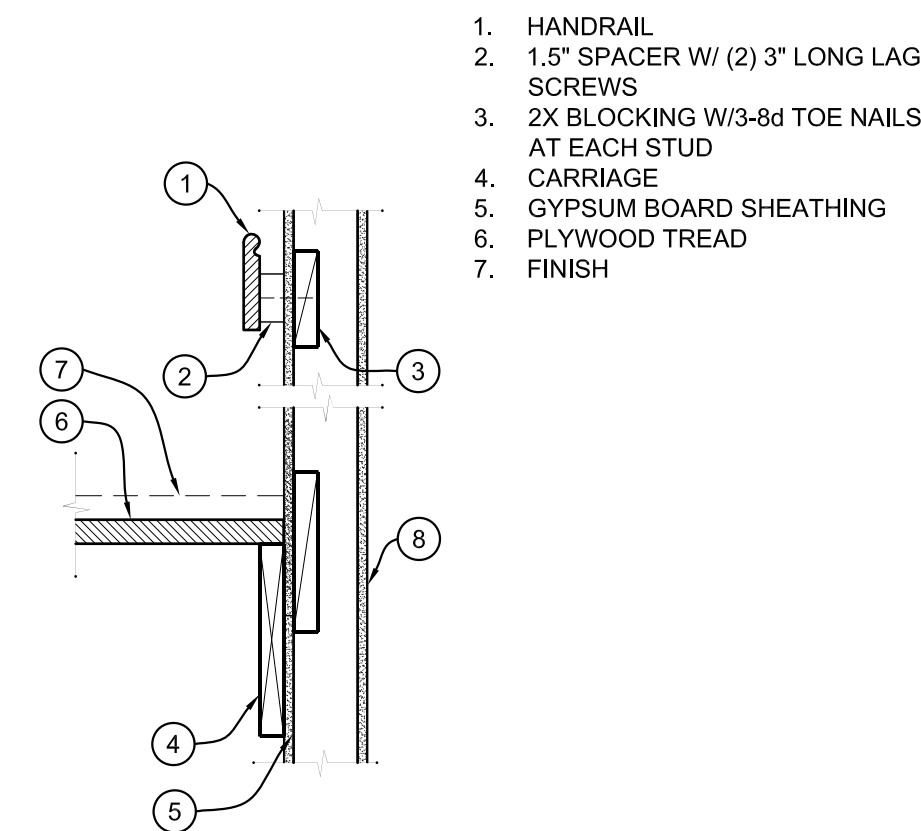



5 NO STRINGER

SCALE: 1"=1'-0"

B SECTION B

SCALE: 1"=1'-0"

1. BALUSTER AT 5'-0" O.C. MAX
2. METAL SLEEVE TO MATCH BALUSTER, TIGHT FIT.
3. 3/4" DIAM THRU BOLTS AT 5" O.C
4. 2"x2"x3/4" STEEL PLATE BASE WELDED TO SLEEVE AND TS 2X2X1/4
5. TS 2X2X1/4, 12" LONG.
6. (3) 3/4" DIAM THRU BOLTS
7. 2X12 STAIR STRINGER
8. 3/4" PLYWOOD, TREAD.
9. FINISH MATERIAL

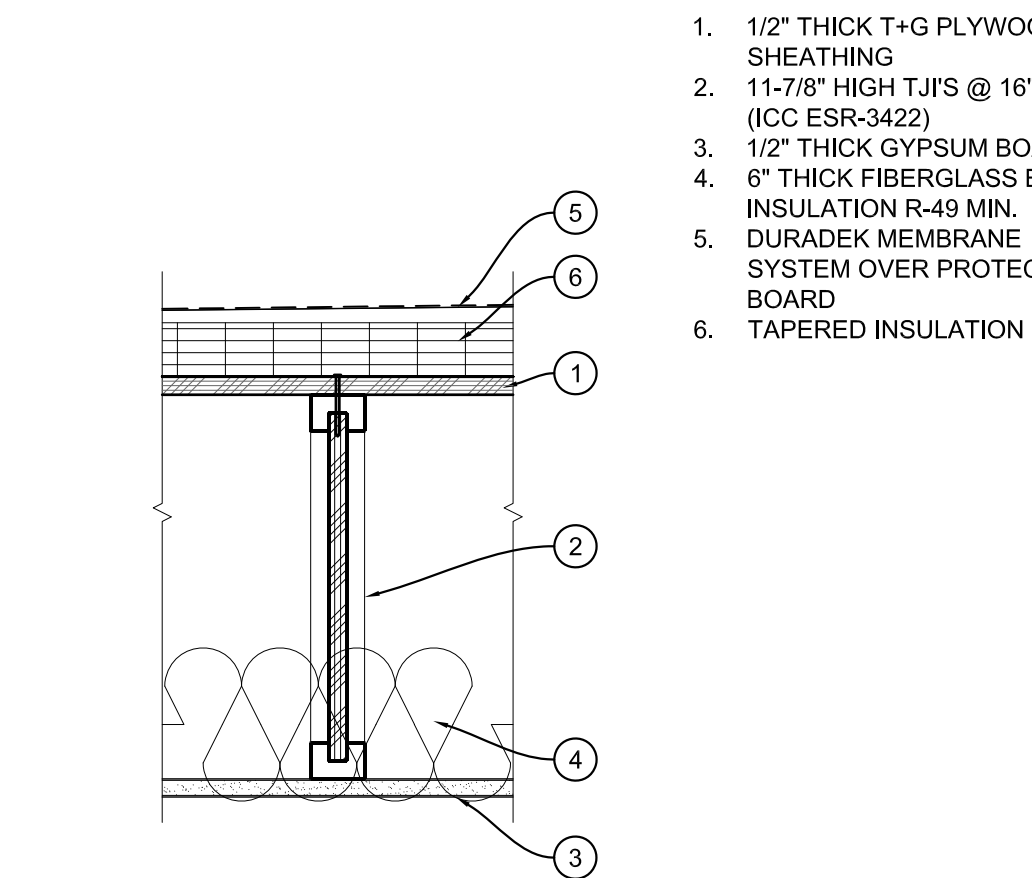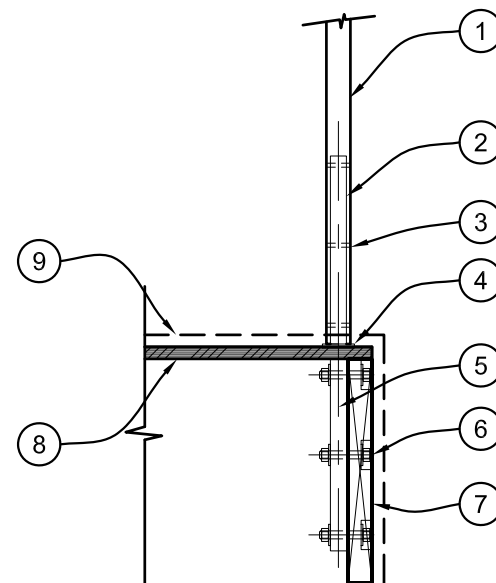



P3 PARTITION "P2" 1HR RATED

SCALE: 3" = 1'-0"

W2 WALL-TYPE W2

SCALE: 3" = 1'-0"

1. TRIPPLE BRICK WALL
2. 1-KOTE STUCCO SYSTEM, ICC-ESR 1607
3. LATH
4. RIGID INSULATION BOARD

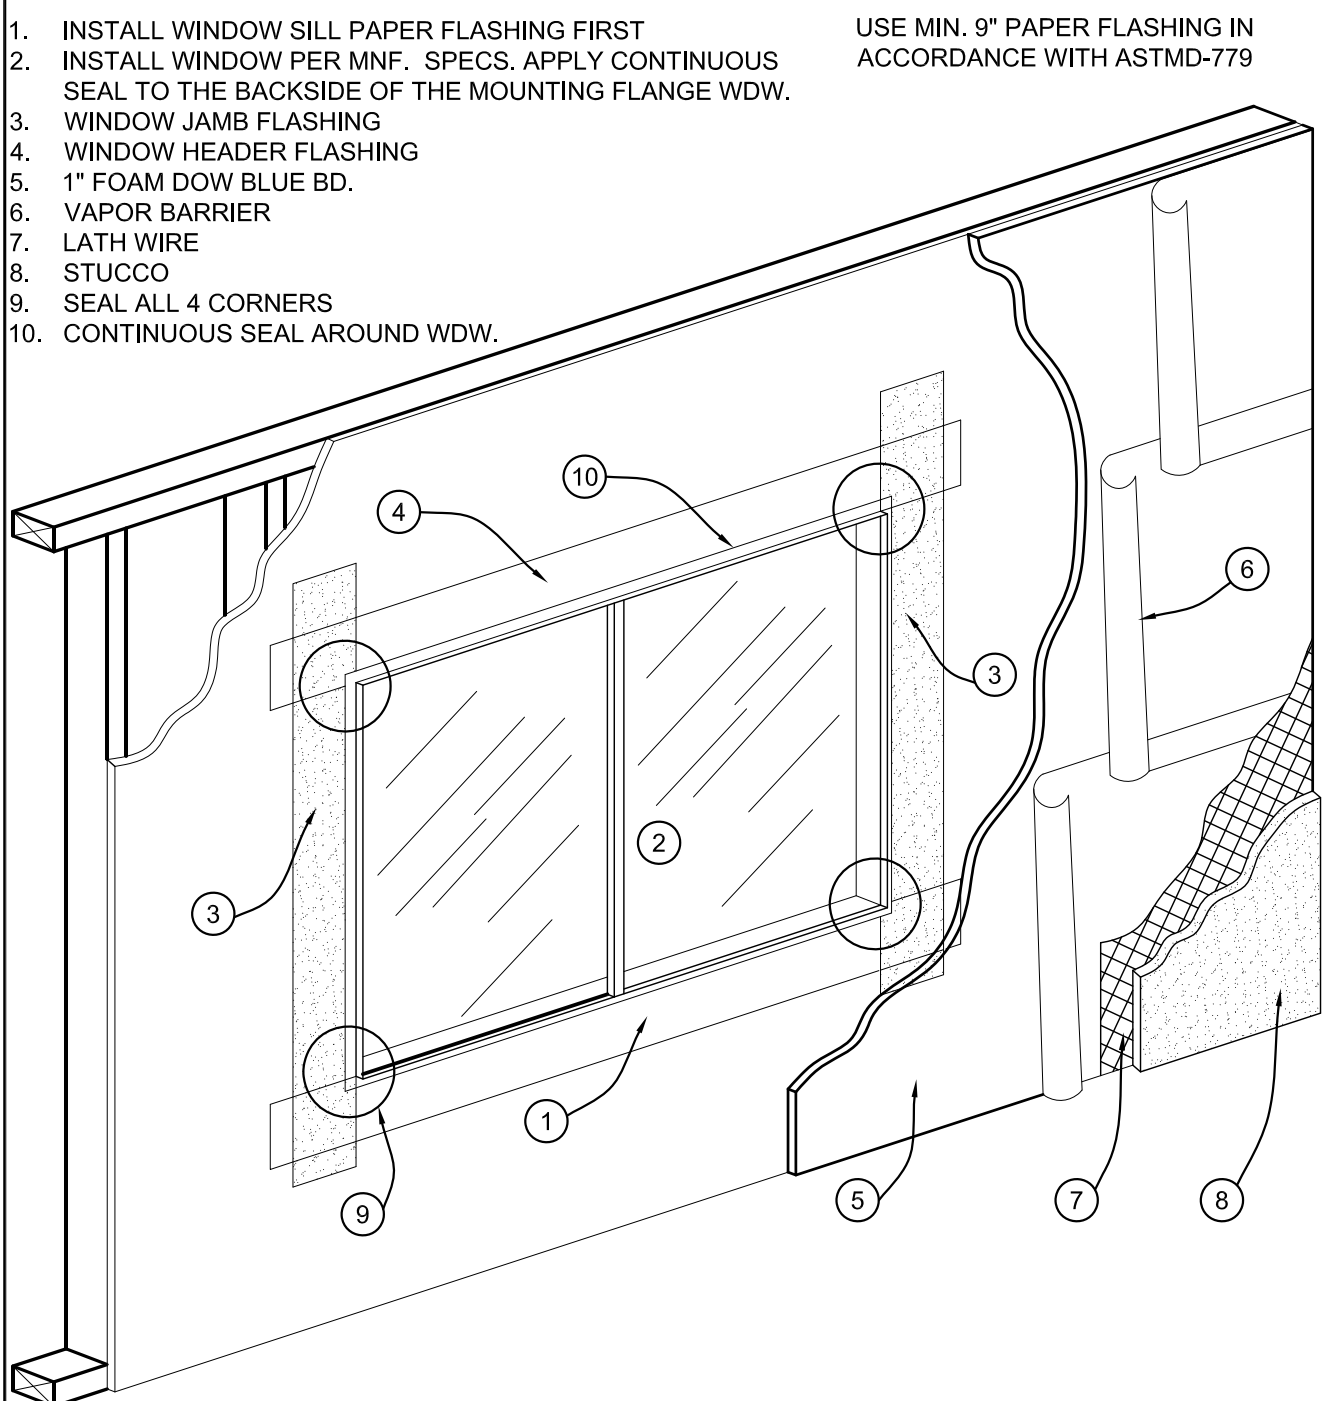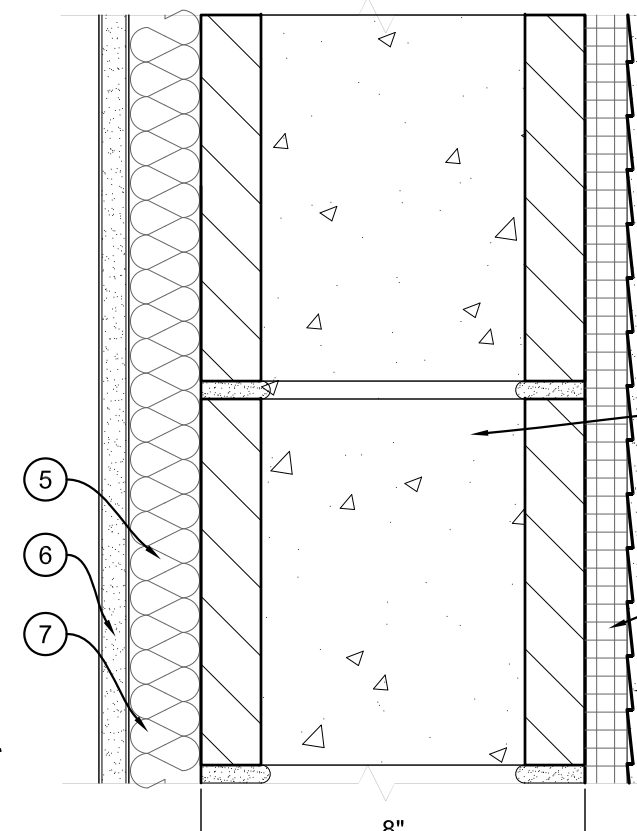

9 WINDOW FLASHING DETAIL


SCALE: N.T.S.

2 STAIR STRINGER TO CONC. SLAB


SCALE: 1"=1'-0"

STR-010

1. POST-TENSION SLAB ON GRADE - SEE STRUCTURAL DRAWINGS
2. CARPET
3. PLYWOOD TREAD AND RISER
4. CHAMFER
5. FULL STRINGER
6. NOTCHED STRINGER
7. CARRIAGE
8. FIREBLOCKING
9. 5/8" GYP. BOARD
10. X 8" LONG W/ (2) Ø1/2" EXPANSION BOLTS INTO SLAB AND (2) 3/8"X 1-1/4" LAG SCREWS INTO WOOD STRINGER

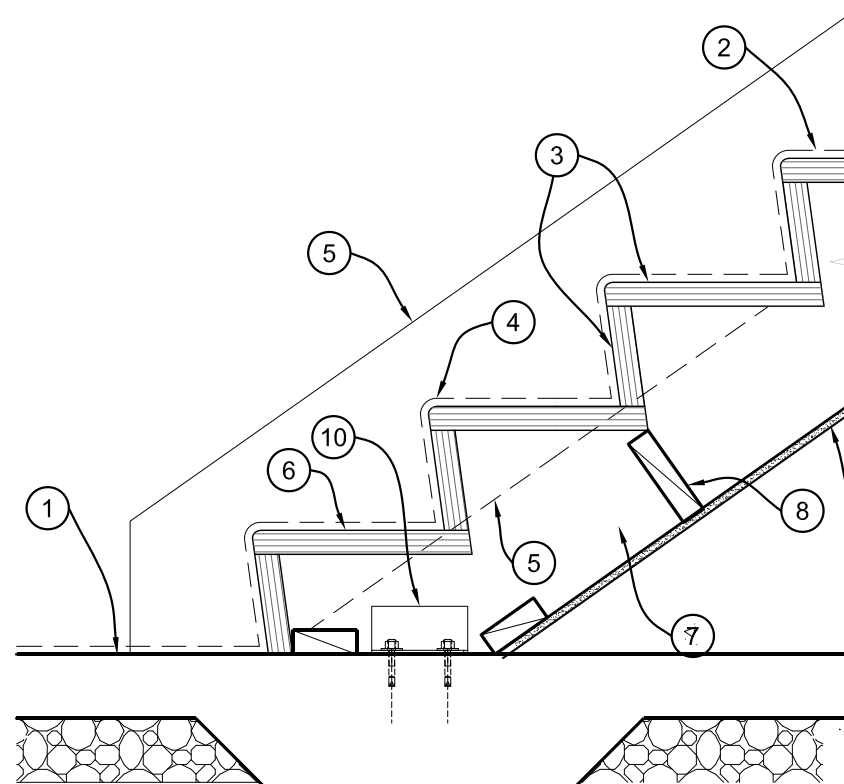

1. NEWEL POST
2. VOLUTE
3. BALUSTER
4. HOUSED STRINGER AT SOLID RAIL AND WALL BEYOND
5. SOLID RAIL
6. OPEN
7. OPENINGS (IRC2009 R312.2) OPEN GUARDRAILS SHALL HAVE INTERMEDIATE RAIL OR AN ORNAMENTAL PATTERN SUCH THAT A SPHERE 4" IN DIAMETER CANNOT PASS THROUGH).
8. MAX. OPENING THAT 6" SPHERE CAN NOT PASS THRU.

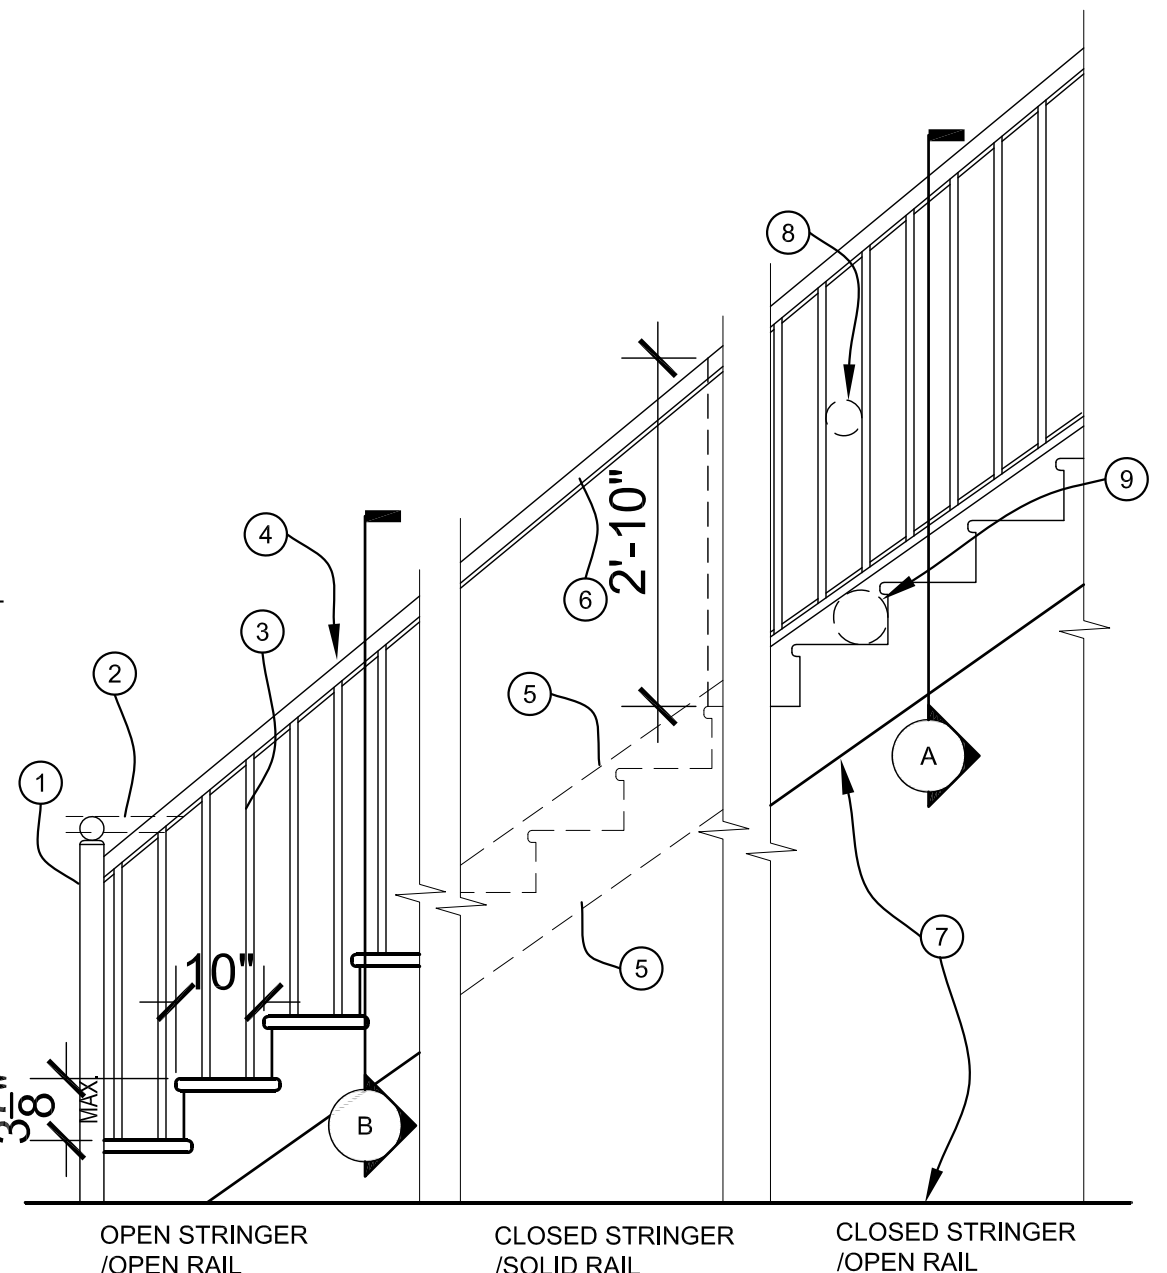

1 STAIR ELEVATION

SCALE: 1/2"=1'-0"

STR-004

D2 ROOF DECK

SCALE: 1 1/2" = 1'-0"

STR-001


P1 PARTITION TYPE "P1"

SCALE: 3" = 1'-0"

P1010-700


S1 SLAB ON GRADE

SCALE: 1 1/2" = 1'-0"


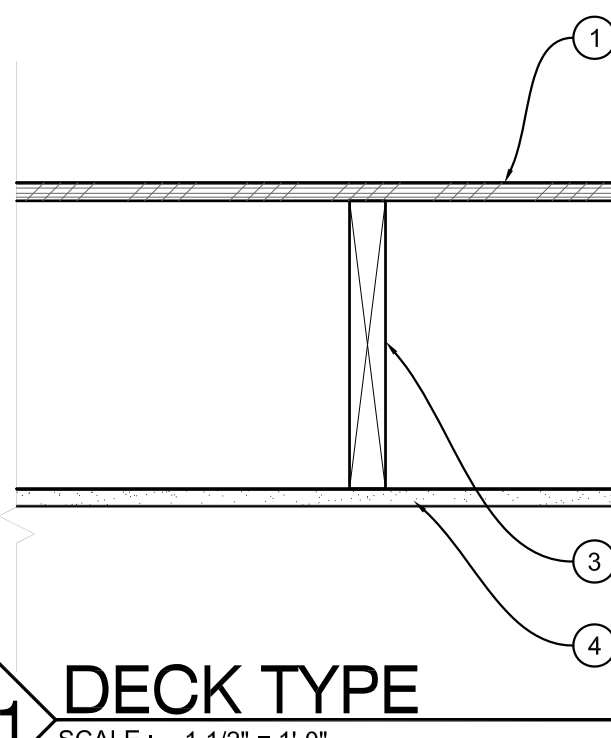


D1 DECK TYPE


SCALE: 1 1/2" = 1'-0"

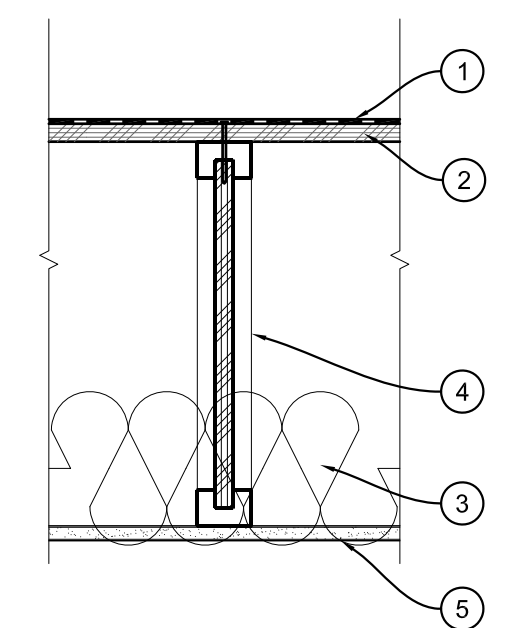

1. 2x6 STUDS AT 24" O.C. TYP. INTERIOR PLUMBING WALL
2. 1/2" THICK GYP. BOARD
3. FULL HEIGHT 1/2" THICK FIBER CEMENT GLASS MATT BOARD AND CERAMIC TILE AT 6'-0" A.F.F. MIN
4. 3" THICK ACOUSTICAL INSULATION IN PLUMBING WALLS.

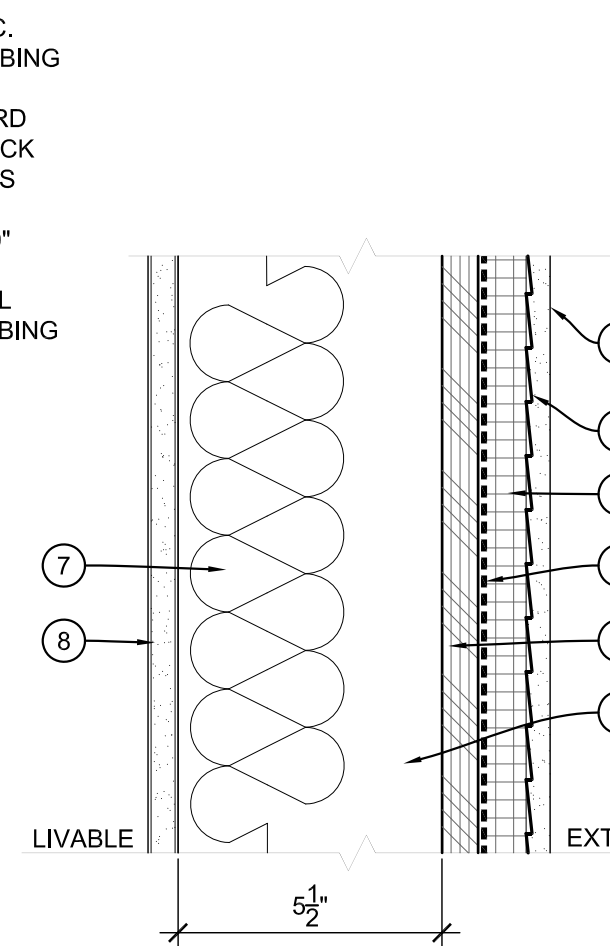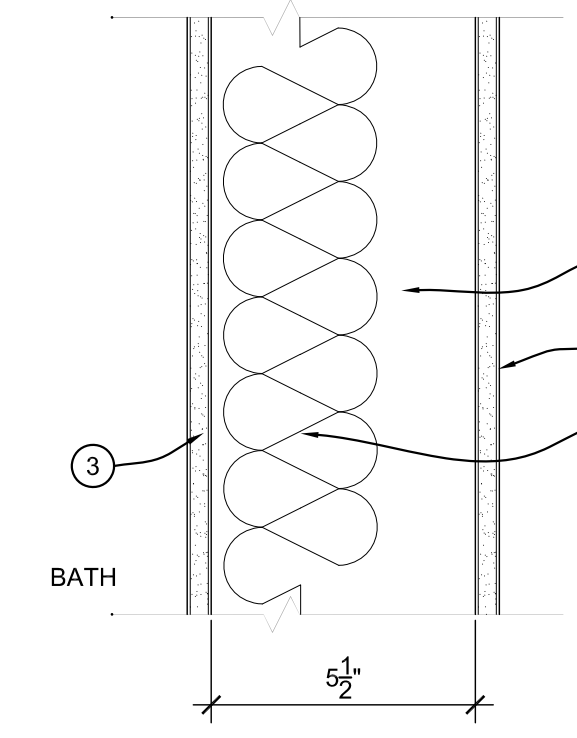


1. 1-KOTE STUCCO SYSTEM, ICC-ESR 1607
2. LATH
3. RIGID INSULATION BOARD
4. BUILDING PAPER
5. PLYWOOD SHEATHING, REFER TO SHEAR WALL SCHEDULE.
6. 2x6 WOOD STUDS @ 16" O.C.
7. FIBERGLASS BATT INSULATION R=19 MIN.
8. 1/2" THICK GYPSUM BOARD

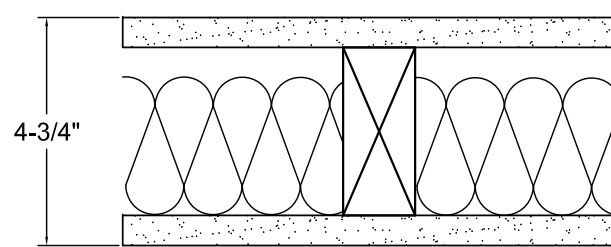

System Description
Wood Stud Partition (Loadbearing)


- 5/8" SHEETROCK Brand FIRECODE Core Gypsum Pane, SHEETROCK
- Brand FIRECODE Core Gypsum Panel Mold Tough, FIBEROCK Brand Panel or IMPERIAL Brand FIRECODE Core Gypsum Base
- 2x4 stud 24" o.c.
- 3" mineral wool batt
- 5/8" SHEETROCK Brand FIRECODE Core Gypsum Panel
- joints finished
- optional veneer plaster

System Performance
1 HR Fire
UL Design No. U305 or U314
46 STC Sound
BNN-700725

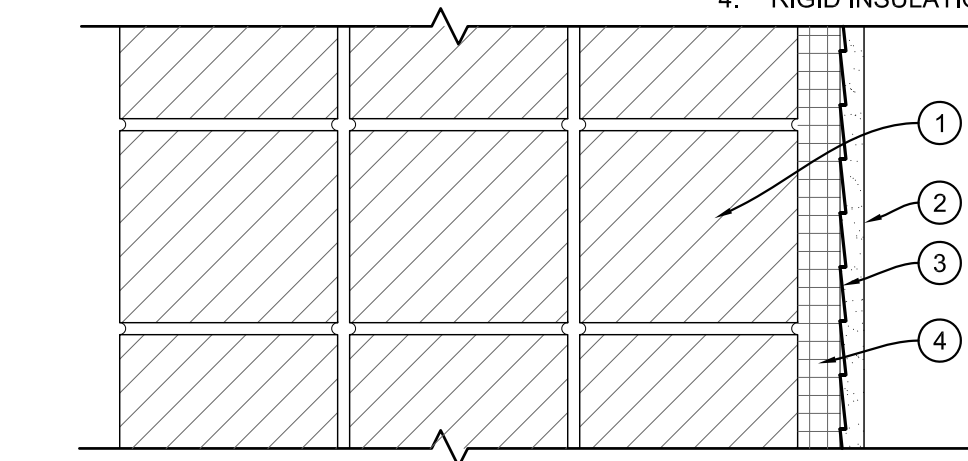


W2 WALL-TYPE W2

SCALE: 3" = 1'-0"

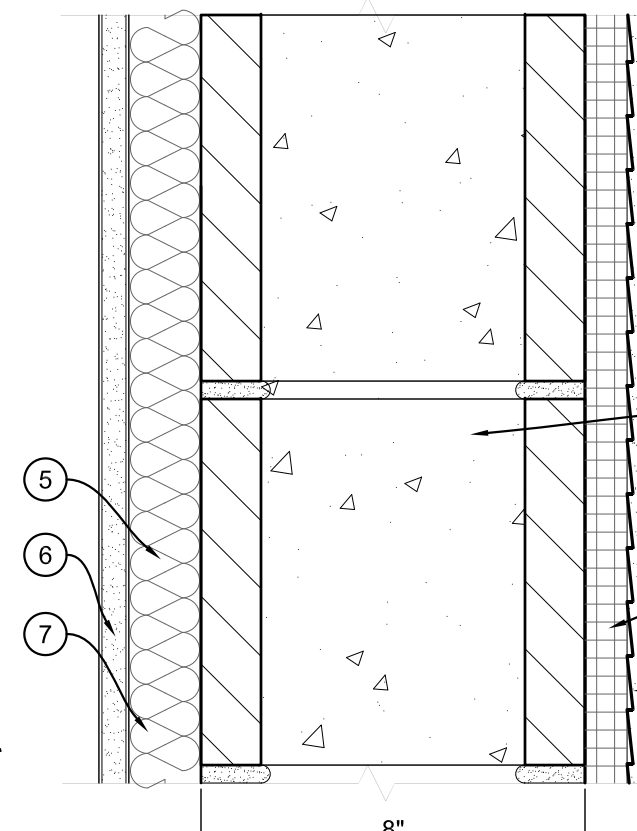

W3 WALL-TYPE W3

SCALE: 3" = 1'-0"

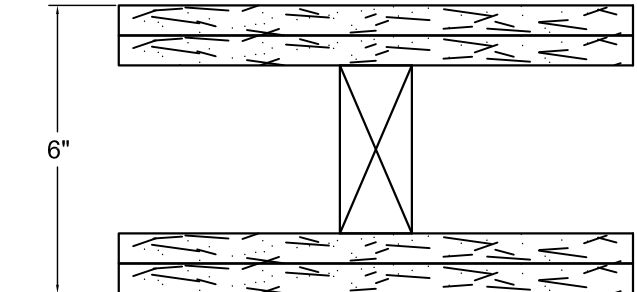


System Performance
2 HR Fire
UL Design No. U301

System Description
Wood Stud Exterior Wall (Loadbearing)

- 5/8" SHEETROCK Brand FIRECODE Core Gypsum Sheathing or FIBEROCK Brand AQUA-X-TOUGH Exterior Sheathing
- 2" x 4" wood studs 16" o.c.
- 5/8" SHEETROCK Brand FIRECODE Core Gypsum Panels
- Joints exposed or finished

W4 WALL-TYPE W4

SCALE: 3" = 1'-0"

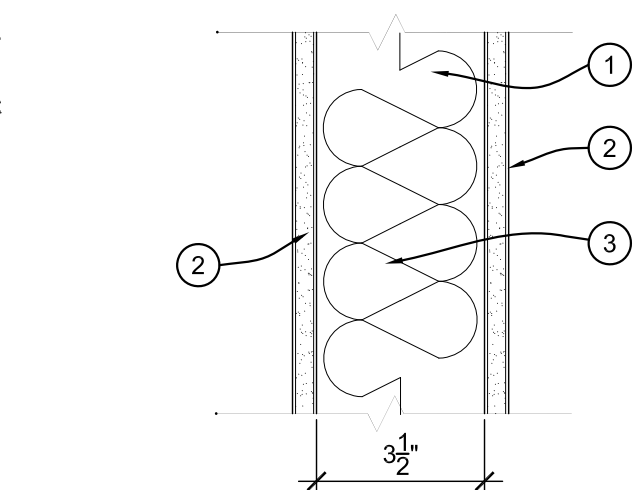

1. 2x4 STUDS AT 24" O.C. TYP. INTERIOR PARTITION WALL
2. 1/2" THICK GYP. BOARD
3. OPTIONAL ACOUSTICAL INSULATION

Project:

WASHINGTON DC
TOWNHOUSE

Seal:

Revision:

No. Date Description

Issue:

Date Description


Project Number:

Title:


CONSTRUCTION SYSTEM
TYPES DETAILS
ARCHITECTURAL
DETAILS

Sheet:


A500

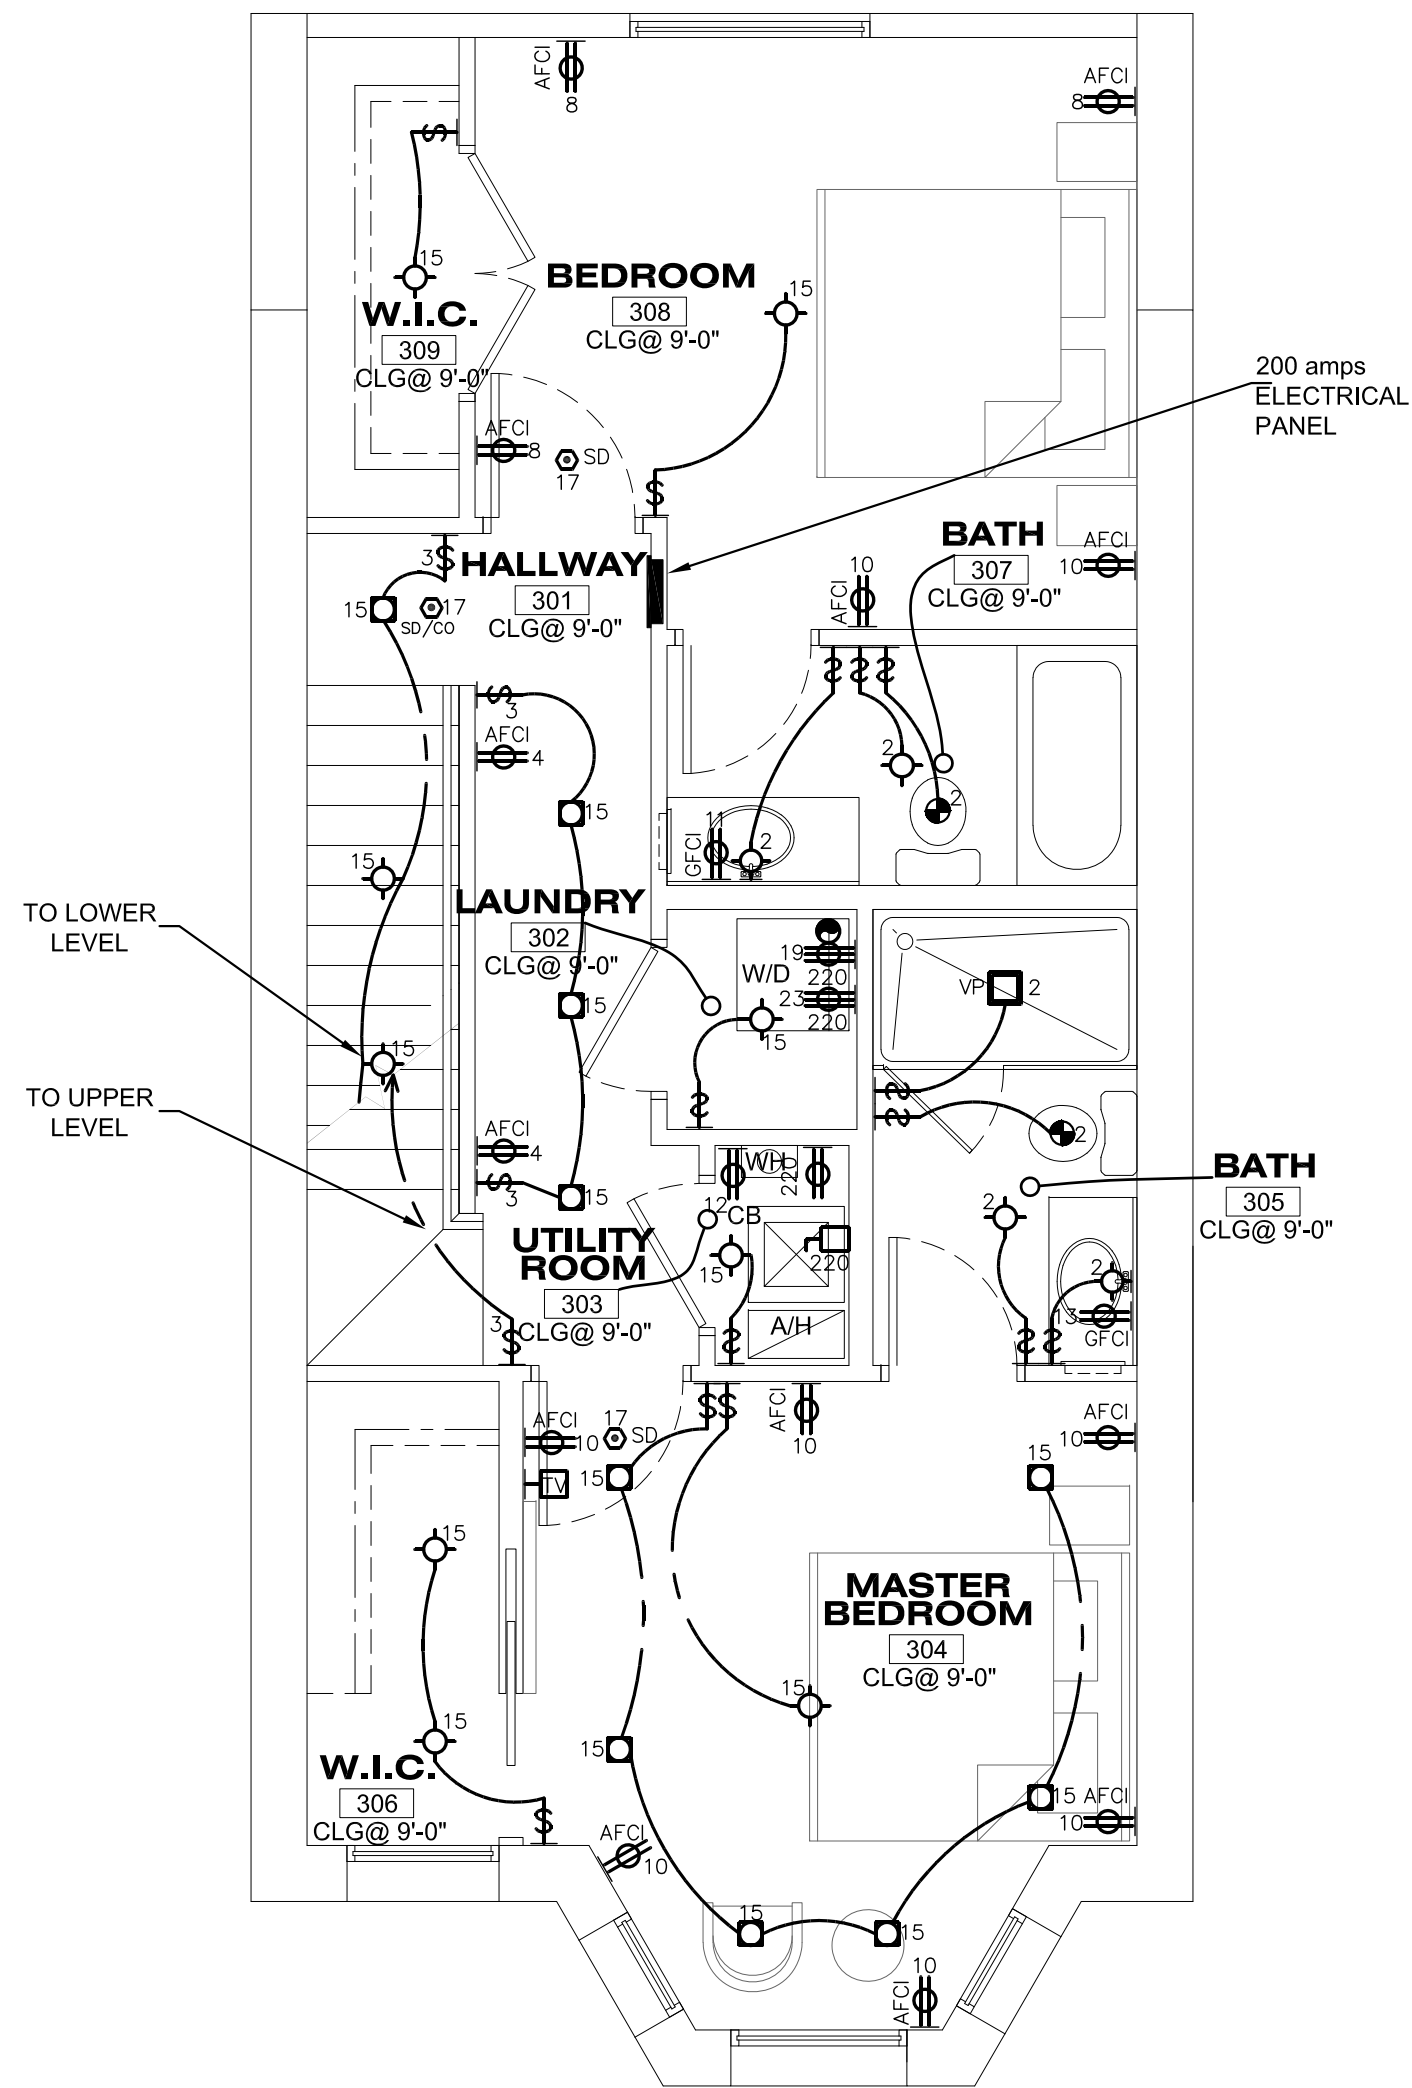


THIRD FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit B

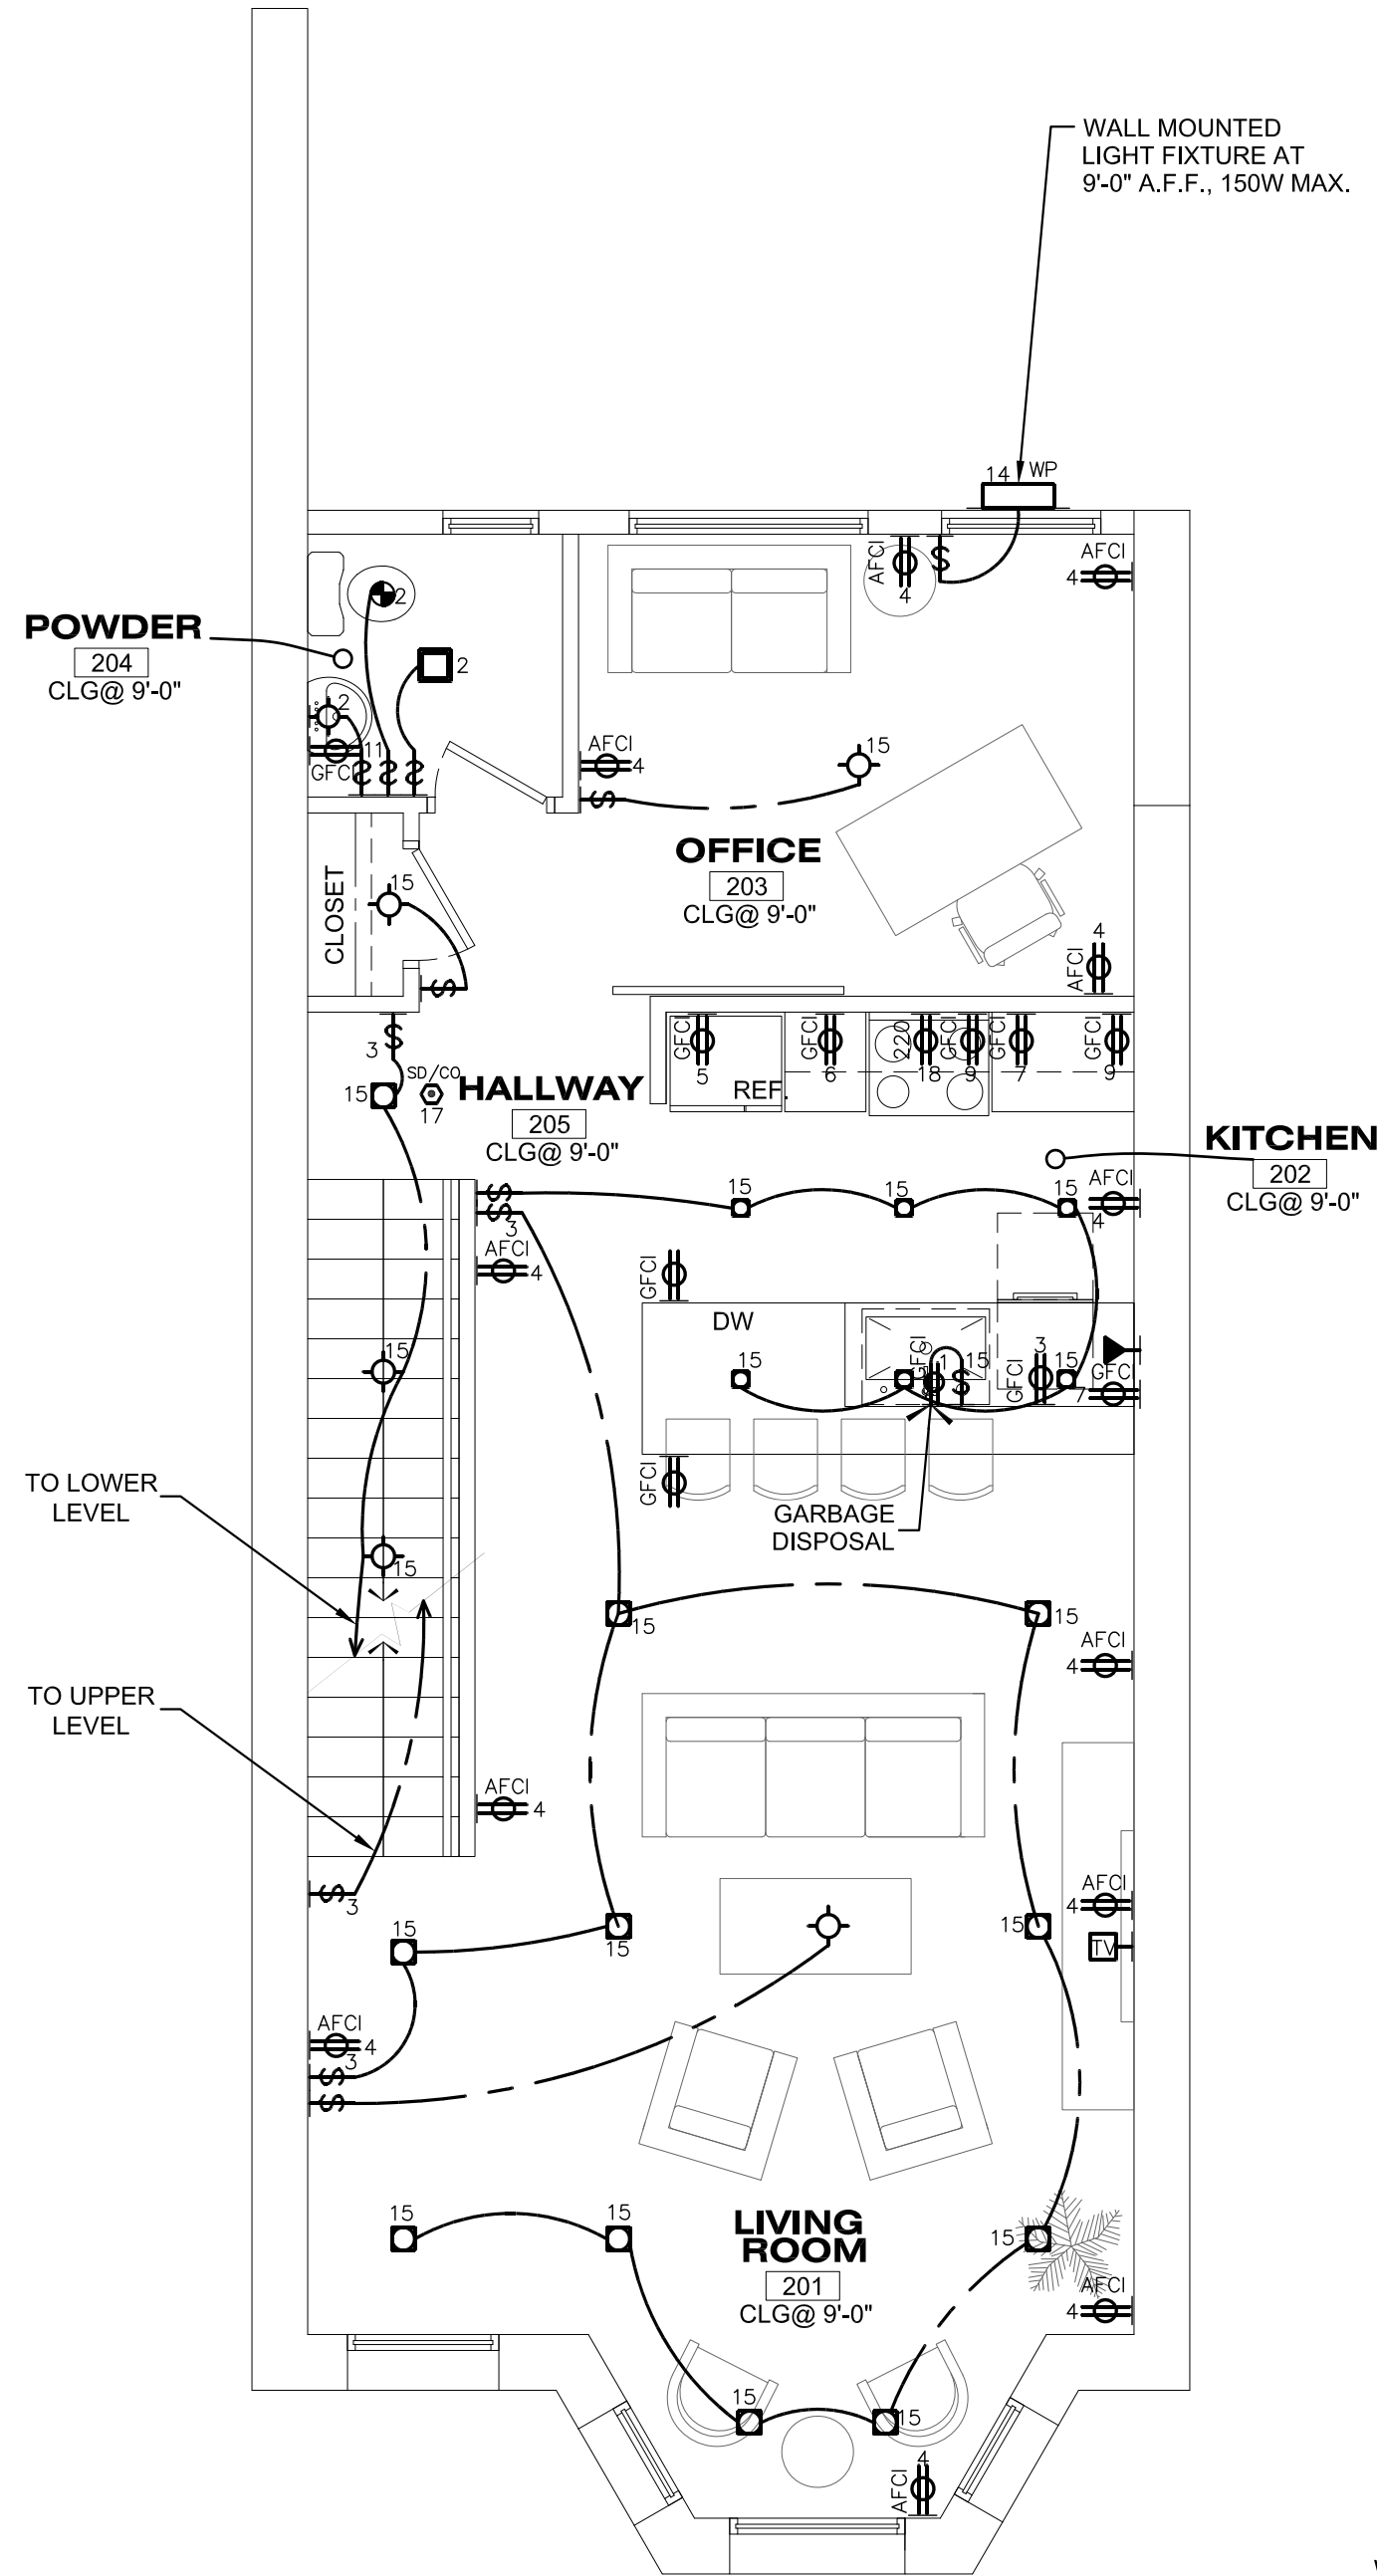

SECOND FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit B

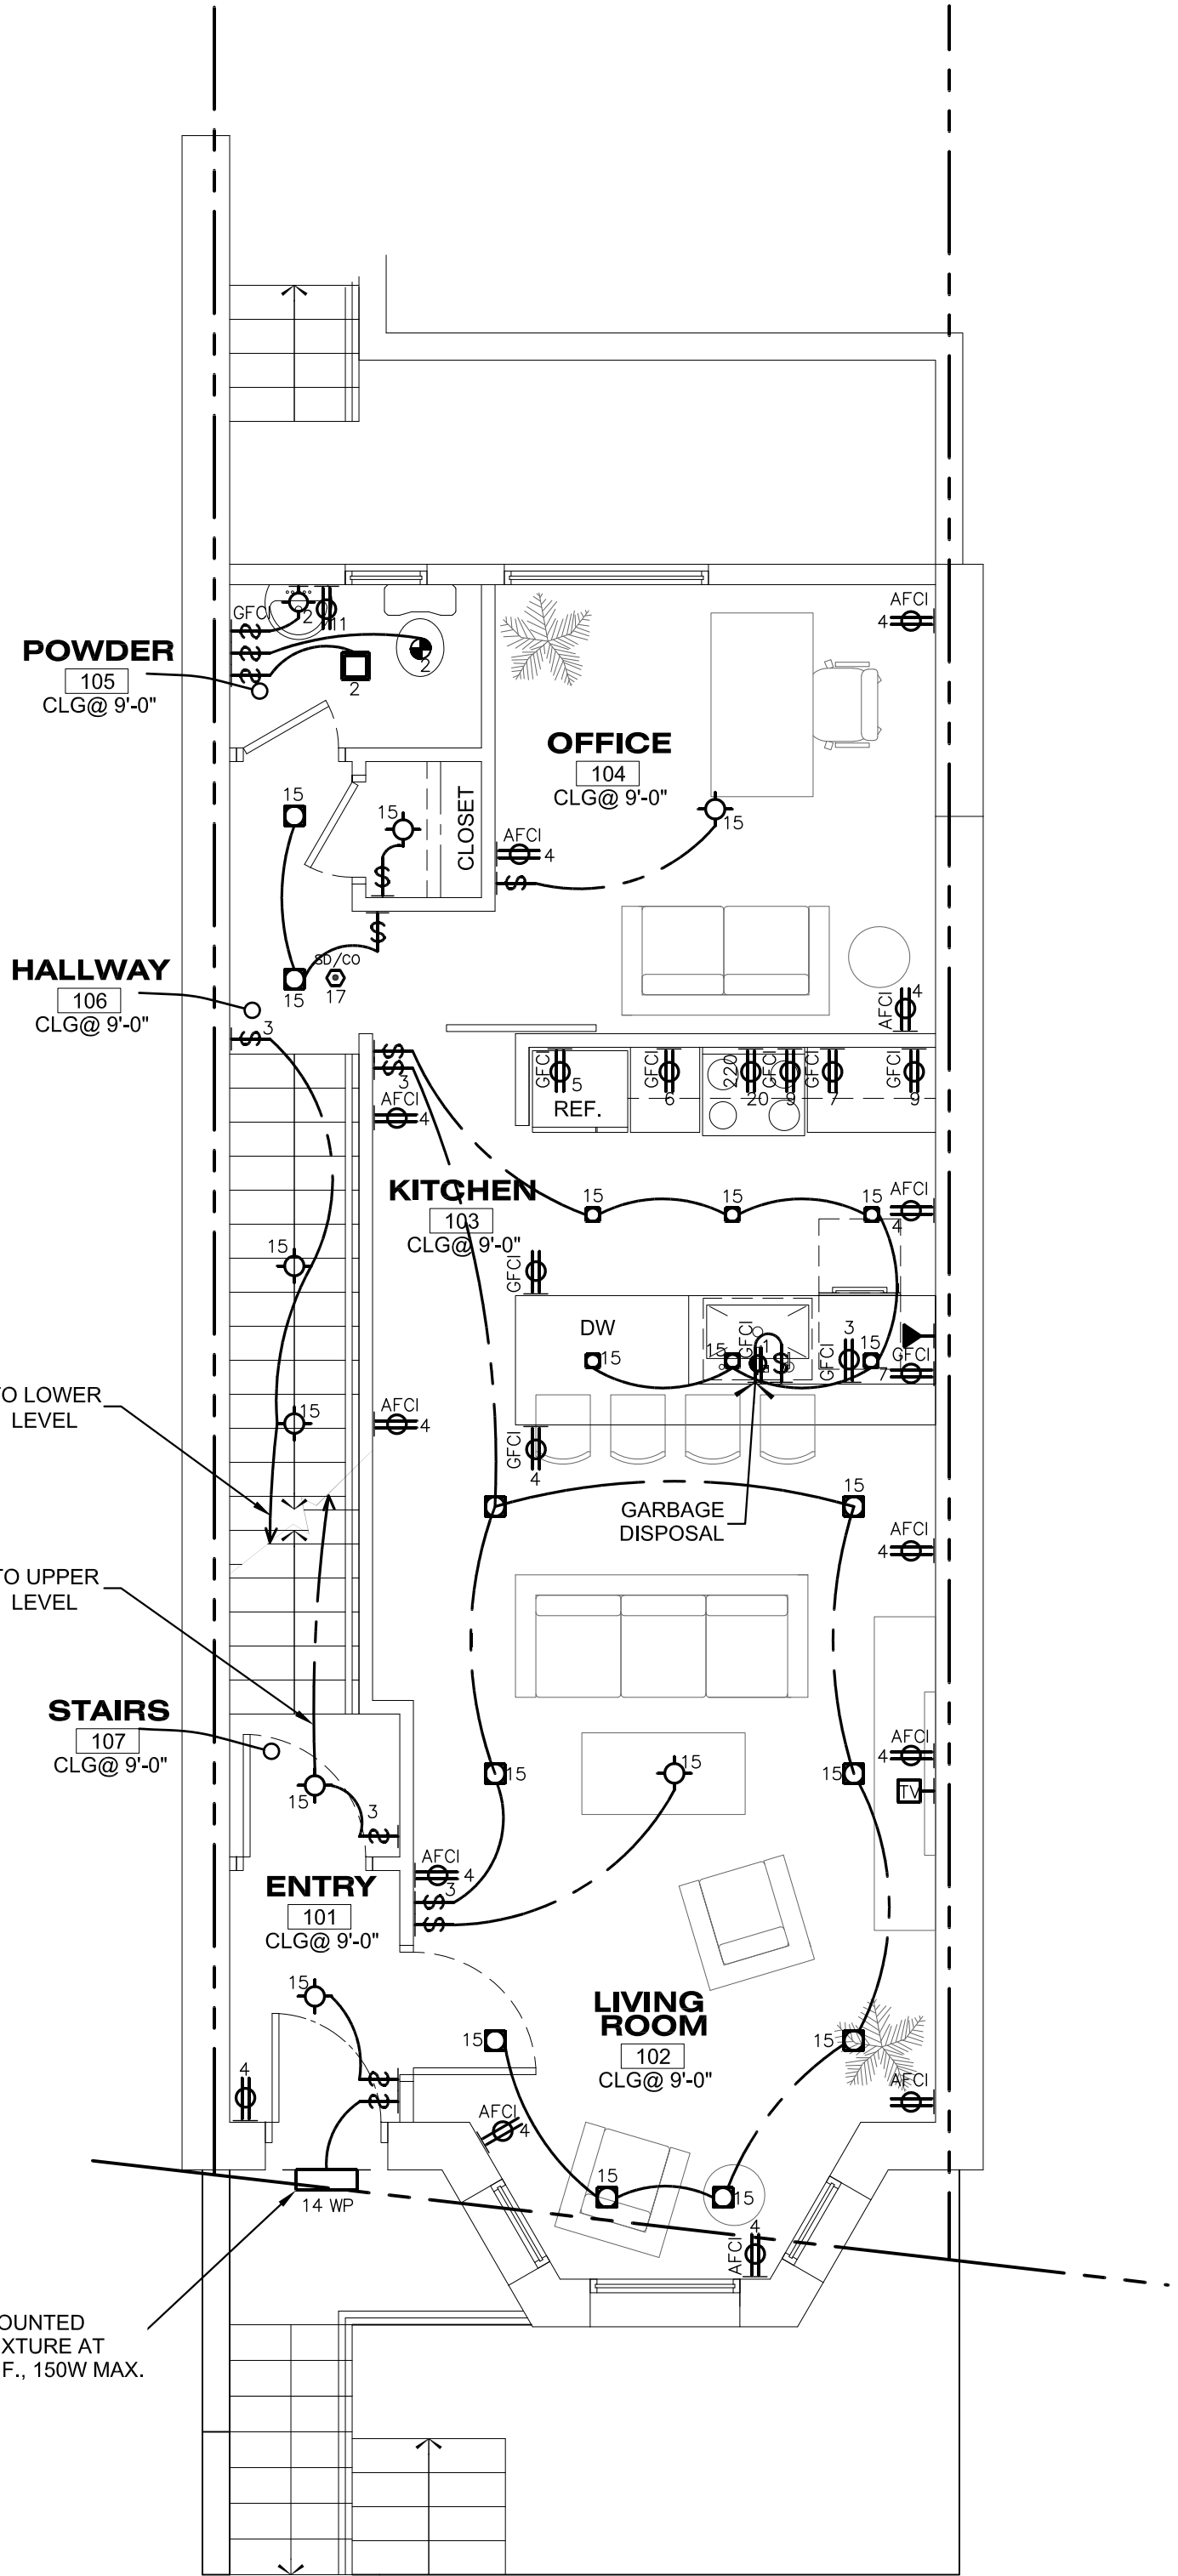

FIRST FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit A

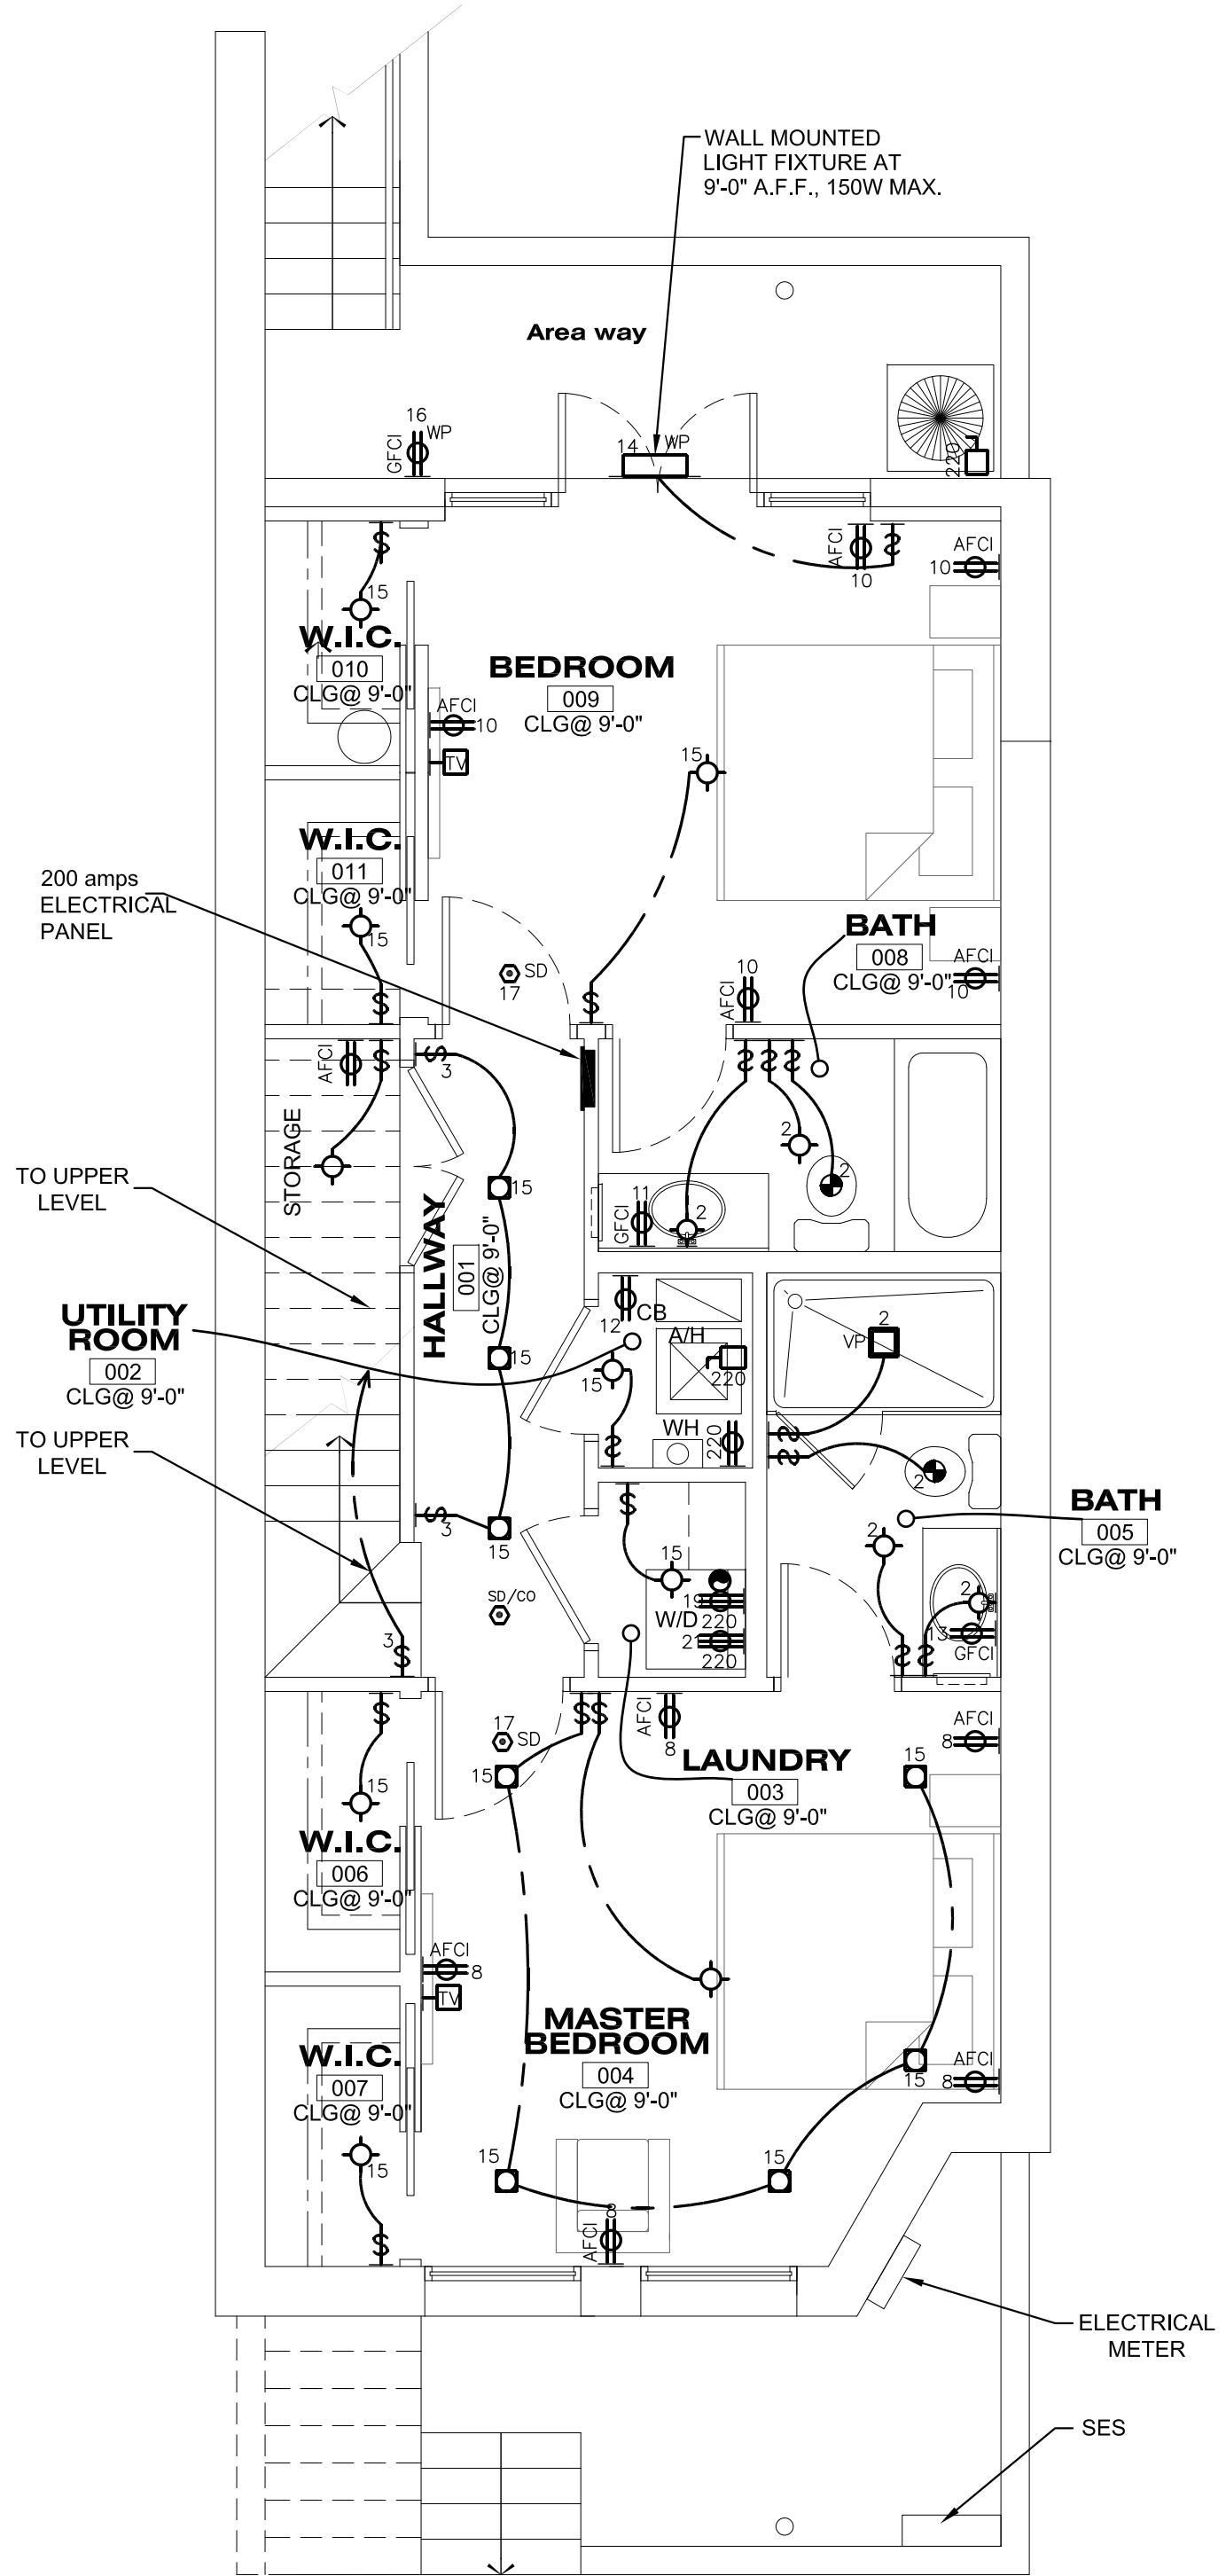

BASEMENT PLAN
SCALE: 1/4" = 1'-0"
unit A

ENERGY CONSERVATION NOTES

- IC-RATED RECESSED LIGHTING FIXTURES SEALED AT HOUSING/INTERIOR FINISH AND LABELED TO INDICATE ±2.0 CFM LEAKAGE AT 75 Pa
- 75% OF LAMPS IN PERMANENT FIXTURES OR 75% OF PERMANENT FIXTURES HAVE HIGH EFFICACY LAMPS. DOES NOT APPLY TO LOW-VOLTAGE LIGHTING.
- FUEL GAS LIGHTING SYSTEMS HAVE NO CONTINUOUS PILOT LIGHTS

**ADD TO GENERAL NOTES
ON ELECTRICAL PLAN IF**

ELECTRICAL LEGEND

- | | | | |
|--|---|--|--|
| | LIGHT, CEILING MTD. | | CHIME |
| | LIGHT, WALL MTD. @ +80" U.N.O. | | EXHAUST FAN TO OUTSIDE,
5 AIR CHANGES/HR. MIN/HARDWIRED WITH
BATTERY BACK UP |
| | LIGHT, RECESSED IN CEILING, ADJUSTABLE | | SMOKE DETECTOR |
| | LIGHT, RECESSED IN CEILING, DIAMETER 6" | | CARBON MONOXIDE
DETECTOR |
| | LIGHT, RECESSED IN CEILING, DIAMETER 4" | | W.P. WEATHERPROOF (RAINTIGHT) |
| | LIGHT, RECESSED IN WALL @ +12" | | U.N.O. UNLESS NOTED OTHERWISE |
| | TELEPHONE JACK @ +12" OR +44" | | SWITCH, SINGLE POLE
@ 48" UNLESS NOTED |
| | TELEVISION JACK @ +12" | | SWITCH, THREE-WAY |
| | PUSH BUTTON | | |

- | | |
|--|---|
| | SWITCH, FOUR-WAY |
| | DIMMER SWITCH |
| | RECEP. @ 12" UNLESS NOTED |
| | RECEP. ONE SIDE SWITCHED |
| | RECEP. 220V. |
| | RECEP., GRD. FAULT
CRT. INTERCEPTOR @ +44" |
| | RECEP. WATER PROOF |
| | RECEP., RECESSED IN FLOOR |
| | RECEP., FOURPLEX |

- | | |
|--|--|
| | CEILING OUTLET |
| | FAN &/OR LIGHT (2 CIRCUITS,
DBL. SWITCH |
| | FLUORESCENT FIXTURE,
EXPOSED BULB |
| | FLUORESCENT FIXTURE,
W/ DIFFUSER |
| | DISCONNECT |
| | LIGHT, CEILING |

- | | |
|--|---|
| | CHANDELIER |
| | LIGHT, CEILING |
| | BATHROOM EXHAUST
FAN, 3" Ø VENT THROUGH
ROOF (VTR)/VENT THROUGH
WALL (VTW) |

Project:

**WASHINGTON DC
TOWNHOUSE**

Seal:

Revision:

No. Date Description

Issue:

Date Description


Project Number:

Title:


**POWER AND LIGHTING
PLANS
BASEMENT PLAN
1ST FLOOR PLAN
2ND FLOOR PLAN
3RD FLOOR PLAN**

Sheet:


E100

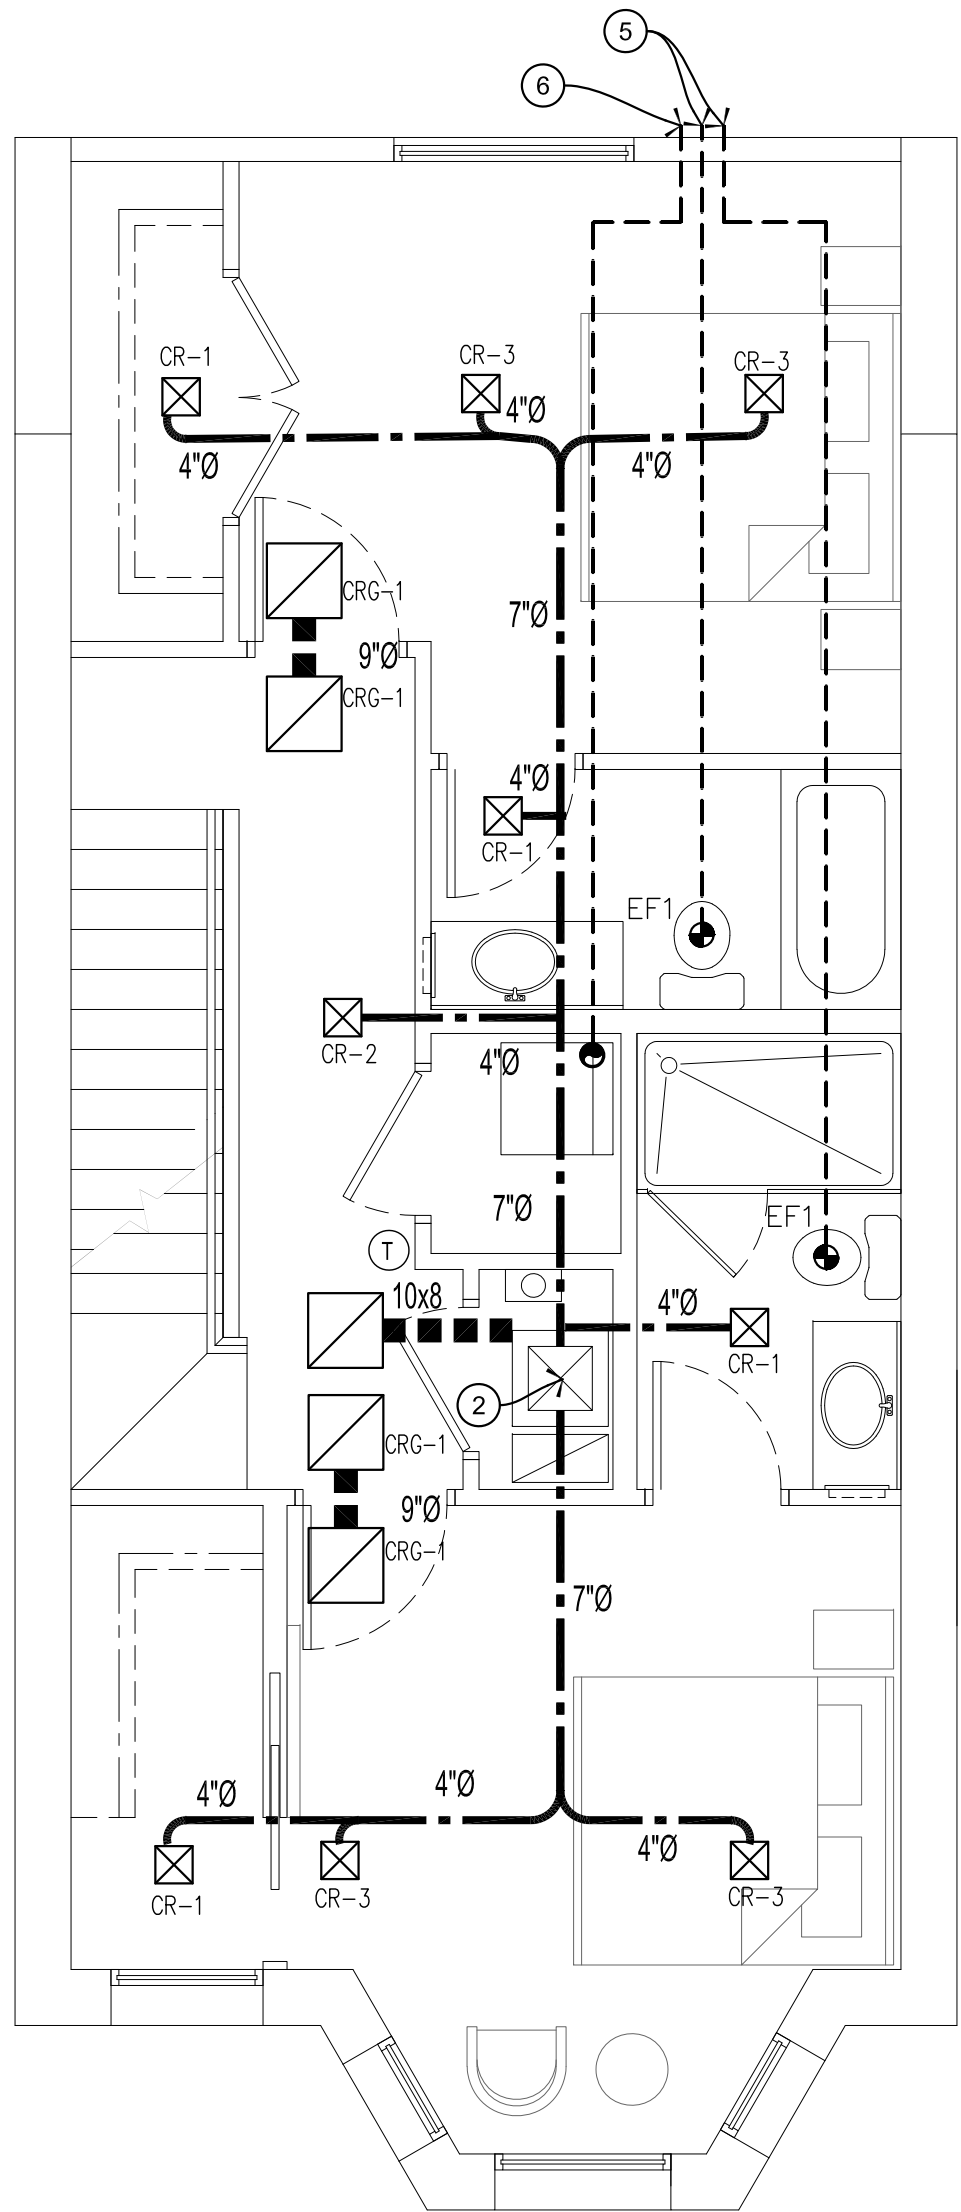


THIRD FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit B

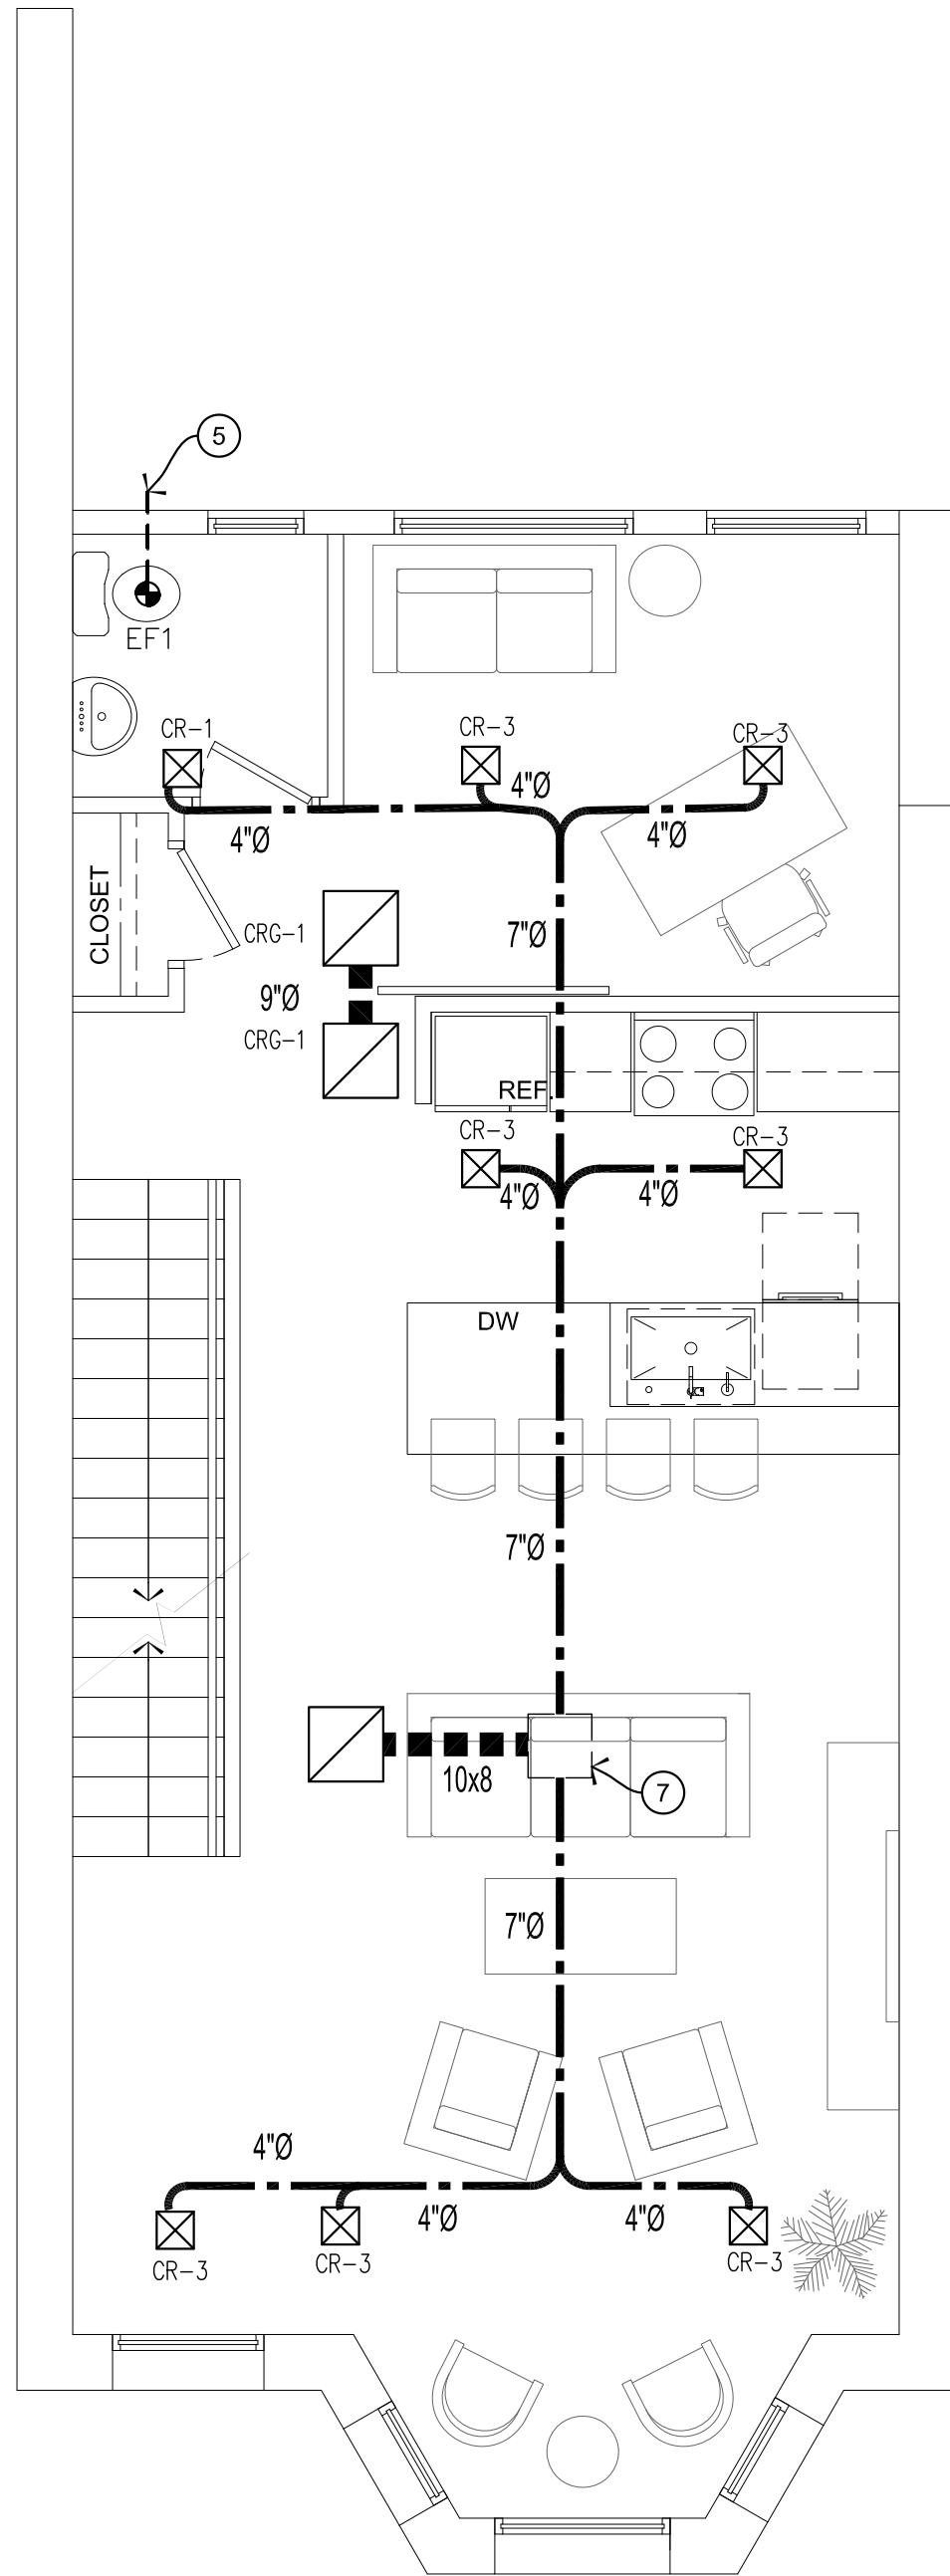

SECOND FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit B

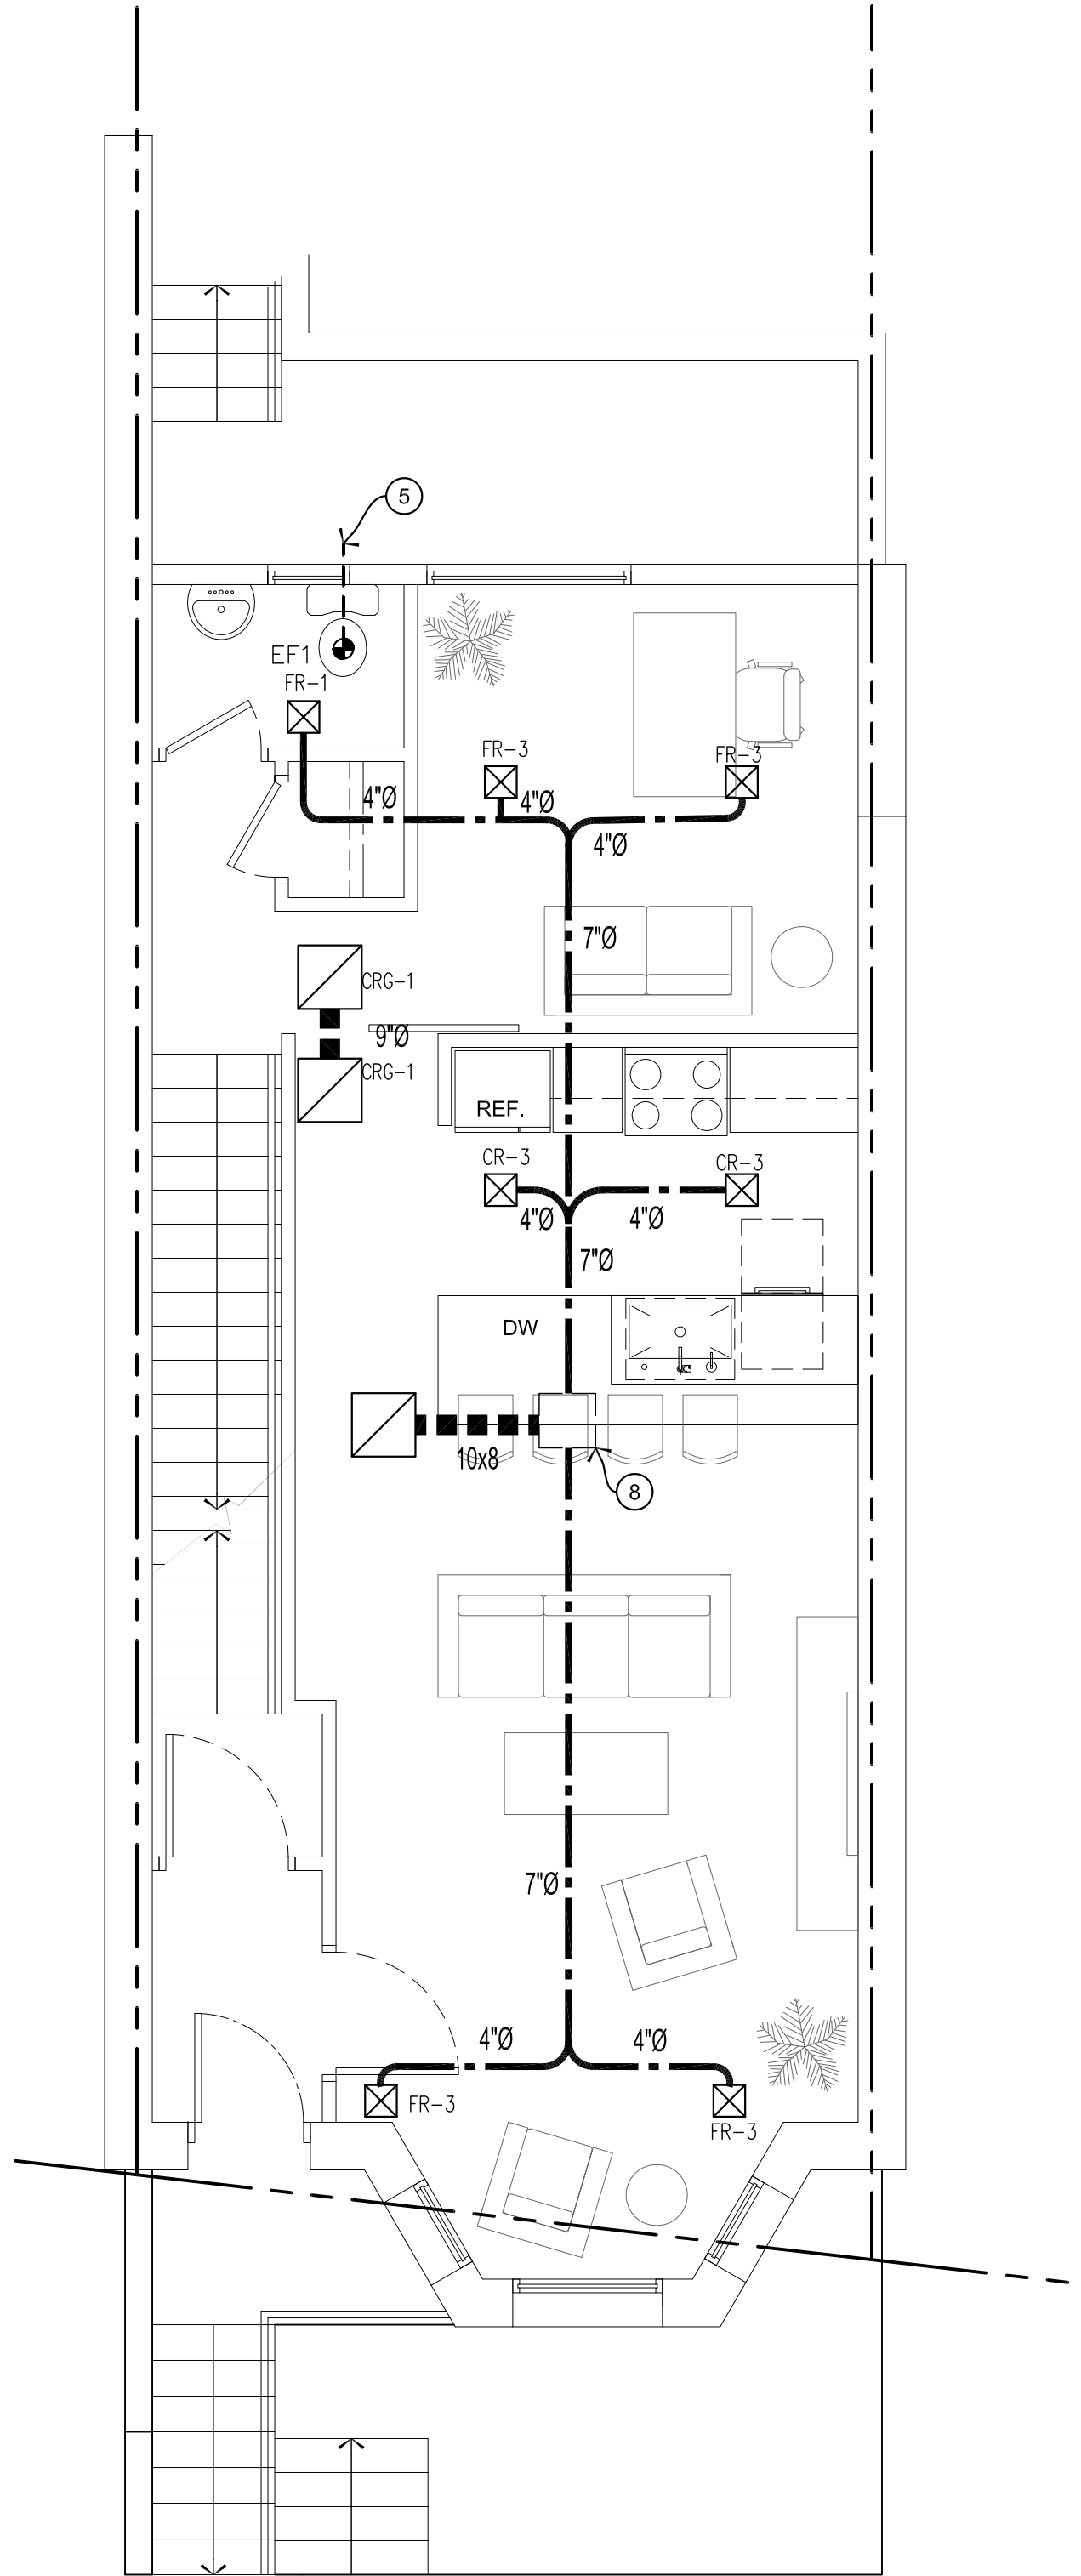

FIRST FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit A

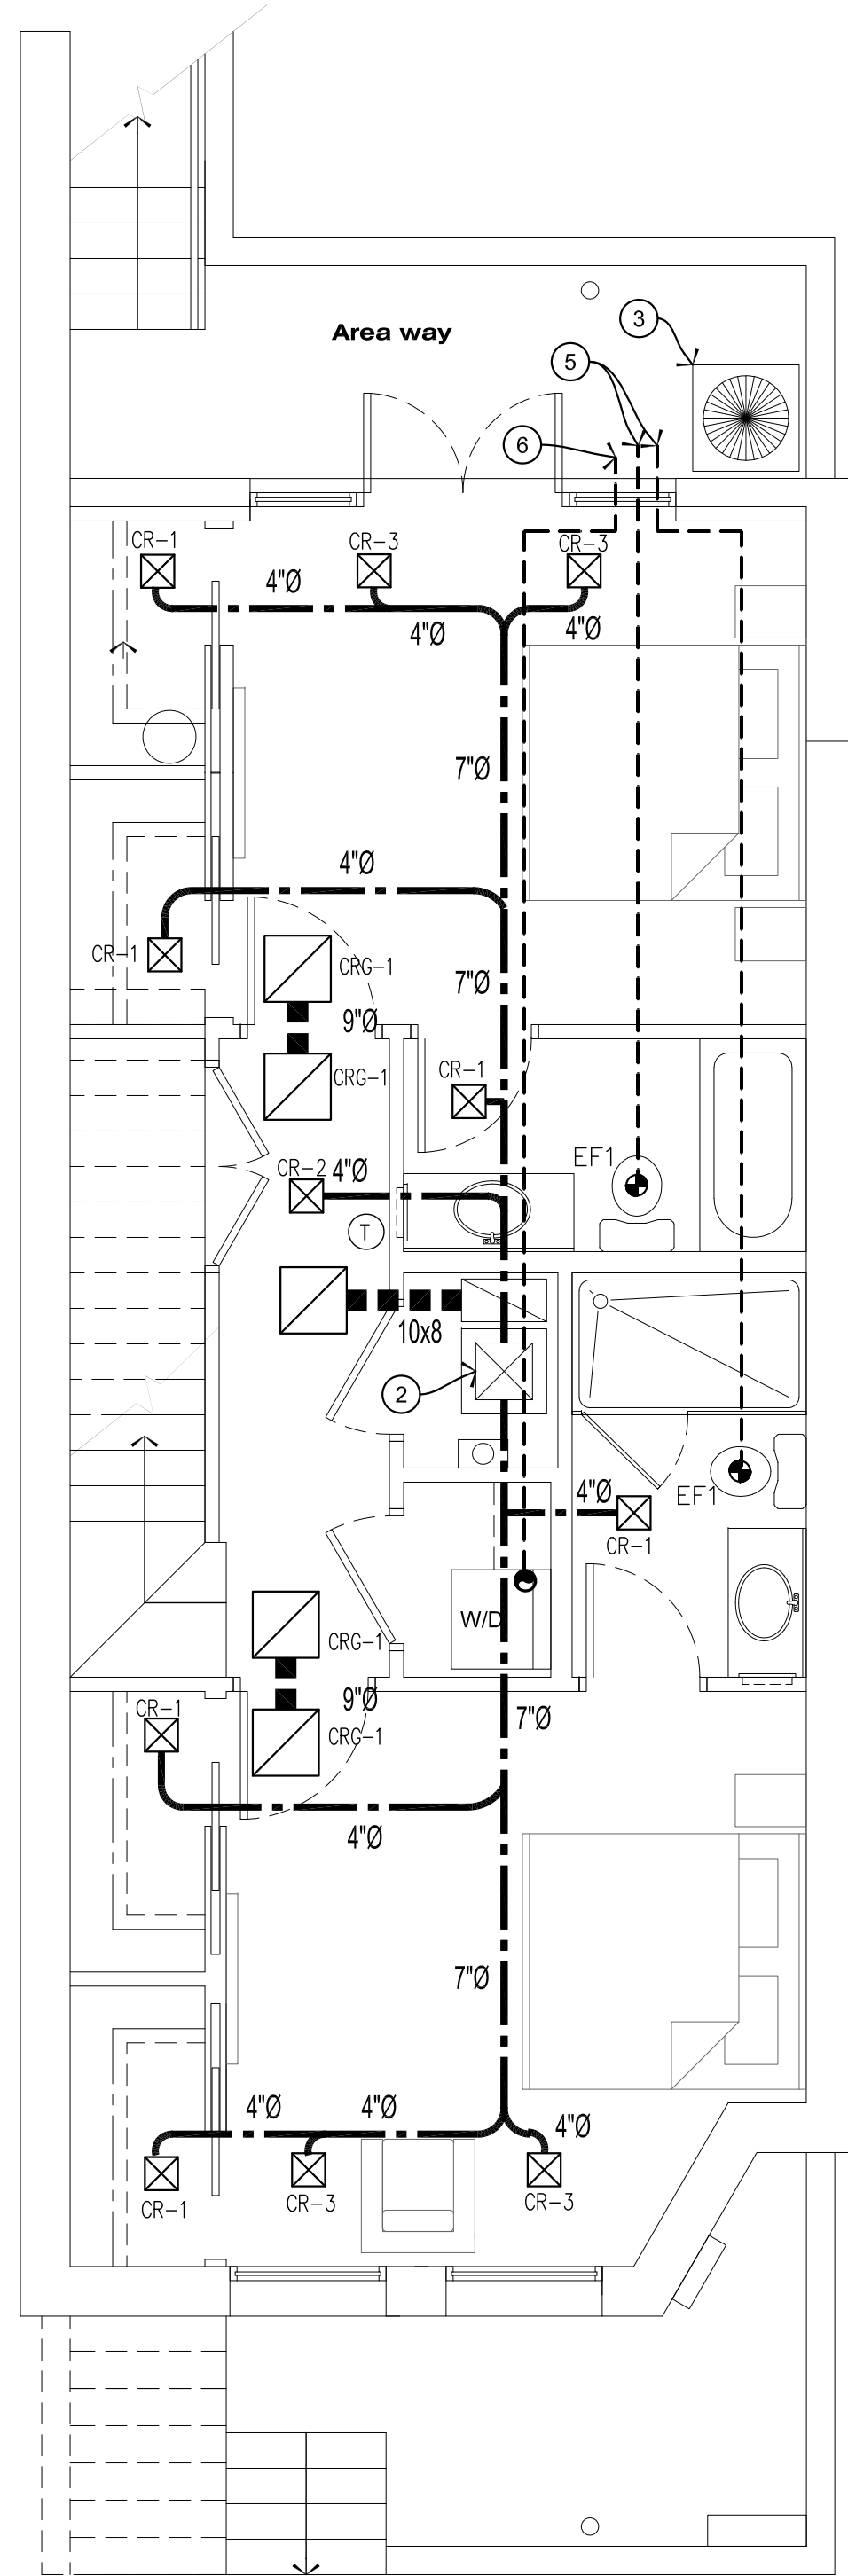

BASEMENT PLAN
SCALE: 1/4" = 1'-0"
unit A

KEYNOTES

- TO REGISTER ABOVE
- AIR HANDLER
- CONDENSING UNIT
- SIDEWALL RETURN
- 4" FLEXIBLE EXHAUST VENT
- 4" FLEXIBLE DRYER VENT
- UP TO AIR HANDLER
- DOWN TO AIR HANDLER

Project:
**WASHINGTON DC
TOWNHOUSE**

Seal:

Revision:
No. Date Description

Issue:
Date Description


Project Number:

Title:


**HVAC PLANS
BASEMENT PLAN
1ST FLOOR PLAN
2ND FLOOR PLAN
3RD FLOOR PLAN**

Sheet:


M100

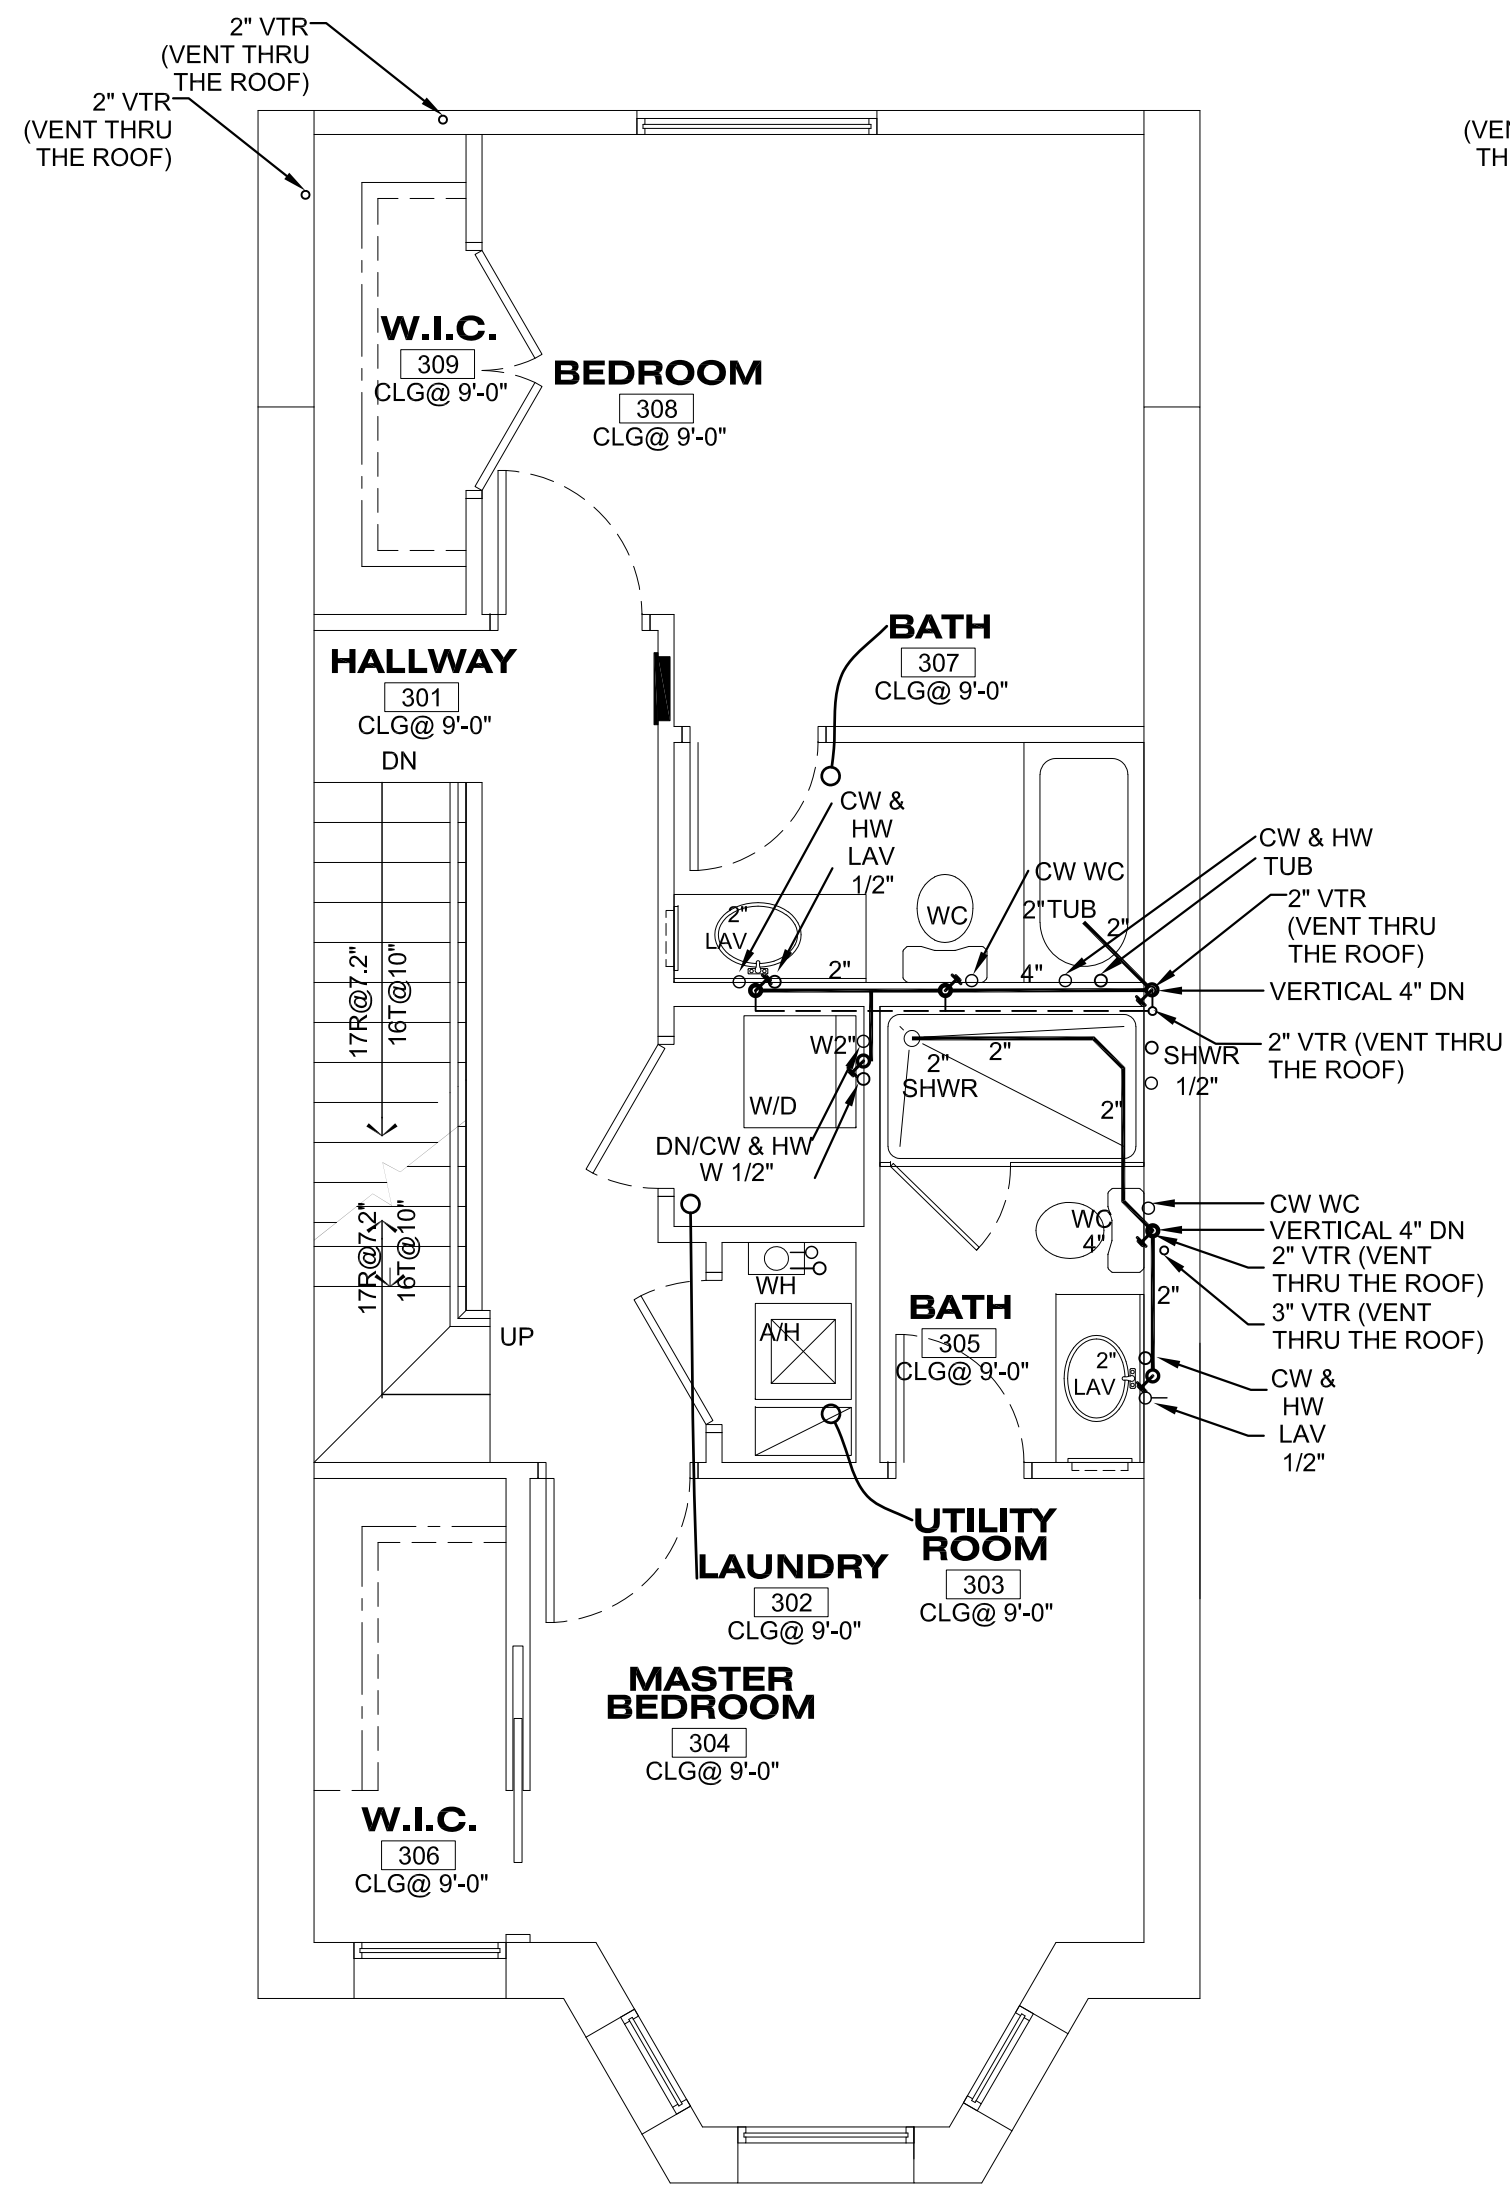


THIRD FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit B

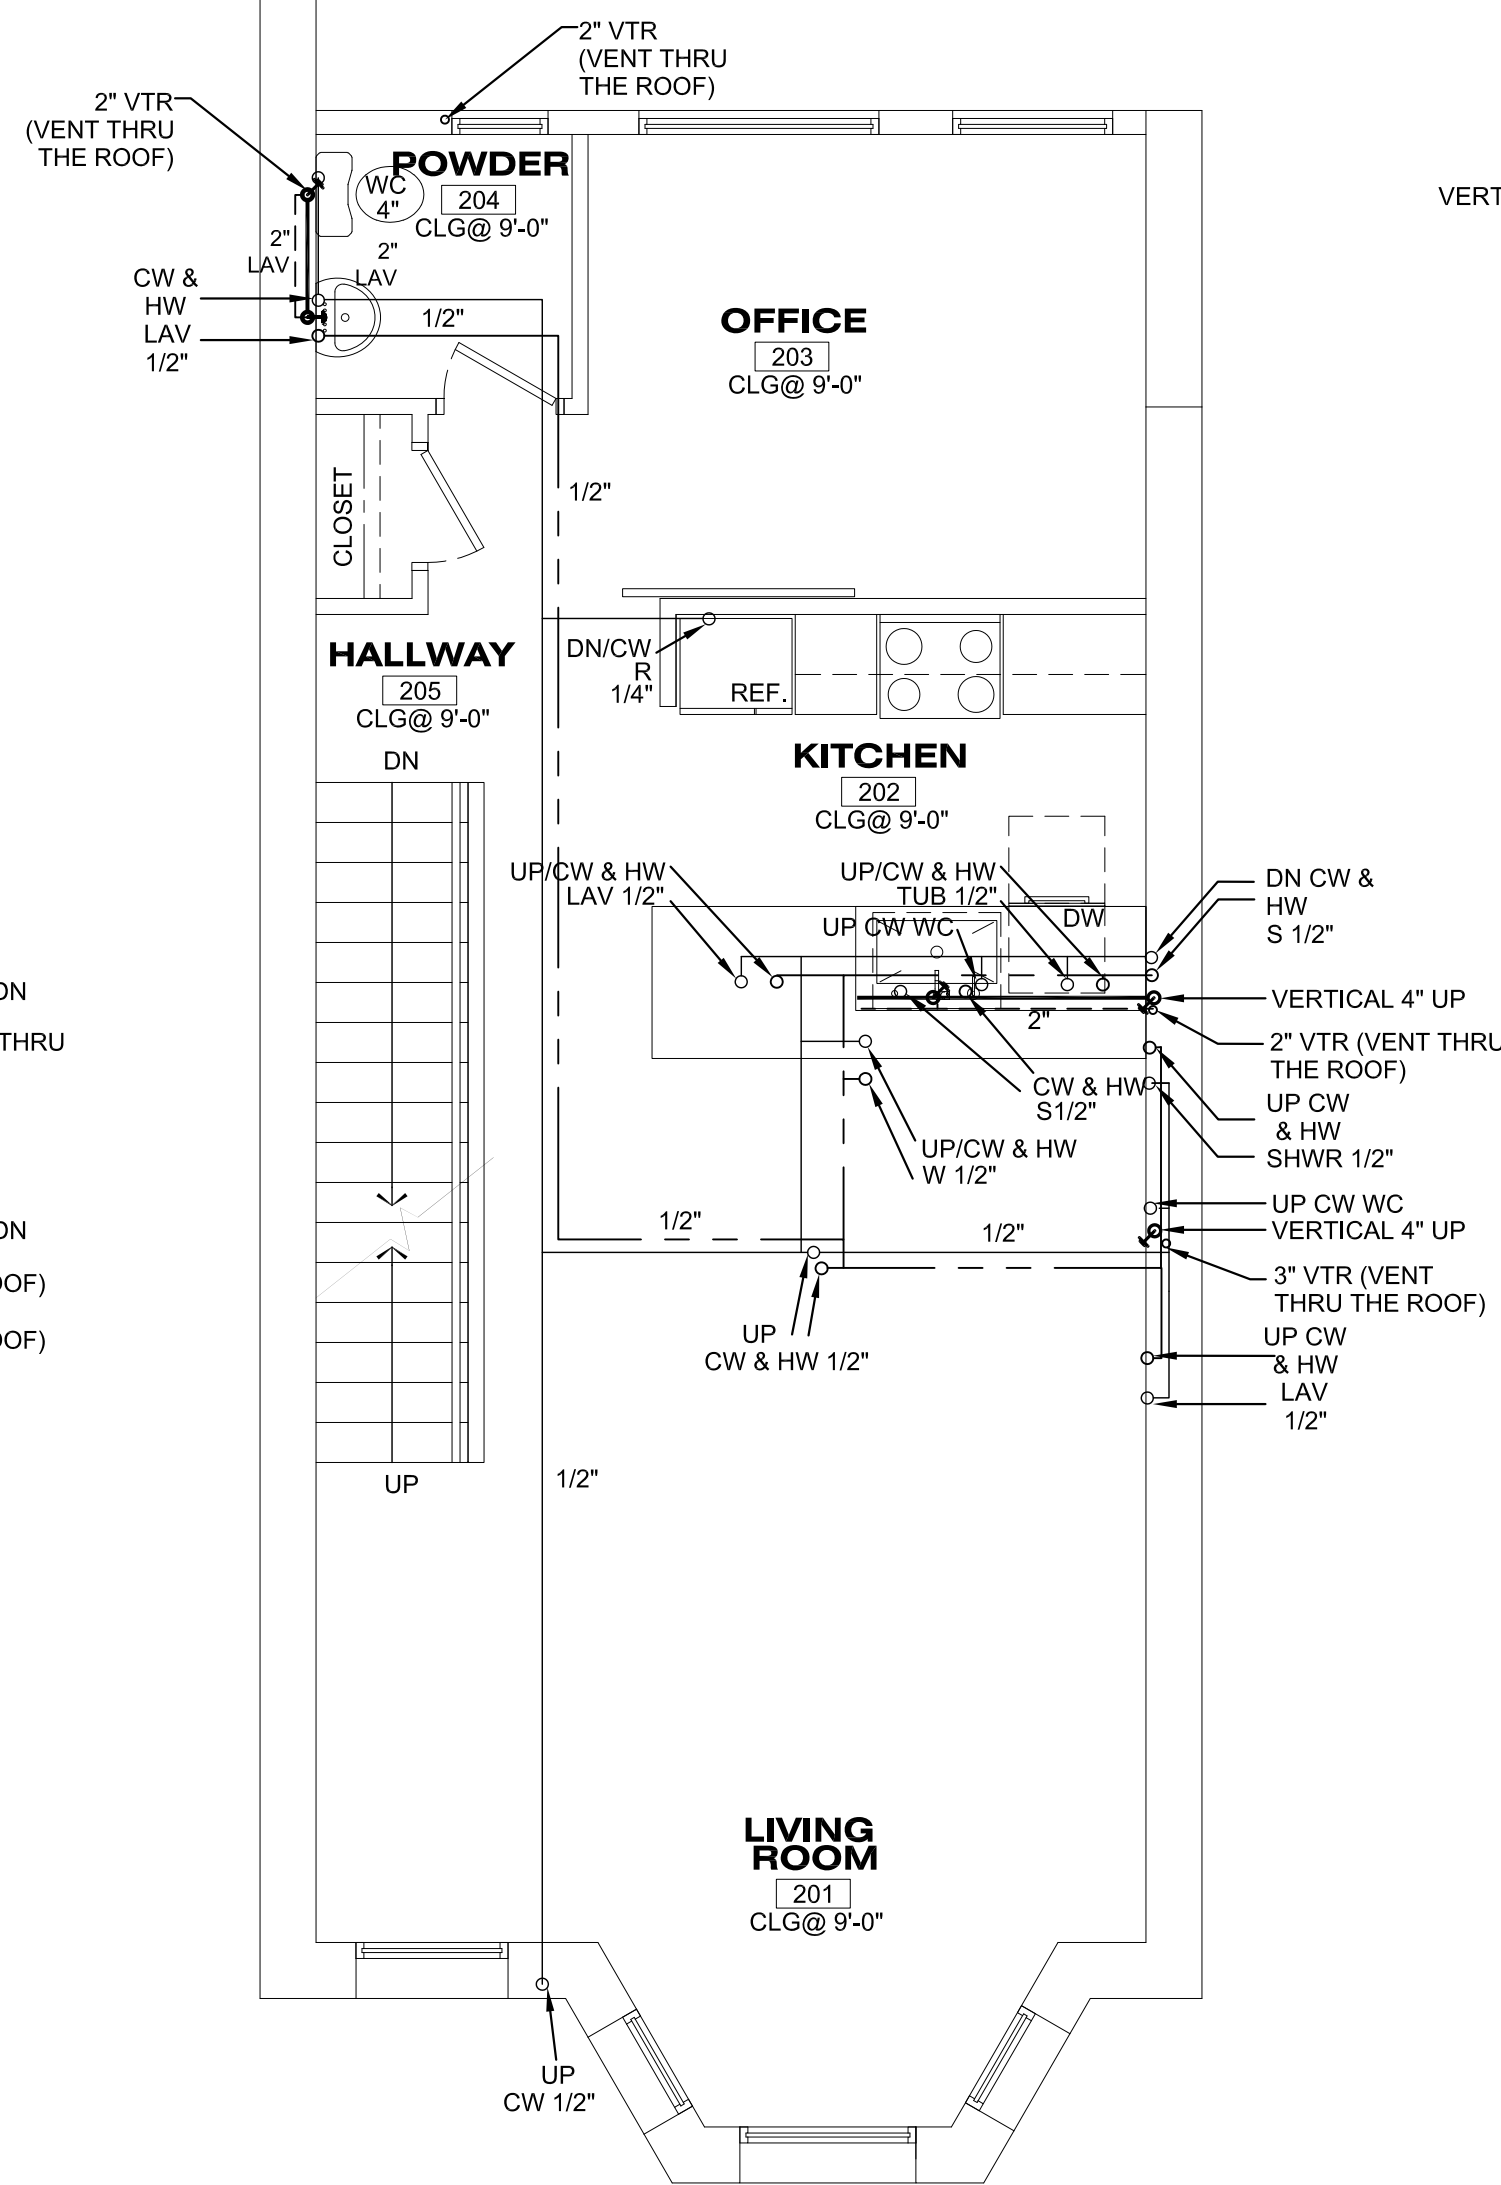

SECOND FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit B

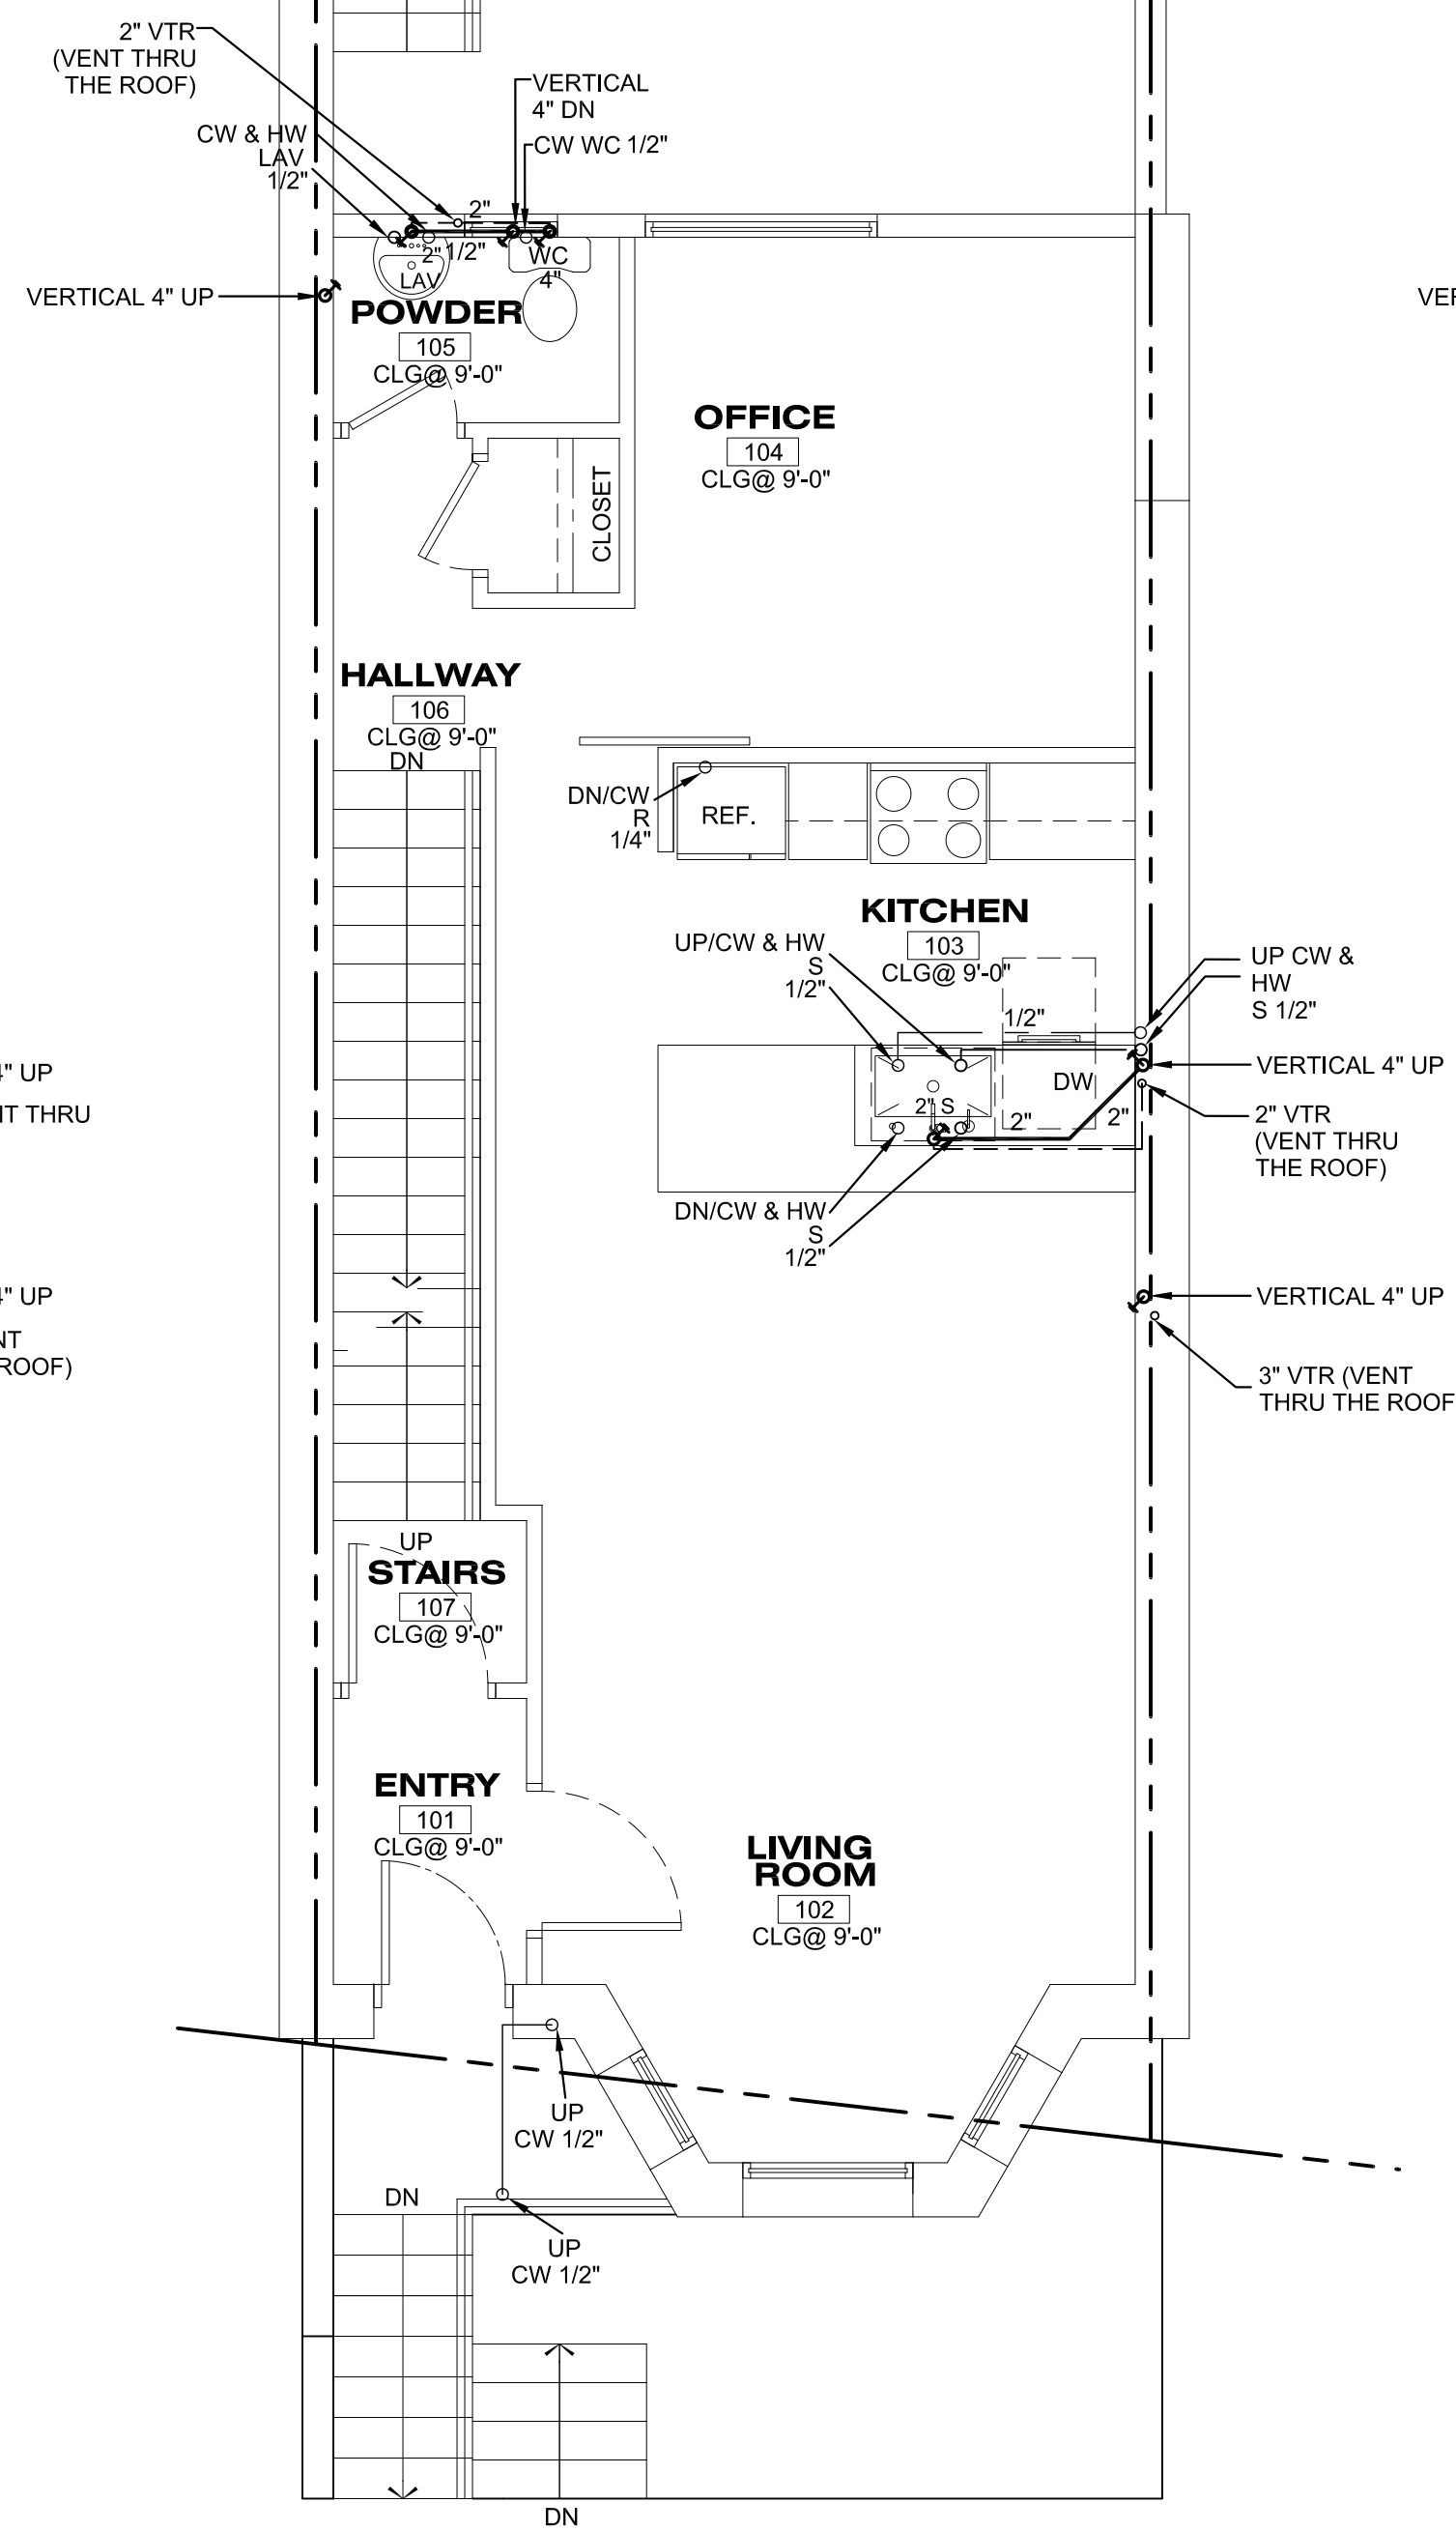

FIRST FLOOR PLAN
SCALE: 1/4" = 1'-0"
unit A

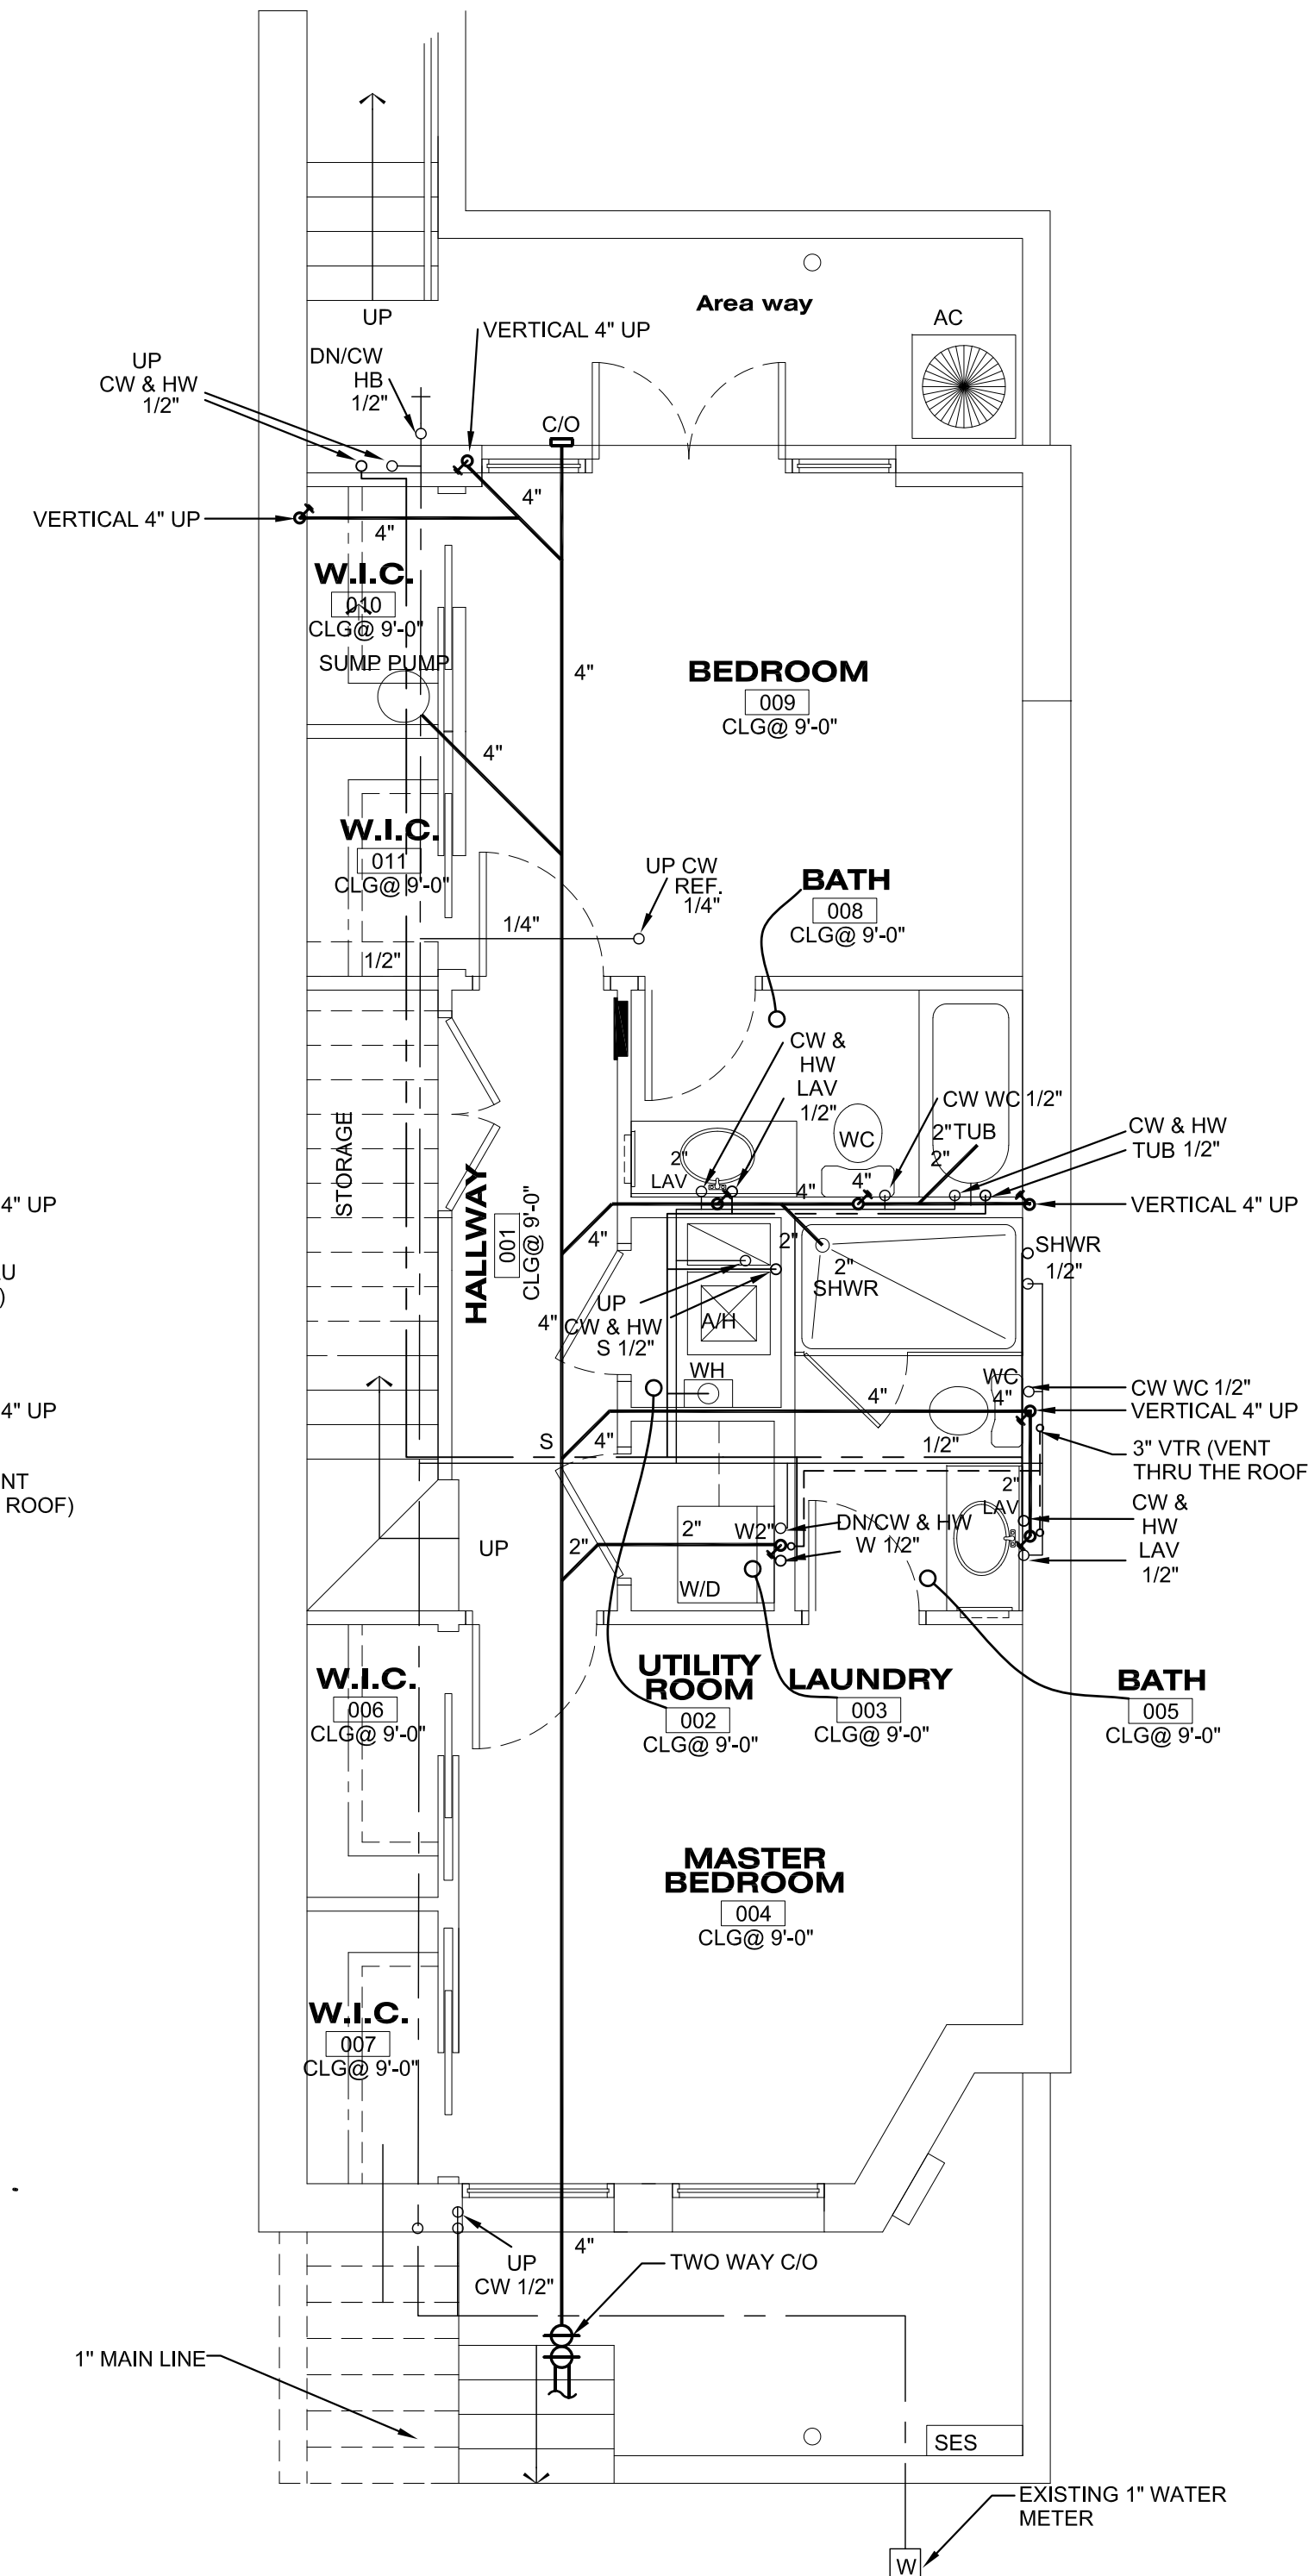

BASEMENT PLAN
SCALE: 1/4" = 1'-0"
unit A

LEGEND

- COLD WATER
- HOT WATER
- WASTE LINE

Project:

**WASHINGTON DC
TOWNHOUSE**

Seal:

Revision:

No. Date Description

Issue:

Date Description


Project Number:

Title:

**WATER SUPPLY AND
VENT. & WASTE
BASEMENT PLAN
1ST FLOOR PLAN
2ND FLOOR PLAN
3RD FLOOR PLAN**


Sheet:

P100

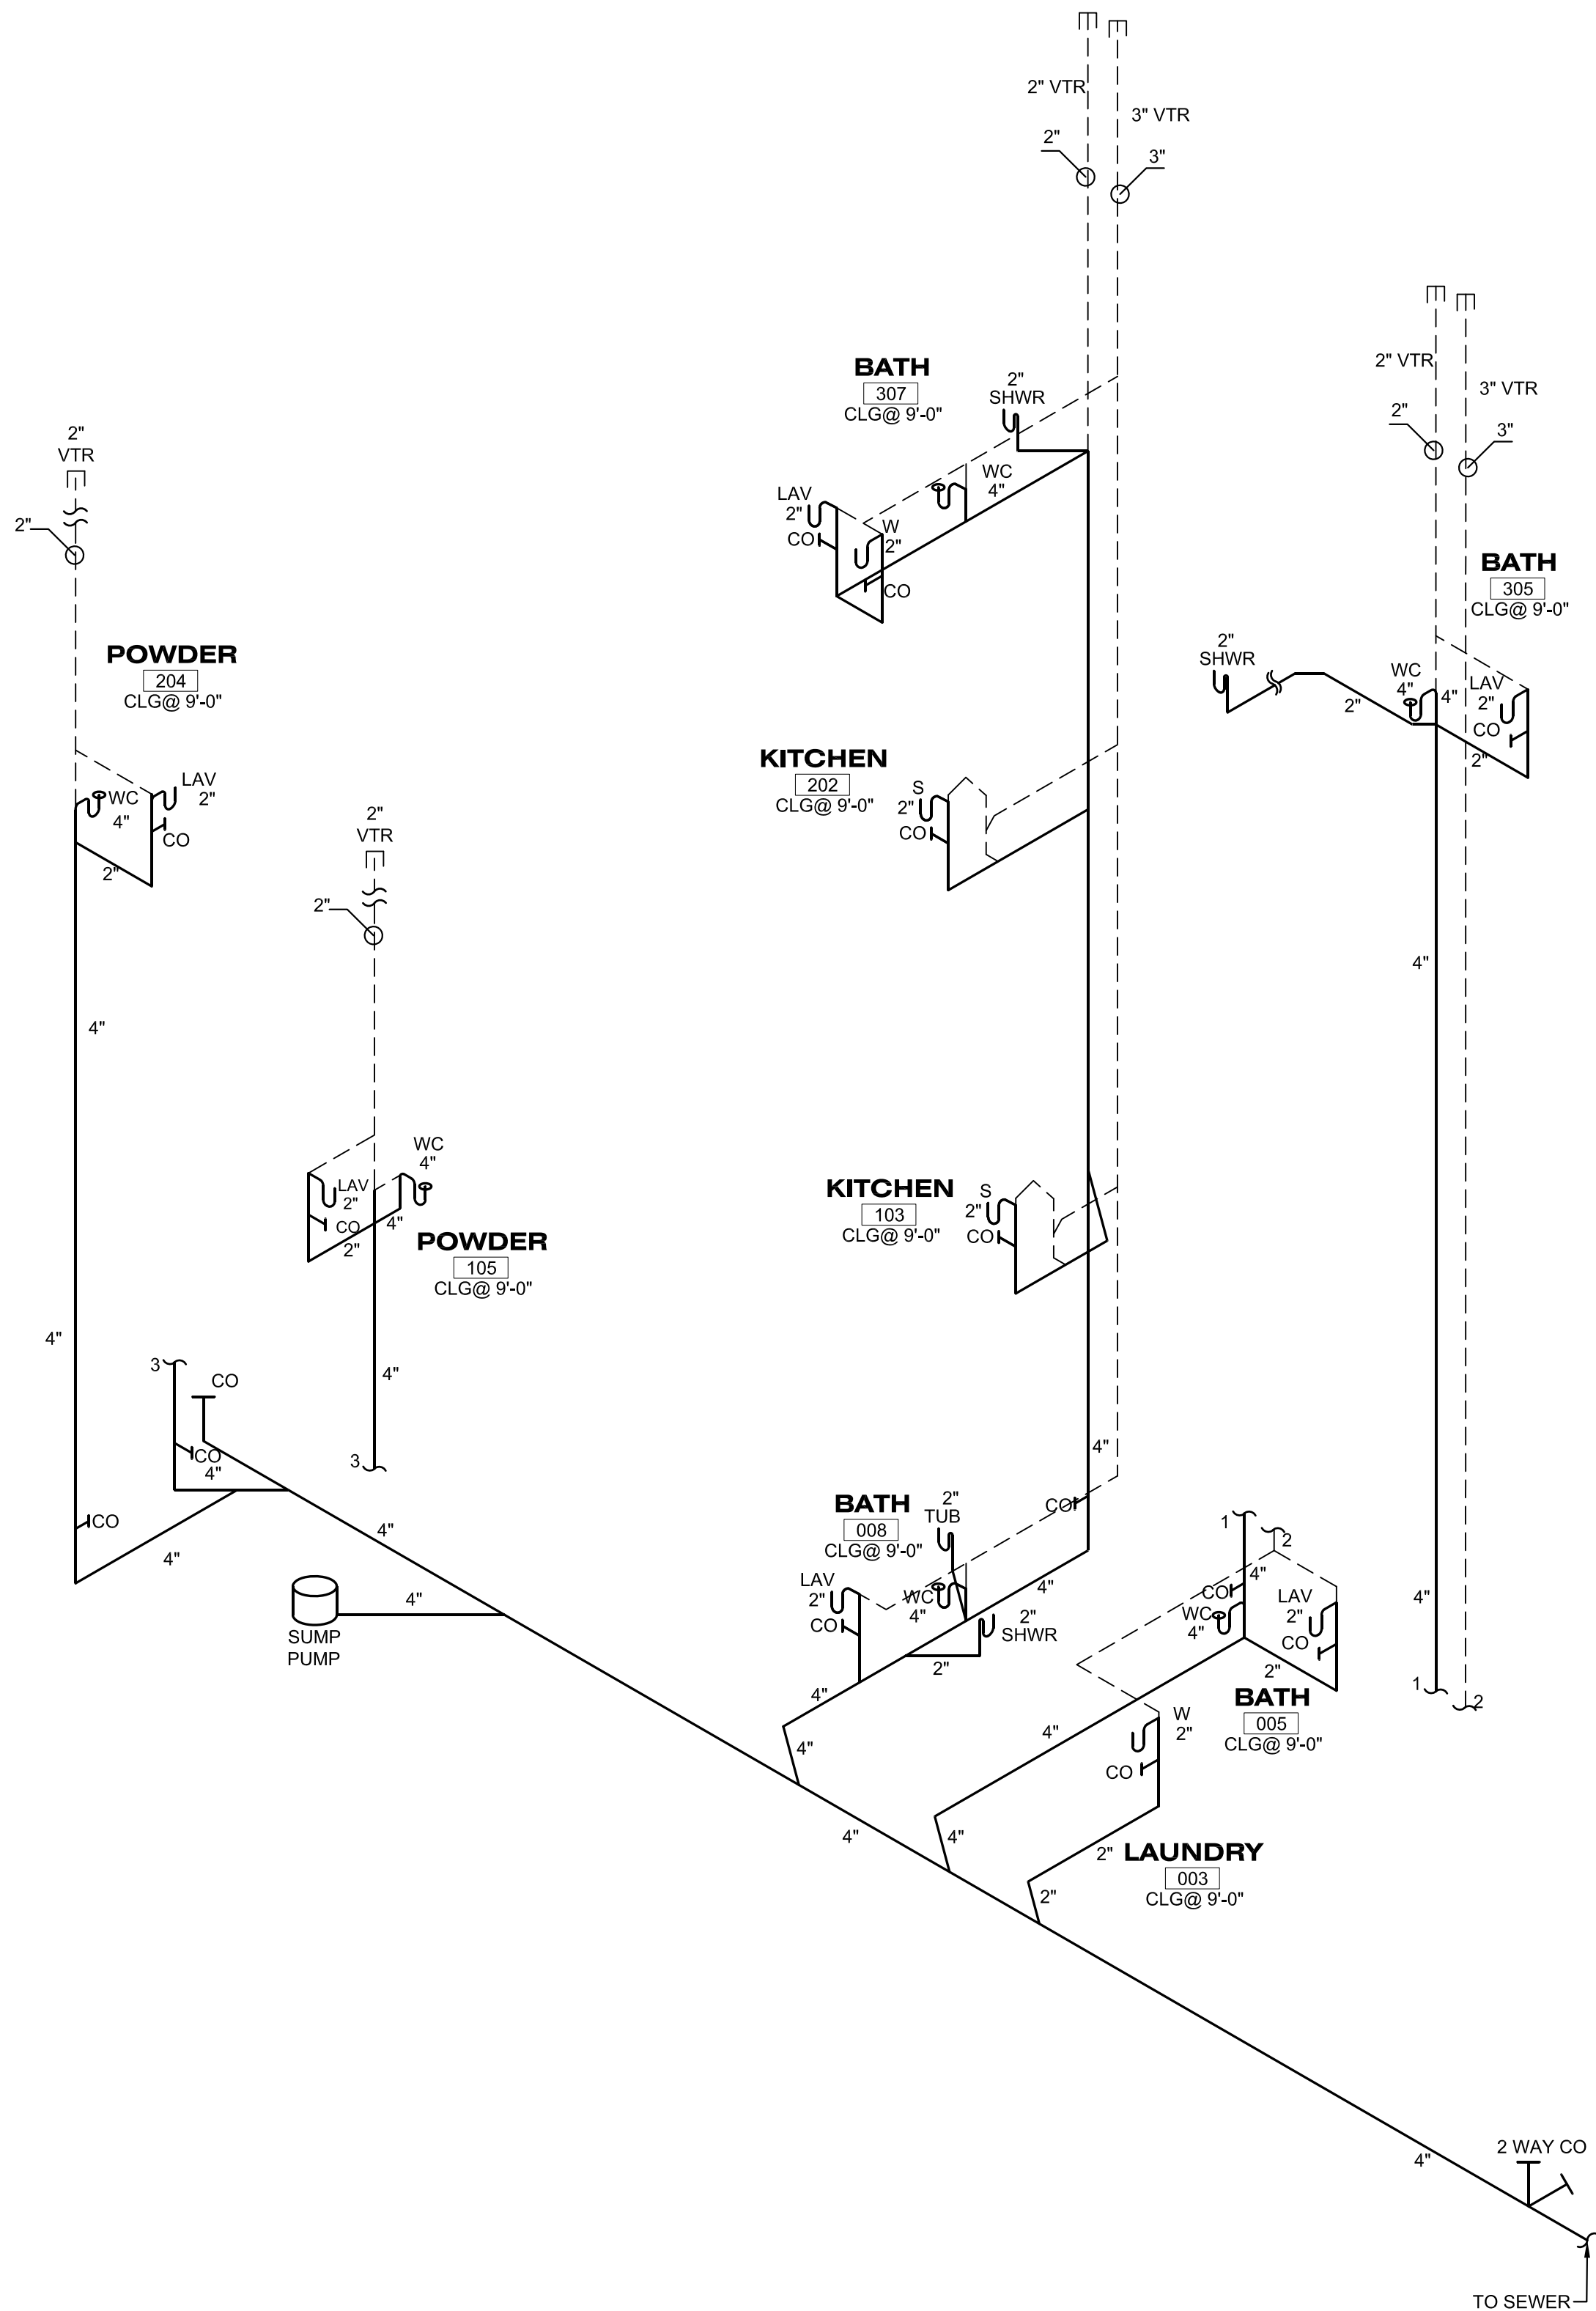

VENT & WASTE ISOMETRICS

SCALE: 1/4" = 1'-0"

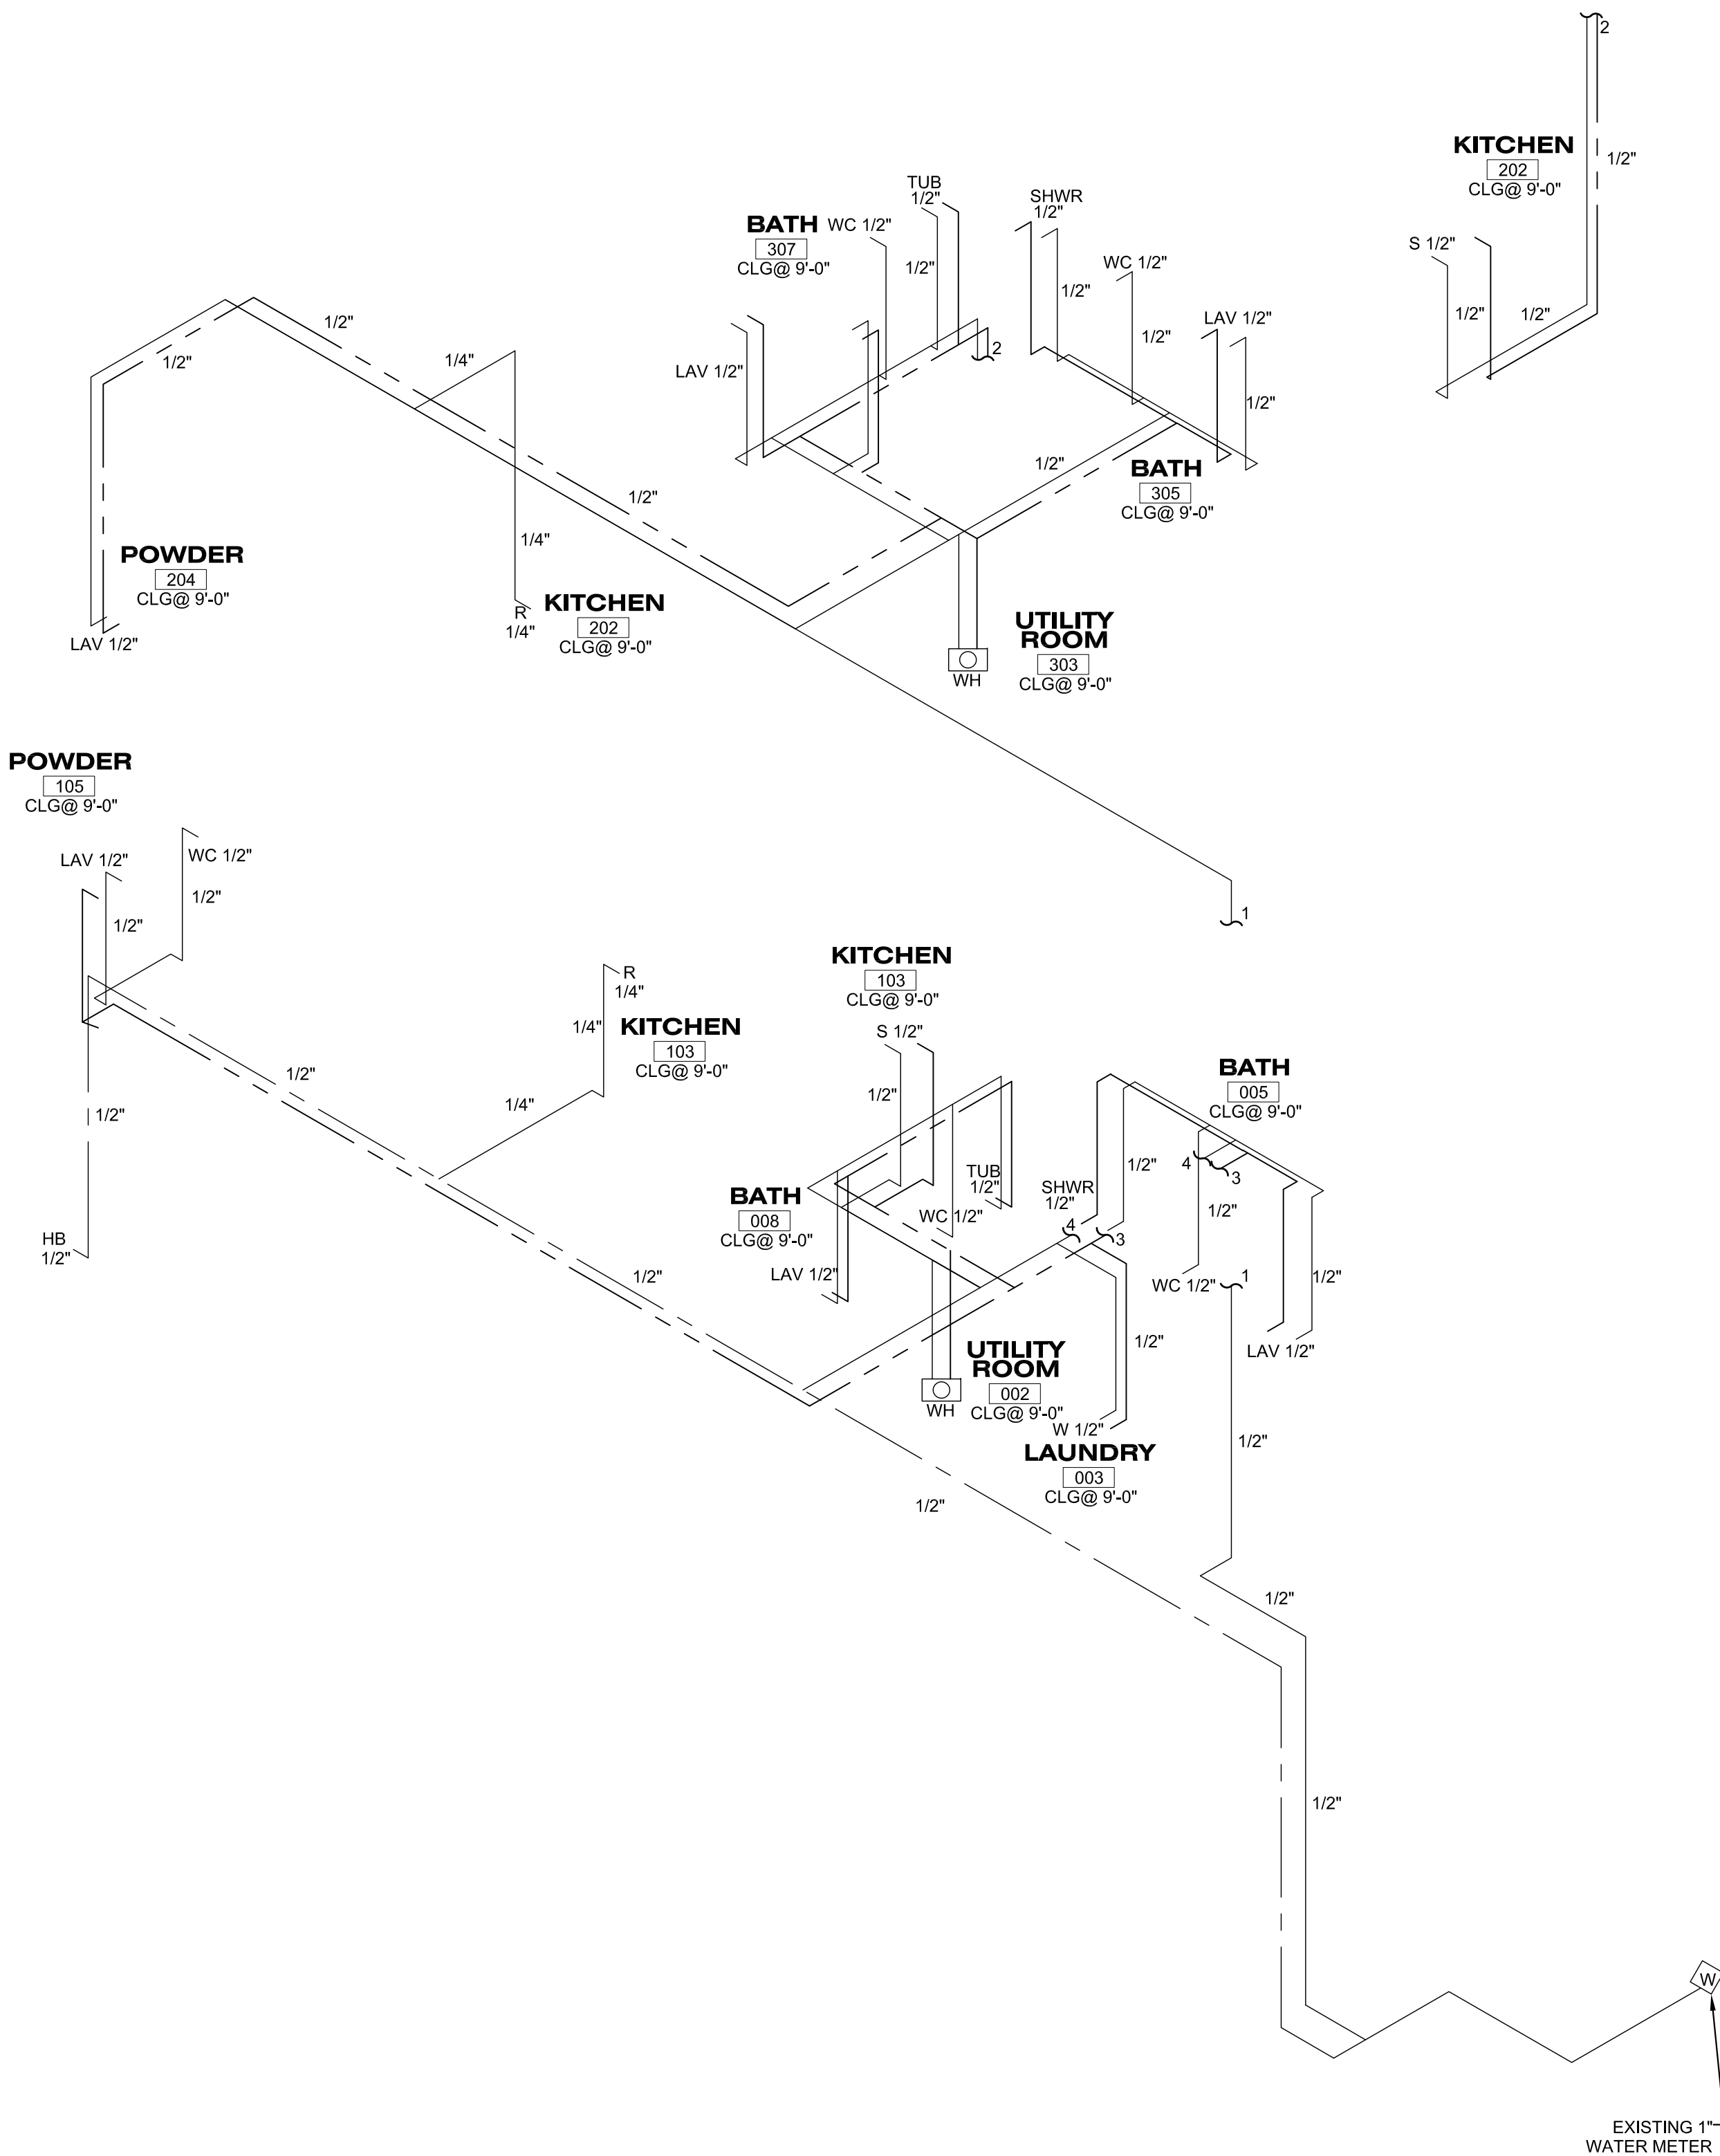

WATER SUPPLY ISOMETRICS

SCALE: 1/4" = 1'-0"

LEGEND

- COLD WATER
- HOT WATER
- WASTE LINE

Project:

WASHINGTON DC
TOWNHOUSE

Seal:

Revision:

No.	Date	Description
-----	------	-------------

Issue:

Date	Description
------	-------------


Project Number:

Title:


WATER SUPPLY AND
VENT. & WASTE
ISOMETRICS

Sheet:


P101

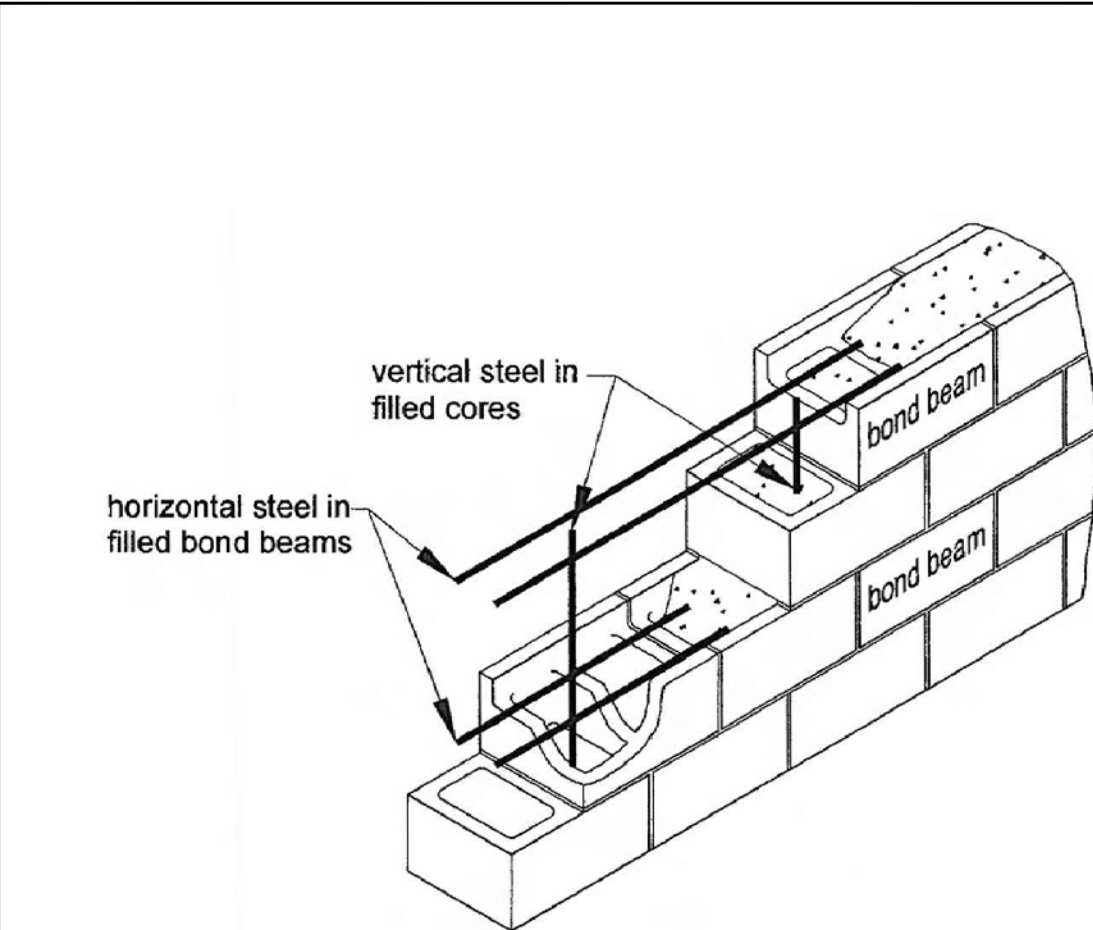


8 TYPICAL WALL REINFORCEMENT DETAIL
SCALE: N.T.S.

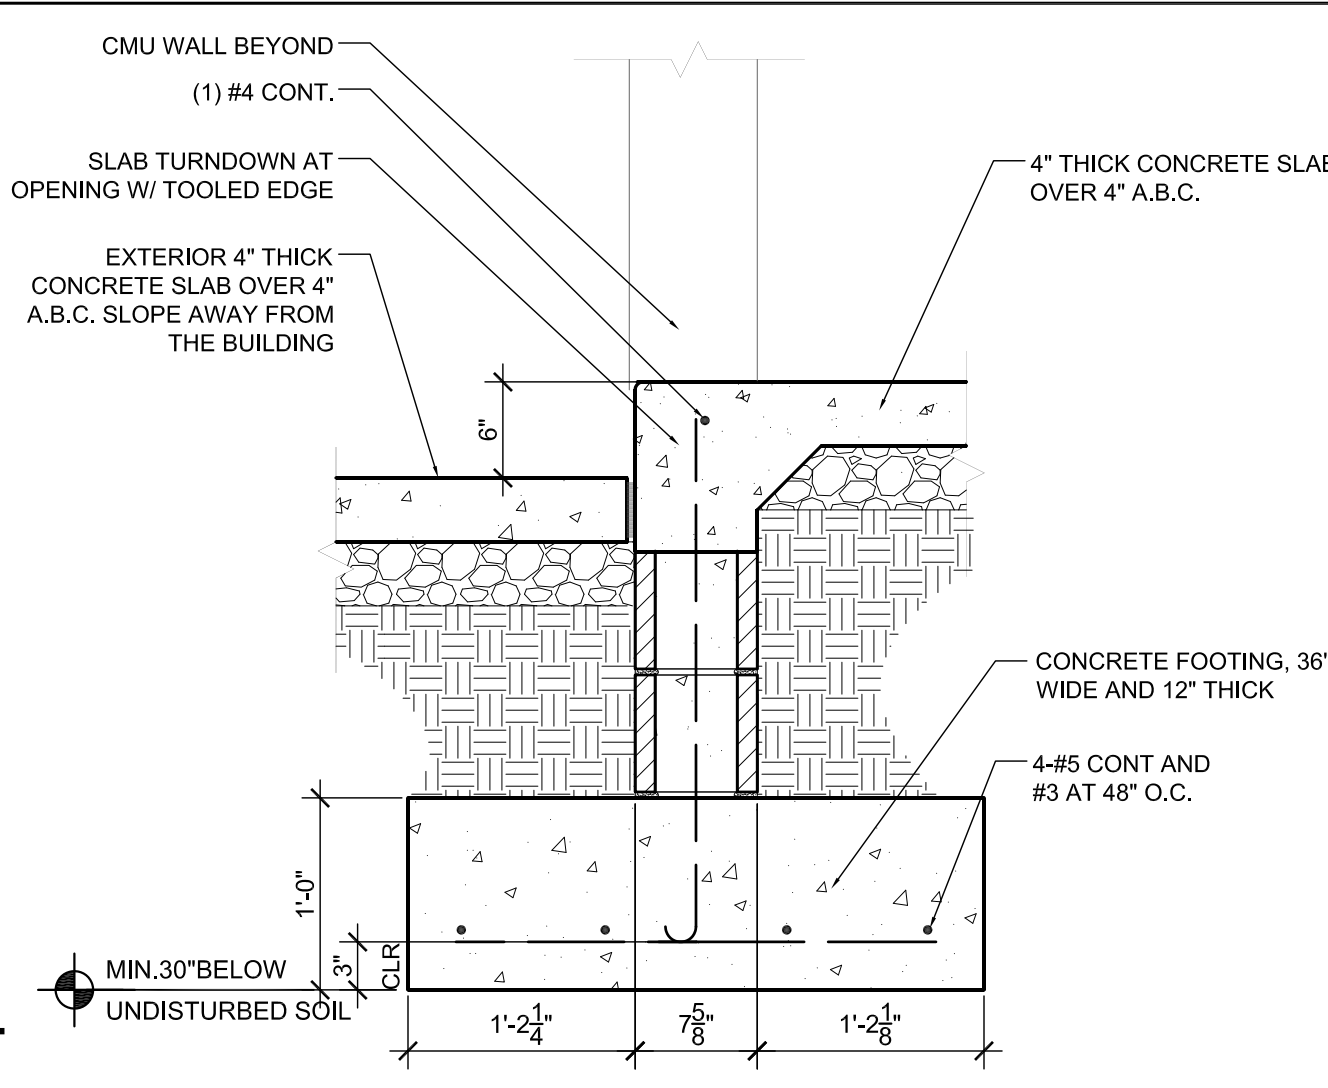


4 EXTERIOR MASONRY WALL FOOTING AT OPENING
SCALE: 1"=1'-0"

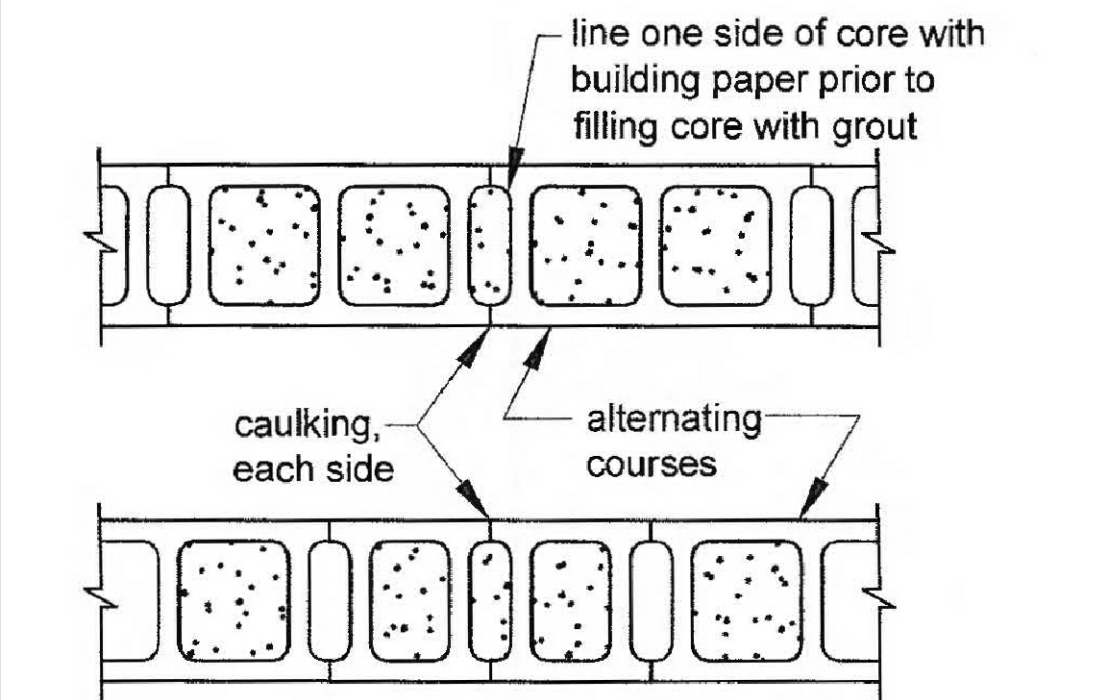


9 MASONRY CONTROL JOINT DETAIL
SCALE: N.T.S.

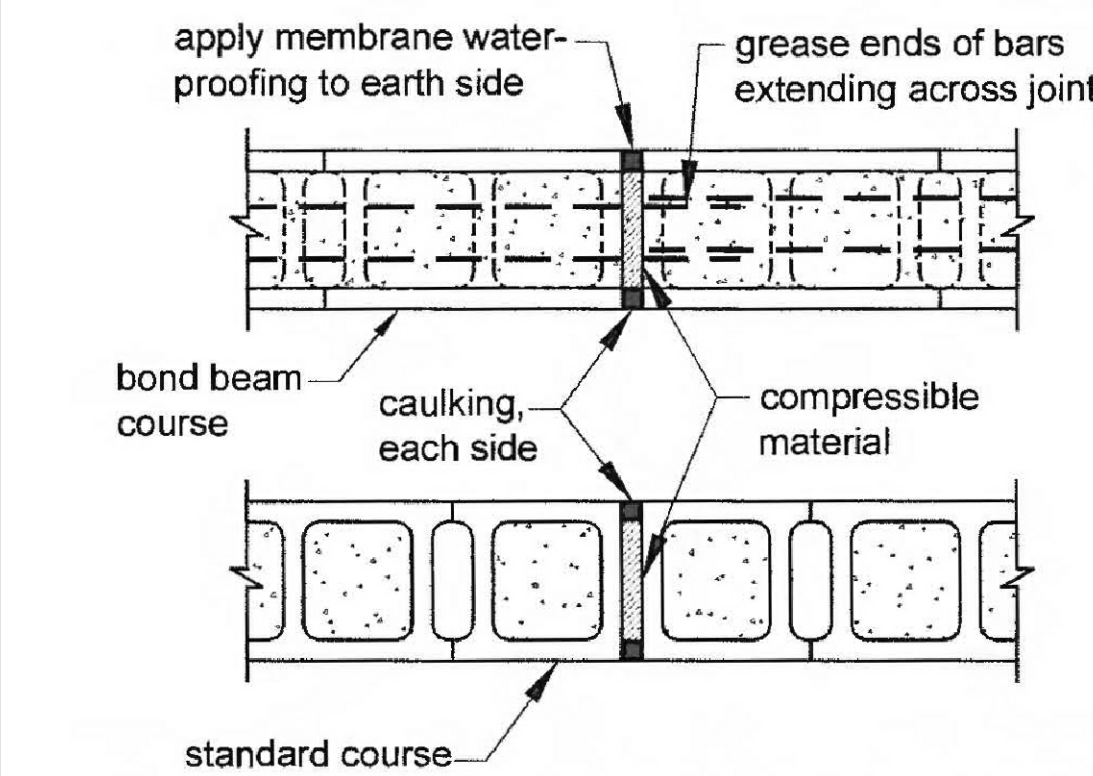


10 MASONRY EXPANSION JOINT DETAIL
SCALE: N.T.S.

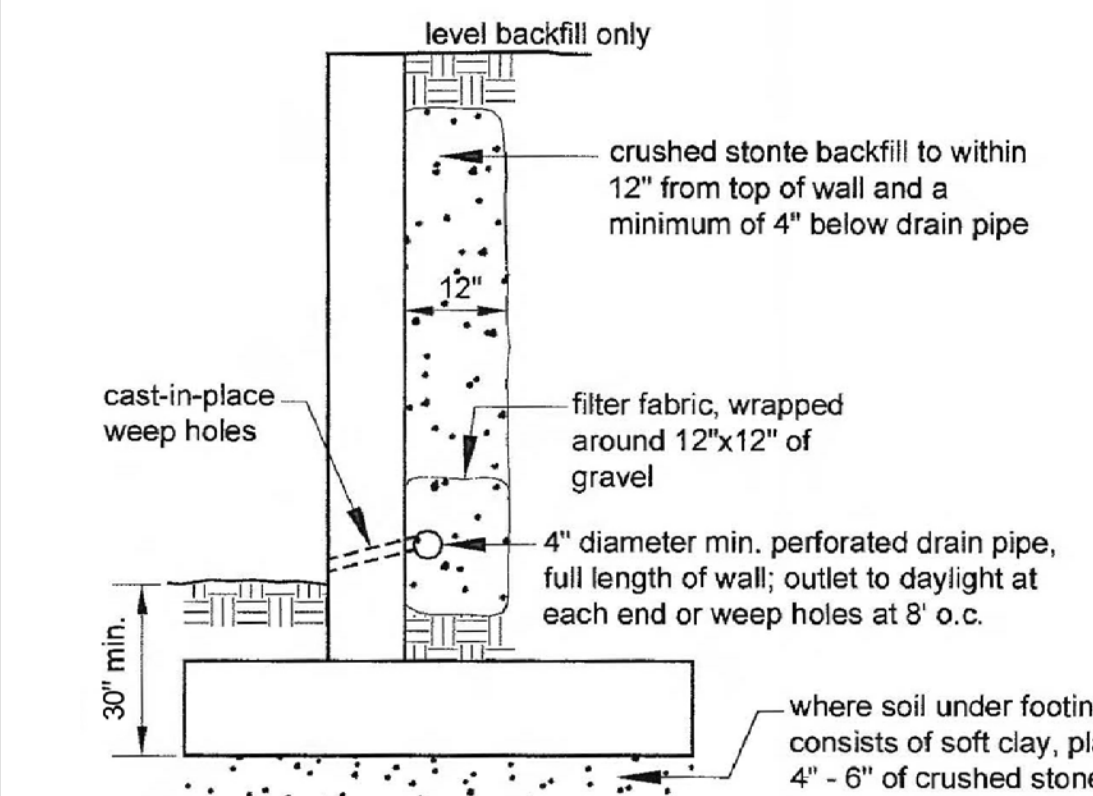


11 MASONRY, CONCRETE WALL BACKFILL AND DRAINAGE
SCALE: N.T.S.

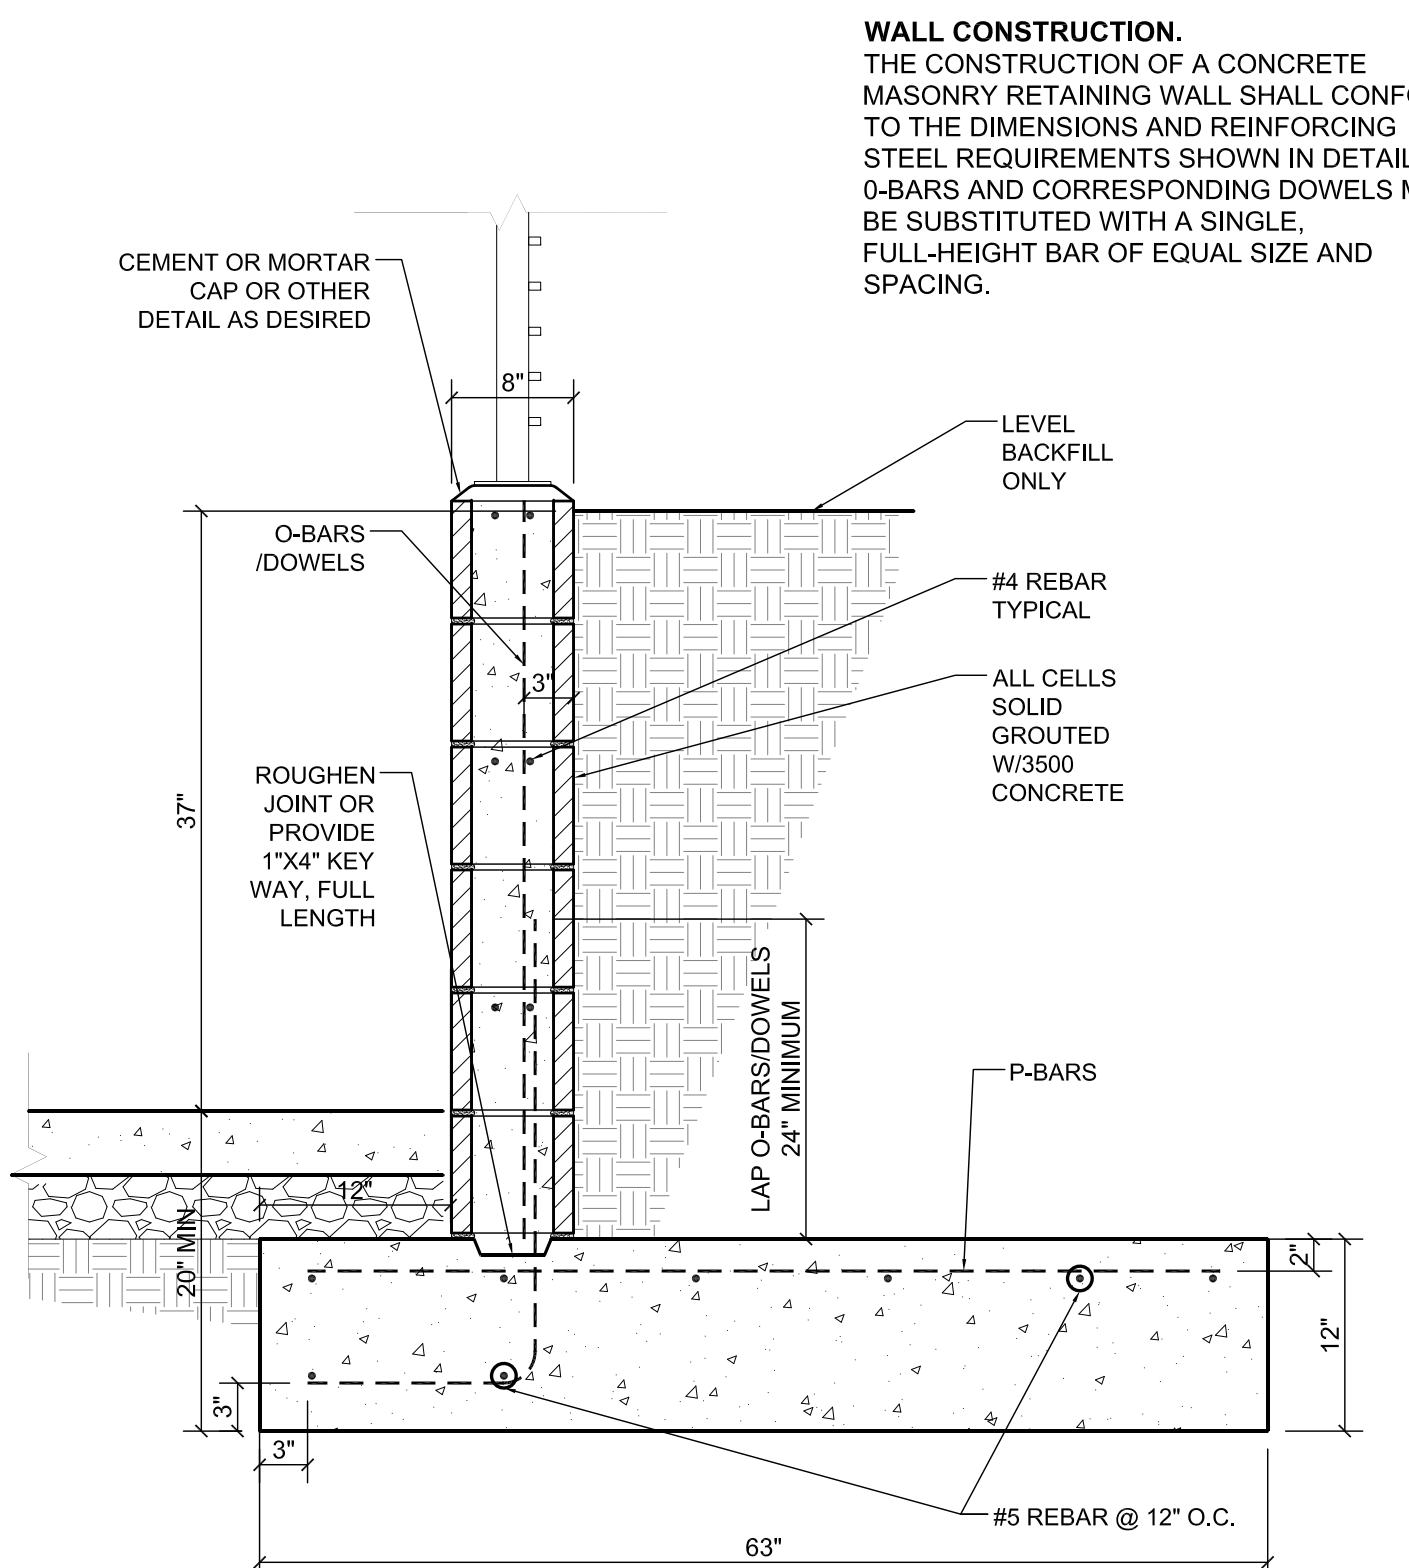


7 MASONRY WALL SECTION
SCALE: 1"=1'-0"

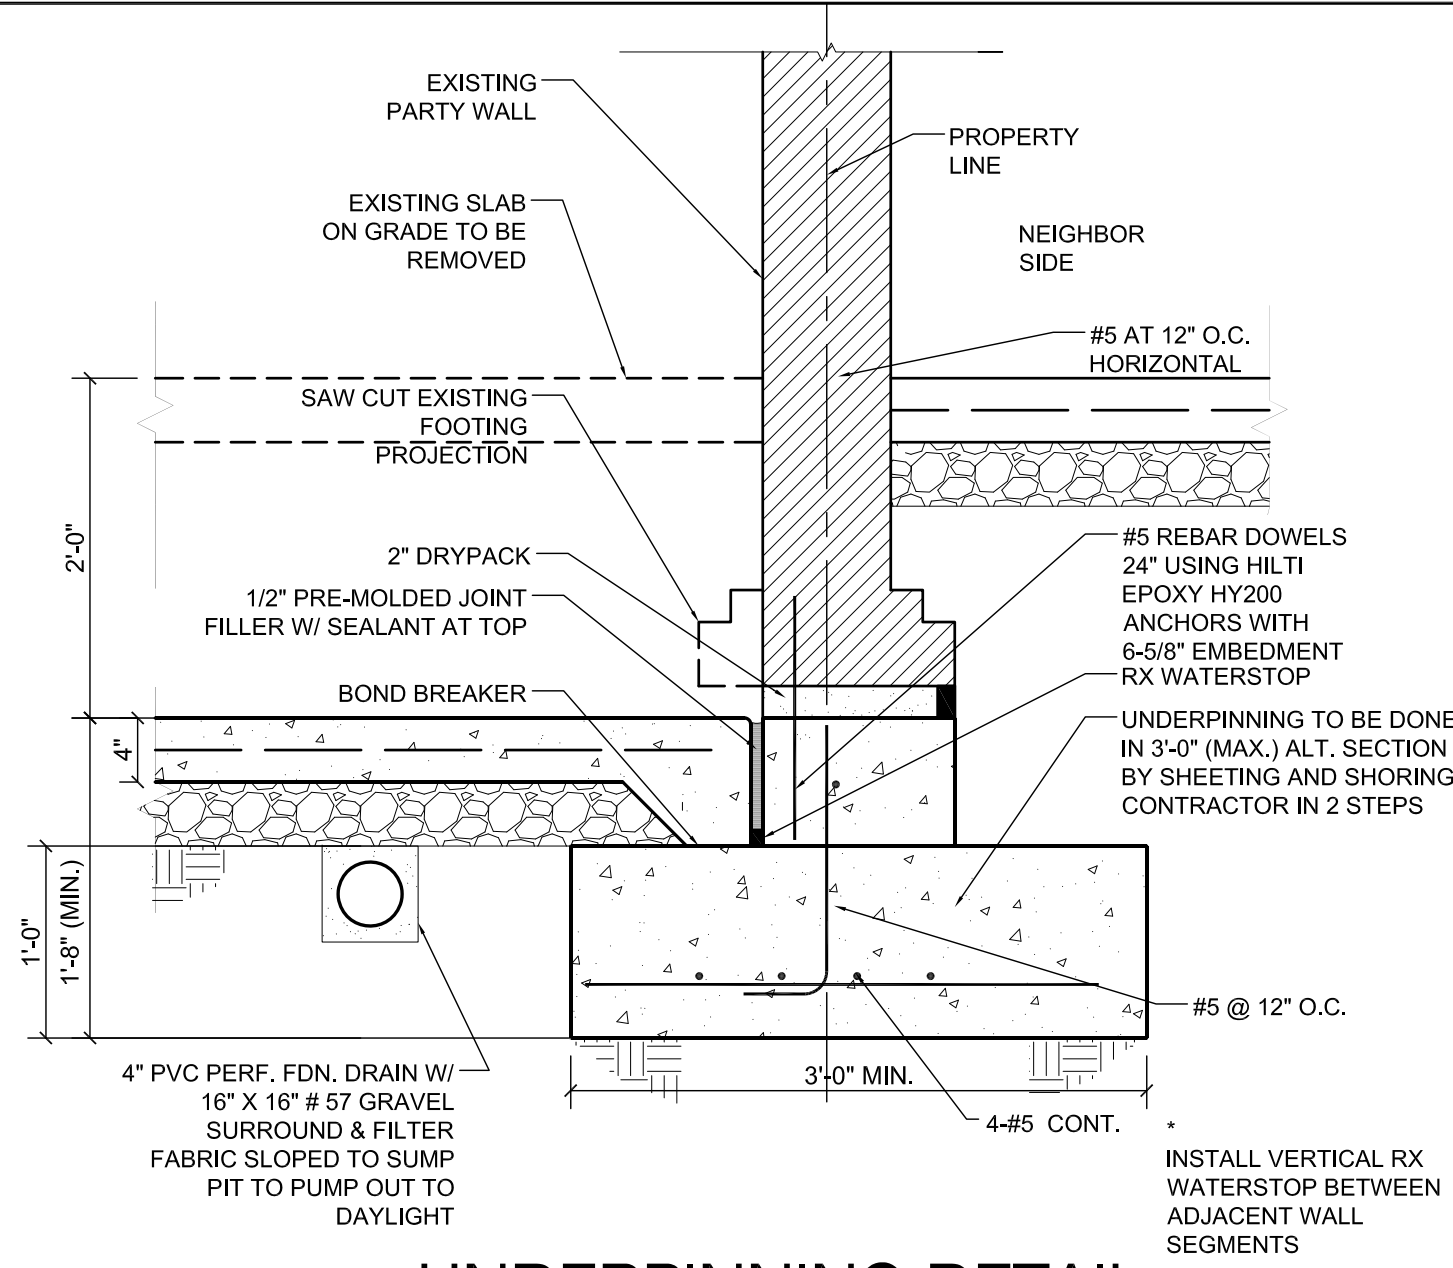

1 UNDERPINNING DETAIL
SCALE: 1"=1'-0"

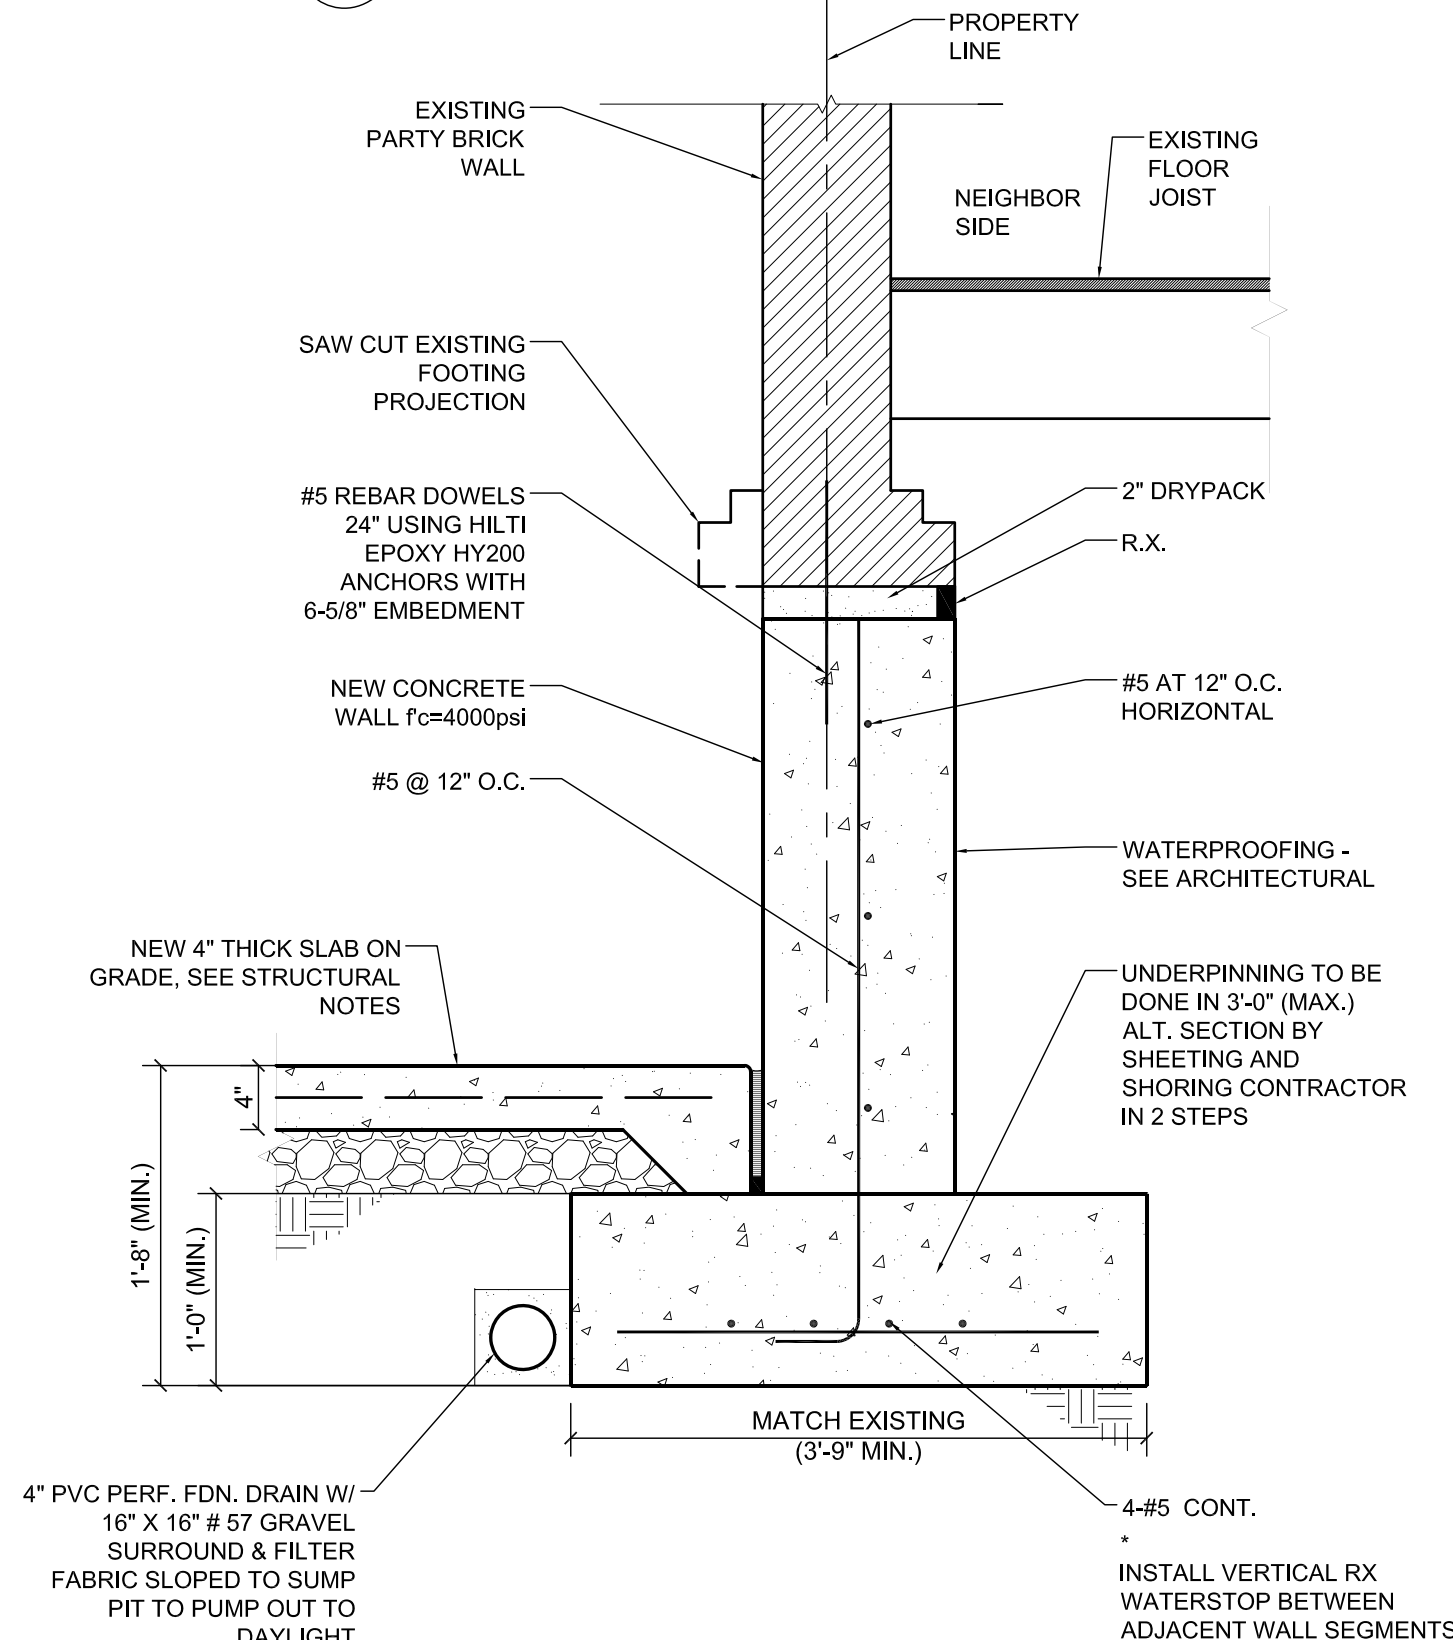

2 UNDERPINNING DETAIL
SCALE: 1"=1'-0"

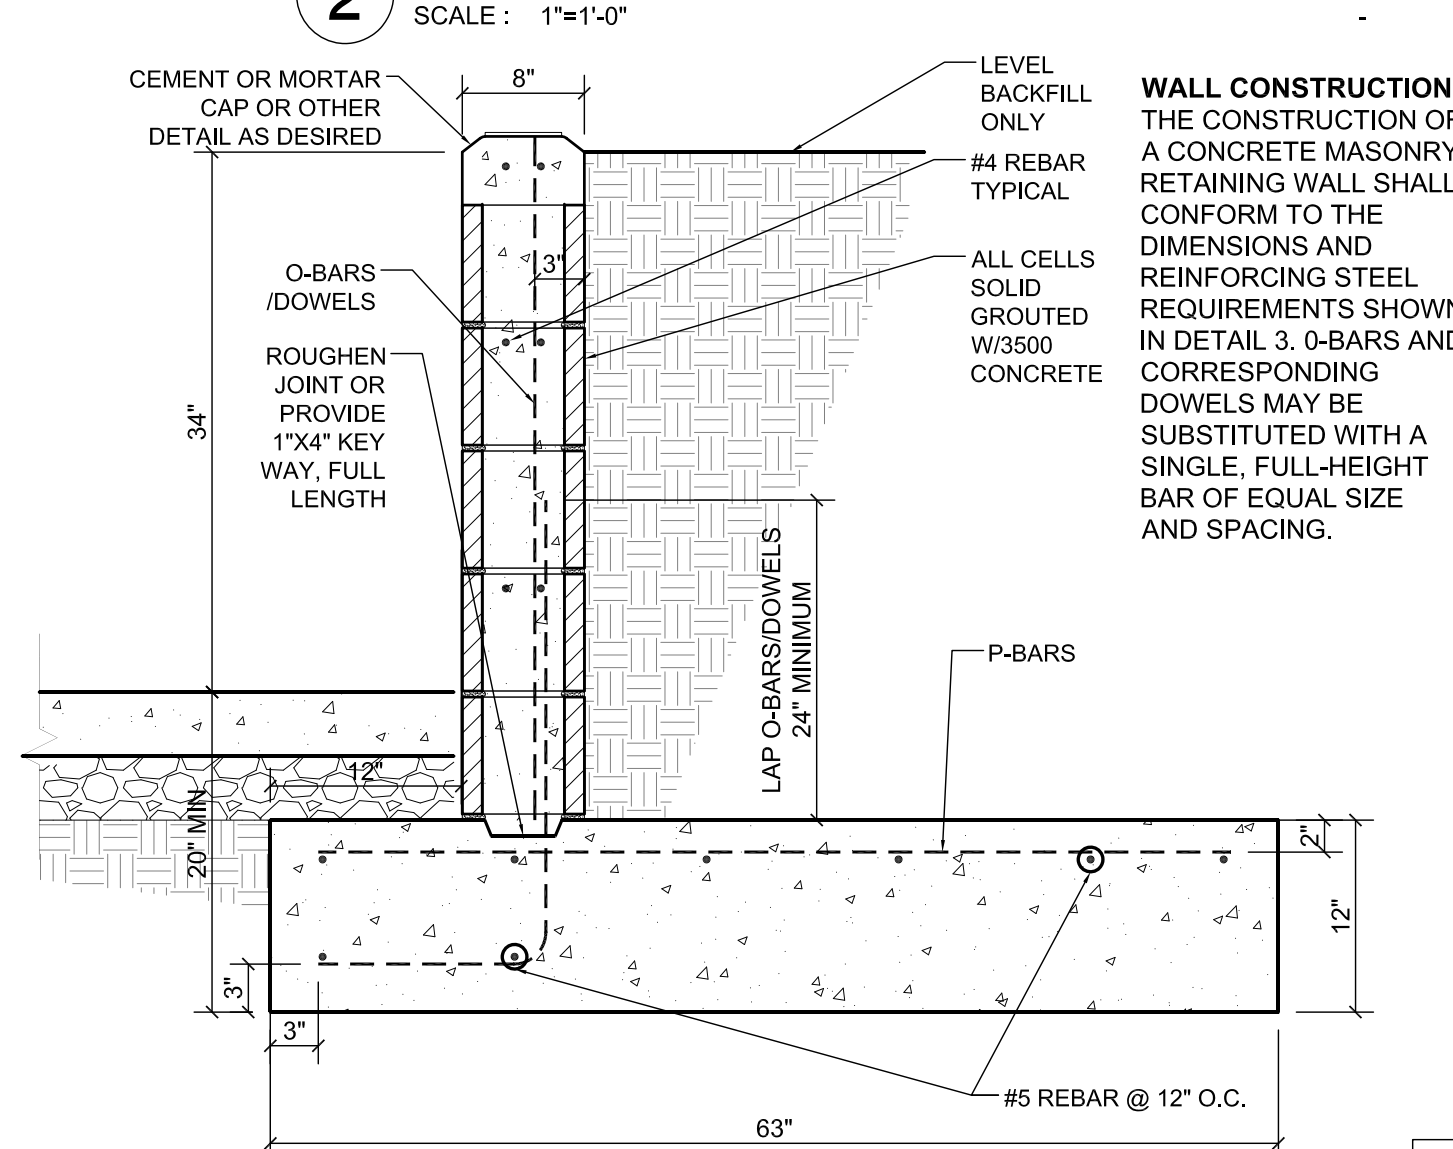


3 MASONRY WALL SECTION
SCALE: 1"=1'-0"

CMU WALL SCHEDULE			FOOTING SCHEDULE			
CMU1	8" THICK CMU WALL	#5 VERTICAL REBAR AT 24" O.C. SOLID GROUTED	MARK	FOOTING SIZE	FOOTING THICKNESS (IN)	REINFORCING (3" CLR BOTTOM)
CMU2	8" THICK CMU WALL	#5 VERTICAL REBAR AT 24" O.C. SOLID GROUTED. NOT GROUTED CELLS FILLED WITH VERMICULITE INSULATION.	WF1	3'-0"	12	4-#5 CONT AND #3 AT 48" O.C.
			F1	2'-6"	12	4-#5 E.W.

KEYNOTES

1. DEPRESS SLAB AT OPENING
2. 4" THICK CONCRETE SLAB OVER 4" A.B.C.
3. NEW 8" REINF. CMU RETAINING WALL
4. EXISTING RETAINING WALL
5. PLUMBING FIXTURES
6. UNDERPINNING, REFER TO GENERAL NOTES
7. EXISTING MASONRY SHARED PARTY WALL
8. FLOOR DRAIN
9. EXISTING NEIGHBOR BUILDING
10. NEW BRICK WALL

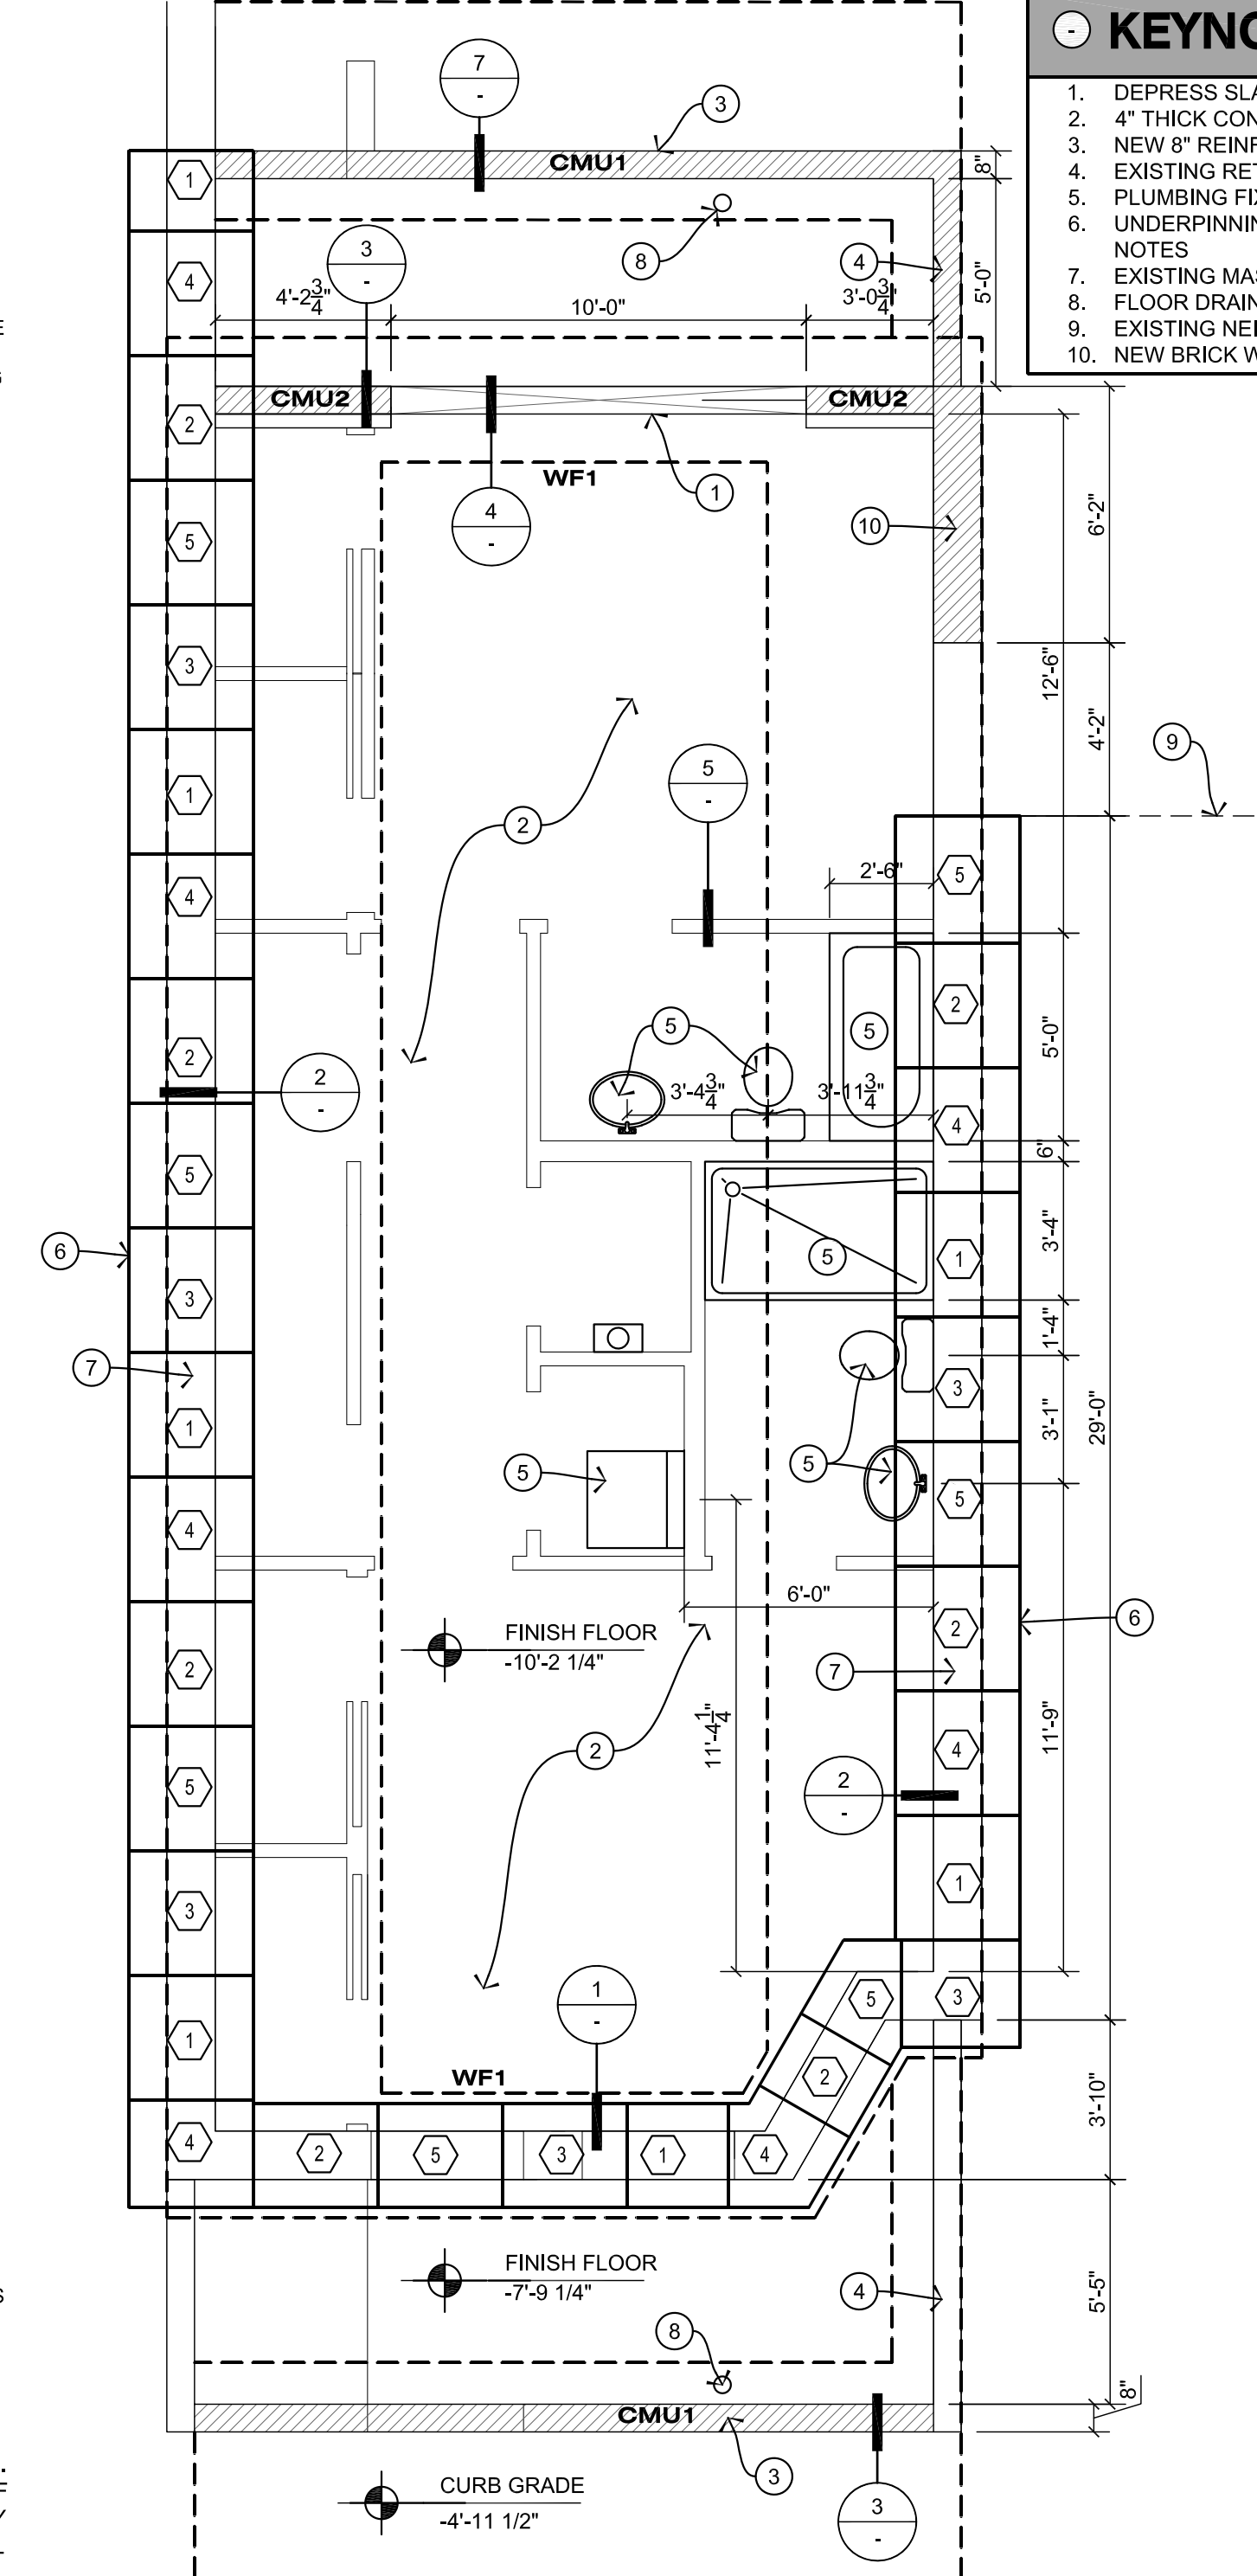

FOUNDATION & UNDERPINNING PLAN

SCALE: 1/4"=1'-0"

FOUNDATIONS AND UNDERPINNING GENERAL NOTES

1. SLAB ON GRADE TO BE 4" THICK CONCRETE OVER 4" OF WASHED GRAVEL REINF. W/ 6X6-10X10 W.W.M. SLAB ON GRADE & SHALL BE LAID ON 6 MIL. POLYETHYLENE OVER TERMITES TREATED SOILS.
2. G.C. TO VERIFY ALL EXISTING CONDITIONS IN THE FIELD AND NOTIFY ENGINEER OF ANY DISCREPANCY BEFORE BEGINNING WORK.
3. TEMPORARY SHORING AND UNDERPINNING - G.C. SHALL SUBMIT SHOP DRAWINGS SIGNED AND SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE PROJECT JURISDICTION FOR REVIEW AND APPROVAL.
4. ALL STAIRS SHALL BE "DESIGN BUILD" BY SUPPLIER. G.C. SHALL SUBMIT SHOP DRAWINGS SIGNED AND SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE PROJECT JURISDICTION FOR REVIEW AND COMMENTS.
5. FOR ALL DIMENSIONS AND ELEVATIONS SEE ARCHITECTURAL DRAWINGS.
6. DESIGNATE UNDERPINNING NUMBER ONE, PROCEED WITH ALL NUMBER ONES FIRST, AND THEN ALL NUMBER THREE, AND THEN ALL NUMBER FIVE, AND THEN ALL NUMBER TWO. SEE STARTING POINT AND DIRECTION OF UNDERPINNING ON THE PLAN.
7. SOIL BEARING:
 - a. SOIL BEARING CAPACITY IS 2500 PSF
 - b. USE DRYPACK THAT CAN REACH 75% OF OF SPECIFIED DESIGN (5000 PSI) IN 72 HOURS MINIMUM.
8. UNDERPINNING WORK SHALL BE PERFORMED BY A CONTRACTOR LICENSED, INSURED AND BONDED IN WASHINGTON DC AND HAVE A MINIMUM OF 5 YEARS OF CONTINUOUS EXPERIENCE IN UNDERPINNING.

"STRUCTURAL PLANS CERTIFIED AS PROVIDED IN SECTION 106.1.4.1 OF THE D.C. CONSTRUCTION CODE" [DCMR 106.1.4.1]

Project:

WASHINGTON DC TOWNHOUSE

Scale:

Revision:

No. Date Description

Issue:

Date Description

Project Number:


Title:

FOUNDATION & UNDERPINNING PLAN & DETAILS

Sheet:


S100

REVIEW SET BID SET PERMIT SET CONSTRUCTION SET

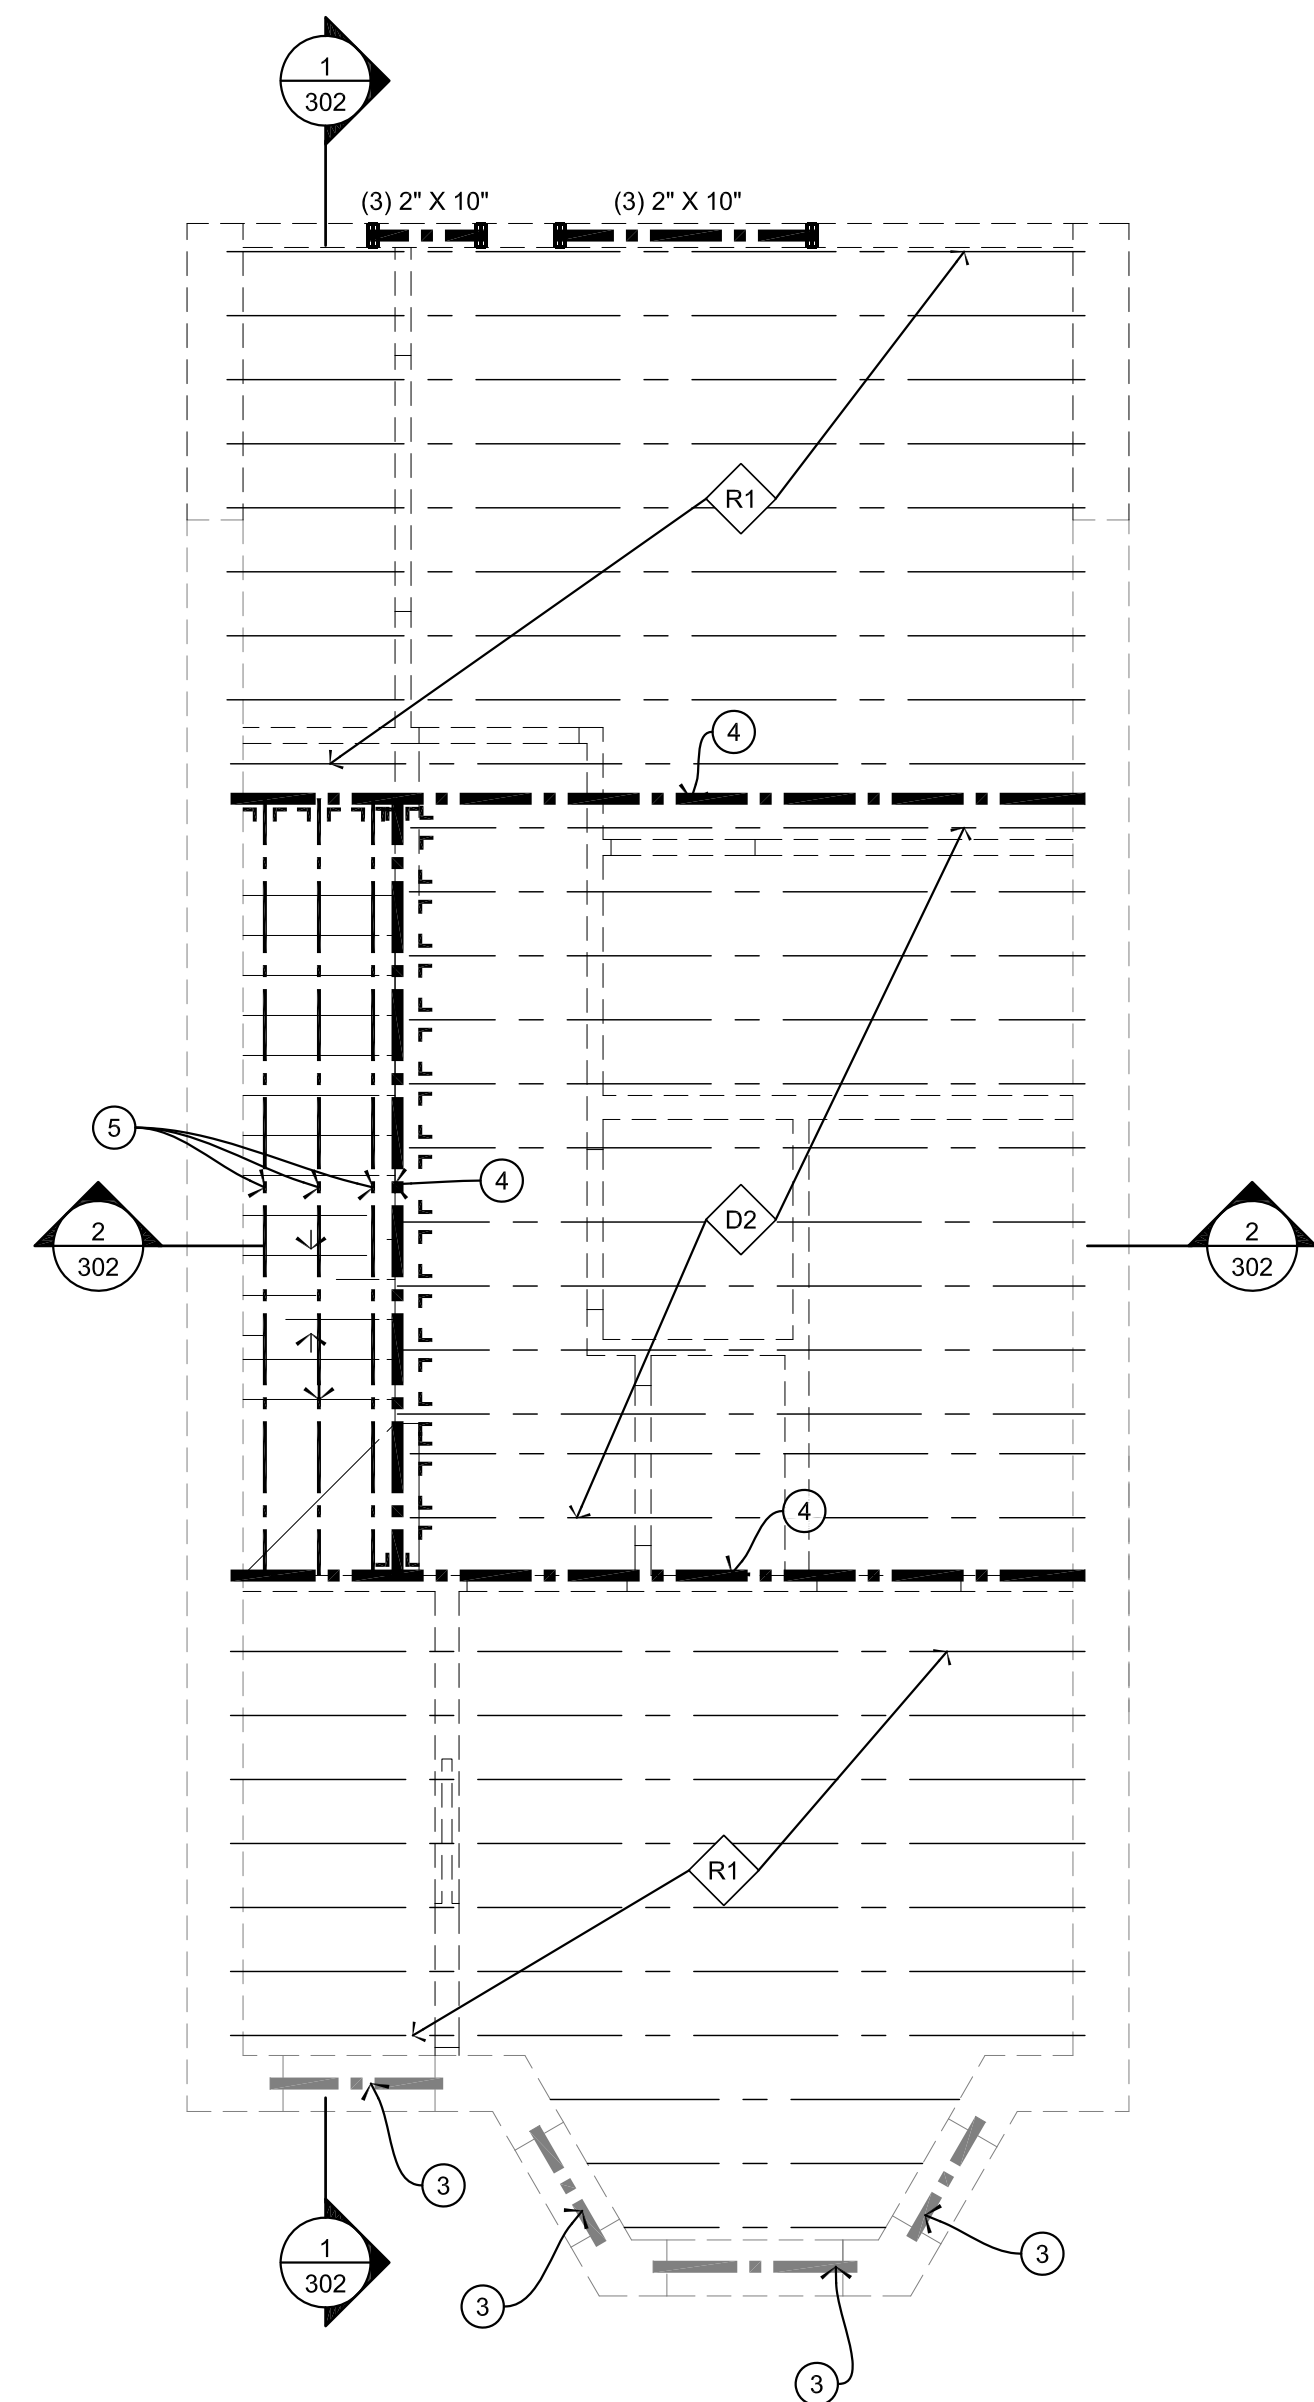


ROOF DECK FRAMING PLAN

SCALE: 1/4" = 1'-0"

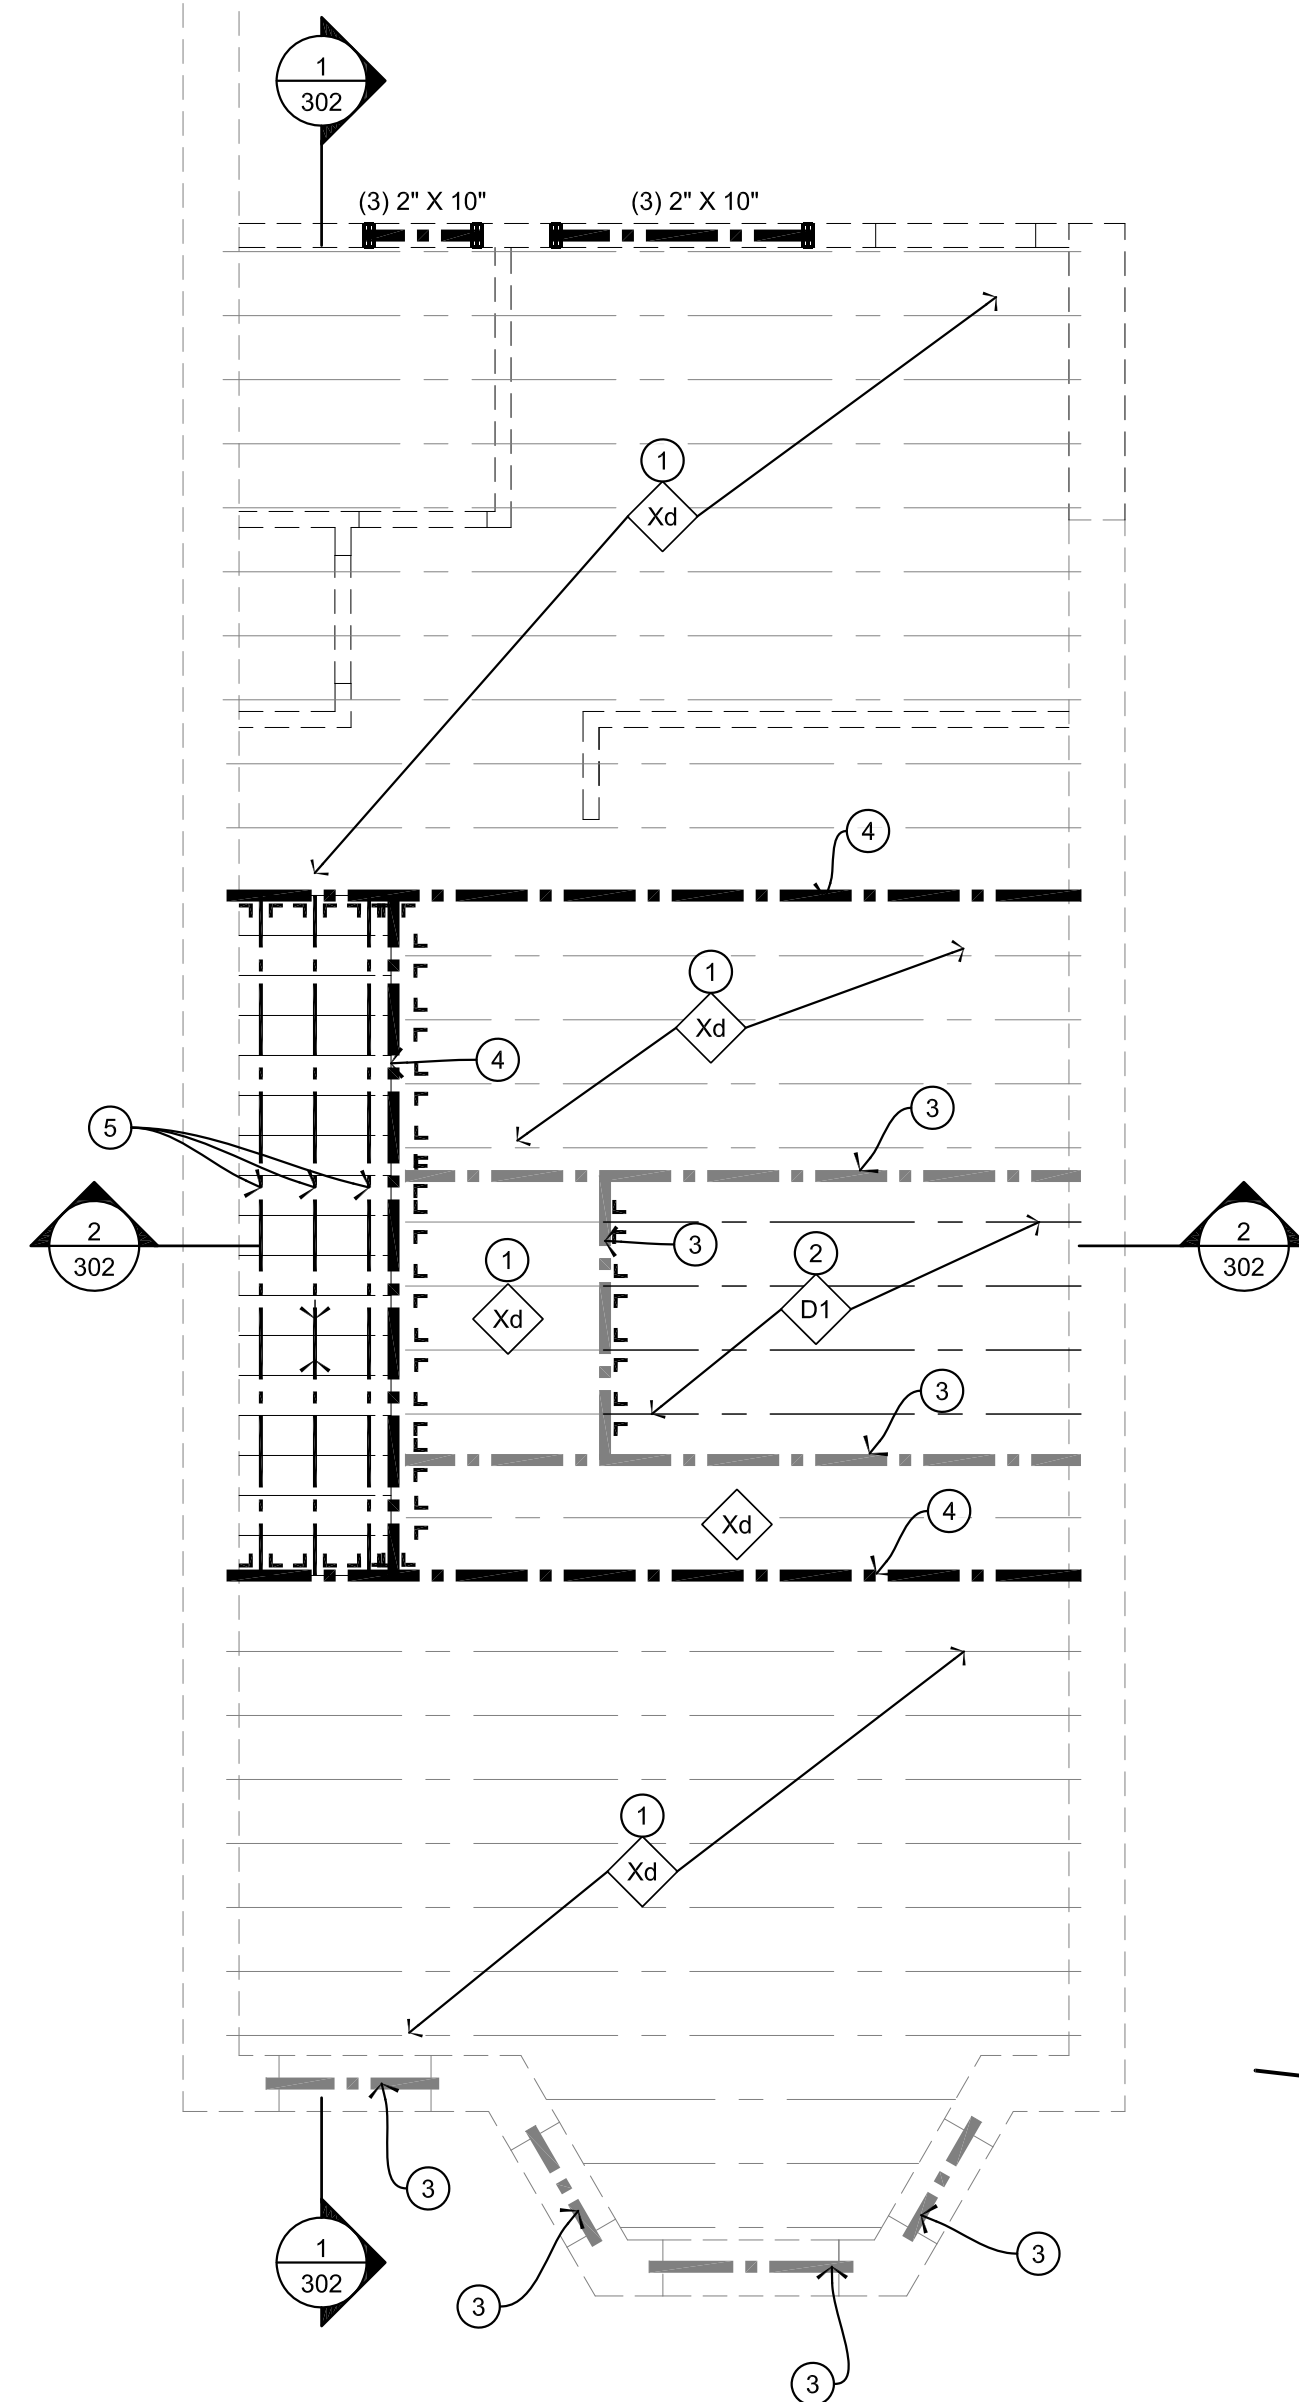


3RD FLOOR FRAMING PLAN

SCALE: 1/4" = 1'-0"

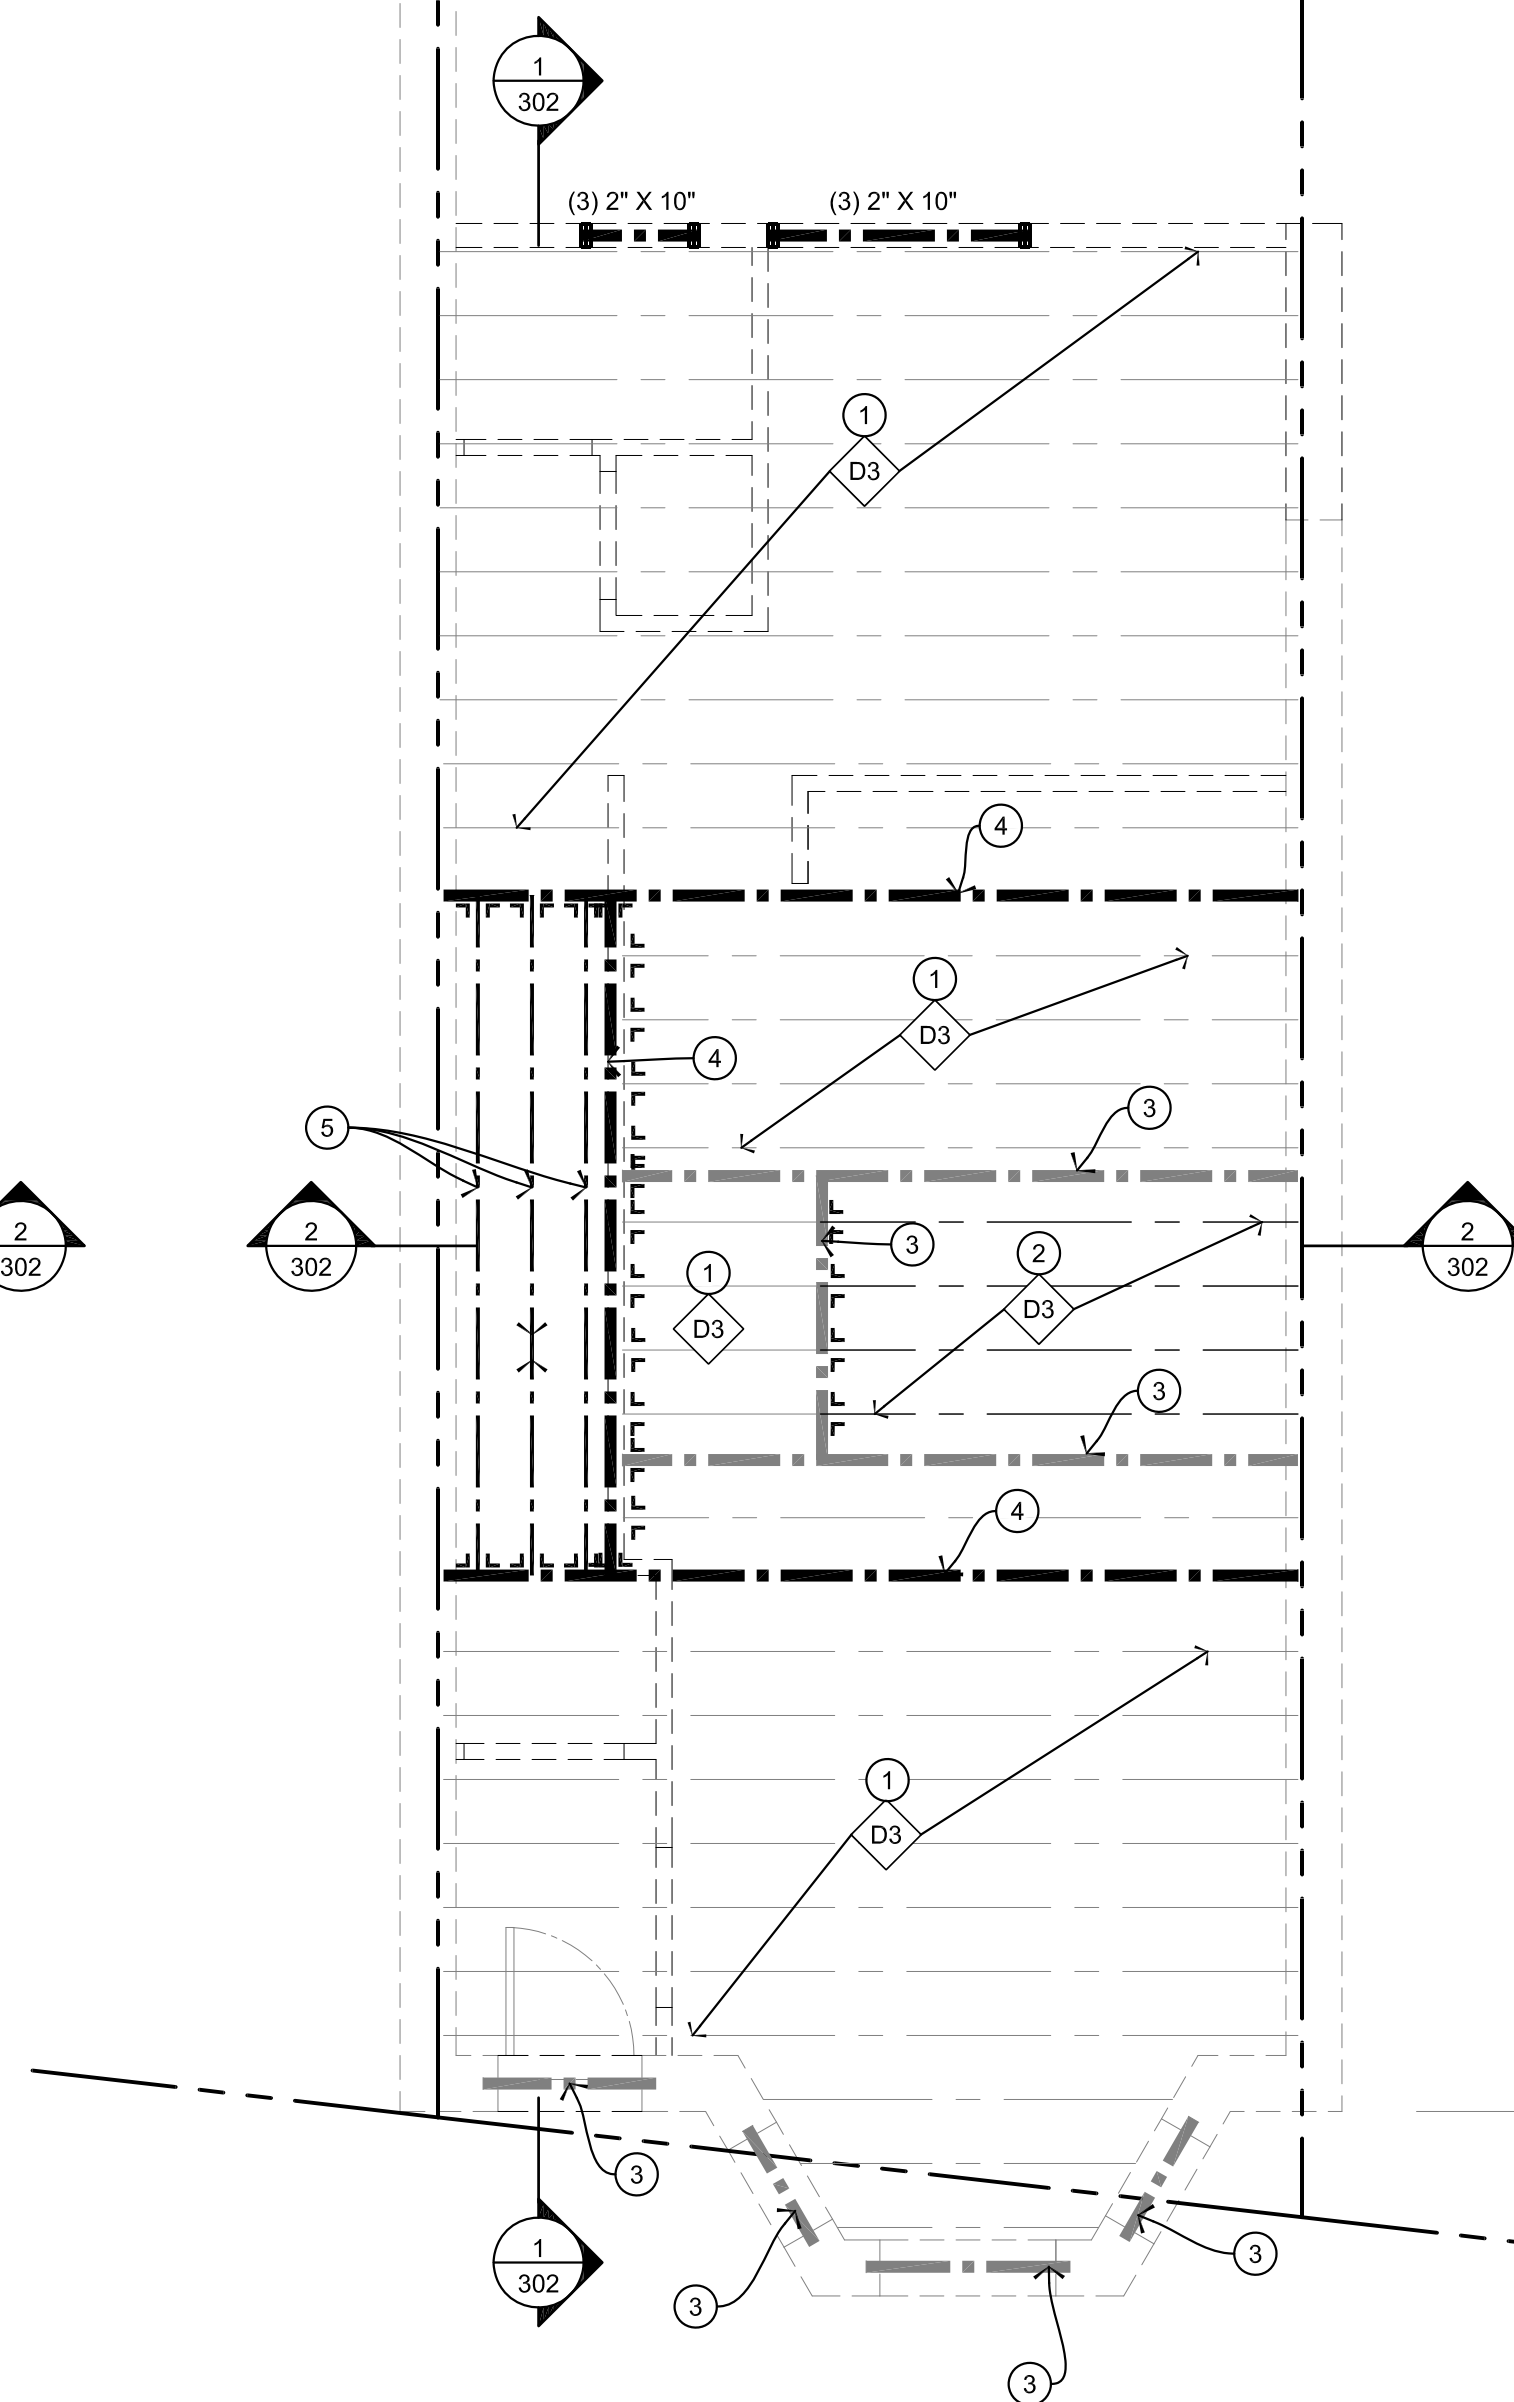


2ND FLOOR FRAMING PLAN

SCALE: 1/4" = 1'-0"

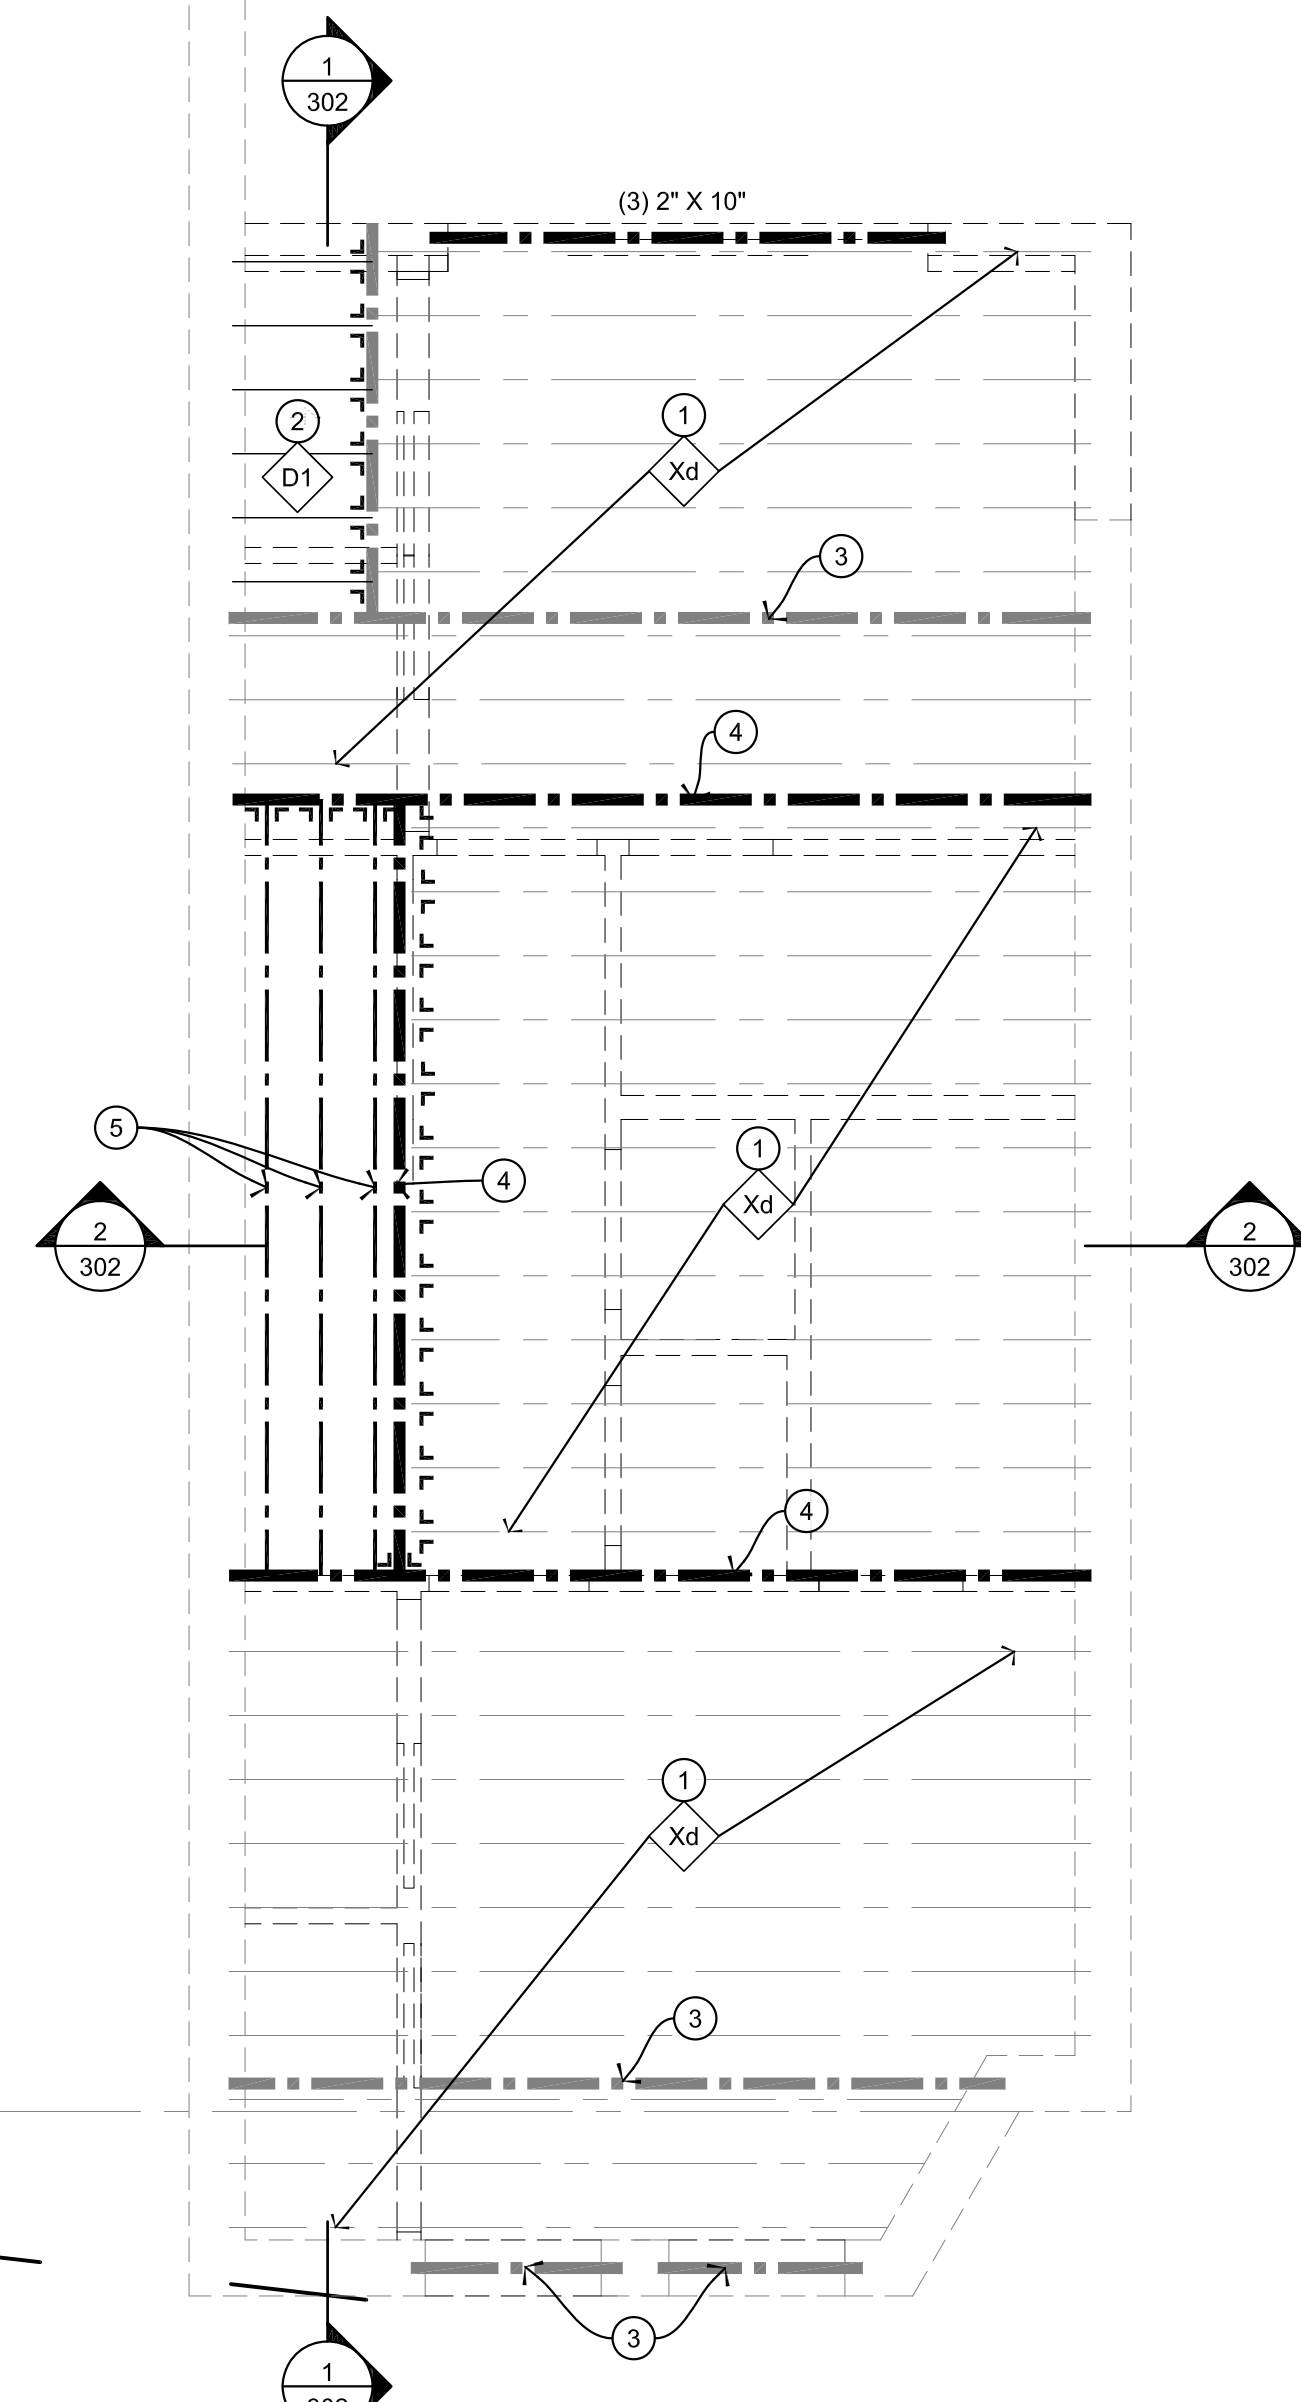

1ST FLOOR FRAMING PLAN

SCALE: 1/4" = 1'-0"

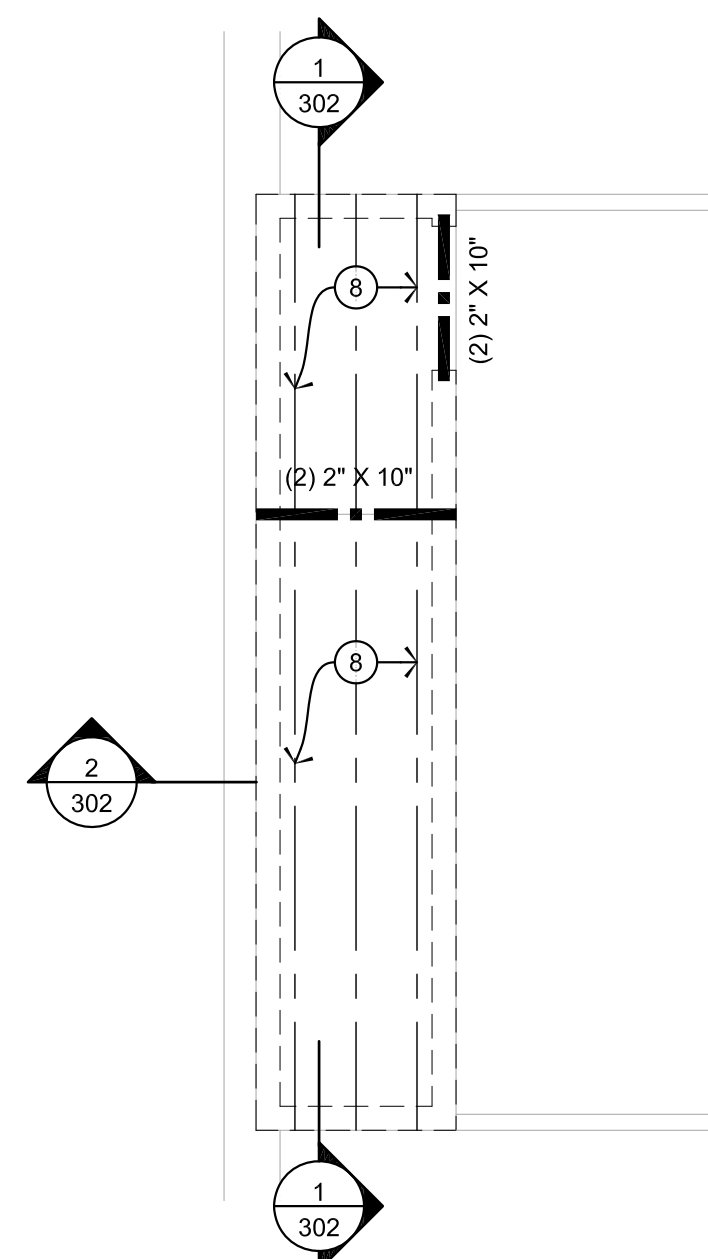

ROOF FRAMING PLAN

SCALE: 1/4" = 1'-0"

LEGEND	CONSTRUCTION SYSTEMS	KEYNOTES
— EXISTING JOIST - - - NEW JOIST — EXISTING BEAM - - - NEW BEAM - - - HANGERS TO BE DESIGNED BY TRUSS MANUFACTURER	FOR CONSTRUCTION SYSTEMS DETAILS REFER TO SHEET A500 Xe EXISTING EXTERIOR WALL TO REMAIN. Xp EXISTING PARTY WALL TO REMAIN Xr EXISTING ROOF TO REMAIN. Xd EXISTING 2X JOISTS AT 16" O.C. W/ NEW 3/4" THICK PLYWOOD SHEATHING, REPAIR OR REPLACE AS NEEDED W1 NEW EXTERIOR WALLS, W/STUCCO FINISH TO MATCH EXISTING. 2 X 6 STUDS @ 16" O.C. AND 1/2" THICK GYPSUM BOARD ON INTERIOR SIDE. 6" THICK R-19 FIBERGLASS BATT INSULATION. W2 NEW TRIPLE BRICK WALL, W/STUCCO FINISH TO MATCH EXISTING. W3 8" THICK MASONRY WALL W/STUCCO FINISH. 5/8" THICK GYPSUM BOARD AND 2x FLAT FURRING ON INTERIOR SIDE P1 NEW INTERIOR WALLS 2 X 4 STUDS @ 24" O.C. WITH GYPSUM BOARD EACH SIDE, U.N.O. OPTIONAL ACOUSTICAL INSULATION. P2 NEW INTERIOR WALLS 2 X 6 STUDS @ 24" O.C. WITH FULL HEIGHT 1/2" THICK FIBER CEMENT GLASS MATT BOARD AND CERAMIC TILE AT 6'-0" A.F.F. MIN. AS OCCURS. 3" THICK BATT FIBERGLAS INSULATION IN PLUMBING WALLS. P3 NEW 1HR RATED INTERIOR WALLS 2 X 4 STUDS @ 24" O.C. WITH 5/8" SHEETROCK BRAND FIRECODE CORE GYP. PANE, EACH SIDE. REFER TO DETAIL. S1 NEW 4" THICK CONCRETE SLAB ON 4" A.B.C. ST1 NEW STAIRS D1 2X JOISTS AT 16" O.C., TO MATCH EXISTING W/ 3/4" THICK PLYWOOD SHEATHING AND 1/2" GYPSUM BOARD CEILING D2 11-7/8" TJI JOISTS AT 16" O.C. W/ 3/4" PLYWOOD SHEATHING AND 1/2" THICK GYPSUM BOARD CEILING D3 1HR RATED DECK: 2X JOISTS AT 16" O.C. W/ 1" NOMINAL WOOD SUB FLOOR AND 1" WOOD FINISH FLOOR AND 1/2" OR 5/8" SHEETROCK BRAND GYPSUM PANEL, FIRECODE C CORE R1 11-7/8" TJI JOISTS AT 16" O.C. W/ 1/2" PLYWOOD SHEATHING AND 1/2" THICK GYPSUM BOARD CEILING	1 EXISTING 2X JOISTS 2 NEW 2X JOISTS TO MATCH EXISTING 3 EXISTING HEADER OR BEAM 4 NEW 4ea 1 3/4" X 11'-1/8" LVLs 5 (3) 2X12 STAIR STRINGERS 6 CUT EXISTING JOISTS 7 NEW HEADER 8 (2) 2X10 AT 24" O.C.

"STRUCTURAL PLANS CERTIFIED AS PROVIDED IN SECTION 106.1.4.1 OF THE D.C. CONSTRUCTION CODE" [DCMR 106.1.4.1]

Project:

**WASHINGTON DC
TOWNHOUSE**

Seal:

Revision:

No. Date Description

Issue:

Date Description


Project Number:

Title:

**1ST FLOOR FRAMING PLAN
2ND FLOOR FRAMING PLAN
3RD FLOOR FRAMING PLAN
ROOF FRAMING PLAN**


Sheet:

S200

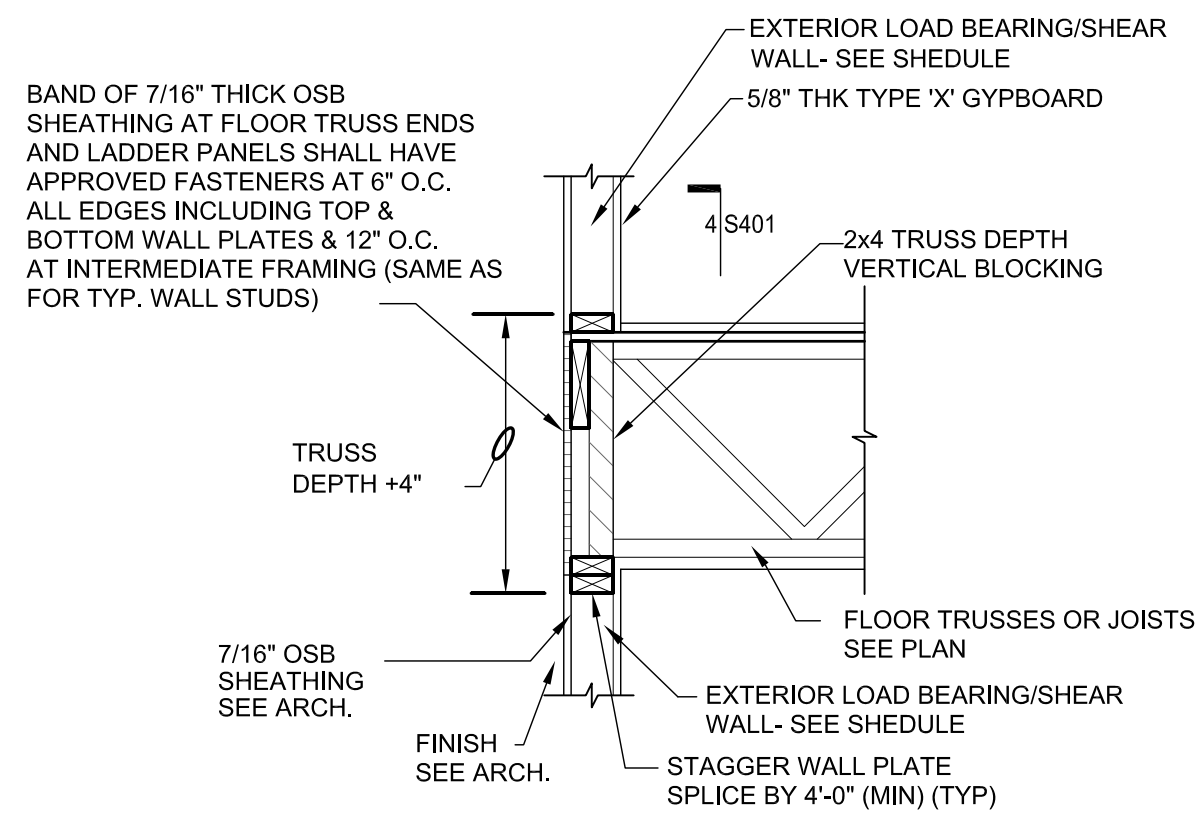


10 TYP. BLOCKING/SHEATHING @ EXTR. WALL (EXTERNAL WALL/FLOOR)

SCALE: 3/4" = 1'-0"

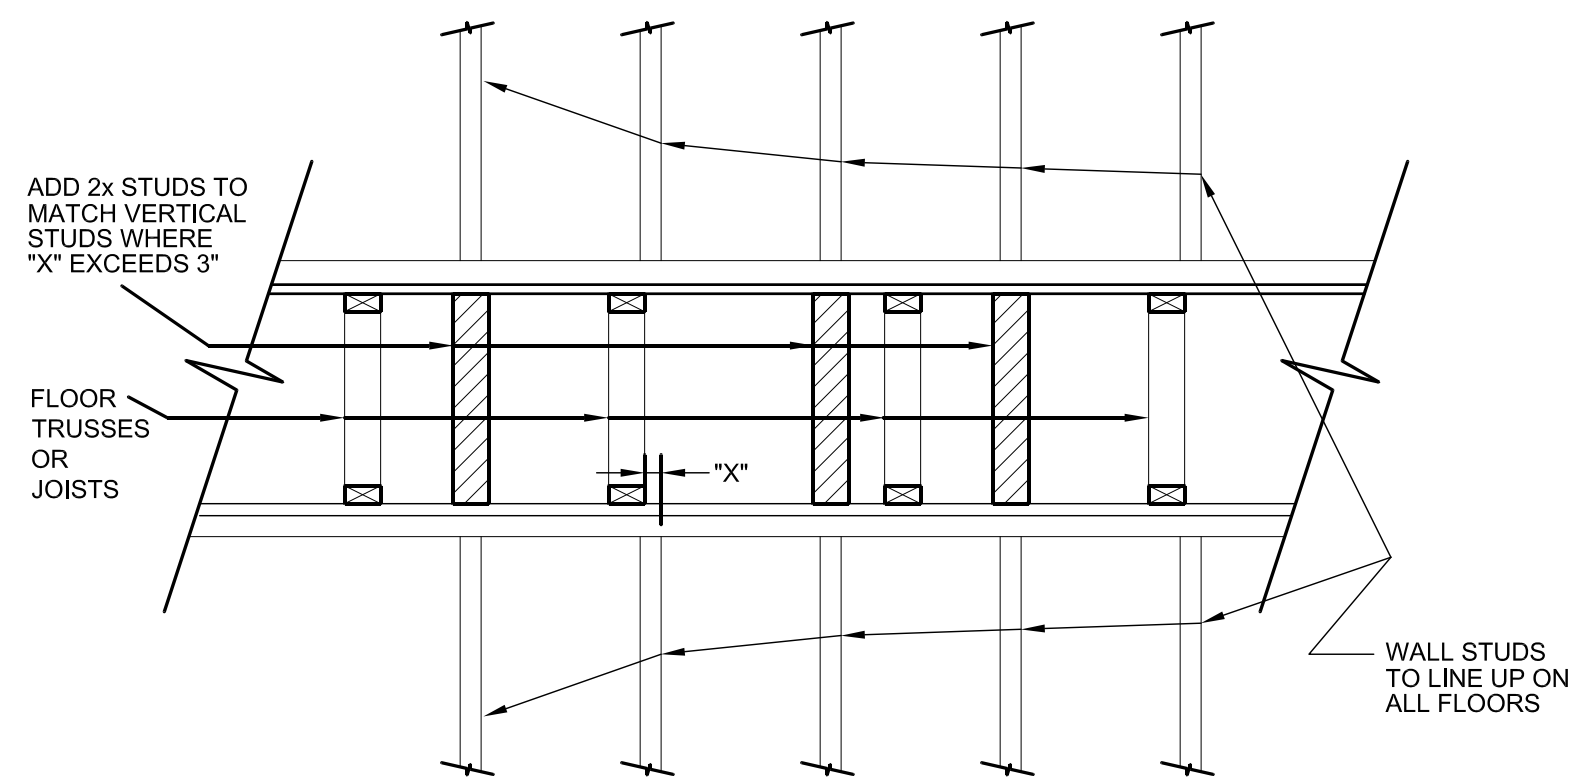


11 TYP. BLOCKING/SHEATHING @ EXTR. WALL

SCALE: 3/4" = 1'-0"

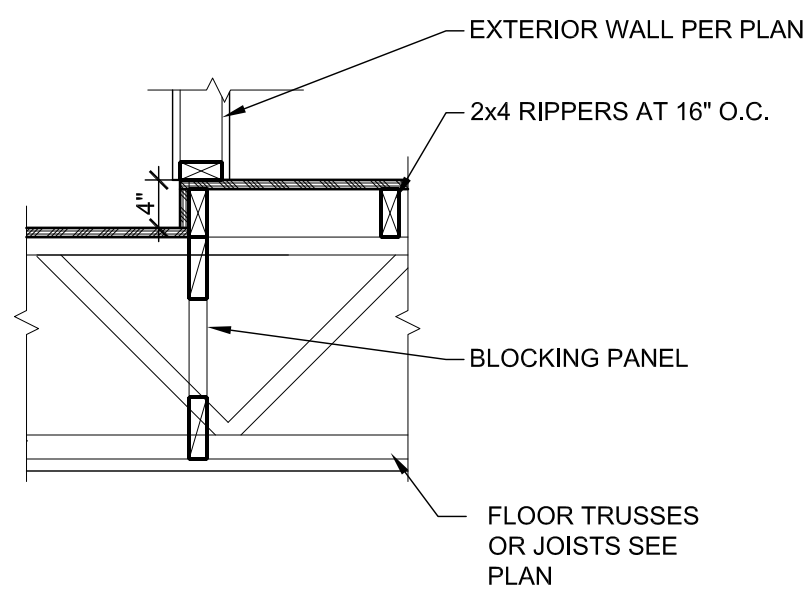


12 OVERFRAMING

SCALE: 3/4" = 1'-0"

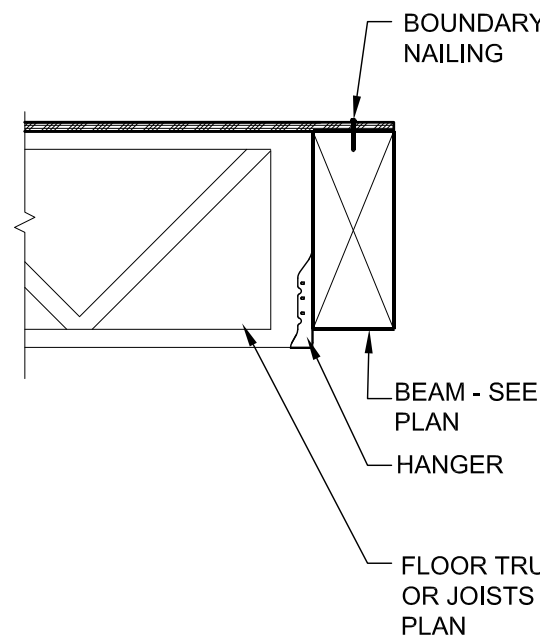


13 TRUSSES OR JOISTS @ BEAM

SCALE: 1" = 1'-0"

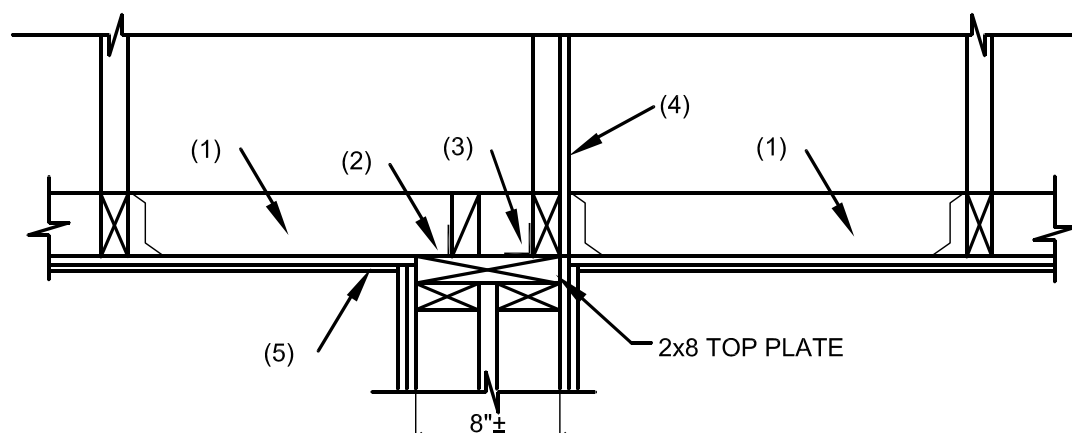

RT ALIGNED W/ WALL

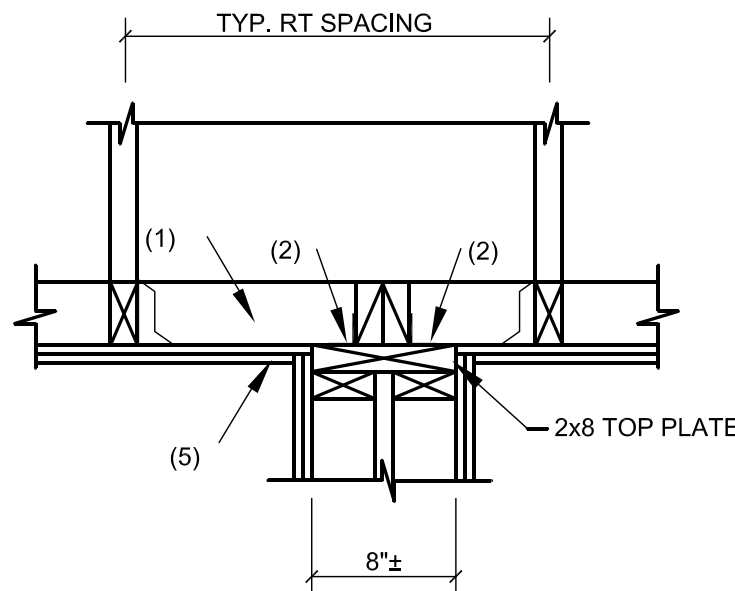


RT NOT ALIGNED W/ WALL

- NOTES:
- 2x4 BLOCKING AT 4'-0" O.C., WITH TYP. JOIST HANGERS EACH END
 - SIMPSON DTC TRUSS CLIPS AT 2'-0" O.C. (AT 2x4 BLOCKING, CUT TO FIT SNUG BETWEEN BLOCKING IN OPP. DIRECTION)
 - SIMPSON DTC TRUSS CLIPS AT 2'-0" O.C. AT TRUSS BOTTOM CHORD.
 - DRAFTSTOP WHERE INDICATED ON ARCHITECTURAL DRAWINGS, BUT NOT TO ENCLOSE MORE THAN TWO UNITS.
 - OBSERVE USG GUIDELINES FOR FASTENING GYPSUM BOARD AT CEILING.
 - NAILS MUST BE CENTERED AT VERTICAL SLOTS OF DTC TRUSS CLIPS.


7 TYPICAL ROOF TRUSS (RT) PARALLEL TO INTERIOR SHEAR WALL CONNECTION

SCALE: 3/4" = 1'-0"

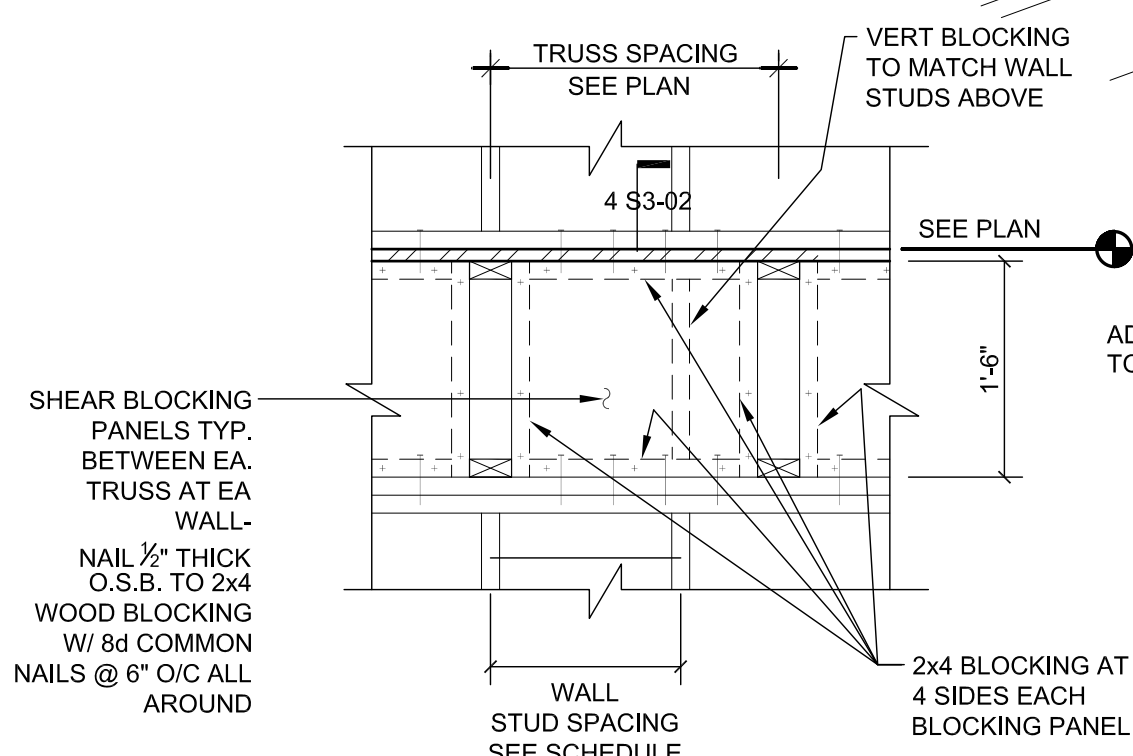


8 TYP. SHEAR BLOCKING PANELS

SCALE: 3/4" = 1'-0"

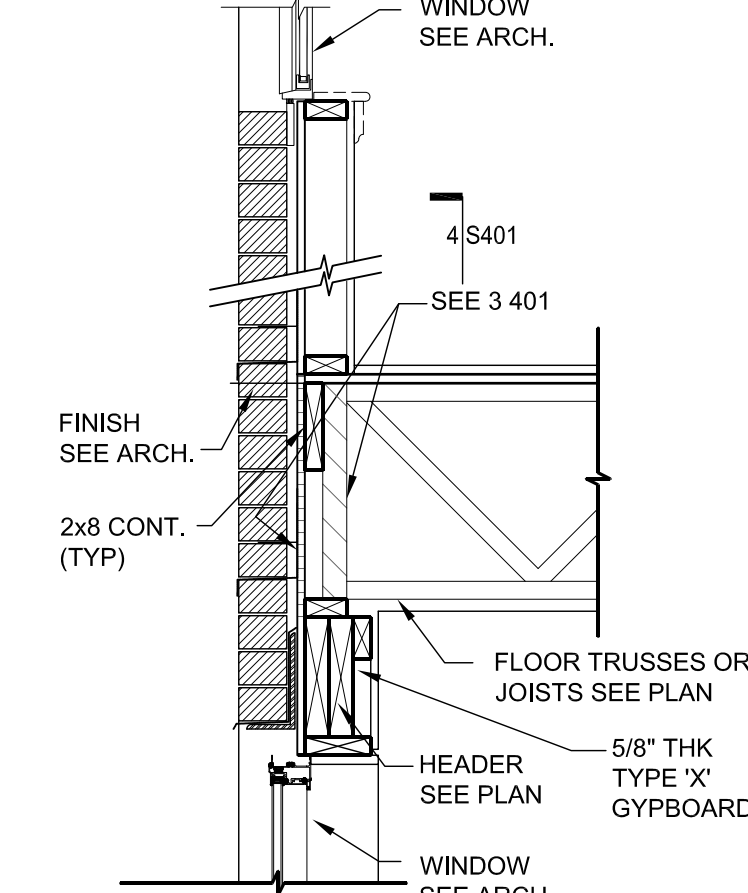


9 WINDOW SILL & HEADER DETAIL

SCALE: 3/4" = 1'-0"

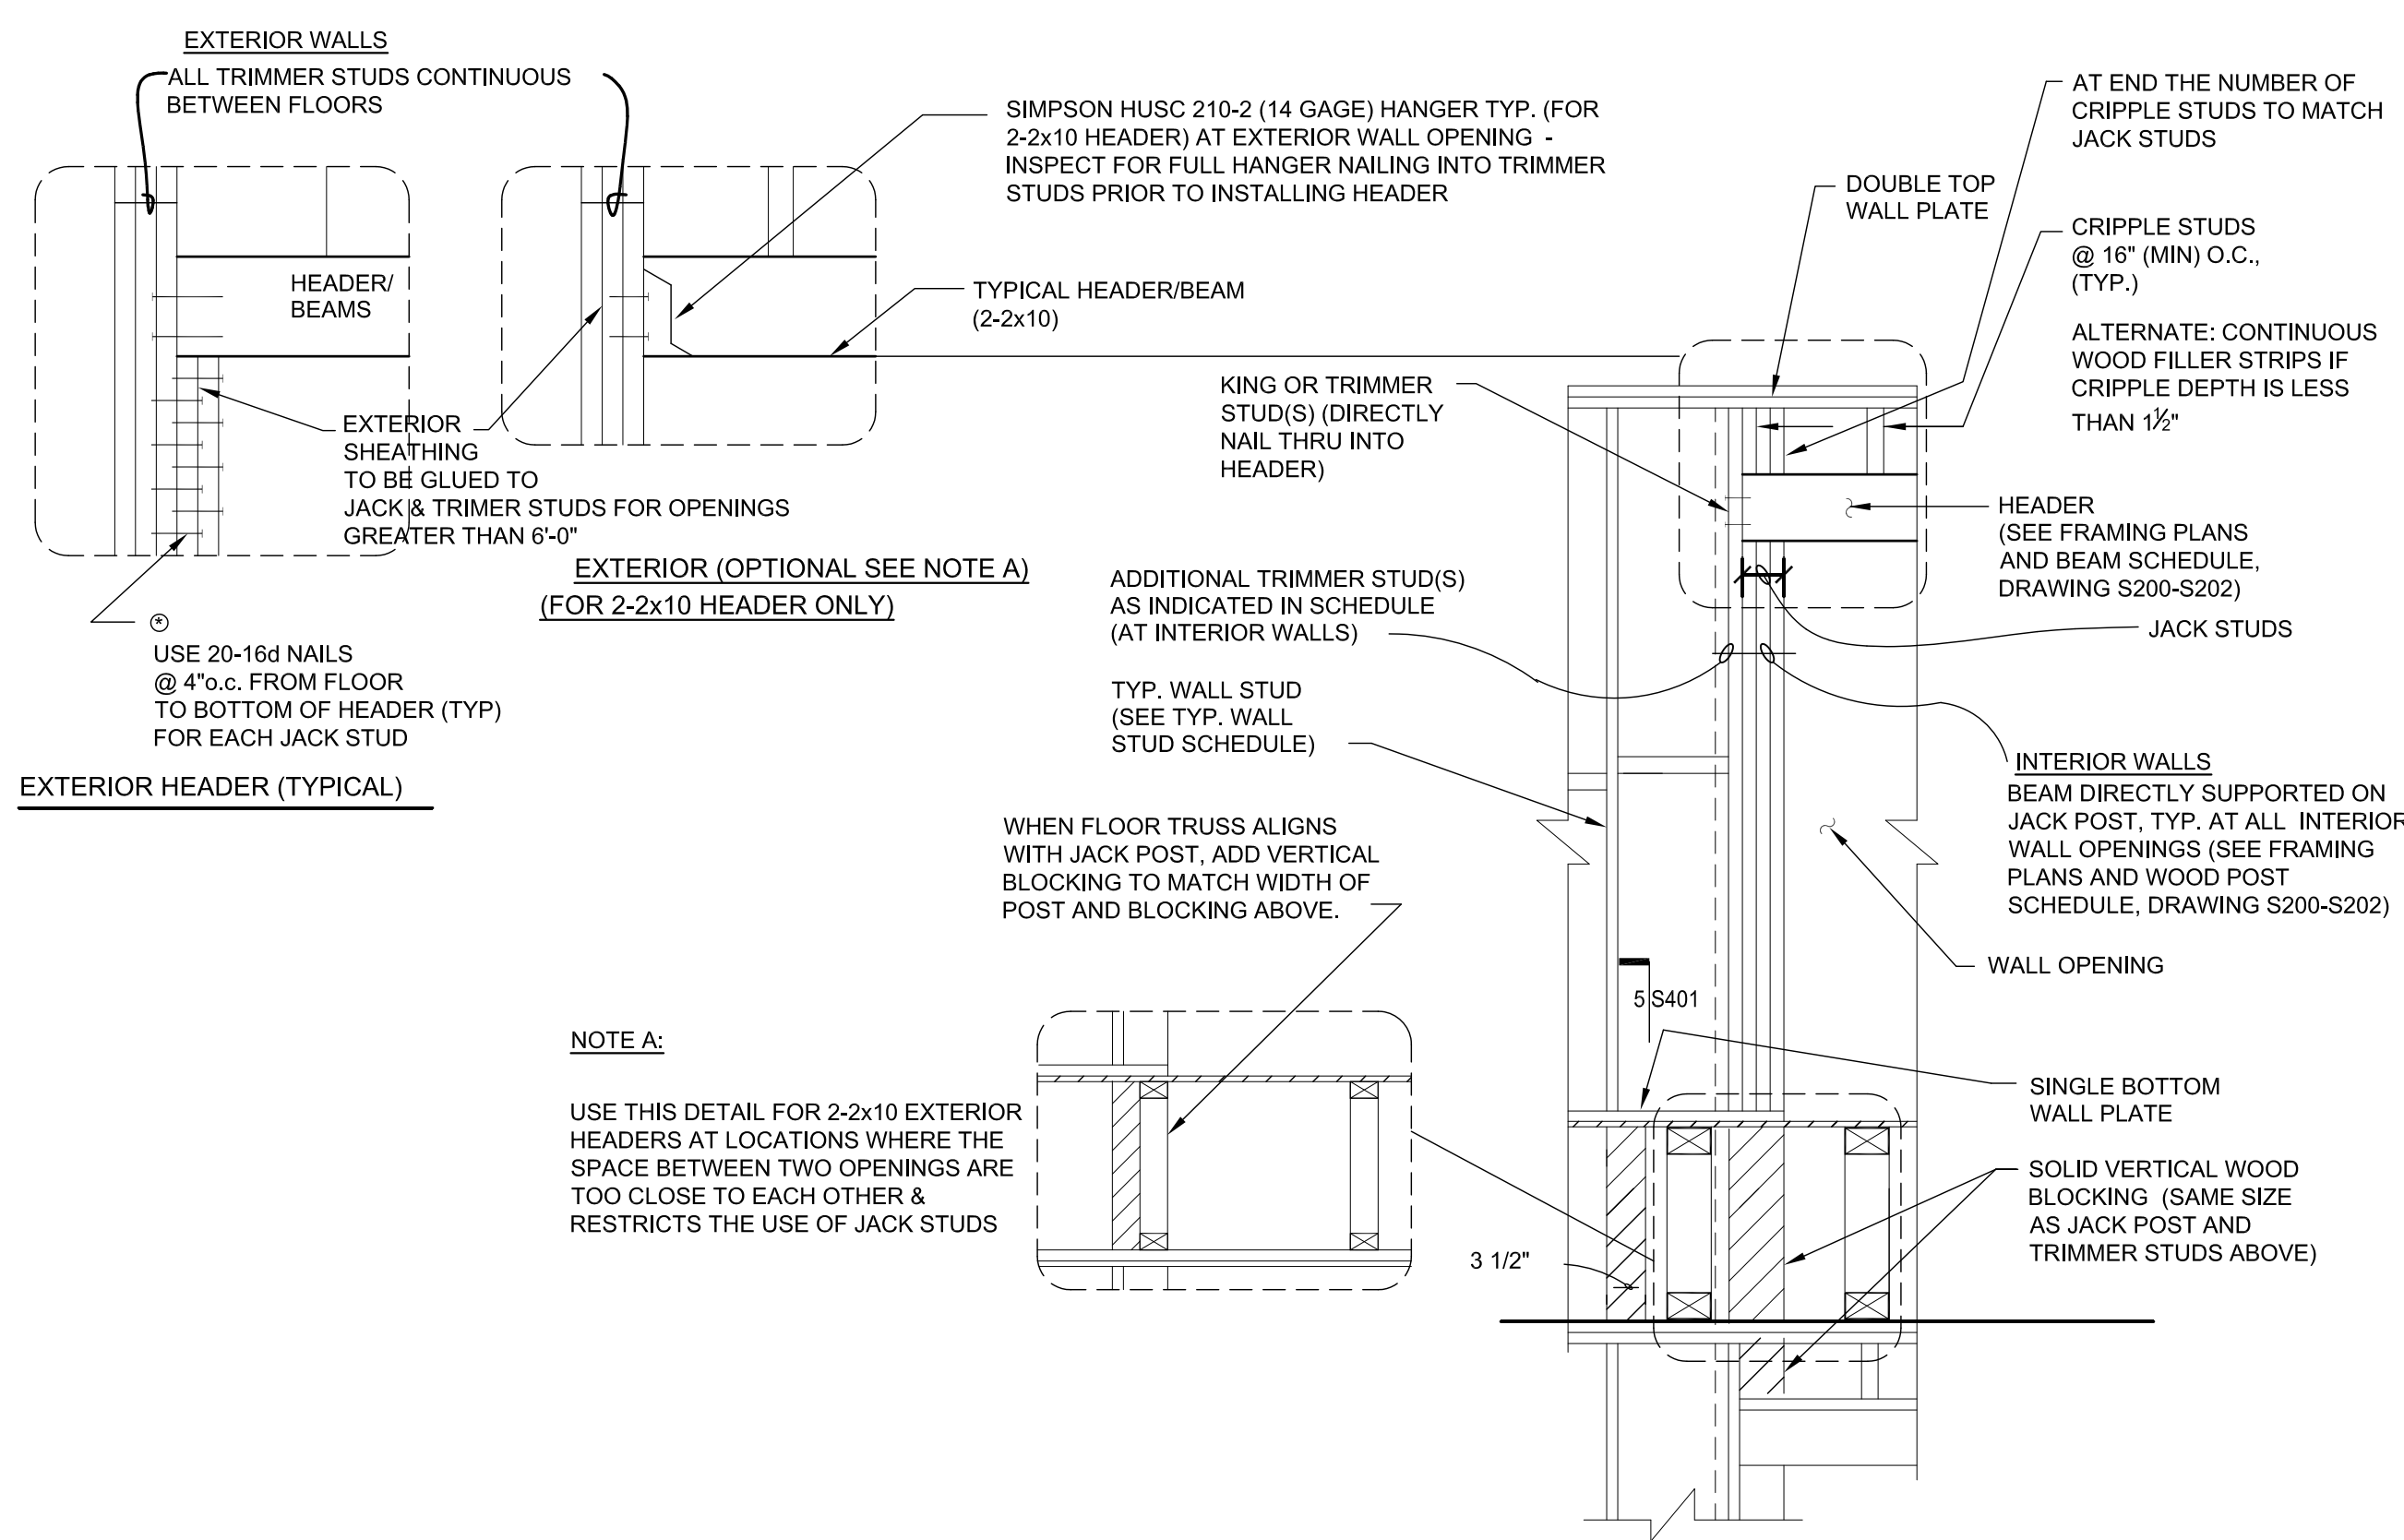


1 TYP. JACKPOST/BLOCKING

SCALE: 3/4" = 1'-0"

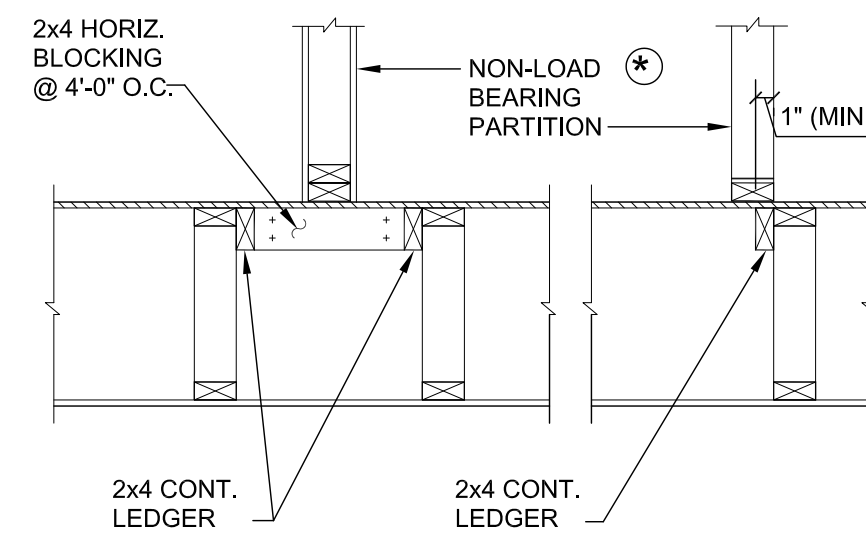


2 TYP. NON-LOAD BEARING PARTITION PARALLEL TO TRUSSES OR JOISTS

SCALE: 3/4" = 1'-0"

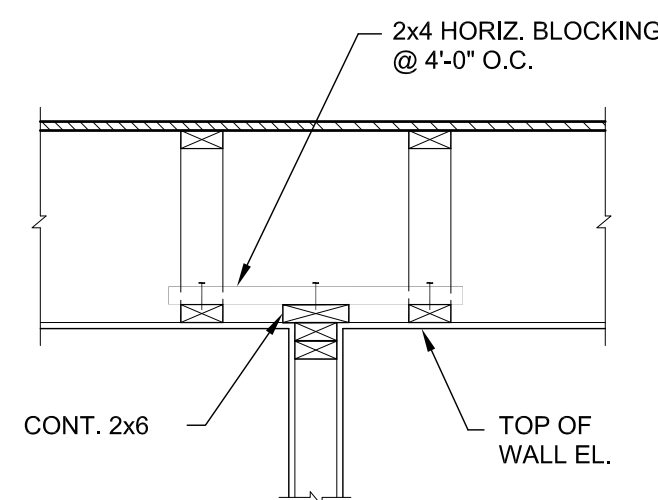


3 TYP. TOP OF WALL AT NON-LOAD BEARING PARTITION PARALLEL TO TRUSSES OR JOISTS

SCALE: 3/4" = 1'-0"

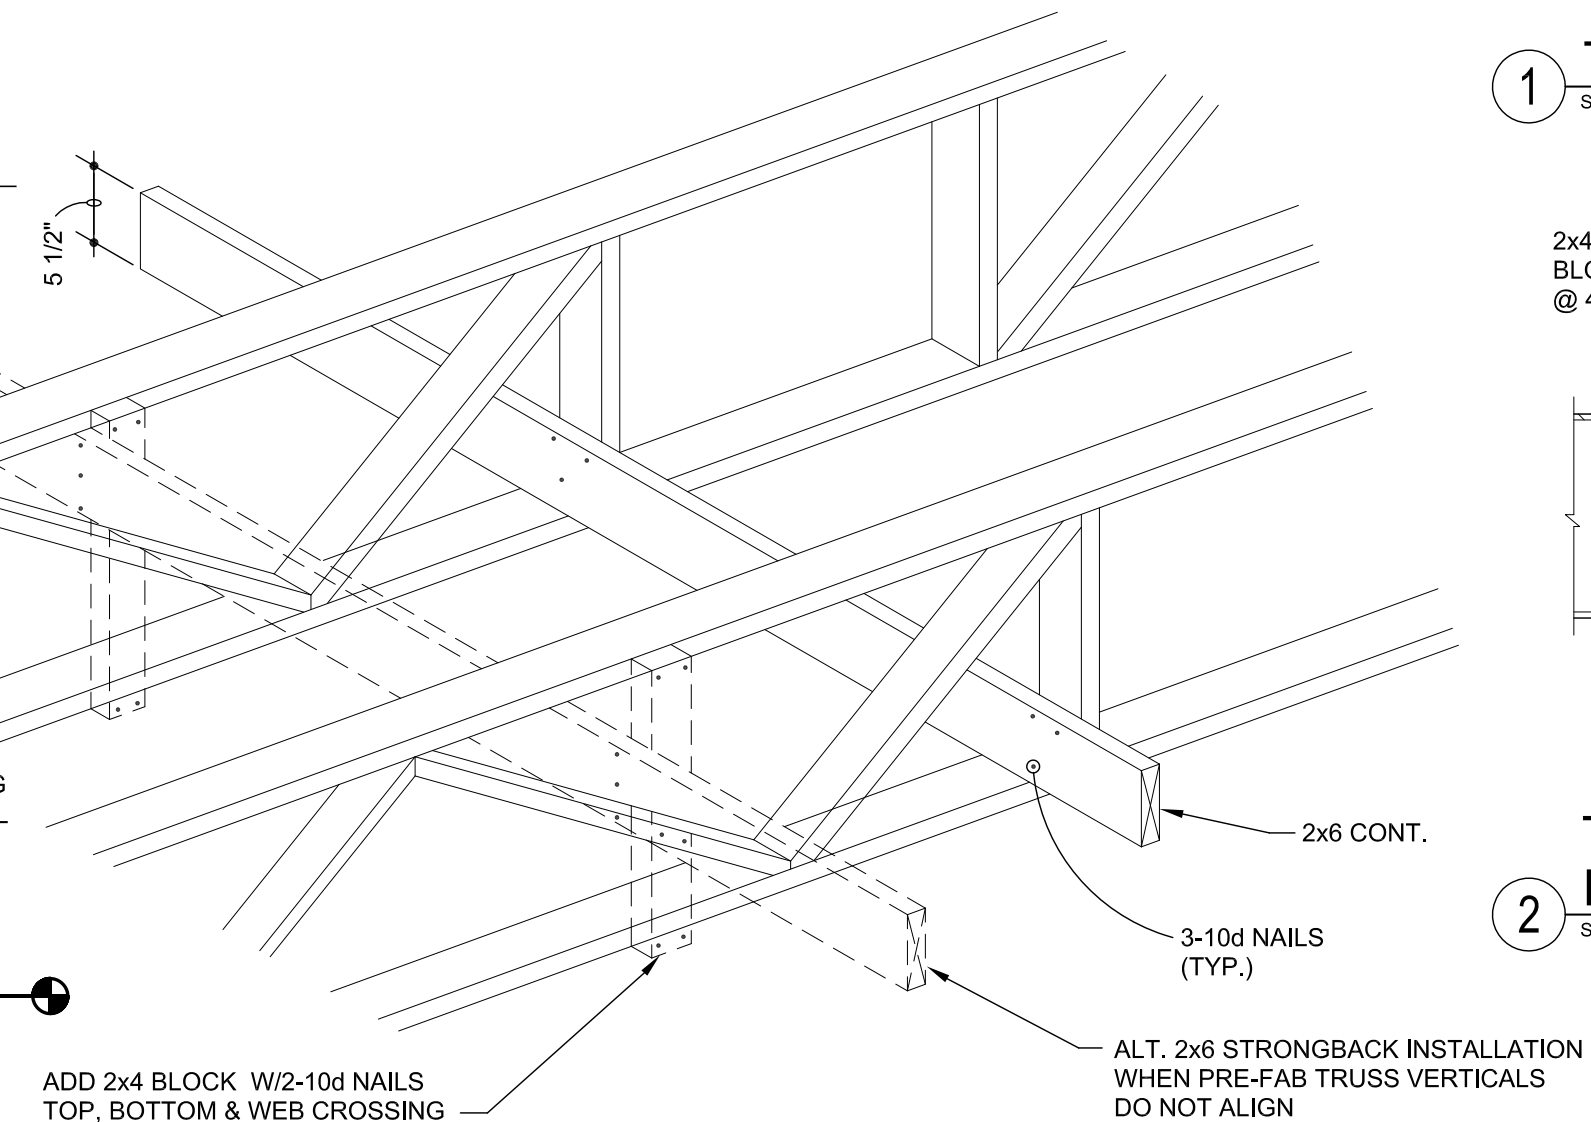


5 APPLICATION OF STRONGBACK (10'-0" O.C. MAX.)

SCALE: 3/4" = 1'-0"

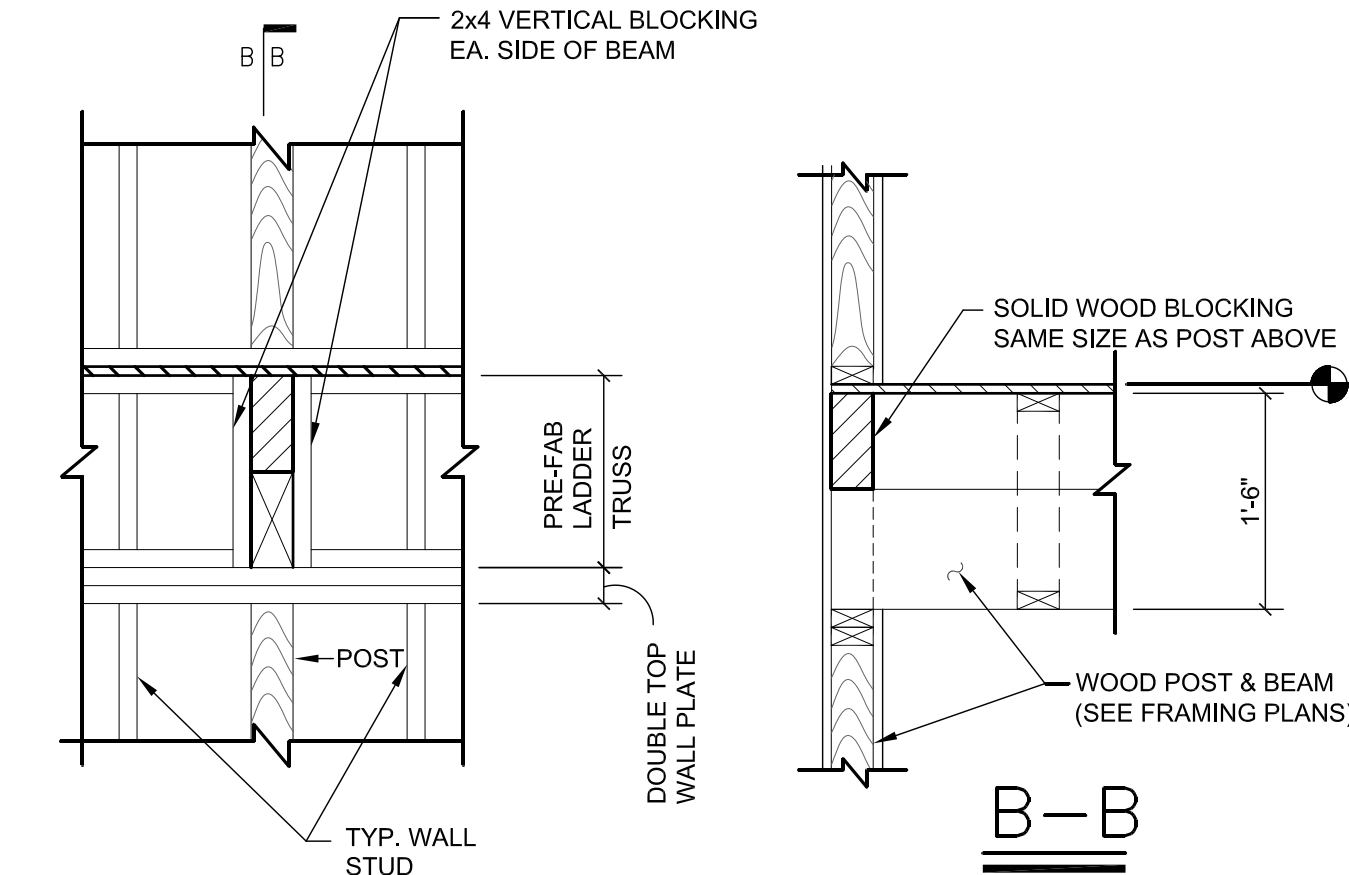

6 WOOD BEAM END POST SUPPORT AT PERPENDICULAR EXTERIOR WALL

SCALE: 3/4" = 1'-0"

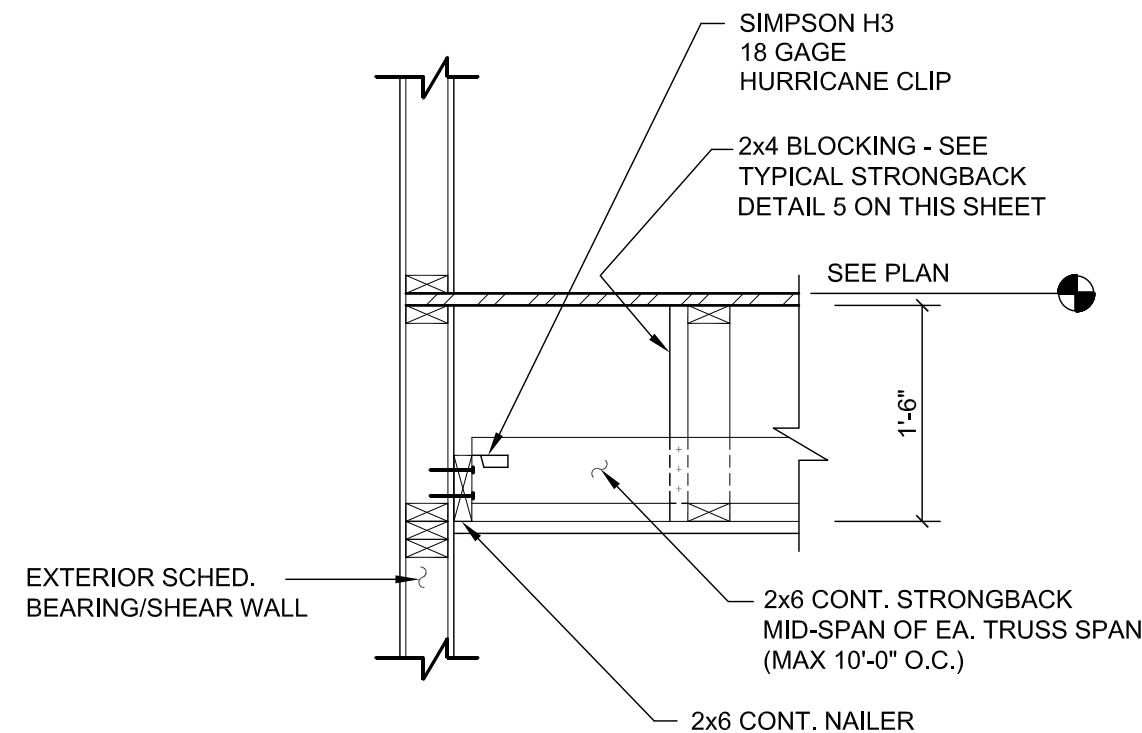

4 TYP. STRONGBACK END DETAIL

SCALE: 3/4" = 1'-0"

Project:

WASHINGTON DC TOWNHOUSE

Seal:

Revisions:

No. Date Description

Issue:

Date Description

Project Number:

Title:

FRAMING DETAILS

Sheet:

S300

REVIEW SET BID SET PERMIT SET CONSTRUCTION SET